eight associates

Eight Associates
5th Floor
57a Great Suffolk Street
London
SE1 0BB

+44 (0) 20 7043 0418

www.eightassociates.co.uk
info@eightassociates.co.uk

Planning Statement
Energy Assessment
Bourne Court

Document information:		
	Prepared for: HGH Consulting	**Date of current issue:** 01/02/2019 **Issue number: 3** **Our reference:** 3161-Energy Assessment-1902-01yp.docx
Assessment information:		
	Prepared by: Yiota Paraskeva **Signature:** Yiota Paraskeva	**Quality assured by:** Chris Hocknell **Signature:** *Chris Hocknell*

Disclaimer:

This report is made on behalf of Eight Associates. By receiving the report and acting on it, the client - or any third party relying on it - accepts that no individual is personally liable in contract, tort or breach of statutory duty (including negligence).

Contents:

Executive Summary 1
Introduction 4
Establishing Emissions: The Carbon Profile 5
'Be Lean': Demand Reduction Measures 6
'Be Clean': Heating Infrastructure & CHP 8
'Be Clean': Connection to Existing and Planned Networks 9
'Be Clean': Site Wide Networks and CHP 10
'Be Clean': Cooling 11
'Be Green': Renewable Energy 15
'Be Green': Summary of Renewable Technologies 22
'Be Green': Photovoltaic 23
Conclusion 25
Appendix 26

eight associates

Executive Summary
Energy Assessment
Bourne Court

About the Scheme:

The development comprises the construction of a residential scheme divided into two blocks with a total of 87 dwellings. The development is located in Ruislip, which is part of the London Borough of Hillingdon and has a total gross internal area of 7,494 m^2.

Planning Policy


In accordance with the Sustainable, Design and Construction SPG, the scheme is required to achieve a minimum of 35% carbon reduction target (beyond Part L 2013) as set out in The London Plan Policy 5.2, and should aspire to 'zero carbon' standard. The 35% target for London Plan compliance has been achieved.

The scheme complies with the 2013 Building Regulations Part L and the minimum energy efficiency targets in the following documents have been followed; new build (Part L1A) – The actual building CO_2 emissions rate (DER) are no greater than the notional building CO_2 target emissions rate.

National Planning Policy Framework sets broad sustainable development objectives and encourages the construction of new homes that are of a high quality. The scheme aims to fulfil this by adopting key energy efficiency principles and the incorporation of renewable energy generation.

The Energy Hierarchy:

The proposed scheme has followed the energy hierarchy that is illustrated below:

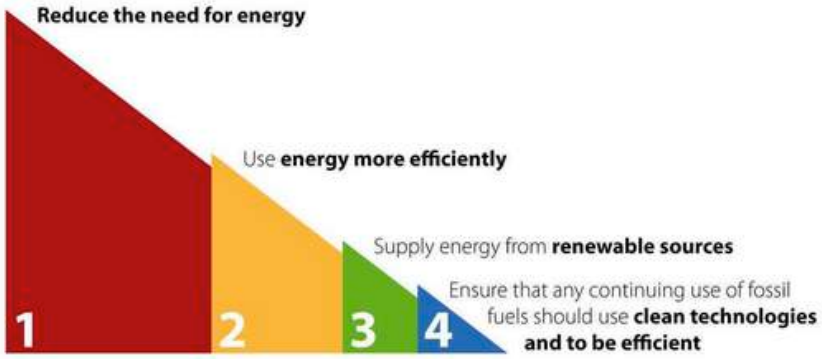

The resulting energy savings are shown below in accordance with the GLA's Energy Hierarchy:

GLA's Energy Hierarchy – Regulated Carbon Emissions				
	Baseline:	Be Lean:	Be Clean:	Be Green:
CO_2 emissions (Tonnes CO_2/yr)	104.24	99.19	-	59.08
CO_2 emissions saving (Tonnes CO_2/yr)	-	5.05	-	40.11
Saving from each stage (%)	-	4.8	-	38.5
Total CO_2 emissions saving (Tonnes CO_2/yr)	45.16			

43.3% Total carbon emissions savings over Part L of the Building Regulations 2013 achieved


eight associates

Executive Summary
Energy Assessment
Bourne Court

GLA's Energy Hierarchy – Regulated Carbon Emissions:

A graphical illustration of how the scheme performs in relation to Building Regulations and the Energy Hierarchy is shown below.

Figure:

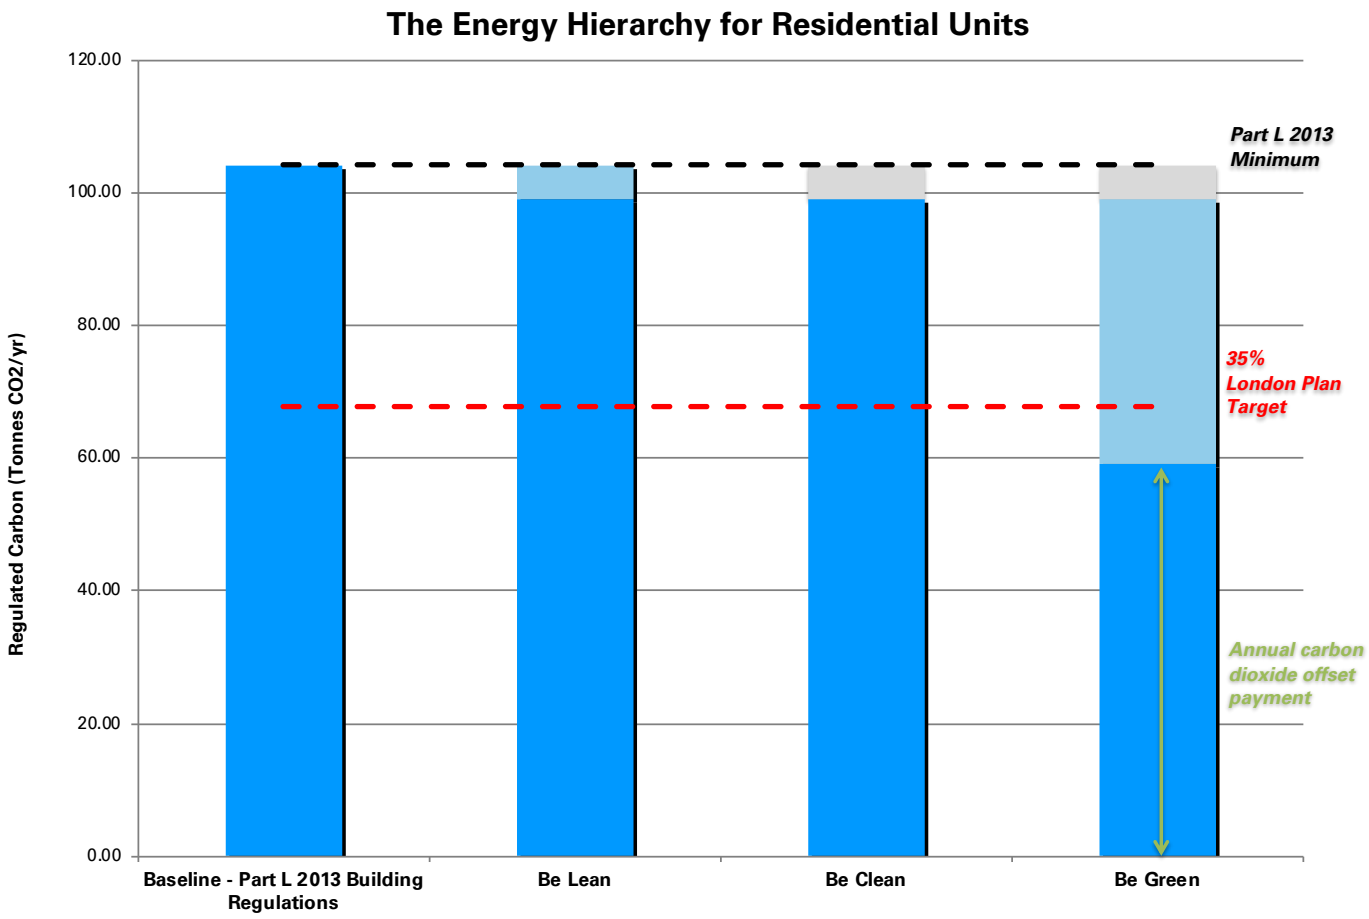

Summary:

As demonstrated above the development will reduce carbon emissions by 4.8% from the fabric energy efficiency measures described in the 'Be Lean' section, and will reduce total carbon emissions by 43.3% over Building Regulations with the further inclusion of low and zero carbon technologies (photovoltaic panels).

eight associates

Executive Summary
Energy Assessment
Bourne Court

Shortfall in Emissions:

As set out in Policy 5.2 of the London Plan, if the development fails to meet the 35% target, the annual shortfall is determined by subtracting the overall regulated carbon dioxide savings from the target savings. The result is then multiplied by the assumed lifetime of the development's services (e.g. 30 years) to give the cumulative shortfall. The cumulative shortfall is multiplied by the carbon dioxide offset price to determine the required cash-in-lieu contribution, as shown below.

Carbon Dioxide Emissions – Regulated (Tonnes CO_2/yr)		
	(Tonnes CO_2/yr)	%
Savings from 'Be Lean'-After energy demand reduction	5.05	4.8%
Savings from 'Be Clean'-After CHP	0.00	0.0%
Savings from 'Be Green'-After renewable energy	40.11	38.5%
Total Cumulative Savings	45.16	43.3%
Total Target Savings	36.48	35%
Annual Surplus (35%)	8.68	14.4%
Annual Shortfall (100% 'zero carbon')	59.08	56.7%
Carbon offset payment	£106,344 (59.08 x £1,800/tonne for 30 years)	

Total Carbon Emissions:

As required by the GLA both the regulated and unregulated emissions of the development must be quantified and demonstrated. The total emissions for the scheme are shown below.

Carbon Dioxide Emissions – Regulated and Unregulated (Tonnes CO_2/yr)			
	Regulated Emissions	Unregulated Emissions	Total Emissions
Baseline: Part L 2013	104.24	86.18	190.42
Be Lean: After demand reduction	99.19	86.18	185.37
Be Clean: After CHP	-	-	-
Be Green: After Renewable energy	59.08	86.18	145.26

eight associates

Introduction
Energy Assessment
Bourne Court

Aim of this study:

The purpose of an energy assessment is to demonstrate that climate change mitigation measures comply with London Plan energy policies, including the energy hierarchy. It also ensures energy remains an integral part of the development's design and evolution.

Methodology:

The methodology followed in this report follows the guidance set out by the Greater London Authority (GLA) for developing energy strategies as detailed in the document "ENERGY PLANNING: Greater London Authority guidance on preparing energy assessments (April 2015)"

Under the GLA's guidance applications for major developments should be accompanied by an energy statement. The energy statement should provide information demonstrating how the energy hierarchy has been followed i.e. 'Lean, Clean, Green', including consideration of passive design and decentralised energy options such CHP/Community CHP.

This report has followed these documents and comprises the following components:

- BASELINE: A calculation of the Part L 2013 Building Regulations complaint CO_2 emission baseline using approved software. The baseline assumes a gas boiler would provide heating and any active cooling would be electrically powered.
- LEAN: A calculation of the impact of demand reduction measures. For example, passive design measures, including optimising orientation and site layout, natural ventilation and lighting, thermal mass and solar shading, and active design measures such as high efficacy lighting and efficient mechanical ventilation with heat recovery.
- COOLING HIERARCHY: in accordance with Policy 5.9 of London Plan, measures that are proposed to reduce the demand for cooling have been set out such as minimisation of solar and internal gains and night cooling strategies.
- CLEAN: in accordance with Policy 5.6 of London Plan, this report has demonstrated how the scheme has selected heating, cooling and power systems to minimise carbon emissions. This comprises an evaluation of the feasibility of connecting to existing low carbon heat networks, planned networks, site-wide and communal heat networks and CHP.
- GREEN: in accordance with Policy 5.7 of London Plan, this report has conducted a feasibility assessment of renewable energy technologies. This comprised a site-specific analysis of the technologies and if applicable how they would be integrated into the heating and cooling strategy for the scheme.

Please note that these findings are currently subject to a detailed analysis from a building services design engineer and qualified quantity surveyor.

eight associates

Establishing Emissions: The Carbon Profile

Energy Assessment


Bourne Court

Building Regulations Part L 2013 Minimum Compliance:

The 'baseline' carbon emissions for the development are 104.24 Tonnes CO_2/yr.

The pie chart below provides a breakdown of the scheme's baseline carbon emissions by system over the course of one year.

Carbon Emissions in Tonnes CO_2/yr	Heating	Hot Water	Cooling	Auxiliary	Lighting
	46.38	41.06	0.00	3.39	13.41

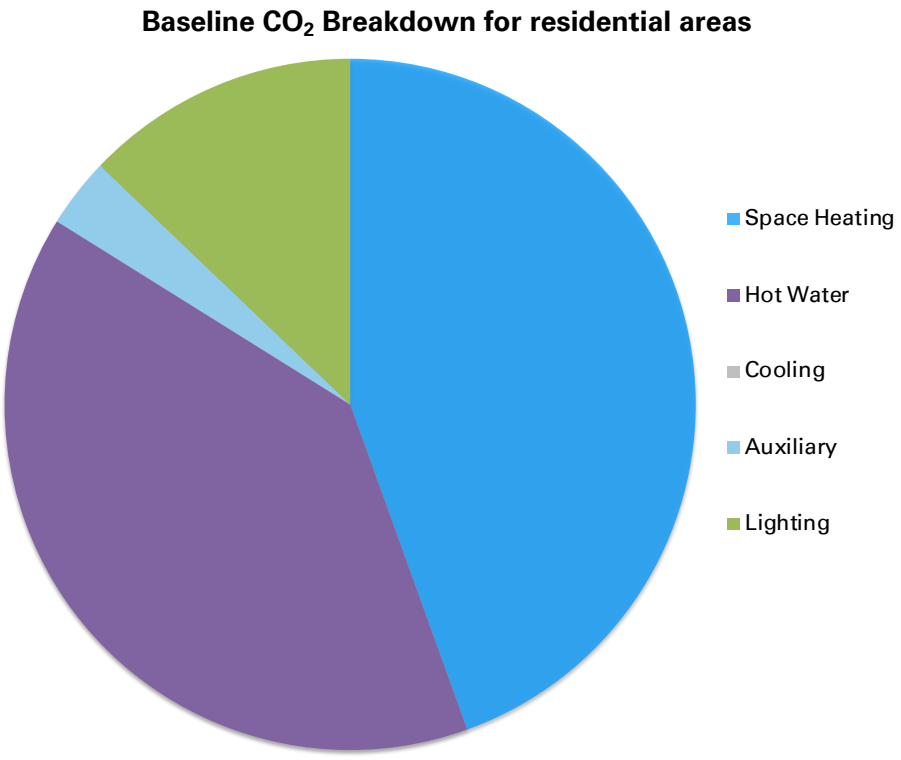

Overview:

The chart above shows that heating is the primary source of carbon emissions, and hot water is the second largest, across the scheme as a whole.

eight associates

‘Be Lean’: Demand Reduction Measures


Energy Assessment

Bourne Court

Be Lean - Summary:

Demand reduction measures have reduced the scheme’s carbon emissions by 4.8 % over the minimum Part L 2013 Building Regulations baseline.

Building Fabric Passive Design measures:

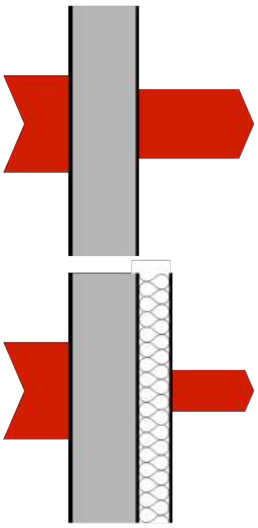

Graphic illustrations of the heat flow through a wall and how it is minimized with low u-value (consequence of the additional insulation).

U Values:

Element	Minimum Building Regulations U value W/m²K	Proposed U value W/m²K
External walls	0.30	0.16
Corridor walls	0.30	0.16
Party wall	0.20	0.00
Ground floor	0.25	0.12
Semi exposed floors	0.25	0.12
Flat roofs	0.20	0.12
Glazing (g-value of 0.55)	2.00	1.40
Doors	2.00	1.40

Airtightness:
The target air permeability for the scheme has been modelled as 4 $m^3/(hr.m^2)$ @ 50 pa.

This will require careful attention to two key areas:

- Structural leakage
- Services leakage

Structural leakage occurs at joints in the building fabric and around window and door openings, loft hatches and access openings. There will also be some diffusion through materials such and cracks in masonry walls typically caused by poor perpends in blockwork inner leafs. Structural leakage is hard to remedy retrospectively therefore good detailing at the design stage is essential.

Services leakage occurs at penetrations from pipes and cables entering the building. These can be sewerage pipes, water pipes and heating pipes. As well as electricity cables there may also be telecommunication cables. Attention therefore, needs to be paid to sealing all penetrations during construction.

Thermal Bridging:
The scheme has been indicatively modelled with the accredited thermal bridge Psi-values for the following junction types:

- E2 – Lintels
- E4 – Jambs
- E7 – Intermediate floor between dwellings
- E16 – Corners
- E17 – Corners inverted
- E9 – Balcony between dwellings, wall insulation continuous

This will result in an average Y value of 0.05 W/m²K for both houses that has to be achieved at design and as built stage.

Thermal Mass:
Thermal mass of the scheme has been indicatively modelled as 250 kJ/m²K (medium).


eight associates

‘Be Lean’: Demand Reduction Measures

Energy Assessment

Bourne Court

Energy Efficient Services Active Design measures:

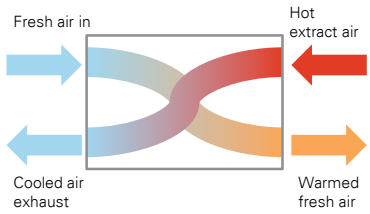

Graphic illustration of a heat recovery unit, which exploits the extract hot air of the room to heat the cold supply air.

Heating:
Heating will be provided by a gas boiler, featuring time and temperature zone control, delayed thermostat and a weather compensator. The heat will be distributed via underfloor heating with pipes in screed above insulation. The gas boiler will have a minimum efficiency of 89.5.

Ventilation:
Balanced mechanical ventilation with heat recovery (80% efficiency) will be provided to dwellings and wet rooms with a specific fan power of 0.66 W/l/s.

Air Conditioning:
No cooling system has been specified for the dwellings. Natural ventilation through openable windows will be used as a passive cooling measure.

Lighting:
High efficiency lighting has been specified for the development.

eight associates


‘Be Clean’: Heating Infrastructure & CHP Energy Assessment Bourne Court

Heating Infrastructure including CHP:

Once demand for energy has been minimised, schemes must demonstrate how their energy systems have been selected in accordance with the order of preference in Policy 5.6B of London Plan. This has involved a systematic appraisal of the potential to connect to existing or planned heating networks and on site communal and CHP systems.

Heating Infrastructure:

The London Heat Map (shown below) has been consulted to establish the possibility of connecting to heating infrastructure.

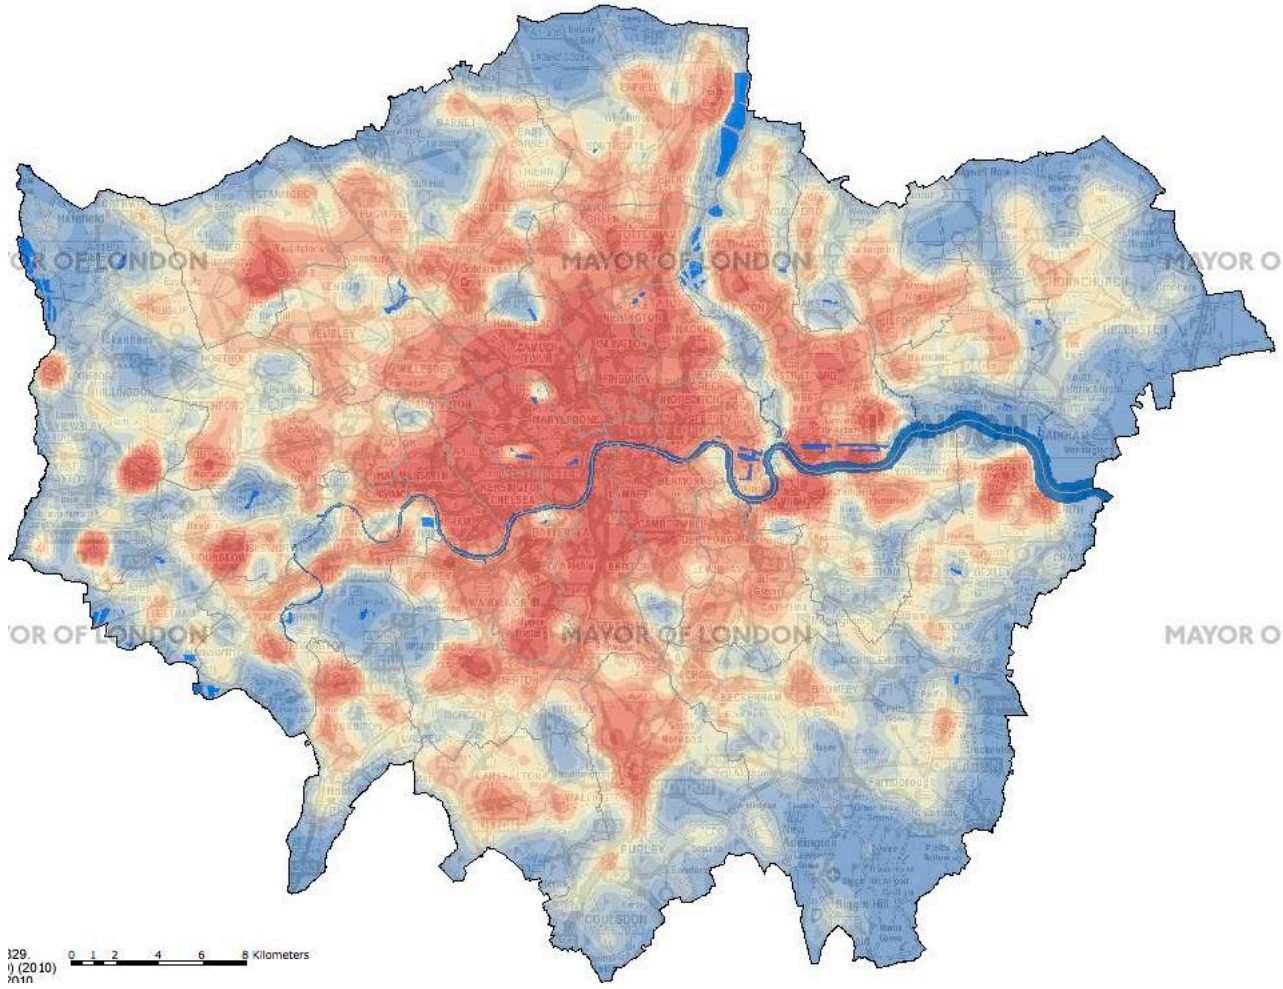

Source: http://www.londonheatmap.org.uk/Mapping

eight associates

‘Be Clean’: Connection to Existing and Planned Networks


Energy Assessment

Bourne Court

Existing and Planned Networks:

Existing networks:

A review of the London Heat Map demonstrates that there are no existing networks present within connectable range of the scheme. A map of the existing and potential networks in the scheme’s location is shown below.

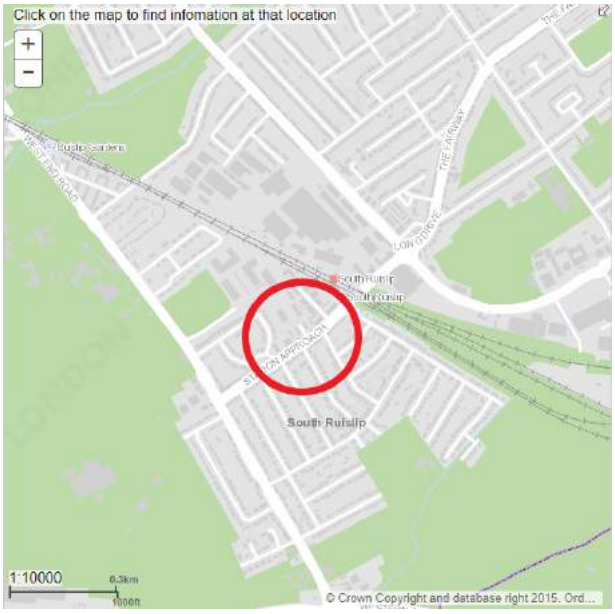

Existing DH Networks

Potential DH Networks

There are no existing or potential networks within the vicinity of the scheme, therefore a connection is not possible.

eight associates

‘Be Clean’: Site Wide Networks and CHP

Energy Assessment

Bourne Court

Site-wide Heat Networks:	In accordance with section 8.2 of the GLA guidance for Energy Planning, where it is demonstrable that a site wide network is not feasible then an individual heating strategy can be implemented. A site wide network will not be adopted because the dwellings on site will not have adequate density and local conditions are not favourable to centralised distribution. Therefore, it is considered that distribution losses would be relatively large and the effectiveness and carbon reducing potential would be undermined when compared to an individual servicing strategy.
Combined Heat and Power (CHP)	In accordance with section 8.3 of the GLA guidance for Energy Planning where connection to an area wide heat network will not be available in the foreseeable future i.e. 5 years following completion, or the development is of such a scale that it could be the catalyst for an area wide heat network, applicants should evaluate the feasibility of on-site CHP GLA guidance stipulates that small, or purely residential developments of less than 350 dwellings will not be expected to include on-site CHP. CHP systems are best utilised where there is a consistent and high demand for heat. Because of the small electricity supplies and demand of this scheme, a CHP installed to meet the base heat load would typically require the export of electricity to the grid. The administrative burden of managing CHP electricity sales at a small scale without an active energy service companies (ESCOs) is prohibitive for smaller operators of residential developments. The heat demand profile of this residential scheme is not suitable to CHP. The implemented fabric improvements from the ‘Be Lean’ scenario have also reduced the energy demand from space heating to hot water. For CHP systems to be economically viable they need to run for at least 5,000 hours per year. Therefore, a CHP system would most likely be oversized, and as a result less efficient and economic.

eight associates

‘Be Clean’: Cooling
Energy Assessment
Bourne Court

Policy 5.9 Overheating and Cooling:

The aim of this policy is to reduce the impact of the urban heat island effect in London and encourage the design of spaces to avoid overheating and excessive heat generation, and to mitigate overheating due to the impact of climate change.

Where design measures and the use of natural and/or mechanical ventilation are not enough to guarantee the occupant’s comfort, in line with the cooling hierarchy the development’s cooling strategy must include details of the active cooling plant being proposed, including efficiencies, and the ability to take advantage of free cooling and/or renewable cooling sources.


Where appropriate, the cooling strategy should investigate the opportunities to improve cooling efficiencies through the use of locally available sources such as ground cooling and river/dock water-cooling.

The Cooling Hierarchy:

Major developments should reduce potential overheating and reliance on air conditioning systems and demonstrate this with the Cooling Hierarchy:

1) **Minimise internal heat generation through energy efficient design**
2) **Reduce the amount of heat entering the building in summer (e.g. shading and fenestration)**
3) **Manage the heat within the building through thermal mass, room height and green roofs**
4) **Passive ventilation**
5) **Mechanical ventilation**
6) **Active cooling systems (ensuring the lowest carbon option)**

Avoiding Overheating Measures taken:



LED bulbs can emit 80% less heat compared to an incandescent bulb and their life span is up to 41 times more.

The following measures have been taken in accordance with the cooling hierarchy to reduce overheating and the need for cooling:

1) **Minimise internal heat generation through energy efficient design**


Internal heat gains have been minimised where possible. Energy Efficient appliances will help reduce internal heat gain and reduce the cooling requirement.

Energy efficient lighting will also be specified (>75 lumens per circuit watt). LED lighting will be specified and a power lighting density figure of 9W/m^2 will be targeted. Occupancy sensors will also be specified to reduce unnecessary lighting usage.


eight associates

‘Be Clean’: Cooling
Energy Assessment
Bourne Court

Avoiding Overheating Measures taken:

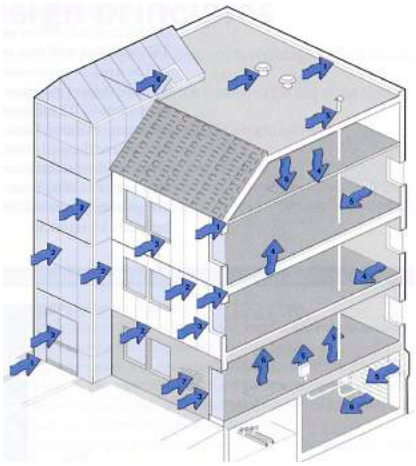

Examples of possible air leakage points in a building

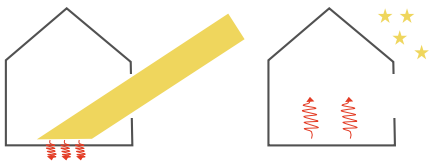

Examples of how the thermal mass absorbs heat during day and emits it during night.

2) Reduce the amount of heat entering the building in summer (e.g. shading and fenestration)

Direct solar gains will be controlled in the following ways:

- Orientation of building – the scheme has been orientated NE/SW to reduce excessive solar gain and openable windows have been specified to facilitate natural ventilation.
- Solar control – all methods controlling solar gain to within tolerable limits have been considered. The location, size, design and type of window openings and glazing have been optimised, and reduced solar gain factors from low emissivity windows with a g-value of 0.55 have been specified.
- Dark-coloured curtain/roller blinds will be specified to limit solar gain. The shading has also been optimised to avoid substantially reducing daylighting or increasing the requirement for electric lighting.

Heat transfer and infiltration has been controlled in the following ways:

- Insulation levels have been maximised and the resulting U-values are lower than required by Building Regulations. The build-ups therefore prevent the penetration of heat as much as practically possible. See the ‘Be Lean’ section of this report for target u values.
- A reduced air permeability rate of 4 $m^3/(hr.m^2)$ @ 50 pa has been targeted to minimise uncontrolled air infiltration. This will require attention to detailing and sealing. See ‘Be Lean’ section of this report for details of how this will be achieved.

3) Manage the heat within the building through thermal mass, room height and green roofs.

The following measures have been specified to manage heat accumulation within the building:

- High thermal mass – exposed building fabric materials such as masonry or concrete have been utilised in the form of concrete floors and dense masonry external walls. These materials act as ‘thermal batteries’; they absorb heat gains during the day when the building is occupied and ‘store’ it for an extended period, thereby helping to stabilise daytime temperatures. At night this heat can be dissipated, which ‘resets’ the heating cycle. Ventilation will also be used at night to purge the stored heat within the structure. A ‘ground coupled’ system that uses the thermal storage capacity of the ground has not been specified as the passive ventilation option has been selected instead.

‘Be Clean’: Cooling
Energy Assessment
Bourne Court


Avoiding Overheating Measures taken:

- Room heights – high ceilings are traditionally used in hot climates to allow thermal stratification so that occupants can inhabit the lower cooler space, and to decrease the transfer of heat gain through the roof. The existing building has floor to ceiling heights of approximately 2.6m. As the roof will be well insulated to achieve a U-value of 0.12 W/m^{2}K, there will be minimal penetration of heat through the roof.

- Green roofs –A green roof has been considered to be unpractical by the design team. Consequently, a roof covering with a high albedo (reflective) surface has been specified in order to minimise the heat absorbed by the roof, and significant thermal insulation has been specified to prevent any heat absorbed being transferred into the building.

4) Passive ventilation

Ventilation that does not use fans or mechanical system has been specified to reduce the cooling load.

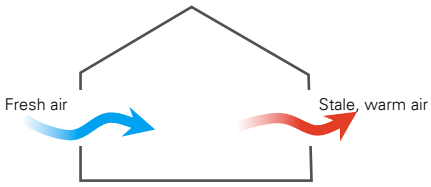

Typical building section demonstrating passive cross ventilation.


- Openable windows are specified on all facades of the building. Cross ventilation will be achieved by opening windows on two facades and ensuring there is a clear path for airflow. Side fins will also provide positive pressure on one side and negative on the other, this will enhance ventilation flow.

- Night time cooling will also be utilised. This will work in tandem with high thermal mass materials specified. The larger temperature differential that exists between internal and external temperatures at night will allow effective stack ventilation and purging of heat accumulated within the structure during the day.

eight associates

‘Be Clean’: Cooling
Energy Assessment
Bourne Court

Avoiding Overheating Measures taken:



Typical building section demonstrating a simple method of supply and extract ventilation system.

5) Mechanical ventilation

Passive ventilation will not be adequate to cool the building to the required temperature. Mechanical ventilation will be utilised in the following forms:

- Fan powered ventilation: single point extracts will be used in. A whole building system will be specified with separate supply and extract fans. Heat recovery units will also be specified to reduce energy demand, optimal performance will be achieved by the reduced air permeability rate of 3 $m^3/(hr.m^2)$ @ 50 pa.

- The mechanical systems will have the following efficiencies which are in compliance with the Domestic Building Services Compliance Guide:
  - ✓ Specific fan power of 0.5 W/l/s for extract fans
  - ✓ Specific fan power of 1.5 W/l/s for whole ventilation systems with heat recovery
  - ✓ Heat recovery efficiency of 70%

Overheating Risk:

According to the GLA guidance on preparing energy assessments (April 2015), Section 11, a dynamic modelling to assess the risk of overheating should be carried out. However, due to the overheating results of SAP showing that there is no significant risk of overheating, it has been considered that a dynamic modelling is not required.

eight associates

‘Be Green’: Renewable Energy

Energy Assessment

Bourne Court

Renewable Energy Feasibility:

In line with Policy 5.7 of the London Plan the feasibility of renewable energy technologies has been considered. A detailed site-specific analysis and associated carbon saving calculations has also been provided for renewable energy technologies considered feasible.

Renewable Energy Technology Comparison:

Each technology has been assessed under 5 broader categories. There are key criteria for each category on which the technology is evaluated. The key criteria have been given a weighting based on a tick-system, a graphical representation of this is shown below:

✓✓✓✓✓ = 1 scored out of a possible 5

The weighting of each of the criteria within the categories is shown below:

- **Local, site-specific impact:** (Maximum score of 4)
  - Local planning criteria = ✓✓
  - Land used by all components = ✓
  - Noise impact from operation = ✓
- **Suitability and design impact:** (Maximum score of 4)
  - Interaction on the current building design = ✓✓
  - Building orientation suitability = ✓
  - Buildability of installation = ✓
- **Economic viability:** (Maximum score of 5)
  - Capital cost of all components = ✓✓
  - Grants and funding available = ✓
  - Payback periods (years) 3-5, 5-10, 10-15 = ✓✓✓
- **Operation and maintenance:** (Maximum score of 3)
  - Servicing requirements (low or high) = ✓
  - Maintenance costs (low or high) = ✓
  - Resource use from future maintenance (low or high) = ✓
- **CO_2 and sustainability:** (Maximum score of 10)
  - Carbon saving per year = ✓✓✓✓
  - Impact of future grid decarbonisation (gas vs. electric) = ✓✓
  - Local air quality/pollution = ✓✓
  - Resource use of installation = ✓✓

Key comments on each of the criteria and the corresponding score will be provided in a table (example below) for each of the technologies. The score for each of the criteria will be summed and each of the technologies will then be ranked. The assessment of each technology is undertaken on the following pages.

Renewable Technology	Local, site-specific impact	Suitability and design impact	Economic viability	Operation and maintenance	CO_2 and sustainability
	✓✓✓✓	✓✓✓✓	✓✓✓✓✓	✓✓✓	✓✓✓✓✓ ✓✓✓✓✓

eight associates

‘Be Green’: Renewable Energy

Energy Assessment

Bourne Court

Biomass & Biofuel:

Rejected



Biomass is normally considered a carbon ‘neutral’ fuel, as the carbon dioxide emitted on burning has been recently absorbed from the atmosphere by photosynthesis. Although some form of fossil fuel derived inputs are required in the production and transportation of the fuel.

Wood is seen as a by-product of other industries and the small quantity of energy for drying, sawing, pelleting and delivery are typically discounted. Biomass from coppicing is likely to have external energy inputs from fertiliser, cutting, drying etc. and these may need to be considered. In this toolkit, all biomass fuels are considered to have zero net carbon emissions.

Biomass can be burnt directly to provide heat in buildings. Wood from forests, urban tree pruning, farmed coppices or farm and factory waste, is the most common fuel and is used commercially in the form of wood chips or pellets. Biomass boilers can also be designed to burn smokeless to comply with the Clean Air Acts.

Boilers can be fed automatically by screw drives from fuel hoppers. This typically involves daily addition of bagged fuels.

A biomass boiler could be installed on site for supplementary LTHW heating; however, a major factor influencing the suitability of a biomass boiler is the availability of the biomass fuel. A local and reliable fuel source would be essential for the biomass boiler to be an efficient replacement for a conventional boiler system. Therefore, a very comprehensive feasibility assessment needs to be undertaken to understand the practicalities of such a system.

It is estimated that the heating and hot water demand of the site is too small to meet the required CO_2 emissions reduction if a biomass boiler was a standalone system. Therefore a biomass boiler would need to be combined with energy demand reduction measures and/or CHP. In order to meet the 35% CO_2 emissions reduction a 1,000kW biomass boiler would need to be installed. The likely installed cost would be circa £250,000. The additional cost of providing and storing the bio-fuel also needs to be accounted for. The site is likely to be unsuitable for biomass boilers due to site constraints such as limited transport/access issues, and storage of the biomass fuel. A detailed feasibility study will be required to investigate the suitability.

Renewable Technology	Local, site-specific impact	Suitability and design impact	Economic viability	Operation and maintenance	CO_2 and sustainability
Biomass Boiler	✓✓✓✓ Local air quality impacts, increased transport usage on the restricted site, increased plant space.	✓✓✓✓ Increase in plant space required, orientation fine, slightly increased buildability issues.	✓✓✓✓✓ Increased capital costs of installation, typical payback of 8 years	✓✓✓ Increased maintenance relative to gas boiler, resource use not significantly increased if well serviced.	✓✓✓✓✓ ✓✓✓✓✓ Very low carbon intensity of feedstock if properly procured. Decarbonisation impact not applicable, air quality issues.

eight associates

‘Be Green’: Renewable Energy

Energy Assessment

Bourne Court

Photovoltaic (PV):

Accepted



Photovoltaic systems convert energy from the sun into electricity through semi conductor cells. Systems consist of semi-conductor cells connected together and mounted into modules. Modules are connected to an inverter to turn the direct current (DC) output into alternating current (AC) electricity for use in buildings.

Photovoltaic systems can be discreet through being designed as an integral part of the roof. An ‘invisible’ design using slates or shingles as opposed to an architectural statement could be preferable in a sensitive area.

Photovoltaic panels supply electricity to the building and are attached to electricity gird or to any other electrical load. Excess electricity can be sold to the National Grid when the generated power exceeds the local need. PV systems require only daylight, not sunlight to generate electricity (although more electricity is produced with more sunlight), so energy can still be produced in overcast or cloudy conditions.

The cost of PV cells is heavily dependent on the size of the array. There are significant cost reductions available for larger installations.

The most suitable location for mounting photovoltaic panels is on roofs as they usually have the greatest exposure to the sun. The proposed site has a potential useable roof area of approximately 720 m^2.

Renewable Technology	Local, site-specific impact	Suitability and design impact	Economic viability	Operation and maintenance	CO_2 and sustainability
Photovoltaic	✓✓✓✓ No local air quality impacts, use of unutilised roof space, conservation officer has concerns for part of the site, no noise issues.	✓✓✓✓ Can be added to the roof, good orientation, and slightly increased buildability issues for wiring and metering.	✓✓✓✓✓ Increased capital costs of installation, typical payback of 8 years, Feed in Tariff available.	✓✓✓ Limited servicing and maintenance i.e. 1 visit per year, inverter will require replacement.	✓✓✓✓✓ ✓✓✓✓✓ High carbon saving from electricity, uses minimal grid electricity, no local air impact, high embodied energy of panels.

eight associates

‘Be Green’: Renewable Energy

Energy Assessment

Bourne Court

Solar Thermal:

Rejected



Solar water heating systems use the energy from the sun to heat water for domestic hot water needs. The systems use a heat collector, generally mounted on the roof in which a fluid is heated by the sun. This fluid is used to heat up water that is stored in either a separate hot water cylinder or a twin coil hot water cylinder inside the building. The systems work very successfully in all parts of the UK, as they can work in diffuse light conditions.

Like photovoltaic panels the most suitable location for mounting solar hot water panels is on roofs as they usually have the greatest exposure to the sun. The proposed site has a potential useable roof area of approximately 720 m^2.

It is estimated that the CO_2 emissions reduction that would be produced by solar hot water as a standalone system would not be adequate to achieve the required CO_2 emissions reduction target. Therefore a solar hot water system would need to be combined with more energy efficiency strategies, a CHP or additional renewable technologies to achieve the carbon reduction target.

Renewable Technology	Local, site-specific impact	Suitability and design impact	Economic viability	Operation and maintenance	CO_2 and sustainability
Solar Thermal	✓✓✓✓ No local air quality impacts, use of unutilised roof space, conservation officer has concerns for part of the site, no noise issues.	✓✓✓✓ Can be added to the roof, good orientation, and slightly increased buildability issues for piping and cylinders.	✓✓✓✓✓ Increased capital costs of installation, typical payback of 8 years, Renewable Heat Incentive available.	✓✓✓ Limited servicing and maintenance i.e. 1 visit every two years, heat transfer fluid requires replacing every 10 years.	✓✓✓✓✓ ✓✓✓✓✓ Lower carbon saving as primarily displacing gas, uses minimal grid electricity, no local air impact, medium embodied energy of panels.

eight associates

‘Be Green’: Renewable Energy

Energy Assessment

Bourne Court

Wind Energy:

Rejected



Wind energy is a cost effective method of renewable power generation. Wind turbines can produce electricity without carbon dioxide emissions in ranges from watts to megawatt outputs. The most common design is for three blades mounted on a horizontal axis, which is free to rotate into the wind on a tall tower.

The blades drive a generator either directly or via a gearbox to produce electricity. The electricity can either be linked to the grid or charge batteries. An inverter is required to convert the electricity from direct current (DC) to alternating current (AC) for feeding into the grid.

Modern quiet wind turbines are becoming viable in low density areas where ease of maintenance and immediate connection to the grid or direct use of the electricity in a building, may make them cost effective, despite lower wind speeds than open areas.

Wind turbines are generally less suited to dense urban areas as their output will be affected by potentially lower and more disrupted wind speeds, and their use of much more cost effective machines may be prohibited by their proximity to some building types. Small turbines can be used in inner city areas mounted on buildings, although there are relatively few installations.

Typically a 1.5 kW turbine can provide 4,000 kWh of electrical power annually. To achieve the required CO_2 emissions reduction target approximately 20 turbines would be required as a standalone solution. The indicative cost of a smaller roof mounted turbine is £2,000/kW so achieving the required CO_2 emissions reduction would cost approximately £60,000.

A detailed wind resource evaluation would be required for the site to fully understand the generation potential and payback period. Also, it is likely that planning restrictions and resistance from small groups within the local community could also affect the viability of wind energy for the project.

Renewable Technology	Local, site-specific impact	Suitability and design impact	Economic viability	Operation and maintenance	CO_2 and sustainability
Wind Energy	✓✓✓✓ No local air quality impacts, use of unutilised roof space, conservation officer will have concerns for the site, minor noise issues.	✓✓✓✓ Can be added to the roof, relatively limited wind speeds in local area, increased buildability issues for wiring and metering.	✓✓✓✓✓ Medium capital costs of installation, typical payback < 5 years, Feed in Tariff available.	✓✓✓ Very limited servicing and maintenance, costs of 2-3% typical.	✓✓✓✓✓ ✓✓✓✓✓ High carbon saving from electricity, output limited from urban installation, consumes little grid electricity, no local air impact, low embodied energy of panels.

eight associates


‘Be Green’: Renewable Energy

Energy Assessment

Bourne Court

Ground Source Heat Pump (GSHP):

Rejected

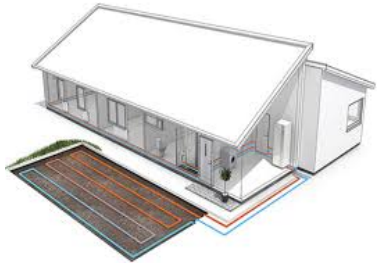

Geo-thermal energy is essentially heat collected from the ground. Heat obtained from the ground may be considered it as a source of heating and cooling within the UK by the use of a geo-thermal heat pump or ground source heat pumps.

A ground source heat pump is a device for converting energy in the form of low level heat to heat at a usable temperature. The heat pump consists of five main parts; ground collector loop/or bores, heat exchanger, compressor, condenser heat exchanger and expansion valve.

At approximately 1.2-1.5 metres down below ground level the temperature is a constant 10 to 12ºC. Any bores would need to be sunk to an effective depth of 50 – 120m and a ground feasibility report would be required to ascertain if this method of heat source was viable.

From the bores pre-insulated pipework is laid in the ground to the heat exchanger device. The system is filled with water and antifreeze. The cooled water is pumped around the loop / bore gathering energy as it circulates. The water that has been heated to 10-12ºC is returned to the ground source heat exchanger where the energy is transferred to the refrigerant gas. For every 1kW of energy used to compress the refrigerant, the process ‘gives up’ 4 kW of energy for use in the system being used to heat the building.

Typical costs for an installation this are in the region of £300-500,000 for a large size installation, with general installation costs at £1200 /kW of energy produced.

Renewable Technology	Local, site-specific impact	Suitability and design impact	Economic viability	Operation and maintenance	CO_2 and sustainability
GSHP	✓✓✓✓ No local air quality impacts, not visible so conservation friendly, no noise issues, however the constrained site may prohibit its installation.	✓✓✓✓ Increased buildability issues for pipework and heating emitters internally.	✓✓✓✓✓ High capital costs of installation, typical payback of 15 years where gas is displaced, Renewable Heat Incentive available.	✓✓✓ Limited servicing and maintenance i.e. 1 visit per year, mechanical parts may require replacement over lifespan.	✓✓✓✓✓ ✓✓✓✓✓ Limited carbon saving from gas displacement, consumes some electricity so benefits from decarbonisation, no local air impact, high embodied energy of equipment.

eight associates


‘Be Green’: Renewable Energy

Energy Assessment

Bourne Court

Air Source Heat Pump (ASHP):

Rejected

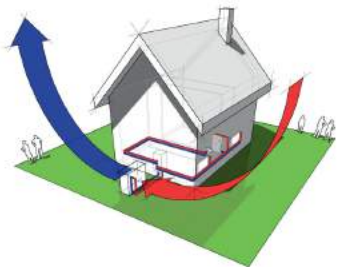

Air source heat pump systems work on the same principle as a ground source heat pump although they use the outside air as the heat source.

The coefficients of performance given by air source heat pump systems are inferior to that of ground source systems due to varying air temperatures. In the depth of winter the energy efficiency of an air source system will be lower than that of a ground source system, and it is likely that more back-up heat will be required if an air source unit is fitted. This back-up heat often comes from a direct electric heater. They operate over a varying temperatures range of -15°C to +25°C, however, the performance will reduce to below the required 3 to 1 carbon saving ratio in winter, and the also require a defrosting mechanism to melt ice that forms on the air heat exchanger.

ASHPs are cheaper to install than ground source heat pumps but are only available on a relatively small scale. If applied across a larger site a number of plant zones would be required for generation of heat, leading to increased plant space requirements. Typical costs for an installation this are in the region of £150-200,000 for a large size installation.

Carbon dioxide emissions savings will typically be less than that of the ground source heat pump. Air source heat pumps may be more suitable as an HVAC solution.

Renewable Technology	Local, site-specific impact	Suitability and design impact	Economic viability	Operation and maintenance	CO_2 and sustainability
ASHP	✓✓✓✓ No local air quality impacts, use of unutilised roof space, conservation officer may have minor concerns over visual impact, no noise issues.	✓✓✓✓ Can be added to the roof, good air-flow on roof, increased buildability issues for pipework and heating emitters internally.	✓✓✓✓✓ Medium- high capital costs of installation, typical payback >15 years where gas is displaced, Renewable Heat Incentive available.	✓✓✓ Limited servicing and maintenance i.e. 1 visit per year, mechanical parts may require replacement over lifespan.	✓✓✓✓✓ ✓✓✓✓✓ Limited carbon saving from gas displacement, less efficient in winter, consumes electricity so benefits from decarbonisation, no local air impact, high embodied energy of equipment.

eight associates

‘Be Green’: Summary of Renewable Technologies

Energy Assessment

Bourne Court

Summary Comparison Matrix:

An assessment of the feasibility of each of the technologies is shown below.

Renewable Technology	Local, site-specific impact	Suitability and design impact	Economic viability	Operation and maintenance	CO_2 and sustainability	Total Score
Biomass Boiler	✓✓✓✓	✓✓✓✓	✓✓✓✓✓	✓✓✓	✓✓✓✓✓ ✓✓✓✓✓	15 out of 26
Photovoltaic	✓✓✓✓	✓✓✓✓	✓✓✓✓✓	✓✓✓	✓✓✓✓✓ ✓✓✓✓✓	17 out of 26
Solar Thermal	✓✓✓✓	✓✓✓✓	✓✓✓✓✓	✓✓✓	✓✓✓✓✓ ✓✓✓✓✓	16 out of 26
Wind Energy	✓✓✓✓	✓✓✓✓	✓✓✓✓✓	✓✓✓	✓✓✓✓✓ ✓✓✓✓✓	17 out of 26
GSHP	✓✓✓✓	✓✓✓✓	✓✓✓✓✓	✓✓✓	✓✓✓✓✓ ✓✓✓✓✓	15 out of 26
ASHP	✓✓✓✓	✓✓✓✓	✓✓✓✓✓	✓✓✓	✓✓✓✓✓ ✓✓✓✓✓	16 out of 26

Renewable Technology Conclusion & Specification:

Photovoltaic panels and wind energy have scored the best. It is assumed that wind energy would be considered unsuitable for the area by conservation criteria and that the local residents would raise concerns over potential noise and turbulence. A ground source heat pump is the most suitable option for providing space heating, although it would need to be supplemented by a gas boiler to achieve the required output. This makes a GSHP economically less attractive and extends the payback period. Therefore, photovoltaic panels have been considered to be the optimum balance of sustainable and economic objectives.

eight associates

‘Be Green’: Photovoltaic Energy Assessment Bourne Court

Summary:

A photovoltaic panel system of 102 kWp has been specified for the development and detailed summary of the lifecycle cost, revenue and payback for the photovoltaic panels is presented in this section.

Location:

The following drawing shows that there is approximately 720 m^2 of available roof that could be used to install photovoltaic modules and lack of shading. A total of 308 PV panels of 330W each will be installed oriented southeast with 0° tilt, covering 525m^2 of the roof (excluding access paths).



eight associates

‘Be Green’: Photovoltaic Energy Assessment Bourne Court

Lifecycle Cost:

The lifecycle of the proposed high efficiency panels is 25 years. To calculate the lifecycle cost of the panels, the maintenance of the system and replacement cost will be included.

The total costs for the proposed system’s lifetime is:

- Capital Cost = £150,000
- Maintenance Cost = £20,000
- Operation Cost = £30,000 (replacement inverters etc.)
- Total Costs = £200,000

Revenue and Payback Parameters:

- The cost of electricity to be displaced is 14p/kWh.
- The 102 kWp system is estimated to generate 77,279kWh/yr. Based on the assumption that 50% of the electricity will be used on site, an offset saving of £5,410/yr will be achieved.
- With the current Feed in Tariff, a tariff of 4.00p/kWh will be received for generation, and 4.32p/kWh will be received for export, which gives an additional saving of £4,760.

Summary Performance Calculations:

The following tables summarise the reduction in carbon emissions and the life cycle cost of the photovoltaic system.

Energy and Carbon Performance Criteria	Value
Predicted Annual Energy Saved (kWh/yr)	77,279
Annual Carbon Emissions Reductions (kg CO_2/year)	40,107
CO_2 Emissions Reduction (%)	38.5

Cost Performance Criteria	Value
Total Cost Over Life Cycle (£)	200,000
Predicted Annual Savings (£)	10,170
Payback Period (yeas)	19.7

eight associates

Conclusion
Energy Assessment
Bourne Court

Summary

The baseline carbon emissions for the scheme are 1044.24 Tonnes CO_2/yr.

As demonstrated, the development will reduce carbon emissions by 4.8% from the fabric energy efficiency measures described in the "Be Lean" section, and will reduce total carbon emissions by 43.3% over Building Regulations with the further inclusion of low and zero carbon technologies (photovoltaic panels).

In accordance with the Sustainable, Design and Construction SPG, the scheme is required to achieve a minimum of 35% carbon reduction target (beyond Part L 2013) as set out in The London Plan Policy 5.2, and should aspire to 'zero carbon' standard. The 35% target for London Plan compliance has been achieved.

The scheme complies with the 2013 Building Regulations Part L and the minimum energy efficiency targets in the following documents have been followed; new build (Part L1A) – The actual building CO_2 emissions rate (DER) are no greater than the notional building CO_2 target emissions rate.

National Planning Policy Framework sets broad sustainable development objectives and encourages the construction of new homes that are of a high quality. The scheme aims to fulfil this by adopting key energy efficiency principles and the incorporation of renewable energy generation.

GLA's Energy Hierarchy – Regulated Carbon Emissions				
	Baseline:	Be Lean:	Be Clean:	Be Green:
CO_2 emissions (Tonnes CO_2/yr)	104.24	99.19	-	59.08
CO_2 emissions saving (Tonnes CO_2/yr)	-	5.05	-	40.11
Saving from each stage (%)	-	4.8	-	38.5
Total CO_2 emissions saving (Tonnes CO_2/yr)	45.16			
43.3% Total carbon emissions savings over Part L of the Building Regulations 2013 achieved				

eight associates

Appendix
Energy Assessment
Bourne Court

Further Information:	As required by the GLA, the emission figures and details of the calculations and methodology used to determine the figures provided within the report can be found in the following pages: Baseline –TER from the Lean SAP TER Worksheets Lean – DER from the Lean SAP DER Worksheets Green – DER from the Green SAP DER Worksheets

eight associates

Appendix
Energy Assessment
Bourne Court

Baseline Scenario

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 1

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	93.3	(1a) x	2.56	(2a) =	238.85	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	93.3	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		238.85	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.13 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.38 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.32 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.41	0.4	0.39	0.35	0.34	0.3	0.3	0.3	0.32	0.34	0.36	0.38

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.58	0.58	0.58	0.56	0.56	0.55	0.55	0.54	0.55	0.56	0.56	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.58	0.58	0.58	0.56	0.56	0.55	0.55	0.54	0.55	0.56	0.56	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			3.14	x	1/[1/(1.4)+ 0.04]	=	4.16			(27)
Windows Type 2			2.15	x	1/[1/(1.4)+ 0.04]	=	2.85			(27)
Windows Type 3			5.26	x	1/[1/(1.4)+ 0.04]	=	6.97			(27)
Windows Type 4			2.93	x	1/[1/(1.4)+ 0.04]	=	3.88			(27)
Floor			93.3	x	0.13	=	12.129			(28)
Walls Type1	66.49	20.92	45.56	x	0.18	=	8.2			(29)
Walls Type2	20.61	2.42	18.19	x	0.18	=	3.27			(29)
Total area of elements, m²			180.4							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 53.76 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11346.84 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.98 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 57.74 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	45.94	45.69	45.44	44.27	44.05	43.04	43.04	42.85	43.43	44.05	44.49	44.96	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	103.68	103.43	103.18	102.01	101.8	100.78	100.78	100.59	101.17	101.8	102.24	102.7	

Average = Sum(39)$_{1...12}$ /12= 102.01 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.11	1.11	1.11	1.09	1.09	1.08	1.08	1.08	1.08	1.09	1.1	1.1

Average = Sum(40)$_{1...12}$ /12= 1.09 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.67 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 97.57 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	107.33	103.43	99.52	95.62	91.72	87.81	87.81	91.72	95.62	99.52	103.43	107.33

Total = Sum(44)$_{1...12}$ = 1170.85 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	159.16	139.21	143.65	125.24	120.17	103.69	96.09	110.26	111.58	130.04	141.94	154.14

Total = Sum(45)$_{1...12}$ = 1535.17 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.87	20.88	21.55	18.79	18.03	15.55	14.41	16.54	16.74	19.51	21.29	23.12

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.72	47.15	46.74	43.31	44.75	46.74	47.15	50.72	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	210.12	185.23	194.36	172.39	166.9	147	140.84	157	158.73	180.75	191.26	205.1	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	210.12	185.23	194.36	172.39	166.9	147	140.84	157	158.73	180.75	191.26	205.1	

Output from water heater (annual)$_{1...12}$ 2109.7 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	65.66	57.79	60.44	53.43	51.64	45.3	43.14	48.35	48.89	55.92	59.53	63.99	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.84	19.4	15.78	11.94	8.93	7.54	8.14	10.59	14.21	18.04	21.06	22.45	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	245.02	247.56	241.16	227.52	210.3	194.11	183.3	180.76	187.17	200.81	218.03	234.21	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	(71)

Water heating gains (Table 5)

(72)m=	88.26	86	81.24	74.21	69.41	62.92	57.98	64.98	67.9	75.16	82.67	86.01	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	421.14	418.99	404.19	379.69	354.66	330.6	315.45	322.35	335.3	360.03	387.78	408.69	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	5.26	x	11.28	x	0.63	x	0.7	=	18.14	(75)
Northeast 0.9x	0.77	x	2.93	x	11.28	x	0.63	x	0.7	=	10.1	(75)
Northeast 0.9x	0.77	x	5.26	x	22.97	x	0.63	x	0.7	=	36.92	(75)
Northeast 0.9x	0.77	x	2.93	x	22.97	x	0.63	x	0.7	=	20.57	(75)
Northeast 0.9x	0.77	x	5.26	x	41.38	x	0.63	x	0.7	=	66.52	(75)

TER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	2.93	x	41.38	x	0.63	x	0.7	=	37.05	(75)
Northeast	0.9x	0.77	x	5.26	x	67.96	x	0.63	x	0.7	=	109.24	(75)
Northeast	0.9x	0.77	x	2.93	x	67.96	x	0.63	x	0.7	=	60.85	(75)
Northeast	0.9x	0.77	x	5.26	x	91.35	x	0.63	x	0.7	=	146.84	(75)
Northeast	0.9x	0.77	x	2.93	x	91.35	x	0.63	x	0.7	=	81.8	(75)
Northeast	0.9x	0.77	x	5.26	x	97.38	x	0.63	x	0.7	=	156.55	(75)
Northeast	0.9x	0.77	x	2.93	x	97.38	x	0.63	x	0.7	=	87.2	(75)
Northeast	0.9x	0.77	x	5.26	x	91.1	x	0.63	x	0.7	=	146.45	(75)
Northeast	0.9x	0.77	x	2.93	x	91.1	x	0.63	x	0.7	=	81.58	(75)
Northeast	0.9x	0.77	x	5.26	x	72.63	x	0.63	x	0.7	=	116.75	(75)
Northeast	0.9x	0.77	x	2.93	x	72.63	x	0.63	x	0.7	=	65.03	(75)
Northeast	0.9x	0.77	x	5.26	x	50.42	x	0.63	x	0.7	=	81.05	(75)
Northeast	0.9x	0.77	x	2.93	x	50.42	x	0.63	x	0.7	=	45.15	(75)
Northeast	0.9x	0.77	x	5.26	x	28.07	x	0.63	x	0.7	=	45.12	(75)
Northeast	0.9x	0.77	x	2.93	x	28.07	x	0.63	x	0.7	=	25.13	(75)
Northeast	0.9x	0.77	x	5.26	x	14.2	x	0.63	x	0.7	=	22.82	(75)
Northeast	0.9x	0.77	x	2.93	x	14.2	x	0.63	x	0.7	=	12.71	(75)
Northeast	0.9x	0.77	x	5.26	x	9.21	x	0.63	x	0.7	=	14.81	(75)
Northeast	0.9x	0.77	x	2.93	x	9.21	x	0.63	x	0.7	=	8.25	(75)
Northwest	0.9x	0.77	x	3.14	x	11.28	x	0.63	x	0.7	=	21.65	(81)
Northwest	0.9x	0.77	x	2.15	x	11.28	x	0.63	x	0.7	=	22.24	(81)
Northwest	0.9x	0.77	x	3.14	x	22.97	x	0.63	x	0.7	=	44.08	(81)
Northwest	0.9x	0.77	x	2.15	x	22.97	x	0.63	x	0.7	=	45.27	(81)
Northwest	0.9x	0.77	x	3.14	x	41.38	x	0.63	x	0.7	=	79.42	(81)
Northwest	0.9x	0.77	x	2.15	x	41.38	x	0.63	x	0.7	=	81.57	(81)
Northwest	0.9x	0.77	x	3.14	x	67.96	x	0.63	x	0.7	=	130.42	(81)
Northwest	0.9x	0.77	x	2.15	x	67.96	x	0.63	x	0.7	=	133.95	(81)
Northwest	0.9x	0.77	x	3.14	x	91.35	x	0.63	x	0.7	=	175.32	(81)
Northwest	0.9x	0.77	x	2.15	x	91.35	x	0.63	x	0.7	=	180.06	(81)
Northwest	0.9x	0.77	x	3.14	x	97.38	x	0.63	x	0.7	=	186.91	(81)
Northwest	0.9x	0.77	x	2.15	x	97.38	x	0.63	x	0.7	=	191.96	(81)
Northwest	0.9x	0.77	x	3.14	x	91.1	x	0.63	x	0.7	=	174.85	(81)
Northwest	0.9x	0.77	x	2.15	x	91.1	x	0.63	x	0.7	=	179.58	(81)
Northwest	0.9x	0.77	x	3.14	x	72.63	x	0.63	x	0.7	=	139.39	(81)
Northwest	0.9x	0.77	x	2.15	x	72.63	x	0.63	x	0.7	=	143.16	(81)
Northwest	0.9x	0.77	x	3.14	x	50.42	x	0.63	x	0.7	=	96.77	(81)
Northwest	0.9x	0.77	x	2.15	x	50.42	x	0.63	x	0.7	=	99.39	(81)
Northwest	0.9x	0.77	x	3.14	x	28.07	x	0.63	x	0.7	=	53.87	(81)
Northwest	0.9x	0.77	x	2.15	x	28.07	x	0.63	x	0.7	=	55.33	(81)
Northwest	0.9x	0.77	x	3.14	x	14.2	x	0.63	x	0.7	=	27.25	(81)
Northwest	0.9x	0.77	x	2.15	x	14.2	x	0.63	x	0.7	=	27.98	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.14	x	9.21	x	0.63	x	0.7	=	17.68	(81)
Northwest 0.9x	0.77	x	2.15	x	9.21	x	0.63	x	0.7	=	18.16	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	72.14	146.84	264.55	434.47	584.01	622.62	582.45	464.33	322.36	179.45	90.77	58.91	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	493.28	565.82	668.75	814.16	938.67	953.22	897.9	786.69	657.66	539.48	478.55	467.6	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.84	0.65	0.49	0.57	0.86	0.99	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.74	19.88	20.15	20.54	20.84	20.97	20.99	20.99	20.87	20.46	20.04	19.72	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.99	19.99	20	20.01	20.01	20.02	20.02	20.02	20.01	20.01	20	20	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.94	0.79	0.56	0.38	0.46	0.8	0.98	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.31	18.51	18.91	19.46	19.86	20	20.02	20.01	19.9	19.37	18.75	18.28	(90)

fLA = Living area ÷ (4) = 0.19 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.58	18.77	19.14	19.66	20.04	20.18	20.2	20.2	20.08	19.57	18.99	18.55	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.58	18.77	19.14	19.66	20.04	20.18	20.2	20.2	20.08	19.57	18.99	18.55	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	1	0.98	0.94	0.79	0.57	0.4	0.48	0.8	0.97	1	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	492.15	563.04	658.39	762.1	746.17	547.61	360.79	377.47	528.61	524.96	476.32	466.79	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1480.12	1434.39	1304.33	1097.95	849.07	562.31	362.58	381.79	605.41	913.27	1215.69	1473.73	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	735.05	585.55	480.58	241.81	76.56	0	0	0	0	288.91	532.35	749.16	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3689.97 (98)

Space heating requirement in kWh/m²/year 39.55 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

TER WorkSheet: New dwelling design stage

Fraction of space heat from main system(s)	(202) = 1 – (201) =	1 (202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1 (204)
Efficiency of main space heating system 1		93.4 (206)
Efficiency of secondary/supplementary heating system, %		0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	735.05	585.55	480.58	241.81	76.56	0	0	0	0	288.91	532.35	749.16	
(211)m = {[(98)m x (204)] } x 100 ÷ (206) (211)	786.99	626.93	514.54	258.9	81.97	0	0	0	0	309.32	569.97	802.1	

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 3950.72 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

Output from water heater (calculated above)	210.12	185.23	194.36	172.39	166.9	147	140.84	157	158.73	180.75	191.26	205.1	

Efficiency of water heater 80.3 (216)

(217)m=	87.94	87.75	87.24	85.9	83.22	80.3	80.3	80.3	80.3	86.23	87.49	88.02	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	238.94	211.1	222.79	200.68	200.55	183.06	175.39	195.52	197.68	209.62	218.6	233.02	

Total = Sum(219a)$_{1...12}$ = 2486.95 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		3950.72
Water heating fuel used		2486.95
Electricity for pumps, fans and electric keep-hot		
central heating pump:	30	(230c)
boiler with a fan-assisted flue	45	(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75 (231)
Electricity for lighting		385.73 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216 =	853.35 (261)
Space heating (secondary)	(215) x	0.519 =	0 (263)
Water heating	(219) x	0.216 =	537.18 (264)
Space and water heating	(261) + (262) + (263) + (264) =		1390.54 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519 =	38.93 (267)
Electricity for lighting	(232) x	0.519 =	200.19 (268)

TER WorkSheet: New dwelling design stage

Total CO2, kg/year	sum of (265)…(271) =	1629.65	(272)
TER =		17.47	(273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 2

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	84.24	(1a) x	2.56	(2a) =	215.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	84.24	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		215.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.14 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.39 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.33 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.42	0.41	0.41	0.36	0.36	0.31	0.31	0.31	0.33	0.36	0.37	0.39

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.58	0.57	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.58	0.57	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			84.24	x	0.13	=	10.9512			(28)
Walls Type1	35.77	16.99	18.78	x	0.18	=	3.38			(29)
Walls Type2	37.54	2.42	35.12	x	0.18	=	6.32			(29)
Total area of elements, m²			157.54							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 45.6 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 10182.6 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.98 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 49.58 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	41.91	41.66	41.42	40.29	40.08	39.1	39.1	38.91	39.48	40.08	40.51	40.96	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	91.49	91.25	91	89.87	89.66	88.68	88.68	88.49	89.06	89.66	90.09	90.54	

Average = Sum(39)$_{1...12}$ /12= 89.87 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.09	1.08	1.08	1.07	1.06	1.05	1.05	1.05	1.06	1.06	1.07	1.07	

Average = Sum(40)$_{1...12}$ /12= 1.07 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.54 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 94.49 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	103.94	100.16	96.38	92.6	88.82	85.04	85.04	88.82	92.6	96.38	100.16	103.94	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1133.85 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	154.13	134.81	139.11	121.28	116.37	100.42	93.05	106.78	108.05	125.93	137.46	149.27	

Total = Sum(45)$_{1...12}$ = 1486.65 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	23.12	20.22	20.87	18.19	17.46	15.06	13.96	16.02	16.21	18.89	20.62	22.39	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.11	45.66	45.26	41.94	43.33	45.26	45.66	49.11	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	

Output from water heater (annual)$_{1...12}$ 2049.26 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	63.99	56.33	58.53	51.74	50.01	43.87	41.77	46.82	47.34	54.15	58.03	62.37	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	20.46	18.17	14.78	11.19	8.36	7.06	7.63	9.92	13.31	16.9	19.72	21.03	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	228.07	230.44	224.48	211.78	195.75	180.69	170.63	168.26	174.22	186.92	202.95	218.01	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	(71)

Water heating gains (Table 5)

(72)m=	86.01	83.82	78.67	71.86	67.21	60.93	56.15	62.93	65.76	72.78	80.6	83.83	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	398.62	396.51	382	358.91	335.41	312.76	298.48	305.18	317.36	340.68	367.35	386.95	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.63	x	0.7	=	26.72	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.63	x	0.7	=	31.86	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.63	x	0.7	=	54.4	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.63	x	0.7	=	64.85	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.63	x	0.7	=	98.01	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.63	x	0.7	=	116.85	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.63	x	0.7	=	160.95	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.63	x	0.7	=	191.9	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.63	x	0.7	=	216.35	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.63	x	0.7	=	257.95	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.63	x	0.7	=	230.66	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.63	x	0.7	=	275	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.63	x	0.7	=	215.77	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.63	x	0.7	=	257.26	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.63	x	0.7	=	172.02	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.63	x	0.7	=	205.09	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.63	x	0.7	=	119.42	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.63	x	0.7	=	142.38	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.63	x	0.7	=	66.48	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.63	x	0.7	=	79.26	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.63	x	0.7	=	33.63	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.63	x	0.7	=	40.09	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.63	x	0.7	=	21.82	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.63	x	0.7	=	26.02	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	58.59	119.25	214.85	352.85	474.3	505.66	473.03	377.11	261.8	145.74	73.72	47.84	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	457.2	515.76	596.86	711.76	809.71	818.42	771.51	682.29	579.17	486.41	441.07	434.79	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.85	0.66	0.5	0.58	0.87	0.99	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.79	19.92	20.18	20.54	20.84	20.97	20.99	20.99	20.87	20.49	20.08	19.77	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.01	20.01	20.02	20.03	20.03	20.04	20.04	20.04	20.04	20.03	20.03	20.02	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.95	0.81	0.57	0.39	0.47	0.8	0.98	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.39	18.58	18.96	19.49	19.87	20.02	20.04	20.04	19.93	19.42	18.82	18.37	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.69	18.87	19.22	19.72	20.08	20.23	20.25	20.24	20.13	19.65	19.1	18.67	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.69	18.87	19.22	19.72	20.08	20.23	20.25	20.24	20.13	19.65	19.1	18.67	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.99	0.94	0.81	0.59	0.42	0.49	0.81	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	456.06	513.16	588.01	669.87	655.53	484.83	321.51	336.07	469.14	473.28	438.86	433.96	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1317	1275.11	1157.83	972.09	751.69	498.88	323.23	340.06	537.37	811.26	1080.79	1310.35	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	640.54	512.03	423.95	217.6	71.54	0	0	0	0	251.46	462.19	652.03	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3231.35 (98)

Space heating requirement in kWh/m²/year 38.36 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	640.54	512.03	423.95	217.6	71.54	0	0	0	0	251.46	462.19	652.03	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	685.8	548.21	453.91	232.98	76.6	0	0	0	0	269.23	494.85	698.11	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3459.69 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23

Efficiency of water heater 80.3 (216)

(217)m=	87.72	87.53	87.03	85.72	83.15	80.3	80.3	80.3	80.3	85.96	87.24	87.81	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	233.79	206.6	216.26	194.75	194.38	177.28	169.85	189.34	191.43	203.62	214.09	228.04	

Total = Sum(219a)$_{1...12}$ = 2419.43 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 3459.69

TER WorkSheet: New dwelling design stage

Water heating fuel used		2419.43	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		361.31	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	747.29	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	522.6	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1269.89	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	187.52	(268)
Total CO2, kg/year		sum of (265)…(271) =			1496.33	(272)

TER = 17.76 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 3

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.63	(1a) x	2.56	(2a) =	183.37	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.37	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.39	0.38	0.33	0.33	0.33	0.35	0.38	0.4	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.06	x1/[1/(1.4)+ 0.04]		=	9.36			(27)
Windows Type 2			4.21	x1/[1/(1.4)+ 0.04]		=	5.58			(27)
Floor			71.63	x	0.13	=	9.311899			(28)
Walls Type1	31.08	15.48	15.6	x	0.18	=	2.81			(29)
Walls Type2	25.62	2.42	23.2	x	0.18	=	4.18			(29)
Total area of elements, m²			128.32							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.24 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8538.81 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.68 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 42.91 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	36.34	36.1	35.87	34.78	34.58	33.63	33.63	33.46	34	34.58	34.99	35.42	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	79.25	79.01	78.78	77.7	77.49	76.55	76.55	76.37	76.91	77.49	77.9	78.33	

Average = Sum(39)$_{1...12}$ /12= 77.69 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.11	1.1	1.1	1.08	1.08	1.07	1.07	1.07	1.07	1.08	1.09	1.09	

Average = Sum(40)$_{1...12}$ /12= 1.08 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.47 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	97.32	93.78	90.24	86.7	83.16	79.62	79.62	83.16	86.7	90.24	93.78	97.32	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1061.64 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	144.32	126.22	130.25	113.55	108.96	94.02	87.13	99.98	101.17	117.91	128.7	139.76	

Total = Sum(45)$_{1...12}$ = 1391.97 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.65	18.93	19.54	17.03	16.34	14.1	13.07	15	15.18	17.69	19.31	20.96	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.59	43.16	45.98	42.76	42.38	39.27	40.57	42.38	42.76	45.98	46.25	49.59	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	

Output from water heater (annual)$_{1...12}$ 1922.64 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.38	52.76	54.8	48.45	46.82	41.08	39.11	43.84	44.33	50.7	54.36	58.87	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.94	15.94	12.96	9.81	7.34	6.19	6.69	8.7	11.67	14.82	17.3	18.44	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.07	203.16	197.9	186.71	172.58	159.3	150.42	148.34	153.6	164.79	178.92	192.2	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	(71)

Water heating gains (Table 5)

(72)m=	81.16	78.51	73.66	67.29	62.93	57.05	52.57	58.92	61.57	68.15	75.49	79.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.45	357.88	344.8	324.08	303.12	282.82	269.96	276.23	287.11	308.03	331.99	350.04	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.06	x	11.28	x	0.63	x	0.7	=	24.34	(75)
Northeast 0.9x	0.77	x	4.21	x	11.28	x	0.63	x	0.7	=	29.03	(75)
Northeast 0.9x	0.77	x	7.06	x	22.97	x	0.63	x	0.7	=	49.55	(75)
Northeast 0.9x	0.77	x	4.21	x	22.97	x	0.63	x	0.7	=	59.1	(75)
Northeast 0.9x	0.77	x	7.06	x	41.38	x	0.63	x	0.7	=	89.28	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.21	x	41.38	x	0.63	x	0.7	=	106.48	(75)
Northeast 0.9x	0.77	x	7.06	x	67.96	x	0.63	x	0.7	=	146.62	(75)
Northeast 0.9x	0.77	x	4.21	x	67.96	x	0.63	x	0.7	=	174.87	(75)
Northeast 0.9x	0.77	x	7.06	x	91.35	x	0.63	x	0.7	=	197.09	(75)
Northeast 0.9x	0.77	x	4.21	x	91.35	x	0.63	x	0.7	=	235.06	(75)
Northeast 0.9x	0.77	x	7.06	x	97.38	x	0.63	x	0.7	=	210.12	(75)
Northeast 0.9x	0.77	x	4.21	x	97.38	x	0.63	x	0.7	=	250.6	(75)
Northeast 0.9x	0.77	x	7.06	x	91.1	x	0.63	x	0.7	=	196.56	(75)
Northeast 0.9x	0.77	x	4.21	x	91.1	x	0.63	x	0.7	=	234.43	(75)
Northeast 0.9x	0.77	x	7.06	x	72.63	x	0.63	x	0.7	=	156.7	(75)
Northeast 0.9x	0.77	x	4.21	x	72.63	x	0.63	x	0.7	=	186.89	(75)
Northeast 0.9x	0.77	x	7.06	x	50.42	x	0.63	x	0.7	=	108.79	(75)
Northeast 0.9x	0.77	x	4.21	x	50.42	x	0.63	x	0.7	=	129.75	(75)
Northeast 0.9x	0.77	x	7.06	x	28.07	x	0.63	x	0.7	=	60.56	(75)
Northeast 0.9x	0.77	x	4.21	x	28.07	x	0.63	x	0.7	=	72.22	(75)
Northeast 0.9x	0.77	x	7.06	x	14.2	x	0.63	x	0.7	=	30.63	(75)
Northeast 0.9x	0.77	x	4.21	x	14.2	x	0.63	x	0.7	=	36.53	(75)
Northeast 0.9x	0.77	x	7.06	x	9.21	x	0.63	x	0.7	=	19.88	(75)
Northeast 0.9x	0.77	x	4.21	x	9.21	x	0.63	x	0.7	=	23.71	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	53.38	108.65	195.76	321.49	432.15	460.72	430.99	343.59	238.53	132.78	67.16	43.59	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	413.83	466.54	540.56	645.57	735.27	743.53	700.95	619.82	525.65	440.82	399.15	393.64	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.83	0.63	0.48	0.55	0.85	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.8	19.93	20.2	20.57	20.86	20.97	21	20.99	20.89	20.5	20.09	19.78	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20	20	20	20.01	20.02	20.03	20.03	20.03	20.02	20.02	20.01	20.01	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.93	0.78	0.55	0.37	0.44	0.78	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.39	18.59	18.97	19.51	19.88	20.01	20.02	20.02	19.93	19.43	18.83	18.37	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.76	18.94	19.29	19.79	20.14	20.26	20.28	20.28	20.18	19.71	19.16	18.74	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.76	18.94	19.29	19.79	20.14	20.26	20.28	20.28	20.18	19.71	19.16	18.74	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.79	0.57	0.4	0.47	0.79	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	412.48	463.53	530.59	600.48	579.08	423.06	280.46	293.24	414.57	426.3	396.59	392.64	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1145.89	1109.53	1008.02	845.96	653.77	433.6	281.77	296.27	467.75	706.19	939.69	1138.87	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	545.66	434.12	355.2	176.74	55.57	0	0	0	0	208.24	391.03	555.19	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2721.75 (98)

Space heating requirement in kWh/m²/year 38 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	545.66	434.12	355.2	176.74	55.57	0	0	0	0	208.24	391.03	555.19	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	584.22	464.79	380.3	189.23	59.5	0	0	0	0	222.95	418.66	594.43	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2914.08 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36

Efficiency of water heater 80.3 (216)

(217)m=	87.51	87.32	86.78	85.36	82.78	80.3	80.3	80.3	80.3	85.66	87.02	87.6	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	221.58	193.99	203.08	183.12	182.81	165.99	159.03	177.28	179.24	191.34	201.05	216.16	

Total = Sum(219a)$_{1...12}$ = 2274.66 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2914.08

TER WorkSheet: New dwelling design stage

Water heating fuel used		2274.66	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		316.91	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	629.44	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	491.33	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1120.77	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	164.47	(268)
Total CO2, kg/year	sum of (265)…(271) =				1324.17	(272)

TER = 18.49 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 4

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.54	(1a) x	2.56	(2a) =	131.94	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.54	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.94	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.32	0.32	0.32	0.34	0.37	0.38	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.56	x	1/[1/(1.4)+ 0.04]	=	8.7			(27)
Windows Type 2			3.91	x	1/[1/(1.4)+ 0.04]	=	5.18			(27)
Floor			51.54	x	0.13	=	6.7002			(28)
Walls Type1	24.61	10.47	14.14	x	0.18	=	2.55			(29)
Walls Type2	39.63	2.42	37.21	x	0.18	=	6.7			(29)
Total area of elements, m²			115.78							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 32.24 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6542.35 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.68 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.92 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.89	25.73	25.58	24.84	24.7	24.06	24.06	23.94	24.31	24.7	24.98	25.27	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	61.81	61.65	61.5	60.76	60.62	59.98	59.98	59.86	60.23	60.62	60.9	61.19	

Average = Sum(39)$_{1...12}$ /12= 60.76 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.2	1.2	1.19	1.18	1.18	1.16	1.16	1.16	1.17	1.18	1.18	1.19	
Average = Sum(40)$_{1...12}$ /12=													1.18 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.42 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	82.96	79.94	76.93	73.91	70.89	67.88	67.88	70.89	73.91	76.93	79.94	82.96	
Total = Sum(44)$_{1...12}$ =													905.02 (44)
Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)													
(45)m=	123.03	107.6	111.03	96.8	92.88	80.15	74.27	85.23	86.25	100.51	109.72	119.15	
Total = Sum(45)$_{1...12}$ =													1186.62 (45)
If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)													
(46)m=	18.45	16.14	16.66	14.52	13.93	12.02	11.14	12.78	12.94	15.08	16.46	17.87	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)
If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)
If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H													
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.28	36.8	39.2	36.45	36.13	33.47	34.59	36.13	36.45	39.2	39.42	42.28	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	

Output from water heater (annual)$_{1...12}$ 1639.01 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.48	44.98	46.72	41.3	39.92	35.02	33.34	37.37	37.79	43.22	46.34	50.18	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.56	12.04	9.79	7.41	5.54	4.68	5.06	6.57	8.82	11.2	13.07	13.93	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.23	152.8	148.85	140.43	129.8	119.81	113.14	111.57	115.53	123.94	134.57	144.56	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	(71)

Water heating gains (Table 5)

(72)m=	69.19	66.93	62.79	57.36	53.65	48.64	44.82	50.23	52.48	58.09	64.36	67.45	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	286.01	283.8	273.47	257.23	241.02	225.16	215.04	220.4	228.86	245.27	264.03	277.98	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	6.56	x	11.28	x	0.63	x	0.7	=	22.62	(75)
Northeast 0.9x	0.77	x	3.91	x	11.28	x	0.63	x	0.7	=	13.48	(75)
Northeast 0.9x	0.77	x	6.56	x	22.97	x	0.63	x	0.7	=	46.04	(75)
Northeast 0.9x	0.77	x	3.91	x	22.97	x	0.63	x	0.7	=	27.44	(75)
Northeast 0.9x	0.77	x	6.56	x	41.38	x	0.63	x	0.7	=	82.96	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	3.91	x	41.38	x	0.63	x	0.7	=	49.45	(75)
Northeast 0.9x	0.77	x	6.56	x	67.96	x	0.63	x	0.7	=	136.24	(75)
Northeast 0.9x	0.77	x	3.91	x	67.96	x	0.63	x	0.7	=	81.2	(75)
Northeast 0.9x	0.77	x	6.56	x	91.35	x	0.63	x	0.7	=	183.13	(75)
Northeast 0.9x	0.77	x	3.91	x	91.35	x	0.63	x	0.7	=	109.15	(75)
Northeast 0.9x	0.77	x	6.56	x	97.38	x	0.63	x	0.7	=	195.24	(75)
Northeast 0.9x	0.77	x	3.91	x	97.38	x	0.63	x	0.7	=	116.37	(75)
Northeast 0.9x	0.77	x	6.56	x	91.1	x	0.63	x	0.7	=	182.64	(75)
Northeast 0.9x	0.77	x	3.91	x	91.1	x	0.63	x	0.7	=	108.86	(75)
Northeast 0.9x	0.77	x	6.56	x	72.63	x	0.63	x	0.7	=	145.6	(75)
Northeast 0.9x	0.77	x	3.91	x	72.63	x	0.63	x	0.7	=	86.79	(75)
Northeast 0.9x	0.77	x	6.56	x	50.42	x	0.63	x	0.7	=	101.08	(75)
Northeast 0.9x	0.77	x	3.91	x	50.42	x	0.63	x	0.7	=	60.25	(75)
Northeast 0.9x	0.77	x	6.56	x	28.07	x	0.63	x	0.7	=	56.27	(75)
Northeast 0.9x	0.77	x	3.91	x	28.07	x	0.63	x	0.7	=	33.54	(75)
Northeast 0.9x	0.77	x	6.56	x	14.2	x	0.63	x	0.7	=	28.46	(75)
Northeast 0.9x	0.77	x	3.91	x	14.2	x	0.63	x	0.7	=	16.96	(75)
Northeast 0.9x	0.77	x	6.56	x	9.21	x	0.63	x	0.7	=	18.47	(75)
Northeast 0.9x	0.77	x	3.91	x	9.21	x	0.63	x	0.7	=	11.01	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	36.1	73.49	132.4	217.44	292.29	311.61	291.5	232.39	161.33	89.81	45.43	29.48	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	322.11	357.29	405.87	474.68	533.31	536.77	506.55	452.79	390.2	335.08	309.46	307.46	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.85	0.67	0.51	0.59	0.86	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.72	19.85	20.11	20.49	20.8	20.96	20.99	20.98	20.85	20.45	20.02	19.69	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.92	19.92	19.93	19.94	19.94	19.95	19.95	19.95	19.95	19.94	19.93	19.93	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.94	0.8	0.58	0.39	0.46	0.79	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.22	18.41	18.8	19.34	19.75	19.92	19.95	19.94	19.83	19.3	18.68	18.19	(90)

fLA = Living area ÷ (4) = 0.3 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.67	18.84	19.19	19.69	20.07	20.23	20.26	20.26	20.13	19.64	19.08	18.64	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.67	18.84	19.19	19.69	20.07	20.23	20.26	20.26	20.13	19.64	19.08	18.64	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.81	0.6	0.43	0.5	0.8	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	320.62	354.37	397.68	443.34	432	324.54	217.61	226.86	312.71	322.96	306.82	306.32	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	888.12	859.73	780.58	655.36	507.24	337.87	219.56	230.87	363.46	548.29	729.74	883.88	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	422.22	339.6	284.87	152.65	55.98	0	0	0	0	167.65	304.5	429.7	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2157.17 (98)

Space heating requirement in kWh/m²/year 41.85 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	422.22	339.6	284.87	152.65	55.98	0	0	0	0	167.65	304.5	429.7	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	452.05	363.6	305	163.44	59.93	0	0	0	0	179.49	326.02	460.06	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2309.61 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42

Efficiency of water heater 80.3 (216)

(217)m=	87.31	87.13	86.64	85.39	83.11	80.3	80.3	80.3	80.3	85.51	86.81	87.4	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.33	165.72	173.41	156.04	155.23	141.5	135.57	151.13	152.8	163.39	171.8	184.7	

Total = Sum(219a)$_{1...12}$ = 1940.6 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2309.61

TER WorkSheet: New dwelling design stage

Water heating fuel used		1940.6	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		239.41	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	498.88	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	419.17	(264)
Space and water heating	(261) + (262) + (263) + (264) =				918.05	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	124.25	(268)
Total CO2, kg/year		sum of (265)…(271) =			1081.22	(272)

TER = 20.98 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 5

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	87.91	(1a) x	2.56	(2a) =	225.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	87.91	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		225.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.13 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.38 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.33 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.42	0.41	0.4	0.36	0.35	0.31	0.31	0.3	0.33	0.35	0.37	0.38

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.62	x1/[1/(1.4)+ 0.04]		=	10.1			(27)
Windows Type 2			4.55	x1/[1/(1.4)+ 0.04]		=	6.03			(27)
Windows Type 3			2.84	x1/[1/(1.4)+ 0.04]		=	3.77			(27)
Floor			87.91	x	0.13	=	11.4283			(28)
Walls Type1	24.61	19.56	5.05	x	0.18	=	0.91			(29)
Walls Type2	39.63	2.42	37.21	x	0.18	=	6.7			(29)
Roof	10.54	0	10.54	x	0.13	=	1.37			(30)
Total area of elements, m²			162.69							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 48.76 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 10483.38 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.96 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 53.71 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	43.54	43.29	43.05	41.9	41.69	40.69	40.69	40.51	41.07	41.69	42.12	42.58	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	97.26	97.01	96.76	95.62	95.4	94.41	94.41	94.22	94.79	95.4	95.84	96.29	

Average = Sum(39)$_{1...12}$ /12= 95.62 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.11	1.1	1.1	1.09	1.09	1.07	1.07	1.07	1.08	1.09	1.09	1.1

Average = Sum(40)$_{1...12}$ /12= 1.09 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.6 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 95.86 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	105.44	101.61	97.77	93.94	90.1	86.27	86.27	90.1	93.94	97.77	101.61	105.44

Total = Sum(44)$_{1...12}$ = 1150.27 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	156.37	136.76	141.12	123.03	118.05	101.87	94.4	108.32	109.62	127.75	139.45	151.43

Total = Sum(45)$_{1...12}$ = 1508.18 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.45	20.51	21.17	18.46	17.71	15.28	14.16	16.25	16.44	19.16	20.92	22.71

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.82	46.33	45.92	42.54	43.96	45.92	46.33	49.82	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39	

Output from water heater (annual)$_{1...12}$ 2076.08 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	64.73	56.98	59.38	52.49	50.73	44.51	42.38	47.5	48.03	54.93	58.7	63.09	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	20.97	18.62	15.15	11.47	8.57	7.24	7.82	10.16	13.64	17.32	20.22	21.55	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	235.18	237.62	231.47	218.38	201.85	186.32	175.94	173.5	179.65	192.74	209.27	224.8	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	(71)

Water heating gains (Table 5)

(72)m=	87	84.79	79.81	72.9	68.19	61.82	56.96	63.84	66.71	73.83	81.52	84.8	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	408.09	405.97	391.37	367.69	343.55	320.31	305.66	312.44	324.94	348.84	375.95	396.09	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.62	x	11.28	x	0.63	x	0.7	=	26.28	(75)
Northeast 0.9x	0.77	x	4.55	x	11.28	x	0.63	x	0.7	=	31.38	(75)
Northeast 0.9x	0.77	x	7.62	x	22.97	x	0.63	x	0.7	=	53.48	(75)
Northeast 0.9x	0.77	x	4.55	x	22.97	x	0.63	x	0.7	=	63.87	(75)
Northeast 0.9x	0.77	x	7.62	x	41.38	x	0.63	x	0.7	=	96.36	(75)

TER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	4.55	x	41.38	x	0.63	x	0.7	=	115.08		(75)
Northeast	0.9x	0.77	x	7.62	x	67.96	x	0.63	x	0.7	=	158.25		(75)
Northeast	0.9x	0.77	x	4.55	x	67.96	x	0.63	x	0.7	=	188.99		(75)
Northeast	0.9x	0.77	x	7.62	x	91.35	x	0.63	x	0.7	=	212.72		(75)
Northeast	0.9x	0.77	x	4.55	x	91.35	x	0.63	x	0.7	=	254.04		(75)
Northeast	0.9x	0.77	x	7.62	x	97.38	x	0.63	x	0.7	=	226.79		(75)
Northeast	0.9x	0.77	x	4.55	x	97.38	x	0.63	x	0.7	=	270.83		(75)
Northeast	0.9x	0.77	x	7.62	x	91.1	x	0.63	x	0.7	=	212.15		(75)
Northeast	0.9x	0.77	x	4.55	x	91.1	x	0.63	x	0.7	=	253.36		(75)
Northeast	0.9x	0.77	x	7.62	x	72.63	x	0.63	x	0.7	=	169.13		(75)
Northeast	0.9x	0.77	x	4.55	x	72.63	x	0.63	x	0.7	=	201.98		(75)
Northeast	0.9x	0.77	x	7.62	x	50.42	x	0.63	x	0.7	=	117.42		(75)
Northeast	0.9x	0.77	x	4.55	x	50.42	x	0.63	x	0.7	=	140.22		(75)
Northeast	0.9x	0.77	x	7.62	x	28.07	x	0.63	x	0.7	=	65.36		(75)
Northeast	0.9x	0.77	x	4.55	x	28.07	x	0.63	x	0.7	=	78.06		(75)
Northeast	0.9x	0.77	x	7.62	x	14.2	x	0.63	x	0.7	=	33.06		(75)
Northeast	0.9x	0.77	x	4.55	x	14.2	x	0.63	x	0.7	=	39.48		(75)
Northeast	0.9x	0.77	x	7.62	x	9.21	x	0.63	x	0.7	=	21.46		(75)
Northeast	0.9x	0.77	x	4.55	x	9.21	x	0.63	x	0.7	=	25.63		(75)
Southeast	0.9x	0.77	x	2.84	x	36.79	x	0.63	x	0.7	=	31.93		(77)
Southeast	0.9x	0.77	x	2.84	x	62.67	x	0.63	x	0.7	=	54.4		(77)
Southeast	0.9x	0.77	x	2.84	x	85.75	x	0.63	x	0.7	=	74.43		(77)
Southeast	0.9x	0.77	x	2.84	x	106.25	x	0.63	x	0.7	=	92.22		(77)
Southeast	0.9x	0.77	x	2.84	x	119.01	x	0.63	x	0.7	=	103.29		(77)
Southeast	0.9x	0.77	x	2.84	x	118.15	x	0.63	x	0.7	=	102.55		(77)
Southeast	0.9x	0.77	x	2.84	x	113.91	x	0.63	x	0.7	=	98.87		(77)
Southeast	0.9x	0.77	x	2.84	x	104.39	x	0.63	x	0.7	=	90.6		(77)
Southeast	0.9x	0.77	x	2.84	x	92.85	x	0.63	x	0.7	=	80.59		(77)
Southeast	0.9x	0.77	x	2.84	x	69.27	x	0.63	x	0.7	=	60.12		(77)
Southeast	0.9x	0.77	x	2.84	x	44.07	x	0.63	x	0.7	=	38.25		(77)
Southeast	0.9x	0.77	x	2.84	x	31.49	x	0.63	x	0.7	=	27.33		(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	89.59	171.75	285.87	439.46	570.06	600.17	564.38	461.72	338.23	203.54	110.79	74.41	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	497.68	577.73	677.23	807.15	913.61	920.48	870.04	774.16	663.17	552.38	486.74	470.51	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.83	0.63	0.47	0.55	0.84	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.79	19.94	20.21	20.58	20.86	20.97	21	20.99	20.89	20.51	20.09	19.76	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20	20	20	20.01	20.01	20.02	20.02	20.02	20.02	20.01	20.01	20	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.93	0.78	0.54	0.37	0.44	0.76	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.37	18.59	18.99	19.52	19.88	20.01	20.02	20.02	19.93	19.44	18.82	18.34	(90)

fLA = Living area ÷ (4) = 0.23 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.7	18.9	19.27	19.76	20.1	20.23	20.25	20.24	20.15	19.69	19.11	18.67	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.7	18.9	19.27	19.76	20.1	20.23	20.25	20.24	20.15	19.69	19.11	18.67	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.78	0.56	0.39	0.46	0.77	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	496.18	573.8	663.54	746.92	713.5	518.87	342.6	358.73	513.67	532.52	483.66	469.43	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1400.22	1358.44	1235.73	1038.66	801.84	531.4	344.12	362.14	573.75	866.8	1151.01	1393.22	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	672.61	527.28	425.71	210.05	65.72	0	0	0	0	248.7	480.5	687.3	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3317.86 (98)

Space heating requirement in kWh/m²/year 37.74 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	672.61	527.28	425.71	210.05	65.72	0	0	0	0	248.7	480.5	687.3	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	720.14	564.53	455.79	224.89	70.37	0	0	0	0	266.28	514.45	735.86	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3552.32 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39

Efficiency of water heater 80.3 (216)

(217)m= 87.8 | 87.56 | 87.01 | 85.59 | 82.95 | 80.3 | 80.3 | 80.3 | 80.3 | 85.9 | 87.3 | 87.89 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 236.14 | 208.74 | 219.45 | 197.86 | 197.67 | 179.85 | 172.31 | 192.08 | 194.2 | 206.72 | 216.22 | 230.29

Total = Sum(219a)$_{1...12}$ = 2451.53 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		3552.32	
Water heating fuel used		2451.53	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		370.29	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	767.3	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	529.53	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1296.83	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	192.18	(268)
Total CO2, kg/year	sum of (265)…(271) =			1527.94	(272)

TER = 17.38 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 6

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.7	(1a) x	2.56	(2a) =	180.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.7	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.17 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.42 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.39	0.38	0.34	0.34	0.33	0.35	0.38	0.4	0.42

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.58	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.58	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.09	x1/[1/(1.4)+ 0.04]		=	8.07			(27)
Windows Type 2			3.49	x1/[1/(1.4)+ 0.04]		=	4.63			(27)
Windows Type 3			2.18	x1/[1/(1.4)+ 0.04]		=	2.89			(27)
Floor			70.697	x	0.13	=	9.19061			(28)
Walls Type1	51.4	15.25	36.15	x	0.18	=	6.51			(29)
Walls Type2	16.74	2.42	14.32	x	0.18	=	2.58			(29)
Total area of elements, m²			138.83							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 40.91 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8634.59 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.67 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 46.58 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	35.93	35.69	35.46	34.38	34.17	33.23	33.23	33.05	33.59	34.17	34.58	35.01	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	82.51	82.27	82.04	80.96	80.75	79.81	79.81	79.63	80.17	80.75	81.16	81.59	

Average = Sum(39)$_{1...12}$ /12= 80.96 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.17	1.16	1.16	1.15	1.14	1.13	1.13	1.13	1.13	1.14	1.15	1.15	
Average = Sum(40)$_{1...12}$ /12=													1.15 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.94 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	96.74	93.22	89.7	86.19	82.67	79.15	79.15	82.67	86.19	89.7	93.22	96.74	
Total = Sum(44)$_{1...12}$ =													1055.33 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	143.46	125.47	129.48	112.88	108.31	93.46	86.61	99.38	100.57	117.21	127.94	138.93	
Total = Sum(45)$_{1...12}$ =													1383.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.52	18.82	19.42	16.93	16.25	14.02	12.99	14.91	15.09	17.58	19.19	20.84	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.3	42.91	45.71	42.5	42.13	39.03	40.33	42.13	42.5	45.71	45.97	49.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	

Output from water heater (annual)$_{1...12}$ 1911.23 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.03	52.45	54.48	48.16	46.55	40.84	38.88	43.58	44.07	50.4	54.03	58.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.75	15.77	12.82	9.71	7.26	6.13	6.62	8.61	11.55	14.67	17.12	18.25	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.92	200.98	195.78	184.71	170.73	157.59	148.81	146.75	151.95	163.03	177	190.14	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	(71)

Water heating gains (Table 5)

(72)m=	80.68	78.05	73.22	66.89	62.56	56.72	52.26	58.57	61.2	67.74	75.05	78.66	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	357.3	354.74	341.77	321.25	300.49	280.38	267.64	273.87	284.65	305.38	329.11	346.99	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.18	x	36.79	x	0.63	x	0.7	=	24.51	(77)
Southeast 0.9x	0.77	x	2.18	x	62.67	x	0.63	x	0.7	=	41.76	(77)
Southeast 0.9x	0.77	x	2.18	x	85.75	x	0.63	x	0.7	=	57.13	(77)
Southeast 0.9x	0.77	x	2.18	x	106.25	x	0.63	x	0.7	=	70.79	(77)
Southeast 0.9x	0.77	x	2.18	x	119.01	x	0.63	x	0.7	=	79.29	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.18	x	118.15	x	0.63	x	0.7	=	78.72	(77)
Southeast 0.9x	0.77	x	2.18	x	113.91	x	0.63	x	0.7	=	75.89	(77)
Southeast 0.9x	0.77	x	2.18	x	104.39	x	0.63	x	0.7	=	69.55	(77)
Southeast 0.9x	0.77	x	2.18	x	92.85	x	0.63	x	0.7	=	61.86	(77)
Southeast 0.9x	0.77	x	2.18	x	69.27	x	0.63	x	0.7	=	46.15	(77)
Southeast 0.9x	0.77	x	2.18	x	44.07	x	0.63	x	0.7	=	29.36	(77)
Southeast 0.9x	0.77	x	2.18	x	31.49	x	0.63	x	0.7	=	20.98	(77)
Southwest 0.9x	0.77	x	6.09	x	36.79		0.63	x	0.7	=	68.48	(79)
Southwest 0.9x	0.77	x	3.49	x	36.79		0.63	x	0.7	=	78.49	(79)
Southwest 0.9x	0.77	x	6.09	x	62.67		0.63	x	0.7	=	116.65	(79)
Southwest 0.9x	0.77	x	3.49	x	62.67		0.63	x	0.7	=	133.69	(79)
Southwest 0.9x	0.77	x	6.09	x	85.75		0.63	x	0.7	=	159.6	(79)
Southwest 0.9x	0.77	x	3.49	x	85.75		0.63	x	0.7	=	182.93	(79)
Southwest 0.9x	0.77	x	6.09	x	106.25		0.63	x	0.7	=	197.75	(79)
Southwest 0.9x	0.77	x	3.49	x	106.25		0.63	x	0.7	=	226.65	(79)
Southwest 0.9x	0.77	x	6.09	x	119.01		0.63	x	0.7	=	221.5	(79)
Southwest 0.9x	0.77	x	3.49	x	119.01		0.63	x	0.7	=	253.87	(79)
Southwest 0.9x	0.77	x	6.09	x	118.15		0.63	x	0.7	=	219.9	(79)
Southwest 0.9x	0.77	x	3.49	x	118.15		0.63	x	0.7	=	252.04	(79)
Southwest 0.9x	0.77	x	6.09	x	113.91		0.63	x	0.7	=	212.01	(79)
Southwest 0.9x	0.77	x	3.49	x	113.91		0.63	x	0.7	=	242.99	(79)
Southwest 0.9x	0.77	x	6.09	x	104.39		0.63	x	0.7	=	194.29	(79)
Southwest 0.9x	0.77	x	3.49	x	104.39		0.63	x	0.7	=	222.68	(79)
Southwest 0.9x	0.77	x	6.09	x	92.85		0.63	x	0.7	=	172.81	(79)
Southwest 0.9x	0.77	x	3.49	x	92.85		0.63	x	0.7	=	198.07	(79)
Southwest 0.9x	0.77	x	6.09	x	69.27		0.63	x	0.7	=	128.92	(79)
Southwest 0.9x	0.77	x	3.49	x	69.27		0.63	x	0.7	=	147.76	(79)
Southwest 0.9x	0.77	x	6.09	x	44.07		0.63	x	0.7	=	82.02	(79)
Southwest 0.9x	0.77	x	3.49	x	44.07		0.63	x	0.7	=	94.01	(79)
Southwest 0.9x	0.77	x	6.09	x	31.49		0.63	x	0.7	=	58.6	(79)
Southwest 0.9x	0.77	x	3.49	x	31.49		0.63	x	0.7	=	67.17	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	171.48	292.1	399.66	495.2	554.66	550.65	530.89	486.52	432.75	322.83	205.39	146.75	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	528.78	646.84	741.43	816.44	855.15	831.03	798.52	760.39	717.39	628.2	534.51	493.74	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.99	0.96	0.9	0.78	0.59	0.44	0.48	0.71	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.87	20.09	20.37	20.68	20.88	20.98	21	20.99	20.94	20.66	20.2	19.83	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.95	19.95	19.95	19.96	19.97	19.98	19.98	19.98	19.97	19.97	19.96	19.96	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.87	0.72	0.51	0.34	0.37	0.63	0.9	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.46	18.78	19.18	19.6	19.86	19.96	19.98	19.98	19.93	19.6	18.95	18.41	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.84	19.13	19.5	19.89	20.14	20.24	20.25	20.25	20.21	19.88	19.29	18.8	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.84	19.13	19.5	19.89	20.14	20.24	20.25	20.25	20.21	19.88	19.29	18.8	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.94	0.87	0.73	0.53	0.36	0.4	0.65	0.9	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	523.69	631.3	699.88	708.93	622.57	440.66	290.35	304.96	464.82	564.8	523.15	490.22	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1199.82	1170.88	1066.44	889.99	681.38	449.89	291.43	306.74	489.53	749.7	989.4	1190.95	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	503.04	362.59	272.72	130.36	43.75	0	0	0	0	137.57	335.71	521.35	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2307.09 (98)

Space heating requirement in kWh/m²/year 32.63 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	503.04	362.59	272.72	130.36	43.75	0	0	0	0	137.57	335.71	521.35	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	538.59	388.22	291.99	139.58	46.84	0	0	0	0	147.29	359.43	558.19	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2470.12 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23

Efficiency of water heater 80.3 (216)

(217)m=	87.36	86.93	86.16	84.61	82.37	80.3	80.3	80.3	80.3	84.63	86.68	87.48

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	220.66	193.69	203.33	183.64	182.63	165	158.09	176.23	178.17	192.51	200.64	215.17

Total = Sum(219a)$_{1...12}$ = 2269.75 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2470.12	
Water heating fuel used		2269.75	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		313.54	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	533.55	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	490.27	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1023.81	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	162.73	(268)
Total CO2, kg/year	sum of (265)…(271) =			1225.46	(272)

TER = 17.33 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 7

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.46	(1a) x	2.56	(2a) =	129.18	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.46	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.18	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.94	x1/[1/(1.4)+ 0.04]		=	7.87			(27)
Windows Type 2			2.13	x1/[1/(1.4)+ 0.04]		=	2.82			(27)
Windows Type 3			2.13	x1/[1/(1.4)+ 0.04]		=	2.82			(27)
Floor			50.46	x	0.13	=	6.5598			(28)
Walls Type1	24.7	10.2	14.5	x	0.18	=	2.61			(29)
Walls Type2	19.12	2.42	16.7	x	0.18	=	3.01			(29)
Total area of elements, m²			94.28							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 28.12 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6081 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.68 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 31.79 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.42	25.26	25.1	24.37	24.23	23.59	23.59	23.47	23.84	24.23	24.51	24.8	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	57.21	57.05	56.9	56.16	56.03	55.39	55.39	55.27	55.63	56.03	56.3	56.59	

Average = Sum(39)$_{1...12}$ /12= 56.16 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.13	1.13	1.13	1.11	1.11	1.1	1.1	1.1	1.1	1.11	1.12	1.12

Average = Sum(40)$_{1...12}$ /12= 1.11 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.66 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.13	79.14	76.15	73.17	70.18	67.2	67.2	70.18	73.17	76.15	79.14	82.13

Total = Sum(44)$_{1...12}$ = 895.94 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.79	106.52	109.92	95.83	91.95	79.35	73.53	84.37	85.38	99.5	108.62	117.95

Total = Sum(45)$_{1...12}$ = 1174.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.37	13.79	11.9	11.03	12.66	12.81	14.93	16.29	17.69

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.85	36.43	38.81	36.08	35.76	33.14	34.24	35.76	36.08	38.81	39.03	41.85	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	

Output from water heater (annual)$_{1...12}$ 1622.57 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.96	44.52	46.25	40.88	39.52	34.67	33.01	37	37.41	42.79	45.87	49.68	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.31	11.82	9.62	7.28	5.44	4.59	4.96	6.45	8.66	11	12.83	13.68	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.43	149.97	146.09	137.82	127.39	117.59	111.04	109.5	113.38	121.65	132.08	141.88	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	(71)

Water heating gains (Table 5)

(72)m=	68.49	66.26	62.16	56.78	53.11	48.15	44.37	49.72	51.96	57.51	63.71	66.78	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.79	279.6	269.42	253.44	237.5	221.89	211.93	217.23	225.56	241.71	260.18	273.89	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.13	x	36.79	x	0.63	x	0.7	=	23.95	(77)
Southeast 0.9x	0.77	x	2.13	x	62.67	x	0.63	x	0.7	=	40.8	(77)
Southeast 0.9x	0.77	x	2.13	x	85.75	x	0.63	x	0.7	=	55.82	(77)
Southeast 0.9x	0.77	x	2.13	x	106.25	x	0.63	x	0.7	=	69.17	(77)
Southeast 0.9x	0.77	x	2.13	x	119.01	x	0.63	x	0.7	=	77.47	(77)

TER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	2.13	x	118.15	x	0.63	x	0.7	=	76.91	(77)
Southeast	0.9x	0.77	x	2.13	x	113.91	x	0.63	x	0.7	=	74.15	(77)
Southeast	0.9x	0.77	x	2.13	x	104.39	x	0.63	x	0.7	=	67.95	(77)
Southeast	0.9x	0.77	x	2.13	x	92.85	x	0.63	x	0.7	=	60.44	(77)
Southeast	0.9x	0.77	x	2.13	x	69.27	x	0.63	x	0.7	=	45.09	(77)
Southeast	0.9x	0.77	x	2.13	x	44.07	x	0.63	x	0.7	=	28.69	(77)
Southeast	0.9x	0.77	x	2.13	x	31.49	x	0.63	x	0.7	=	20.5	(77)
Southwest	0.9x	0.77	x	5.94	x	36.79		0.63	x	0.7	=	66.79	(79)
Southwest	0.9x	0.77	x	2.13	x	36.79		0.63	x	0.7	=	23.95	(79)
Southwest	0.9x	0.77	x	5.94	x	62.67		0.63	x	0.7	=	113.77	(79)
Southwest	0.9x	0.77	x	2.13	x	62.67		0.63	x	0.7	=	40.8	(79)
Southwest	0.9x	0.77	x	5.94	x	85.75		0.63	x	0.7	=	155.67	(79)
Southwest	0.9x	0.77	x	2.13	x	85.75		0.63	x	0.7	=	55.82	(79)
Southwest	0.9x	0.77	x	5.94	x	106.25		0.63	x	0.7	=	192.88	(79)
Southwest	0.9x	0.77	x	2.13	x	106.25		0.63	x	0.7	=	69.17	(79)
Southwest	0.9x	0.77	x	5.94	x	119.01		0.63	x	0.7	=	216.04	(79)
Southwest	0.9x	0.77	x	2.13	x	119.01		0.63	x	0.7	=	77.47	(79)
Southwest	0.9x	0.77	x	5.94	x	118.15		0.63	x	0.7	=	214.48	(79)
Southwest	0.9x	0.77	x	2.13	x	118.15		0.63	x	0.7	=	76.91	(79)
Southwest	0.9x	0.77	x	5.94	x	113.91		0.63	x	0.7	=	206.78	(79)
Southwest	0.9x	0.77	x	2.13	x	113.91		0.63	x	0.7	=	74.15	(79)
Southwest	0.9x	0.77	x	5.94	x	104.39		0.63	x	0.7	=	189.5	(79)
Southwest	0.9x	0.77	x	2.13	x	104.39		0.63	x	0.7	=	67.95	(79)
Southwest	0.9x	0.77	x	5.94	x	92.85		0.63	x	0.7	=	168.56	(79)
Southwest	0.9x	0.77	x	2.13	x	92.85		0.63	x	0.7	=	60.44	(79)
Southwest	0.9x	0.77	x	5.94	x	69.27		0.63	x	0.7	=	125.74	(79)
Southwest	0.9x	0.77	x	2.13	x	69.27		0.63	x	0.7	=	45.09	(79)
Southwest	0.9x	0.77	x	5.94	x	44.07		0.63	x	0.7	=	80	(79)
Southwest	0.9x	0.77	x	2.13	x	44.07		0.63	x	0.7	=	28.69	(79)
Southwest	0.9x	0.77	x	5.94	x	31.49		0.63	x	0.7	=	57.16	(79)
Southwest	0.9x	0.77	x	2.13	x	31.49		0.63	x	0.7	=	20.5	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	114.7	195.37	267.31	331.21	370.99	368.3	355.08	325.41	289.44	215.92	137.38	98.16	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	396.48	474.97	536.73	584.66	608.49	590.19	567.01	542.64	515	457.63	397.56	372.05	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.89	0.77	0.58	0.43	0.46	0.7	0.92	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.95	20.16	20.42	20.71	20.9	20.98	21	21	20.95	20.7	20.27	19.91	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.97	19.98	19.98	19.99	19.99	20	20	20	20	19.99	19.99	19.98	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.86	0.71	0.5	0.33	0.37	0.61	0.89	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.6	18.89	19.27	19.67	19.9	19.99	20	20	19.97	19.67	19.07	18.55	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.04	19.31	19.64	20.01	20.23	20.31	20.33	20.33	20.29	20	19.46	19	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.04	19.31	19.64	20.01	20.23	20.31	20.33	20.33	20.29	20	19.46	19	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.94	0.86	0.72	0.53	0.36	0.4	0.64	0.89	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	391.91	462.26	504.65	504.85	439.81	310.72	205.78	215.99	328.96	407.64	387.7	368.8	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	843.29	821.94	747.9	623.74	477.72	316.53	206.45	217.08	344.28	526.86	695.84	837.32	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	335.83	241.71	180.98	85.61	28.2	0	0	0	0	88.7	221.86	348.58	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1531.47 (98)

Space heating requirement in kWh/m²/year 30.35 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	335.83	241.71	180.98	85.61	28.2	0	0	0	0	88.7	221.86	348.58	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	359.56	258.79	193.76	91.65	30.2	0	0	0	0	94.97	237.54	373.22	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1639.69 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8

Efficiency of water heater 80.3 (216)

(217)m= 86.82 | 86.36 | 85.55 | 83.99 | 81.96 | 80.3 | 80.3 | 80.3 | 80.3 | 83.97 | 86.07 | 86.96 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 188.48 | 165.52 | 173.86 | 157.05 | 155.83 | 140.08 | 134.21 | 149.61 | 151.26 | 164.72 | 171.53 | 183.76

Total = Sum(219a)$_{1...12}$ = 1935.93 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1639.69	
Water heating fuel used		1935.93	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		235.08	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	354.17	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	418.16	(264)
Space and water heating	(261) + (262) + (263) + (264) =			772.33	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	122.01	(268)
Total CO2, kg/year	sum of (265)…(271) =			933.27	(272)

TER = 18.5 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 8

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.46	(1a) x	2.56	(2a) =	129.18	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.46	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.18	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.94	x1/[1/(1.4)+ 0.04]		=	7.87			(27)
Windows Type 2			2.13	x1/[1/(1.4)+ 0.04]		=	2.82			(27)
Windows Type 3			2.13	x1/[1/(1.4)+ 0.04]		=	2.82			(27)
Floor			50.46	x	0.13	=	6.5598			(28)
Walls Type1	24.7	10.2	14.5	x	0.18	=	2.61			(29)
Walls Type2	33.62	2.42	31.2	x	0.18	=	5.62			(29)
Total area of elements, m²			108.78							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 30.73 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6327.45 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.68 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 34.4 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.42	25.26	25.1	24.37	24.23	23.59	23.59	23.47	23.84	24.23	24.51	24.8	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	59.82	59.66	59.51	58.77	58.63	58	58	57.88	58.24	58.63	58.91	59.2	

Average = Sum(39)$_{1...12}$ /12= 58.77 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.19	1.18	1.18	1.16	1.16	1.15	1.15	1.15	1.15	1.16	1.17	1.17	
Average = Sum(40)$_{1...12}$ /12=													1.16 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.66 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	82.13	79.14	76.15	73.17	70.18	67.2	67.2	70.18	73.17	76.15	79.14	82.13	
Total = Sum(44)$_{1...12}$ =													895.94 (44)
Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)													
(45)m=	121.79	106.52	109.92	95.83	91.95	79.35	73.53	84.37	85.38	99.5	108.62	117.95	
Total = Sum(45)$_{1...12}$ =													1174.72 (45)
If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)													
(46)m=	18.27	15.98	16.49	14.37	13.79	11.9	11.03	12.66	12.81	14.93	16.29	17.69	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)
If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)
If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H													
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.85	36.43	38.81	36.08	35.76	33.14	34.24	35.76	36.08	38.81	39.03	41.85	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	

Output from water heater (annual)$_{1...12}$ 1622.57 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.96	44.52	46.25	40.88	39.52	34.67	33.01	37	37.41	42.79	45.87	49.68	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.31	11.82	9.62	7.28	5.44	4.59	4.96	6.45	8.66	11	12.83	13.68	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.43	149.97	146.09	137.82	127.39	117.59	111.04	109.5	113.38	121.65	132.08	141.88	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	(71)

Water heating gains (Table 5)

(72)m=	68.49	66.26	62.16	56.78	53.11	48.15	44.37	49.72	51.96	57.51	63.71	66.78	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.79	279.6	269.42	253.44	237.5	221.89	211.93	217.23	225.56	241.71	260.18	273.89	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	5.94	x	36.79	x	0.63	x	0.7	=	66.79	(79)
Southwest$_{0.9x}$	0.77	x	2.13	x	36.79	x	0.63	x	0.7	=	23.95	(79)
Southwest$_{0.9x}$	0.77	x	5.94	x	62.67	x	0.63	x	0.7	=	113.77	(79)
Southwest$_{0.9x}$	0.77	x	2.13	x	62.67	x	0.63	x	0.7	=	40.8	(79)
Southwest$_{0.9x}$	0.77	x	5.94	x	85.75	x	0.63	x	0.7	=	155.67	(79)

TER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.13	x	85.75		0.63	x	0.7	=	55.82	(79)
Southwest 0.9x	0.77	x	5.94	x	106.25		0.63	x	0.7	=	192.88	(79)
Southwest 0.9x	0.77	x	2.13	x	106.25		0.63	x	0.7	=	69.17	(79)
Southwest 0.9x	0.77	x	5.94	x	119.01		0.63	x	0.7	=	216.04	(79)
Southwest 0.9x	0.77	x	2.13	x	119.01		0.63	x	0.7	=	77.47	(79)
Southwest 0.9x	0.77	x	5.94	x	118.15		0.63	x	0.7	=	214.48	(79)
Southwest 0.9x	0.77	x	2.13	x	118.15		0.63	x	0.7	=	76.91	(79)
Southwest 0.9x	0.77	x	5.94	x	113.91		0.63	x	0.7	=	206.78	(79)
Southwest 0.9x	0.77	x	2.13	x	113.91		0.63	x	0.7	=	74.15	(79)
Southwest 0.9x	0.77	x	5.94	x	104.39		0.63	x	0.7	=	189.5	(79)
Southwest 0.9x	0.77	x	2.13	x	104.39		0.63	x	0.7	=	67.95	(79)
Southwest 0.9x	0.77	x	5.94	x	92.85		0.63	x	0.7	=	168.56	(79)
Southwest 0.9x	0.77	x	2.13	x	92.85		0.63	x	0.7	=	60.44	(79)
Southwest 0.9x	0.77	x	5.94	x	69.27		0.63	x	0.7	=	125.74	(79)
Southwest 0.9x	0.77	x	2.13	x	69.27		0.63	x	0.7	=	45.09	(79)
Southwest 0.9x	0.77	x	5.94	x	44.07		0.63	x	0.7	=	80	(79)
Southwest 0.9x	0.77	x	2.13	x	44.07		0.63	x	0.7	=	28.69	(79)
Southwest 0.9x	0.77	x	5.94	x	31.49		0.63	x	0.7	=	57.16	(79)
Southwest 0.9x	0.77	x	2.13	x	31.49		0.63	x	0.7	=	20.5	(79)
Northwest 0.9x	0.77	x	2.13	x	11.28	x	0.63	x	0.7	=	7.34	(81)
Northwest 0.9x	0.77	x	2.13	x	22.97	x	0.63	x	0.7	=	14.95	(81)
Northwest 0.9x	0.77	x	2.13	x	41.38	x	0.63	x	0.7	=	26.94	(81)
Northwest 0.9x	0.77	x	2.13	x	67.96	x	0.63	x	0.7	=	44.24	(81)
Northwest 0.9x	0.77	x	2.13	x	91.35	x	0.63	x	0.7	=	59.46	(81)
Northwest 0.9x	0.77	x	2.13	x	97.38	x	0.63	x	0.7	=	63.39	(81)
Northwest 0.9x	0.77	x	2.13	x	91.1	x	0.63	x	0.7	=	59.3	(81)
Northwest 0.9x	0.77	x	2.13	x	72.63	x	0.63	x	0.7	=	47.28	(81)
Northwest 0.9x	0.77	x	2.13	x	50.42	x	0.63	x	0.7	=	32.82	(81)
Northwest 0.9x	0.77	x	2.13	x	28.07	x	0.63	x	0.7	=	18.27	(81)
Northwest 0.9x	0.77	x	2.13	x	14.2	x	0.63	x	0.7	=	9.24	(81)
Northwest 0.9x	0.77	x	2.13	x	9.21	x	0.63	x	0.7	=	6	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	98.09	169.52	238.43	306.28	352.98	354.79	340.24	304.73	261.82	189.1	117.93	83.66	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	379.88	449.13	507.85	559.73	590.48	576.68	552.16	521.97	487.38	430.81	378.11	357.55	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.99	0.97	0.91	0.8	0.62	0.46	0.5	0.74	0.94	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.85	20.04	20.31	20.63	20.86	20.97	20.99	20.99	20.93	20.62	20.17	19.82	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.93	19.93	19.94	19.95	19.95	19.96	19.96	19.96	19.96	19.95	19.95	19.94	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.96	0.89	0.74	0.53	0.35	0.39	0.66	0.92	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.42	18.7	19.09	19.53	19.82	19.94	19.96	19.96	19.9	19.53	18.9	18.38	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.89	19.14	19.49	19.89	20.16	20.28	20.3	20.3	20.24	19.89	19.32	18.85	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.89	19.14	19.49	19.89	20.16	20.28	20.3	20.3	20.24	19.89	19.32	18.85	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.89	0.75	0.56	0.39	0.43	0.68	0.91	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	376.22	439.68	483.85	496.08	444.79	320.63	213.34	223.69	333.67	393.7	370.61	354.91	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	872.72	849.56	772.93	646.09	496.29	329.39	214.47	225.57	357.55	544.62	719.76	867.22	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	369.39	275.44	215.07	108.01	38.32	0	0	0	0	112.29	251.39	381.16	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1751.06 (98)

Space heating requirement in kWh/m²/year 34.7 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	369.39	275.44	215.07	108.01	38.32	0	0	0	0	112.29	251.39	381.16	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	395.5	294.9	230.27	115.64	41.02	0	0	0	0	120.22	269.15	408.1	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1874.8 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8

Efficiency of water heater 80.3 (216)

(217)m= 87.04 | 86.68 | 85.98 | 84.55 | 82.43 | 80.3 | 80.3 | 80.3 | 80.3 | 84.53 | 86.38 | 87.16 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 188.01 | 164.92 | 172.98 | 156.01 | 154.95 | 140.08 | 134.21 | 149.61 | 151.26 | 163.62 | 170.92 | 183.34

Total = Sum(219a)$_{1...12}$ = 1929.93 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1874.8	
Water heating fuel used		1929.93	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		235.08	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	404.96	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	416.87	(264)
Space and water heating	(261) + (262) + (263) + (264) =			821.82	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	122.01	(268)
Total CO2, kg/year	sum of (265)…(271) =			982.76	(272)

TER = 19.48 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 9

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.04	(1a) x	2.56	(2a) =	186.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.04	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.44	0.43	0.38	0.38	0.33	0.33	0.32	0.35	0.38	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.38	x1/[1/(1.4)+ 0.04]		=	9.78			(27)
Windows Type 2			4.23	x1/[1/(1.4)+ 0.04]		=	5.61			(27)
Floor			73.04	x	0.13	=	9.4952			(28)
Walls Type1	36.47	15.84	20.63	x	0.18	=	3.71			(29)
Walls Type2	41.48	2.42	39.06	x	0.18	=	7.03			(29)
Total area of elements, m²			150.99							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.66 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 9049.13 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.83 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 47.49 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	36.96	36.72	36.49	35.4	35.19	34.24	34.24	34.07	34.61	35.19	35.6	36.04	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	84.45	84.21	83.98	82.89	82.68	81.73	81.73	81.55	82.1	82.68	83.09	83.53	

Average = Sum(39)$_{1...12}$ /12= 82.88 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.16	1.15	1.15	1.13	1.13	1.12	1.12	1.12	1.12	1.13	1.14	1.14

Average = Sum(40)$_{1...12}$ /12= 1.13 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.24 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.17	94.6	91.03	87.46	83.89	80.32	80.32	83.89	87.46	91.03	94.6	98.17

Total = Sum(44)$_{1...12}$ = 1070.92 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.58	127.32	131.39	114.55	109.91	94.84	87.89	100.85	102.06	118.94	129.83	140.99

Total = Sum(45)$_{1...12}$ = 1404.14 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.84	19.1	19.71	17.18	16.49	14.23	13.18	15.13	15.31	17.84	19.47	21.15

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.03	43.54	46.39	43.13	42.75	39.61	40.93	42.75	43.13	46.39	46.65	50.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	

Output from water heater (annual)$_{1...12}$ 1939.46 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.91	53.22	55.28	48.87	47.23	41.44	39.45	44.22	44.72	51.14	54.83	59.38	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.23	16.19	13.17	9.97	7.45	6.29	6.8	8.84	11.86	15.06	17.57	18.74	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.29	206.41	201.06	189.69	175.34	161.84	152.83	150.71	156.05	167.42	181.78	195.27	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	(71)

Water heating gains (Table 5)

(72)m=	81.87	79.2	74.31	67.87	63.48	57.55	53.03	59.44	62.11	68.74	76.15	79.82	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	365.15	362.56	349.3	328.3	307.04	286.45	273.42	279.75	290.78	311.99	336.27	354.59	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.38	x	36.79	x	0.63	x	0.7	=	82.99	(77)
Southeast 0.9x	0.77	x	4.23	x	36.79	x	0.63	x	0.7	=	95.13	(77)
Southeast 0.9x	0.77	x	7.38	x	62.67	x	0.63	x	0.7	=	141.36	(77)
Southeast 0.9x	0.77	x	4.23	x	62.67	x	0.63	x	0.7	=	162.04	(77)
Southeast 0.9x	0.77	x	7.38	x	85.75	x	0.63	x	0.7	=	193.41	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.23	x	85.75	x	0.63	x	0.7	=	221.71	(77)
Southeast 0.9x	0.77	x	7.38	x	106.25	x	0.63	x	0.7	=	239.64	(77)
Southeast 0.9x	0.77	x	4.23	x	106.25	x	0.63	x	0.7	=	274.71	(77)
Southeast 0.9x	0.77	x	7.38	x	119.01	x	0.63	x	0.7	=	268.42	(77)
Southeast 0.9x	0.77	x	4.23	x	119.01	x	0.63	x	0.7	=	307.7	(77)
Southeast 0.9x	0.77	x	7.38	x	118.15	x	0.63	x	0.7	=	266.48	(77)
Southeast 0.9x	0.77	x	4.23	x	118.15	x	0.63	x	0.7	=	305.48	(77)
Southeast 0.9x	0.77	x	7.38	x	113.91	x	0.63	x	0.7	=	256.91	(77)
Southeast 0.9x	0.77	x	4.23	x	113.91	x	0.63	x	0.7	=	294.51	(77)
Southeast 0.9x	0.77	x	7.38	x	104.39	x	0.63	x	0.7	=	235.44	(77)
Southeast 0.9x	0.77	x	4.23	x	104.39	x	0.63	x	0.7	=	269.9	(77)
Southeast 0.9x	0.77	x	7.38	x	92.85	x	0.63	x	0.7	=	209.42	(77)
Southeast 0.9x	0.77	x	4.23	x	92.85	x	0.63	x	0.7	=	240.07	(77)
Southeast 0.9x	0.77	x	7.38	x	69.27	x	0.63	x	0.7	=	156.23	(77)
Southeast 0.9x	0.77	x	4.23	x	69.27	x	0.63	x	0.7	=	179.09	(77)
Southeast 0.9x	0.77	x	7.38	x	44.07	x	0.63	x	0.7	=	99.4	(77)
Southeast 0.9x	0.77	x	4.23	x	44.07	x	0.63	x	0.7	=	113.94	(77)
Southeast 0.9x	0.77	x	7.38	x	31.49	x	0.63	x	0.7	=	71.02	(77)
Southeast 0.9x	0.77	x	4.23	x	31.49	x	0.63	x	0.7	=	81.41	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	178.12	303.4	415.12	514.35	576.12	571.95	551.42	505.34	449.49	335.32	213.34	152.43	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	543.26	665.95	764.42	842.65	883.16	858.4	824.85	785.09	740.27	647.31	549.61	507.02	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.99	0.96	0.9	0.77	0.59	0.43	0.47	0.71	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.88	20.1	20.38	20.68	20.89	20.98	21	20.99	20.95	20.67	20.21	19.84	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.96	19.96	19.96	19.97	19.97	19.99	19.99	19.99	19.98	19.97	19.97	19.97	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.87	0.71	0.5	0.33	0.37	0.62	0.9	0.98	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.48	18.8	19.2	19.62	19.87	19.97	19.98	19.99	19.94	19.61	18.97	18.43	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.86	19.15	19.52	19.91	20.15	20.25	20.26	20.26	20.22	19.9	19.31	18.82	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.86	19.15	19.52	19.91	20.15	20.25	20.26	20.26	20.22	19.9	19.31	18.82	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.94	0.87	0.73	0.53	0.36	0.4	0.65	0.9	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	538.14	650.05	721.4	730.55	640.4	452.43	298.05	313.06	477.67	581.67	538.07	503.49	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1229.87	1200.34	1093.4	912.65	698.66	461.43	299.09	314.77	502.08	768.86	1014.47	1220.93	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	514.64	369.79	276.77	131.11	43.35	0	0	0	0	139.27	343.01	533.77	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2351.72 (98)

Space heating requirement in kWh/m²/year 32.2 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	514.64	369.79	276.77	131.11	43.35	0	0	0	0	139.27	343.01	533.77	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	551.01	395.93	296.33	140.37	46.41	0	0	0	0	149.11	367.25	571.49	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2517.9 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01

Efficiency of water heater 80.3 (216)

(217)m=	87.37	86.94	86.16	84.59	82.33	80.3	80.3	80.3	80.3	84.62	86.7	87.5	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	223.87	196.52	206.33	186.4	185.41	167.44	160.42	178.83	180.81	195.37	203.56	218.3	

Total = Sum(219a)$_{1...12}$ = 2303.26 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2517.9

TER WorkSheet: New dwelling design stage

Water heating fuel used		2303.26	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		321.92	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	543.87	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	497.5	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1041.37	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	167.08	(268)
Total CO2, kg/year		sum of (265)…(271) =			1247.37	(272)

TER = 17.08 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 10

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.73	(1a) x	2.56	(2a) =	188.75	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.73	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.75	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.43	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.46	x	1/[1/(1.4)+ 0.04]	=	9.89			(27)
Windows Type 2			4.28	x	1/[1/(1.4)+ 0.04]	=	5.67			(27)
Floor			73.73	x	0.13	=	9.5849			(28)
Walls Type1	31.87	16.02	15.85	x	0.18	=	2.85			(29)
Walls Type2	46.82	2.42	44.4	x	0.18	=	7.99			(29)
Total area of elements, m²			152.42							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 44.09 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 9134.55 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.68 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 47.76 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	37.26	37.02	36.79	35.7	35.49	34.54	34.54	34.36	34.91	35.49	35.91	36.34	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	85.03	84.79	84.56	83.46	83.26	82.3	82.3	82.13	82.67	83.26	83.67	84.1	

Average = Sum(39)$_{1...12}$ /12= 83.46 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.15	1.15	1.15	1.13	1.13	1.12	1.12	1.11	1.12	1.13	1.13	1.14	
Average = Sum(40)$_{1...12}$ /12=													1.13 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.61 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	98.57	94.99	91.41	87.82	84.24	80.65	80.65	84.24	87.82	91.41	94.99	98.57	
Total = Sum(44)$_{1...12}$ =													1075.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.18	127.85	131.93	115.02	110.37	95.24	88.25	101.27	102.48	119.43	130.37	141.57	
Total = Sum(45)$_{1...12}$ =													1409.96 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.93	19.18	19.79	17.25	16.55	14.29	13.24	15.19	15.37	17.91	19.56	21.24	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.23	43.72	46.58	43.31	42.93	39.77	41.1	42.93	43.31	46.58	46.84	50.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.2	145.79	166.01	177.21	191.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.2	145.79	166.01	177.21	191.8	

Output from water heater (annual)$_{1...12}$ 1947.49 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.16	53.44	55.51	49.07	47.43	41.61	39.62	44.4	44.9	51.36	55.06	59.63	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.37	16.31	13.27	10.04	7.51	6.34	6.85	8.9	11.95	15.17	17.71	18.88	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.84	207.98	202.59	191.14	176.67	163.08	153.99	151.86	157.24	168.7	183.16	196.76	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	(71)

Water heating gains (Table 5)

(72)m=	82.21	79.53	74.61	68.16	63.75	57.79	53.25	59.68	62.36	69.03	76.47	80.15	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.41	364.81	351.47	330.33	308.92	288.2	275.09	281.44	292.55	313.89	338.34	356.78	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.46	x	36.79	x	0.63	x	0.7	=	83.89	(77)
Southeast 0.9x	0.77	x	4.28	x	36.79	x	0.63	x	0.7	=	96.25	(77)
Southeast 0.9x	0.77	x	7.46	x	62.67	x	0.63	x	0.7	=	142.89	(77)
Southeast 0.9x	0.77	x	4.28	x	62.67	x	0.63	x	0.7	=	163.96	(77)
Southeast 0.9x	0.77	x	7.46	x	85.75	x	0.63	x	0.7	=	195.51	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.28	x	85.75	x	0.63	x	0.7	=	224.33	(77)
Southeast 0.9x	0.77	x	7.46	x	106.25	x	0.63	x	0.7	=	242.24	(77)
Southeast 0.9x	0.77	x	4.28	x	106.25	x	0.63	x	0.7	=	277.96	(77)
Southeast 0.9x	0.77	x	7.46	x	119.01	x	0.63	x	0.7	=	271.33	(77)
Southeast 0.9x	0.77	x	4.28	x	119.01	x	0.63	x	0.7	=	311.34	(77)
Southeast 0.9x	0.77	x	7.46	x	118.15	x	0.63	x	0.7	=	269.37	(77)
Southeast 0.9x	0.77	x	4.28	x	118.15	x	0.63	x	0.7	=	309.09	(77)
Southeast 0.9x	0.77	x	7.46	x	113.91	x	0.63	x	0.7	=	259.7	(77)
Southeast 0.9x	0.77	x	4.28	x	113.91	x	0.63	x	0.7	=	297.99	(77)
Southeast 0.9x	0.77	x	7.46	x	104.39	x	0.63	x	0.7	=	238	(77)
Southeast 0.9x	0.77	x	4.28	x	104.39	x	0.63	x	0.7	=	273.09	(77)
Southeast 0.9x	0.77	x	7.46	x	92.85	x	0.63	x	0.7	=	211.69	(77)
Southeast 0.9x	0.77	x	4.28	x	92.85	x	0.63	x	0.7	=	242.91	(77)
Southeast 0.9x	0.77	x	7.46	x	69.27	x	0.63	x	0.7	=	157.92	(77)
Southeast 0.9x	0.77	x	4.28	x	69.27	x	0.63	x	0.7	=	181.21	(77)
Southeast 0.9x	0.77	x	7.46	x	44.07	x	0.63	x	0.7	=	100.48	(77)
Southeast 0.9x	0.77	x	4.28	x	44.07	x	0.63	x	0.7	=	115.29	(77)
Southeast 0.9x	0.77	x	7.46	x	31.49	x	0.63	x	0.7	=	71.79	(77)
Southeast 0.9x	0.77	x	4.28	x	31.49	x	0.63	x	0.7	=	82.37	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	180.14	306.84	419.84	520.2	582.67	578.45	557.69	511.09	454.6	339.13	215.77	154.16	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	547.55	671.66	771.31	850.53	891.59	866.66	832.78	792.53	747.15	653.02	554.1	510.94	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.99	0.96	0.9	0.77	0.59	0.43	0.47	0.71	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.89	20.1	20.38	20.69	20.89	20.98	21	20.99	20.95	20.67	20.21	19.85	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.96	19.96	19.96	19.97	19.98	19.99	19.99	19.99	19.98	19.98	19.97	19.97	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.87	0.71	0.5	0.33	0.37	0.62	0.9	0.98	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.49	18.81	19.21	19.63	19.88	19.97	19.99	19.99	19.95	19.62	18.98	18.44	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.87	19.16	19.52	19.91	20.15	20.25	20.26	20.26	20.22	19.9	19.31	18.82	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.87	19.16	19.52	19.91	20.15	20.25	20.26	20.26	20.22	19.9	19.31	18.82	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.94	0.87	0.72	0.53	0.36	0.4	0.64	0.9	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	542.42	655.62	727.78	736.92	645.54	455.71	300.09	315.22	481.29	586.63	542.49	507.41	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1238.45	1208.79	1101.13	919.13	703.56	464.61	301.11	316.91	505.56	774.3	1021.62	1229.49	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	517.85	371.73	277.77	131.19	43.16	0	0	0	0	139.63	344.98	537.23	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2363.54 (98)

Space heating requirement in kWh/m²/year 32.06 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	517.85	371.73	277.77	131.19	43.16	0	0	0	0	139.63	344.98	537.23	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	554.44	397.99	297.4	140.46	46.21	0	0	0	0	149.49	369.35	575.19	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2530.56 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.2	145.79	166.01	177.21	191.8

Efficiency of water heater 80.3 (216)

(217)m=	87.38	86.95	86.16	84.58	82.32	80.3	80.3	80.3	80.3	84.62	86.7	87.5	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	224.79	197.33	207.19	187.19	186.21	168.13	161.08	179.57	181.55	196.18	204.4	219.19	

Total = Sum(219a)$_{1...12}$ = 2312.82 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2530.56

TER WorkSheet: New dwelling design stage

Water heating fuel used		2312.82	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		324.35	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	546.6	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	499.57	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1046.17	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	168.34	(268)
Total CO2, kg/year		sum of (265)…(271) =			1253.43	(272)

TER = 17 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat11

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	52.19	(1a) x	2.56	(2a) =	133.61	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	52.19	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		133.61	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.43	0.42	0.42	0.37	0.37	0.32	0.32	0.31	0.34	0.37	0.38	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			4.95	x1/[1/(1.4)+ 0.04]		=	6.56			(27)
Windows Type 2			2.84	x1/[1/(1.4)+ 0.04]		=	3.77			(27)
Floor			52.19	x	0.13	=	6.784699			(28)
Walls Type1	24.97	10.63	14.34	x	0.18	=	2.58			(29)
Walls Type2	39.92	2.42	37.5	x	0.18	=	6.75			(29)
Total area of elements, m²			117.08							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 32.63 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6622.18 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.68 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 36.3 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	26.18	26.02	25.86	25.12	24.99	24.34	24.34	24.22	24.59	24.99	25.27	25.56	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	62.49	62.33	62.17	61.43	61.29	60.65	60.65	60.53	60.89	61.29	61.57	61.86	

Average = Sum(39)$_{1...12}$ /12= 61.43 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.2	1.19	1.19	1.18	1.17	1.16	1.16	1.16	1.17	1.17	1.18	1.19	
Average = Sum(40)$_{1...12}$ /12=													1.18 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.75 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.87 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	83.46	80.43	77.39	74.36	71.32	68.29	68.29	71.32	74.36	77.39	80.43	83.46	
Total = Sum(44)$_{1...12}$ =													910.48 (44)
Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)													
(45)m=	123.77	108.25	111.7	97.39	93.44	80.64	74.72	85.74	86.77	101.12	110.38	119.86	
Total = Sum(45)$_{1...12}$ =													1193.79 (45)
If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)													
(46)m=	18.57	16.24	16.76	14.61	14.02	12.1	11.21	12.86	13.02	15.17	16.56	17.98	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)
If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)
If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H													
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.53	37.02	39.44	36.67	36.34	33.68	34.8	36.34	36.67	39.44	39.66	42.53	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	166.3	145.27	151.14	134.06	129.79	114.31	109.52	122.09	123.44	140.56	150.04	162.4	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	166.3	145.27	151.14	134.06	129.79	114.31	109.52	122.09	123.44	140.56	150.04	162.4	

Output from water heater (annual)$_{1...12}$ 1648.9 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.79	45.25	47	41.55	40.16	35.23	33.54	37.6	38.02	43.48	46.62	50.49	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.7	12.17	9.9	7.49	5.6	4.73	5.11	6.64	8.92	11.32	13.21	14.09	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	152.92	154.51	150.51	141.99	131.25	121.15	114.4	112.81	116.81	125.33	136.07	146.17	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	(71)

Water heating gains (Table 5)

(72)m=	69.61	67.33	63.17	57.71	53.97	48.93	45.09	50.53	52.8	58.44	64.75	67.86	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	288.55	286.33	275.9	259.51	243.14	227.13	216.92	222.31	230.85	247.41	266.35	280.44	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	4.95	x	36.79	x	0.63	x	0.7	=	55.66	(77)
Southeast 0.9x	0.77	x	2.84	x	36.79	x	0.63	x	0.7	=	63.87	(77)
Southeast 0.9x	0.77	x	4.95	x	62.67	x	0.63	x	0.7	=	94.81	(77)
Southeast 0.9x	0.77	x	2.84	x	62.67	x	0.63	x	0.7	=	108.79	(77)
Southeast 0.9x	0.77	x	4.95	x	85.75	x	0.63	x	0.7	=	129.73	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.84	x	85.75	x	0.63	x	0.7	=	148.86	(77)
Southeast 0.9x	0.77	x	4.95	x	106.25	x	0.63	x	0.7	=	160.74	(77)
Southeast 0.9x	0.77	x	2.84	x	106.25	x	0.63	x	0.7	=	184.44	(77)
Southeast 0.9x	0.77	x	4.95	x	119.01	x	0.63	x	0.7	=	180.04	(77)
Southeast 0.9x	0.77	x	2.84	x	119.01	x	0.63	x	0.7	=	206.59	(77)
Southeast 0.9x	0.77	x	4.95	x	118.15	x	0.63	x	0.7	=	178.74	(77)
Southeast 0.9x	0.77	x	2.84	x	118.15	x	0.63	x	0.7	=	205.09	(77)
Southeast 0.9x	0.77	x	4.95	x	113.91	x	0.63	x	0.7	=	172.32	(77)
Southeast 0.9x	0.77	x	2.84	x	113.91	x	0.63	x	0.7	=	197.73	(77)
Southeast 0.9x	0.77	x	4.95	x	104.39	x	0.63	x	0.7	=	157.92	(77)
Southeast 0.9x	0.77	x	2.84	x	104.39	x	0.63	x	0.7	=	181.21	(77)
Southeast 0.9x	0.77	x	4.95	x	92.85	x	0.63	x	0.7	=	140.46	(77)
Southeast 0.9x	0.77	x	2.84	x	92.85	x	0.63	x	0.7	=	161.18	(77)
Southeast 0.9x	0.77	x	4.95	x	69.27	x	0.63	x	0.7	=	104.79	(77)
Southeast 0.9x	0.77	x	2.84	x	69.27	x	0.63	x	0.7	=	120.24	(77)
Southeast 0.9x	0.77	x	4.95	x	44.07	x	0.63	x	0.7	=	66.67	(77)
Southeast 0.9x	0.77	x	2.84	x	44.07	x	0.63	x	0.7	=	76.5	(77)
Southeast 0.9x	0.77	x	4.95	x	31.49	x	0.63	x	0.7	=	47.63	(77)
Southeast 0.9x	0.77	x	2.84	x	31.49	x	0.63	x	0.7	=	54.66	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	119.53	203.61	278.58	345.18	386.63	383.83	370.05	339.13	301.64	225.03	143.17	102.29	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	408.08	489.94	554.48	604.69	629.77	610.96	586.97	561.44	532.5	472.44	409.52	382.73	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.9	0.79	0.61	0.45	0.49	0.72	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.86	20.07	20.34	20.65	20.87	20.97	20.99	20.99	20.94	20.64	20.19	19.82	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.92	19.92	19.93	19.94	19.94	19.95	19.95	19.95	19.95	19.94	19.94	19.93	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.88	0.73	0.52	0.35	0.38	0.64	0.9	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.43	18.73	19.12	19.55	19.82	19.93	19.95	19.95	19.9	19.55	18.92	18.38	(90)

fLA = Living area ÷ (4) = 0.32 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.88	19.15	19.51	19.9	20.15	20.26	20.28	20.28	20.23	19.9	19.32	18.84	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.88	19.15	19.51	19.9	20.15	20.26	20.28	20.28	20.23	19.9	19.32	18.84	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.94	0.87	0.74	0.55	0.38	0.42	0.66	0.9	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	403.52	477.49	523.55	528.46	467	334.53	222	233	351.44	424.86	399.92	379.48	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	911.13	888.36	808.63	675.45	517.95	343.32	223.12	234.77	373.12	569.93	752.35	905.37	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	377.66	276.1	212.1	105.83	37.9	0	0	0	0	107.94	253.75	391.26	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1762.54 (98)

Space heating requirement in kWh/m²/year 33.77 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	377.66	276.1	212.1	105.83	37.9	0	0	0	0	107.94	253.75	391.26	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	404.35	295.61	227.08	113.31	40.58	0	0	0	0	115.56	271.68	418.91	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1887.09 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	166.3	145.27	151.14	134.06	129.79	114.31	109.52	122.09	123.44	140.56	150.04	162.4

Efficiency of water heater 80.3 (216)

(217)m=	87.05	86.64	85.9	84.46	82.38	80.3	80.3	80.3	80.3	84.4	86.36	87.18	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	191.04	167.66	175.94	158.71	157.55	142.36	136.39	152.04	153.72	166.54	173.73	186.27	

Total = Sum(219a)$_{1...12}$ = 1961.95 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1887.09

TER WorkSheet: New dwelling design stage

Water heating fuel used		1961.95	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		242.02	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	407.61	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	423.78	(264)
Space and water heating	(261) + (262) + (263) + (264) =				831.39	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	125.61	(268)
Total CO2, kg/year		sum of (265)…(271) =			995.93	(272)

TER = 19.08 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 12

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.42	(1a) x	2.56	(2a) =	187.95	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.42	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.95	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.44	0.43	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.56	x1/[1/(1.4)+ 0.04]		=	7.37			(27)
Windows Type 2			3.19	x1/[1/(1.4)+ 0.04]		=	4.23			(27)
Windows Type 3			2	x1/[1/(1.4)+ 0.04]		=	2.65			(27)
Windows Type 4			2	x1/[1/(1.4)+ 0.04]		=	2.65			(27)
Floor			73.418	x	0.13	=	9.544339			(28)
Walls Type1	52.05	15.94	36.11	x	0.18	=	6.5			(29)
Walls Type2	17.46	2.42	15.04	x	0.18	=	2.71			(29)
Total area of elements, m²			142.93							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 42.3 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8945.6 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.2 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 48.5 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	37.12	36.89	36.65	35.56	35.36	34.4	34.4	34.23	34.77	35.36	35.77	36.2	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	85.63	85.39	85.16	84.06	83.86	82.91	82.91	82.73	83.28	83.86	84.27	84.71	

Average = Sum(39)$_{1...12}$ /12= 84.06 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.17	1.16	1.16	1.15	1.14	1.13	1.13	1.13	1.13	1.14	1.15	1.15	

Average = Sum(40)$_{1...12}$ /12= 1.15 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.45 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	98.39	94.81	91.24	87.66	84.08	80.5	80.5	84.08	87.66	91.24	94.81	98.39	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1073.36 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	145.91	127.61	131.69	114.81	110.16	95.06	88.09	101.08	102.29	119.21	130.12	141.31	

Total = Sum(45)$_{1...12}$ = 1407.34 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.89	19.14	19.75	17.22	16.52	14.26	13.21	15.16	15.34	17.88	19.52	21.2	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.14	43.64	46.49	43.23	42.85	39.7	41.02	42.85	43.23	46.49	46.76	50.14	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	

Output from water heater (annual)$_{1...12}$ 1943.87 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.05	53.34	55.41	48.98	47.34	41.53	39.54	44.32	44.82	51.26	54.96	59.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.3	16.26	13.22	10.01	7.48	6.32	6.83	8.87	11.91	15.12	17.65	18.81	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.14	207.27	201.9	190.48	176.07	162.52	153.47	151.34	156.7	168.12	182.54	196.09	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	(71)

Water heating gains (Table 5)

(72)m=	82.06	79.38	74.47	68.03	63.63	57.68	53.15	59.57	62.25	68.9	76.33	80	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	366.39	363.8	350.49	329.41	308.07	287.41	274.34	280.68	291.75	313.03	337.41	355.79	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2	x	11.28	x	0.63	x	0.7	=	6.9	(75)
Northeast 0.9x	0.77	x	2	x	22.97	x	0.63	x	0.7	=	14.04	(75)
Northeast 0.9x	0.77	x	2	x	41.38	x	0.63	x	0.7	=	25.29	(75)
Northeast 0.9x	0.77	x	2	x	67.96	x	0.63	x	0.7	=	41.54	(75)
Northeast 0.9x	0.77	x	2	x	91.35	x	0.63	x	0.7	=	55.83	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2	x	97.38	x	0.63	x	0.7	=	59.52	(75)
Northeast 0.9x	0.77	x	2	x	91.1	x	0.63	x	0.7	=	55.68	(75)
Northeast 0.9x	0.77	x	2	x	72.63	x	0.63	x	0.7	=	44.39	(75)
Northeast 0.9x	0.77	x	2	x	50.42	x	0.63	x	0.7	=	30.82	(75)
Northeast 0.9x	0.77	x	2	x	28.07	x	0.63	x	0.7	=	17.16	(75)
Northeast 0.9x	0.77	x	2	x	14.2	x	0.63	x	0.7	=	8.68	(75)
Northeast 0.9x	0.77	x	2	x	9.21	x	0.63	x	0.7	=	5.63	(75)
Southeast 0.9x	0.77	x	5.56	x	36.79	x	0.63	x	0.7	=	62.52	(77)
Southeast 0.9x	0.77	x	3.19	x	36.79	x	0.63	x	0.7	=	71.74	(77)
Southeast 0.9x	0.77	x	5.56	x	62.67	x	0.63	x	0.7	=	106.5	(77)
Southeast 0.9x	0.77	x	3.19	x	62.67	x	0.63	x	0.7	=	122.2	(77)
Southeast 0.9x	0.77	x	5.56	x	85.75	x	0.63	x	0.7	=	145.71	(77)
Southeast 0.9x	0.77	x	3.19	x	85.75	x	0.63	x	0.7	=	167.2	(77)
Southeast 0.9x	0.77	x	5.56	x	106.25	x	0.63	x	0.7	=	180.54	(77)
Southeast 0.9x	0.77	x	3.19	x	106.25	x	0.63	x	0.7	=	207.17	(77)
Southeast 0.9x	0.77	x	5.56	x	119.01	x	0.63	x	0.7	=	202.22	(77)
Southeast 0.9x	0.77	x	3.19	x	119.01	x	0.63	x	0.7	=	232.05	(77)
Southeast 0.9x	0.77	x	5.56	x	118.15	x	0.63	x	0.7	=	200.76	(77)
Southeast 0.9x	0.77	x	3.19	x	118.15	x	0.63	x	0.7	=	230.37	(77)
Southeast 0.9x	0.77	x	5.56	x	113.91	x	0.63	x	0.7	=	193.56	(77)
Southeast 0.9x	0.77	x	3.19	x	113.91	x	0.63	x	0.7	=	222.1	(77)
Southeast 0.9x	0.77	x	5.56	x	104.39	x	0.63	x	0.7	=	177.38	(77)
Southeast 0.9x	0.77	x	3.19	x	104.39	x	0.63	x	0.7	=	203.54	(77)
Southeast 0.9x	0.77	x	5.56	x	92.85	x	0.63	x	0.7	=	157.77	(77)
Southeast 0.9x	0.77	x	3.19	x	92.85	x	0.63	x	0.7	=	181.04	(77)
Southeast 0.9x	0.77	x	5.56	x	69.27	x	0.63	x	0.7	=	117.7	(77)
Southeast 0.9x	0.77	x	3.19	x	69.27	x	0.63	x	0.7	=	135.06	(77)
Southeast 0.9x	0.77	x	5.56	x	44.07	x	0.63	x	0.7	=	74.88	(77)
Southeast 0.9x	0.77	x	3.19	x	44.07	x	0.63	x	0.7	=	85.93	(77)
Southeast 0.9x	0.77	x	5.56	x	31.49	x	0.63	x	0.7	=	53.5	(77)
Southeast 0.9x	0.77	x	3.19	x	31.49	x	0.63	x	0.7	=	61.4	(77)
Southwest 0.9x	0.77	x	2	x	36.79		0.63	x	0.7	=	22.49	(79)
Southwest 0.9x	0.77	x	2	x	62.67		0.63	x	0.7	=	38.31	(79)
Southwest 0.9x	0.77	x	2	x	85.75		0.63	x	0.7	=	52.41	(79)
Southwest 0.9x	0.77	x	2	x	106.25		0.63	x	0.7	=	64.94	(79)
Southwest 0.9x	0.77	x	2	x	119.01		0.63	x	0.7	=	72.74	(79)
Southwest 0.9x	0.77	x	2	x	118.15		0.63	x	0.7	=	72.22	(79)
Southwest 0.9x	0.77	x	2	x	113.91		0.63	x	0.7	=	69.62	(79)
Southwest 0.9x	0.77	x	2	x	104.39		0.63	x	0.7	=	63.81	(79)
Southwest 0.9x	0.77	x	2	x	92.85		0.63	x	0.7	=	56.75	(79)
Southwest 0.9x	0.77	x	2	x	69.27		0.63	x	0.7	=	42.34	(79)

TER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2	x	44.07		0.63	x	0.7	=	26.94	(79)
Southwest 0.9x	0.77	x	2	x	31.49		0.63	x	0.7	=	19.25	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	163.65	281.04	390.62	494.19	562.85	562.87	540.96	489.12	426.39	312.25	196.43	139.78	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	530.04	644.84	741.11	823.61	870.92	850.29	815.3	769.8	718.14	625.29	533.84	495.57	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.97	0.91	0.79	0.6	0.44	0.49	0.73	0.94	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.85	20.06	20.34	20.66	20.88	20.98	21	20.99	20.94	20.64	20.18	19.81	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.95	19.95	19.95	19.96	19.97	19.98	19.98	19.98	19.97	19.97	19.96	19.96	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.96	0.88	0.73	0.51	0.34	0.38	0.65	0.91	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.43	18.73	19.14	19.58	19.85	19.96	19.98	19.98	19.93	19.56	18.92	18.38	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.78	19.06	19.44	19.85	20.11	20.22	20.23	20.23	20.18	19.83	19.23	18.74	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.78	19.06	19.44	19.85	20.11	20.22	20.23	20.23	20.18	19.83	19.23	18.74	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.88	0.74	0.54	0.37	0.41	0.66	0.91	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	525.57	631.4	704.14	722.5	641.23	455.55	299.83	314.9	477.56	568.98	523.95	492.47	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1240.2	1209.52	1101.64	920.46	705.3	465.56	301.01	316.92	506.25	774.25	1022.37	1231.6	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	531.68	388.49	295.74	142.53	47.67	0	0	0	0	152.72	358.86	549.91	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2467.61 (98)

Space heating requirement in kWh/m²/year 33.61 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

TER WorkSheet: New dwelling design stage

Fraction of space heat from main system(s)	(202) = 1 – (201) =	1 (202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1 (204)
Efficiency of main space heating system 1		93.4 (206)
Efficiency of secondary/supplementary heating system, %		0 (208)

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)												
531.68	388.49	295.74	142.53	47.67	0	0	0	0	152.72	358.86	549.91	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)												(211)
569.25	415.95	316.64	152.6	51.03	0	0	0	0	163.51	384.22	588.77	

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 2641.98 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45

Efficiency of water heater 80.3 (216)

(217)m=	87.44	87.05	86.32	84.79	82.49	80.3	80.3	80.3	80.3	84.85	86.8	87.56

(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	224.22	196.73	206.42	186.38	185.49	167.82	160.79	179.24	181.22	195.29	203.79	218.66

Total = Sum(219a)$_{1...12}$ = 2306.04 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2641.98
Water heating fuel used		2306.04
Electricity for pumps, fans and electric keep-hot		
central heating pump:	30	(230c)
boiler with a fan-assisted flue	45	(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75 (231)
Electricity for lighting		323.25 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	570.67	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	498.1	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1068.77	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	167.77	(268)

TER WorkSheet: New dwelling design stage

Total CO2, kg/year	sum of (265)…(271) =	1275.46	(272)
TER =		17.37	(273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 13

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	89.09	(1a) x	2.56	(2a) =	228.06	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	89.09	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		228.06	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.13 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.38 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.32 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.41	0.41	0.4	0.36	0.35	0.31	0.31	0.3	0.32	0.35	0.36	0.38

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.54	0.55	0.56	0.57	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.54	0.55	0.56	0.57	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.31	x	1/[1/(1.4)+ 0.04]	=	9.69			(27)
Windows Type 2			2.87	x	1/[1/(1.4)+ 0.04]	=	3.8			(27)
Windows Type 3			2.62	x	1/[1/(1.4)+ 0.04]	=	3.47			(27)
Windows Type 4			4.19	x	1/[1/(1.4)+ 0.04]	=	5.55			(27)
Floor			89.086	x	0.13	=	11.58118			(28)
Walls Type1	67.1	19.86	47.24	x	0.18	=	8.5			(29)
Walls Type2	23.57	2.42	21.15	x	0.18	=	3.81			(29)
Roof	10.26	0	10.26	x	0.13	=	1.33			(30)
Total area of elements, m²			190.02							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 53.97 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11054.44 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.58 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 62.55 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

TER WorkSheet: New dwelling design stage

(38)m=	44.06	43.81	43.57	42.42	42.2	41.2	41.2	41.02	41.59	42.2	42.64	43.09	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	106.62	106.37	106.12	104.97	104.76	103.75	103.75	103.57	104.14	104.76	105.19	105.65	

Average = Sum(39)$_{1...12}$ /12= 104.97 (39)

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.2	1.19	1.19	1.18	1.18	1.16	1.16	1.16	1.17	1.18	1.18	1.19	

Average = Sum(40)$_{1...12}$ /12= 1.18 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.61 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 96.26 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	105.88	102.03	98.18	94.33	90.48	86.63	86.63	90.48	94.33	98.18	102.03	105.88	

Total = Sum(44)$_{1...12}$ = 1155.11 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	157.02	137.33	141.72	123.55	118.55	102.3	94.8	108.78	110.08	128.29	140.04	152.07	

Total = Sum(45)$_{1...12}$ = 1514.53 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.55	20.6	21.26	18.53	17.78	15.35	14.22	16.32	16.51	19.24	21.01	22.81	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

TER WorkSheet: New dwelling design stage

Primary circuit loss (annual) from Table 3 | 0 | (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.03	46.52	46.11	42.72	44.15	46.11	46.52	50.03	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	207.98	183.36	191.75	170.07	164.66	145.02	138.94	154.89	156.6	178.32	189.35	203.03	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	207.98	183.36	191.75	170.07	164.66	145.02	138.94	154.89	156.6	178.32	189.35	203.03	

Output from water heater (annual)$_{1...12}$ | 2083.98 | (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	64.95	57.17	59.63	52.71	50.95	44.7	42.56	47.7	48.23	55.16	58.89	63.3	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.16	18.8	15.29	11.57	8.65	7.3	7.89	10.26	13.77	17.48	20.4	21.75	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	237.39	239.85	233.64	220.43	203.75	188.07	177.59	175.13	181.34	194.55	211.23	226.91	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	(71)

Water heating gains (Table 5)

(72)m=	87.3	85.08	80.15	73.21	68.48	62.08	57.2	64.11	66.99	74.14	81.79	85.08	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	411.04	408.92	394.27	370.4	346.07	322.64	307.88	314.69	327.29	351.37	378.62	398.94	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.62	x	36.79	x	0.63	x	0.7	=	29.46	(79)
Southwest$_{0.9x}$	0.77	x	4.19	x	36.79	x	0.63	x	0.7	=	47.12	(79)

TER WorkSheet: New dwelling design stage

Southwest	0.9x	0.77	x	2.62	x	62.67		0.63	x	0.7	=	50.18	(79)
Southwest	0.9x	0.77	x	4.19	x	62.67		0.63	x	0.7	=	80.25	(79)
Southwest	0.9x	0.77	x	2.62	x	85.75		0.63	x	0.7	=	68.66	(79)
Southwest	0.9x	0.77	x	4.19	x	85.75		0.63	x	0.7	=	109.81	(79)
Southwest	0.9x	0.77	x	2.62	x	106.25		0.63	x	0.7	=	85.08	(79)
Southwest	0.9x	0.77	x	4.19	x	106.25		0.63	x	0.7	=	136.06	(79)
Southwest	0.9x	0.77	x	2.62	x	119.01		0.63	x	0.7	=	95.29	(79)
Southwest	0.9x	0.77	x	4.19	x	119.01		0.63	x	0.7	=	152.4	(79)
Southwest	0.9x	0.77	x	2.62	x	118.15		0.63	x	0.7	=	94.6	(79)
Southwest	0.9x	0.77	x	4.19	x	118.15		0.63	x	0.7	=	151.29	(79)
Southwest	0.9x	0.77	x	2.62	x	113.91		0.63	x	0.7	=	91.21	(79)
Southwest	0.9x	0.77	x	4.19	x	113.91		0.63	x	0.7	=	145.86	(79)
Southwest	0.9x	0.77	x	2.62	x	104.39		0.63	x	0.7	=	83.59	(79)
Southwest	0.9x	0.77	x	4.19	x	104.39		0.63	x	0.7	=	133.67	(79)
Southwest	0.9x	0.77	x	2.62	x	92.85		0.63	x	0.7	=	74.35	(79)
Southwest	0.9x	0.77	x	4.19	x	92.85		0.63	x	0.7	=	118.9	(79)
Southwest	0.9x	0.77	x	2.62	x	69.27		0.63	x	0.7	=	55.46	(79)
Southwest	0.9x	0.77	x	4.19	x	69.27		0.63	x	0.7	=	88.7	(79)
Southwest	0.9x	0.77	x	2.62	x	44.07		0.63	x	0.7	=	35.29	(79)
Southwest	0.9x	0.77	x	4.19	x	44.07		0.63	x	0.7	=	56.43	(79)
Southwest	0.9x	0.77	x	2.62	x	31.49		0.63	x	0.7	=	25.21	(79)
Southwest	0.9x	0.77	x	4.19	x	31.49		0.63	x	0.7	=	40.32	(79)
Northwest	0.9x	0.77	x	7.31	x	11.28	x	0.63	x	0.7	=	25.21	(81)
Northwest	0.9x	0.77	x	2.87	x	11.28	x	0.63	x	0.7	=	19.79	(81)
Northwest	0.9x	0.77	x	7.31	x	22.97	x	0.63	x	0.7	=	51.31	(81)
Northwest	0.9x	0.77	x	2.87	x	22.97	x	0.63	x	0.7	=	40.29	(81)
Northwest	0.9x	0.77	x	7.31	x	41.38	x	0.63	x	0.7	=	92.44	(81)
Northwest	0.9x	0.77	x	2.87	x	41.38	x	0.63	x	0.7	=	72.59	(81)
Northwest	0.9x	0.77	x	7.31	x	67.96	x	0.63	x	0.7	=	151.82	(81)
Northwest	0.9x	0.77	x	2.87	x	67.96	x	0.63	x	0.7	=	119.21	(81)
Northwest	0.9x	0.77	x	7.31	x	91.35	x	0.63	x	0.7	=	204.07	(81)
Northwest	0.9x	0.77	x	2.87	x	91.35	x	0.63	x	0.7	=	160.24	(81)
Northwest	0.9x	0.77	x	7.31	x	97.38	x	0.63	x	0.7	=	217.56	(81)
Northwest	0.9x	0.77	x	2.87	x	97.38	x	0.63	x	0.7	=	170.83	(81)
Northwest	0.9x	0.77	x	7.31	x	91.1	x	0.63	x	0.7	=	203.52	(81)
Northwest	0.9x	0.77	x	2.87	x	91.1	x	0.63	x	0.7	=	159.81	(81)
Northwest	0.9x	0.77	x	7.31	x	72.63	x	0.63	x	0.7	=	162.25	(81)
Northwest	0.9x	0.77	x	2.87	x	72.63	x	0.63	x	0.7	=	127.4	(81)
Northwest	0.9x	0.77	x	7.31	x	50.42	x	0.63	x	0.7	=	112.64	(81)
Northwest	0.9x	0.77	x	2.87	x	50.42	x	0.63	x	0.7	=	88.45	(81)
Northwest	0.9x	0.77	x	7.31	x	28.07	x	0.63	x	0.7	=	62.7	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	2.87	x	28.07	x	0.63	x	0.7	=	49.24	(81)
Northwest 0.9x	0.77	x	7.31	x	14.2	x	0.63	x	0.7	=	31.72	(81)
Northwest 0.9x	0.77	x	2.87	x	14.2	x	0.63	x	0.7	=	24.9	(81)
Northwest 0.9x	0.77	x	7.31	x	9.21	x	0.63	x	0.7	=	20.58	(81)
Northwest 0.9x	0.77	x	2.87	x	9.21	x	0.63	x	0.7	=	16.16	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	121.58	222.03	343.5	492.16	612	634.29	600.4	506.91	394.34	256.1	148.34	102.28	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	532.62	630.95	737.77	862.56	958.06	956.93	908.28	821.61	721.62	607.47	526.97	501.22	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.84	0.66	0.49	0.56	0.83	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.69	19.87	20.15	20.52	20.82	20.96	20.99	20.99	20.87	20.48	20.02	19.67	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.92	19.92	19.93	19.94	19.94	19.95	19.95	19.95	19.94	19.94	19.94	19.93	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.93	0.79	0.56	0.38	0.44	0.75	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.19	18.44	18.85	19.39	19.77	19.92	19.95	19.94	19.85	19.33	18.67	18.15	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.56	18.79	19.18	19.67	20.03	20.18	20.21	20.2	20.1	19.62	19	18.53	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.56	18.79	19.18	19.67	20.03	20.18	20.21	20.2	20.1	19.62	19	18.53	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	1	0.99	0.98	0.92	0.79	0.58	0.41	0.47	0.77	0.96	0.99	1	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	530.52	625.22	719.54	795.14	757.46	559.45	371.58	388.7	553.82	581.06	522.63	499.74	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	1520.66	1477.87	1345.23	1130.68	872.84	579.25	374.26	394.04	625.17	944.86	1252.22	1513.72	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	736.66	572.98	465.51	241.58	85.84	0	0	0	0	270.67	525.31	754.4	

Total per year (kWh/year) = Sum(98)$_{1…5,9…12}$ = 3652.96 (98)

Space heating requirement in kWh/m²/year 41 (99)

TER WorkSheet: New dwelling design stage

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system		0 (201)
Fraction of space heat from main system(s)	(202) = 1 – (201) =	1 (202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1 (204)
Efficiency of main space heating system 1		93.4 (206)
Efficiency of secondary/supplementary heating system, %		0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	736.66	572.98	465.51	241.58	85.84	0	0	0	0	270.67	525.31	754.4	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	788.72	613.47	498.41	258.66	91.91	0	0	0	0	289.8	562.43	807.71	

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 3911.1 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

Output from water heater (calculated above)

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
207.98	183.36	191.75	170.07	164.66	145.02	138.94	154.89	156.6	178.32	189.35	203.03

Efficiency of water heater 80.3 (216)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(217)m=	87.96	87.73	87.2	85.93	83.5	80.3	80.3	80.3	80.3	86.1	87.48	88.05

(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(219)m=	236.44	209.02	219.9	197.91	197.21	180.6	173.03	192.89	195.02	207.11	216.44	230.58

Total = Sum(219a)$_{1...12}$ = 2456.14 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		3911.1
Water heating fuel used		2456.14
Electricity for pumps, fans and electric keep-hot		
central heating pump:	30	(230c)
boiler with a fan-assisted flue	45	(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75 (231)
Electricity for lighting		373.75 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216	=	844.8 (261)
Space heating (secondary)	(215) x	0.519	=	0 (263)
Water heating	(219) x	0.216	=	530.53 (264)
Space and water heating	(261) + (262) + (263) + (264) =			1375.32 (265)

TER WorkSheet: New dwelling design stage

Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	193.98	(268)
Total CO2, kg/year			sum of (265)…(271) =		1608.22	(272)

TER = 18.05 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 14

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	89.3	(1a) x	2.56	(2a) =	228.61	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	89.3	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		228.61	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.13 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)		0 (9)
Additional infiltration	[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction		0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35		
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0		0 (12)
If no draught lobby, enter 0.05, else enter 0		0 (13)
Percentage of windows and doors draught stripped		0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area		5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.38 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used		
Number of sides sheltered		2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =	0.32 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.41	0.41	0.4	0.36	0.35	0.31	0.31	0.3	0.32	0.35	0.36	0.38

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.54	0.55	0.56	0.57	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.54	0.55	0.56	0.57	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Floor			89.3	x	0.13	=	11.609			(28)
Walls Type1	46.68	17.54	29.14	x	0.18	=	5.25			(29)
Walls Type2	43.8	2.42	41.38	x	0.18	=	7.45			(29)
Total area of elements, m²			179.78							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 49.98 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11021.84 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.83 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 53.81 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	44.16	43.91	43.66	42.51	42.3	41.29	41.29	41.11	41.68	42.3	42.73	43.19	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	97.97	97.72	97.47	96.32	96.1	95.1	95.1	94.92	95.49	96.1	96.54	96.99	

Average = Sum(39)$_{1...12}$ /12= 96.32 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.1	1.09	1.09	1.08	1.08	1.06	1.06	1.06	1.07	1.08	1.08	1.09

Average = Sum(40)$_{1...12}$ /12= 1.08 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.62 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 96.33 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	105.96	102.11	98.26	94.4	90.55	86.7	86.7	90.55	94.4	98.26	102.11	105.96

Total = Sum(44)$_{1...12}$ = 1155.96 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	157.14	137.44	141.82	123.64	118.64	102.38	94.87	108.86	110.16	128.38	140.14	152.18

Total = Sum(45)$_{1...12}$ = 1515.65 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.57	20.62	21.27	18.55	17.8	15.36	14.23	16.33	16.52	19.26	21.02	22.83

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.07	46.56	46.14	42.75	44.18	46.14	46.56	50.07	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	208.1	183.46	191.89	170.2	164.78	145.13	139.05	155	156.72	178.45	189.45	203.14	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	208.1	183.46	191.89	170.2	164.78	145.13	139.05	155	156.72	178.45	189.45	203.14	

Output from water heater (annual)$_{1...12}$ 2085.39 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	64.99	57.2	59.67	52.75	50.98	44.73	42.59	47.73	48.27	55.2	58.93	63.34	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.39	19	15.45	11.7	8.74	7.38	7.98	10.37	13.92	17.67	20.62	21.98	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	237.78	240.25	234.03	220.8	204.09	188.38	177.89	175.42	181.64	194.88	211.59	227.29	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	(71)

Water heating gains (Table 5)

(72)m=	87.35	85.13	80.21	73.26	68.53	62.12	57.24	64.16	67.04	74.2	81.84	85.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	411.77	409.62	394.93	371	346.6	323.13	308.35	315.19	327.84	351.99	379.29	399.65	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	8.06	x	11.28	x	0.63	x	0.7	=	27.79	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	32.69	(81)
Northwest 0.9x	0.77	x	8.06	x	22.97	x	0.63	x	0.7	=	56.57	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	66.54	(81)
Northwest 0.9x	0.77	x	8.06	x	41.38	x	0.63	x	0.7	=	101.93	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	119.88	(81)
Northwest 0.9x	0.77	x	8.06	x	67.96	x	0.63	x	0.7	=	167.39	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	196.88	(81)
Northwest 0.9x	0.77	x	8.06	x	91.35	x	0.63	x	0.7	=	225.01	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	264.65	(81)
Northwest 0.9x	0.77	x	8.06	x	97.38	x	0.63	x	0.7	=	239.88	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	282.14	(81)
Northwest 0.9x	0.77	x	8.06	x	91.1	x	0.63	x	0.7	=	224.4	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	263.94	(81)
Northwest 0.9x	0.77	x	8.06	x	72.63	x	0.63	x	0.7	=	178.9	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	210.42	(81)
Northwest 0.9x	0.77	x	8.06	x	50.42	x	0.63	x	0.7	=	124.2	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	146.08	(81)
Northwest 0.9x	0.77	x	8.06	x	28.07	x	0.63	x	0.7	=	69.14	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	81.32	(81)
Northwest 0.9x	0.77	x	8.06	x	14.2	x	0.63	x	0.7	=	34.97	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	41.13	(81)
Northwest 0.9x	0.77	x	8.06	x	9.21	x	0.63	x	0.7	=	22.7	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	26.7	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	60.48	123.11	221.81	364.27	489.66	522.02	488.34	389.31	270.28	150.45	76.1	49.39	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	472.25	532.73	616.74	735.27	836.25	845.15	796.69	704.5	598.11	502.44	455.39	449.04	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.97	0.87	0.68	0.52	0.6	0.88	0.99	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.76	19.89	20.15	20.51	20.82	20.96	20.99	20.99	20.86	20.46	20.05	19.74	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20	20.01	20.01	20.02	20.02	20.03	20.03	20.03	20.03	20.02	20.02	20.01	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.95	0.82	0.59	0.41	0.48	0.82	0.98	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.34	18.54	18.91	19.44	19.84	20.01	20.03	20.03	19.91	19.38	18.78	18.32	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.73	18.91	19.25	19.73	20.11	20.27	20.29	20.29	20.17	19.67	19.13	18.71	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.73	18.91	19.25	19.73	20.11	20.27	20.29	20.29	20.17	19.67	19.13	18.71	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	1	0.99	0.95	0.83	0.62	0.44	0.52	0.83	0.98	1	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	471.22	530.38	608.74	697	691.38	520.37	348.62	363.47	495.4	490.62	453.42	448.3	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1413.93	1368.72	1242.57	1043.59	808.46	539.08	351.09	369.07	579.32	872	1161.26	1407.47	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	701.38	563.36	471.57	249.55	87.11	0	0	0	0	283.74	509.65	713.63	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3579.98 (98)

Space heating requirement in kWh/m²/year 40.09 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	701.38	563.36	471.57	249.55	87.11	0	0	0	0	283.74	509.65	713.63	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	750.94	603.17	504.9	267.18	93.26	0	0	0	0	303.79	545.66	764.05	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3832.95 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	208.1	183.46	191.89	170.2	164.78	145.13	139.05	155	156.72	178.45	189.45	203.14	

Efficiency of water heater 80.3 (216)

(217)m=	87.87	87.69	87.23	86.01	83.53	80.3	80.3	80.3	80.3	86.21	87.42	87.95	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	236.82	209.22	219.99	197.88	197.28	180.74	173.16	193.03	195.16	206.99	216.72	230.98	

Total = Sum(219a)$_{1...12}$ = 2457.97 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 3832.95

TER WorkSheet: New dwelling design stage

Water heating fuel used		2457.97	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		377.76	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	827.92	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	530.92	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1358.84	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	196.06	(268)
Total CO2, kg/year		sum of (265)…(271) =			1593.82	(272)

TER = 17.85 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 15

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	87.91	(1a) x	2.56	(2a) =	225.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	87.91	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		225.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.13 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.38 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.33 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.42	0.41	0.4	0.36	0.35	0.31	0.31	0.3	0.33	0.35	0.37	0.38

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Floor			87.918	x	0.13	=	11.42934			(28)
Walls Type1	35.76	15.8	19.96	x	0.18	=	3.59			(29)
Walls Type2	40.33	2.42	37.91	x	0.18	=	6.82			(29)
Total area of elements, m²			164							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 45.21 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 10654.65 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.3 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 49.51 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	43.54	43.29	43.05	41.9	41.69	40.69	40.69	40.51	41.07	41.69	42.12	42.58	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	93.05	92.8	92.56	91.41	91.2	90.2	90.2	90.01	90.58	91.2	91.63	92.08	

Average = Sum(39)$_{1...12}$ /12= 91.41 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.06	1.06	1.05	1.04	1.04	1.03	1.03	1.02	1.03	1.04	1.04	1.05	
Average = Sum(40)$_{1...12}$ /12=													1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.6 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 95.86 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	105.44	101.61	97.77	93.94	90.1	86.27	86.27	90.1	93.94	97.77	101.61	105.44	
Total = Sum(44)$_{1...12}$ =													1150.27 (44)
Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)													
(45)m=	156.37	136.76	141.12	123.03	118.05	101.87	94.4	108.32	109.62	127.75	139.45	151.43	
Total = Sum(45)$_{1...12}$ =													1508.18 (45)
If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)													
(46)m=	23.45	20.51	21.17	18.46	17.71	15.28	14.16	16.25	16.44	19.16	20.92	22.71	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)
If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)
If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H													
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.82	46.33	45.92	42.54	43.96	45.92	46.33	49.82	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39	

Output from water heater (annual)$_{1...12}$ 2076.08 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	64.73	56.98	59.38	52.49	50.73	44.51	42.38	47.5	48.03	54.93	58.7	63.09	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.42	19.02	15.47	11.71	8.76	7.39	7.99	10.38	13.93	17.69	20.65	22.01	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	235.18	237.62	231.47	218.38	201.85	186.32	175.94	173.5	179.65	192.74	209.27	224.8	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	(71)

Water heating gains (Table 5)

(72)m=	87	84.79	79.81	72.9	68.19	61.82	56.96	63.84	66.71	73.83	81.52	84.8	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	408.54	406.38	391.69	367.93	343.74	320.47	305.83	312.66	325.23	349.21	376.38	396.56	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	54.48	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	110.9	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	199.81	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	328.14	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	441.08	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	470.24	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	439.9	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	350.69	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	243.47	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	135.53	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	68.55	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	44.49	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	54.48	110.9	199.81	328.14	441.08	470.24	439.9	350.69	243.47	135.53	68.55	44.49	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	463.03	517.27	591.5	696.07	784.82	790.71	745.73	663.36	568.7	484.74	444.94	441.05	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.97	0.88	0.69	0.52	0.61	0.88	0.99	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.81	19.94	20.18	20.53	20.82	20.97	20.99	20.99	20.87	20.49	20.1	19.8	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.04	20.04	20.05	20.05	20.06	20.06	20.06	20.06	20.05	20.05	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.96	0.83	0.6	0.42	0.49	0.82	0.98	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.44	18.62	18.98	19.49	19.88	20.04	20.06	20.06	19.94	19.43	18.86	18.42	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.79	18.95	19.28	19.75	20.12	20.27	20.29	20.29	20.18	19.7	19.17	18.77	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.79	18.95	19.28	19.75	20.12	20.27	20.29	20.29	20.18	19.7	19.17	18.77	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	1	1	0.99	0.95	0.84	0.63	0.44	0.52	0.83	0.98	1	1	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	462.05	515.12	584.39	662.54	655.92	494.21	331.07	345.37	473.04	473.71	443.06	440.34	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	1347.98	1304.14	1182.84	991.7	767.63	511.62	333.26	350.32	550.36	829.87	1106.27	1341.34	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	659.13	530.22	445.25	237	83.11	0	0	0	0	264.99	477.52	670.35	

TER WorkSheet: New dwelling design stage

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ =	3367.56	(98)
Space heating requirement in kWh/m²/year	38.31	(99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system	0	(201)
Fraction of space heat from main system(s) (202) = 1 – (201) =	1	(202)
Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] =	1	(204)
Efficiency of main space heating system 1	93.4	(206)
Efficiency of secondary/supplementary heating system, %	0	(208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	659.13	530.22	445.25	237	83.11	0	0	0	0	264.99	477.52	670.35	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)	705.71	567.68	476.71	253.75	88.99	0	0	0	0	283.71	511.26	717.72	(211)

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 3605.52 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39	

Efficiency of water heater 80.3 (216)

(217)m=	87.76	87.58	87.11	85.9	83.44	80.3	80.3	80.3	80.3	86.06	87.29	87.84	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	236.24	208.72	219.2	197.17	196.52	179.85	172.31	192.08	194.2	206.34	216.25	230.41	

Total = Sum(219a)$_{1...12}$ = 2449.29 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		3605.52
Water heating fuel used		2449.29
Electricity for pumps, fans and electric keep-hot		
central heating pump:	30	(230c)
boiler with a fan-assisted flue	45	(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75 (231)
Electricity for lighting		378.27 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216	=	778.79 (261)

TER WorkSheet: New dwelling design stage

Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	529.05	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1307.84	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	196.32	(268)
Total CO2, kg/year		sum of (265)…(271) =		1543.09	(272)

TER = 17.55 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 16

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	95.34	(1a) x	2.56	(2a) =	244.07	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	95.34	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		244.07	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.12 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.37 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.32 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.4	0.4	0.39	0.35	0.34	0.3	0.3	0.29	0.32	0.34	0.36	0.37

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.58	0.58	0.58	0.56	0.56	0.55	0.55	0.54	0.55	0.56	0.56	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.58	0.58	0.58	0.56	0.56	0.55	0.55	0.54	0.55	0.56	0.56	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Floor			95.34	x	0.13	=	12.3942			(28)
Walls Type1	52.82	18.69	34.13	x	0.18	=	6.14			(29)
Walls Type2	30.82	2.42	28.4	x	0.18	=	5.11			(29)
Total area of elements, m²			178.98							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 50.85 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11550.41 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.3 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 57.15 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	46.85	46.59	46.34	45.17	44.95	43.92	43.92	43.73	44.32	44.95	45.39	45.86	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	104	103.74	103.49	102.32	102.1	101.07	101.07	100.88	101.47	102.1	102.54	103.01	

Average = Sum(39)$_{1...12}$ /12= 102.32 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.09	1.09	1.09	1.07	1.07	1.06	1.06	1.06	1.06	1.07	1.08	1.08	
Average = Sum(40)$_{1...12}$ /12=													1.07 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.69 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 98.13 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	107.95	104.02	100.1	96.17	92.25	88.32	88.32	92.25	96.17	100.1	104.02	107.95	
Total = Sum(44)$_{1...12}$ =													1177.62 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	160.08	140.01	144.48	125.96	120.86	104.29	96.64	110.9	112.22	130.79	142.76	155.03	
Total = Sum(45)$_{1...12}$ =													1544.04 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	24.01	21	21.67	18.89	18.13	15.64	14.5	16.64	16.83	19.62	21.41	23.25	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.96	47.43	47.01	43.56	45.01	47.01	47.43	50.96	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	211.04	186.04	195.44	173.39	167.87	147.85	141.65	157.91	159.65	181.75	192.08	205.99	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	211.04	186.04	195.44	173.39	167.87	147.85	141.65	157.91	159.65	181.75	192.08	205.99	

Output from water heater (annual)$_{1...12}$ 2120.66 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	65.97	58.06	60.78	53.74	51.94	45.57	43.39	48.63	49.17	56.23	59.8	64.29	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	22.37	19.86	16.16	12.23	9.14	7.72	8.34	10.84	14.55	18.48	21.56	22.99	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	248.57	251.15	244.65	230.81	213.34	196.92	185.96	183.38	189.88	203.72	221.18	237.6	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	(71)

Water heating gains (Table 5)

(72)m=	88.67	86.4	81.69	74.64	69.81	63.29	58.31	65.36	68.29	75.57	83.05	86.41	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	425.98	423.79	408.87	384.06	358.67	334.31	318.99	325.96	339.1	364.14	392.18	413.38	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	54.48	(81)
Northwest 0.9x	0.77	x	2.89	x	11.28	x	0.63	x	0.7	=	9.97	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	110.9	(81)
Northwest 0.9x	0.77	x	2.89	x	22.97	x	0.63	x	0.7	=	20.28	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	199.81	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	2.89	x	41.38	x	0.63	x	0.7	=	36.55	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	328.14	(81)
Northwest 0.9x	0.77	x	2.89	x	67.96	x	0.63	x	0.7	=	60.02	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	441.08	(81)
Northwest 0.9x	0.77	x	2.89	x	91.35	x	0.63	x	0.7	=	80.68	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	470.24	(81)
Northwest 0.9x	0.77	x	2.89	x	97.38	x	0.63	x	0.7	=	86.01	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	439.9	(81)
Northwest 0.9x	0.77	x	2.89	x	91.1	x	0.63	x	0.7	=	80.46	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	350.69	(81)
Northwest 0.9x	0.77	x	2.89	x	72.63	x	0.63	x	0.7	=	64.15	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	243.47	(81)
Northwest 0.9x	0.77	x	2.89	x	50.42	x	0.63	x	0.7	=	44.53	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	135.53	(81)
Northwest 0.9x	0.77	x	2.89	x	28.07	x	0.63	x	0.7	=	24.79	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	68.55	(81)
Northwest 0.9x	0.77	x	2.89	x	14.2	x	0.63	x	0.7	=	12.54	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	44.49	(81)
Northwest 0.9x	0.77	x	2.89	x	9.21	x	0.63	x	0.7	=	8.14	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	64.45	131.18	236.35	388.16	521.76	556.25	520.36	414.84	288	160.32	81.09	52.63	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	490.43	554.97	645.22	772.21	880.43	890.56	839.35	740.79	627.1	524.46	473.27	466.01	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.97	0.87	0.69	0.52	0.61	0.89	0.99	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.76	19.89	20.14	20.51	20.82	20.96	20.99	20.99	20.85	20.46	20.05	19.74	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.01	20.01	20.01	20.02	20.02	20.03	20.03	20.04	20.03	20.02	20.02	20.02	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.96	0.83	0.6	0.41	0.49	0.82	0.98	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.34	18.53	18.9	19.44	19.85	20.01	20.03	20.03	19.91	19.37	18.77	18.32	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.7	18.87	19.22	19.71	20.09	20.25	20.27	20.27	20.14	19.64	19.09	18.67	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.7	18.87	19.22	19.71	20.09	20.25	20.27	20.27	20.14	19.64	19.09	18.67	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	1	0.99	0.95	0.83	0.62	0.44	0.52	0.83	0.98	1	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	489.48	552.76	637.42	733.64	730.83	550.91	368.57	384.32	522.37	512.98	471.43	465.32	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1497.19	1449.44	1315.95	1105.66	856.6	570.95	371.18	390.31	613.3	923.23	1229.84	1490.86	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	749.74	602.57	504.83	267.86	93.58	0	0	0	0	305.23	546.05	763.01	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3832.86 (98)

Space heating requirement in kWh/m²/year 40.2 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	749.74	602.57	504.83	267.86	93.58	0	0	0	0	305.23	546.05	763.01	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	802.72	645.15	540.5	286.79	100.19	0	0	0	0	326.8	584.64	816.92	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 4103.7 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	211.04	186.04	195.44	173.39	167.87	147.85	141.65	157.91	159.65	181.75	192.08	205.99

Efficiency of water heater 80.3 (216)

(217)m=	87.97	87.79	87.33	86.14	83.64	80.3	80.3	80.3	80.3	86.35	87.53	88.05	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	239.9	211.9	223.78	201.28	200.69	184.12	176.4	196.65	198.82	210.48	219.43	233.96	

Total = Sum(219a)$_{1...12}$ = 2497.43 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 4103.7

TER WorkSheet: New dwelling design stage

Water heating fuel used		2497.43	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		394.98	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	886.4	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	539.44	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1425.84	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	205	(268)
Total CO2, kg/year		sum of (265)…(271) =			1669.76	(272)

TER = 17.51 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 17

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.76	(1a) x	2.56	(2a) =	188.83	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.76	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.83	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)			0	(9)
Additional infiltration		[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0	(12)
If no draught lobby, enter 0.05, else enter 0			0	(13)
Percentage of windows and doors draught stripped			0	(14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5	(17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered			2	(19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.43	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			3.72	x1/[1/(1.4)+ 0.04]		=	4.93			(27)
Windows Type 2			2.55	x1/[1/(1.4)+ 0.04]		=	3.38			(27)
Windows Type 3			3.47	x1/[1/(1.4)+ 0.04]		=	4.6			(27)
Floor			2.464	x	0.13	=	0.32032			(28)
Walls Type1	56.59	16.01	40.58	x	0.18	=	7.3			(29)
Walls Type2	12.58	2.42	10.16	x	0.18	=	1.83			(29)
Total area of elements, m²			71.63							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.1 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1047.35 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.31 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 37.4 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	37.27	37.04	36.8	35.71	35.51	34.55	34.55	34.38	34.92	35.51	35.92	36.35	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	74.68	74.44	74.21	73.11	72.91	71.96	71.96	71.78	72.32	72.91	73.32	73.76	

Average = Sum(39)$_{1...12}$ /12= 73.11 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.01	1.01	1.01	0.99	0.99	0.98	0.98	0.97	0.98	0.99	0.99	1

Average = Sum(40)$_{1...12}$ /12= 0.99 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.63 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.59	95.01	91.42	87.84	84.25	80.67	80.67	84.25	87.84	91.42	95.01	98.59

Total = Sum(44)$_{1...12}$ = 1075.55 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.21	127.88	131.96	115.04	110.39	95.25	88.27	101.29	102.5	119.45	130.39	141.6

Total = Sum(45)$_{1...12}$ = 1410.22 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.93	19.18	19.79	17.26	16.56	14.29	13.24	15.19	15.37	17.92	19.56	21.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.24	43.73	46.59	43.32	42.93	39.78	41.11	42.93	43.32	46.59	46.85	50.24	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84	

Output from water heater (annual)$_{1...12}$ 1947.85 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.18	53.45	55.52	49.08	47.44	41.62	39.63	44.41	44.91	51.36	55.07	59.64	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.37	16.32	13.27	10.05	7.51	6.34	6.85	8.91	11.95	15.18	17.71	18.88	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.91	208.05	202.66	191.2	176.73	163.13	154.05	151.91	157.29	168.76	183.23	196.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	(71)

Water heating gains (Table 5)

(72)m=	82.22	79.54	74.63	68.17	63.76	57.8	53.26	59.69	62.37	69.04	76.48	80.16	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.52	364.91	351.57	330.42	309.01	288.28	275.17	281.52	292.63	313.98	338.43	356.88	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	3.47	x	11.28	x	0.63	x	0.7	=	11.97	(75)
Northeast 0.9x	0.77	x	3.47	x	22.97	x	0.63	x	0.7	=	24.36	(75)
Northeast 0.9x	0.77	x	3.47	x	41.38	x	0.63	x	0.7	=	43.88	(75)
Northeast 0.9x	0.77	x	3.47	x	67.96	x	0.63	x	0.7	=	72.07	(75)
Northeast 0.9x	0.77	x	3.47	x	91.35	x	0.63	x	0.7	=	96.87	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	3.47	x	97.38	x	0.63	x	0.7	=	103.27	(75)
Northeast 0.9x	0.77	x	3.47	x	91.1	x	0.63	x	0.7	=	96.61	(75)
Northeast 0.9x	0.77	x	3.47	x	72.63	x	0.63	x	0.7	=	77.02	(75)
Northeast 0.9x	0.77	x	3.47	x	50.42	x	0.63	x	0.7	=	53.47	(75)
Northeast 0.9x	0.77	x	3.47	x	28.07	x	0.63	x	0.7	=	29.76	(75)
Northeast 0.9x	0.77	x	3.47	x	14.2	x	0.63	x	0.7	=	15.06	(75)
Northeast 0.9x	0.77	x	3.47	x	9.21	x	0.63	x	0.7	=	9.77	(75)
Northwest 0.9x	0.77	x	3.72	x	11.28	x	0.63	x	0.7	=	25.65	(81)
Northwest 0.9x	0.77	x	2.55	x	11.28	x	0.63	x	0.7	=	17.59	(81)
Northwest 0.9x	0.77	x	3.72	x	22.97	x	0.63	x	0.7	=	52.22	(81)
Northwest 0.9x	0.77	x	2.55	x	22.97	x	0.63	x	0.7	=	35.8	(81)
Northwest 0.9x	0.77	x	3.72	x	41.38	x	0.63	x	0.7	=	94.09	(81)
Northwest 0.9x	0.77	x	2.55	x	41.38	x	0.63	x	0.7	=	64.49	(81)
Northwest 0.9x	0.77	x	3.72	x	67.96	x	0.63	x	0.7	=	154.52	(81)
Northwest 0.9x	0.77	x	2.55	x	67.96	x	0.63	x	0.7	=	105.92	(81)
Northwest 0.9x	0.77	x	3.72	x	91.35	x	0.63	x	0.7	=	207.7	(81)
Northwest 0.9x	0.77	x	2.55	x	91.35	x	0.63	x	0.7	=	142.37	(81)
Northwest 0.9x	0.77	x	3.72	x	97.38	x	0.63	x	0.7	=	221.43	(81)
Northwest 0.9x	0.77	x	2.55	x	97.38	x	0.63	x	0.7	=	151.79	(81)
Northwest 0.9x	0.77	x	3.72	x	91.1	x	0.63	x	0.7	=	207.14	(81)
Northwest 0.9x	0.77	x	2.55	x	91.1	x	0.63	x	0.7	=	141.99	(81)
Northwest 0.9x	0.77	x	3.72	x	72.63	x	0.63	x	0.7	=	165.14	(81)
Northwest 0.9x	0.77	x	2.55	x	72.63	x	0.63	x	0.7	=	113.2	(81)
Northwest 0.9x	0.77	x	3.72	x	50.42	x	0.63	x	0.7	=	114.64	(81)
Northwest 0.9x	0.77	x	2.55	x	50.42	x	0.63	x	0.7	=	78.59	(81)
Northwest 0.9x	0.77	x	3.72	x	28.07	x	0.63	x	0.7	=	63.82	(81)
Northwest 0.9x	0.77	x	2.55	x	28.07	x	0.63	x	0.7	=	43.75	(81)
Northwest 0.9x	0.77	x	3.72	x	14.2	x	0.63	x	0.7	=	32.28	(81)
Northwest 0.9x	0.77	x	2.55	x	14.2	x	0.63	x	0.7	=	22.13	(81)
Northwest 0.9x	0.77	x	3.72	x	9.21	x	0.63	x	0.7	=	20.95	(81)
Northwest 0.9x	0.77	x	2.55	x	9.21	x	0.63	x	0.7	=	14.36	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	55.21	112.37	202.46	332.5	446.94	476.49	445.75	355.35	246.7	137.33	69.46	45.08	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	422.72	477.29	554.03	662.92	755.95	764.77	720.91	636.87	539.33	451.31	407.89	401.96	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.8	0.59	0.44	0.51	0.82	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.92	20.06	20.31	20.66	20.9	20.99	21	21	20.92	20.58	20.2	19.9	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.07	20.08	20.08	20.09	20.09	20.1	20.1	20.11	20.1	20.09	20.09	20.08	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.92	0.75	0.51	0.35	0.42	0.75	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.63	18.82	19.19	19.7	20	20.1	20.1	20.1	20.04	19.6	19.04	18.61	(90)

fLA = Living area ÷ (4) = 0.24 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.94	19.12	19.46	19.93	20.22	20.31	20.32	20.32	20.25	19.84	19.32	18.92	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.94	19.12	19.46	19.93	20.22	20.31	20.32	20.32	20.25	19.84	19.32	18.92	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.76	0.53	0.37	0.44	0.76	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	421.42	474.21	543.06	609.65	571.59	405.44	267.02	279.86	409.22	434.89	405.29	401.02	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1093.22	1058.53	961.85	806.28	621.26	410.88	267.59	281.28	444.9	673.6	895.91	1085.64	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	499.82	392.66	311.59	141.57	36.95	0	0	0	0	177.6	353.24	509.36	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2422.8 (98)

Space heating requirement in kWh/m²/year 32.85 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	499.82	392.66	311.59	141.57	36.95	0	0	0	0	177.6	353.24	509.36	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	535.14	420.41	333.6	151.58	39.56	0	0	0	0	190.15	378.21	545.35	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2594 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84

Efficiency of water heater 80.3 (216)

(217)m= 87.3 | 87.07 | 86.44 | 84.77 | 82.08 | 80.3 | 80.3 | 80.3 | 80.3 | 85.22 | 86.75 | 87.39 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 225.03 | 197.09 | 206.55 | 186.81 | 186.79 | 168.16 | 161.11 | 179.6 | 181.59 | 194.83 | 204.31 | 219.51

Total = Sum(219a)$_{1...12}$ = 2311.39 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2594	
Water heating fuel used		2311.39	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		324.47	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	560.3	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	499.26	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1059.56	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	168.4	(268)
Total CO2, kg/year	sum of (265)…(271) =			1266.89	(272)

TER = 17.18 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 18

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	84.24	(1a) x	2.56	(2a) =	215.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	84.24	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		215.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.14 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.39 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.33 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.42	0.41	0.41	0.36	0.36	0.31	0.31	0.31	0.33	0.36	0.37	0.39

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.58	0.57	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.58	0.57	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.75	x	1/[1/(1.4)+ 0.04]	=	10.27			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Walls Type1	35.61	16.99	18.62	x	0.18	=	3.35			(29)
Walls Type2	20.82	2.42	18.4	x	0.18	=	3.31			(29)
Total area of elements, m²			56.43							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.61 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 629.29 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 2.33 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 33.94 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	41.91	41.66	41.42	40.29	40.08	39.1	39.1	38.91	39.48	40.08	40.51	40.96	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	75.85	75.61	75.37	74.24	74.02	73.04	73.04	72.86	73.42	74.02	74.45	74.9	

Average = Sum(39)$_{1...12}$ /12= 74.23 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.9	0.9	0.89	0.88	0.88	0.87	0.87	0.86	0.87	0.88	0.88	0.89

Average = Sum(40)$_{1...12}$ /12= 0.88 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.54 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 94.49 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	103.94	100.16	96.38	92.6	88.82	85.04	85.04	88.82	92.6	96.38	100.16	103.94	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1133.85 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	154.13	134.81	139.11	121.28	116.37	100.42	93.05	106.78	108.05	125.93	137.46	149.27	

Total = Sum(45)$_{1...12}$ = 1486.65 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.12	20.22	20.87	18.19	17.46	15.06	13.96	16.02	16.21	18.89	20.62	22.39	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.11	45.66	45.26	41.94	43.33	45.26	45.66	49.11	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	

Output from water heater (annual)$_{1...12}$ 2049.26 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	63.99	56.33	58.53	51.74	50.01	43.87	41.77	46.82	47.34	54.15	58.03	62.37	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	20.46	18.17	14.78	11.19	8.36	7.06	7.63	9.92	13.31	16.9	19.72	21.03	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	228.07	230.44	224.48	211.78	195.75	180.69	170.63	168.26	174.22	186.92	202.95	218.01	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	(71)

Water heating gains (Table 5)

(72)m=	86.01	83.82	78.67	71.86	67.21	60.93	56.15	62.93	65.76	72.78	80.6	83.83	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	398.62	396.51	382	358.91	335.41	312.76	298.48	305.18	317.36	340.68	367.35	386.95	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.63	x	0.7	=	26.72	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.63	x	0.7	=	31.86	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.63	x	0.7	=	54.4	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.63	x	0.7	=	64.85	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.63	x	0.7	=	98.01	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.63	x	0.7	=	116.85	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.63	x	0.7	=	160.95	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.63	x	0.7	=	191.9	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.63	x	0.7	=	216.35	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.63	x	0.7	=	257.95	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.63	x	0.7	=	230.66	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.63	x	0.7	=	275	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.63	x	0.7	=	215.77	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.63	x	0.7	=	257.26	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.63	x	0.7	=	172.02	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.63	x	0.7	=	205.09	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.63	x	0.7	=	119.42	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.63	x	0.7	=	142.38	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.63	x	0.7	=	66.48	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.63	x	0.7	=	79.26	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.63	x	0.7	=	33.63	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.63	x	0.7	=	40.09	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.63	x	0.7	=	21.82	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.63	x	0.7	=	26.02	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	58.59	119.25	214.85	352.85	474.3	505.66	473.03	377.11	261.8	145.74	73.72	47.84	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	457.2	515.76	596.86	711.76	809.71	818.42	771.51	682.29	579.17	486.41	441.07	434.79	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.78	0.56	0.42	0.49	0.8	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.05	20.18	20.41	20.73	20.94	20.99	21	21	20.95	20.66	20.3	20.04	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.17	20.17	20.17	20.18	20.19	20.2	20.2	20.2	20.19	20.19	20.18	20.18	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.92	0.73	0.5	0.34	0.4	0.73	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.89	19.07	19.41	19.87	20.13	20.19	20.2	20.2	20.15	19.78	19.26	18.87	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.14	19.31	19.63	20.06	20.3	20.37	20.37	20.37	20.32	19.97	19.49	19.12	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.14	19.31	19.63	20.06	20.3	20.37	20.37	20.37	20.32	19.97	19.49	19.12	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.74	0.51	0.36	0.42	0.74	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	456.13	513.04	586.13	653.61	600.26	418.02	275.06	288.54	430.72	469.38	438.75	434.03	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1125.78	1089.69	989.62	828.32	636.8	421.07	275.32	289.25	456.97	693.35	922.39	1117.69	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	498.22	387.51	300.2	125.8	27.19	0	0	0	0	166.63	348.22	508.64	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2362.4 (98)

Space heating requirement in kWh/m²/year 28.04 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	498.22	387.51	300.2	125.8	27.19	0	0	0	0	166.63	348.22	508.64	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	533.43	414.9	321.41	134.69	29.11	0	0	0	0	178.41	372.83	544.58	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2529.34 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23

Efficiency of water heater 80.3 (216)

(217)m=	87.2	86.92	86.22	84.35	81.61	80.3	80.3	80.3	80.3	84.93	86.6	87.3	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	235.19	208.04	218.3	197.92	198.04	177.28	169.85	189.34	191.43	206.1	215.68	229.36	

Total = Sum(219a)$_{1...12}$ = 2436.54 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2529.34

TER WorkSheet: New dwelling design stage

Water heating fuel used		2436.54	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		361.31	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	546.34	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	526.29	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1072.63	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	187.52	(268)
Total CO2, kg/year		sum of (265)…(271) =			1299.07	(272)

TER = 15.42 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 19

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.63	(1a) x	2.56	(2a) =	183.37	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.37	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)			0	(9)
Additional infiltration		[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0	(12)
If no draught lobby, enter 0.05, else enter 0			0	(13)
Percentage of windows and doors draught stripped			0	(14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5	(17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered			2	(19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.39	0.38	0.33	0.33	0.33	0.35	0.38	0.4	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.06	x	1/[1/(1.4)+ 0.04]	=	9.36			(27)
Windows Type 2			4.21	x	1/[1/(1.4)+ 0.04]	=	5.58			(27)
Walls Type1	31.08	15.48	15.6	x	0.18	=	2.81			(29)
Walls Type2	25.62	2.42	23.2	x	0.18	=	4.18			(29)
Total area of elements, m²			56.69							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 29.93 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 659.51 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 2 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 31.93 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	36.34	36.1	35.87	34.78	34.58	33.63	33.63	33.46	34	34.58	34.99	35.42	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	68.27	68.03	67.8	66.71	66.51	65.56	65.56	65.39	65.93	66.51	66.92	67.35	

Average = Sum(39)$_{1...12}$ /12= 66.71 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.95	0.95	0.95	0.93	0.93	0.92	0.92	0.91	0.92	0.93	0.93	0.94

Average = Sum(40)$_{1...12}$ /12= 0.93 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.47 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	97.32	93.78	90.24	86.7	83.16	79.62	79.62	83.16	86.7	90.24	93.78	97.32

Total = Sum(44)$_{1...12}$ = 1061.64 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	144.32	126.22	130.25	113.55	108.96	94.02	87.13	99.98	101.17	117.91	128.7	139.76

Total = Sum(45)$_{1...12}$ = 1391.97 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.65	18.93	19.54	17.03	16.34	14.1	13.07	15	15.18	17.69	19.31	20.96

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.59	43.16	45.98	42.76	42.38	39.27	40.57	42.38	42.76	45.98	46.25	49.59	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	

Output from water heater (annual)$_{1...12}$ 1922.64 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.38	52.76	54.8	48.45	46.82	41.08	39.11	43.84	44.33	50.7	54.36	58.87	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.94	15.94	12.96	9.81	7.34	6.19	6.69	8.7	11.67	14.82	17.3	18.44	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.07	203.16	197.9	186.71	172.58	159.3	150.42	148.34	153.6	164.79	178.92	192.2	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	(71)

Water heating gains (Table 5)

(72)m=	81.16	78.51	73.66	67.29	62.93	57.05	52.57	58.92	61.57	68.15	75.49	79.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.45	357.88	344.8	324.08	303.12	282.82	269.96	276.23	287.11	308.03	331.99	350.04	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.06	x	11.28	x	0.63	x	0.7	=	24.34	(75)
Northeast 0.9x	0.77	x	4.21	x	11.28	x	0.63	x	0.7	=	29.03	(75)
Northeast 0.9x	0.77	x	7.06	x	22.97	x	0.63	x	0.7	=	49.55	(75)
Northeast 0.9x	0.77	x	4.21	x	22.97	x	0.63	x	0.7	=	59.1	(75)
Northeast 0.9x	0.77	x	7.06	x	41.38	x	0.63	x	0.7	=	89.28	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.21	x	41.38	x	0.63	x	0.7	=	106.48	(75)
Northeast 0.9x	0.77	x	7.06	x	67.96	x	0.63	x	0.7	=	146.62	(75)
Northeast 0.9x	0.77	x	4.21	x	67.96	x	0.63	x	0.7	=	174.87	(75)
Northeast 0.9x	0.77	x	7.06	x	91.35	x	0.63	x	0.7	=	197.09	(75)
Northeast 0.9x	0.77	x	4.21	x	91.35	x	0.63	x	0.7	=	235.06	(75)
Northeast 0.9x	0.77	x	7.06	x	97.38	x	0.63	x	0.7	=	210.12	(75)
Northeast 0.9x	0.77	x	4.21	x	97.38	x	0.63	x	0.7	=	250.6	(75)
Northeast 0.9x	0.77	x	7.06	x	91.1	x	0.63	x	0.7	=	196.56	(75)
Northeast 0.9x	0.77	x	4.21	x	91.1	x	0.63	x	0.7	=	234.43	(75)
Northeast 0.9x	0.77	x	7.06	x	72.63	x	0.63	x	0.7	=	156.7	(75)
Northeast 0.9x	0.77	x	4.21	x	72.63	x	0.63	x	0.7	=	186.89	(75)
Northeast 0.9x	0.77	x	7.06	x	50.42	x	0.63	x	0.7	=	108.79	(75)
Northeast 0.9x	0.77	x	4.21	x	50.42	x	0.63	x	0.7	=	129.75	(75)
Northeast 0.9x	0.77	x	7.06	x	28.07	x	0.63	x	0.7	=	60.56	(75)
Northeast 0.9x	0.77	x	4.21	x	28.07	x	0.63	x	0.7	=	72.22	(75)
Northeast 0.9x	0.77	x	7.06	x	14.2	x	0.63	x	0.7	=	30.63	(75)
Northeast 0.9x	0.77	x	4.21	x	14.2	x	0.63	x	0.7	=	36.53	(75)
Northeast 0.9x	0.77	x	7.06	x	9.21	x	0.63	x	0.7	=	19.88	(75)
Northeast 0.9x	0.77	x	4.21	x	9.21	x	0.63	x	0.7	=	23.71	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	53.38	108.65	195.76	321.49	432.15	460.72	430.99	343.59	238.53	132.78	67.16	43.59	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	413.83	466.54	540.56	645.57	735.27	743.53	700.95	619.82	525.65	440.82	399.15	393.64	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.93	0.77	0.56	0.41	0.48	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.01	20.14	20.39	20.72	20.93	20.99	21	21	20.95	20.64	20.27	19.99	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.13	20.13	20.14	20.14	20.15	20.15	20.16	20.15	20.14	20.14	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.91	0.72	0.49	0.33	0.4	0.72	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.79	18.99	19.34	19.82	20.08	20.15	20.15	20.16	20.11	19.72	19.19	18.78	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.12	19.29	19.62	20.06	20.31	20.37	20.38	20.38	20.33	19.97	19.47	19.1	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.12	19.29	19.62	20.06	20.31	20.37	20.38	20.38	20.33	19.97	19.47	19.1	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.73	0.5	0.35	0.42	0.73	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	412.52	463.38	528.9	587.38	538.08	375.29	247.34	259.31	386.03	422.95	396.46	392.7	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1011.36	979.03	889.48	744.29	572.34	378.42	247.64	260.09	410.63	622.85	828.1	1003.3	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	445.54	346.52	268.27	112.98	25.49	0	0	0	0	148.73	310.78	454.29	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2112.59 (98)

Space heating requirement in kWh/m²/year 29.49 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	445.54	346.52	268.27	112.98	25.49	0	0	0	0	148.73	310.78	454.29	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	477.02	371.01	287.22	120.96	27.3	0	0	0	0	159.24	332.74	486.39	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2261.88 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36

Efficiency of water heater 80.3 (216)

(217)m=	87.08	86.81	86.11	84.25	81.61	80.3	80.3	80.3	80.3	84.81	86.48	87.17	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	222.68	195.11	204.67	185.53	185.43	165.99	159.03	177.28	179.24	193.25	202.3	217.21	

Total = Sum(219a)$_{1...12}$ = 2287.72 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2261.88

TER WorkSheet: New dwelling design stage

Water heating fuel used		2287.72	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		316.91	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	488.57	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	494.15	(264)
Space and water heating	(261) + (262) + (263) + (264) =				982.71	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	164.47	(268)
Total CO2, kg/year		sum of (265)…(271) =			1186.11	(272)

TER = 16.56 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 20

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	58.62	(1a) x	2.56	(2a) =	150.07	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	58.62	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		150.07	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.13 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.38 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.33 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.42	0.41	0.4	0.36	0.35	0.31	0.31	0.3	0.33	0.35	0.37	0.38

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.58	x1/[1/(1.4)+ 0.04]		=	7.4			(27)
Windows Type 2			3.33	x1/[1/(1.4)+ 0.04]		=	4.41			(27)
Floor			7.078	x	0.13	=	0.92014			(28)
Walls Type1	37.03	12.24	24.79	x	0.18	=	4.46			(29)
Walls Type2	26.11	2.42	23.69	x	0.18	=	4.26			(29)
Total area of elements, m²			70.22							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 28.29 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1354.99 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.39 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 31.68 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	29.03	28.87	28.7	27.94	27.8	27.13	27.13	27.01	27.39	27.8	28.09	28.39	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	60.72	60.55	60.39	59.63	59.48	58.82	58.82	58.69	59.07	59.48	59.77	60.07	

Average = Sum(39)$_{1...12}$ /12= 59.62 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.04	1.03	1.03	1.02	1.01	1	1	1	1.01	1.01	1.02	1.02

Average = Sum(40)$_{1...12}$ /12= 1.02 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.94 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 80.33 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	88.36	85.15	81.94	78.72	75.51	72.3	72.3	75.51	78.72	81.94	85.15	88.36	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 963.97 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	131.04	114.61	118.27	103.11	98.93	85.37	79.11	90.78	91.86	107.06	116.86	126.91

Total = Sum(45)$_{1...12}$ = 1263.92 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.66	17.19	17.74	15.47	14.84	12.81	11.87	13.62	13.78	16.06	17.53	19.04

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	45.03	39.19	41.75	38.82	38.48	35.65	36.84	38.48	38.82	41.75	41.99	45.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94	

Output from water heater (annual)$_{1...12}$ 1745.77 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	54.83	47.91	49.76	43.99	42.52	37.3	35.51	39.8	40.25	46.04	49.36	53.45	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	15.15	13.46	10.95	8.29	6.19	5.23	5.65	7.35	9.86	12.52	14.61	15.58	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	169.45	171.21	166.78	157.35	145.44	134.25	126.77	125.01	129.44	138.88	150.79	161.98	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	(71)

Water heating gains (Table 5)

(72)m=	73.69	71.29	66.88	61.1	57.14	51.81	47.74	53.5	55.9	61.88	68.55	71.85	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	313.44	311.1	299.75	281.87	263.91	246.42	235.29	240.99	250.34	268.41	289.08	304.53	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	5.58	x	11.28	x	0.63	x	0.7	=	19.24	(75)
Northeast 0.9x	0.77	x	3.33	x	11.28	x	0.63	x	0.7	=	22.97	(75)
Northeast 0.9x	0.77	x	5.58	x	22.97	x	0.63	x	0.7	=	39.17	(75)
Northeast 0.9x	0.77	x	3.33	x	22.97	x	0.63	x	0.7	=	46.75	(75)
Northeast 0.9x	0.77	x	5.58	x	41.38	x	0.63	x	0.7	=	70.56	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	3.33	x	41.38	x	0.63	x	0.7	=	84.22	(75)
Northeast 0.9x	0.77	x	5.58	x	67.96	x	0.63	x	0.7	=	115.89	(75)
Northeast 0.9x	0.77	x	3.33	x	67.96	x	0.63	x	0.7	=	138.32	(75)
Northeast 0.9x	0.77	x	5.58	x	91.35	x	0.63	x	0.7	=	155.77	(75)
Northeast 0.9x	0.77	x	3.33	x	91.35	x	0.63	x	0.7	=	185.92	(75)
Northeast 0.9x	0.77	x	5.58	x	97.38	x	0.63	x	0.7	=	166.07	(75)
Northeast 0.9x	0.77	x	3.33	x	97.38	x	0.63	x	0.7	=	198.21	(75)
Northeast 0.9x	0.77	x	5.58	x	91.1	x	0.63	x	0.7	=	155.36	(75)
Northeast 0.9x	0.77	x	3.33	x	91.1	x	0.63	x	0.7	=	185.43	(75)
Northeast 0.9x	0.77	x	5.58	x	72.63	x	0.63	x	0.7	=	123.85	(75)
Northeast 0.9x	0.77	x	3.33	x	72.63	x	0.63	x	0.7	=	147.82	(75)
Northeast 0.9x	0.77	x	5.58	x	50.42	x	0.63	x	0.7	=	85.98	(75)
Northeast 0.9x	0.77	x	3.33	x	50.42	x	0.63	x	0.7	=	102.63	(75)
Northeast 0.9x	0.77	x	5.58	x	28.07	x	0.63	x	0.7	=	47.86	(75)
Northeast 0.9x	0.77	x	3.33	x	28.07	x	0.63	x	0.7	=	57.13	(75)
Northeast 0.9x	0.77	x	5.58	x	14.2	x	0.63	x	0.7	=	24.21	(75)
Northeast 0.9x	0.77	x	3.33	x	14.2	x	0.63	x	0.7	=	28.9	(75)
Northeast 0.9x	0.77	x	5.58	x	9.21	x	0.63	x	0.7	=	15.71	(75)
Northeast 0.9x	0.77	x	3.33	x	9.21	x	0.63	x	0.7	=	18.75	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	42.21	85.91	154.79	254.2	341.7	364.29	340.78	271.68	188.61	104.99	53.11	34.47	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	355.64	397.01	454.53	536.07	605.61	610.71	576.08	512.67	438.95	373.4	342.19	339	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.81	0.6	0.45	0.52	0.82	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.92	20.05	20.3	20.64	20.89	20.98	21	20.99	20.92	20.58	20.2	19.9	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.05	20.06	20.06	20.07	20.07	20.08	20.08	20.08	20.08	20.07	20.07	20.06	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.75	0.52	0.35	0.42	0.74	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.61	18.8	19.16	19.66	19.97	20.07	20.08	20.08	20.01	19.58	19.02	18.59	(90)

fLA = Living area ÷ (4) = 0.3 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.01	19.18	19.51	19.95	20.25	20.35	20.36	20.36	20.28	19.88	19.37	18.98	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.01	19.18	19.51	19.95	20.25	20.35	20.36	20.36	20.28	19.88	19.37	18.98	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.77	0.54	0.38	0.45	0.76	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	354.25	393.98	444.77	493.23	463.33	332.36	220.28	230.66	334.1	358.54	339.5	337.97	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	892.89	864.56	785.46	659.13	508.54	337.91	220.9	232.14	365.36	552.14	733.69	888.01	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	400.75	316.23	253.48	119.45	33.64	0	0	0	0	144.04	283.82	409.23	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1960.64 (98)

Space heating requirement in kWh/m²/year 33.45 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	400.75	316.23	253.48	119.45	33.64	0	0	0	0	144.04	283.82	409.23	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	429.07	338.58	271.39	127.89	36.02	0	0	0	0	154.22	303.87	438.15	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2099.18 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94

Efficiency of water heater 80.3 (216)

(217)m=	87.06	86.83	86.2	84.62	82.1	80.3	80.3	80.3	80.3	84.97	86.5	87.16	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	202.25	177.14	185.63	167.73	167.37	150.72	144.4	160.97	162.75	175.14	183.66	197.27	

Total = Sum(219a)$_{1...12}$ = 2075.01 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2099.18

TER WorkSheet: New dwelling design stage

Water heating fuel used		2075.01	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		267.64	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	453.42	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	448.2	(264)
Space and water heating	(261) + (262) + (263) + (264) =				901.63	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	138.9	(268)
Total CO2, kg/year		sum of (265)…(271) =			1079.45	(272)

TER = 18.41 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 21

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.71	(1a) x	2.56	(2a) =	183.58	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.71	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.58	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.39	0.38	0.33	0.33	0.33	0.35	0.38	0.4	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.05	x1/[1/(1.4)+ 0.04]		=	8.02			(27)
Windows Type 2			3.6	x1/[1/(1.4)+ 0.04]		=	4.77			(27)
Windows Type 3			2.25	x1/[1/(1.4)+ 0.04]		=	2.98			(27)
Walls Type1	54.82	15.5	39.32	x	0.18	=	7.08			(29)
Walls Type2	34.97	2.42	32.55	x	0.18	=	5.86			(29)
Total area of elements, m²			89.79							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 35.91 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1221.77 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.56 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 39.47 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	36.37	36.13	35.9	34.82	34.61	33.67	33.67	33.49	34.03	34.61	35.02	35.45	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	75.84	75.6	75.37	74.28	74.08	73.13	73.13	72.96	73.5	74.08	74.49	74.92	

Average = Sum(39)$_{1...12}$ /12= 74.28 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.06	1.05	1.05	1.04	1.03	1.02	1.02	1.02	1.02	1.03	1.04	1.04	

Average = Sum(40)$_{1...12}$ /12= 1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.51 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	97.37	93.83	90.28	86.74	83.2	79.66	79.66	83.2	86.74	90.28	93.83	97.37	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1062.17 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	144.39	126.28	130.31	113.61	109.01	94.07	87.17	100.03	101.22	117.97	128.77	139.83	

Total = Sum(45)$_{1...12}$ = 1392.67 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.66	18.94	19.55	17.04	16.35	14.11	13.08	15	15.18	17.69	19.32	20.98	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.62	43.19	46.01	42.78	42.4	39.29	40.6	42.4	42.78	46.01	46.27	49.62	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45	

Output from water heater (annual)$_{1...12}$ 1923.61 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.41	52.79	54.83	48.47	46.85	41.1	39.13	43.86	44.35	50.73	54.38	58.9	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.96	15.95	12.97	9.82	7.34	6.2	6.7	8.71	11.68	14.84	17.32	18.46	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.25	203.34	198.08	186.88	172.73	159.44	150.56	148.47	153.74	164.94	179.08	192.37	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	(71)

Water heating gains (Table 5)

(72)m=	81.2	78.55	73.7	67.32	62.97	57.08	52.6	58.95	61.6	68.18	75.53	79.17	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.72	358.15	345.06	324.32	303.35	283.03	270.16	276.43	287.32	308.26	332.23	350.3	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	6.05	x	11.28	x	0.63	x	0.7	=	20.86	(75)
Northeast 0.9x	0.77	x	3.6	x	11.28	x	0.63	x	0.7	=	24.83	(75)
Northeast 0.9x	0.77	x	6.05	x	22.97	x	0.63	x	0.7	=	42.46	(75)
Northeast 0.9x	0.77	x	3.6	x	22.97	x	0.63	x	0.7	=	50.54	(75)
Northeast 0.9x	0.77	x	6.05	x	41.38	x	0.63	x	0.7	=	76.51	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	3.6	x	41.38	x	0.63	x	0.7	=	91.05	(75)
Northeast 0.9x	0.77	x	6.05	x	67.96	x	0.63	x	0.7	=	125.65	(75)
Northeast 0.9x	0.77	x	3.6	x	67.96	x	0.63	x	0.7	=	149.53	(75)
Northeast 0.9x	0.77	x	6.05	x	91.35	x	0.63	x	0.7	=	168.89	(75)
Northeast 0.9x	0.77	x	3.6	x	91.35	x	0.63	x	0.7	=	201	(75)
Northeast 0.9x	0.77	x	6.05	x	97.38	x	0.63	x	0.7	=	180.06	(75)
Northeast 0.9x	0.77	x	3.6	x	97.38	x	0.63	x	0.7	=	214.29	(75)
Northeast 0.9x	0.77	x	6.05	x	91.1	x	0.63	x	0.7	=	168.44	(75)
Northeast 0.9x	0.77	x	3.6	x	91.1	x	0.63	x	0.7	=	200.46	(75)
Northeast 0.9x	0.77	x	6.05	x	72.63	x	0.63	x	0.7	=	134.28	(75)
Northeast 0.9x	0.77	x	3.6	x	72.63	x	0.63	x	0.7	=	159.81	(75)
Northeast 0.9x	0.77	x	6.05	x	50.42	x	0.63	x	0.7	=	93.23	(75)
Northeast 0.9x	0.77	x	3.6	x	50.42	x	0.63	x	0.7	=	110.95	(75)
Northeast 0.9x	0.77	x	6.05	x	28.07	x	0.63	x	0.7	=	51.9	(75)
Northeast 0.9x	0.77	x	3.6	x	28.07	x	0.63	x	0.7	=	61.76	(75)
Northeast 0.9x	0.77	x	6.05	x	14.2	x	0.63	x	0.7	=	26.25	(75)
Northeast 0.9x	0.77	x	3.6	x	14.2	x	0.63	x	0.7	=	31.24	(75)
Northeast 0.9x	0.77	x	6.05	x	9.21	x	0.63	x	0.7	=	17.04	(75)
Northeast 0.9x	0.77	x	3.6	x	9.21	x	0.63	x	0.7	=	20.28	(75)
Southeast 0.9x	0.77	x	2.25	x	36.79	x	0.63	x	0.7	=	25.3	(77)
Southeast 0.9x	0.77	x	2.25	x	62.67	x	0.63	x	0.7	=	43.1	(77)
Southeast 0.9x	0.77	x	2.25	x	85.75	x	0.63	x	0.7	=	58.97	(77)
Southeast 0.9x	0.77	x	2.25	x	106.25	x	0.63	x	0.7	=	73.06	(77)
Southeast 0.9x	0.77	x	2.25	x	119.01	x	0.63	x	0.7	=	81.84	(77)
Southeast 0.9x	0.77	x	2.25	x	118.15	x	0.63	x	0.7	=	81.24	(77)
Southeast 0.9x	0.77	x	2.25	x	113.91	x	0.63	x	0.7	=	78.33	(77)
Southeast 0.9x	0.77	x	2.25	x	104.39	x	0.63	x	0.7	=	71.78	(77)
Southeast 0.9x	0.77	x	2.25	x	92.85	x	0.63	x	0.7	=	63.85	(77)
Southeast 0.9x	0.77	x	2.25	x	69.27	x	0.63	x	0.7	=	47.63	(77)
Southeast 0.9x	0.77	x	2.25	x	44.07	x	0.63	x	0.7	=	30.3	(77)
Southeast 0.9x	0.77	x	2.25	x	31.49	x	0.63	x	0.7	=	21.65	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	70.99	136.1	226.52	348.24	451.73	475.59	447.23	365.88	268.02	161.28	87.79	58.96	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	431.71	494.25	571.58	672.56	755.07	758.62	717.39	642.31	555.34	469.54	420.03	409.27	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.8	0.6	0.45	0.52	0.81	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.89	20.03	20.29	20.64	20.89	20.98	21	20.99	20.92	20.58	20.17	19.86	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.04	20.04	20.04	20.05	20.06	20.07	20.07	20.07	20.06	20.06	20.05	20.05	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.75	0.52	0.35	0.41	0.73	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.55	18.76	19.14	19.64	19.95	20.06	20.07	20.07	20	19.57	18.98	18.52	(90)

fLA = Living area ÷ (4) = 0.28 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.93	19.12	19.47	19.92	20.22	20.32	20.33	20.33	20.26	19.85	19.32	18.9	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.93	19.12	19.47	19.92	20.22	20.32	20.33	20.33	20.26	19.85	19.32	18.9	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.76	0.54	0.38	0.44	0.75	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	430.06	490.17	558.08	615.7	574.68	411.08	271.9	284.8	415.91	449.2	416.68	408.08	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1109.18	1075.19	977.34	818.89	631.07	418.15	272.7	286.61	452.74	685.46	910.08	1101.5	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	505.26	393.13	311.93	146.3	41.96	0	0	0	0	175.77	355.25	515.91	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2445.51 (98)

Space heating requirement in kWh/m²/year 34.1 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	505.26	393.13	311.93	146.3	41.96	0	0	0	0	175.77	355.25	515.91	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	540.97	420.91	333.97	156.63	44.92	0	0	0	0	188.2	380.35	552.36	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2618.32 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45

Efficiency of water heater 80.3 (216)

(217)m= 87.35 | 87.1 | 86.47 | 84.88 | 82.3 | 80.3 | 80.3 | 80.3 | 80.3 | 85.23 | 86.8 | 87.45 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 222.1 | 194.57 | 203.91 | 184.24 | 183.99 | 166.07 | 159.11 | 177.37 | 179.33 | 192.4 | 201.67 | 216.65

Total = Sum(219a)$_{1...12}$ = 2281.39 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2618.32	
Water heating fuel used		2281.39	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		317.19	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	565.56	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	492.78	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1058.34	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	164.62	(268)
Total CO2, kg/year	sum of (265)…(271) =			1261.88	(272)

TER = 17.6 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 22

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.7	(1a) x	2.56	(2a) =	180.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.7	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.17 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.42 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.39	0.38	0.34	0.34	0.33	0.35	0.38	0.4	0.42

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.58	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.58	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.09	x1/[1/(1.4)+ 0.04]		=	8.07			(27)
Windows Type 2			3.49	x1/[1/(1.4)+ 0.04]		=	4.63			(27)
Windows Type 3			2.18	x1/[1/(1.4)+ 0.04]		=	2.89			(27)
Walls Type1	54.73	15.25	39.48	x	0.18	=	7.11			(29)
Walls Type2	22.23	2.42	19.81	x	0.18	=	3.57			(29)
Total area of elements, m²			76.96							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.31 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1007.9 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.93 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 37.24 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	35.93	35.69	35.46	34.38	34.17	33.23	33.23	33.05	33.59	34.17	34.58	35.01	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	73.16	72.93	72.7	71.61	71.41	70.47	70.47	70.29	70.83	71.41	71.82	72.25	

Average = Sum(39)$_{1...12}$ /12= 71.61 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.03	1.03	1.03	1.01	1.01	1	1	0.99	1	1.01	1.02	1.02

Average = Sum(40)$_{1...12}$ /12= 1.01 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.94 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.74	93.22	89.7	86.19	82.67	79.15	79.15	82.67	86.19	89.7	93.22	96.74

Total = Sum(44)$_{1...12}$ = 1055.33 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.46	125.47	129.48	112.88	108.31	93.46	86.61	99.38	100.57	117.21	127.94	138.93

Total = Sum(45)$_{1...12}$ = 1383.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.52	18.82	19.42	16.93	16.25	14.02	12.99	14.91	15.09	17.58	19.19	20.84

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.3	42.91	45.71	42.5	42.13	39.03	40.33	42.13	42.5	45.71	45.97	49.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	

Output from water heater (annual)$_{1...12}$ 1911.23 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.03	52.45	54.48	48.16	46.55	40.84	38.88	43.58	44.07	50.4	54.03	58.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.75	15.77	12.82	9.71	7.26	6.13	6.62	8.61	11.55	14.67	17.12	18.25	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.92	200.98	195.78	184.71	170.73	157.59	148.81	146.75	151.95	163.03	177	190.14	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	(71)

Water heating gains (Table 5)

(72)m=	80.68	78.05	73.22	66.89	62.56	56.72	52.26	58.57	61.2	67.74	75.05	78.66	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	357.3	354.74	341.77	321.25	300.49	280.38	267.64	273.87	284.65	305.38	329.11	346.99	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.18	x	36.79	x	0.63	x	0.7	=	24.51	(77)
Southeast 0.9x	0.77	x	2.18	x	62.67	x	0.63	x	0.7	=	41.76	(77)
Southeast 0.9x	0.77	x	2.18	x	85.75	x	0.63	x	0.7	=	57.13	(77)
Southeast 0.9x	0.77	x	2.18	x	106.25	x	0.63	x	0.7	=	70.79	(77)
Southeast 0.9x	0.77	x	2.18	x	119.01	x	0.63	x	0.7	=	79.29	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.18	x	118.15	x	0.63	x	0.7	=	78.72	(77)
Southeast 0.9x	0.77	x	2.18	x	113.91	x	0.63	x	0.7	=	75.89	(77)
Southeast 0.9x	0.77	x	2.18	x	104.39	x	0.63	x	0.7	=	69.55	(77)
Southeast 0.9x	0.77	x	2.18	x	92.85	x	0.63	x	0.7	=	61.86	(77)
Southeast 0.9x	0.77	x	2.18	x	69.27	x	0.63	x	0.7	=	46.15	(77)
Southeast 0.9x	0.77	x	2.18	x	44.07	x	0.63	x	0.7	=	29.36	(77)
Southeast 0.9x	0.77	x	2.18	x	31.49	x	0.63	x	0.7	=	20.98	(77)
Southwest 0.9x	0.77	x	6.09	x	36.79		0.63	x	0.7	=	68.48	(79)
Southwest 0.9x	0.77	x	3.49	x	36.79		0.63	x	0.7	=	78.49	(79)
Southwest 0.9x	0.77	x	6.09	x	62.67		0.63	x	0.7	=	116.65	(79)
Southwest 0.9x	0.77	x	3.49	x	62.67		0.63	x	0.7	=	133.69	(79)
Southwest 0.9x	0.77	x	6.09	x	85.75		0.63	x	0.7	=	159.6	(79)
Southwest 0.9x	0.77	x	3.49	x	85.75		0.63	x	0.7	=	182.93	(79)
Southwest 0.9x	0.77	x	6.09	x	106.25		0.63	x	0.7	=	197.75	(79)
Southwest 0.9x	0.77	x	3.49	x	106.25		0.63	x	0.7	=	226.65	(79)
Southwest 0.9x	0.77	x	6.09	x	119.01		0.63	x	0.7	=	221.5	(79)
Southwest 0.9x	0.77	x	3.49	x	119.01		0.63	x	0.7	=	253.87	(79)
Southwest 0.9x	0.77	x	6.09	x	118.15		0.63	x	0.7	=	219.9	(79)
Southwest 0.9x	0.77	x	3.49	x	118.15		0.63	x	0.7	=	252.04	(79)
Southwest 0.9x	0.77	x	6.09	x	113.91		0.63	x	0.7	=	212.01	(79)
Southwest 0.9x	0.77	x	3.49	x	113.91		0.63	x	0.7	=	242.99	(79)
Southwest 0.9x	0.77	x	6.09	x	104.39		0.63	x	0.7	=	194.29	(79)
Southwest 0.9x	0.77	x	3.49	x	104.39		0.63	x	0.7	=	222.68	(79)
Southwest 0.9x	0.77	x	6.09	x	92.85		0.63	x	0.7	=	172.81	(79)
Southwest 0.9x	0.77	x	3.49	x	92.85		0.63	x	0.7	=	198.07	(79)
Southwest 0.9x	0.77	x	6.09	x	69.27		0.63	x	0.7	=	128.92	(79)
Southwest 0.9x	0.77	x	3.49	x	69.27		0.63	x	0.7	=	147.76	(79)
Southwest 0.9x	0.77	x	6.09	x	44.07		0.63	x	0.7	=	82.02	(79)
Southwest 0.9x	0.77	x	3.49	x	44.07		0.63	x	0.7	=	94.01	(79)
Southwest 0.9x	0.77	x	6.09	x	31.49		0.63	x	0.7	=	58.6	(79)
Southwest 0.9x	0.77	x	3.49	x	31.49		0.63	x	0.7	=	67.17	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	171.48	292.1	399.66	495.2	554.66	550.65	530.89	486.52	432.75	322.83	205.39	146.75	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	528.78	646.84	741.43	816.44	855.15	831.03	798.52	760.39	717.39	628.2	534.51	493.74	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.72	0.53	0.39	0.42	0.65	0.91	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.06	20.27	20.53	20.79	20.94	20.99	21	21	20.97	20.77	20.36	20.02	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.05	20.06	20.06	20.07	20.07	20.09	20.09	20.09	20.08	20.07	20.07	20.07	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.67	0.46	0.31	0.34	0.58	0.88	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.81	19.12	19.48	19.84	20.02	20.08	20.09	20.09	20.06	19.82	19.26	18.76	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.14	19.43	19.77	20.1	20.27	20.33	20.33	20.33	20.31	20.08	19.55	19.1	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.14	19.43	19.77	20.1	20.27	20.33	20.33	20.33	20.31	20.08	19.55	19.1	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.84	0.68	0.48	0.33	0.36	0.6	0.88	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	523.45	629.33	692.17	685.91	581.73	399.98	262.67	275.91	428.48	551.5	521.77	490.13	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1086.04	1059.48	964.36	801.98	611.93	403.53	263.01	276.49	439.8	676.93	894.49	1076.51	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	418.57	289.06	202.51	83.57	22.47	0	0	0	0	93.32	268.36	436.27	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1814.13 (98)

Space heating requirement in kWh/m²/year 25.66 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	418.57	289.06	202.51	83.57	22.47	0	0	0	0	93.32	268.36	436.27	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	448.15	309.49	216.82	89.48	24.06	0	0	0	0	99.91	287.33	467.1	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1942.33 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23

Efficiency of water heater 80.3 (216)

(217)m=	86.95	86.4	85.42	83.57	81.48	80.3	80.3	80.3	80.3	83.71	86.14	87.1

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	221.68	194.88	205.1	185.94	184.62	165	158.09	176.23	178.17	194.63	201.9	216.11

Total = Sum(219a)$_{1...12}$ = 2282.36 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1942.33	
Water heating fuel used		2282.36	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		313.54	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	419.54	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	492.99	(264)
Space and water heating	(261) + (262) + (263) + (264) =			912.53	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	162.73	(268)
Total CO2, kg/year	sum of (265)…(271) =			1114.19	(272)

TER = 15.76 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 23

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.46	(1a) x	2.56	(2a) =	129.18	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.46	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.18	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.5	x	1/[1/(1.4)+ 0.04]	=	9.94			(27)
Windows Type 2			2.69	x	1/[1/(1.4)+ 0.04]	=	3.57			(27)
Walls Type1	24.7	10.19	14.51	x	0.18	=	2.61			(29)
Walls Type2	19.12	2.42	16.7	x	0.18	=	3.01			(29)
Total area of elements, m²			43.82							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 21.55 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 530.57 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 1.45 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 22.99 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.42	25.26	25.1	24.37	24.23	23.59	23.59	23.47	23.84	24.23	24.51	24.8	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	48.41	48.25	48.09	47.36	47.22	46.58	46.58	46.47	46.83	47.22	47.5	47.79	

Average = Sum(39)$_{1...12}$ /12= 47.36 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.96	0.95	0.94	0.94	0.92	0.92	0.92	0.93	0.94	0.94	0.95

Average = Sum(40)$_{1...12}$ /12= 0.94 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.66 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.13	79.14	76.15	73.17	70.18	67.2	67.2	70.18	73.17	76.15	79.14	82.13

Total = Sum(44)$_{1...12}$ = 895.94 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.79	106.52	109.92	95.83	91.95	79.35	73.53	84.37	85.38	99.5	108.62	117.95

Total = Sum(45)$_{1...12}$ = 1174.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.37	13.79	11.9	11.03	12.66	12.81	14.93	16.29	17.69

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.85	36.43	38.81	36.08	35.76	33.14	34.24	35.76	36.08	38.81	39.03	41.85	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	

Output from water heater (annual)$_{1...12}$ 1622.57 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.96	44.52	46.25	40.88	39.52	34.67	33.01	37	37.41	42.79	45.87	49.68	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.31	11.82	9.62	7.28	5.44	4.59	4.96	6.45	8.66	11	12.84	13.68	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.43	149.97	146.09	137.82	127.39	117.59	111.04	109.5	113.38	121.65	132.08	141.88	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	(71)

Water heating gains (Table 5)

(72)m=	68.49	66.26	62.16	56.78	53.11	48.15	44.37	49.72	51.96	57.51	63.71	66.78	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.79	279.61	269.42	253.44	237.5	221.89	211.93	217.23	225.56	241.71	260.18	273.89	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	7.5	x	36.79	x	0.63	x	0.7	=	84.34	(79)
Southwest$_{0.9x}$	0.77	x	2.69	x	36.79	x	0.63	x	0.7	=	30.25	(79)
Southwest$_{0.9x}$	0.77	x	7.5	x	62.67	x	0.63	x	0.7	=	143.65	(79)
Southwest$_{0.9x}$	0.77	x	2.69	x	62.67	x	0.63	x	0.7	=	51.52	(79)
Southwest$_{0.9x}$	0.77	x	7.5	x	85.75	x	0.63	x	0.7	=	196.55	(79)

TER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.69	x	85.75	0.63	x	0.7	=	70.5	(79)
Southwest 0.9x	0.77	x	7.5	x	106.25	0.63	x	0.7	=	243.54	(79)
Southwest 0.9x	0.77	x	2.69	x	106.25	0.63	x	0.7	=	87.35	(79)
Southwest 0.9x	0.77	x	7.5	x	119.01	0.63	x	0.7	=	272.78	(79)
Southwest 0.9x	0.77	x	2.69	x	119.01	0.63	x	0.7	=	97.84	(79)
Southwest 0.9x	0.77	x	7.5	x	118.15	0.63	x	0.7	=	270.81	(79)
Southwest 0.9x	0.77	x	2.69	x	118.15	0.63	x	0.7	=	97.13	(79)
Southwest 0.9x	0.77	x	7.5	x	113.91	0.63	x	0.7	=	261.09	(79)
Southwest 0.9x	0.77	x	2.69	x	113.91	0.63	x	0.7	=	93.64	(79)
Southwest 0.9x	0.77	x	7.5	x	104.39	0.63	x	0.7	=	239.27	(79)
Southwest 0.9x	0.77	x	2.69	x	104.39	0.63	x	0.7	=	85.82	(79)
Southwest 0.9x	0.77	x	7.5	x	92.85	0.63	x	0.7	=	212.83	(79)
Southwest 0.9x	0.77	x	2.69	x	92.85	0.63	x	0.7	=	76.33	(79)
Southwest 0.9x	0.77	x	7.5	x	69.27	0.63	x	0.7	=	158.77	(79)
Southwest 0.9x	0.77	x	2.69	x	69.27	0.63	x	0.7	=	56.94	(79)
Southwest 0.9x	0.77	x	7.5	x	44.07	0.63	x	0.7	=	101.01	(79)
Southwest 0.9x	0.77	x	2.69	x	44.07	0.63	x	0.7	=	36.23	(79)
Southwest 0.9x	0.77	x	7.5	x	31.49	0.63	x	0.7	=	72.17	(79)
Southwest 0.9x	0.77	x	2.69	x	31.49	0.63	x	0.7	=	25.89	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	114.58	195.18	267.05	330.89	370.62	367.94	354.74	325.09	289.16	215.71	137.24	98.06	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	396.37	474.78	536.47	584.33	608.13	589.83	566.66	542.33	514.72	457.42	397.42	371.95	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.85	0.69	0.5	0.36	0.39	0.61	0.88	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.2	20.4	20.63	20.85	20.96	21	21	21	20.99	20.83	20.48	20.16	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.12	20.12	20.13	20.14	20.15	20.15	20.15	20.14	20.14	20.13	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.92	0.81	0.64	0.44	0.29	0.32	0.54	0.85	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.06	19.35	19.67	19.97	20.1	20.14	20.15	20.15	20.13	19.96	19.47	19.02	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.43	19.69	19.99	20.26	20.38	20.42	20.43	20.43	20.41	20.25	19.8	19.39	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.43	19.69	19.99	20.26	20.38	20.42	20.43	20.43	20.41	20.25	19.8	19.39	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.92	0.82	0.65	0.46	0.31	0.34	0.57	0.85	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	391.22	459.12	494.55	478.07	396.4	269.9	178.14	186.95	290.97	390.77	385.28	368.38	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	732.66	713.66	648.57	538	410.12	271.28	178.25	187.15	295.61	455.55	603.35	726.08	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	254.03	171.05	114.59	43.15	10.21	0	0	0	0	48.2	157.01	266.12	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1064.35 (98)

Space heating requirement in kWh/m²/year 21.09 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	254.03	171.05	114.59	43.15	10.21	0	0	0	0	48.2	157.01	266.12	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	271.98	183.14	122.69	46.2	10.93	0	0	0	0	51.6	168.1	284.93	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1139.57 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8

Efficiency of water heater 80.3 (216)

(217)m=	86.15	85.5	84.4	82.57	80.97	80.3	80.3	80.3	80.3	82.69	85.21	86.33	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.94	167.18	176.21	159.75	157.73	140.08	134.21	149.61	151.26	167.27	173.28	185.11	

Total = Sum(219a)$_{1...12}$ = 1951.65 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1139.57

TER WorkSheet: New dwelling design stage

Water heating fuel used		1951.65	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		235.11	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	246.15	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	421.56	(264)
Space and water heating	(261) + (262) + (263) + (264) =				667.7	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	122.02	(268)
Total CO2, kg/year		sum of (265)…(271) =			828.65	(272)

TER = 16.42 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 24

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	49.88	(1a) x	2.56	(2a) =	127.71	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	49.88	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		127.71	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.4	x	1/[1/(1.4)+ 0.04]	=	9.81			(27)
Windows Type 2			2.65	x	1/[1/(1.4)+ 0.04]	=	3.51			(27)
Walls Type1	24.52	10.05	14.47	x	0.18	=	2.6			(29)
Walls Type2	18.94	2.42	16.52	x	0.18	=	2.97			(29)
Total area of elements, m²			43.46							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 21.32 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 526.8 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 1.43 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 22.76 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.16	25	24.85	24.12	23.98	23.34	23.34	23.23	23.59	23.98	24.26	24.55	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	47.92	47.76	47.6	46.87	46.74	46.1	46.1	45.98	46.34	46.74	47.01	47.3	

Average = Sum(39)$_{1...12}$ /12= 46.87 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.96	0.95	0.94	0.94	0.92	0.92	0.92	0.93	0.94	0.94	0.95

Average = Sum(40)$_{1...12}$ /12= 0.94 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.69 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.26 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	81.69	78.72	75.74	72.77	69.8	66.83	66.83	69.8	72.77	75.74	78.72	81.69

Total = Sum(44)$_{1...12}$ = 891.11 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.14	105.95	109.33	95.31	91.46	78.92	73.13	83.92	84.92	98.97	108.03	117.31

Total = Sum(45)$_{1...12}$ = 1168.39 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.17	15.89	16.4	14.3	13.72	11.84	10.97	12.59	12.74	14.85	16.2	17.6

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.63	36.23	38.6	35.89	35.57	32.96	34.06	35.57	35.89	38.6	38.82	41.63	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	

Output from water heater (annual)$_{1...12}$ 1613.83 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.68	44.29	46	40.66	39.3	34.48	32.83	36.8	37.21	42.56	45.62	49.41	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.18	11.71	9.52	7.21	5.39	4.55	4.92	6.39	8.58	10.89	12.71	13.55	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	146.94	148.46	144.62	136.44	126.11	116.41	109.92	108.4	112.24	120.42	130.75	140.45	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	(71)

Water heating gains (Table 5)

(72)m=	68.12	65.9	61.83	56.48	52.83	47.89	44.13	49.46	51.68	57.2	63.37	66.42	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	279.54	277.37	267.27	251.43	235.63	220.15	210.27	215.55	223.8	239.81	258.13	271.72	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	7.4	x	36.79	x	0.63	x	0.7	=	83.21	(79)
Southwest$_{0.9x}$	0.77	x	2.65	x	36.79	x	0.63	x	0.7	=	29.8	(79)
Southwest$_{0.9x}$	0.77	x	7.4	x	62.67	x	0.63	x	0.7	=	141.74	(79)
Southwest$_{0.9x}$	0.77	x	2.65	x	62.67	x	0.63	x	0.7	=	50.76	(79)
Southwest$_{0.9x}$	0.77	x	7.4	x	85.75	x	0.63	x	0.7	=	193.93	(79)

TER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.65	x	85.75	0.63	x	0.7	=	69.45	(79)
Southwest 0.9x	0.77	x	7.4	x	106.25	0.63	x	0.7	=	240.29	(79)
Southwest 0.9x	0.77	x	2.65	x	106.25	0.63	x	0.7	=	86.05	(79)
Southwest 0.9x	0.77	x	7.4	x	119.01	0.63	x	0.7	=	269.15	(79)
Southwest 0.9x	0.77	x	2.65	x	119.01	0.63	x	0.7	=	96.38	(79)
Southwest 0.9x	0.77	x	7.4	x	118.15	0.63	x	0.7	=	267.2	(79)
Southwest 0.9x	0.77	x	2.65	x	118.15	0.63	x	0.7	=	95.69	(79)
Southwest 0.9x	0.77	x	7.4	x	113.91	0.63	x	0.7	=	257.61	(79)
Southwest 0.9x	0.77	x	2.65	x	113.91	0.63	x	0.7	=	92.25	(79)
Southwest 0.9x	0.77	x	7.4	x	104.39	0.63	x	0.7	=	236.08	(79)
Southwest 0.9x	0.77	x	2.65	x	104.39	0.63	x	0.7	=	84.54	(79)
Southwest 0.9x	0.77	x	7.4	x	92.85	0.63	x	0.7	=	209.99	(79)
Southwest 0.9x	0.77	x	2.65	x	92.85	0.63	x	0.7	=	75.2	(79)
Southwest 0.9x	0.77	x	7.4	x	69.27	0.63	x	0.7	=	156.65	(79)
Southwest 0.9x	0.77	x	2.65	x	69.27	0.63	x	0.7	=	56.1	(79)
Southwest 0.9x	0.77	x	7.4	x	44.07	0.63	x	0.7	=	99.67	(79)
Southwest 0.9x	0.77	x	2.65	x	44.07	0.63	x	0.7	=	35.69	(79)
Southwest 0.9x	0.77	x	7.4	x	31.49	0.63	x	0.7	=	71.21	(79)
Southwest 0.9x	0.77	x	2.65	x	31.49	0.63	x	0.7	=	25.5	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	113.01	192.5	263.38	326.34	365.53	362.89	349.86	320.63	285.19	212.75	135.36	96.71	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	392.55	469.87	530.65	577.77	601.16	583.04	560.13	536.17	508.98	452.56	393.48	368.43	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.85	0.69	0.5	0.36	0.39	0.61	0.88	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.2	20.4	20.63	20.85	20.96	21	21	21	20.98	20.83	20.48	20.16	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.12	20.12	20.13	20.14	20.15	20.15	20.15	20.14	20.14	20.13	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.92	0.81	0.64	0.44	0.29	0.32	0.54	0.85	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.06	19.35	19.67	19.97	20.1	20.14	20.15	20.15	20.13	19.96	19.47	19.02	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.44	19.69	19.99	20.26	20.39	20.43	20.43	20.43	20.41	20.25	19.8	19.4	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.44	19.69	19.99	20.26	20.39	20.43	20.43	20.43	20.41	20.25	19.8	19.4	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.92	0.82	0.65	0.46	0.31	0.35	0.57	0.85	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	387.42	454.35	489.24	472.95	392.31	267.19	176.41	185.12	288.03	386.68	381.43	364.87	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	725.39	706.53	642.05	532.56	406	268.57	176.52	185.32	292.66	450.96	597.29	718.82	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	251.45	169.46	113.69	42.92	10.19	0	0	0	0	47.83	155.42	263.34	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1054.3 (98)

Space heating requirement in kWh/m²/year 21.13 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	251.45	169.46	113.69	42.92	10.19	0	0	0	0	47.83	155.42	263.34	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	269.22	181.44	121.73	45.95	10.91	0	0	0	0	51.21	166.4	281.94	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1128.8 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94

Efficiency of water heater 80.3 (216)

(217)m=	86.14	85.49	84.4	82.57	80.97	80.3	80.3	80.3	80.3	82.68	85.19	86.31	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	188.95	166.3	175.27	158.89	156.88	139.33	133.49	148.81	150.45	166.38	172.37	184.14	

Total = Sum(219a)$_{1...12}$ = 1941.25 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1128.8

TER WorkSheet: New dwelling design stage

Water heating fuel used			1941.25	
Electricity for pumps, fans and electric keep-hot				
central heating pump:		30		(230c)
boiler with a fan-assisted flue		45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		75	(231)
Electricity for lighting			232.8	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	243.82	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	419.31	(264)
Space and water heating	(261) + (262) + (263) + (264) =				663.13	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	120.82	(268)
Total CO2, kg/year	sum of (265)…(271) =				822.88	(272)

TER = 16.5 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 25

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.49	(1a) x	2.56	(2a) =	129.25	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.49	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.25	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.51	x1/[1/(1.4)+ 0.04]		=	9.96			(27)
Windows Type 2			2.69	x1/[1/(1.4)+ 0.04]		=	3.57			(27)
Floor			50.498	x	0.13	=	6.56474			(28)
Walls Type1	15.41	10.2	5.21	x	0.18	=	0.94			(29)
Walls Type2	48.46	2.42	46.04	x	0.18	=	8.29			(29)
Total area of elements, m²			114.36							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.73 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 4658.55 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 0.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 32.54 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.43	25.27	25.11	24.38	24.24	23.6	23.6	23.49	23.85	24.24	24.52	24.81	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	57.97	57.81	57.65	56.92	56.78	56.14	56.14	56.02	56.39	56.78	57.06	57.35	

Average = Sum(39)$_{1...12}$ /12= 56.92 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.15	1.14	1.14	1.13	1.12	1.11	1.11	1.11	1.12	1.12	1.13	1.14

Average = Sum(40)$_{1...12}$ /12= 1.13 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.68 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	82.15	79.16	76.18	73.19	70.2	67.21	67.21	70.2	73.19	76.18	79.16	82.15	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 896.19 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.83	106.55	109.95	95.86	91.98	79.37	73.55	84.4	85.41	99.53	108.65	117.98

Total = Sum(45)$_{1...12}$ = 1175.05 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.38	13.8	11.91	11.03	12.66	12.81	14.93	16.3	17.7

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.86	36.44	38.82	36.09	35.77	33.15	34.25	35.77	36.09	38.82	39.04	41.86	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85	

Output from water heater (annual)$_{1...12}$ 1623.02 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.97	44.54	46.26	40.9	39.53	34.68	33.02	37.01	37.42	42.8	45.88	49.7	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.32	11.83	9.62	7.28	5.44	4.6	4.97	6.46	8.67	11	12.84	13.69	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.51	150.05	146.16	137.9	127.46	117.65	111.1	109.56	113.44	121.71	132.15	141.95	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	(71)

Water heating gains (Table 5)

(72)m=	68.51	66.28	62.18	56.8	53.13	48.16	44.38	49.74	51.97	57.53	63.73	66.79	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.91	279.72	269.54	253.55	237.6	221.98	212.01	217.32	225.65	241.81	260.28	274.01	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.69	x	36.79	x	0.63	x	0.7	=	30.25	(77)
Southeast 0.9x	0.77	x	2.69	x	62.67	x	0.63	x	0.7	=	51.52	(77)
Southeast 0.9x	0.77	x	2.69	x	85.75	x	0.63	x	0.7	=	70.5	(77)
Southeast 0.9x	0.77	x	2.69	x	106.25	x	0.63	x	0.7	=	87.35	(77)
Southeast 0.9x	0.77	x	2.69	x	119.01	x	0.63	x	0.7	=	97.84	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.69	x	118.15	x	0.63	x	0.7	=	97.13	(77)
Southeast 0.9x	0.77	x	2.69	x	113.91	x	0.63	x	0.7	=	93.64	(77)
Southeast 0.9x	0.77	x	2.69	x	104.39	x	0.63	x	0.7	=	85.82	(77)
Southeast 0.9x	0.77	x	2.69	x	92.85	x	0.63	x	0.7	=	76.33	(77)
Southeast 0.9x	0.77	x	2.69	x	69.27	x	0.63	x	0.7	=	56.94	(77)
Southeast 0.9x	0.77	x	2.69	x	44.07	x	0.63	x	0.7	=	36.23	(77)
Southeast 0.9x	0.77	x	2.69	x	31.49	x	0.63	x	0.7	=	25.89	(77)
Southwest 0.9x	0.77	x	7.51	x	36.79		0.63	x	0.7	=	84.45	(79)
Southwest 0.9x	0.77	x	7.51	x	62.67		0.63	x	0.7	=	143.85	(79)
Southwest 0.9x	0.77	x	7.51	x	85.75		0.63	x	0.7	=	196.82	(79)
Southwest 0.9x	0.77	x	7.51	x	106.25		0.63	x	0.7	=	243.86	(79)
Southwest 0.9x	0.77	x	7.51	x	119.01		0.63	x	0.7	=	273.15	(79)
Southwest 0.9x	0.77	x	7.51	x	118.15		0.63	x	0.7	=	271.17	(79)
Southwest 0.9x	0.77	x	7.51	x	113.91		0.63	x	0.7	=	261.44	(79)
Southwest 0.9x	0.77	x	7.51	x	104.39		0.63	x	0.7	=	239.59	(79)
Southwest 0.9x	0.77	x	7.51	x	92.85		0.63	x	0.7	=	213.11	(79)
Southwest 0.9x	0.77	x	7.51	x	69.27		0.63	x	0.7	=	158.98	(79)
Southwest 0.9x	0.77	x	7.51	x	44.07		0.63	x	0.7	=	101.15	(79)
Southwest 0.9x	0.77	x	7.51	x	31.49		0.63	x	0.7	=	72.27	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	114.7	195.37	267.31	331.21	370.99	368.3	355.08	325.41	289.44	215.92	137.38	98.16	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	396.6	475.09	536.85	584.76	608.59	590.28	567.1	542.73	515.09	457.73	397.66	372.16	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.9	0.77	0.59	0.43	0.47	0.7	0.92	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.93	20.14	20.4	20.69	20.89	20.98	21	20.99	20.95	20.69	20.25	19.89	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.96	19.96	19.97	19.98	19.98	19.99	19.99	19.99	19.99	19.98	19.98	19.97	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.87	0.71	0.5	0.33	0.37	0.62	0.89	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.56	18.86	19.23	19.64	19.88	19.98	19.99	19.99	19.95	19.64	19.03	18.51	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.01	19.28	19.62	19.98	20.21	20.31	20.32	20.32	20.28	19.98	19.43	18.96	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.01	19.28	19.62	19.98	20.21	20.31	20.32	20.32	20.28	19.98	19.43	18.96	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.94	0.87	0.73	0.53	0.37	0.4	0.64	0.89	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	392.05	462.54	505.32	506.55	442.85	313.92	208.04	218.35	331.76	408.72	387.93	368.92	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	852.57	831	756.18	630.85	483.33	320.31	208.8	219.57	348.33	532.77	703.57	846.65	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	342.63	247.61	186.64	89.5	30.12	0	0	0	0	92.3	227.27	355.43	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1571.48 (98)

Space heating requirement in kWh/m²/year 31.12 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	342.63	247.61	186.64	89.5	30.12	0	0	0	0	92.3	227.27	355.43	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	366.84	265.11	199.83	95.82	32.25	0	0	0	0	98.82	243.33	380.54	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1682.53 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85

Efficiency of water heater 80.3 (216)

(217)m=	86.87	86.42	85.62	84.1	82.05	80.3	80.3	80.3	80.3	84.06	86.13	87.01	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	188.44	165.46	173.75	156.9	155.7	140.12	134.25	149.65	151.31	164.59	171.46	183.72	

Total = Sum(219a)$_{1...12}$ = 1935.35 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1682.53

TER WorkSheet: New dwelling design stage

Water heating fuel used		1935.35	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		235.22	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	363.43	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	418.04	(264)
Space and water heating	(261) + (262) + (263) + (264) =				781.46	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	122.08	(268)
Total CO2, kg/year		sum of (265)…(271) =			942.47	(272)

TER = 18.67 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 26

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.04	(1a) x	2.56	(2a) =	186.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.04	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)			0	(9)
Additional infiltration		[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0	(12)
If no draught lobby, enter 0.05, else enter 0			0	(13)
Percentage of windows and doors draught stripped			0	(14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5	(17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered			2	(19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.44	0.43	0.38	0.38	0.33	0.33	0.32	0.35	0.38	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.38	x	1/[1/(1.4)+ 0.04]	=	9.78			(27)
Windows Type 2			4.23	x	1/[1/(1.4)+ 0.04]	=	5.61			(27)
Walls Type1	36.47	15.84	20.63	x	0.18	=	3.71			(29)
Walls Type2	41.48	2.42	39.06	x	0.18	=	7.03			(29)
Total area of elements, m²			77.95							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 34.16 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1014.73 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 2.28 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 36.45 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	36.96	36.72	36.49	35.4	35.19	34.24	34.24	34.07	34.61	35.19	35.6	36.04	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	73.41	73.17	72.94	71.84	71.64	70.69	70.69	70.51	71.06	71.64	72.05	72.49	

Average = Sum(39)$_{1...12}$ /12= 71.84 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.01	1	1	0.98	0.98	0.97	0.97	0.97	0.97	0.98	0.99	0.99

Average = Sum(40)$_{1...12}$ /12= 0.98 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.24 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.17	94.6	91.03	87.46	83.89	80.32	80.32	83.89	87.46	91.03	94.6	98.17

Total = Sum(44)$_{1...12}$ = 1070.92 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.58	127.32	131.39	114.55	109.91	94.84	87.89	100.85	102.06	118.94	129.83	140.99

Total = Sum(45)$_{1...12}$ = 1404.14 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.84	19.1	19.71	17.18	16.49	14.23	13.18	15.13	15.31	17.84	19.47	21.15

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.03	43.54	46.39	43.13	42.75	39.61	40.93	42.75	43.13	46.39	46.65	50.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	

Output from water heater (annual)$_{1...12}$ 1939.46 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.91	53.22	55.28	48.87	47.23	41.44	39.45	44.22	44.72	51.14	54.83	59.38	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.23	16.19	13.17	9.97	7.45	6.29	6.8	8.84	11.86	15.06	17.57	18.74	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.29	206.41	201.06	189.69	175.34	161.84	152.83	150.71	156.05	167.42	181.78	195.27	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	(71)

Water heating gains (Table 5)

(72)m=	81.87	79.2	74.31	67.87	63.48	57.55	53.03	59.44	62.11	68.74	76.15	79.82	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	365.15	362.56	349.3	328.3	307.04	286.45	273.42	279.75	290.78	311.99	336.27	354.59	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.38	x	36.79	x	0.63	x	0.7	=	82.99	(77)
Southeast 0.9x	0.77	x	4.23	x	36.79	x	0.63	x	0.7	=	95.13	(77)
Southeast 0.9x	0.77	x	7.38	x	62.67	x	0.63	x	0.7	=	141.36	(77)
Southeast 0.9x	0.77	x	4.23	x	62.67	x	0.63	x	0.7	=	162.04	(77)
Southeast 0.9x	0.77	x	7.38	x	85.75	x	0.63	x	0.7	=	193.41	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.23	x	85.75	x	0.63	x	0.7	=	221.71	(77)
Southeast 0.9x	0.77	x	7.38	x	106.25	x	0.63	x	0.7	=	239.64	(77)
Southeast 0.9x	0.77	x	4.23	x	106.25	x	0.63	x	0.7	=	274.71	(77)
Southeast 0.9x	0.77	x	7.38	x	119.01	x	0.63	x	0.7	=	268.42	(77)
Southeast 0.9x	0.77	x	4.23	x	119.01	x	0.63	x	0.7	=	307.7	(77)
Southeast 0.9x	0.77	x	7.38	x	118.15	x	0.63	x	0.7	=	266.48	(77)
Southeast 0.9x	0.77	x	4.23	x	118.15	x	0.63	x	0.7	=	305.48	(77)
Southeast 0.9x	0.77	x	7.38	x	113.91	x	0.63	x	0.7	=	256.91	(77)
Southeast 0.9x	0.77	x	4.23	x	113.91	x	0.63	x	0.7	=	294.51	(77)
Southeast 0.9x	0.77	x	7.38	x	104.39	x	0.63	x	0.7	=	235.44	(77)
Southeast 0.9x	0.77	x	4.23	x	104.39	x	0.63	x	0.7	=	269.9	(77)
Southeast 0.9x	0.77	x	7.38	x	92.85	x	0.63	x	0.7	=	209.42	(77)
Southeast 0.9x	0.77	x	4.23	x	92.85	x	0.63	x	0.7	=	240.07	(77)
Southeast 0.9x	0.77	x	7.38	x	69.27	x	0.63	x	0.7	=	156.23	(77)
Southeast 0.9x	0.77	x	4.23	x	69.27	x	0.63	x	0.7	=	179.09	(77)
Southeast 0.9x	0.77	x	7.38	x	44.07	x	0.63	x	0.7	=	99.4	(77)
Southeast 0.9x	0.77	x	4.23	x	44.07	x	0.63	x	0.7	=	113.94	(77)
Southeast 0.9x	0.77	x	7.38	x	31.49	x	0.63	x	0.7	=	71.02	(77)
Southeast 0.9x	0.77	x	4.23	x	31.49	x	0.63	x	0.7	=	81.41	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	178.12	303.4	415.12	514.35	576.12	571.95	551.42	505.34	449.49	335.32	213.34	152.43	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	543.26	665.95	764.42	842.65	883.16	858.4	824.85	785.09	740.27	647.31	549.61	507.02	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.86	0.71	0.52	0.38	0.41	0.64	0.9	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.09	20.31	20.56	20.81	20.95	20.99	21	21	20.98	20.79	20.39	20.06	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.08	20.08	20.08	20.1	20.1	20.11	20.11	20.11	20.11	20.1	20.09	20.09	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.83	0.66	0.45	0.3	0.33	0.57	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.88	19.19	19.55	19.89	20.05	20.11	20.11	20.11	20.09	19.87	19.32	18.83	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.21	19.49	19.83	20.14	20.3	20.35	20.35	20.35	20.33	20.12	19.61	19.17	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.21	19.49	19.83	20.14	20.3	20.35	20.35	20.35	20.33	20.12	19.61	19.17	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.67	0.47	0.32	0.35	0.59	0.87	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	537.82	647.52	711.51	701.38	589.91	403.43	264.96	278.29	433.32	564.82	536.31	503.36	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1094.58	1067.86	971.92	807.8	615.95	406.27	265.22	278.74	442.84	682.17	901.58	1084.87	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	414.23	282.47	193.74	76.62	19.37	0	0	0	0	87.31	263	432.64	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1769.38 (98)

Space heating requirement in kWh/m²/year 24.22 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	414.23	282.47	193.74	76.62	19.37	0	0	0	0	87.31	263	432.64	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	443.5	302.43	207.43	82.04	20.74	0	0	0	0	93.48	281.58	463.21	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1894.41 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01

Efficiency of water heater 80.3 (216)

(217)m=	86.89	86.31	85.27	83.35	81.32	80.3	80.3	80.3	80.3	83.53	86.05	87.05	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	225.11	197.97	208.49	189.19	187.72	167.44	160.42	178.83	180.81	197.93	205.08	219.44	

Total = Sum(219a)$_{1...12}$ = 2318.42 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1894.41

TER WorkSheet: New dwelling design stage

Water heating fuel used		2318.42	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		321.92	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	409.19	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	500.78	(264)
Space and water heating	(261) + (262) + (263) + (264) =				909.97	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	167.08	(268)
Total CO2, kg/year	sum of (265)…(271) =				1115.97	(272)

TER = 15.28 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 27

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.73	(1a) x	2.56	(2a) =	188.75	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.73	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.75	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.43	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.46	x	1/[1/(1.4)+ 0.04]	=	9.89			(27)
Windows Type 2			4.28	x	1/[1/(1.4)+ 0.04]	=	5.67			(27)
Walls Type1	31.87	16.02	15.85	x	0.18	=	2.85			(29)
Walls Type2	39.15	2.42	36.73	x	0.18	=	6.61			(29)
Total area of elements, m²			71.02							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.12 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 893.84 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 2.04 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.17 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	37.26	37.02	36.79	35.7	35.49	34.54	34.54	34.36	34.91	35.49	35.91	36.34	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	72.43	72.19	71.96	70.86	70.66	69.71	69.71	69.53	70.07	70.66	71.07	71.51	

Average = Sum(39)$_{1...12}$ /12= 70.86 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.98	0.98	0.98	0.96	0.96	0.95	0.95	0.94	0.95	0.96	0.96	0.97

Average = Sum(40)$_{1...12}$ /12= 0.96 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.61 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.57	94.99	91.4	87.82	84.24	80.65	80.65	84.24	87.82	91.4	94.99	98.57

Total = Sum(44)$_{1...12}$ = 1075.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.18	127.85	131.93	115.02	110.37	95.24	88.25	101.27	102.48	119.43	130.37	141.57

Total = Sum(45)$_{1...12}$ = 1409.95 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.93	19.18	19.79	17.25	16.55	14.29	13.24	15.19	15.37	17.91	19.55	21.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.23	43.72	46.58	43.31	42.93	39.77	41.1	42.93	43.31	46.58	46.84	50.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8	

Output from water heater (annual)$_{1...12}$ 1947.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.16	53.44	55.51	49.07	47.43	41.61	39.62	44.4	44.9	51.35	55.06	59.63	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.37	16.31	13.27	10.04	7.51	6.34	6.85	8.9	11.95	15.17	17.71	18.88	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.84	207.98	202.59	191.13	176.67	163.07	153.99	151.86	157.24	168.7	183.16	196.76	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	(71)

Water heating gains (Table 5)

(72)m=	82.21	79.53	74.61	68.15	63.75	57.79	53.25	59.68	62.36	69.03	76.47	80.15	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.41	364.81	351.47	330.33	308.92	288.2	275.09	281.44	292.55	313.89	338.34	356.78	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.46	x	36.79	x	0.63	x	0.7	=	83.89	(77)
Southeast 0.9x	0.77	x	4.28	x	36.79	x	0.63	x	0.7	=	96.25	(77)
Southeast 0.9x	0.77	x	7.46	x	62.67	x	0.63	x	0.7	=	142.89	(77)
Southeast 0.9x	0.77	x	4.28	x	62.67	x	0.63	x	0.7	=	163.96	(77)
Southeast 0.9x	0.77	x	7.46	x	85.75	x	0.63	x	0.7	=	195.51	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.28	x	85.75	x	0.63	x	0.7	=	224.33	(77)
Southeast 0.9x	0.77	x	7.46	x	106.25	x	0.63	x	0.7	=	242.24	(77)
Southeast 0.9x	0.77	x	4.28	x	106.25	x	0.63	x	0.7	=	277.96	(77)
Southeast 0.9x	0.77	x	7.46	x	119.01	x	0.63	x	0.7	=	271.33	(77)
Southeast 0.9x	0.77	x	4.28	x	119.01	x	0.63	x	0.7	=	311.34	(77)
Southeast 0.9x	0.77	x	7.46	x	118.15	x	0.63	x	0.7	=	269.37	(77)
Southeast 0.9x	0.77	x	4.28	x	118.15	x	0.63	x	0.7	=	309.09	(77)
Southeast 0.9x	0.77	x	7.46	x	113.91	x	0.63	x	0.7	=	259.7	(77)
Southeast 0.9x	0.77	x	4.28	x	113.91	x	0.63	x	0.7	=	297.99	(77)
Southeast 0.9x	0.77	x	7.46	x	104.39	x	0.63	x	0.7	=	238	(77)
Southeast 0.9x	0.77	x	4.28	x	104.39	x	0.63	x	0.7	=	273.09	(77)
Southeast 0.9x	0.77	x	7.46	x	92.85	x	0.63	x	0.7	=	211.69	(77)
Southeast 0.9x	0.77	x	4.28	x	92.85	x	0.63	x	0.7	=	242.91	(77)
Southeast 0.9x	0.77	x	7.46	x	69.27	x	0.63	x	0.7	=	157.92	(77)
Southeast 0.9x	0.77	x	4.28	x	69.27	x	0.63	x	0.7	=	181.21	(77)
Southeast 0.9x	0.77	x	7.46	x	44.07	x	0.63	x	0.7	=	100.48	(77)
Southeast 0.9x	0.77	x	4.28	x	44.07	x	0.63	x	0.7	=	115.29	(77)
Southeast 0.9x	0.77	x	7.46	x	31.49	x	0.63	x	0.7	=	71.79	(77)
Southeast 0.9x	0.77	x	4.28	x	31.49	x	0.63	x	0.7	=	82.37	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	180.14	306.84	419.84	520.2	582.67	578.45	557.69	511.09	454.6	339.13	215.77	154.16	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	547.55	671.65	771.31	850.53	891.59	866.65	832.78	792.52	747.14	653.02	554.1	510.94	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.86	0.7	0.51	0.37	0.4	0.63	0.9	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.13	20.34	20.59	20.83	20.96	20.99	21	21	20.98	20.8	20.42	20.09	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.1	20.1	20.1	20.12	20.12	20.13	20.13	20.13	20.12	20.12	20.11	20.11	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.93	0.82	0.64	0.44	0.3	0.33	0.56	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.94	19.25	19.6	19.93	20.08	20.13	20.13	20.13	20.11	19.91	19.37	18.89	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.26	19.54	19.87	20.17	20.32	20.36	20.36	20.36	20.35	20.15	19.66	19.22	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.26	19.54	19.87	20.17	20.32	20.36	20.36	20.36	20.35	20.15	19.66	19.22	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.66	0.46	0.31	0.35	0.58	0.87	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	542.01	652.52	715.81	701.96	586.25	399.17	262.14	275.31	429.66	566.37	540.34	507.24	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1083.58	1057.09	961.98	798.95	608.79	401.49	262.33	275.66	437.71	674.94	892.36	1073.74	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	402.93	271.87	183.15	69.83	16.77	0	0	0	0	80.77	253.46	421.48	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1700.26 (98)

Space heating requirement in kWh/m²/year 23.06 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	402.93	271.87	183.15	69.83	16.77	0	0	0	0	80.77	253.46	421.48	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	431.4	291.08	196.09	74.76	17.95	0	0	0	0	86.48	271.37	451.26	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1820.4 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8

Efficiency of water heater 80.3 (216)

(217)m=	86.82	86.2	85.12	83.14	81.19	80.3	80.3	80.3	80.3	83.35	85.95	86.98	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	226.23	199.03	209.73	190.43	188.79	168.13	161.08	179.57	181.55	199.17	206.17	220.52	

Total = Sum(219a)$_{1...12}$ = 2330.41 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1820.4

TER WorkSheet: New dwelling design stage

Water heating fuel used		2330.41	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		324.34	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	393.21	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	503.37	(264)
Space and water heating	(261) + (262) + (263) + (264) =				896.58	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	168.33	(268)
Total CO2, kg/year		sum of (265)…(271) =			1103.83	(272)

TER = 14.97 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 28

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	58.88	(1a) x	2.56	(2a) =	150.74	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	58.88	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		150.74	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.13	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)			0	(9)
Additional infiltration		[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0	(12)
If no draught lobby, enter 0.05, else enter 0			0	(13)
Percentage of windows and doors draught stripped			0	(14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5	(17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.38	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered			2	(19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.33	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.41	0.41	0.4	0.36	0.35	0.31	0.31	0.3	0.33	0.35	0.37	0.38

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.37	x1/[1/(1.4)+ 0.04]		=	8.45			(27)
Windows Type 2			3.65	x1/[1/(1.4)+ 0.04]		=	4.84			(27)
Windows Type 3			2.28	x1/[1/(1.4)+ 0.04]		=	3.02			(27)
Floor			6.686	x	0.13	=	0.86918			(28)
Walls Type1	31.19	12.3	18.89	x	0.18	=	3.4			(29)
Walls Type2	39.09	2.42	36.67	x	0.18	=	6.6			(29)
Total area of elements, m²			76.96							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 29.6 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1445.87 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 2.74 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 32.34 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	29.15	28.98	28.82	28.06	27.91	27.25	27.25	27.12	27.5	27.91	28.2	28.51	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	61.49	61.32	61.16	60.4	60.25	59.59	59.59	59.46	59.84	60.25	60.54	60.85	

Average = Sum(39)$_{1...12}$ /12= 60.4 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.04	1.04	1.04	1.03	1.02	1.01	1.01	1.01	1.02	1.02	1.03	1.03

Average = Sum(40)$_{1...12}$ /12= 1.03 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.95 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 80.51 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	88.56	85.34	82.12	78.9	75.68	72.46	72.46	75.68	78.9	82.12	85.34	88.56	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 966.12 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	131.33	114.86	118.53	103.34	99.15	85.56	79.29	90.98	92.07	107.3	117.12	127.19

Total = Sum(45)$_{1...12}$ = 1266.73 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.7	17.23	17.78	15.5	14.87	12.83	11.89	13.65	13.81	16.09	17.57	19.08

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	45.13	39.28	41.85	38.91	38.57	35.73	36.92	38.57	38.91	41.85	42.09	45.13	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32	

Output from water heater (annual)$_{1...12}$ 1749.66 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	54.95	48.01	49.87	44.09	42.61	37.38	35.59	39.89	40.34	46.14	49.47	53.57	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	15.21	13.51	10.99	8.32	6.22	5.25	5.67	7.37	9.9	12.57	14.67	15.64	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	170.12	171.89	167.44	157.97	146.01	134.78	127.27	125.51	129.95	139.42	151.38	162.62	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	(71)

Water heating gains (Table 5)

(72)m=	73.86	71.45	67.03	61.23	57.27	51.92	47.84	53.62	56.03	62.01	68.7	72.01	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	314.44	312.09	300.71	282.77	264.75	247.2	236.03	241.75	251.13	269.25	290	305.51	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	6.37	x	36.79	x	0.63	x	0.7	=	71.63	(77)
Southeast 0.9x	0.77	x	3.65	x	36.79	x	0.63	x	0.7	=	41.04	(77)
Southeast 0.9x	0.77	x	2.28	x	36.79	x	0.63	x	0.7	=	25.64	(77)
Southeast 0.9x	0.77	x	6.37	x	62.67	x	0.63	x	0.7	=	122.01	(77)
Southeast 0.9x	0.77	x	3.65	x	62.67	x	0.63	x	0.7	=	69.91	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.28	x	62.67	x	0.63	x	0.7	=	43.67	(77)
Southeast 0.9x	0.77	x	6.37	x	85.75	x	0.63	x	0.7	=	166.94	(77)
Southeast 0.9x	0.77	x	3.65	x	85.75	x	0.63	x	0.7	=	95.66	(77)
Southeast 0.9x	0.77	x	2.28	x	85.75	x	0.63	x	0.7	=	59.75	(77)
Southeast 0.9x	0.77	x	6.37	x	106.25	x	0.63	x	0.7	=	206.85	(77)
Southeast 0.9x	0.77	x	3.65	x	106.25	x	0.63	x	0.7	=	118.52	(77)
Southeast 0.9x	0.77	x	2.28	x	106.25	x	0.63	x	0.7	=	74.04	(77)
Southeast 0.9x	0.77	x	6.37	x	119.01	x	0.63	x	0.7	=	231.68	(77)
Southeast 0.9x	0.77	x	3.65	x	119.01	x	0.63	x	0.7	=	132.75	(77)
Southeast 0.9x	0.77	x	2.28	x	119.01	x	0.63	x	0.7	=	82.93	(77)
Southeast 0.9x	0.77	x	6.37	x	118.15	x	0.63	x	0.7	=	230.01	(77)
Southeast 0.9x	0.77	x	3.65	x	118.15	x	0.63	x	0.7	=	131.79	(77)
Southeast 0.9x	0.77	x	2.28	x	118.15	x	0.63	x	0.7	=	82.33	(77)
Southeast 0.9x	0.77	x	6.37	x	113.91	x	0.63	x	0.7	=	221.75	(77)
Southeast 0.9x	0.77	x	3.65	x	113.91	x	0.63	x	0.7	=	127.06	(77)
Southeast 0.9x	0.77	x	2.28	x	113.91	x	0.63	x	0.7	=	79.37	(77)
Southeast 0.9x	0.77	x	6.37	x	104.39	x	0.63	x	0.7	=	203.22	(77)
Southeast 0.9x	0.77	x	3.65	x	104.39	x	0.63	x	0.7	=	116.45	(77)
Southeast 0.9x	0.77	x	2.28	x	104.39	x	0.63	x	0.7	=	72.74	(77)
Southeast 0.9x	0.77	x	6.37	x	92.85	x	0.63	x	0.7	=	180.76	(77)
Southeast 0.9x	0.77	x	3.65	x	92.85	x	0.63	x	0.7	=	103.58	(77)
Southeast 0.9x	0.77	x	2.28	x	92.85	x	0.63	x	0.7	=	64.7	(77)
Southeast 0.9x	0.77	x	6.37	x	69.27	x	0.63	x	0.7	=	134.85	(77)
Southeast 0.9x	0.77	x	3.65	x	69.27	x	0.63	x	0.7	=	77.27	(77)
Southeast 0.9x	0.77	x	2.28	x	69.27	x	0.63	x	0.7	=	48.27	(77)
Southeast 0.9x	0.77	x	6.37	x	44.07	x	0.63	x	0.7	=	85.79	(77)
Southeast 0.9x	0.77	x	3.65	x	44.07	x	0.63	x	0.7	=	49.16	(77)
Southeast 0.9x	0.77	x	2.28	x	44.07	x	0.63	x	0.7	=	30.71	(77)
Southeast 0.9x	0.77	x	6.37	x	31.49	x	0.63	x	0.7	=	61.3	(77)
Southeast 0.9x	0.77	x	3.65	x	31.49	x	0.63	x	0.7	=	35.12	(77)
Southeast 0.9x	0.77	x	2.28	x	31.49	x	0.63	x	0.7	=	21.94	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	138.31	235.59	322.35	399.4	447.37	444.13	428.19	392.41	349.03	260.38	165.66	118.36	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	452.75	547.69	623.06	682.17	712.12	691.33	664.22	634.16	600.16	529.63	455.66	423.87	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.73	0.54	0.39	0.43	0.66	0.91	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.06	20.27	20.52	20.78	20.93	20.99	21	21	20.97	20.76	20.36	20.02	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.05	20.05	20.05	20.06	20.06	20.07	20.07	20.08	20.07	20.06	20.06	20.06	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.67	0.47	0.31	0.34	0.58	0.88	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.81	19.11	19.47	19.82	20.01	20.07	20.07	20.07	20.05	19.81	19.25	18.76	(90)

fLA = Living area ÷ (4) = 0.34 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.23	19.5	19.82	20.15	20.32	20.38	20.39	20.39	20.36	20.13	19.62	19.18	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.23	19.5	19.82	20.15	20.32	20.38	20.39	20.39	20.36	20.13	19.62	19.18	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.84	0.69	0.49	0.34	0.37	0.61	0.88	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	447.77	532.41	581.88	576.18	491.16	340.73	225.19	236.4	363.9	465.45	444.21	420.44	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	918.17	895.34	814.9	679.21	519.33	344.32	225.55	237.01	374.66	574.3	758.26	911.75	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	349.97	243.89	173.36	74.18	20.96	0	0	0	0	80.98	226.12	365.54	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1535 (98)

Space heating requirement in kWh/m²/year 26.07 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	349.97	243.89	173.36	74.18	20.96	0	0	0	0	80.98	226.12	365.54	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	374.7	261.13	185.61	79.42	22.44	0	0	0	0	86.7	242.09	391.37	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1643.47 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32

Efficiency of water heater 80.3 (216)

(217)m=	86.74	86.2	85.25	83.5	81.5	80.3	80.3	80.3	80.3	83.59	85.93	86.9

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	203.43	178.82	188.13	170.36	168.98	151.05	144.72	161.33	163.11	178.43	185.27	198.3

Total = Sum(219a)$_{1...12}$ = 2091.94 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1643.47	
Water heating fuel used		2091.94	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		268.68	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	354.99	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	451.86	(264)
Space and water heating	(261) + (262) + (263) + (264) =			806.85	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	139.45	(268)
Total CO2, kg/year	sum of (265)…(271) =			985.22	(272)

TER = 16.73 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 29

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.42	(1a) x	2.56	(2a) =	187.95	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.42	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.95	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.44	0.43	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.56	x1/[1/(1.4)+ 0.04]		=	7.37			(27)
Windows Type 2			3.19	x1/[1/(1.4)+ 0.04]		=	4.23			(27)
Windows Type 3			2	x1/[1/(1.4)+ 0.04]		=	2.65			(27)
Windows Type 4			2	x1/[1/(1.4)+ 0.04]		=	2.65			(27)
Walls Type1	52.48	15.94	36.54	x	0.18	=	6.58			(29)
Walls Type2	22.71	2.42	20.29	x	0.18	=	3.65			(29)
Total area of elements, m²			75.19							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.78 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 966.13 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.14 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 37.93 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	37.12	36.89	36.65	35.56	35.36	34.4	34.4	34.23	34.77	35.36	35.77	36.2	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	75.05	74.81	74.58	73.49	73.28	72.33	72.33	72.15	72.7	73.28	73.7	74.13	

Average = Sum(39)$_{1...12}$ /12= 73.49 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.02	1.02	1.02	1	1	0.99	0.99	0.98	0.99	1	1	1.01

Average = Sum(40)$_{1...12}$ /12= 1 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.45 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.39	94.81	91.24	87.66	84.08	80.5	80.5	84.08	87.66	91.24	94.81	98.39

Total = Sum(44)$_{1...12}$ = 1073.36 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.91	127.61	131.69	114.81	110.16	95.06	88.09	101.08	102.29	119.21	130.12	141.31

Total = Sum(45)$_{1...12}$ = 1407.34 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.89	19.14	19.75	17.22	16.52	14.26	13.21	15.16	15.34	17.88	19.52	21.2

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.14	43.64	46.49	43.23	42.85	39.7	41.02	42.85	43.23	46.49	46.76	50.14	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	

Output from water heater (annual)$_{1...12}$ 1943.87 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.05	53.34	55.41	48.98	47.34	41.53	39.54	44.32	44.82	51.26	54.96	59.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.3	16.26	13.22	10.01	7.48	6.32	6.83	8.87	11.91	15.12	17.65	18.81	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.14	207.27	201.9	190.48	176.07	162.52	153.47	151.34	156.7	168.12	182.54	196.09	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	(71)

Water heating gains (Table 5)

(72)m=	82.06	79.38	74.47	68.03	63.63	57.68	53.15	59.57	62.25	68.9	76.33	80	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	366.39	363.8	350.49	329.41	308.07	287.41	274.34	280.68	291.75	313.03	337.41	355.79	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2	x	11.28	x	0.63	x	0.7	=	6.9	(75)
Northeast 0.9x	0.77	x	2	x	22.97	x	0.63	x	0.7	=	14.04	(75)
Northeast 0.9x	0.77	x	2	x	41.38	x	0.63	x	0.7	=	25.29	(75)
Northeast 0.9x	0.77	x	2	x	67.96	x	0.63	x	0.7	=	41.54	(75)
Northeast 0.9x	0.77	x	2	x	91.35	x	0.63	x	0.7	=	55.83	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2	x	97.38	x	0.63	x	0.7	=	59.52	(75)
Northeast 0.9x	0.77	x	2	x	91.1	x	0.63	x	0.7	=	55.68	(75)
Northeast 0.9x	0.77	x	2	x	72.63	x	0.63	x	0.7	=	44.39	(75)
Northeast 0.9x	0.77	x	2	x	50.42	x	0.63	x	0.7	=	30.82	(75)
Northeast 0.9x	0.77	x	2	x	28.07	x	0.63	x	0.7	=	17.16	(75)
Northeast 0.9x	0.77	x	2	x	14.2	x	0.63	x	0.7	=	8.68	(75)
Northeast 0.9x	0.77	x	2	x	9.21	x	0.63	x	0.7	=	5.63	(75)
Southeast 0.9x	0.77	x	5.56	x	36.79	x	0.63	x	0.7	=	62.52	(77)
Southeast 0.9x	0.77	x	3.19	x	36.79	x	0.63	x	0.7	=	71.74	(77)
Southeast 0.9x	0.77	x	5.56	x	62.67	x	0.63	x	0.7	=	106.5	(77)
Southeast 0.9x	0.77	x	3.19	x	62.67	x	0.63	x	0.7	=	122.2	(77)
Southeast 0.9x	0.77	x	5.56	x	85.75	x	0.63	x	0.7	=	145.71	(77)
Southeast 0.9x	0.77	x	3.19	x	85.75	x	0.63	x	0.7	=	167.2	(77)
Southeast 0.9x	0.77	x	5.56	x	106.25	x	0.63	x	0.7	=	180.54	(77)
Southeast 0.9x	0.77	x	3.19	x	106.25	x	0.63	x	0.7	=	207.17	(77)
Southeast 0.9x	0.77	x	5.56	x	119.01	x	0.63	x	0.7	=	202.22	(77)
Southeast 0.9x	0.77	x	3.19	x	119.01	x	0.63	x	0.7	=	232.05	(77)
Southeast 0.9x	0.77	x	5.56	x	118.15	x	0.63	x	0.7	=	200.76	(77)
Southeast 0.9x	0.77	x	3.19	x	118.15	x	0.63	x	0.7	=	230.37	(77)
Southeast 0.9x	0.77	x	5.56	x	113.91	x	0.63	x	0.7	=	193.56	(77)
Southeast 0.9x	0.77	x	3.19	x	113.91	x	0.63	x	0.7	=	222.1	(77)
Southeast 0.9x	0.77	x	5.56	x	104.39	x	0.63	x	0.7	=	177.38	(77)
Southeast 0.9x	0.77	x	3.19	x	104.39	x	0.63	x	0.7	=	203.54	(77)
Southeast 0.9x	0.77	x	5.56	x	92.85	x	0.63	x	0.7	=	157.77	(77)
Southeast 0.9x	0.77	x	3.19	x	92.85	x	0.63	x	0.7	=	181.04	(77)
Southeast 0.9x	0.77	x	5.56	x	69.27	x	0.63	x	0.7	=	117.7	(77)
Southeast 0.9x	0.77	x	3.19	x	69.27	x	0.63	x	0.7	=	135.06	(77)
Southeast 0.9x	0.77	x	5.56	x	44.07	x	0.63	x	0.7	=	74.88	(77)
Southeast 0.9x	0.77	x	3.19	x	44.07	x	0.63	x	0.7	=	85.93	(77)
Southeast 0.9x	0.77	x	5.56	x	31.49	x	0.63	x	0.7	=	53.5	(77)
Southeast 0.9x	0.77	x	3.19	x	31.49	x	0.63	x	0.7	=	61.4	(77)
Southwest 0.9x	0.77	x	2	x	36.79		0.63	x	0.7	=	22.49	(79)
Southwest 0.9x	0.77	x	2	x	62.67		0.63	x	0.7	=	38.31	(79)
Southwest 0.9x	0.77	x	2	x	85.75		0.63	x	0.7	=	52.41	(79)
Southwest 0.9x	0.77	x	2	x	106.25		0.63	x	0.7	=	64.94	(79)
Southwest 0.9x	0.77	x	2	x	119.01		0.63	x	0.7	=	72.74	(79)
Southwest 0.9x	0.77	x	2	x	118.15		0.63	x	0.7	=	72.22	(79)
Southwest 0.9x	0.77	x	2	x	113.91		0.63	x	0.7	=	69.62	(79)
Southwest 0.9x	0.77	x	2	x	104.39		0.63	x	0.7	=	63.81	(79)
Southwest 0.9x	0.77	x	2	x	92.85		0.63	x	0.7	=	56.75	(79)
Southwest 0.9x	0.77	x	2	x	69.27		0.63	x	0.7	=	42.34	(79)

TER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2	x	44.07		0.63	x	0.7	=	26.94	(79)
Southwest 0.9x	0.77	x	2	x	31.49		0.63	x	0.7	=	19.25	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	163.65	281.04	390.62	494.19	562.85	562.87	540.96	489.12	426.39	312.25	196.43	139.78	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	530.04	644.84	741.11	823.61	870.92	850.29	815.3	769.8	718.14	625.29	533.84	495.57	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.96	0.88	0.73	0.54	0.39	0.43	0.67	0.92	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.05	20.25	20.51	20.78	20.94	20.99	21	21	20.97	20.75	20.35	20.01	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.06	20.07	20.07	20.08	20.08	20.1	20.1	20.1	20.09	20.08	20.08	20.08	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.85	0.67	0.46	0.31	0.35	0.59	0.89	0.98	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.81	19.1	19.47	19.85	20.03	20.09	20.1	20.1	20.07	19.82	19.25	18.76	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.12	19.39	19.73	20.08	20.26	20.32	20.32	20.32	20.3	20.05	19.52	19.07	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.12	19.39	19.73	20.08	20.26	20.32	20.32	20.32	20.3	20.05	19.52	19.07	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	0.99	0.98	0.94	0.85	0.68	0.48	0.33	0.37	0.61	0.89	0.98	0.99	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	525.39	629.66	696.75	698.42	596.06	409.9	268.83	282.41	438.01	556.01	522.74	492.42	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	1111.96	1084.1	986.87	821.56	627.14	413.41	269.16	283	450.47	692.68	915.55	1102.59	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	436.41	305.39	215.85	88.66	23.12	0	0	0	0	101.68	282.82	453.97	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1907.88 (98)

Space heating requirement in kWh/m²/year 25.99 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

TER WorkSheet: New dwelling design stage

Fraction of space heat from main system(s)	(202) = 1 – (201) =	1	(202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1	(204)
Efficiency of main space heating system 1		93.4	(206)
Efficiency of secondary/supplementary heating system, %		0	(208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	436.41	305.39	215.85	88.66	23.12	0	0	0	0	101.68	282.82	453.97	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)	467.24	326.96	231.1	94.92	24.75	0	0	0	0	108.87	302.8	486.05	(211)

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 2042.7 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Output from water heater (calculated above)	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	
Efficiency of water heater													80.3 (216)
(217)m=	87.01	86.49	85.53	83.66	81.5	80.3	80.3	80.3	80.3	83.86	86.23	87.15	(217)
Fuel for water heating, kWh/month (219)m = (64)m x 100 ÷ (217)m													
(219)m=	225.33	198	208.31	188.91	187.75	167.82	160.79	179.24	181.22	197.58	205.14	219.68	

Total = Sum(219a)$_{1...12}$ = 2319.75 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2042.7	
Water heating fuel used		2319.75	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		323.25	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	441.22	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	501.07	(264)
Space and water heating	(261) + (262) + (263) + (264) =				942.29	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	167.77	(268)

TER WorkSheet: New dwelling design stage

Total CO2, kg/year	sum of (265)…(271) =	1148.98	(272)
TER =		15.65	(273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 30

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	72.68	(1a) x	2.56	(2a) =	186.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	72.68	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.38	0.38	0.33	0.33	0.32	0.35	0.38	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.29	x1/[1/(1.4)+ 0.04]		=	8.34			(27)
Windows Type 2			3.6	x1/[1/(1.4)+ 0.04]		=	4.77			(27)
Windows Type 3			2.25	x1/[1/(1.4)+ 0.04]		=	2.98			(27)
Walls Type1	55.67	15.74	39.93	x	0.18	=	7.19			(29)
Walls Type2	22.71	2.42	20.29	x	0.18	=	3.65			(29)
Total area of elements, m²			78.38							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 34.13 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1023.69 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.37 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 37.5 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	36.8	36.56	36.33	35.24	35.03	34.08	34.08	33.91	34.45	35.03	35.45	35.88	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	74.3	74.06	73.83	72.74	72.53	71.58	71.58	71.41	71.95	72.53	72.95	73.38	

Average = Sum(39)$_{1...12}$ /12= 72.74 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.02	1.02	1.02	1	1	0.98	0.98	0.98	0.99	1	1	1.01

Average = Sum(40)$_{1...12}$ /12= 1 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.31 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.05 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	97.95	94.39	90.83	87.26	83.7	80.14	80.14	83.7	87.26	90.83	94.39	97.95

Total = Sum(44)$_{1...12}$ = 1068.55 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.26	127.04	131.1	114.29	109.67	94.63	87.69	100.63	101.83	118.67	129.54	140.67

Total = Sum(45)$_{1...12}$ = 1401.04 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.79	19.06	19.66	17.14	16.45	14.2	13.15	15.09	15.27	17.8	19.43	21.1

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.91	43.44	46.28	43.03	42.65	39.52	40.84	42.65	43.03	46.28	46.55	49.91	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59	

Output from water heater (annual)$_{1...12}$ 1935.17 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.78	53.1	55.16	48.76	47.13	41.35	39.37	44.12	44.62	51.03	54.71	59.25	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.16	16.13	13.11	9.93	7.42	6.27	6.77	8.8	11.81	15	17.5	18.66	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	203.46	205.57	200.25	188.92	174.63	161.19	152.21	150.1	155.42	166.75	181.05	194.48	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	(71)

Water heating gains (Table 5)

(72)m=	81.69	79.02	74.14	67.72	63.34	57.43	52.91	59.3	61.97	68.59	75.99	79.64	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	363.95	361.36	348.15	327.22	306.03	285.52	272.54	278.85	289.84	310.97	335.18	353.42	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.25	x	36.79	x	0.63	x	0.7	=	25.3	(79)
Southwest$_{0.9x}$	0.77	x	2.25	x	62.67	x	0.63	x	0.7	=	43.1	(79)
Southwest$_{0.9x}$	0.77	x	2.25	x	85.75	x	0.63	x	0.7	=	58.97	(79)
Southwest$_{0.9x}$	0.77	x	2.25	x	106.25	x	0.63	x	0.7	=	73.06	(79)
Southwest$_{0.9x}$	0.77	x	2.25	x	119.01	x	0.63	x	0.7	=	81.84	(79)

TER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.25	x	118.15		0.63	x	0.7	=	81.24	(79)
Southwest 0.9x	0.77	x	2.25	x	113.91		0.63	x	0.7	=	78.33	(79)
Southwest 0.9x	0.77	x	2.25	x	104.39		0.63	x	0.7	=	71.78	(79)
Southwest 0.9x	0.77	x	2.25	x	92.85		0.63	x	0.7	=	63.85	(79)
Southwest 0.9x	0.77	x	2.25	x	69.27		0.63	x	0.7	=	47.63	(79)
Southwest 0.9x	0.77	x	2.25	x	44.07		0.63	x	0.7	=	30.3	(79)
Southwest 0.9x	0.77	x	2.25	x	31.49		0.63	x	0.7	=	21.65	(79)
Northwest 0.9x	0.77	x	6.29	x	11.28	x	0.63	x	0.7	=	21.69	(81)
Northwest 0.9x	0.77	x	3.6	x	11.28	x	0.63	x	0.7	=	24.83	(81)
Northwest 0.9x	0.77	x	6.29	x	22.97	x	0.63	x	0.7	=	44.15	(81)
Northwest 0.9x	0.77	x	3.6	x	22.97	x	0.63	x	0.7	=	50.54	(81)
Northwest 0.9x	0.77	x	6.29	x	41.38	x	0.63	x	0.7	=	79.54	(81)
Northwest 0.9x	0.77	x	3.6	x	41.38	x	0.63	x	0.7	=	91.05	(81)
Northwest 0.9x	0.77	x	6.29	x	67.96	x	0.63	x	0.7	=	130.63	(81)
Northwest 0.9x	0.77	x	3.6	x	67.96	x	0.63	x	0.7	=	149.53	(81)
Northwest 0.9x	0.77	x	6.29	x	91.35	x	0.63	x	0.7	=	175.59	(81)
Northwest 0.9x	0.77	x	3.6	x	91.35	x	0.63	x	0.7	=	201	(81)
Northwest 0.9x	0.77	x	6.29	x	97.38	x	0.63	x	0.7	=	187.2	(81)
Northwest 0.9x	0.77	x	3.6	x	97.38	x	0.63	x	0.7	=	214.29	(81)
Northwest 0.9x	0.77	x	6.29	x	91.1	x	0.63	x	0.7	=	175.12	(81)
Northwest 0.9x	0.77	x	3.6	x	91.1	x	0.63	x	0.7	=	200.46	(81)
Northwest 0.9x	0.77	x	6.29	x	72.63	x	0.63	x	0.7	=	139.61	(81)
Northwest 0.9x	0.77	x	3.6	x	72.63	x	0.63	x	0.7	=	159.81	(81)
Northwest 0.9x	0.77	x	6.29	x	50.42	x	0.63	x	0.7	=	96.92	(81)
Northwest 0.9x	0.77	x	3.6	x	50.42	x	0.63	x	0.7	=	110.95	(81)
Northwest 0.9x	0.77	x	6.29	x	28.07	x	0.63	x	0.7	=	53.95	(81)
Northwest 0.9x	0.77	x	3.6	x	28.07	x	0.63	x	0.7	=	61.76	(81)
Northwest 0.9x	0.77	x	6.29	x	14.2	x	0.63	x	0.7	=	27.29	(81)
Northwest 0.9x	0.77	x	3.6	x	14.2	x	0.63	x	0.7	=	31.24	(81)
Northwest 0.9x	0.77	x	6.29	x	9.21	x	0.63	x	0.7	=	17.71	(81)
Northwest 0.9x	0.77	x	3.6	x	9.21	x	0.63	x	0.7	=	20.28	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	71.82	137.78	229.56	353.22	458.43	482.73	453.91	371.2	271.72	163.34	88.83	59.64	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	435.76	499.14	577.71	680.44	764.46	768.25	726.45	650.05	561.56	474.32	424.01	413.06	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.98	0.93	0.79	0.58	0.43	0.5	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.93	20.08	20.34	20.68	20.91	20.99	21	21	20.93	20.61	20.21	19.91	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.06	20.07	20.07	20.08	20.08	20.1	20.1	20.1	20.09	20.08	20.08	20.08	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.91	0.74	0.51	0.34	0.4	0.72	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.64	18.85	19.22	19.71	20	20.09	20.1	20.1	20.04	19.63	19.06	18.61	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.96	19.16	19.51	19.95	20.23	20.31	20.32	20.32	20.26	19.88	19.35	18.94	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.96	19.16	19.51	19.95	20.23	20.31	20.32	20.32	20.26	19.88	19.35	18.94	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.75	0.53	0.37	0.43	0.74	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	434.11	494.98	563.53	619.31	571.23	403.74	265.97	278.85	412.75	452.72	420.59	411.88	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1089.56	1056.21	960.15	804.03	618.65	409.08	266.53	280.16	443.56	672.97	893.64	1081.71	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	487.65	377.15	295.08	133	35.27	0	0	0	0	163.86	340.59	498.35	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2330.97 (98)

Space heating requirement in kWh/m²/year 32.07 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	487.65	377.15	295.08	133	35.27	0	0	0	0	163.86	340.59	498.35	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	522.11	403.8	315.94	142.4	37.77	0	0	0	0	175.44	364.66	533.57	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2495.68 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59

Efficiency of water heater 80.3 (216)

(217)m= 87.26 | 86.99 | 86.32 | 84.63 | 82.02 | 80.3 | 80.3 | 80.3 | 80.3 | 85.03 | 86.68 | 87.36 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 223.66 | 195.98 | 205.48 | 185.9 | 185.71 | 167.07 | 160.07 | 178.43 | 180.41 | 193.99 | 203.14 | 218.16

Total = Sum(219a)$_{1...12}$ = 2298 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2495.68	
Water heating fuel used		2298	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		320.64	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	539.07	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	496.37	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1035.43	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	166.41	(268)
Total CO2, kg/year	sum of (265)…(271) =			1240.77	(272)

TER = 17.07 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 31

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	66.61	(1a) x	2.56	(2a) =	170.53	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	66.61	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		170.53	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.12 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.37 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.31 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.4	0.39	0.38	0.34	0.34	0.3	0.3	0.29	0.31	0.34	0.35	0.37

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.58	0.58	0.57	0.56	0.56	0.54	0.54	0.54	0.55	0.56	0.56	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.58	0.58	0.57	0.56	0.56	0.54	0.54	0.54	0.55	0.56	0.56	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.98	x	1/[1/(1.4)+ 0.04]	=	10.58			(27)
Windows Type 2			3.13	x	1/[1/(1.4)+ 0.04]	=	4.15			(27)
Walls Type1	31.65	14.24	17.41	x	0.18	=	3.13			(29)
Walls Type2	32.4	2.42	29.98	x	0.18	=	5.4			(29)
Total area of elements, m²			64.05							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 29.83 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 805.56 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 2.04 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 31.87 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	32.6	32.42	32.25	31.46	31.31	30.61	30.61	30.48	30.88	31.31	31.61	31.92	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	64.46	64.29	64.12	63.32	63.18	62.48	62.48	62.35	62.75	63.18	63.48	63.79	

Average = Sum(39)$_{1...12}$ /12= 63.32 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.97	0.97	0.96	0.95	0.95	0.94	0.94	0.94	0.94	0.95	0.95	0.96

Average = Sum(40)$_{1...12}$ /12= 0.95 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.16 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 85.53 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	94.08	90.66	87.24	83.82	80.4	76.98	76.98	80.4	83.82	87.24	90.66	94.08

Total = Sum(44)$_{1...12}$ = 1026.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	139.52	122.03	125.92	109.78	105.34	90.9	84.23	96.65	97.81	113.99	124.43	135.12

Total = Sum(45)$_{1...12}$ = 1345.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	20.93	18.3	18.89	16.47	15.8	13.63	12.63	14.5	14.67	17.1	18.66	20.27

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.94	41.73	44.46	41.34	40.97	37.96	39.23	40.97	41.34	44.46	44.71	47.94	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06	

Output from water heater (annual)$_{1...12}$ 1858.74 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	58.38	51.01	52.98	46.84	45.27	39.71	37.81	42.38	42.86	49.01	52.55	56.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.9	15.01	12.21	9.24	6.91	5.83	6.3	8.19	11	13.96	16.29	17.37	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	189.27	191.24	186.29	175.75	162.45	149.95	141.6	139.63	144.58	155.12	168.42	180.92	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	(71)

Water heating gains (Table 5)

(72)m=	78.46	75.9	71.21	65.05	60.84	55.16	50.82	56.96	59.52	65.88	72.98	76.5	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	343.05	340.57	328.13	308.46	288.62	269.36	257.14	263.21	273.52	293.38	316.12	333.21	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.98	x	11.28	x	0.63	x	0.7	=	27.52	(81)
Northwest 0.9x	0.77	x	3.13	x	11.28	x	0.63	x	0.7	=	21.59	(81)
Northwest 0.9x	0.77	x	7.98	x	22.97	x	0.63	x	0.7	=	56.01	(81)
Northwest 0.9x	0.77	x	3.13	x	22.97	x	0.63	x	0.7	=	43.94	(81)
Northwest 0.9x	0.77	x	7.98	x	41.38	x	0.63	x	0.7	=	100.91	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.13	x	41.38	x	0.63	x	0.7	=	79.16	(81)
Northwest 0.9x	0.77	x	7.98	x	67.96	x	0.63	x	0.7	=	165.73	(81)
Northwest 0.9x	0.77	x	3.13	x	67.96	x	0.63	x	0.7	=	130.01	(81)
Northwest 0.9x	0.77	x	7.98	x	91.35	x	0.63	x	0.7	=	222.77	(81)
Northwest 0.9x	0.77	x	3.13	x	91.35	x	0.63	x	0.7	=	174.76	(81)
Northwest 0.9x	0.77	x	7.98	x	97.38	x	0.63	x	0.7	=	237.5	(81)
Northwest 0.9x	0.77	x	3.13	x	97.38	x	0.63	x	0.7	=	186.31	(81)
Northwest 0.9x	0.77	x	7.98	x	91.1	x	0.63	x	0.7	=	222.18	(81)
Northwest 0.9x	0.77	x	3.13	x	91.1	x	0.63	x	0.7	=	174.29	(81)
Northwest 0.9x	0.77	x	7.98	x	72.63	x	0.63	x	0.7	=	177.12	(81)
Northwest 0.9x	0.77	x	3.13	x	72.63	x	0.63	x	0.7	=	138.95	(81)
Northwest 0.9x	0.77	x	7.98	x	50.42	x	0.63	x	0.7	=	122.97	(81)
Northwest 0.9x	0.77	x	3.13	x	50.42	x	0.63	x	0.7	=	96.46	(81)
Northwest 0.9x	0.77	x	7.98	x	28.07	x	0.63	x	0.7	=	68.45	(81)
Northwest 0.9x	0.77	x	3.13	x	28.07	x	0.63	x	0.7	=	53.7	(81)
Northwest 0.9x	0.77	x	7.98	x	14.2	x	0.63	x	0.7	=	34.62	(81)
Northwest 0.9x	0.77	x	3.13	x	14.2	x	0.63	x	0.7	=	27.16	(81)
Northwest 0.9x	0.77	x	7.98	x	9.21	x	0.63	x	0.7	=	22.47	(81)
Northwest 0.9x	0.77	x	3.13	x	9.21	x	0.63	x	0.7	=	17.63	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	49.1	99.95	180.08	295.74	397.53	423.81	396.47	316.07	219.43	122.15	61.78	40.1	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	392.16	440.52	508.2	604.2	686.15	693.17	653.61	579.27	492.94	415.53	377.9	373.3	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.93	0.78	0.57	0.42	0.49	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20	20.13	20.37	20.71	20.92	20.99	21	21	20.94	20.63	20.26	19.98	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.11	20.11	20.11	20.12	20.13	20.14	20.14	20.14	20.13	20.13	20.12	20.12	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.91	0.73	0.49	0.34	0.4	0.72	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.77	18.96	19.31	19.79	20.06	20.13	20.13	20.14	20.08	19.69	19.16	18.74	(90)

fLA = Living area ÷ (4) = 0.37 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.22	19.39	19.7	20.12	20.38	20.45	20.45	20.45	20.4	20.04	19.56	19.2	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.22	19.39	19.7	20.12	20.38	20.45	20.45	20.45	20.4	20.04	19.56	19.2	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.74	0.52	0.37	0.43	0.75	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	390.86	437.47	497.4	552.26	510.7	361.34	240.28	251.62	368.15	399.1	375.28	372.36	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	961.9	931.51	846.66	710.7	548.08	365.24	240.69	252.65	395.24	596.23	791.07	956.7	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	424.86	331.99	259.85	114.07	27.81	0	0	0	0	146.67	299.37	434.74	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2039.37 (98)

Space heating requirement in kWh/m²/year 30.61 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	424.86	331.99	259.85	114.07	27.81	0	0	0	0	146.67	299.37	434.74	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	454.88	355.45	278.21	122.13	29.78	0	0	0	0	157.03	320.52	465.46	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2183.48 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06

Efficiency of water heater 80.3 (216)

(217)m=	87.05	86.79	86.11	84.35	81.76	80.3	80.3	80.3	80.3	84.86	86.47	87.15	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	215.36	188.67	197.86	179.14	178.95	160.47	153.74	171.39	173.28	186.72	195.59	210.05	

Total = Sum(219a)$_{1...12}$ = 2211.22 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2183.48

TER WorkSheet: New dwelling design stage

Water heating fuel used		2211.22	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		298.48	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	471.63	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	477.62	(264)
Space and water heating	(261) + (262) + (263) + (264) =				949.25	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	154.91	(268)
Total CO2, kg/year		sum of (265)…(271) =			1143.09	(272)

TER = 17.16 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 32

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.61	(1a) x	2.56	(2a) =	132.12	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.61	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		132.12	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)			0	(9)
Additional infiltration		[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0	(12)
If no draught lobby, enter 0.05, else enter 0			0	(13)
Percentage of windows and doors draught stripped			0	(14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5	(17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered			2	(19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.34	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.43	0.43	0.42	0.38	0.37	0.32	0.32	0.32	0.34	0.37	0.38	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	25.19	9.48	15.71	x	0.18	=	2.83			(29)
Walls Type2	25.13	2.42	22.71	x	0.18	=	4.09			(29)
Total area of elements, m²			50.32							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 21.9 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 653.12 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 1.69 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 23.6 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.92	25.76	25.61	24.87	24.73	24.09	24.09	23.97	24.34	24.73	25.01	25.3	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	49.52	49.36	49.2	48.47	48.33	47.69	47.69	47.57	47.93	48.33	48.61	48.9	

Average = Sum(39)$_{1...12}$ /12= 48.47 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.96	0.95	0.94	0.94	0.92	0.92	0.92	0.93	0.94	0.94	0.95

Average = Sum(40)$_{1...12}$ /12= 0.94 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.47 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	83.01	79.99	76.98	73.96	70.94	67.92	67.92	70.94	73.96	76.98	79.99	83.01

Total = Sum(44)$_{1...12}$ = 905.59 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	123.1	107.67	111.1	96.86	92.94	80.2	74.32	85.28	86.3	100.58	109.79	119.22

Total = Sum(45)$_{1...12}$ = 1187.37 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.47	16.15	16.67	14.53	13.94	12.03	11.15	12.79	12.95	15.09	16.47	17.88

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.3	36.82	39.23	36.47	36.15	33.49	34.61	36.15	36.47	39.23	39.45	42.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52	

Output from water heater (annual)$_{1...12}$ 1640.04 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.51	45	46.75	41.32	39.94	35.04	33.36	37.39	37.81	43.25	46.37	50.22	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.74	12.21	9.93	7.52	5.62	4.74	5.12	6.66	8.94	11.35	13.25	14.13	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.41	152.98	149.02	140.59	129.95	119.95	113.27	111.7	115.66	124.09	134.73	144.73	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	(71)

Water heating gains (Table 5)

(72)m=	69.23	66.97	62.83	57.4	53.68	48.67	44.84	50.26	52.52	58.13	64.4	67.5	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	286.45	284.22	273.84	257.57	241.32	225.43	215.3	220.68	229.18	245.63	264.44	278.41	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	10.9	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	21.79	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	22.18	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	44.36	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	39.96	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	79.92	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	65.63	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	131.25	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	88.22	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	176.43	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	94.05	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	188.1	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	87.98	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	175.96	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	70.14	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	140.28	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	48.69	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	97.39	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	27.11	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	54.21	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	13.71	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	27.42	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	8.9	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	17.8	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	32.69	66.54	119.88	196.88	264.65	282.14	263.94	210.42	146.08	81.32	41.13	26.7	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	319.13	350.76	393.73	454.45	505.96	507.57	479.24	431.1	375.26	326.95	305.57	305.11	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.8	0.59	0.44	0.5	0.8	0.97	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.04	20.16	20.39	20.7	20.92	20.99	21	21	20.94	20.65	20.3	20.02	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.12	20.12	20.13	20.14	20.15	20.15	20.15	20.14	20.14	20.13	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.75	0.52	0.35	0.41	0.73	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.83	19.01	19.34	19.78	20.06	20.14	20.15	20.15	20.1	19.73	19.22	18.81	(90)

fLA = Living area ÷ (4) = 0.47 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.41	19.55	19.83	20.22	20.47	20.54	20.55	20.55	20.5	20.16	19.73	19.39	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.41	19.55	19.83	20.22	20.47	20.54	20.55	20.55	20.5	20.16	19.73	19.39	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.77	0.55	0.39	0.46	0.76	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	317.85	348.1	385.57	419.39	389.76	279.54	187.96	196.44	284.47	313.52	303.07	304.15	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	748.04	723.3	656.11	548.55	423.6	283.37	188.38	197.41	306.61	462.24	613.88	742.65	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	320.06	252.14	201.28	92.99	25.17	0	0	0	0	110.65	223.78	326.25	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1552.33 (98)

Space heating requirement in kWh/m²/year 30.08 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	320.06	252.14	201.28	92.99	25.17	0	0	0	0	110.65	223.78	326.25	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	342.68	269.95	215.51	99.56	26.95	0	0	0	0	118.47	239.6	349.3	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1662.02 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52

Efficiency of water heater 80.3 (216)

(217)m=	86.69	86.44	85.79	84.16	81.79	80.3	80.3	80.3	80.3	84.47	86.07	86.79	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	190.81	167.15	175.24	158.42	157.83	141.59	135.65	151.22	152.89	165.5	173.39	186.12	

Total = Sum(219a)$_{1...12}$ = 1955.83 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1662.02

TER WorkSheet: New dwelling design stage

Water heating fuel used		1955.83	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		242.71	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	359	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	422.46	(264)
Space and water heating	(261) + (262) + (263) + (264) =				781.46	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	125.97	(268)
Total CO2, kg/year		sum of (265)…(271) =			946.35	(272)

TER = 18.34 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 33

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.63	(1a) x	2.56	(2a) =	129.62	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.62	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	24.86	9.48	15.38	x	0.18	=	2.77			(29)
Walls Type2	19.11	2.42	16.69	x	0.18	=	3			(29)
Total area of elements, m²			43.97							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 20.76 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 545.17 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 1.64 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 22.4 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.49	25.33	25.18	24.44	24.31	23.67	23.67	23.55	23.91	24.31	24.58	24.87	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	47.89	47.73	47.58	46.84	46.7	46.07	46.07	45.95	46.31	46.7	46.98	47.27	

Average = Sum(39)$_{1...12}$ /12= 46.84 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.95	0.94	0.94	0.93	0.92	0.91	0.91	0.91	0.91	0.92	0.93	0.93

Average = Sum(40)$_{1...12}$ /12= 0.93 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.71 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.78 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	82.26	79.27	76.28	73.29	70.29	67.3	67.3	70.29	73.29	76.28	79.27	82.26	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 897.38 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.99	106.69	110.1	95.98	92.1	79.48	73.65	84.51	85.52	99.66	108.79	118.14

Total = Sum(45)$_{1...12}$ = 1176.6 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.3	16	16.51	14.4	13.81	11.92	11.05	12.68	12.83	14.95	16.32	17.72

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.92	36.49	38.87	36.14	35.82	33.19	34.3	35.82	36.14	38.87	39.09	41.92	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06	

Output from water heater (annual)$_{1...12}$ 1625.17 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.04	44.6	46.32	40.95	39.58	34.72	33.06	37.05	37.47	42.86	45.95	49.76	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.48	11.97	9.73	7.37	5.51	4.65	5.02	6.53	8.77	11.13	12.99	13.85	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.87	150.42	146.52	138.24	127.78	117.94	111.37	109.83	113.72	122.01	132.47	142.3	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	(71)

Water heating gains (Table 5)

(72)m=	68.6	66.36	62.26	56.88	53.2	48.23	44.44	49.8	52.04	57.6	63.81	66.88	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	282.58	280.38	270.15	254.11	238.11	222.45	212.47	217.8	226.16	242.37	260.91	274.67	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	10.9	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	21.79	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	22.18	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	44.36	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	39.96	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	79.92	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	65.63	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	131.25	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	88.22	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	176.43	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	94.05	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	188.1	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	87.98	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	175.96	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	70.14	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	140.28	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	48.69	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	97.39	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	27.11	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	54.21	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	13.71	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	27.42	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	8.9	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	17.8	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	32.69	66.54	119.88	196.88	264.65	282.14	263.94	210.42	146.08	81.32	41.13	26.7	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	315.27	346.92	390.04	450.99	502.76	504.59	476.41	428.21	372.24	323.69	302.04	301.36	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.94	0.79	0.57	0.42	0.49	0.79	0.97	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.07	20.18	20.41	20.72	20.93	20.99	21	21	20.95	20.67	20.32	20.05	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.13	20.13	20.13	20.15	20.15	20.16	20.16	20.16	20.16	20.15	20.14	20.14	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.91	0.74	0.5	0.34	0.4	0.71	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.88	19.05	19.38	19.82	20.08	20.15	20.16	20.16	20.11	19.76	19.26	18.86	(90)

fLA = Living area ÷ (4) = 0.48 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.45	19.6	19.88	20.26	20.49	20.56	20.56	20.56	20.52	20.2	19.77	19.43	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.45	19.6	19.88	20.26	20.49	20.56	20.56	20.56	20.52	20.2	19.77	19.43	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.76	0.54	0.38	0.45	0.75	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	313.96	344.17	381.46	413.82	381.19	271.35	182.31	190.57	277.95	309.59	299.46	300.38	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	725.6	701.61	636.5	531.93	410.48	274.46	182.63	191.35	297.17	448.31	595.28	720.1	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	306.26	240.2	189.75	85.04	21.79	0	0	0	0	103.21	212.99	312.27	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1471.5 (98)

Space heating requirement in kWh/m²/year 29.06 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	306.26	240.2	189.75	85.04	21.79	0	0	0	0	103.21	212.99	312.27	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	327.9	257.17	203.16	91.05	23.33	0	0	0	0	110.51	228.04	334.33	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1575.48 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06

Efficiency of water heater 80.3 (216)

(217)m=	86.6	86.34	85.66	83.97	81.63	80.3	80.3	80.3	80.3	84.32	85.97	86.7	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.26	165.82	173.9	157.34	156.71	140.31	134.42	149.85	151.51	164.29	172.02	184.6	

Total = Sum(219a)$_{1...12}$ = 1940.04 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1575.48

TER WorkSheet: New dwelling design stage

Water heating fuel used		1940.04	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		237.98	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	340.3	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	419.05	(264)
Space and water heating	(261) + (262) + (263) + (264) =				759.35	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	123.51	(268)
Total CO2, kg/year		sum of (265)…(271) =			921.79	(272)

TER = 18.21 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 34

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.03	(1a) x	2.56	(2a) =	130.63	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.03	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.63	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	25.06	9.48	15.58	x	0.18	=	2.8			(29)
Walls Type2	19.31	2.42	16.89	x	0.18	=	3.04			(29)
Total area of elements, m²			44.37							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 20.83 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 551.97 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 1.67 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 22.51 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.67	25.51	25.35	24.62	24.48	23.84	23.84	23.72	24.08	24.48	24.76	25.05	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	48.17	48.01	47.86	47.12	46.98	46.34	46.34	46.23	46.59	46.98	47.26	47.55	

Average = Sum(39)$_{1...12}$ /12= 47.12 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.94	0.94	0.94	0.92	0.92	0.91	0.91	0.91	0.91	0.92	0.93	0.93

Average = Sum(40)$_{1...12}$ /12= 0.92 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.06 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.56	79.56	76.56	73.56	70.55	67.55	67.55	70.55	73.56	76.56	79.56	82.56

Total = Sum(44)$_{1...12}$ = 900.7 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.44	107.09	110.5	96.34	92.44	79.77	73.92	84.82	85.83	100.03	109.19	118.58

Total = Sum(45)$_{1...12}$ = 1180.95 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.37	16.06	16.58	14.45	13.87	11.97	11.09	12.72	12.88	15	16.38	17.79

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.07	36.62	39.01	36.27	35.95	33.31	34.42	35.95	36.27	39.01	39.24	42.07	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65	

Output from water heater (annual)$_{1...12}$ 1631.18 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.23	44.76	46.5	41.1	39.72	34.85	33.18	37.19	37.61	43.01	46.12	49.95	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.58	12.06	9.81	7.43	5.55	4.69	5.07	6.58	8.84	11.22	13.1	13.96	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.9	151.45	147.53	139.19	128.66	118.76	112.14	110.59	114.51	122.85	133.38	143.28	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	(71)

Water heating gains (Table 5)

(72)m=	68.86	66.61	62.49	57.09	53.39	48.4	44.6	49.99	52.23	57.81	64.05	67.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	284.14	281.93	271.65	255.51	239.41	223.65	213.61	218.96	227.38	243.69	262.33	276.18	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	10.9	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	21.79	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	22.18	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	44.36	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	39.96	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	79.92	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	65.63	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	131.25	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	88.22	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	176.43	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	94.05	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	188.1	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	87.98	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	175.96	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	70.14	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	140.28	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	48.69	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	97.39	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	27.11	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	54.21	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	13.71	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	27.42	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	8.9	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	17.8	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	32.69	66.54	119.88	196.88	264.65	282.14	263.94	210.42	146.08	81.32	41.13	26.7	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	316.83	348.47	391.53	452.39	504.06	505.8	477.55	429.38	373.46	325.01	303.47	302.88	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.79	0.58	0.43	0.49	0.79	0.97	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.07	20.18	20.41	20.72	20.93	20.99	21	21	20.95	20.67	20.32	20.05	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.13	20.13	20.14	20.15	20.15	20.16	20.16	20.16	20.16	20.15	20.15	20.14	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.74	0.51	0.35	0.4	0.72	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.88	19.05	19.38	19.82	20.08	20.15	20.16	20.16	20.12	19.76	19.26	18.86	(90)

fLA = Living area ÷ (4) = 0.48 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.45	19.6	19.87	20.25	20.49	20.56	20.56	20.56	20.51	20.2	19.77	19.43	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.45	19.6	19.87	20.25	20.49	20.56	20.56	20.56	20.51	20.2	19.77	19.43	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.76	0.54	0.38	0.45	0.75	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	315.53	345.74	383.03	415.53	383.07	272.84	183.29	191.61	279.38	310.99	300.9	301.9	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	729.74	705.6	640.08	534.92	412.8	276	183.63	192.4	298.84	450.85	598.69	724.25	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	308.17	241.82	191.25	85.96	22.11	0	0	0	0	104.06	214.41	314.22	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1482.01 (98)

Space heating requirement in kWh/m²/year 29.04 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	308.17	241.82	191.25	85.96	22.11	0	0	0	0	104.06	214.41	314.22	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	329.95	258.91	204.76	92.04	23.68	0	0	0	0	111.41	229.56	336.43	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1586.74 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65

Efficiency of water heater 80.3 (216)

(217)m=	86.61	86.35	85.67	83.99	81.64	80.3	80.3	80.3	80.3	84.33	85.98	86.71	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.95	166.42	174.52	157.89	157.27	140.82	134.92	150.41	152.07	164.88	172.64	185.27	

Total = Sum(219a)$_{1...12}$ = 1947.06 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1586.74

TER WorkSheet: New dwelling design stage

Water heating fuel used		1947.06	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		239.88	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	342.74	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	420.57	(264)
Space and water heating	(261) + (262) + (263) + (264) =				763.3	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	124.5	(268)
Total CO2, kg/year		sum of (265)…(271) =			926.72	(272)

TER = 18.16 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 35

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.86	(1a) x	2.56	(2a) =	183.97	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.86	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.97	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.39	0.38	0.33	0.33	0.32	0.35	0.38	0.4	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	36.57	12.64	23.93	x	0.18	=	4.31			(29)
Walls Type2	26	2.42	23.58	x	0.18	=	4.24			(29)
Total area of elements, m²			62.57							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 27.73 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 807.6 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 2.59 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 30.32 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	36.44	36.2	35.97	34.88	34.68	33.73	33.73	33.56	34.1	34.68	35.09	35.52	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	66.75	66.52	66.29	65.2	65	64.05	64.05	63.87	64.41	65	65.41	65.84	

Average = Sum(39)$_{1...12}$ /12= 65.2 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.93	0.93	0.92	0.91	0.9	0.89	0.89	0.89	0.9	0.9	0.91	0.92

Average = Sum(40)$_{1...12}$ /12= 0.91 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.6 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	97.46	93.91	90.37	86.83	83.28	79.74	79.74	83.28	86.83	90.37	93.91	97.46	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1063.18 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	144.53	126.41	130.44	113.72	109.12	94.16	87.25	100.12	101.32	118.08	128.89	139.97

Total = Sum(45)$_{1...12}$ = 1394 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.68	18.96	19.57	17.06	16.37	14.12	13.09	15.02	15.2	17.71	19.33	21

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.66	43.23	46.05	42.82	42.44	39.32	40.63	42.44	42.82	46.05	46.31	49.66	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63	

Output from water heater (annual)$_{1...12}$ 1925.45 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.47	52.84	54.88	48.52	46.89	41.14	39.17	43.9	44.39	50.77	54.43	58.96	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.43	16.37	13.31	10.08	7.53	6.36	6.87	8.93	11.99	15.22	17.77	18.94	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.6	203.7	198.42	187.2	173.03	159.72	150.82	148.73	154	165.23	179.39	192.71	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	(71)

Water heating gains (Table 5)

(72)m=	81.28	78.63	73.77	67.38	63.03	57.14	52.65	59.01	61.66	68.24	75.6	79.24	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	361.67	359.04	345.86	325.02	303.95	283.57	270.7	277.03	288.01	309.05	333.12	351.24	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	21.79	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	21.79	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	44.36	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	44.36	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	79.92	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	79.92	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	131.25	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	131.25	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	176.43	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	176.43	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	188.1	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	188.1	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	175.96	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	175.96	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	140.28	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	140.28	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	97.39	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	97.39	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	54.21	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	54.21	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	27.42	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	27.42	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	17.8	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	17.8	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	43.59	88.72	159.84	262.51	352.86	376.19	351.92	280.55	194.77	108.42	54.84	35.59	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	405.25	447.76	505.7	587.53	656.81	659.76	622.62	557.58	482.78	417.47	387.96	386.84	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.82	0.61	0.45	0.52	0.82	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.03	20.15	20.37	20.69	20.91	20.99	21	21	20.94	20.63	20.29	20.02	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.14	20.15	20.15	20.16	20.16	20.17	20.17	20.18	20.17	20.16	20.16	20.15	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.94	0.77	0.54	0.37	0.43	0.76	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.84	19.01	19.34	19.79	20.08	20.17	20.17	20.18	20.12	19.73	19.22	18.83	(90)

fLA = Living area ÷ (4) = 0.34 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.25	19.4	19.69	20.1	20.36	20.45	20.45	20.46	20.4	20.04	19.58	19.23	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.25	19.4	19.69	20.1	20.36	20.45	20.45	20.46	20.4	20.04	19.58	19.23	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.79	0.56	0.4	0.46	0.78	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	404.15	445.35	497.63	548.75	516.01	369.56	246.42	257.82	374.51	403.94	385.75	386.04	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	997.74	964.45	874.33	729.98	563.03	374.5	246.9	259.01	405.58	613.4	816.58	989.66	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	441.63	348.83	280.27	130.49	34.99	0	0	0	0	155.84	310.19	449.1	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2151.33 (98)

Space heating requirement in kWh/m²/year 29.94 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	441.63	348.83	280.27	130.49	34.99	0	0	0	0	155.84	310.19	449.1	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	472.84	373.48	300.07	139.71	37.46	0	0	0	0	166.85	332.11	480.83	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2303.35 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63

Efficiency of water heater 80.3 (216)

(217)m=	87.06	86.83	86.21	84.6	82.02	80.3	80.3	80.3	80.3	84.92	86.47	87.15	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	223.07	195.37	204.72	185.04	184.78	166.23	159.26	177.54	179.5	193.27	202.61	217.6	

Total = Sum(219a)$_{1...12}$ = 2288.99 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2303.35

TER WorkSheet: New dwelling design stage

Water heating fuel used		2288.99	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		325.42	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	497.52	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	494.42	(264)
Space and water heating	(261) + (262) + (263) + (264) =				991.95	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	168.89	(268)
Total CO2, kg/year		sum of (265)…(271) =			1199.77	(272)

TER = 16.7 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 36

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.76	(1a) x	2.56	(2a) =	188.83	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.76	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.83	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.43	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			3.72	x1/[1/(1.4)+ 0.04]		=	4.93			(27)
Windows Type 2			2.55	x1/[1/(1.4)+ 0.04]		=	3.38			(27)
Windows Type 3			3.47	x1/[1/(1.4)+ 0.04]		=	4.6			(27)
Walls Type1	56.59	16.01	40.58	x	0.18	=	7.3			(29)
Walls Type2	12.58	2.42	10.16	x	0.18	=	1.83			(29)
Roof	73.76	0	73.76	x	0.13	=	9.59			(30)
Total area of elements, m²			142.93							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 42.37 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1526.4 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.33 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 49.7 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	37.27	37.04	36.8	35.71	35.51	34.55	34.55	34.38	34.92	35.51	35.92	36.35	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	86.97	86.74	86.5	85.41	85.21	84.25	84.25	84.08	84.62	85.21	85.62	86.05	

Average = Sum(39)$_{1...12}$ /12= 85.41 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.18	1.18	1.17	1.16	1.16	1.14	1.14	1.14	1.15	1.16	1.16	1.17	

Average = Sum(40)$_{1...12}$ /12= 1.16 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.63 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	98.59	95.01	91.42	87.84	84.25	80.67	80.67	84.25	87.84	91.42	95.01	98.59	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1075.55 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	146.21	127.88	131.96	115.04	110.39	95.25	88.27	101.29	102.5	119.45	130.39	141.6	

Total = Sum(45)$_{1...12}$ = 1410.22 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.93	19.18	19.79	17.26	16.56	14.29	13.24	15.19	15.37	17.92	19.56	21.24	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.24	43.73	46.59	43.32	42.93	39.78	41.11	42.93	43.32	46.59	46.85	50.24	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84	

Output from water heater (annual)$_{1...12}$ 1947.85 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.18	53.45	55.52	49.08	47.44	41.62	39.63	44.41	44.91	51.36	55.07	59.64	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.37	16.32	13.27	10.05	7.51	6.34	6.85	8.91	11.95	15.18	17.71	18.88	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.91	208.05	202.66	191.2	176.73	163.13	154.05	151.91	157.29	168.76	183.23	196.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	(71)

Water heating gains (Table 5)

(72)m=	82.22	79.54	74.63	68.17	63.76	57.8	53.26	59.69	62.37	69.04	76.48	80.16	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.52	364.91	351.57	330.42	309.01	288.28	275.17	281.52	292.63	313.98	338.43	356.88	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	3.47	x	11.28	x	0.63	x	0.7	=	11.97	(75)
Northeast 0.9x	0.77	x	3.47	x	22.97	x	0.63	x	0.7	=	24.36	(75)
Northeast 0.9x	0.77	x	3.47	x	41.38	x	0.63	x	0.7	=	43.88	(75)
Northeast 0.9x	0.77	x	3.47	x	67.96	x	0.63	x	0.7	=	72.07	(75)
Northeast 0.9x	0.77	x	3.47	x	91.35	x	0.63	x	0.7	=	96.87	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	3.47	x	97.38	x	0.63	x	0.7	=	103.27	(75)
Northeast 0.9x	0.77	x	3.47	x	91.1	x	0.63	x	0.7	=	96.61	(75)
Northeast 0.9x	0.77	x	3.47	x	72.63	x	0.63	x	0.7	=	77.02	(75)
Northeast 0.9x	0.77	x	3.47	x	50.42	x	0.63	x	0.7	=	53.47	(75)
Northeast 0.9x	0.77	x	3.47	x	28.07	x	0.63	x	0.7	=	29.76	(75)
Northeast 0.9x	0.77	x	3.47	x	14.2	x	0.63	x	0.7	=	15.06	(75)
Northeast 0.9x	0.77	x	3.47	x	9.21	x	0.63	x	0.7	=	9.77	(75)
Northwest 0.9x	0.77	x	3.72	x	11.28	x	0.63	x	0.7	=	25.65	(81)
Northwest 0.9x	0.77	x	2.55	x	11.28	x	0.63	x	0.7	=	17.59	(81)
Northwest 0.9x	0.77	x	3.72	x	22.97	x	0.63	x	0.7	=	52.22	(81)
Northwest 0.9x	0.77	x	2.55	x	22.97	x	0.63	x	0.7	=	35.8	(81)
Northwest 0.9x	0.77	x	3.72	x	41.38	x	0.63	x	0.7	=	94.09	(81)
Northwest 0.9x	0.77	x	2.55	x	41.38	x	0.63	x	0.7	=	64.49	(81)
Northwest 0.9x	0.77	x	3.72	x	67.96	x	0.63	x	0.7	=	154.52	(81)
Northwest 0.9x	0.77	x	2.55	x	67.96	x	0.63	x	0.7	=	105.92	(81)
Northwest 0.9x	0.77	x	3.72	x	91.35	x	0.63	x	0.7	=	207.7	(81)
Northwest 0.9x	0.77	x	2.55	x	91.35	x	0.63	x	0.7	=	142.37	(81)
Northwest 0.9x	0.77	x	3.72	x	97.38	x	0.63	x	0.7	=	221.43	(81)
Northwest 0.9x	0.77	x	2.55	x	97.38	x	0.63	x	0.7	=	151.79	(81)
Northwest 0.9x	0.77	x	3.72	x	91.1	x	0.63	x	0.7	=	207.14	(81)
Northwest 0.9x	0.77	x	2.55	x	91.1	x	0.63	x	0.7	=	141.99	(81)
Northwest 0.9x	0.77	x	3.72	x	72.63	x	0.63	x	0.7	=	165.14	(81)
Northwest 0.9x	0.77	x	2.55	x	72.63	x	0.63	x	0.7	=	113.2	(81)
Northwest 0.9x	0.77	x	3.72	x	50.42	x	0.63	x	0.7	=	114.64	(81)
Northwest 0.9x	0.77	x	2.55	x	50.42	x	0.63	x	0.7	=	78.59	(81)
Northwest 0.9x	0.77	x	3.72	x	28.07	x	0.63	x	0.7	=	63.82	(81)
Northwest 0.9x	0.77	x	2.55	x	28.07	x	0.63	x	0.7	=	43.75	(81)
Northwest 0.9x	0.77	x	3.72	x	14.2	x	0.63	x	0.7	=	32.28	(81)
Northwest 0.9x	0.77	x	2.55	x	14.2	x	0.63	x	0.7	=	22.13	(81)
Northwest 0.9x	0.77	x	3.72	x	9.21	x	0.63	x	0.7	=	20.95	(81)
Northwest 0.9x	0.77	x	2.55	x	9.21	x	0.63	x	0.7	=	14.36	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	55.21	112.37	202.46	332.5	446.94	476.49	445.75	355.35	246.7	137.33	69.46	45.08	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	422.72	477.29	554.03	662.92	755.95	764.77	720.91	636.87	539.33	451.31	407.89	401.96	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.85	0.66	0.51	0.59	0.87	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.69	19.83	20.11	20.49	20.81	20.96	20.99	20.98	20.85	20.44	20	19.67	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.94	19.94	19.94	19.95	19.96	19.97	19.97	19.97	19.96	19.96	19.95	19.95	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.94	0.8	0.57	0.39	0.47	0.8	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.2	18.4	18.8	19.36	19.78	19.94	19.96	19.96	19.84	19.29	18.66	18.17	(90)

fLA = Living area ÷ (4) = 0.24 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.56	18.75	19.11	19.63	20.03	20.19	20.21	20.21	20.08	19.57	18.98	18.54	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.56	18.75	19.11	19.63	20.03	20.19	20.21	20.21	20.08	19.57	18.98	18.54	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.94	0.81	0.59	0.42	0.49	0.81	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	421.33	474.25	544.32	620.53	609.26	454.26	302.01	315.2	435.18	437.49	405.33	400.93	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1240.05	1200.92	1091.04	916.66	709.35	470.71	304.28	320.17	506.31	763.98	1017.47	1233.59	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	609.12	488.32	406.76	213.21	74.47	0	0	0	0	242.91	440.74	619.5	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3095.03 (98)

Space heating requirement in kWh/m²/year 41.96 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	609.12	488.32	406.76	213.21	74.47	0	0	0	0	242.91	440.74	619.5	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	652.17	522.83	435.51	228.28	79.73	0	0	0	0	260.08	471.88	663.27	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3313.74 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84

Efficiency of water heater 80.3 (216)

(217)m= 87.71 | 87.54 | 87.06 | 85.8 | 83.34 | 80.3 | 80.3 | 80.3 | 80.3 | 86.01 | 87.25 | 87.79 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	223.98	196.04	205.08	184.57	183.96	168.16	161.11	179.6	181.59	193.05	203.14	218.52

Total = Sum(219a)$_{1...12}$ = 2298.81 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		3313.74	
Water heating fuel used		2298.81	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		324.47	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	715.77	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	496.54	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1212.31	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	168.4	(268)
Total CO2, kg/year	sum of (265)…(271) =			1419.63	(272)

TER = 19.25 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 37

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	84.24	(1a) x	2.56	(2a) =	215.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	84.24	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		215.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.14 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.39 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.33 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.42	0.41	0.41	0.36	0.36	0.31	0.31	0.31	0.33	0.36	0.37	0.39

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.58	0.57	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.58	0.57	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	35.61	16.99	18.62	x	0.18	=	3.35			(29)
Walls Type2	20.82	2.42	18.4	x	0.18	=	3.31			(29)
Roof	84.25	0	84.25	x	0.13	=	10.95			(30)
Total area of elements, m²			140.67							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 42.56 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1387.5 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.47 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 48.03 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	41.91	41.66	41.42	40.29	40.08	39.1	39.1	38.91	39.48	40.08	40.51	40.96	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	89.94	89.69	89.45	88.32	88.11	87.12	87.12	86.94	87.5	88.11	88.54	88.98	

Average = Sum(39)$_{1...12}$ /12= 88.32 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.07	1.06	1.06	1.05	1.05	1.03	1.03	1.03	1.04	1.05	1.05	1.06

Average = Sum(40)$_{1...12}$ /12= 1.05 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.54 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 94.49 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	103.94	100.16	96.38	92.6	88.82	85.04	85.04	88.82	92.6	96.38	100.16	103.94	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1133.85 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	154.13	134.81	139.11	121.28	116.37	100.42	93.05	106.78	108.05	125.93	137.46	149.27

Total = Sum(45)$_{1...12}$ = 1486.65 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.12	20.22	20.87	18.19	17.46	15.06	13.96	16.02	16.21	18.89	20.62	22.39

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.11	45.66	45.26	41.94	43.33	45.26	45.66	49.11	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	

Output from water heater (annual)$_{1...12}$ 2049.26 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	63.99	56.33	58.53	51.74	50.01	43.87	41.77	46.82	47.34	54.15	58.03	62.37	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	20.46	18.17	14.78	11.19	8.36	7.06	7.63	9.92	13.31	16.9	19.72	21.03	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	228.07	230.44	224.48	211.78	195.75	180.69	170.63	168.26	174.22	186.92	202.95	218.01	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	(71)

Water heating gains (Table 5)

(72)m=	86.01	83.82	78.67	71.86	67.21	60.93	56.15	62.93	65.76	72.78	80.6	83.83	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	398.62	396.51	382	358.91	335.41	312.76	298.48	305.18	317.36	340.68	367.35	386.95	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.63	x	0.7	=	26.72	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.63	x	0.7	=	31.86	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.63	x	0.7	=	54.4	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.63	x	0.7	=	64.85	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.63	x	0.7	=	98.01	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.63	x	0.7	=	116.85	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.63	x	0.7	=	160.95	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.63	x	0.7	=	191.9	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.63	x	0.7	=	216.35	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.63	x	0.7	=	257.95	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.63	x	0.7	=	230.66	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.63	x	0.7	=	275	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.63	x	0.7	=	215.77	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.63	x	0.7	=	257.26	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.63	x	0.7	=	172.02	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.63	x	0.7	=	205.09	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.63	x	0.7	=	119.42	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.63	x	0.7	=	142.38	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.63	x	0.7	=	66.48	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.63	x	0.7	=	79.26	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.63	x	0.7	=	33.63	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.63	x	0.7	=	40.09	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.63	x	0.7	=	21.82	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.63	x	0.7	=	26.02	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	58.59	119.25	214.85	352.85	474.3	505.66	473.03	377.11	261.8	145.74	73.72	47.84	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	457.2	515.76	596.86	711.76	809.71	818.42	771.51	682.29	579.17	486.41	441.07	434.79	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.85	0.65	0.49	0.57	0.86	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.82	19.95	20.2	20.56	20.85	20.97	21	20.99	20.88	20.5	20.1	19.8	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.03	20.03	20.04	20.05	20.05	20.05	20.06	20.05	20.05	20.04	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.95	0.8	0.57	0.39	0.46	0.8	0.98	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.44	18.63	19	19.53	19.9	20.04	20.05	20.05	19.95	19.45	18.87	18.42	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.74	18.92	19.26	19.75	20.11	20.24	20.26	20.26	20.15	19.68	19.13	18.72	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.74	18.92	19.26	19.75	20.11	20.24	20.26	20.26	20.15	19.68	19.13	18.72	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.94	0.8	0.59	0.41	0.49	0.81	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	456.07	513.16	587.9	668.81	651.38	478.92	317.15	331.71	466.27	473.05	438.86	433.97	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1298.49	1257.16	1141.57	958.26	740.69	491.39	318.63	335.2	529.72	799.92	1065.48	1291.69	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	626.76	499.97	411.93	208.41	66.45	0	0	0	0	243.19	451.17	638.15	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3146.02 (98)

Space heating requirement in kWh/m²/year 37.35 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	626.76	499.97	411.93	208.41	66.45	0	0	0	0	243.19	451.17	638.15	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	671.05	535.3	441.04	223.13	71.14	0	0	0	0	260.38	483.05	683.24	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3368.33 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23

Efficiency of water heater 80.3 (216)

(217)m=	87.68	87.48	86.97	85.61	83	80.3	80.3	80.3	80.3	85.88	87.19	87.76	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	233.91	206.72	216.42	195	194.73	177.28	169.85	189.34	191.43	203.82	214.22	228.15	

Total = Sum(219a)$_{1...12}$ = 2420.86 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 3368.33

TER WorkSheet: New dwelling design stage

Water heating fuel used			2420.86	
Electricity for pumps, fans and electric keep-hot				
central heating pump:		30		(230c)
boiler with a fan-assisted flue		45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		75	(231)
Electricity for lighting			361.31	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	727.56	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	522.9	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1250.46	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	187.52	(268)
Total CO2, kg/year	sum of (265)…(271) =				1476.91	(272)

TER = 17.53 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 38

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.63	(1a) x	2.56	(2a) =	183.37	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.37	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.39	0.38	0.33	0.33	0.33	0.35	0.38	0.4	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.06	x1/[1/(1.4)+ 0.04]		=	9.36			(27)
Windows Type 2			4.21	x1/[1/(1.4)+ 0.04]		=	5.58			(27)
Walls Type1	31.08	15.48	15.6	x	0.18	=	2.81			(29)
Walls Type2	25.62	2.42	23.2	x	0.18	=	4.18			(29)
Roof	71.63	0	71.63	x	0.13	=	9.31			(30)
Total area of elements, m²			128.33							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.24 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1304.2 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.83 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 44.06 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	36.34	36.1	35.87	34.78	34.58	33.63	33.63	33.46	34	34.58	34.99	35.42	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	80.4	80.16	79.93	78.84	78.64	77.69	77.69	77.52	78.06	78.64	79.05	79.48	

Average = Sum(39)$_{1...12}$ /12= 78.84 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.12	1.12	1.12	1.1	1.1	1.08	1.08	1.08	1.09	1.1	1.1	1.11

Average = Sum(40)$_{1...12}$ /12= 1.1 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.47 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	97.32	93.78	90.24	86.7	83.16	79.62	79.62	83.16	86.7	90.24	93.78	97.32

Total = Sum(44)$_{1...12}$ = 1061.64 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	144.32	126.22	130.25	113.55	108.96	94.02	87.13	99.98	101.17	117.91	128.7	139.76

Total = Sum(45)$_{1...12}$ = 1391.97 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.65	18.93	19.54	17.03	16.34	14.1	13.07	15	15.18	17.69	19.31	20.96

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.59	43.16	45.98	42.76	42.38	39.27	40.57	42.38	42.76	45.98	46.25	49.59	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	

Output from water heater (annual)$_{1...12}$ 1922.64 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.38	52.76	54.8	48.45	46.82	41.08	39.11	43.84	44.33	50.7	54.36	58.87	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.94	15.94	12.96	9.81	7.34	6.19	6.69	8.7	11.67	14.82	17.3	18.44	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.07	203.16	197.9	186.71	172.58	159.3	150.42	148.34	153.6	164.79	178.92	192.2	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	(71)

Water heating gains (Table 5)

(72)m=	81.16	78.51	73.66	67.29	62.93	57.05	52.57	58.92	61.57	68.15	75.49	79.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.45	357.88	344.8	324.08	303.12	282.82	269.96	276.23	287.11	308.03	331.99	350.04	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.06	x	11.28	x	0.63	x	0.7	=	24.34	(75)
Northeast 0.9x	0.77	x	4.21	x	11.28	x	0.63	x	0.7	=	29.03	(75)
Northeast 0.9x	0.77	x	7.06	x	22.97	x	0.63	x	0.7	=	49.55	(75)
Northeast 0.9x	0.77	x	4.21	x	22.97	x	0.63	x	0.7	=	59.1	(75)
Northeast 0.9x	0.77	x	7.06	x	41.38	x	0.63	x	0.7	=	89.28	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.21	x	41.38	x	0.63	x	0.7	=	106.48	(75)
Northeast 0.9x	0.77	x	7.06	x	67.96	x	0.63	x	0.7	=	146.62	(75)
Northeast 0.9x	0.77	x	4.21	x	67.96	x	0.63	x	0.7	=	174.87	(75)
Northeast 0.9x	0.77	x	7.06	x	91.35	x	0.63	x	0.7	=	197.09	(75)
Northeast 0.9x	0.77	x	4.21	x	91.35	x	0.63	x	0.7	=	235.06	(75)
Northeast 0.9x	0.77	x	7.06	x	97.38	x	0.63	x	0.7	=	210.12	(75)
Northeast 0.9x	0.77	x	4.21	x	97.38	x	0.63	x	0.7	=	250.6	(75)
Northeast 0.9x	0.77	x	7.06	x	91.1	x	0.63	x	0.7	=	196.56	(75)
Northeast 0.9x	0.77	x	4.21	x	91.1	x	0.63	x	0.7	=	234.43	(75)
Northeast 0.9x	0.77	x	7.06	x	72.63	x	0.63	x	0.7	=	156.7	(75)
Northeast 0.9x	0.77	x	4.21	x	72.63	x	0.63	x	0.7	=	186.89	(75)
Northeast 0.9x	0.77	x	7.06	x	50.42	x	0.63	x	0.7	=	108.79	(75)
Northeast 0.9x	0.77	x	4.21	x	50.42	x	0.63	x	0.7	=	129.75	(75)
Northeast 0.9x	0.77	x	7.06	x	28.07	x	0.63	x	0.7	=	60.56	(75)
Northeast 0.9x	0.77	x	4.21	x	28.07	x	0.63	x	0.7	=	72.22	(75)
Northeast 0.9x	0.77	x	7.06	x	14.2	x	0.63	x	0.7	=	30.63	(75)
Northeast 0.9x	0.77	x	4.21	x	14.2	x	0.63	x	0.7	=	36.53	(75)
Northeast 0.9x	0.77	x	7.06	x	9.21	x	0.63	x	0.7	=	19.88	(75)
Northeast 0.9x	0.77	x	4.21	x	9.21	x	0.63	x	0.7	=	23.71	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	53.38	108.65	195.76	321.49	432.15	460.72	430.99	343.59	238.53	132.78	67.16	43.59	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	413.83	466.54	540.56	645.57	735.27	743.53	700.95	619.82	525.65	440.82	399.15	393.64	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.84	0.64	0.48	0.56	0.85	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.78	19.91	20.18	20.55	20.85	20.97	20.99	20.99	20.88	20.49	20.07	19.76	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.98	19.99	19.99	20	20	20.01	20.01	20.02	20.01	20	20	19.99	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.94	0.79	0.55	0.38	0.45	0.78	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.35	18.55	18.93	19.48	19.86	20	20.01	20.01	19.91	19.4	18.79	18.32	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.72	18.91	19.26	19.76	20.12	20.25	20.27	20.27	20.17	19.69	19.13	18.7	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.72	18.91	19.26	19.76	20.12	20.25	20.27	20.27	20.17	19.69	19.13	18.7	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.79	0.58	0.4	0.48	0.79	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	412.47	463.53	530.7	601.41	582.4	427.55	283.73	296.53	416.87	426.52	396.59	392.63	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1159.61	1122.83	1020.09	856.26	661.99	439.2	285.22	299.92	473.49	714.64	951.05	1152.7	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	555.87	443.05	364.11	183.49	59.21	0	0	0	0	214.36	399.21	565.49	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2784.79 (98)

Space heating requirement in kWh/m²/year 38.88 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	555.87	443.05	364.11	183.49	59.21	0	0	0	0	214.36	399.21	565.49	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	595.15	474.36	389.83	196.46	63.4	0	0	0	0	229.5	427.42	605.45	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2981.57 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36

Efficiency of water heater 80.3 (216)

(217)m=	87.55	87.36	86.84	85.46	82.9	80.3	80.3	80.3	80.3	85.73	87.06	87.63	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	221.48	193.89	202.95	182.91	182.54	165.99	159.03	177.28	179.24	191.18	200.95	216.07	

Total = Sum(219a)$_{1...12}$ = 2273.5 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2981.57

TER WorkSheet: New dwelling design stage

Water heating fuel used		2273.5	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		316.91	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	644.02	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	491.08	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1135.1	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	164.47	(268)
Total CO2, kg/year	sum of (265)…(271) =				1338.5	(272)

TER = 18.69 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 39

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	58.62	(1a) x	2.56	(2a) =	150.07	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	58.62	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		150.07	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.13 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.38 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.33 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.42	0.41	0.4	0.36	0.35	0.31	0.31	0.3	0.33	0.35	0.37	0.38

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.58	x	1/[1/(1.4)+ 0.04]	=	7.4			(27)
Windows Type 2			3.33	x	1/[1/(1.4)+ 0.04]	=	4.41			(27)
Walls Type1	37.03	12.24	24.79	x	0.18	=	4.46			(29)
Walls Type2	26.11	2.42	23.69	x	0.18	=	4.26			(29)
Roof	58.62	0	58.62	x	0.13	=	7.62			(30)
Total area of elements, m²			121.76							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 34.99 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1351.76 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.69 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 39.69 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	29.03	28.87	28.7	27.94	27.8	27.13	27.13	27.01	27.39	27.8	28.09	28.39	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	68.72	68.55	68.39	67.63	67.48	66.82	66.82	66.7	67.07	67.48	67.77	68.07	

Average = Sum(39)$_{1...12}$ /12= 67.63 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.17	1.17	1.17	1.15	1.15	1.14	1.14	1.14	1.14	1.15	1.16	1.16	
Average = Sum(40)$_{1...12}$ /12=													1.15 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.94 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 80.33 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	88.36	85.15	81.94	78.72	75.51	72.3	72.3	75.51	78.72	81.94	85.15	88.36	
Total = Sum(44)$_{1...12}$ =													963.97 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	131.04	114.61	118.27	103.11	98.93	85.37	79.11	90.78	91.86	107.06	116.86	126.91	
Total = Sum(45)$_{1...12}$ =													1263.92 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	19.66	17.19	17.74	15.47	14.84	12.81	11.87	13.62	13.78	16.06	17.53	19.04	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	45.03	39.19	41.75	38.82	38.48	35.65	36.84	38.48	38.82	41.75	41.99	45.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94	

Output from water heater (annual)$_{1...12}$ 1745.77 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	54.83	47.91	49.76	43.99	42.52	37.3	35.51	39.8	40.25	46.04	49.36	53.45	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	15.15	13.46	10.95	8.29	6.19	5.23	5.65	7.35	9.86	12.52	14.61	15.58	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	169.45	171.21	166.78	157.35	145.44	134.25	126.77	125.01	129.44	138.88	150.79	161.98	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	(71)

Water heating gains (Table 5)

(72)m=	73.69	71.29	66.88	61.1	57.14	51.81	47.74	53.5	55.9	61.88	68.55	71.85	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	313.44	311.1	299.75	281.87	263.91	246.42	235.29	240.99	250.34	268.41	289.08	304.53	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	5.58	x	11.28	x	0.63	x	0.7	=	19.24	(75)
Northeast 0.9x	0.77	x	3.33	x	11.28	x	0.63	x	0.7	=	22.97	(75)
Northeast 0.9x	0.77	x	5.58	x	22.97	x	0.63	x	0.7	=	39.17	(75)
Northeast 0.9x	0.77	x	3.33	x	22.97	x	0.63	x	0.7	=	46.75	(75)
Northeast 0.9x	0.77	x	5.58	x	41.38	x	0.63	x	0.7	=	70.56	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	3.33	x	41.38	x	0.63	x	0.7	=	84.22	(75)
Northeast 0.9x	0.77	x	5.58	x	67.96	x	0.63	x	0.7	=	115.89	(75)
Northeast 0.9x	0.77	x	3.33	x	67.96	x	0.63	x	0.7	=	138.32	(75)
Northeast 0.9x	0.77	x	5.58	x	91.35	x	0.63	x	0.7	=	155.77	(75)
Northeast 0.9x	0.77	x	3.33	x	91.35	x	0.63	x	0.7	=	185.92	(75)
Northeast 0.9x	0.77	x	5.58	x	97.38	x	0.63	x	0.7	=	166.07	(75)
Northeast 0.9x	0.77	x	3.33	x	97.38	x	0.63	x	0.7	=	198.21	(75)
Northeast 0.9x	0.77	x	5.58	x	91.1	x	0.63	x	0.7	=	155.36	(75)
Northeast 0.9x	0.77	x	3.33	x	91.1	x	0.63	x	0.7	=	185.43	(75)
Northeast 0.9x	0.77	x	5.58	x	72.63	x	0.63	x	0.7	=	123.85	(75)
Northeast 0.9x	0.77	x	3.33	x	72.63	x	0.63	x	0.7	=	147.82	(75)
Northeast 0.9x	0.77	x	5.58	x	50.42	x	0.63	x	0.7	=	85.98	(75)
Northeast 0.9x	0.77	x	3.33	x	50.42	x	0.63	x	0.7	=	102.63	(75)
Northeast 0.9x	0.77	x	5.58	x	28.07	x	0.63	x	0.7	=	47.86	(75)
Northeast 0.9x	0.77	x	3.33	x	28.07	x	0.63	x	0.7	=	57.13	(75)
Northeast 0.9x	0.77	x	5.58	x	14.2	x	0.63	x	0.7	=	24.21	(75)
Northeast 0.9x	0.77	x	3.33	x	14.2	x	0.63	x	0.7	=	28.9	(75)
Northeast 0.9x	0.77	x	5.58	x	9.21	x	0.63	x	0.7	=	15.71	(75)
Northeast 0.9x	0.77	x	3.33	x	9.21	x	0.63	x	0.7	=	18.75	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	42.21	85.91	154.79	254.2	341.7	364.29	340.78	271.68	188.61	104.99	53.11	34.47	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	355.64	397.01	454.53	536.07	605.61	610.71	576.08	512.67	438.95	373.4	342.19	339	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.85	0.66	0.5	0.58	0.86	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.74	19.87	20.13	20.51	20.82	20.96	20.99	20.98	20.86	20.46	20.04	19.71	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.94	19.94	19.95	19.96	19.96	19.97	19.97	19.97	19.96	19.96	19.96	19.95	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.94	0.8	0.57	0.39	0.46	0.79	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.26	18.46	18.84	19.38	19.78	19.94	19.97	19.96	19.85	19.33	18.71	18.23	(90)

fLA = Living area ÷ (4) = 0.3 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.7	18.88	19.23	19.72	20.1	20.25	20.27	20.27	20.15	19.67	19.11	18.68	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.7	18.88	19.23	19.72	20.1	20.25	20.27	20.27	20.15	19.67	19.11	18.68	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.8	0.6	0.42	0.5	0.8	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	354.2	394.05	445.75	500.48	487.49	364.18	243.64	254.16	351.4	360.56	339.58	337.91	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	989.77	958.47	870.67	731.87	566.56	377.54	245.53	258.18	406.12	611.97	813.95	985.57	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	472.86	379.29	316.14	166.6	58.83	0	0	0	0	187.04	341.55	481.86	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2404.16 (98)

Space heating requirement in kWh/m²/year 41.01 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	472.86	379.29	316.14	166.6	58.83	0	0	0	0	187.04	341.55	481.86	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	506.27	406.09	338.48	178.37	62.99	0	0	0	0	200.26	365.68	515.91	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2574.05 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94

Efficiency of water heater 80.3 (216)

(217)m=	87.42	87.23	86.73	85.46	83.08	80.3	80.3	80.3	80.3	85.63	86.93	87.51	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	201.42	176.31	184.5	166.09	165.39	150.72	144.4	160.97	162.75	173.79	182.74	196.49	

Total = Sum(219a)$_{1...12}$ = 2065.56 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2574.05

TER WorkSheet: New dwelling design stage

Water heating fuel used		2065.56	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		267.64	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	555.99	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	446.16	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1002.16	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	138.9	(268)
Total CO2, kg/year		sum of (265)…(271) =			1179.98	(272)

TER = 20.13 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 40

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.71	(1a) x	2.56	(2a) =	183.58	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.71	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.58	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.39	0.38	0.33	0.33	0.33	0.35	0.38	0.4	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.05	x1/[1/(1.4)+ 0.04]		=	8.02			(27)
Windows Type 2			3.6	x1/[1/(1.4)+ 0.04]		=	4.77			(27)
Windows Type 3			2.25	x1/[1/(1.4)+ 0.04]		=	2.98			(27)
Walls Type1	54.82	15.5	39.32	x	0.18	=	7.08			(29)
Walls Type2	34.97	2.42	32.55	x	0.18	=	5.86			(29)
Roof	71.71	0	71.71	x	0.13	=	9.32			(30)
Total area of elements, m²			161.5							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 45.23 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1867.16 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.15 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 50.38 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	36.37	36.13	35.9	34.82	34.61	33.67	33.67	33.49	34.03	34.61	35.02	35.45	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	86.75	86.52	86.28	85.2	84.99	84.05	84.05	83.87	84.41	84.99	85.41	85.84	

Average = Sum(39)$_{1...12}$ /12= 85.2 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.21	1.21	1.2	1.19	1.19	1.17	1.17	1.17	1.18	1.19	1.19	1.2	
Average = Sum(40)$_{1...12}$ /12=													1.19 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.51 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	97.37	93.83	90.28	86.74	83.2	79.66	79.66	83.2	86.74	90.28	93.83	97.37	
Total = Sum(44)$_{1...12}$ =													1062.17 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	144.39	126.28	130.31	113.61	109.01	94.07	87.17	100.03	101.22	117.97	128.77	139.83	
Total = Sum(45)$_{1...12}$ =													1392.67 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.66	18.94	19.55	17.04	16.35	14.11	13.08	15	15.18	17.69	19.32	20.98	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)
If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.62	43.19	46.01	42.78	42.4	39.29	40.6	42.4	42.78	46.01	46.27	49.62	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45	

Output from water heater (annual)$_{1...12}$ 1923.61 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.41	52.79	54.83	48.47	46.85	41.1	39.13	43.86	44.35	50.73	54.38	58.9	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.96	15.95	12.97	9.82	7.34	6.2	6.7	8.71	11.68	14.84	17.32	18.46	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.25	203.34	198.08	186.88	172.73	159.44	150.56	148.47	153.74	164.94	179.08	192.37	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	(71)

Water heating gains (Table 5)

(72)m=	81.2	78.55	73.7	67.32	62.97	57.08	52.6	58.95	61.6	68.18	75.53	79.17	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.72	358.15	345.06	324.32	303.35	283.03	270.16	276.43	287.32	308.26	332.23	350.3	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	6.05	x	11.28	x	0.63	x	0.7	=	20.86	(75)
Northeast 0.9x	0.77	x	3.6	x	11.28	x	0.63	x	0.7	=	24.83	(75)
Northeast 0.9x	0.77	x	6.05	x	22.97	x	0.63	x	0.7	=	42.46	(75)
Northeast 0.9x	0.77	x	3.6	x	22.97	x	0.63	x	0.7	=	50.54	(75)
Northeast 0.9x	0.77	x	6.05	x	41.38	x	0.63	x	0.7	=	76.51	(75)

TER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	3.6	x	41.38	x	0.63	x	0.7	=	91.05	(75)
Northeast	0.9x	0.77	x	6.05	x	67.96	x	0.63	x	0.7	=	125.65	(75)
Northeast	0.9x	0.77	x	3.6	x	67.96	x	0.63	x	0.7	=	149.53	(75)
Northeast	0.9x	0.77	x	6.05	x	91.35	x	0.63	x	0.7	=	168.89	(75)
Northeast	0.9x	0.77	x	3.6	x	91.35	x	0.63	x	0.7	=	201	(75)
Northeast	0.9x	0.77	x	6.05	x	97.38	x	0.63	x	0.7	=	180.06	(75)
Northeast	0.9x	0.77	x	3.6	x	97.38	x	0.63	x	0.7	=	214.29	(75)
Northeast	0.9x	0.77	x	6.05	x	91.1	x	0.63	x	0.7	=	168.44	(75)
Northeast	0.9x	0.77	x	3.6	x	91.1	x	0.63	x	0.7	=	200.46	(75)
Northeast	0.9x	0.77	x	6.05	x	72.63	x	0.63	x	0.7	=	134.28	(75)
Northeast	0.9x	0.77	x	3.6	x	72.63	x	0.63	x	0.7	=	159.81	(75)
Northeast	0.9x	0.77	x	6.05	x	50.42	x	0.63	x	0.7	=	93.23	(75)
Northeast	0.9x	0.77	x	3.6	x	50.42	x	0.63	x	0.7	=	110.95	(75)
Northeast	0.9x	0.77	x	6.05	x	28.07	x	0.63	x	0.7	=	51.9	(75)
Northeast	0.9x	0.77	x	3.6	x	28.07	x	0.63	x	0.7	=	61.76	(75)
Northeast	0.9x	0.77	x	6.05	x	14.2	x	0.63	x	0.7	=	26.25	(75)
Northeast	0.9x	0.77	x	3.6	x	14.2	x	0.63	x	0.7	=	31.24	(75)
Northeast	0.9x	0.77	x	6.05	x	9.21	x	0.63	x	0.7	=	17.04	(75)
Northeast	0.9x	0.77	x	3.6	x	9.21	x	0.63	x	0.7	=	20.28	(75)
Southeast	0.9x	0.77	x	2.25	x	36.79	x	0.63	x	0.7	=	25.3	(77)
Southeast	0.9x	0.77	x	2.25	x	62.67	x	0.63	x	0.7	=	43.1	(77)
Southeast	0.9x	0.77	x	2.25	x	85.75	x	0.63	x	0.7	=	58.97	(77)
Southeast	0.9x	0.77	x	2.25	x	106.25	x	0.63	x	0.7	=	73.06	(77)
Southeast	0.9x	0.77	x	2.25	x	119.01	x	0.63	x	0.7	=	81.84	(77)
Southeast	0.9x	0.77	x	2.25	x	118.15	x	0.63	x	0.7	=	81.24	(77)
Southeast	0.9x	0.77	x	2.25	x	113.91	x	0.63	x	0.7	=	78.33	(77)
Southeast	0.9x	0.77	x	2.25	x	104.39	x	0.63	x	0.7	=	71.78	(77)
Southeast	0.9x	0.77	x	2.25	x	92.85	x	0.63	x	0.7	=	63.85	(77)
Southeast	0.9x	0.77	x	2.25	x	69.27	x	0.63	x	0.7	=	47.63	(77)
Southeast	0.9x	0.77	x	2.25	x	44.07	x	0.63	x	0.7	=	30.3	(77)
Southeast	0.9x	0.77	x	2.25	x	31.49	x	0.63	x	0.7	=	21.65	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	70.99	136.1	226.52	348.24	451.73	475.59	447.23	365.88	268.02	161.28	87.79	58.96	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	431.71	494.25	571.58	672.56	755.07	758.62	717.39	642.31	555.34	469.54	420.03	409.27	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.85	0.67	0.51	0.58	0.85	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.68	19.83	20.11	20.49	20.81	20.96	20.99	20.98	20.86	20.45	20	19.66	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.91	19.91	19.92	19.93	19.93	19.94	19.94	19.94	19.94	19.93	19.93	19.92	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.94	0.8	0.57	0.39	0.46	0.78	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.16	18.38	18.79	19.34	19.75	19.92	19.94	19.94	19.82	19.29	18.64	18.13	(90)

fLA = Living area ÷ (4) = 0.28 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.59	18.79	19.16	19.66	20.05	20.21	20.24	20.23	20.11	19.61	19.02	18.56	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.59	18.79	19.16	19.66	20.05	20.21	20.24	20.23	20.11	19.61	19.02	18.56	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.8	0.6	0.42	0.49	0.79	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	429.98	490.27	559.51	625.77	606.85	453.45	303.03	316.2	439.89	452.12	416.75	407.99	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1239.6	1201.8	1092.32	917.11	709.3	471.46	305.62	321.47	507.7	766.13	1018.18	1232.88	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	602.36	478.15	396.41	209.76	76.22	0	0	0	0	233.62	433.03	613.72	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3043.28 (98)

Space heating requirement in kWh/m²/year 42.44 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	602.36	478.15	396.41	209.76	76.22	0	0	0	0	233.62	433.03	613.72	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	644.92	511.94	424.42	224.59	81.61	0	0	0	0	250.13	463.63	657.09	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3258.33 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45

Efficiency of water heater 80.3 (216)

(217)m=	87.71	87.52	87.03	85.79	83.42	80.3	80.3	80.3	80.3	85.94	87.24	87.8

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	221.19	193.64	202.6	182.29	181.5	166.07	159.11	177.37	179.33	190.8	200.64	215.79

Total = Sum(219a)$_{1...12}$ = 2270.32 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		3258.33	
Water heating fuel used		2270.32	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		317.19	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	703.8	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	490.39	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1194.19	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	164.62	(268)
Total CO2, kg/year	sum of (265)…(271) =			1397.74	(272)

TER = 19.49 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 41

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.7	(1a) x	2.56	(2a) =	180.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.7	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.17 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.42 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.39	0.38	0.34	0.34	0.33	0.35	0.38	0.4	0.42

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.58	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.58	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.09	x1/[1/(1.4)+ 0.04]		=	8.07			(27)
Windows Type 2			3.49	x1/[1/(1.4)+ 0.04]		=	4.63			(27)
Windows Type 3			2.18	x1/[1/(1.4)+ 0.04]		=	2.89			(27)
Walls Type1	54.73	15.25	39.48	x	0.18	=	7.11			(29)
Walls Type2	22.23	2.42	19.81	x	0.18	=	3.57			(29)
Roof	70.7	0	70.7	x	0.13	=	9.19			(30)
Total area of elements, m²			147.65							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 42.5 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1644.17 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.93 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 48.43 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	35.93	35.69	35.46	34.38	34.17	33.23	33.23	33.05	33.59	34.17	34.58	35.01	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	84.36	84.12	83.89	82.81	82.61	81.66	81.66	81.49	82.03	82.61	83.02	83.45	

Average = Sum(39)$_{1...12}$ /12= 82.81 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.19	1.19	1.19	1.17	1.17	1.16	1.16	1.15	1.16	1.17	1.17	1.18

Average = Sum(40)$_{1...12}$ /12= 1.17 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.94 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.74	93.22	89.7	86.19	82.67	79.15	79.15	82.67	86.19	89.7	93.22	96.74

Total = Sum(44)$_{1...12}$ = 1055.33 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.46	125.47	129.48	112.88	108.31	93.46	86.61	99.38	100.57	117.21	127.94	138.93

Total = Sum(45)$_{1...12}$ = 1383.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.52	18.82	19.42	16.93	16.25	14.02	12.99	14.91	15.09	17.58	19.19	20.84

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.3	42.91	45.71	42.5	42.13	39.03	40.33	42.13	42.5	45.71	45.97	49.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	

Output from water heater (annual)$_{1...12}$ 1911.23 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.03	52.45	54.48	48.16	46.55	40.84	38.88	43.58	44.07	50.4	54.03	58.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.75	15.77	12.82	9.71	7.26	6.13	6.62	8.61	11.55	14.67	17.12	18.25	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.92	200.98	195.78	184.71	170.73	157.59	148.81	146.75	151.95	163.03	177	190.14	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	(71)

Water heating gains (Table 5)

(72)m=	80.68	78.05	73.22	66.89	62.56	56.72	52.26	58.57	61.2	67.74	75.05	78.66	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	357.3	354.74	341.77	321.25	300.49	280.38	267.64	273.87	284.65	305.38	329.11	346.99	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.18	x	36.79	x	0.63	x	0.7	=	24.51	(77)
Southeast 0.9x	0.77	x	2.18	x	62.67	x	0.63	x	0.7	=	41.76	(77)
Southeast 0.9x	0.77	x	2.18	x	85.75	x	0.63	x	0.7	=	57.13	(77)
Southeast 0.9x	0.77	x	2.18	x	106.25	x	0.63	x	0.7	=	70.79	(77)
Southeast 0.9x	0.77	x	2.18	x	119.01	x	0.63	x	0.7	=	79.29	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.18	x	118.15	x	0.63	x	0.7	=	78.72	(77)
Southeast 0.9x	0.77	x	2.18	x	113.91	x	0.63	x	0.7	=	75.89	(77)
Southeast 0.9x	0.77	x	2.18	x	104.39	x	0.63	x	0.7	=	69.55	(77)
Southeast 0.9x	0.77	x	2.18	x	92.85	x	0.63	x	0.7	=	61.86	(77)
Southeast 0.9x	0.77	x	2.18	x	69.27	x	0.63	x	0.7	=	46.15	(77)
Southeast 0.9x	0.77	x	2.18	x	44.07	x	0.63	x	0.7	=	29.36	(77)
Southeast 0.9x	0.77	x	2.18	x	31.49	x	0.63	x	0.7	=	20.98	(77)
Southwest 0.9x	0.77	x	6.09	x	36.79		0.63	x	0.7	=	68.48	(79)
Southwest 0.9x	0.77	x	3.49	x	36.79		0.63	x	0.7	=	78.49	(79)
Southwest 0.9x	0.77	x	6.09	x	62.67		0.63	x	0.7	=	116.65	(79)
Southwest 0.9x	0.77	x	3.49	x	62.67		0.63	x	0.7	=	133.69	(79)
Southwest 0.9x	0.77	x	6.09	x	85.75		0.63	x	0.7	=	159.6	(79)
Southwest 0.9x	0.77	x	3.49	x	85.75		0.63	x	0.7	=	182.93	(79)
Southwest 0.9x	0.77	x	6.09	x	106.25		0.63	x	0.7	=	197.75	(79)
Southwest 0.9x	0.77	x	3.49	x	106.25		0.63	x	0.7	=	226.65	(79)
Southwest 0.9x	0.77	x	6.09	x	119.01		0.63	x	0.7	=	221.5	(79)
Southwest 0.9x	0.77	x	3.49	x	119.01		0.63	x	0.7	=	253.87	(79)
Southwest 0.9x	0.77	x	6.09	x	118.15		0.63	x	0.7	=	219.9	(79)
Southwest 0.9x	0.77	x	3.49	x	118.15		0.63	x	0.7	=	252.04	(79)
Southwest 0.9x	0.77	x	6.09	x	113.91		0.63	x	0.7	=	212.01	(79)
Southwest 0.9x	0.77	x	3.49	x	113.91		0.63	x	0.7	=	242.99	(79)
Southwest 0.9x	0.77	x	6.09	x	104.39		0.63	x	0.7	=	194.29	(79)
Southwest 0.9x	0.77	x	3.49	x	104.39		0.63	x	0.7	=	222.68	(79)
Southwest 0.9x	0.77	x	6.09	x	92.85		0.63	x	0.7	=	172.81	(79)
Southwest 0.9x	0.77	x	3.49	x	92.85		0.63	x	0.7	=	198.07	(79)
Southwest 0.9x	0.77	x	6.09	x	69.27		0.63	x	0.7	=	128.92	(79)
Southwest 0.9x	0.77	x	3.49	x	69.27		0.63	x	0.7	=	147.76	(79)
Southwest 0.9x	0.77	x	6.09	x	44.07		0.63	x	0.7	=	82.02	(79)
Southwest 0.9x	0.77	x	3.49	x	44.07		0.63	x	0.7	=	94.01	(79)
Southwest 0.9x	0.77	x	6.09	x	31.49		0.63	x	0.7	=	58.6	(79)
Southwest 0.9x	0.77	x	3.49	x	31.49		0.63	x	0.7	=	67.17	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	171.48	292.1	399.66	495.2	554.66	550.65	530.89	486.52	432.75	322.83	205.39	146.75	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	528.78	646.84	741.43	816.44	855.15	831.03	798.52	760.39	717.39	628.2	534.51	493.74	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.99	0.96	0.9	0.78	0.6	0.45	0.49	0.72	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.84	20.05	20.34	20.65	20.87	20.97	21	20.99	20.94	20.64	20.17	19.8	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.93	19.93	19.93	19.94	19.95	19.96	19.96	19.96	19.95	19.95	19.94	19.94	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.88	0.73	0.52	0.34	0.38	0.64	0.91	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.39	18.71	19.12	19.56	19.83	19.94	19.95	19.96	19.91	19.55	18.89	18.35	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.78	19.07	19.45	19.85	20.11	20.22	20.24	20.24	20.18	19.84	19.24	18.74	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.78	19.07	19.45	19.85	20.11	20.22	20.24	20.24	20.18	19.84	19.24	18.74	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.87	0.74	0.54	0.37	0.41	0.66	0.9	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	523.7	631.56	700.96	712.37	629.28	448.05	295.58	310.42	471.06	566.73	523.32	490.22	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1221.87	1192.44	1086.16	906.92	694.73	458.85	296.9	312.56	499.09	763.69	1007.76	1213.13	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	519.43	376.91	286.58	140.08	48.7	0	0	0	0	146.54	348.8	537.84	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2404.89 (98)

Space heating requirement in kWh/m²/year 34.02 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	519.43	376.91	286.58	140.08	48.7	0	0	0	0	146.54	348.8	537.84	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	556.14	403.55	306.83	149.98	52.14	0	0	0	0	156.89	373.44	575.85	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2574.83 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23

Efficiency of water heater 80.3 (216)

(217)m=	87.42	87.02	86.28	84.79	82.56	80.3	80.3	80.3	80.3	84.79	86.77	87.55

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	220.49	193.49	203.04	183.25	182.23	165	158.09	176.23	178.17	192.15	200.43	215.01

Total = Sum(219a)$_{1...12}$ = 2267.58 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2574.83	
Water heating fuel used		2267.58	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		313.54	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	556.16	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	489.8	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1045.96	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	162.73	(268)
Total CO2, kg/year	sum of (265)…(271) =			1247.61	(272)

TER = 17.65 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 42

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.46	(1a) x	2.56	(2a) =	129.18	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.46	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.18	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)			0	(9)
Additional infiltration		[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0	(12)
If no draught lobby, enter 0.05, else enter 0			0	(13)
Percentage of windows and doors draught stripped			0	(14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5	(17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered			2	(19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.34	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.5	x	1/[1/(1.4)+ 0.04]	=	9.94			(27)
Windows Type 2			2.69	x	1/[1/(1.4)+ 0.04]	=	3.57			(27)
Walls Type1	24.7	10.19	14.51	x	0.18	=	2.61			(29)
Walls Type2	19.12	2.42	16.7	x	0.18	=	3.01			(29)
Roof	50.46	0	50.46	x	0.13	=	6.56			(30)
Total area of elements, m²			94.28							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 28.11 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 984.71 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 32.11 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.42	25.26	25.1	24.37	24.23	23.59	23.59	23.47	23.84	24.23	24.51	24.8	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	57.53	57.37	57.21	56.48	56.34	55.7	55.7	55.58	55.95	56.34	56.62	56.91	

Average = Sum(39)$_{1...12}$ /12= 56.48 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.14	1.14	1.13	1.12	1.12	1.1	1.1	1.1	1.11	1.12	1.12	1.13	
Average = Sum(40)$_{1...12}$ /12=													1.12 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.66 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	82.13	79.14	76.15	73.17	70.18	67.2	67.2	70.18	73.17	76.15	79.14	82.13	
Total = Sum(44)$_{1...12}$ =													895.94 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	121.79	106.52	109.92	95.83	91.95	79.35	73.53	84.37	85.38	99.5	108.62	117.95	
Total = Sum(45)$_{1...12}$ =													1174.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	18.27	15.98	16.49	14.37	13.79	11.9	11.03	12.66	12.81	14.93	16.29	17.69	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.85	36.43	38.81	36.08	35.76	33.14	34.24	35.76	36.08	38.81	39.03	41.85	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	

Output from water heater (annual)$_{1...12}$ 1622.57 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.96	44.52	46.25	40.88	39.52	34.67	33.01	37	37.41	42.79	45.87	49.68	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.31	11.82	9.62	7.28	5.44	4.59	4.96	6.45	8.66	11	12.84	13.68	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.43	149.97	146.09	137.82	127.39	117.59	111.04	109.5	113.38	121.65	132.08	141.88	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	(71)

Water heating gains (Table 5)

(72)m=	68.49	66.26	62.16	56.78	53.11	48.15	44.37	49.72	51.96	57.51	63.71	66.78	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.79	279.61	269.42	253.44	237.5	221.89	211.93	217.23	225.56	241.71	260.18	273.89	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	7.5	x	36.79	x	0.63	x	0.7	=	84.34	(79)
Southwest$_{0.9x}$	0.77	x	2.69	x	36.79	x	0.63	x	0.7	=	30.25	(79)
Southwest$_{0.9x}$	0.77	x	7.5	x	62.67	x	0.63	x	0.7	=	143.65	(79)
Southwest$_{0.9x}$	0.77	x	2.69	x	62.67	x	0.63	x	0.7	=	51.52	(79)
Southwest$_{0.9x}$	0.77	x	7.5	x	85.75	x	0.63	x	0.7	=	196.55	(79)

TER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.69	x	85.75	0.63	x	0.7	=	70.5	(79)
Southwest 0.9x	0.77	x	7.5	x	106.25	0.63	x	0.7	=	243.54	(79)
Southwest 0.9x	0.77	x	2.69	x	106.25	0.63	x	0.7	=	87.35	(79)
Southwest 0.9x	0.77	x	7.5	x	119.01	0.63	x	0.7	=	272.78	(79)
Southwest 0.9x	0.77	x	2.69	x	119.01	0.63	x	0.7	=	97.84	(79)
Southwest 0.9x	0.77	x	7.5	x	118.15	0.63	x	0.7	=	270.81	(79)
Southwest 0.9x	0.77	x	2.69	x	118.15	0.63	x	0.7	=	97.13	(79)
Southwest 0.9x	0.77	x	7.5	x	113.91	0.63	x	0.7	=	261.09	(79)
Southwest 0.9x	0.77	x	2.69	x	113.91	0.63	x	0.7	=	93.64	(79)
Southwest 0.9x	0.77	x	7.5	x	104.39	0.63	x	0.7	=	239.27	(79)
Southwest 0.9x	0.77	x	2.69	x	104.39	0.63	x	0.7	=	85.82	(79)
Southwest 0.9x	0.77	x	7.5	x	92.85	0.63	x	0.7	=	212.83	(79)
Southwest 0.9x	0.77	x	2.69	x	92.85	0.63	x	0.7	=	76.33	(79)
Southwest 0.9x	0.77	x	7.5	x	69.27	0.63	x	0.7	=	158.77	(79)
Southwest 0.9x	0.77	x	2.69	x	69.27	0.63	x	0.7	=	56.94	(79)
Southwest 0.9x	0.77	x	7.5	x	44.07	0.63	x	0.7	=	101.01	(79)
Southwest 0.9x	0.77	x	2.69	x	44.07	0.63	x	0.7	=	36.23	(79)
Southwest 0.9x	0.77	x	7.5	x	31.49	0.63	x	0.7	=	72.17	(79)
Southwest 0.9x	0.77	x	2.69	x	31.49	0.63	x	0.7	=	25.89	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	114.58	195.18	267.05	330.89	370.62	367.94	354.74	325.09	289.16	215.71	137.24	98.06	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	396.37	474.78	536.47	584.33	608.13	589.83	566.66	542.33	514.72	457.42	397.42	371.95	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.89	0.77	0.59	0.43	0.47	0.7	0.92	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.94	20.15	20.41	20.7	20.89	20.98	21	20.99	20.95	20.69	20.26	19.91	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.97	19.97	19.97	19.99	19.99	20	20	20	19.99	19.99	19.98	19.98	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.86	0.71	0.5	0.33	0.37	0.62	0.89	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.58	18.88	19.25	19.65	19.89	19.99	20	20	19.96	19.66	19.05	18.53	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.03	19.29	19.63	20	20.22	20.31	20.32	20.32	20.28	19.99	19.45	18.98	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.03	19.29	19.63	20	20.22	20.31	20.32	20.32	20.28	19.99	19.45	18.98	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.94	0.86	0.73	0.53	0.36	0.4	0.64	0.89	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	391.81	462.16	504.69	505.36	440.98	312.04	206.71	216.97	330.08	407.93	387.63	368.71	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	847.13	825.68	751.31	626.68	480.04	318.1	207.43	218.11	345.96	529.3	699.03	841.18	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	338.76	244.29	183.49	87.35	29.06	0	0	0	0	90.3	224.21	351.52	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1548.97 (98)

Space heating requirement in kWh/m²/year 30.7 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	338.76	244.29	183.49	87.35	29.06	0	0	0	0	90.3	224.21	351.52	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	362.69	261.55	196.45	93.52	31.12	0	0	0	0	96.68	240.06	376.36	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1658.43 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8

Efficiency of water heater 80.3 (216)

(217)m=	86.84	86.39	85.58	84.04	82	80.3	80.3	80.3	80.3	84.01	86.1	86.98	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	188.44	165.47	173.79	156.97	155.75	140.08	134.21	149.61	151.26	164.64	171.48	183.72	

Total = Sum(219a)$_{1...12}$ = 1935.42 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1658.43

TER WorkSheet: New dwelling design stage

Water heating fuel used		1935.42	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		235.11	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	358.22	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	418.05	(264)
Space and water heating	(261) + (262) + (263) + (264) =				776.27	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	122.02	(268)
Total CO2, kg/year		sum of (265)…(271) =			937.22	(272)

TER = 18.57 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 43

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	49.88	(1a) x	2.56	(2a) =	127.71	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	49.88	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		127.71	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.16	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)			0	(9)
Additional infiltration		[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0	(12)
If no draught lobby, enter 0.05, else enter 0			0	(13)
Percentage of windows and doors draught stripped			0	(14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5	(17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered			2	(19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.4	x	1/[1/(1.4)+ 0.04]	=	9.81			(27)
Windows Type 2			2.65	x	1/[1/(1.4)+ 0.04]	=	3.51			(27)
Walls Type1	24.52	10.05	14.47	x	0.18	=	2.6			(29)
Walls Type2	18.94	2.42	16.52	x	0.18	=	2.97			(29)
Roof	49.88	0	49.88	x	0.13	=	6.49			(30)
Total area of elements, m²			93.34							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 27.81 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 975.76 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.98 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 31.79 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.16	25	24.85	24.12	23.98	23.34	23.34	23.23	23.59	23.98	24.26	24.55	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	56.95	56.79	56.64	55.91	55.77	55.13	55.13	55.01	55.38	55.77	56.05	56.34	

Average = Sum(39)$_{1...12}$ /12= 55.91 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.14	1.14	1.14	1.12	1.12	1.11	1.11	1.1	1.11	1.12	1.12	1.13	
Average = Sum(40)$_{1...12}$ /12=													1.12 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.69 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.26 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	81.69	78.72	75.74	72.77	69.8	66.83	66.83	69.8	72.77	75.74	78.72	81.69	
Total = Sum(44)$_{1...12}$ =													891.11 (44)
Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)													
(45)m=	121.14	105.95	109.33	95.31	91.46	78.92	73.13	83.92	84.92	98.97	108.03	117.31	
Total = Sum(45)$_{1...12}$ =													1168.39 (45)
If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)													
(46)m=	18.17	15.89	16.4	14.3	13.72	11.84	10.97	12.59	12.74	14.85	16.2	17.6	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)
If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H													
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.63	36.23	38.6	35.89	35.57	32.96	34.06	35.57	35.89	38.6	38.82	41.63	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	

Output from water heater (annual)$_{1...12}$ 1613.83 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.68	44.29	46	40.66	39.3	34.48	32.83	36.8	37.21	42.56	45.62	49.41	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.18	11.71	9.52	7.21	5.39	4.55	4.92	6.39	8.58	10.89	12.71	13.55	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	146.94	148.46	144.62	136.44	126.11	116.41	109.92	108.4	112.24	120.42	130.75	140.45	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	(71)

Water heating gains (Table 5)

(72)m=	68.12	65.9	61.83	56.48	52.83	47.89	44.13	49.46	51.68	57.2	63.37	66.42	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	279.54	277.37	267.27	251.43	235.63	220.15	210.27	215.55	223.8	239.81	258.13	271.72	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	7.4	x	36.79	x	0.63	x	0.7	=	83.21	(79)
Southwest$_{0.9x}$	0.77	x	2.65	x	36.79	x	0.63	x	0.7	=	29.8	(79)
Southwest$_{0.9x}$	0.77	x	7.4	x	62.67	x	0.63	x	0.7	=	141.74	(79)
Southwest$_{0.9x}$	0.77	x	2.65	x	62.67	x	0.63	x	0.7	=	50.76	(79)
Southwest$_{0.9x}$	0.77	x	7.4	x	85.75	x	0.63	x	0.7	=	193.93	(79)

TER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.65	x	85.75	0.63	x	0.7	=	69.45	(79)
Southwest 0.9x	0.77	x	7.4	x	106.25	0.63	x	0.7	=	240.29	(79)
Southwest 0.9x	0.77	x	2.65	x	106.25	0.63	x	0.7	=	86.05	(79)
Southwest 0.9x	0.77	x	7.4	x	119.01	0.63	x	0.7	=	269.15	(79)
Southwest 0.9x	0.77	x	2.65	x	119.01	0.63	x	0.7	=	96.38	(79)
Southwest 0.9x	0.77	x	7.4	x	118.15	0.63	x	0.7	=	267.2	(79)
Southwest 0.9x	0.77	x	2.65	x	118.15	0.63	x	0.7	=	95.69	(79)
Southwest 0.9x	0.77	x	7.4	x	113.91	0.63	x	0.7	=	257.61	(79)
Southwest 0.9x	0.77	x	2.65	x	113.91	0.63	x	0.7	=	92.25	(79)
Southwest 0.9x	0.77	x	7.4	x	104.39	0.63	x	0.7	=	236.08	(79)
Southwest 0.9x	0.77	x	2.65	x	104.39	0.63	x	0.7	=	84.54	(79)
Southwest 0.9x	0.77	x	7.4	x	92.85	0.63	x	0.7	=	209.99	(79)
Southwest 0.9x	0.77	x	2.65	x	92.85	0.63	x	0.7	=	75.2	(79)
Southwest 0.9x	0.77	x	7.4	x	69.27	0.63	x	0.7	=	156.65	(79)
Southwest 0.9x	0.77	x	2.65	x	69.27	0.63	x	0.7	=	56.1	(79)
Southwest 0.9x	0.77	x	7.4	x	44.07	0.63	x	0.7	=	99.67	(79)
Southwest 0.9x	0.77	x	2.65	x	44.07	0.63	x	0.7	=	35.69	(79)
Southwest 0.9x	0.77	x	7.4	x	31.49	0.63	x	0.7	=	71.21	(79)
Southwest 0.9x	0.77	x	2.65	x	31.49	0.63	x	0.7	=	25.5	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	113.01	192.5	263.38	326.34	365.53	362.89	349.86	320.63	285.19	212.75	135.36	96.71	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	392.55	469.87	530.65	577.77	601.16	583.04	560.13	536.17	508.98	452.56	393.48	368.43	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.9	0.77	0.59	0.43	0.47	0.7	0.92	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.94	20.15	20.41	20.7	20.89	20.98	21	20.99	20.95	20.69	20.26	19.9	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.97	19.97	19.97	19.98	19.99	20	20	20	19.99	19.99	19.98	19.98	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.86	0.71	0.5	0.33	0.37	0.62	0.89	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.58	18.87	19.25	19.65	19.89	19.98	20	20	19.96	19.65	19.05	18.53	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.03	19.3	19.63	20	20.22	20.31	20.33	20.33	20.29	20	19.45	18.99	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.03	19.3	19.63	20	20.22	20.31	20.33	20.33	20.29	20	19.45	18.99	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.94	0.87	0.73	0.53	0.37	0.4	0.64	0.89	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	388.01	457.35	499.25	499.88	436.36	308.94	204.76	214.9	326.75	403.64	383.76	365.2	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	838.86	817.56	743.89	620.44	475.31	315.01	205.47	216.05	342.59	524.07	692.15	832.92	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	335.43	242.06	182.01	86.8	28.98	0	0	0	0	89.6	222.04	347.98	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1534.9 (98)

Space heating requirement in kWh/m²/year 30.77 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	335.43	242.06	182.01	86.8	28.98	0	0	0	0	89.6	222.04	347.98	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	359.13	259.16	194.87	92.94	31.02	0	0	0	0	95.93	237.73	372.57	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1643.36 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94

Efficiency of water heater 80.3 (216)

(217)m=	86.83	86.38	85.57	84.04	82	80.3	80.3	80.3	80.3	84	86.09	86.97	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	187.45	164.6	172.86	156.12	154.91	139.33	133.49	148.81	150.45	163.77	170.58	182.75	

Total = Sum(219a)$_{1...12}$ = 1925.1 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1643.36

TER WorkSheet: New dwelling design stage

Water heating fuel used		1925.1	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		232.8	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	354.97	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	415.82	(264)
Space and water heating	(261) + (262) + (263) + (264) =				770.79	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	120.82	(268)
Total CO2, kg/year	sum of (265)…(271) =				930.53	(272)

TER = 18.65 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 44

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.49	(1a) x	2.56	(2a) =	129.25	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.49	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.25	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)			0	(9)
Additional infiltration		[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0	(12)
If no draught lobby, enter 0.05, else enter 0			0	(13)
Percentage of windows and doors draught stripped			0	(14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5	(17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered			2	(19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.34	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.51	x	1/[1/(1.4)+ 0.04]	=	9.96			(27)
Windows Type 2			2.69	x	1/[1/(1.4)+ 0.04]	=	3.57			(27)
Walls Type1	15.41	10.2	5.21	x	0.18	=	0.94			(29)
Walls Type2	48.46	2.42	46.04	x	0.18	=	8.29			(29)
Roof	50.5	0	50.5	x	0.13	=	6.56			(30)
Total area of elements, m²			114.36							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.73 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1325.68 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.43 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.17 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.43	25.27	25.11	24.38	24.24	23.6	23.6	23.49	23.85	24.24	24.52	24.81	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	60.6	60.44	60.28	59.55	59.41	58.77	58.77	58.65	59.02	59.41	59.69	59.98	

Average = Sum(39)$_{1...12}$ /12= 59.55 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.2	1.2	1.19	1.18	1.18	1.16	1.16	1.16	1.17	1.18	1.18	1.19	
Average = Sum(40)$_{1...12}$ /12=													1.18 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.68 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	82.15	79.16	76.18	73.19	70.2	67.21	67.21	70.2	73.19	76.18	79.16	82.15	
Total = Sum(44)$_{1...12}$ =													896.19 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.83	106.55	109.95	95.86	91.98	79.37	73.55	84.4	85.41	99.53	108.65	117.98	
Total = Sum(45)$_{1...12}$ =													1175.05 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.38	13.8	11.91	11.03	12.66	12.81	14.93	16.3	17.7	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.86	36.44	38.82	36.09	35.77	33.15	34.25	35.77	36.09	38.82	39.04	41.86	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85	

Output from water heater (annual)$_{1...12}$ 1623.02 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.97	44.54	46.26	40.9	39.53	34.68	33.02	37.01	37.42	42.8	45.88	49.7	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.32	11.83	9.62	7.28	5.44	4.6	4.97	6.46	8.67	11	12.84	13.69	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.51	150.05	146.16	137.9	127.46	117.65	111.1	109.56	113.44	121.71	132.15	141.95	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	(71)

Water heating gains (Table 5)

(72)m=	68.51	66.28	62.18	56.8	53.13	48.16	44.38	49.74	51.97	57.53	63.73	66.79	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.91	279.72	269.54	253.55	237.6	221.98	212.01	217.32	225.65	241.81	260.28	274.01	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.69	x	36.79	x	0.63	x	0.7	=	30.25	(77)
Southeast 0.9x	0.77	x	2.69	x	62.67	x	0.63	x	0.7	=	51.52	(77)
Southeast 0.9x	0.77	x	2.69	x	85.75	x	0.63	x	0.7	=	70.5	(77)
Southeast 0.9x	0.77	x	2.69	x	106.25	x	0.63	x	0.7	=	87.35	(77)
Southeast 0.9x	0.77	x	2.69	x	119.01	x	0.63	x	0.7	=	97.84	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.69	x	118.15	x	0.63	x	0.7	=	97.13	(77)
Southeast 0.9x	0.77	x	2.69	x	113.91	x	0.63	x	0.7	=	93.64	(77)
Southeast 0.9x	0.77	x	2.69	x	104.39	x	0.63	x	0.7	=	85.82	(77)
Southeast 0.9x	0.77	x	2.69	x	92.85	x	0.63	x	0.7	=	76.33	(77)
Southeast 0.9x	0.77	x	2.69	x	69.27	x	0.63	x	0.7	=	56.94	(77)
Southeast 0.9x	0.77	x	2.69	x	44.07	x	0.63	x	0.7	=	36.23	(77)
Southeast 0.9x	0.77	x	2.69	x	31.49	x	0.63	x	0.7	=	25.89	(77)
Southwest 0.9x	0.77	x	7.51	x	36.79		0.63	x	0.7	=	84.45	(79)
Southwest 0.9x	0.77	x	7.51	x	62.67		0.63	x	0.7	=	143.85	(79)
Southwest 0.9x	0.77	x	7.51	x	85.75		0.63	x	0.7	=	196.82	(79)
Southwest 0.9x	0.77	x	7.51	x	106.25		0.63	x	0.7	=	243.86	(79)
Southwest 0.9x	0.77	x	7.51	x	119.01		0.63	x	0.7	=	273.15	(79)
Southwest 0.9x	0.77	x	7.51	x	118.15		0.63	x	0.7	=	271.17	(79)
Southwest 0.9x	0.77	x	7.51	x	113.91		0.63	x	0.7	=	261.44	(79)
Southwest 0.9x	0.77	x	7.51	x	104.39		0.63	x	0.7	=	239.59	(79)
Southwest 0.9x	0.77	x	7.51	x	92.85		0.63	x	0.7	=	213.11	(79)
Southwest 0.9x	0.77	x	7.51	x	69.27		0.63	x	0.7	=	158.98	(79)
Southwest 0.9x	0.77	x	7.51	x	44.07		0.63	x	0.7	=	101.15	(79)
Southwest 0.9x	0.77	x	7.51	x	31.49		0.63	x	0.7	=	72.27	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	114.7	195.37	267.31	331.21	370.99	368.3	355.08	325.41	289.44	215.92	137.38	98.16	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	396.6	475.09	536.85	584.76	608.59	590.28	567.1	542.73	515.09	457.73	397.66	372.16	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.91	0.79	0.61	0.45	0.49	0.72	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.86	20.07	20.34	20.65	20.87	20.97	20.99	20.99	20.93	20.64	20.19	19.82	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.92	19.92	19.92	19.94	19.94	19.95	19.95	19.95	19.94	19.94	19.93	19.93	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.88	0.73	0.52	0.35	0.38	0.64	0.9	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.43	18.73	19.12	19.54	19.82	19.93	19.95	19.95	19.9	19.55	18.92	18.38	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.9	19.17	19.52	19.9	20.16	20.27	20.29	20.29	20.24	19.91	19.33	18.85	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.9	19.17	19.52	19.9	20.16	20.27	20.29	20.29	20.24	19.91	19.33	18.85	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.94	0.87	0.74	0.55	0.38	0.42	0.66	0.9	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	392.11	463	507.02	511.56	452.44	324.59	215.74	226.37	340.85	411.75	388.27	368.95	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	884.45	862.16	784.66	655.28	502.61	333.32	216.86	228.13	362.22	553.06	730.15	878.71	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	366.3	268.24	206.57	103.48	37.32	0	0	0	0	105.14	246.15	379.26	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1712.44 (98)

Space heating requirement in kWh/m²/year 33.92 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	366.3	268.24	206.57	103.48	37.32	0	0	0	0	105.14	246.15	379.26	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	392.18	287.19	221.16	110.79	39.96	0	0	0	0	112.56	263.54	406.06	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1833.45 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85

Efficiency of water heater 80.3 (216)

(217)m=	87.02	86.61	85.88	84.45	82.38	80.3	80.3	80.3	80.3	84.37	86.33	87.15	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	188.11	165.09	173.23	156.25	155.07	140.12	134.25	149.65	151.31	163.98	171.08	183.42	

Total = Sum(219a)$_{1...12}$ = 1931.56 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1833.45

TER WorkSheet: New dwelling design stage

Water heating fuel used		1931.56	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		235.22	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	396.03	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	417.22	(264)
Space and water heating	(261) + (262) + (263) + (264) =				813.24	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	122.08	(268)
Total CO2, kg/year		sum of (265)…(271) =			974.25	(272)

TER = 19.3 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 45

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.04	(1a) x	2.56	(2a) =	186.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.04	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.44	0.43	0.38	0.38	0.33	0.33	0.32	0.35	0.38	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.38	x1/[1/(1.4)+ 0.04]		=	9.78			(27)
Windows Type 2			4.23	x1/[1/(1.4)+ 0.04]		=	5.61			(27)
Walls Type1	36.47	15.84	20.63	x	0.18	=	3.71			(29)
Walls Type2	41.48	2.42	39.06	x	0.18	=	7.03			(29)
Roof	73.04	0	73.04	x	0.13	=	9.49			(30)
Total area of elements, m²			150.99							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.66 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1672.06 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.74 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 48.4 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	36.96	36.72	36.49	35.4	35.19	34.24	34.24	34.07	34.61	35.19	35.6	36.04	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	85.35	85.12	84.88	83.79	83.59	82.64	82.64	82.46	83	83.59	84	84.43	

Average = Sum(39)$_{1...12}$ /12= 83.79 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.17	1.17	1.16	1.15	1.14	1.13	1.13	1.13	1.14	1.14	1.15	1.16

Average = Sum(40)$_{1...12}$ /12= 1.15 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.24 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	98.17	94.6	91.03	87.46	83.89	80.32	80.32	83.89	87.46	91.03	94.6	98.17	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1070.92 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.58	127.32	131.39	114.55	109.91	94.84	87.89	100.85	102.06	118.94	129.83	140.99

Total = Sum(45)$_{1...12}$ = 1404.14 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.84	19.1	19.71	17.18	16.49	14.23	13.18	15.13	15.31	17.84	19.47	21.15

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.03	43.54	46.39	43.13	42.75	39.61	40.93	42.75	43.13	46.39	46.65	50.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	

Output from water heater (annual)$_{1...12}$ 1939.46 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.91	53.22	55.28	48.87	47.23	41.44	39.45	44.22	44.72	51.14	54.83	59.38	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.23	16.19	13.17	9.97	7.45	6.29	6.8	8.84	11.86	15.06	17.57	18.74	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.29	206.41	201.06	189.69	175.34	161.84	152.83	150.71	156.05	167.42	181.78	195.27	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	(71)

Water heating gains (Table 5)

(72)m=	81.87	79.2	74.31	67.87	63.48	57.55	53.03	59.44	62.11	68.74	76.15	79.82	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	365.15	362.56	349.3	328.3	307.04	286.45	273.42	279.75	290.78	311.99	336.27	354.59	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.38	x	36.79	x	0.63	x	0.7	=	82.99	(77)
Southeast 0.9x	0.77	x	4.23	x	36.79	x	0.63	x	0.7	=	95.13	(77)
Southeast 0.9x	0.77	x	7.38	x	62.67	x	0.63	x	0.7	=	141.36	(77)
Southeast 0.9x	0.77	x	4.23	x	62.67	x	0.63	x	0.7	=	162.04	(77)
Southeast 0.9x	0.77	x	7.38	x	85.75	x	0.63	x	0.7	=	193.41	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.23	x	85.75	x	0.63	x	0.7	=	221.71	(77)
Southeast 0.9x	0.77	x	7.38	x	106.25	x	0.63	x	0.7	=	239.64	(77)
Southeast 0.9x	0.77	x	4.23	x	106.25	x	0.63	x	0.7	=	274.71	(77)
Southeast 0.9x	0.77	x	7.38	x	119.01	x	0.63	x	0.7	=	268.42	(77)
Southeast 0.9x	0.77	x	4.23	x	119.01	x	0.63	x	0.7	=	307.7	(77)
Southeast 0.9x	0.77	x	7.38	x	118.15	x	0.63	x	0.7	=	266.48	(77)
Southeast 0.9x	0.77	x	4.23	x	118.15	x	0.63	x	0.7	=	305.48	(77)
Southeast 0.9x	0.77	x	7.38	x	113.91	x	0.63	x	0.7	=	256.91	(77)
Southeast 0.9x	0.77	x	4.23	x	113.91	x	0.63	x	0.7	=	294.51	(77)
Southeast 0.9x	0.77	x	7.38	x	104.39	x	0.63	x	0.7	=	235.44	(77)
Southeast 0.9x	0.77	x	4.23	x	104.39	x	0.63	x	0.7	=	269.9	(77)
Southeast 0.9x	0.77	x	7.38	x	92.85	x	0.63	x	0.7	=	209.42	(77)
Southeast 0.9x	0.77	x	4.23	x	92.85	x	0.63	x	0.7	=	240.07	(77)
Southeast 0.9x	0.77	x	7.38	x	69.27	x	0.63	x	0.7	=	156.23	(77)
Southeast 0.9x	0.77	x	4.23	x	69.27	x	0.63	x	0.7	=	179.09	(77)
Southeast 0.9x	0.77	x	7.38	x	44.07	x	0.63	x	0.7	=	99.4	(77)
Southeast 0.9x	0.77	x	4.23	x	44.07	x	0.63	x	0.7	=	113.94	(77)
Southeast 0.9x	0.77	x	7.38	x	31.49	x	0.63	x	0.7	=	71.02	(77)
Southeast 0.9x	0.77	x	4.23	x	31.49	x	0.63	x	0.7	=	81.41	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	178.12	303.4	415.12	514.35	576.12	571.95	551.42	505.34	449.49	335.32	213.34	152.43	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	543.26	665.95	764.42	842.65	883.16	858.4	824.85	785.09	740.27	647.31	549.61	507.02	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.99	0.96	0.9	0.78	0.59	0.44	0.48	0.71	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.87	20.08	20.36	20.67	20.88	20.98	21	20.99	20.94	20.66	20.2	19.83	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.95	19.95	19.95	19.96	19.96	19.98	19.98	19.98	19.97	19.96	19.96	19.96	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.87	0.72	0.51	0.34	0.37	0.63	0.9	0.98	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.45	18.77	19.17	19.6	19.86	19.96	19.97	19.97	19.93	19.59	18.94	18.4	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.84	19.13	19.5	19.89	20.14	20.24	20.25	20.25	20.21	19.88	19.28	18.79	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.84	19.13	19.5	19.89	20.14	20.24	20.25	20.25	20.21	19.88	19.28	18.79	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.94	0.87	0.73	0.53	0.36	0.4	0.65	0.9	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	538.15	650.19	721.96	732.33	643.81	456.12	300.64	315.76	480.81	582.67	538.16	503.49	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1240.71	1210.95	1103.1	920.98	705.24	465.84	301.78	317.64	506.79	775.75	1023.5	1231.83	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	522.7	376.83	283.57	135.83	45.7	0	0	0	0	143.65	349.44	541.88	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2399.62 (98)

Space heating requirement in kWh/m²/year 32.85 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	522.7	376.83	283.57	135.83	45.7	0	0	0	0	143.65	349.44	541.88	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	559.63	403.46	303.61	145.43	48.93	0	0	0	0	153.81	374.14	580.17	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2569.18 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01

Efficiency of water heater 80.3 (216)

(217)m=	87.41	86.99	86.22	84.68	82.42	80.3	80.3	80.3	80.3	84.7	86.74	87.53	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	223.79	196.43	206.18	186.21	185.22	167.44	160.42	178.83	180.81	195.19	203.46	218.22	

Total = Sum(219a)$_{1...12}$ = 2302.19 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2569.18

TER WorkSheet: New dwelling design stage

Water heating fuel used		2302.19	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		321.92	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	554.94	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	497.27	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1052.22	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	167.08	(268)
Total CO2, kg/year		sum of (265)…(271) =			1258.22	(272)

TER = 17.23 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 46

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.73	(1a) x	2.56	(2a) =	188.75	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.73	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.75	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.43	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.46	x	1/[1/(1.4)+ 0.04]	=	9.89			(27)
Windows Type 2			4.28	x	1/[1/(1.4)+ 0.04]	=	5.67			(27)
Walls Type1	31.87	16.02	15.85	x	0.18	=	2.85			(29)
Walls Type2	39.15	2.42	36.73	x	0.18	=	6.61			(29)
Roof	73.73	0	73.73	x	0.13	=	9.58			(30)
Total area of elements, m²			144.75							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 42.71 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1557.4 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.65 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 47.36 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	37.26	37.02	36.79	35.7	35.49	34.54	34.54	34.36	34.91	35.49	35.91	36.34	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	84.62	84.38	84.15	83.06	82.85	81.9	81.9	81.72	82.27	82.85	83.27	83.7	

Average = Sum(39)$_{1...12}$ /12= 83.06 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.15	1.14	1.14	1.13	1.12	1.11	1.11	1.11	1.12	1.12	1.13	1.14	

Average = Sum(40)$_{1...12}$ /12= 1.13 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.61 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	98.57	94.99	91.4	87.82	84.24	80.65	80.65	84.24	87.82	91.4	94.99	98.57	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1075.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	146.18	127.85	131.93	115.02	110.37	95.24	88.25	101.27	102.48	119.43	130.37	141.57	

Total = Sum(45)$_{1...12}$ = 1409.95 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.93	19.18	19.79	17.25	16.55	14.29	13.24	15.19	15.37	17.91	19.55	21.24	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.23	43.72	46.58	43.31	42.93	39.77	41.1	42.93	43.31	46.58	46.84	50.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8	

Output from water heater (annual)$_{1...12}$ 1947.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.16	53.44	55.51	49.07	47.43	41.61	39.62	44.4	44.9	51.35	55.06	59.63	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.37	16.31	13.27	10.04	7.51	6.34	6.85	8.9	11.95	15.17	17.71	18.88	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.84	207.98	202.59	191.13	176.67	163.07	153.99	151.86	157.24	168.7	183.16	196.76	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	(71)

Water heating gains (Table 5)

(72)m=	82.21	79.53	74.61	68.15	63.75	57.79	53.25	59.68	62.36	69.03	76.47	80.15	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.41	364.81	351.47	330.33	308.92	288.2	275.09	281.44	292.55	313.89	338.34	356.78	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.46	x	36.79	x	0.63	x	0.7	=	83.89	(77)
Southeast 0.9x	0.77	x	4.28	x	36.79	x	0.63	x	0.7	=	96.25	(77)
Southeast 0.9x	0.77	x	7.46	x	62.67	x	0.63	x	0.7	=	142.89	(77)
Southeast 0.9x	0.77	x	4.28	x	62.67	x	0.63	x	0.7	=	163.96	(77)
Southeast 0.9x	0.77	x	7.46	x	85.75	x	0.63	x	0.7	=	195.51	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.28	x	85.75	x	0.63	x	0.7	=	224.33	(77)
Southeast 0.9x	0.77	x	7.46	x	106.25	x	0.63	x	0.7	=	242.24	(77)
Southeast 0.9x	0.77	x	4.28	x	106.25	x	0.63	x	0.7	=	277.96	(77)
Southeast 0.9x	0.77	x	7.46	x	119.01	x	0.63	x	0.7	=	271.33	(77)
Southeast 0.9x	0.77	x	4.28	x	119.01	x	0.63	x	0.7	=	311.34	(77)
Southeast 0.9x	0.77	x	7.46	x	118.15	x	0.63	x	0.7	=	269.37	(77)
Southeast 0.9x	0.77	x	4.28	x	118.15	x	0.63	x	0.7	=	309.09	(77)
Southeast 0.9x	0.77	x	7.46	x	113.91	x	0.63	x	0.7	=	259.7	(77)
Southeast 0.9x	0.77	x	4.28	x	113.91	x	0.63	x	0.7	=	297.99	(77)
Southeast 0.9x	0.77	x	7.46	x	104.39	x	0.63	x	0.7	=	238	(77)
Southeast 0.9x	0.77	x	4.28	x	104.39	x	0.63	x	0.7	=	273.09	(77)
Southeast 0.9x	0.77	x	7.46	x	92.85	x	0.63	x	0.7	=	211.69	(77)
Southeast 0.9x	0.77	x	4.28	x	92.85	x	0.63	x	0.7	=	242.91	(77)
Southeast 0.9x	0.77	x	7.46	x	69.27	x	0.63	x	0.7	=	157.92	(77)
Southeast 0.9x	0.77	x	4.28	x	69.27	x	0.63	x	0.7	=	181.21	(77)
Southeast 0.9x	0.77	x	7.46	x	44.07	x	0.63	x	0.7	=	100.48	(77)
Southeast 0.9x	0.77	x	4.28	x	44.07	x	0.63	x	0.7	=	115.29	(77)
Southeast 0.9x	0.77	x	7.46	x	31.49	x	0.63	x	0.7	=	71.79	(77)
Southeast 0.9x	0.77	x	4.28	x	31.49	x	0.63	x	0.7	=	82.37	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	180.14	306.84	419.84	520.2	582.67	578.45	557.69	511.09	454.6	339.13	215.77	154.16	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	547.55	671.65	771.31	850.53	891.59	866.65	832.78	792.52	747.14	653.02	554.1	510.94	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.99	0.96	0.9	0.77	0.59	0.43	0.47	0.71	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.89	20.11	20.39	20.69	20.89	20.98	21	20.99	20.95	20.67	20.22	19.85	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.96	19.96	19.97	19.98	19.98	19.99	19.99	19.99	19.99	19.98	19.98	19.97	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.87	0.71	0.5	0.33	0.37	0.62	0.9	0.98	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.5	18.82	19.22	19.64	19.88	19.98	19.99	19.99	19.95	19.63	18.99	18.45	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.88	19.17	19.53	19.92	20.16	20.25	20.26	20.26	20.22	19.91	19.32	18.83	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.88	19.17	19.53	19.92	20.16	20.25	20.26	20.26	20.22	19.91	19.32	18.83	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.94	0.87	0.72	0.52	0.36	0.4	0.64	0.9	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	542.41	655.56	727.52	736.09	643.97	454.04	298.92	314	479.86	586.16	542.44	507.41	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1233.59	1204.03	1096.78	915.39	700.6	462.63	299.9	315.62	503.44	771.21	1017.57	1224.6	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	514.24	368.57	274.73	129.1	42.14	0	0	0	0	137.67	342.09	533.59	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2342.13 (98)

Space heating requirement in kWh/m²/year 31.77 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	514.24	368.57	274.73	129.1	42.14	0	0	0	0	137.67	342.09	533.59	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	550.57	394.62	294.15	138.22	45.11	0	0	0	0	147.4	366.27	571.3	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2507.64 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8

Efficiency of water heater 80.3 (216)

(217)m=	87.36	86.93	86.13	84.54	82.28	80.3	80.3	80.3	80.3	84.58	86.68	87.49	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	224.82	197.38	207.25	187.28	186.3	168.13	161.08	179.57	181.55	196.26	204.44	219.23	

Total = Sum(219a)$_{1...12}$ = 2313.3 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2507.64

TER WorkSheet: New dwelling design stage

Water heating fuel used		2313.3	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		324.34	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	541.65	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	499.67	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1041.32	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	168.33	(268)
Total CO2, kg/year		sum of (265)…(271) =			1248.58	(272)

TER = 16.93 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 47

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	58.88	(1a) x	2.56	(2a) =	150.74	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	58.88	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		150.74	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.13 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.38 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.33 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.41	0.41	0.4	0.36	0.35	0.31	0.31	0.3	0.33	0.35	0.37	0.38

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.58	0.58	0.56	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.37	x1/[1/(1.4)+ 0.04]		=	8.45			(27)
Windows Type 2			3.65	x1/[1/(1.4)+ 0.04]		=	4.84			(27)
Windows Type 3			2.28	x1/[1/(1.4)+ 0.04]		=	3.02			(27)
Walls Type1	31.19	12.3	18.89	x	0.18	=	3.4			(29)
Walls Type2	39.09	2.42	36.67	x	0.18	=	6.6			(29)
Roof	58.88	0	58.88	x	0.13	=	7.65			(30)
Total area of elements, m²			129.16							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 36.38 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1474.37 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.65 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 41.03 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	29.15	28.98	28.82	28.06	27.91	27.25	27.25	27.12	27.5	27.91	28.2	28.51	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	70.18	70.02	69.86	69.09	68.95	68.28	68.28	68.16	68.54	68.95	69.24	69.54	

Average = Sum(39)$_{1...12}$ /12= 69.09 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.19	1.19	1.19	1.17	1.17	1.16	1.16	1.16	1.16	1.17	1.18	1.18

Average = Sum(40)$_{1...12}$ /12= 1.17 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.95 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 80.51 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	88.56	85.34	82.12	78.9	75.68	72.46	72.46	75.68	78.9	82.12	85.34	88.56	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 966.12 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	131.33	114.86	118.53	103.34	99.15	85.56	79.29	90.98	92.07	107.3	117.12	127.19

Total = Sum(45)$_{1...12}$ = 1266.73 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.7	17.23	17.78	15.5	14.87	12.83	11.89	13.65	13.81	16.09	17.57	19.08

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	45.13	39.28	41.85	38.91	38.57	35.73	36.92	38.57	38.91	41.85	42.09	45.13	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32	

Output from water heater (annual)$_{1...12}$ 1749.66 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	54.95	48.01	49.87	44.09	42.61	37.38	35.59	39.89	40.34	46.14	49.47	53.57	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	15.21	13.51	10.99	8.32	6.22	5.25	5.67	7.37	9.9	12.57	14.67	15.64	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	170.12	171.89	167.44	157.97	146.01	134.78	127.27	125.51	129.95	139.42	151.38	162.62	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	(71)

Water heating gains (Table 5)

(72)m=	73.86	71.45	67.03	61.23	57.27	51.92	47.84	53.62	56.03	62.01	68.7	72.01	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	314.44	312.09	300.71	282.77	264.75	247.2	236.03	241.75	251.13	269.25	290	305.51	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	6.37	x	36.79	x	0.63	x	0.7	=	71.63	(77)
Southeast 0.9x	0.77	x	3.65	x	36.79	x	0.63	x	0.7	=	41.04	(77)
Southeast 0.9x	0.77	x	2.28	x	36.79	x	0.63	x	0.7	=	25.64	(77)
Southeast 0.9x	0.77	x	6.37	x	62.67	x	0.63	x	0.7	=	122.01	(77)
Southeast 0.9x	0.77	x	3.65	x	62.67	x	0.63	x	0.7	=	69.91	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.28	x	62.67	x	0.63	x	0.7	=	43.67	(77)
Southeast 0.9x	0.77	x	6.37	x	85.75	x	0.63	x	0.7	=	166.94	(77)
Southeast 0.9x	0.77	x	3.65	x	85.75	x	0.63	x	0.7	=	95.66	(77)
Southeast 0.9x	0.77	x	2.28	x	85.75	x	0.63	x	0.7	=	59.75	(77)
Southeast 0.9x	0.77	x	6.37	x	106.25	x	0.63	x	0.7	=	206.85	(77)
Southeast 0.9x	0.77	x	3.65	x	106.25	x	0.63	x	0.7	=	118.52	(77)
Southeast 0.9x	0.77	x	2.28	x	106.25	x	0.63	x	0.7	=	74.04	(77)
Southeast 0.9x	0.77	x	6.37	x	119.01	x	0.63	x	0.7	=	231.68	(77)
Southeast 0.9x	0.77	x	3.65	x	119.01	x	0.63	x	0.7	=	132.75	(77)
Southeast 0.9x	0.77	x	2.28	x	119.01	x	0.63	x	0.7	=	82.93	(77)
Southeast 0.9x	0.77	x	6.37	x	118.15	x	0.63	x	0.7	=	230.01	(77)
Southeast 0.9x	0.77	x	3.65	x	118.15	x	0.63	x	0.7	=	131.79	(77)
Southeast 0.9x	0.77	x	2.28	x	118.15	x	0.63	x	0.7	=	82.33	(77)
Southeast 0.9x	0.77	x	6.37	x	113.91	x	0.63	x	0.7	=	221.75	(77)
Southeast 0.9x	0.77	x	3.65	x	113.91	x	0.63	x	0.7	=	127.06	(77)
Southeast 0.9x	0.77	x	2.28	x	113.91	x	0.63	x	0.7	=	79.37	(77)
Southeast 0.9x	0.77	x	6.37	x	104.39	x	0.63	x	0.7	=	203.22	(77)
Southeast 0.9x	0.77	x	3.65	x	104.39	x	0.63	x	0.7	=	116.45	(77)
Southeast 0.9x	0.77	x	2.28	x	104.39	x	0.63	x	0.7	=	72.74	(77)
Southeast 0.9x	0.77	x	6.37	x	92.85	x	0.63	x	0.7	=	180.76	(77)
Southeast 0.9x	0.77	x	3.65	x	92.85	x	0.63	x	0.7	=	103.58	(77)
Southeast 0.9x	0.77	x	2.28	x	92.85	x	0.63	x	0.7	=	64.7	(77)
Southeast 0.9x	0.77	x	6.37	x	69.27	x	0.63	x	0.7	=	134.85	(77)
Southeast 0.9x	0.77	x	3.65	x	69.27	x	0.63	x	0.7	=	77.27	(77)
Southeast 0.9x	0.77	x	2.28	x	69.27	x	0.63	x	0.7	=	48.27	(77)
Southeast 0.9x	0.77	x	6.37	x	44.07	x	0.63	x	0.7	=	85.79	(77)
Southeast 0.9x	0.77	x	3.65	x	44.07	x	0.63	x	0.7	=	49.16	(77)
Southeast 0.9x	0.77	x	2.28	x	44.07	x	0.63	x	0.7	=	30.71	(77)
Southeast 0.9x	0.77	x	6.37	x	31.49	x	0.63	x	0.7	=	61.3	(77)
Southeast 0.9x	0.77	x	3.65	x	31.49	x	0.63	x	0.7	=	35.12	(77)
Southeast 0.9x	0.77	x	2.28	x	31.49	x	0.63	x	0.7	=	21.94	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	138.31	235.59	322.35	399.4	447.37	444.13	428.19	392.41	349.03	260.38	165.66	118.36	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	452.75	547.69	623.06	682.17	712.12	691.33	664.22	634.16	600.16	529.63	455.66	423.87	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.9	0.79	0.61	0.45	0.49	0.72	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.86	20.07	20.35	20.65	20.87	20.97	20.99	20.99	20.94	20.64	20.19	19.82	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.93	19.93	19.93	19.94	19.94	19.95	19.95	19.95	19.95	19.94	19.94	19.94	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.87	0.73	0.52	0.34	0.38	0.64	0.9	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.43	18.73	19.13	19.55	19.83	19.94	19.95	19.95	19.9	19.56	18.91	18.37	(90)

fLA = Living area ÷ (4) = 0.34 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.91	19.18	19.54	19.92	20.18	20.29	20.3	20.3	20.25	19.92	19.34	18.86	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.91	19.18	19.54	19.92	20.18	20.29	20.3	20.3	20.25	19.92	19.34	18.86	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.87	0.74	0.55	0.38	0.42	0.66	0.9	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	448.05	534.29	588.82	596.33	527.56	378.35	251.59	263.98	397.01	477.42	445.57	420.55	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1025.29	1000.12	910.82	761.73	584.52	388.2	252.85	266	421.62	642.8	847.62	1019.43	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	429.47	313.04	239.57	119.09	42.38	0	0	0	0	123.04	289.47	445.57	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2001.62 (98)

Space heating requirement in kWh/m²/year 33.99 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	429.47	313.04	239.57	119.09	42.38	0	0	0	0	123.04	289.47	445.57	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	459.82	335.16	256.5	127.5	45.37	0	0	0	0	131.73	309.93	477.05	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2143.06 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32

Efficiency of water heater 80.3 (216)

(217)m= 87.21 | 86.8 | 86.06 | 84.61 | 82.47 | 80.3 | 80.3 | 80.3 | 80.3 | 84.57 | 86.54 | 87.34 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 202.35 | 177.59 | 186.36 | 168.13 | 167 | 151.05 | 144.72 | 161.33 | 163.11 | 176.35 | 183.98 | 197.3

Total = Sum(219a)$_{1...12}$ = 2079.27 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2143.06	
Water heating fuel used		2079.27	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		268.68	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	462.9	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	449.12	(264)
Space and water heating	(261) + (262) + (263) + (264) =			912.02	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	139.45	(268)
Total CO2, kg/year	sum of (265)…(271) =			1090.39	(272)

TER = 18.52 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 48

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.42	(1a) x	2.56	(2a) =	187.95	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.42	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.95	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.44	0.43	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.56	x1/[1/(1.4)+ 0.04]		=	7.37			(27)
Windows Type 2			3.19	x1/[1/(1.4)+ 0.04]		=	4.23			(27)
Windows Type 3			2	x1/[1/(1.4)+ 0.04]		=	2.65			(27)
Windows Type 4			2	x1/[1/(1.4)+ 0.04]		=	2.65			(27)
Walls Type1	52.48	15.94	36.54	x	0.18	=	6.58			(29)
Walls Type2	22.71	2.42	20.29	x	0.18	=	3.65			(29)
Roof	73.42	0	73.42	x	0.13	=	9.54			(30)
Total area of elements, m²			148.61							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.33 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1626.89 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.06 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 49.39 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	37.12	36.89	36.65	35.56	35.36	34.4	34.4	34.23	34.77	35.36	35.77	36.2	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	86.51	86.27	86.04	84.95	84.74	83.79	83.79	83.61	84.16	84.74	85.16	85.59	

Average = Sum(39)$_{1...12}$ /12= 84.95 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.18	1.18	1.17	1.16	1.15	1.14	1.14	1.14	1.15	1.15	1.16	1.17	

Average = Sum(40)$_{1...12}$ /12= 1.16 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.45 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	98.39	94.81	91.24	87.66	84.08	80.5	80.5	84.08	87.66	91.24	94.81	98.39	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1073.36 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	145.91	127.61	131.69	114.81	110.16	95.06	88.09	101.08	102.29	119.21	130.12	141.31	

Total = Sum(45)$_{1...12}$ = 1407.34 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.89	19.14	19.75	17.22	16.52	14.26	13.21	15.16	15.34	17.88	19.52	21.2	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.14	43.64	46.49	43.23	42.85	39.7	41.02	42.85	43.23	46.49	46.76	50.14	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	

Output from water heater (annual)$_{1...12}$ 1943.87 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.05	53.34	55.41	48.98	47.34	41.53	39.54	44.32	44.82	51.26	54.96	59.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.3	16.26	13.22	10.01	7.48	6.32	6.83	8.87	11.91	15.12	17.65	18.81	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.14	207.27	201.9	190.48	176.07	162.52	153.47	151.34	156.7	168.12	182.54	196.09	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	(71)

Water heating gains (Table 5)

(72)m=	82.06	79.38	74.47	68.03	63.63	57.68	53.15	59.57	62.25	68.9	76.33	80	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	366.39	363.8	350.49	329.41	308.07	287.41	274.34	280.68	291.75	313.03	337.41	355.79	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2	x	11.28	x	0.63	x	0.7	=	6.9	(75)
Northeast 0.9x	0.77	x	2	x	22.97	x	0.63	x	0.7	=	14.04	(75)
Northeast 0.9x	0.77	x	2	x	41.38	x	0.63	x	0.7	=	25.29	(75)
Northeast 0.9x	0.77	x	2	x	67.96	x	0.63	x	0.7	=	41.54	(75)
Northeast 0.9x	0.77	x	2	x	91.35	x	0.63	x	0.7	=	55.83	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2	x	97.38	x	0.63	x	0.7	=	59.52	(75)
Northeast 0.9x	0.77	x	2	x	91.1	x	0.63	x	0.7	=	55.68	(75)
Northeast 0.9x	0.77	x	2	x	72.63	x	0.63	x	0.7	=	44.39	(75)
Northeast 0.9x	0.77	x	2	x	50.42	x	0.63	x	0.7	=	30.82	(75)
Northeast 0.9x	0.77	x	2	x	28.07	x	0.63	x	0.7	=	17.16	(75)
Northeast 0.9x	0.77	x	2	x	14.2	x	0.63	x	0.7	=	8.68	(75)
Northeast 0.9x	0.77	x	2	x	9.21	x	0.63	x	0.7	=	5.63	(75)
Southeast 0.9x	0.77	x	5.56	x	36.79	x	0.63	x	0.7	=	62.52	(77)
Southeast 0.9x	0.77	x	3.19	x	36.79	x	0.63	x	0.7	=	71.74	(77)
Southeast 0.9x	0.77	x	5.56	x	62.67	x	0.63	x	0.7	=	106.5	(77)
Southeast 0.9x	0.77	x	3.19	x	62.67	x	0.63	x	0.7	=	122.2	(77)
Southeast 0.9x	0.77	x	5.56	x	85.75	x	0.63	x	0.7	=	145.71	(77)
Southeast 0.9x	0.77	x	3.19	x	85.75	x	0.63	x	0.7	=	167.2	(77)
Southeast 0.9x	0.77	x	5.56	x	106.25	x	0.63	x	0.7	=	180.54	(77)
Southeast 0.9x	0.77	x	3.19	x	106.25	x	0.63	x	0.7	=	207.17	(77)
Southeast 0.9x	0.77	x	5.56	x	119.01	x	0.63	x	0.7	=	202.22	(77)
Southeast 0.9x	0.77	x	3.19	x	119.01	x	0.63	x	0.7	=	232.05	(77)
Southeast 0.9x	0.77	x	5.56	x	118.15	x	0.63	x	0.7	=	200.76	(77)
Southeast 0.9x	0.77	x	3.19	x	118.15	x	0.63	x	0.7	=	230.37	(77)
Southeast 0.9x	0.77	x	5.56	x	113.91	x	0.63	x	0.7	=	193.56	(77)
Southeast 0.9x	0.77	x	3.19	x	113.91	x	0.63	x	0.7	=	222.1	(77)
Southeast 0.9x	0.77	x	5.56	x	104.39	x	0.63	x	0.7	=	177.38	(77)
Southeast 0.9x	0.77	x	3.19	x	104.39	x	0.63	x	0.7	=	203.54	(77)
Southeast 0.9x	0.77	x	5.56	x	92.85	x	0.63	x	0.7	=	157.77	(77)
Southeast 0.9x	0.77	x	3.19	x	92.85	x	0.63	x	0.7	=	181.04	(77)
Southeast 0.9x	0.77	x	5.56	x	69.27	x	0.63	x	0.7	=	117.7	(77)
Southeast 0.9x	0.77	x	3.19	x	69.27	x	0.63	x	0.7	=	135.06	(77)
Southeast 0.9x	0.77	x	5.56	x	44.07	x	0.63	x	0.7	=	74.88	(77)
Southeast 0.9x	0.77	x	3.19	x	44.07	x	0.63	x	0.7	=	85.93	(77)
Southeast 0.9x	0.77	x	5.56	x	31.49	x	0.63	x	0.7	=	53.5	(77)
Southeast 0.9x	0.77	x	3.19	x	31.49	x	0.63	x	0.7	=	61.4	(77)
Southwest 0.9x	0.77	x	2	x	36.79		0.63	x	0.7	=	22.49	(79)
Southwest 0.9x	0.77	x	2	x	62.67		0.63	x	0.7	=	38.31	(79)
Southwest 0.9x	0.77	x	2	x	85.75		0.63	x	0.7	=	52.41	(79)
Southwest 0.9x	0.77	x	2	x	106.25		0.63	x	0.7	=	64.94	(79)
Southwest 0.9x	0.77	x	2	x	119.01		0.63	x	0.7	=	72.74	(79)
Southwest 0.9x	0.77	x	2	x	118.15		0.63	x	0.7	=	72.22	(79)
Southwest 0.9x	0.77	x	2	x	113.91		0.63	x	0.7	=	69.62	(79)
Southwest 0.9x	0.77	x	2	x	104.39		0.63	x	0.7	=	63.81	(79)
Southwest 0.9x	0.77	x	2	x	92.85		0.63	x	0.7	=	56.75	(79)
Southwest 0.9x	0.77	x	2	x	69.27		0.63	x	0.7	=	42.34	(79)

TER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2	x	44.07		0.63	x	0.7	=	26.94	(79)
Southwest 0.9x	0.77	x	2	x	31.49		0.63	x	0.7	=	19.25	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	163.65	281.04	390.62	494.19	562.85	562.87	540.96	489.12	426.39	312.25	196.43	139.78	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	530.04	644.84	741.11	823.61	870.92	850.29	815.3	769.8	718.14	625.29	533.84	495.57	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.97	0.91	0.79	0.61	0.45	0.49	0.74	0.94	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.83	20.04	20.32	20.65	20.87	20.97	21	20.99	20.93	20.63	20.16	19.8	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.94	19.94	19.94	19.95	19.96	19.97	19.97	19.97	19.96	19.96	19.95	19.95	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.96	0.88	0.73	0.52	0.35	0.39	0.65	0.92	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.4	18.7	19.11	19.56	19.84	19.95	19.97	19.97	19.91	19.54	18.89	18.35	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.76	19.04	19.41	19.83	20.1	20.21	20.22	20.22	20.17	19.81	19.21	18.71	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.76	19.04	19.41	19.83	20.1	20.21	20.22	20.22	20.17	19.81	19.21	18.71	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.88	0.74	0.54	0.37	0.41	0.67	0.91	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	525.57	631.49	704.57	724.01	644.34	459.03	302.29	317.47	480.39	569.76	524.01	492.47	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1250.64	1219.72	1110.96	928.46	711.61	469.8	303.58	319.66	510.75	780.84	1031.06	1242.1	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	539.45	395.29	302.35	147.21	50.05	0	0	0	0	157.04	365.07	557.73	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2514.19 (98)

Space heating requirement in kWh/m²/year 34.24 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

TER WorkSheet: New dwelling design stage

Fraction of space heat from main system(s)	(202) = 1 – (201) =	1 (202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1 (204)
Efficiency of main space heating system 1		93.4 (206)
Efficiency of secondary/supplementary heating system, %		0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	539.45	395.29	302.35	147.21	50.05	0	0	0	0	157.04	365.07	557.73	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)	577.57	423.22	323.72	157.61	53.59	0	0	0	0	168.14	390.87	597.14	

(211)

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 2691.86 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

Output from water heater (calculated above)	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	

Efficiency of water heater 80.3 (216)

(217)m=	87.47	87.09	86.37	84.87	82.57	80.3	80.3	80.3	80.3	84.92	86.84	87.58	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	224.14	196.64	206.29	186.2	185.3	167.82	160.79	179.24	181.22	195.13	203.7	218.58	

Total = Sum(219a)$_{1...12}$ = 2305.05 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2691.86
Water heating fuel used		2305.05
Electricity for pumps, fans and electric keep-hot		
central heating pump:	30	(230c)
boiler with a fan-assisted flue	45	(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75 (231)
Electricity for lighting		323.25 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216	=	581.44 (261)
Space heating (secondary)	(215) x	0.519	=	0 (263)
Water heating	(219) x	0.216	=	497.89 (264)
Space and water heating	(261) + (262) + (263) + (264) =			1079.33 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93 (267)
Electricity for lighting	(232) x	0.519	=	167.77 (268)

TER WorkSheet: New dwelling design stage

Total CO2, kg/year	sum of (265)…(271) =	1286.02	(272)
TER =		17.52	(273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 49

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	72.68	(1a) x	2.56	(2a) =	186.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	72.68	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.38	0.38	0.33	0.33	0.32	0.35	0.38	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.29	x1/[1/(1.4)+ 0.04]		=	8.34			(27)
Windows Type 2			3.6	x1/[1/(1.4)+ 0.04]		=	4.77			(27)
Windows Type 3			2.25	x1/[1/(1.4)+ 0.04]		=	2.98			(27)
Walls Type1	55.67	15.74	39.93	x	0.18	=	7.19			(29)
Walls Type2	22.71	2.42	20.29	x	0.18	=	3.65			(29)
Roof	72.68	0	72.68	x	0.13	=	9.45			(30)
Total area of elements, m²			151.05							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.57 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1677.77 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.87 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 49.44 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	36.8	36.56	36.33	35.24	35.03	34.08	34.08	33.91	34.45	35.03	35.45	35.88	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	86.24	86	85.77	84.68	84.47	83.52	83.52	83.35	83.89	84.47	84.89	85.32	

Average = Sum(39)$_{1...12}$ /12= 84.68 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.19	1.18	1.18	1.17	1.16	1.15	1.15	1.15	1.15	1.16	1.17	1.17	

Average = Sum(40)$_{1...12}$ /12= 1.17 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.31 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.05 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	97.95	94.39	90.83	87.26	83.7	80.14	80.14	83.7	87.26	90.83	94.39	97.95	

Total = Sum(44)$_{1...12}$ = 1068.55 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	145.26	127.04	131.1	114.29	109.67	94.63	87.69	100.63	101.83	118.67	129.54	140.67	

Total = Sum(45)$_{1...12}$ = 1401.04 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.79	19.06	19.66	17.14	16.45	14.2	13.15	15.09	15.27	17.8	19.43	21.1	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.91	43.44	46.28	43.03	42.65	39.52	40.84	42.65	43.03	46.28	46.55	49.91	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59	

Output from water heater (annual)$_{1...12}$ 1935.17 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.78	53.1	55.16	48.76	47.13	41.35	39.37	44.12	44.62	51.03	54.71	59.25	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.16	16.13	13.11	9.93	7.42	6.27	6.77	8.8	11.81	15	17.5	18.66	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	203.46	205.57	200.25	188.92	174.63	161.19	152.21	150.1	155.42	166.75	181.05	194.48	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	(71)

Water heating gains (Table 5)

(72)m=	81.69	79.02	74.14	67.72	63.34	57.43	52.91	59.3	61.97	68.59	75.99	79.64	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	363.95	361.36	348.15	327.22	306.03	285.52	272.54	278.85	289.84	310.97	335.18	353.42	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.25	x	36.79	x	0.63	x	0.7	=	25.3	(79)
Southwest$_{0.9x}$	0.77	x	2.25	x	62.67	x	0.63	x	0.7	=	43.1	(79)
Southwest$_{0.9x}$	0.77	x	2.25	x	85.75	x	0.63	x	0.7	=	58.97	(79)
Southwest$_{0.9x}$	0.77	x	2.25	x	106.25	x	0.63	x	0.7	=	73.06	(79)
Southwest$_{0.9x}$	0.77	x	2.25	x	119.01	x	0.63	x	0.7	=	81.84	(79)

TER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.25	x	118.15		0.63	x	0.7	=	81.24	(79)
Southwest 0.9x	0.77	x	2.25	x	113.91		0.63	x	0.7	=	78.33	(79)
Southwest 0.9x	0.77	x	2.25	x	104.39		0.63	x	0.7	=	71.78	(79)
Southwest 0.9x	0.77	x	2.25	x	92.85		0.63	x	0.7	=	63.85	(79)
Southwest 0.9x	0.77	x	2.25	x	69.27		0.63	x	0.7	=	47.63	(79)
Southwest 0.9x	0.77	x	2.25	x	44.07		0.63	x	0.7	=	30.3	(79)
Southwest 0.9x	0.77	x	2.25	x	31.49		0.63	x	0.7	=	21.65	(79)
Northwest 0.9x	0.77	x	6.29	x	11.28	x	0.63	x	0.7	=	21.69	(81)
Northwest 0.9x	0.77	x	3.6	x	11.28	x	0.63	x	0.7	=	24.83	(81)
Northwest 0.9x	0.77	x	6.29	x	22.97	x	0.63	x	0.7	=	44.15	(81)
Northwest 0.9x	0.77	x	3.6	x	22.97	x	0.63	x	0.7	=	50.54	(81)
Northwest 0.9x	0.77	x	6.29	x	41.38	x	0.63	x	0.7	=	79.54	(81)
Northwest 0.9x	0.77	x	3.6	x	41.38	x	0.63	x	0.7	=	91.05	(81)
Northwest 0.9x	0.77	x	6.29	x	67.96	x	0.63	x	0.7	=	130.63	(81)
Northwest 0.9x	0.77	x	3.6	x	67.96	x	0.63	x	0.7	=	149.53	(81)
Northwest 0.9x	0.77	x	6.29	x	91.35	x	0.63	x	0.7	=	175.59	(81)
Northwest 0.9x	0.77	x	3.6	x	91.35	x	0.63	x	0.7	=	201	(81)
Northwest 0.9x	0.77	x	6.29	x	97.38	x	0.63	x	0.7	=	187.2	(81)
Northwest 0.9x	0.77	x	3.6	x	97.38	x	0.63	x	0.7	=	214.29	(81)
Northwest 0.9x	0.77	x	6.29	x	91.1	x	0.63	x	0.7	=	175.12	(81)
Northwest 0.9x	0.77	x	3.6	x	91.1	x	0.63	x	0.7	=	200.46	(81)
Northwest 0.9x	0.77	x	6.29	x	72.63	x	0.63	x	0.7	=	139.61	(81)
Northwest 0.9x	0.77	x	3.6	x	72.63	x	0.63	x	0.7	=	159.81	(81)
Northwest 0.9x	0.77	x	6.29	x	50.42	x	0.63	x	0.7	=	96.92	(81)
Northwest 0.9x	0.77	x	3.6	x	50.42	x	0.63	x	0.7	=	110.95	(81)
Northwest 0.9x	0.77	x	6.29	x	28.07	x	0.63	x	0.7	=	53.95	(81)
Northwest 0.9x	0.77	x	3.6	x	28.07	x	0.63	x	0.7	=	61.76	(81)
Northwest 0.9x	0.77	x	6.29	x	14.2	x	0.63	x	0.7	=	27.29	(81)
Northwest 0.9x	0.77	x	3.6	x	14.2	x	0.63	x	0.7	=	31.24	(81)
Northwest 0.9x	0.77	x	6.29	x	9.21	x	0.63	x	0.7	=	17.71	(81)
Northwest 0.9x	0.77	x	3.6	x	9.21	x	0.63	x	0.7	=	20.28	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	71.82	137.78	229.56	353.22	458.43	482.73	453.91	371.2	271.72	163.34	88.83	59.64	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	435.76	499.14	577.71	680.44	764.46	768.25	726.45	650.05	561.56	474.32	424.01	413.06	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.84	0.66	0.5	0.57	0.85	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.71	19.86	20.13	20.51	20.82	20.96	20.99	20.99	20.87	20.47	20.02	19.69	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.93	19.93	19.94	19.95	19.95	19.96	19.96	19.96	19.96	19.95	19.95	19.94	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.93	0.79	0.57	0.38	0.45	0.77	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.21	18.43	18.84	19.38	19.78	19.94	19.96	19.96	19.85	19.32	18.68	18.19	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.59	18.79	19.16	19.67	20.04	20.19	20.22	20.21	20.1	19.61	19.02	18.56	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.59	18.79	19.16	19.67	20.04	20.19	20.22	20.21	20.1	19.61	19.02	18.56	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.8	0.59	0.41	0.48	0.79	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	434.03	495.12	565.31	631.64	609.28	451.34	299.92	313.4	440.93	456.32	420.7	411.79	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1232.1	1194.62	1085.86	911.56	704.34	467.13	302.07	317.88	503.61	761.1	1011.76	1225.31	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	593.76	470.06	387.29	201.54	70.73	0	0	0	0	226.76	425.56	605.25	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2980.95 (98)

Space heating requirement in kWh/m²/year 41.02 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	593.76	470.06	387.29	201.54	70.73	0	0	0	0	226.76	425.56	605.25	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	635.72	503.28	414.66	215.78	75.72	0	0	0	0	242.78	455.63	648.02	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3191.6 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59

Efficiency of water heater 80.3 (216)

(217)m= 87.67 | 87.47 | 86.96 | 85.68 | 83.25 | 80.3 | 80.3 | 80.3 | 80.3 | 85.85 | 87.19 | 87.76 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 222.62 | 194.91 | 203.97 | 183.63 | 182.97 | 167.07 | 160.07 | 178.43 | 180.41 | 192.14 | 201.96 | 217.18

Total = Sum(219a)$_{1...12}$ = 2285.35 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		3191.6	
Water heating fuel used		2285.35	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		320.64	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	689.38	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	493.64	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1183.02	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	166.41	(268)
Total CO2, kg/year	sum of (265)…(271) =			1388.36	(272)

TER = 19.1 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 50

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	66.61	(1a) x	2.56	(2a) =	170.53	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	66.61	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		170.53	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.12 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.37 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.31 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.4	0.39	0.38	0.34	0.34	0.3	0.3	0.29	0.31	0.34	0.35	0.37

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.58	0.58	0.57	0.56	0.56	0.54	0.54	0.54	0.55	0.56	0.56	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.58	0.58	0.57	0.56	0.56	0.54	0.54	0.54	0.55	0.56	0.56	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.98	x1/[1/(1.4)+ 0.04]		=	10.58			(27)
Windows Type 2			3.13	x1/[1/(1.4)+ 0.04]		=	4.15			(27)
Walls Type1	31.65	14.24	17.41	x	0.18	=	3.13			(29)
Walls Type2	32.4	2.42	29.98	x	0.18	=	5.4			(29)
Roof	66.61	0	66.61	x	0.13	=	8.66			(30)
Total area of elements, m²			130.66							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 38.49 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1405.1 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.73 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 43.22 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	32.6	32.42	32.25	31.46	31.31	30.61	30.61	30.48	30.88	31.31	31.61	31.92	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	75.81	75.64	75.47	74.67	74.52	73.83	73.83	73.7	74.1	74.52	74.82	75.14	

Average = Sum(39)$_{1...12}$ /12= 74.67 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.14	1.14	1.13	1.12	1.12	1.11	1.11	1.11	1.11	1.12	1.12	1.13	
Average = Sum(40)$_{1...12}$ /12=													1.12 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.16 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 85.53 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	94.08	90.66	87.24	83.82	80.4	76.98	76.98	80.4	83.82	87.24	90.66	94.08	
Total = Sum(44)$_{1...12}$ =													1026.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	139.52	122.03	125.92	109.78	105.34	90.9	84.23	96.65	97.81	113.99	124.43	135.12	
Total = Sum(45)$_{1...12}$ =													1345.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	20.93	18.3	18.89	16.47	15.8	13.63	12.63	14.5	14.67	17.1	18.66	20.27	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)
If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.94	41.73	44.46	41.34	40.97	37.96	39.23	40.97	41.34	44.46	44.71	47.94	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06	

Output from water heater (annual)$_{1...12}$ 1858.74 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	58.38	51.01	52.98	46.84	45.27	39.71	37.81	42.38	42.86	49.01	52.55	56.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.9	15.01	12.21	9.24	6.91	5.83	6.3	8.19	11	13.96	16.29	17.37	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	189.27	191.24	186.29	175.75	162.45	149.95	141.6	139.63	144.58	155.12	168.42	180.92	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	(71)

Water heating gains (Table 5)

(72)m=	78.46	75.9	71.21	65.05	60.84	55.16	50.82	56.96	59.52	65.88	72.98	76.5	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	343.05	340.57	328.13	308.46	288.62	269.36	257.14	263.21	273.52	293.38	316.12	333.21	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.98	x	11.28	x	0.63	x	0.7	=	27.52	(81)
Northwest 0.9x	0.77	x	3.13	x	11.28	x	0.63	x	0.7	=	21.59	(81)
Northwest 0.9x	0.77	x	7.98	x	22.97	x	0.63	x	0.7	=	56.01	(81)
Northwest 0.9x	0.77	x	3.13	x	22.97	x	0.63	x	0.7	=	43.94	(81)
Northwest 0.9x	0.77	x	7.98	x	41.38	x	0.63	x	0.7	=	100.91	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.13	x	41.38	x	0.63	x	0.7	=	79.16	(81)
Northwest 0.9x	0.77	x	7.98	x	67.96	x	0.63	x	0.7	=	165.73	(81)
Northwest 0.9x	0.77	x	3.13	x	67.96	x	0.63	x	0.7	=	130.01	(81)
Northwest 0.9x	0.77	x	7.98	x	91.35	x	0.63	x	0.7	=	222.77	(81)
Northwest 0.9x	0.77	x	3.13	x	91.35	x	0.63	x	0.7	=	174.76	(81)
Northwest 0.9x	0.77	x	7.98	x	97.38	x	0.63	x	0.7	=	237.5	(81)
Northwest 0.9x	0.77	x	3.13	x	97.38	x	0.63	x	0.7	=	186.31	(81)
Northwest 0.9x	0.77	x	7.98	x	91.1	x	0.63	x	0.7	=	222.18	(81)
Northwest 0.9x	0.77	x	3.13	x	91.1	x	0.63	x	0.7	=	174.29	(81)
Northwest 0.9x	0.77	x	7.98	x	72.63	x	0.63	x	0.7	=	177.12	(81)
Northwest 0.9x	0.77	x	3.13	x	72.63	x	0.63	x	0.7	=	138.95	(81)
Northwest 0.9x	0.77	x	7.98	x	50.42	x	0.63	x	0.7	=	122.97	(81)
Northwest 0.9x	0.77	x	3.13	x	50.42	x	0.63	x	0.7	=	96.46	(81)
Northwest 0.9x	0.77	x	7.98	x	28.07	x	0.63	x	0.7	=	68.45	(81)
Northwest 0.9x	0.77	x	3.13	x	28.07	x	0.63	x	0.7	=	53.7	(81)
Northwest 0.9x	0.77	x	7.98	x	14.2	x	0.63	x	0.7	=	34.62	(81)
Northwest 0.9x	0.77	x	3.13	x	14.2	x	0.63	x	0.7	=	27.16	(81)
Northwest 0.9x	0.77	x	7.98	x	9.21	x	0.63	x	0.7	=	22.47	(81)
Northwest 0.9x	0.77	x	3.13	x	9.21	x	0.63	x	0.7	=	17.63	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	49.1	99.95	180.08	295.74	397.53	423.81	396.47	316.07	219.43	122.15	61.78	40.1	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	392.16	440.52	508.2	604.2	686.15	693.17	653.61	579.27	492.94	415.53	377.9	373.3	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.84	0.65	0.49	0.57	0.85	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.76	19.9	20.16	20.54	20.84	20.97	20.99	20.99	20.87	20.48	20.06	19.74	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.97	19.97	19.97	19.98	19.99	19.99	19.99	20	19.99	19.99	19.98	19.98	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.94	0.79	0.56	0.38	0.45	0.78	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.32	18.52	18.9	19.44	19.83	19.97	19.99	19.99	19.89	19.37	18.76	18.29	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.72	18.9	19.25	19.74	20.1	20.25	20.27	20.26	20.16	19.67	19.12	18.69	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.72	18.9	19.25	19.74	20.1	20.25	20.27	20.26	20.16	19.67	19.12	18.69	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.8	0.58	0.41	0.49	0.8	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	390.76	437.5	498.68	563.21	546.64	404.34	269.02	281.05	392.34	401.71	375.3	372.26	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1092.94	1058.73	962.19	809.53	626.35	416.82	270.68	284.74	448.69	676.25	899.21	1088.73	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	522.42	417.47	344.85	177.35	59.3	0	0	0	0	204.26	377.21	533.05	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2635.91 (98)

Space heating requirement in kWh/m²/year 39.57 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	522.42	417.47	344.85	177.35	59.3	0	0	0	0	204.26	377.21	533.05	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	559.34	446.97	369.22	189.88	63.49	0	0	0	0	218.69	403.87	570.72	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2822.18 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06

Efficiency of water heater 80.3 (216)

(217)m=	87.49	87.31	86.79	85.46	82.97	80.3	80.3	80.3	80.3	85.69	87.01	87.58	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	214.26	187.56	196.31	176.84	176.33	160.47	153.74	171.39	173.28	184.9	194.38	209.01	

Total = Sum(219a)$_{1...12}$ = 2198.47 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2822.18

TER WorkSheet: New dwelling design stage

Water heating fuel used		2198.47	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		298.48	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	609.59	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	474.87	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1084.46	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	154.91	(268)
Total CO2, kg/year		sum of (265)…(271) =			1278.29	(272)

TER = 19.19 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 51

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.61	(1a) x	2.56	(2a) =	132.12	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.61	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		132.12	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.43	0.43	0.42	0.38	0.37	0.32	0.32	0.32	0.34	0.37	0.38	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	25.19	9.48	15.71	x	0.18	=	2.83			(29)
Walls Type2	25.13	2.42	22.71	x	0.18	=	4.09			(29)
Roof	51.61	0	51.61	x	0.13	=	6.71			(30)
Total area of elements, m²			101.93							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 28.61 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1117.59 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.27 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 32.88 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.92	25.76	25.61	24.87	24.73	24.09	24.09	23.97	24.34	24.73	25.01	25.3	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	58.8	58.64	58.48	57.75	57.61	56.97	56.97	56.85	57.21	57.61	57.89	58.18	

Average = Sum(39)$_{1...12}$ /12= 57.75 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.14	1.14	1.13	1.12	1.12	1.1	1.1	1.1	1.11	1.12	1.12	1.13

Average = Sum(40)$_{1...12}$ /12= 1.12 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.47 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	83.01	79.99	76.98	73.96	70.94	67.92	67.92	70.94	73.96	76.98	79.99	83.01

Total = Sum(44)$_{1...12}$ = 905.59 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	123.1	107.67	111.1	96.86	92.94	80.2	74.32	85.28	86.3	100.58	109.79	119.22

Total = Sum(45)$_{1...12}$ = 1187.37 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.47	16.15	16.67	14.53	13.94	12.03	11.15	12.79	12.95	15.09	16.47	17.88

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.3	36.82	39.23	36.47	36.15	33.49	34.61	36.15	36.47	39.23	39.45	42.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52	

Output from water heater (annual)$_{1...12}$ 1640.04 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.51	45	46.75	41.32	39.94	35.04	33.36	37.39	37.81	43.25	46.37	50.22	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.74	12.21	9.93	7.52	5.62	4.74	5.12	6.66	8.94	11.35	13.25	14.13	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.41	152.98	149.02	140.59	129.95	119.95	113.27	111.7	115.66	124.09	134.73	144.73	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	(71)

Water heating gains (Table 5)

(72)m=	69.23	66.97	62.83	57.4	53.68	48.67	44.84	50.26	52.52	58.13	64.4	67.5	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	286.45	284.22	273.84	257.57	241.32	225.43	215.3	220.68	229.18	245.63	264.44	278.41	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	10.9	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	21.79	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	22.18	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	44.36	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	39.96	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	79.92	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	65.63	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	131.25	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	88.22	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	176.43	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	94.05	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	188.1	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	87.98	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	175.96	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	70.14	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	140.28	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	48.69	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	97.39	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	27.11	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	54.21	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	13.71	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	27.42	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	8.9	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	17.8	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	32.69	66.54	119.88	196.88	264.65	282.14	263.94	210.42	146.08	81.32	41.13	26.7	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	319.13	350.76	393.73	454.45	505.96	507.57	479.24	431.1	375.26	326.95	305.57	305.11	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.86	0.68	0.51	0.59	0.86	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.79	19.91	20.16	20.52	20.82	20.96	20.99	20.99	20.87	20.49	20.08	19.77	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.97	19.97	19.97	19.99	19.99	20	20	20	19.99	19.99	19.98	19.98	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.99	0.94	0.81	0.59	0.4	0.47	0.79	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.36	18.54	18.9	19.42	19.81	19.97	19.99	19.99	19.88	19.39	18.8	18.34	(90)

fLA = Living area ÷ (4) = 0.35 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.86	19.03	19.35	19.81	20.17	20.32	20.35	20.34	20.23	19.78	19.25	18.84	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.86	19.03	19.35	19.81	20.17	20.32	20.35	20.34	20.23	19.78	19.25	18.84	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.94	0.82	0.62	0.44	0.51	0.81	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	317.78	348.16	386.58	427.1	415.66	313.47	211.7	220.57	303.44	315.86	303.15	304.07	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	856.41	828.45	751.48	629.87	487.67	325.97	213.49	224.22	350.83	528.66	703.54	851.96	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	400.74	322.75	271.48	146	53.57	0	0	0	0	158.33	288.28	407.63	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2048.78 (98)

Space heating requirement in kWh/m²/year 39.7 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	400.74	322.75	271.48	146	53.57	0	0	0	0	158.33	288.28	407.63	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	429.06	345.56	290.66	156.31	57.36	0	0	0	0	169.51	308.65	436.43	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2193.55 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52

Efficiency of water heater 80.3 (216)

(217)m=	87.2	87.02	86.52	85.28	83.02	80.3	80.3	80.3	80.3	85.37	86.68	87.28	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.7	166.05	173.75	156.35	155.49	141.59	135.65	151.22	152.89	163.77	172.17	185.05	

Total = Sum(219a)$_{1...12}$ = 1943.68 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2193.55

TER WorkSheet: New dwelling design stage

Water heating fuel used		1943.68	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		242.71	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	473.81	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	419.84	(264)
Space and water heating	(261) + (262) + (263) + (264) =				893.64	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	125.97	(268)
Total CO2, kg/year	sum of (265)…(271) =				1058.53	(272)

TER = 20.51 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 52

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.63	(1a) x	2.56	(2a) =	129.62	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.62	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	24.86	9.48	15.38	x	0.18	=	2.77			(29)
Walls Type2	19.11	2.42	16.69	x	0.18	=	3			(29)
Roof	50.63	0	50.63	x	0.13	=	6.58			(30)
Total area of elements, m²			94.6							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 27.34 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1000.85 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.32 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 31.66 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.49	25.33	25.18	24.44	24.31	23.67	23.67	23.55	23.91	24.31	24.58	24.87	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	57.16	57	56.84	56.11	55.97	55.33	55.33	55.21	55.58	55.97	56.25	56.54	

Average = Sum(39)$_{1...12}$ /12= 56.11 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.13	1.13	1.12	1.11	1.11	1.09	1.09	1.09	1.1	1.11	1.11	1.12

Average = Sum(40)$_{1...12}$ /12= 1.11 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.71 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.78 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.26	79.27	76.28	73.29	70.29	67.3	67.3	70.29	73.29	76.28	79.27	82.26

Total = Sum(44)$_{1...12}$ = 897.38 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.99	106.69	110.1	95.98	92.1	79.48	73.65	84.51	85.52	99.66	108.79	118.14

Total = Sum(45)$_{1...12}$ = 1176.6 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.3	16	16.51	14.4	13.81	11.92	11.05	12.68	12.83	14.95	16.32	17.72

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.92	36.49	38.87	36.14	35.82	33.19	34.3	35.82	36.14	38.87	39.09	41.92	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06	

Output from water heater (annual)$_{1...12}$ 1625.17 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.04	44.6	46.32	40.95	39.58	34.72	33.06	37.05	37.47	42.86	45.95	49.76	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.48	11.97	9.73	7.37	5.51	4.65	5.02	6.53	8.77	11.13	12.99	13.85	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.87	150.42	146.52	138.24	127.78	117.94	111.37	109.83	113.72	122.01	132.47	142.3	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	(71)

Water heating gains (Table 5)

(72)m=	68.6	66.36	62.26	56.88	53.2	48.23	44.44	49.8	52.04	57.6	63.81	66.88	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	282.58	280.38	270.15	254.11	238.11	222.45	212.47	217.8	226.16	242.37	260.91	274.67	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	10.9	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	21.79	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	22.18	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	44.36	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	39.96	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	79.92	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	65.63	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	131.25	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	88.22	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	176.43	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	94.05	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	188.1	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	87.98	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	175.96	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	70.14	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	140.28	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	48.69	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	97.39	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	27.11	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	54.21	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	13.71	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	27.42	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	8.9	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	17.8	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	32.69	66.54	119.88	196.88	264.65	282.14	263.94	210.42	146.08	81.32	41.13	26.7	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	315.27	346.92	390.04	450.99	502.76	504.59	476.41	428.21	372.24	323.69	302.04	301.36	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.85	0.66	0.5	0.58	0.85	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.81	19.93	20.18	20.54	20.83	20.97	20.99	20.99	20.88	20.5	20.1	19.79	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.98	19.98	19.98	19.99	20	20.01	20.01	20.01	20	20	19.99	19.99	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.94	0.8	0.58	0.39	0.46	0.78	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.39	18.58	18.94	19.45	19.83	19.98	20	20	19.9	19.41	18.83	18.37	(90)

fLA = Living area ÷ (4) = 0.36 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.9	19.07	19.39	19.84	20.19	20.34	20.36	20.36	20.25	19.81	19.29	18.88	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.9	19.07	19.39	19.84	20.19	20.34	20.36	20.36	20.25	19.81	19.29	18.88	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.94	0.81	0.61	0.43	0.5	0.8	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	313.9	344.27	382.66	422.52	409.18	306.46	206.54	215.34	298.36	312.26	299.58	300.32	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	834.59	807.38	732.49	613.93	475.2	317.48	208.09	218.52	341.93	515.29	685.52	830.03	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	387.39	311.21	260.28	137.82	49.12	0	0	0	0	151.05	277.88	394.11	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1968.86 (98)

Space heating requirement in kWh/m²/year 38.89 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	387.39	311.21	260.28	137.82	49.12	0	0	0	0	151.05	277.88	394.11	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	414.77	333.2	278.67	147.56	52.59	0	0	0	0	161.73	297.52	421.96	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2107.99 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06

Efficiency of water heater 80.3 (216)

(217)m=	87.14	86.95	86.44	85.16	82.87	80.3	80.3	80.3	80.3	85.27	86.62	87.23	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	188.09	164.66	172.33	155.15	154.37	140.31	134.42	149.85	151.51	162.47	170.73	183.49	

Total = Sum(219a)$_{1...12}$ = 1927.38 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2107.99

TER WorkSheet: New dwelling design stage

Water heating fuel used			1927.38	
Electricity for pumps, fans and electric keep-hot				
central heating pump:		30		(230c)
boiler with a fan-assisted flue		45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		75	(231)
Electricity for lighting			237.98	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	455.33	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	416.31	(264)
Space and water heating	(261) + (262) + (263) + (264) =				871.64	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	123.51	(268)
Total CO2, kg/year	sum of (265)…(271) =				1034.07	(272)

TER = 20.42 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 53

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.03	(1a) x	2.56	(2a) =	130.63	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.03	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.63	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	25.06	9.48	15.58	x	0.18	=	2.8			(29)
Walls Type2	19.31	2.42	16.89	x	0.18	=	3.04			(29)
Roof	50.03	0	50.03	x	0.13	=	6.5			(30)
Total area of elements, m²			94.4							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 27.34 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1002.21 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.34 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 31.68 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.67	25.51	25.35	24.62	24.48	23.84	23.84	23.72	24.08	24.48	24.76	25.05	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	57.35	57.19	57.03	56.29	56.16	55.52	55.52	55.4	55.76	56.16	56.43	56.73	

Average = Sum(39)$_{1...12}$ /12= 56.29 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.12	1.12	1.12	1.1	1.1	1.09	1.09	1.09	1.09	1.1	1.11	1.11

Average = Sum(40)$_{1...12}$ /12= 1.1 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.06 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.56	79.56	76.56	73.56	70.55	67.55	67.55	70.55	73.56	76.56	79.56	82.56

Total = Sum(44)$_{1...12}$ = 900.7 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.44	107.09	110.5	96.34	92.44	79.77	73.92	84.82	85.83	100.03	109.19	118.58

Total = Sum(45)$_{1...12}$ = 1180.95 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.37	16.06	16.58	14.45	13.87	11.97	11.09	12.72	12.88	15	16.38	17.79

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.07	36.62	39.01	36.27	35.95	33.31	34.42	35.95	36.27	39.01	39.24	42.07	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65	

Output from water heater (annual)$_{1...12}$ 1631.18 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.23	44.76	46.5	41.1	39.72	34.85	33.18	37.19	37.61	43.01	46.12	49.95	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.58	12.06	9.81	7.43	5.55	4.69	5.07	6.58	8.84	11.22	13.1	13.96	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.9	151.45	147.53	139.19	128.66	118.76	112.14	110.59	114.51	122.85	133.38	143.28	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	(71)

Water heating gains (Table 5)

(72)m=	68.86	66.61	62.49	57.09	53.39	48.4	44.6	49.99	52.23	57.81	64.05	67.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	284.14	281.93	271.65	255.51	239.41	223.65	213.61	218.96	227.38	243.69	262.33	276.18	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	10.9	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	21.79	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	22.18	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	44.36	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	39.96	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	79.92	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	65.63	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	131.25	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	88.22	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	176.43	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	94.05	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	188.1	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	87.98	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	175.96	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	70.14	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	140.28	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	48.69	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	97.39	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	27.11	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	54.21	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	13.71	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	27.42	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	8.9	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	17.8	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	32.69	66.54	119.88	196.88	264.65	282.14	263.94	210.42	146.08	81.32	41.13	26.7	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	316.83	348.47	391.53	452.39	504.06	505.8	477.55	429.38	373.46	325.01	303.47	302.88	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.85	0.67	0.5	0.58	0.85	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.81	19.94	20.19	20.54	20.83	20.97	20.99	20.99	20.88	20.51	20.11	19.79	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.98	19.98	19.99	20	20	20.01	20.01	20.01	20.01	20	20	19.99	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.94	0.8	0.58	0.39	0.46	0.78	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.4	18.59	18.95	19.46	19.84	19.99	20.01	20.01	19.91	19.42	18.84	18.38	(90)

fLA = Living area ÷ (4) = 0.36 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.91	19.07	19.39	19.84	20.19	20.34	20.36	20.36	20.25	19.81	19.29	18.89	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.91	19.07	19.39	19.84	20.19	20.34	20.36	20.36	20.25	19.81	19.29	18.89	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.94	0.81	0.61	0.43	0.5	0.8	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	315.47	345.84	384.2	424.05	410.65	307.54	207.24	216.08	299.53	313.61	301.02	301.84	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	837.6	810.27	735.07	616.04	476.8	318.54	208.77	219.25	343.09	517.1	687.99	833.04	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	388.47	312.1	261.05	138.23	49.22	0	0	0	0	151.4	278.62	395.22	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1974.3 (98)

Space heating requirement in kWh/m²/year 38.69 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	388.47	312.1	261.05	138.23	49.22	0	0	0	0	151.4	278.62	395.22	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	415.92	334.15	279.49	148	52.7	0	0	0	0	162.1	298.31	423.15	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2113.81 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65

Efficiency of water heater 80.3 (216)

(217)m=	87.14	86.95	86.44	85.16	82.87	80.3	80.3	80.3	80.3	85.27	86.61	87.23	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	188.79	165.27	172.97	155.73	154.94	140.82	134.92	150.41	152.07	163.07	171.37	184.17	

Total = Sum(219a)$_{1...12}$ = 1934.54 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2113.81

TER WorkSheet: New dwelling design stage

Water heating fuel used		1934.54	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		239.88	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	456.58	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	417.86	(264)
Space and water heating	(261) + (262) + (263) + (264) =				874.44	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	124.5	(268)
Total CO2, kg/year		sum of (265)…(271) =			1037.87	(272)

TER = 20.34 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 54

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.86	(1a) x	2.56	(2a) =	183.97	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.86	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.97	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.39	0.38	0.33	0.33	0.32	0.35	0.38	0.4	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	36.57	12.64	23.93	x	0.18	=	4.31			(29)
Walls Type2	26	2.42	23.58	x	0.18	=	4.24			(29)
Roof	71.86	0	71.86	x	0.13	=	9.34			(30)
Total area of elements, m²			134.43							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 37.07 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1454.36 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.54 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 42.61 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	36.44	36.2	35.97	34.88	34.68	33.73	33.73	33.56	34.1	34.68	35.09	35.52	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	79.05	78.81	78.58	77.49	77.29	76.34	76.34	76.17	76.71	77.29	77.7	78.13	

Average = Sum(39)$_{1...12}$ /12= 77.49 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.1	1.1	1.09	1.08	1.08	1.06	1.06	1.06	1.07	1.08	1.08	1.09

Average = Sum(40)$_{1...12}$ /12= 1.08 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.6 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	97.46	93.91	90.37	86.83	83.28	79.74	79.74	83.28	86.83	90.37	93.91	97.46

Total = Sum(44)$_{1...12}$ = 1063.18 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	144.53	126.41	130.44	113.72	109.12	94.16	87.25	100.12	101.32	118.08	128.89	139.97

Total = Sum(45)$_{1...12}$ = 1394 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.68	18.96	19.57	17.06	16.37	14.12	13.09	15.02	15.2	17.71	19.33	21

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.66	43.23	46.05	42.82	42.44	39.32	40.63	42.44	42.82	46.05	46.31	49.66	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63	

Output from water heater (annual)$_{1...12}$ 1925.45 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.47	52.84	54.88	48.52	46.89	41.14	39.17	43.9	44.39	50.77	54.43	58.96	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.43	16.37	13.31	10.08	7.53	6.36	6.87	8.93	11.99	15.22	17.77	18.94	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.6	203.7	198.42	187.2	173.03	159.72	150.82	148.73	154	165.23	179.39	192.71	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	(71)

Water heating gains (Table 5)

(72)m=	81.28	78.63	73.77	67.38	63.03	57.14	52.65	59.01	61.66	68.24	75.6	79.24	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	361.67	359.04	345.86	325.02	303.95	283.57	270.7	277.03	288.01	309.05	333.12	351.24	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	21.79	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.63	x	0.7	=	21.79	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	44.36	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.63	x	0.7	=	44.36	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	79.92	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.63	x	0.7	=	79.92	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	131.25	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.63	x	0.7	=	131.25	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	176.43	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.63	x	0.7	=	176.43	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	188.1	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.63	x	0.7	=	188.1	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	175.96	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.63	x	0.7	=	175.96	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	140.28	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.63	x	0.7	=	140.28	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	97.39	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.63	x	0.7	=	97.39	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	54.21	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.63	x	0.7	=	54.21	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	27.42	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.63	x	0.7	=	27.42	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	17.8	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.63	x	0.7	=	17.8	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	43.59	88.72	159.84	262.51	352.86	376.19	351.92	280.55	194.77	108.42	54.84	35.59	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	405.25	447.76	505.7	587.53	656.81	659.76	622.62	557.58	482.78	417.47	387.96	386.84	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.97	0.88	0.7	0.53	0.61	0.88	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.79	19.91	20.16	20.51	20.81	20.96	20.99	20.98	20.86	20.48	20.08	19.78	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20	20	20.01	20.02	20.02	20.03	20.03	20.03	20.03	20.02	20.02	20.01	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.95	0.83	0.61	0.42	0.49	0.82	0.98	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.38	18.56	18.92	19.43	19.83	20.01	20.03	20.03	19.91	19.4	18.82	18.37	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.74	18.91	19.24	19.71	20.08	20.25	20.27	20.27	20.15	19.67	19.14	18.72	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.74	18.91	19.24	19.71	20.08	20.25	20.27	20.27	20.15	19.67	19.14	18.72	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.99	0.95	0.84	0.63	0.45	0.52	0.83	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	404.06	445.36	498.57	557.44	548.79	414.78	278.28	290.18	398.37	406.26	385.78	385.95	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1141.62	1103.97	1000.72	837.52	647.83	431.18	280.44	294.8	464.14	701.3	935.55	1134.83	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	548.74	442.58	373.59	201.65	73.68	0	0	0	0	219.51	395.83	557.17	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2812.77 (98)

Space heating requirement in kWh/m²/year 39.14 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	548.74	442.58	373.59	201.65	73.68	0	0	0	0	219.51	395.83	557.17	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	587.52	473.86	399.99	215.9	78.89	0	0	0	0	235.02	423.8	596.54	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3011.53 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63

Efficiency of water heater 80.3 (216)

(217)m=	87.52	87.36	86.89	85.69	83.35	80.3	80.3	80.3	80.3	85.78	87.04	87.6	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	221.88	194.19	203.11	182.68	181.84	166.23	159.26	177.54	179.5	191.33	201.29	216.47	

Total = Sum(219a)$_{1...12}$ = 2275.31 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		3011.53

TER WorkSheet: New dwelling design stage

Water heating fuel used		2275.31	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		325.42	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	650.49	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	491.47	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1141.96	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	168.89	(268)
Total CO2, kg/year		sum of (265)…(271) =			1349.78	(272)

TER = 18.78 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 55

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	91.9	(1a) x	2.56	(2a) =	235.26	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	91.9	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		235.26	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.13 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.38 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.32 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.41	0.4	0.39	0.35	0.34	0.3	0.3	0.3	0.32	0.34	0.36	0.38

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.58	0.58	0.58	0.56	0.56	0.55	0.55	0.54	0.55	0.56	0.57	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.58	0.58	0.58	0.56	0.56	0.55	0.55	0.54	0.55	0.56	0.57	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²	U-value W/m2K	A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04] =	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04] =	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04] =	3.83			(27)
Floor			91.9	x 0.13 =	11.947			(28)
Walls	82.84	22.77	60.07	x 0.18 =	10.81			(29)
Total area of elements, m²			174.74					(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 52.95 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11130.17 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 10.83 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 63.78 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	45.32	45.06	44.82	43.66	43.44	42.43	42.43	42.24	42.82	43.44	43.88	44.34	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	109.1	108.84	108.6	107.44	107.22	106.21	106.21	106.02	106.6	107.22	107.66	108.12	

Average = Sum(39)$_{1...12}$ /12= 107.43 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.19	1.18	1.18	1.17	1.17	1.16	1.16	1.15	1.16	1.17	1.17	1.18

Average = Sum(40)$_{1...12}$ /12= 1.17 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.65 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 97.16 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	106.87	102.99	99.1	95.21	91.33	87.44	87.44	91.33	95.21	99.1	102.99	106.87

Total = Sum(44)$_{1...12}$ = 1165.89 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	158.49	138.62	143.04	124.71	119.66	103.26	95.68	109.8	111.11	129.48	141.34	153.49

Total = Sum(45)$_{1...12}$ = 1528.67 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.77	20.79	21.46	18.71	17.95	15.49	14.35	16.47	16.67	19.42	21.2	23.02

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.5	46.96	46.54	43.12	44.56	46.54	46.96	50.5	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	209.45	184.64	193.54	171.66	166.2	146.38	140.24	156.34	158.06	179.99	190.66	204.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	209.45	184.64	193.54	171.66	166.2	146.38	140.24	156.34	158.06	179.99	190.66	204.45	

Output from water heater (annual)$_{1...12}$ 2101.6 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	65.44	57.6	60.19	53.2	51.42	45.11	42.95	48.14	48.68	55.68	59.33	63.77	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.62	19.2	15.62	11.82	8.84	7.46	8.06	10.48	14.07	17.86	20.85	22.22	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	242.53	245.05	238.7	225.2	208.16	192.14	181.44	178.92	185.27	198.77	215.81	231.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	(71)

Water heating gains (Table 5)

(72)m=	87.95	85.71	80.89	73.89	69.11	62.66	57.73	64.71	67.61	74.84	82.4	85.72	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	417.87	415.72	400.98	376.68	351.88	328.02	313	319.87	332.71	357.23	384.82	405.53	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.63	x	0.7	=	19.93	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.63	x	0.7	=	40.57	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.63	x	0.7	=	73.09	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.63	x	0.7	=	120.04	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.63	x	0.7	=	161.36	(75)

TER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	2.89	x	97.38	x	0.63	x	0.7	=	172.02	(75)
Northeast	0.9x	0.77	x	2.89	x	91.1	x	0.63	x	0.7	=	160.93	(75)
Northeast	0.9x	0.77	x	2.89	x	72.63	x	0.63	x	0.7	=	128.29	(75)
Northeast	0.9x	0.77	x	2.89	x	50.42	x	0.63	x	0.7	=	89.07	(75)
Northeast	0.9x	0.77	x	2.89	x	28.07	x	0.63	x	0.7	=	49.58	(75)
Northeast	0.9x	0.77	x	2.89	x	14.2	x	0.63	x	0.7	=	25.08	(75)
Northeast	0.9x	0.77	x	2.89	x	9.21	x	0.63	x	0.7	=	16.28	(75)
Southeast	0.9x	0.77	x	7.75	x	36.79	x	0.63	x	0.7	=	87.15	(77)
Southeast	0.9x	0.77	x	4.62	x	36.79	x	0.63	x	0.7	=	103.9	(77)
Southeast	0.9x	0.77	x	7.75	x	62.67	x	0.63	x	0.7	=	148.44	(77)
Southeast	0.9x	0.77	x	4.62	x	62.67	x	0.63	x	0.7	=	176.98	(77)
Southeast	0.9x	0.77	x	7.75	x	85.75	x	0.63	x	0.7	=	203.11	(77)
Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.63	x	0.7	=	242.15	(77)
Southeast	0.9x	0.77	x	7.75	x	106.25	x	0.63	x	0.7	=	251.66	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.63	x	0.7	=	300.04	(77)
Southeast	0.9x	0.77	x	7.75	x	119.01	x	0.63	x	0.7	=	281.88	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.63	x	0.7	=	336.07	(77)
Southeast	0.9x	0.77	x	7.75	x	118.15	x	0.63	x	0.7	=	279.84	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.63	x	0.7	=	333.64	(77)
Southeast	0.9x	0.77	x	7.75	x	113.91	x	0.63	x	0.7	=	269.79	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.63	x	0.7	=	321.66	(77)
Southeast	0.9x	0.77	x	7.75	x	104.39	x	0.63	x	0.7	=	247.25	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.63	x	0.7	=	294.78	(77)
Southeast	0.9x	0.77	x	7.75	x	92.85	x	0.63	x	0.7	=	219.92	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.63	x	0.7	=	262.2	(77)
Southeast	0.9x	0.77	x	7.75	x	69.27	x	0.63	x	0.7	=	164.06	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.63	x	0.7	=	195.6	(77)
Southeast	0.9x	0.77	x	7.75	x	44.07	x	0.63	x	0.7	=	104.38	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.63	x	0.7	=	124.45	(77)
Southeast	0.9x	0.77	x	7.75	x	31.49	x	0.63	x	0.7	=	74.58	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.63	x	0.7	=	88.92	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	210.98	365.99	518.35	671.74	779.3	785.5	752.38	670.32	571.19	409.24	253.91	179.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	628.85	781.72	919.33	1048.42	1131.18	1113.53	1065.38	990.2	903.9	766.47	638.72	585.31	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.97	0.91	0.78	0.59	0.43	0.49	0.74	0.95	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.79	20.01	20.31	20.65	20.88	20.98	21	20.99	20.93	20.6	20.12	19.75	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.93	19.93	19.93	19.94	19.95	19.96	19.96	19.96	19.95	19.95	19.94	19.94	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.96	0.88	0.72	0.5	0.33	0.38	0.65	0.92	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.33	18.65	19.08	19.55	19.84	19.94	19.95	19.95	19.9	19.51	18.82	18.27	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.65	18.94	19.35	19.79	20.07	20.17	20.18	20.18	20.13	19.75	19.11	18.6	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.65	18.94	19.35	19.79	20.07	20.17	20.18	20.18	20.13	19.75	19.11	18.6	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.87	0.72	0.52	0.36	0.4	0.67	0.92	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	624.51	767.24	875.28	916.75	818.75	579.52	379.19	398.51	603.7	702.61	628.73	582.37	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1565.27	1528.71	1395.11	1170.11	897.01	591.46	380.6	401.1	642.55	980.79	1292.82	1556.64	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	699.92	511.7	386.75	182.42	58.23	0	0	0	0	206.97	478.14	724.85	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3248.99 (98)

Space heating requirement in kWh/m²/year 35.35 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	699.92	511.7	386.75	182.42	58.23	0	0	0	0	206.97	478.14	724.85	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	749.38	547.86	414.08	195.31	62.34	0	0	0	0	221.6	511.93	776.07	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3478.57 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	209.45	184.64	193.54	171.66	166.2	146.38	140.24	156.34	158.06	179.99	190.66	204.45

Efficiency of water heater 80.3 (216)

(217)m=	87.85	87.48	86.76	85.2	82.7	80.3	80.3	80.3	80.3	85.4	87.27	87.97

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	238.4	211.06	223.07	201.47	200.97	182.29	174.65	194.69	196.84	210.75	218.47	232.42

Total = Sum(219a)$_{1...12}$ = 2485.08 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		3478.57	
Water heating fuel used		2485.08	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		381.85	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	751.37	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	536.78	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1288.15	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	198.18	(268)
Total CO2, kg/year	sum of (265)…(271) =			1525.25	(272)

TER = 16.6 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 56

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	65.29	(1a) x	2.56	(2a) =	167.14	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	65.29	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		167.14	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.12 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.37 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.31 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.4	0.39	0.38	0.35	0.34	0.3	0.3	0.29	0.31	0.34	0.35	0.37

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.58	0.58	0.57	0.56	0.56	0.54	0.54	0.54	0.55	0.56	0.56	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.58	0.58	0.57	0.56	0.56	0.54	0.54	0.54	0.55	0.56	0.56	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.06	x1/[1/(1.4)+ 0.04]		=	9.36			(27)
Windows Type 2			4.21	x1/[1/(1.4)+ 0.04]		=	5.58			(27)
Windows Type 3			2.63	x1/[1/(1.4)+ 0.04]		=	3.49			(27)
Floor			65.29	x	0.13	=	8.4877			(28)
Walls Type1	43.35	13.9	29.45	x	0.18	=	5.3			(29)
Walls Type2	25.26	2.42	22.84	x	0.18	=	4.11			(29)
Total area of elements, m²			133.9							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 38.75 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8070.85 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.06 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 42.81 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	32	31.83	31.66	30.87	30.72	30.04	30.04	29.91	30.3	30.72	31.02	31.34	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	74.81	74.64	74.47	73.68	73.53	72.85	72.85	72.72	73.11	73.53	73.83	74.15	

Average = Sum(39)$_{1...12}$ /12= 73.68 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.15	1.14	1.14	1.13	1.13	1.12	1.12	1.11	1.12	1.13	1.13	1.14	

Average = Sum(40)$_{1...12}$ /12= 1.13 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.13 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 84.71 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	93.18	89.79	86.4	83.01	79.62	76.24	76.24	79.62	83.01	86.4	89.79	93.18	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1016.48 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	138.18	120.85	124.71	108.72	104.32	90.02	83.42	95.73	96.87	112.89	123.23	133.82	

Total = Sum(45)$_{1...12}$ = 1332.76 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	20.73	18.13	18.71	16.31	15.65	13.5	12.51	14.36	14.53	16.93	18.48	20.07	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.48	41.33	44.03	40.94	40.58	37.6	38.85	40.58	40.94	44.03	44.28	47.48	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	185.66	162.18	168.74	149.66	144.9	127.62	122.27	136.3	137.81	156.92	167.51	181.3	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	185.66	162.18	168.74	149.66	144.9	127.62	122.27	136.3	137.81	156.92	167.51	181.3	

Output from water heater (annual)$_{1...12}$ 1840.87 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	57.82	50.52	52.47	46.39	44.83	39.33	37.45	41.97	42.44	48.54	52.04	56.37	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.62	14.76	12	9.09	6.79	5.74	6.2	8.06	10.81	13.73	16.02	17.08	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	186.07	188	183.13	172.77	159.7	147.41	139.2	137.27	142.13	152.49	165.57	177.86	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	(71)

Water heating gains (Table 5)

(72)m=	77.71	75.17	70.53	64.42	60.26	54.63	50.34	56.41	58.95	65.25	72.28	75.76	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	338.29	335.83	323.56	304.18	284.65	265.67	253.63	259.64	269.79	289.36	311.77	328.59	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.63	x	11.28	x	0.63	x	0.7	=	9.07	(75)
Northeast 0.9x	0.77	x	2.63	x	22.97	x	0.63	x	0.7	=	18.46	(75)
Northeast 0.9x	0.77	x	2.63	x	41.38	x	0.63	x	0.7	=	33.26	(75)
Northeast 0.9x	0.77	x	2.63	x	67.96	x	0.63	x	0.7	=	54.62	(75)
Northeast 0.9x	0.77	x	2.63	x	91.35	x	0.63	x	0.7	=	73.42	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.63	x	97.38	x	0.63	x	0.7	=	78.27	(75)
Northeast 0.9x	0.77	x	2.63	x	91.1	x	0.63	x	0.7	=	73.22	(75)
Northeast 0.9x	0.77	x	2.63	x	72.63	x	0.63	x	0.7	=	58.37	(75)
Northeast 0.9x	0.77	x	2.63	x	50.42	x	0.63	x	0.7	=	40.53	(75)
Northeast 0.9x	0.77	x	2.63	x	28.07	x	0.63	x	0.7	=	22.56	(75)
Northeast 0.9x	0.77	x	2.63	x	14.2	x	0.63	x	0.7	=	11.41	(75)
Northeast 0.9x	0.77	x	2.63	x	9.21	x	0.63	x	0.7	=	7.41	(75)
Southeast 0.9x	0.77	x	7.06	x	36.79	x	0.63	x	0.7	=	79.39	(77)
Southeast 0.9x	0.77	x	4.21	x	36.79	x	0.63	x	0.7	=	47.34	(77)
Southeast 0.9x	0.77	x	7.06	x	62.67	x	0.63	x	0.7	=	135.23	(77)
Southeast 0.9x	0.77	x	4.21	x	62.67	x	0.63	x	0.7	=	80.64	(77)
Southeast 0.9x	0.77	x	7.06	x	85.75	x	0.63	x	0.7	=	185.02	(77)
Southeast 0.9x	0.77	x	4.21	x	85.75	x	0.63	x	0.7	=	110.33	(77)
Southeast 0.9x	0.77	x	7.06	x	106.25	x	0.63	x	0.7	=	229.25	(77)
Southeast 0.9x	0.77	x	4.21	x	106.25	x	0.63	x	0.7	=	136.71	(77)
Southeast 0.9x	0.77	x	7.06	x	119.01	x	0.63	x	0.7	=	256.78	(77)
Southeast 0.9x	0.77	x	4.21	x	119.01	x	0.63	x	0.7	=	153.12	(77)
Southeast 0.9x	0.77	x	7.06	x	118.15	x	0.63	x	0.7	=	254.92	(77)
Southeast 0.9x	0.77	x	4.21	x	118.15	x	0.63	x	0.7	=	152.02	(77)
Southeast 0.9x	0.77	x	7.06	x	113.91	x	0.63	x	0.7	=	245.77	(77)
Southeast 0.9x	0.77	x	4.21	x	113.91	x	0.63	x	0.7	=	146.56	(77)
Southeast 0.9x	0.77	x	7.06	x	104.39	x	0.63	x	0.7	=	225.24	(77)
Southeast 0.9x	0.77	x	4.21	x	104.39	x	0.63	x	0.7	=	134.31	(77)
Southeast 0.9x	0.77	x	7.06	x	92.85	x	0.63	x	0.7	=	200.34	(77)
Southeast 0.9x	0.77	x	4.21	x	92.85	x	0.63	x	0.7	=	119.47	(77)
Southeast 0.9x	0.77	x	7.06	x	69.27	x	0.63	x	0.7	=	149.45	(77)
Southeast 0.9x	0.77	x	4.21	x	69.27	x	0.63	x	0.7	=	89.12	(77)
Southeast 0.9x	0.77	x	7.06	x	44.07	x	0.63	x	0.7	=	95.09	(77)
Southeast 0.9x	0.77	x	4.21	x	44.07	x	0.63	x	0.7	=	56.7	(77)
Southeast 0.9x	0.77	x	7.06	x	31.49	x	0.63	x	0.7	=	67.94	(77)
Southeast 0.9x	0.77	x	4.21	x	31.49	x	0.63	x	0.7	=	40.51	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	135.8	234.32	328.61	420.58	483.32	485.21	465.56	417.92	360.33	261.13	163.2	115.86	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	474.09	570.15	652.17	724.76	767.97	750.88	719.19	677.56	630.13	550.5	474.97	444.45	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.97	0.91	0.78	0.6	0.44	0.49	0.73	0.94	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.88	20.08	20.35	20.66	20.88	20.98	21	20.99	20.94	20.64	20.2	19.84	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.96	19.97	19.97	19.98	19.98	19.99	19.99	19.99	19.98	19.98	19.98	19.97	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.96	0.88	0.73	0.51	0.34	0.38	0.65	0.91	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.49	18.78	19.17	19.6	19.87	19.97	19.99	19.99	19.94	19.59	18.96	18.44	(90)

fLA = Living area ÷ (4) = 0.31 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.92	19.18	19.54	19.93	20.19	20.28	20.3	20.3	20.25	19.91	19.34	18.87	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.92	19.18	19.54	19.93	20.19	20.28	20.3	20.3	20.25	19.91	19.34	18.87	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.88	0.74	0.54	0.37	0.42	0.67	0.91	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	470.09	558.63	620.74	637.86	567.64	405.21	268.43	281.69	423.53	502.48	466.29	441.65	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1093.69	1065.97	970.84	812.86	623.96	414.11	269.5	283.54	449.57	684.86	903.75	1087.91	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	463.96	340.93	260.47	126	41.9	0	0	0	0	135.69	314.97	480.82	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2164.74 (98)

Space heating requirement in kWh/m²/year 33.16 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	463.96	340.93	260.47	126	41.9	0	0	0	0	135.69	314.97	480.82	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	496.74	365.02	278.88	134.9	44.86	0	0	0	0	145.28	337.23	514.79	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2317.7 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	185.66	162.18	168.74	149.66	144.9	127.62	122.27	136.3	137.81	156.92	167.51	181.3

Efficiency of water heater 80.3 (216)

(217)m=	87.26	86.88	86.14	84.62	82.36	80.3	80.3	80.3	80.3	84.69	86.62	87.39

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	212.76	186.68	195.89	176.86	175.92	158.93	152.26	169.74	171.61	185.29	193.39	207.46

Total = Sum(219a)$_{1...12}$ = 2186.8 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2317.7	
Water heating fuel used		2186.8	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		293.49	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	500.62	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	472.35	(264)
Space and water heating	(261) + (262) + (263) + (264) =				972.97	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	152.32	(268)
Total CO2, kg/year	sum of (265)…(271) =				1164.22	(272)

TER = 17.83 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 57

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.41	(1a) x	2.56	(2a) =	129.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.41	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.38	x	1/[1/(1.4)+ 0.04]	=	8.46			(27)
Windows Type 2			3.8	x	1/[1/(1.4)+ 0.04]	=	5.04			(27)
Floor			50.41	x	0.13	=	6.5533			(28)
Walls Type1	24.71	10.18	14.53	x	0.18	=	2.62			(29)
Walls Type2	43.27	2.42	40.85	x	0.18	=	7.35			(29)
Total area of elements, m²			118.39							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 32.44 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6486.56 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 2.81 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.25 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.39	25.24	25.08	24.35	24.21	23.57	23.57	23.45	23.82	24.21	24.49	24.78	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	60.65	60.49	60.33	59.6	59.46	58.82	58.82	58.7	59.07	59.46	59.74	60.03	

Average = Sum(39)$_{1...12}$ /12= 59.6 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.2	1.2	1.2	1.18	1.18	1.17	1.17	1.16	1.17	1.18	1.19	1.19	

Average = Sum(40)$_{1...12}$ /12= 1.18 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.63 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	82.09	79.1	76.12	73.13	70.15	67.16	67.16	70.15	73.13	76.12	79.1	82.09	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 895.52 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	121.74	106.47	109.87	95.79	91.91	79.31	73.49	84.33	85.34	99.46	108.57	117.89	

Total = Sum(45)$_{1...12}$ = 1174.17 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	18.26	15.97	16.48	14.37	13.79	11.9	11.02	12.65	12.8	14.92	16.28	17.68	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.83	36.41	38.79	36.07	35.75	33.12	34.23	35.75	36.07	38.79	39.01	41.83	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.57	142.88	148.66	131.85	127.66	112.43	107.72	120.08	121.41	138.25	147.58	159.73	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.57	142.88	148.66	131.85	127.66	112.43	107.72	120.08	121.41	138.25	147.58	159.73	

Output from water heater (annual)$_{1...12}$ 1621.81 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.94	44.5	46.23	40.87	39.5	34.65	32.99	36.98	37.39	42.77	45.85	49.66	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.3	11.81	9.61	7.27	5.44	4.59	4.96	6.45	8.65	10.99	12.82	13.67	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.3	149.84	145.96	137.7	127.28	117.49	110.94	109.41	113.28	121.54	131.96	141.76	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	(71)

Water heating gains (Table 5)

(72)m=	68.46	66.23	62.14	56.76	53.09	48.13	44.35	49.7	51.93	57.48	63.68	66.74	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.59	279.41	269.24	253.27	237.34	221.74	211.78	217.09	225.4	241.54	260	273.7	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	6.38	x	36.79	x	0.63	x	0.7	=	71.74	(77)
Southeast 0.9x	0.77	x	3.8	x	36.79	x	0.63	x	0.7	=	42.73	(77)
Southeast 0.9x	0.77	x	6.38	x	62.67	x	0.63	x	0.7	=	122.2	(77)
Southeast 0.9x	0.77	x	3.8	x	62.67	x	0.63	x	0.7	=	72.78	(77)
Southeast 0.9x	0.77	x	6.38	x	85.75	x	0.63	x	0.7	=	167.2	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	3.8	x	85.75	x	0.63	x	0.7	=	99.59	(77)
Southeast 0.9x	0.77	x	6.38	x	106.25	x	0.63	x	0.7	=	207.17	(77)
Southeast 0.9x	0.77	x	3.8	x	106.25	x	0.63	x	0.7	=	123.39	(77)
Southeast 0.9x	0.77	x	6.38	x	119.01	x	0.63	x	0.7	=	232.05	(77)
Southeast 0.9x	0.77	x	3.8	x	119.01	x	0.63	x	0.7	=	138.21	(77)
Southeast 0.9x	0.77	x	6.38	x	118.15	x	0.63	x	0.7	=	230.37	(77)
Southeast 0.9x	0.77	x	3.8	x	118.15	x	0.63	x	0.7	=	137.21	(77)
Southeast 0.9x	0.77	x	6.38	x	113.91	x	0.63	x	0.7	=	222.1	(77)
Southeast 0.9x	0.77	x	3.8	x	113.91	x	0.63	x	0.7	=	132.29	(77)
Southeast 0.9x	0.77	x	6.38	x	104.39	x	0.63	x	0.7	=	203.54	(77)
Southeast 0.9x	0.77	x	3.8	x	104.39	x	0.63	x	0.7	=	121.23	(77)
Southeast 0.9x	0.77	x	6.38	x	92.85	x	0.63	x	0.7	=	181.04	(77)
Southeast 0.9x	0.77	x	3.8	x	92.85	x	0.63	x	0.7	=	107.83	(77)
Southeast 0.9x	0.77	x	6.38	x	69.27	x	0.63	x	0.7	=	135.06	(77)
Southeast 0.9x	0.77	x	3.8	x	69.27	x	0.63	x	0.7	=	80.44	(77)
Southeast 0.9x	0.77	x	6.38	x	44.07	x	0.63	x	0.7	=	85.93	(77)
Southeast 0.9x	0.77	x	3.8	x	44.07	x	0.63	x	0.7	=	51.18	(77)
Southeast 0.9x	0.77	x	6.38	x	31.49	x	0.63	x	0.7	=	61.4	(77)
Southeast 0.9x	0.77	x	3.8	x	31.49	x	0.63	x	0.7	=	36.57	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	114.47	194.99	266.79	330.56	370.26	367.58	354.39	324.77	288.88	215.5	137.11	97.96	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	396.06	474.4	536.02	583.83	607.6	589.32	566.17	541.86	514.28	457.04	397.11	371.67	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.91	0.79	0.61	0.45	0.49	0.72	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.86	20.06	20.34	20.64	20.86	20.97	20.99	20.99	20.93	20.64	20.19	19.82	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.92	19.92	19.92	19.93	19.94	19.95	19.95	19.95	19.94	19.94	19.93	19.93	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.88	0.73	0.52	0.35	0.38	0.64	0.9	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.42	18.72	19.11	19.54	19.81	19.93	19.94	19.95	19.9	19.55	18.91	18.37	(90)

fLA = Living area ÷ (4) = 0.4 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19	19.26	19.6	19.98	20.24	20.35	20.37	20.37	20.31	19.99	19.42	18.95	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19	19.26	19.6	19.98	20.24	20.35	20.37	20.37	20.31	19.99	19.42	18.95	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.88	0.75	0.56	0.39	0.43	0.67	0.9	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	391.71	462.66	507.02	512.5	454.97	328.6	220.27	230.81	344.13	412.45	388.02	368.55	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	891.29	868.56	790.48	660.46	507.5	338.05	221.55	232.81	366.96	558.12	736.12	885.54	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	371.69	272.76	210.89	106.53	39.08	0	0	0	0	108.38	250.63	384.64	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1744.62 (98)

Space heating requirement in kWh/m²/year 34.61 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	371.69	272.76	210.89	106.53	39.08	0	0	0	0	108.38	250.63	384.64	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	397.95	292.04	225.8	114.06	41.85	0	0	0	0	116.04	268.35	411.82	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1867.9 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.57	142.88	148.66	131.85	127.66	112.43	107.72	120.08	121.41	138.25	147.58	159.73

Efficiency of water heater 80.3 (216)

(217)m=	87.05	86.65	85.93	84.52	82.46	80.3	80.3	80.3	80.3	84.45	86.37	87.18	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	187.89	164.89	173	156	154.81	140.02	134.15	149.54	151.19	163.71	170.86	183.21	

Total = Sum(219a)$_{1...12}$ = 1929.26 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1867.9

TER WorkSheet: New dwelling design stage

Water heating fuel used			1929.26	
Electricity for pumps, fans and electric keep-hot				
central heating pump:		30		(230c)
boiler with a fan-assisted flue		45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		75	(231)
Electricity for lighting			234.9	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	403.47	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	416.72	(264)
Space and water heating	(261) + (262) + (263) + (264) =				820.19	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	121.91	(268)
Total CO2, kg/year	sum of (265)…(271) =				981.03	(272)

TER = 19.46 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 58

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.54	(1a) x	2.56	(2a) =	131.94	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.54	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.94	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)			0	(9)
Additional infiltration		[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0	(12)
If no draught lobby, enter 0.05, else enter 0			0	(13)
Percentage of windows and doors draught stripped			0	(14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5	(17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered			2	(19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.34	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.32	0.32	0.32	0.34	0.37	0.38	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.56	x	1/[1/(1.4)+ 0.04]	=	8.7			(27)
Windows Type 2			3.91	x	1/[1/(1.4)+ 0.04]	=	5.18			(27)
Floor			51.54	x	0.13	=	6.7002			(28)
Walls Type1	24.71	10.47	14.24	x	0.18	=	2.56			(29)
Walls Type2	39.57	2.42	37.15	x	0.18	=	6.69			(29)
Total area of elements, m²			115.82							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 32.25 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6543.03 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 2.82 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.07 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.89	25.73	25.58	24.84	24.7	24.06	24.06	23.94	24.31	24.7	24.98	25.27	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	60.96	60.8	60.64	59.91	59.77	59.13	59.13	59.01	59.37	59.77	60.05	60.34	

Average = Sum(39)$_{1...12}$ /12= 59.91 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.18	1.18	1.18	1.16	1.16	1.15	1.15	1.14	1.15	1.16	1.17	1.17	

Average = Sum(40)$_{1...12}$ /12= 1.16 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	82.96	79.94	76.93	73.91	70.89	67.88	67.88	70.89	73.91	76.93	79.94	82.96	

Total = Sum(44)$_{1...12}$ = 905.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	123.03	107.6	111.03	96.8	92.88	80.15	74.27	85.23	86.25	100.51	109.72	119.15	

Total = Sum(45)$_{1...12}$ = 1186.62 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	18.45	16.14	16.66	14.52	13.93	12.02	11.14	12.78	12.94	15.08	16.46	17.87	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.28	36.8	39.2	36.45	36.13	33.47	34.59	36.13	36.45	39.2	39.42	42.28	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	

Output from water heater (annual)$_{1...12}$ 1639.01 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.48	44.98	46.72	41.3	39.92	35.02	33.34	37.37	37.79	43.22	46.34	50.18	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.56	12.04	9.79	7.41	5.54	4.68	5.06	6.57	8.82	11.2	13.07	13.93	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.23	152.8	148.85	140.43	129.8	119.81	113.14	111.57	115.53	123.94	134.57	144.56	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	(71)

Water heating gains (Table 5)

(72)m=	69.19	66.93	62.79	57.36	53.65	48.64	44.82	50.23	52.48	58.09	64.36	67.45	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	286.01	283.8	273.47	257.23	241.02	225.16	215.04	220.4	228.86	245.27	264.03	277.98	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	6.56	x	36.79	x	0.63	x	0.7	=	73.77	(77)
Southeast 0.9x	0.77	x	3.91	x	36.79	x	0.63	x	0.7	=	43.97	(77)
Southeast 0.9x	0.77	x	6.56	x	62.67	x	0.63	x	0.7	=	125.65	(77)
Southeast 0.9x	0.77	x	3.91	x	62.67	x	0.63	x	0.7	=	74.89	(77)
Southeast 0.9x	0.77	x	6.56	x	85.75	x	0.63	x	0.7	=	171.92	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	3.91	x	85.75	x	0.63	x	0.7	=	102.47	(77)
Southeast 0.9x	0.77	x	6.56	x	106.25	x	0.63	x	0.7	=	213.02	(77)
Southeast 0.9x	0.77	x	3.91	x	106.25	x	0.63	x	0.7	=	126.97	(77)
Southeast 0.9x	0.77	x	6.56	x	119.01	x	0.63	x	0.7	=	238.6	(77)
Southeast 0.9x	0.77	x	3.91	x	119.01	x	0.63	x	0.7	=	142.21	(77)
Southeast 0.9x	0.77	x	6.56	x	118.15	x	0.63	x	0.7	=	236.87	(77)
Southeast 0.9x	0.77	x	3.91	x	118.15	x	0.63	x	0.7	=	141.18	(77)
Southeast 0.9x	0.77	x	6.56	x	113.91	x	0.63	x	0.7	=	228.37	(77)
Southeast 0.9x	0.77	x	3.91	x	113.91	x	0.63	x	0.7	=	136.12	(77)
Southeast 0.9x	0.77	x	6.56	x	104.39	x	0.63	x	0.7	=	209.28	(77)
Southeast 0.9x	0.77	x	3.91	x	104.39	x	0.63	x	0.7	=	124.74	(77)
Southeast 0.9x	0.77	x	6.56	x	92.85	x	0.63	x	0.7	=	186.15	(77)
Southeast 0.9x	0.77	x	3.91	x	92.85	x	0.63	x	0.7	=	110.95	(77)
Southeast 0.9x	0.77	x	6.56	x	69.27	x	0.63	x	0.7	=	138.87	(77)
Southeast 0.9x	0.77	x	3.91	x	69.27	x	0.63	x	0.7	=	82.77	(77)
Southeast 0.9x	0.77	x	6.56	x	44.07	x	0.63	x	0.7	=	88.35	(77)
Southeast 0.9x	0.77	x	3.91	x	44.07	x	0.63	x	0.7	=	52.66	(77)
Southeast 0.9x	0.77	x	6.56	x	31.49	x	0.63	x	0.7	=	63.13	(77)
Southeast 0.9x	0.77	x	3.91	x	31.49	x	0.63	x	0.7	=	37.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	117.73	200.54	274.39	339.98	380.81	378.05	364.48	334.03	297.1	221.64	141.02	100.75	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	403.74	484.34	547.85	597.21	621.83	603.21	579.53	554.43	525.97	466.91	405.05	378.73	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.9	0.78	0.6	0.44	0.48	0.72	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.88	20.09	20.36	20.66	20.87	20.97	21	20.99	20.94	20.66	20.21	19.84	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.93	19.94	19.94	19.95	19.95	19.96	19.96	19.96	19.96	19.95	19.95	19.94	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.87	0.72	0.52	0.34	0.38	0.63	0.9	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.47	18.77	19.16	19.58	19.84	19.95	19.96	19.96	19.92	19.58	18.95	18.42	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.82	19.1	19.46	19.85	20.1	20.2	20.22	20.22	20.17	19.85	19.27	18.77	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.82	19.1	19.46	19.85	20.1	20.2	20.22	20.22	20.17	19.85	19.27	18.77	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.94	0.87	0.73	0.54	0.37	0.4	0.65	0.89	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	399.06	471.58	516.14	519.15	455.98	323.8	213.12	223.95	341.51	417.86	395.15	375.39	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	885.23	863.28	785.73	655.8	501.92	331.31	214.01	225.39	360.5	552.85	730.53	879.44	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	361.71	263.22	200.58	98.39	34.18	0	0	0	0	100.43	241.48	375.01	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1674.99 (98)

Space heating requirement in kWh/m²/year 32.5 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	361.71	263.22	200.58	98.39	34.18	0	0	0	0	100.43	241.48	375.01	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	387.27	281.82	214.75	105.34	36.6	0	0	0	0	107.53	258.54	401.51	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1793.36 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42

Efficiency of water heater 80.3 (216)

(217)m=	86.97	86.54	85.78	84.3	82.22	80.3	80.3	80.3	80.3	84.24	86.26	87.1	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	190.07	166.85	175.14	158.07	156.9	141.5	135.57	151.13	152.8	165.86	172.9	185.32	

Total = Sum(219a)$_{1...12}$ = 1952.1 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1793.36

TER WorkSheet: New dwelling design stage

Water heating fuel used		1952.1	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		239.41	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	387.36	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	421.65	(264)
Space and water heating	(261) + (262) + (263) + (264) =				809.02	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	124.25	(268)
Total CO2, kg/year	sum of (265)…(271) =				972.2	(272)

TER = 18.86 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 59

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	89.93	(1a) x	2.56	(2a) =	230.23	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	89.93	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		230.23	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.13 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.38 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.32 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.41	0.4	0.4	0.36	0.35	0.31	0.31	0.3	0.32	0.35	0.36	0.38

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.58	0.58	0.58	0.56	0.56	0.55	0.55	0.54	0.55	0.56	0.57	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.58	0.58	0.58	0.56	0.56	0.55	0.55	0.54	0.55	0.56	0.57	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.83	x1/[1/(1.4)+ 0.04]		=	9.05			(27)
Windows Type 2			4.07	x1/[1/(1.4)+ 0.04]		=	5.4			(27)
Windows Type 3			2.55	x1/[1/(1.4)+ 0.04]		=	3.38			(27)
Floor			89.933	x	0.13	=	11.69129			(28)
Walls Type1	66.42	20.07	46.35	x	0.18	=	8.34			(29)
Walls Type2	37.87	2.42	35.45	x	0.18	=	6.38			(29)
Roof	12.86	0	12.86	x	0.13	=	1.67			(30)
Total area of elements, m²			207.08							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 57.12 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11399 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.11 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 65.22 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	44.44	44.19	43.94	42.79	42.58	41.57	41.57	41.38	41.96	42.58	43.01	43.47	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	109.66	109.41	109.17	108.01	107.8	106.79	106.79	106.61	107.18	107.8	108.24	108.69	

Average = Sum(39)$_{1...12}$ /12= 108.01 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.22	1.22	1.21	1.2	1.2	1.19	1.19	1.19	1.19	1.2	1.2	1.21	
Average = Sum(40)$_{1...12}$ /12=													1.2 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.62 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 96.54 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	106.19	102.33	98.47	94.61	90.75	86.89	86.89	90.75	94.61	98.47	102.33	106.19	
Total = Sum(44)$_{1...12}$ =													1158.47 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	157.48	137.73	142.13	123.91	118.9	102.6	95.07	109.1	110.4	128.66	140.44	152.51	
Total = Sum(45)$_{1...12}$ =													1518.94 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	23.62	20.66	21.32	18.59	17.83	15.39	14.26	16.36	16.56	19.3	21.07	22.88	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.18	46.66	46.24	42.85	44.28	46.24	46.66	50.18	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	208.44	183.76	192.31	170.57	165.14	145.45	139.35	155.34	157.06	178.84	189.76	203.47	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	208.44	183.76	192.31	170.57	165.14	145.45	139.35	155.34	157.06	178.84	189.76	203.47	

Output from water heater (annual)$_{1...12}$ 2089.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	65.1	57.3	59.8	52.86	51.09	44.83	42.68	47.84	48.37	55.32	59.03	63.45	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.3	18.92	15.39	11.65	8.71	7.35	7.94	10.33	13.86	17.6	20.54	21.89	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	238.95	241.43	235.19	221.88	205.09	189.31	178.77	176.29	182.54	195.84	212.63	228.41	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	(71)

Water heating gains (Table 5)

(72)m=	87.5	85.27	80.38	73.42	68.67	62.26	57.37	64.3	67.18	74.36	81.98	85.28	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	413.13	411	396.32	372.33	347.85	324.29	309.45	316.28	328.95	353.17	380.52	400.96	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	6.83	x	36.79	x	0.63	x	0.7	=	76.8	(77)
Southeast 0.9x	0.77	x	4.07	x	36.79	x	0.63	x	0.7	=	91.53	(77)
Southeast 0.9x	0.77	x	6.83	x	62.67	x	0.63	x	0.7	=	130.82	(77)
Southeast 0.9x	0.77	x	4.07	x	62.67	x	0.63	x	0.7	=	155.91	(77)
Southeast 0.9x	0.77	x	6.83	x	85.75	x	0.63	x	0.7	=	178.99	(77)

TER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	4.07	x	85.75	x	0.63	x	0.7	=	213.33	(77)
Southeast	0.9x	0.77	x	6.83	x	106.25	x	0.63	x	0.7	=	221.78	(77)
Southeast	0.9x	0.77	x	4.07	x	106.25	x	0.63	x	0.7	=	264.32	(77)
Southeast	0.9x	0.77	x	6.83	x	119.01	x	0.63	x	0.7	=	248.42	(77)
Southeast	0.9x	0.77	x	4.07	x	119.01	x	0.63	x	0.7	=	296.06	(77)
Southeast	0.9x	0.77	x	6.83	x	118.15	x	0.63	x	0.7	=	246.62	(77)
Southeast	0.9x	0.77	x	4.07	x	118.15	x	0.63	x	0.7	=	293.92	(77)
Southeast	0.9x	0.77	x	6.83	x	113.91	x	0.63	x	0.7	=	237.77	(77)
Southeast	0.9x	0.77	x	4.07	x	113.91	x	0.63	x	0.7	=	283.37	(77)
Southeast	0.9x	0.77	x	6.83	x	104.39	x	0.63	x	0.7	=	217.9	(77)
Southeast	0.9x	0.77	x	4.07	x	104.39	x	0.63	x	0.7	=	259.69	(77)
Southeast	0.9x	0.77	x	6.83	x	92.85	x	0.63	x	0.7	=	193.81	(77)
Southeast	0.9x	0.77	x	4.07	x	92.85	x	0.63	x	0.7	=	230.99	(77)
Southeast	0.9x	0.77	x	6.83	x	69.27	x	0.63	x	0.7	=	144.58	(77)
Southeast	0.9x	0.77	x	4.07	x	69.27	x	0.63	x	0.7	=	172.32	(77)
Southeast	0.9x	0.77	x	6.83	x	44.07	x	0.63	x	0.7	=	91.99	(77)
Southeast	0.9x	0.77	x	4.07	x	44.07	x	0.63	x	0.7	=	109.63	(77)
Southeast	0.9x	0.77	x	6.83	x	31.49	x	0.63	x	0.7	=	65.73	(77)
Southeast	0.9x	0.77	x	4.07	x	31.49	x	0.63	x	0.7	=	78.33	(77)
Southwest	0.9x	0.77	x	2.55	x	36.79		0.63	x	0.7	=	57.35	(79)
Southwest	0.9x	0.77	x	2.55	x	62.67		0.63	x	0.7	=	97.68	(79)
Southwest	0.9x	0.77	x	2.55	x	85.75		0.63	x	0.7	=	133.66	(79)
Southwest	0.9x	0.77	x	2.55	x	106.25		0.63	x	0.7	=	165.61	(79)
Southwest	0.9x	0.77	x	2.55	x	119.01		0.63	x	0.7	=	185.49	(79)
Southwest	0.9x	0.77	x	2.55	x	118.15		0.63	x	0.7	=	184.15	(79)
Southwest	0.9x	0.77	x	2.55	x	113.91		0.63	x	0.7	=	177.54	(79)
Southwest	0.9x	0.77	x	2.55	x	104.39		0.63	x	0.7	=	162.71	(79)
Southwest	0.9x	0.77	x	2.55	x	92.85		0.63	x	0.7	=	144.72	(79)
Southwest	0.9x	0.77	x	2.55	x	69.27		0.63	x	0.7	=	107.96	(79)
Southwest	0.9x	0.77	x	2.55	x	44.07		0.63	x	0.7	=	68.69	(79)
Southwest	0.9x	0.77	x	2.55	x	31.49		0.63	x	0.7	=	49.08	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	225.68	384.42	525.98	651.71	729.97	724.69	698.68	640.29	569.52	424.86	270.31	193.14	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	638.81	795.42	922.3	1024.04	1077.82	1048.98	1008.13	956.57	898.47	778.03	650.83	594.1	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.97	0.91	0.8	0.62	0.46	0.5	0.74	0.94	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.77	19.99	20.29	20.61	20.85	20.97	20.99	20.99	20.92	20.6	20.11	19.73	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.9	19.91	19.91	19.92	19.92	19.93	19.93	19.93	19.93	19.92	19.92	19.91	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.96	0.89	0.74	0.53	0.35	0.39	0.65	0.92	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.28	18.61	19.03	19.49	19.79	19.91	19.93	19.93	19.87	19.48	18.79	18.22	(90)

fLA = Living area ÷ (4) = 0.23 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.61	18.92	19.31	19.74	20.03	20.15	20.17	20.17	20.11	19.73	19.09	18.56	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.61	18.92	19.31	19.74	20.03	20.15	20.17	20.17	20.11	19.73	19.09	18.56	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.88	0.75	0.55	0.38	0.42	0.67	0.91	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	633.71	778.73	875.87	900.86	803.86	576.21	379.01	398.3	602.22	708.56	639.17	590.62	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1569.78	1533.99	1398.8	1171.15	897.55	592.47	381.03	401.62	643.95	984.25	1297.3	1561.04	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	696.44	507.53	389.06	194.6	69.71	0	0	0	0	205.12	473.85	721.99	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3258.3 (98)

Space heating requirement in kWh/m²/year 36.23 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	696.44	507.53	389.06	194.6	69.71	0	0	0	0	205.12	473.85	721.99	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	745.65	543.39	416.56	208.36	74.63	0	0	0	0	219.61	507.34	773.01	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3488.54 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	208.44	183.76	192.31	170.57	165.14	145.45	139.35	155.34	157.06	178.84	189.76	203.47

Efficiency of water heater 80.3 (216)

(217)m=	87.85	87.48	86.79	85.38	83.05	80.3	80.3	80.3	80.3	85.4	87.26	87.97

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	237.26	210.07	221.58	199.77	198.83	181.13	173.53	193.45	195.59	209.42	217.46	231.3

Total = Sum(219a)$_{1...12}$ = 2469.39 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		3488.54	
Water heating fuel used		2469.39	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		376.21	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	753.53	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	533.39	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1286.91	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	195.25	(268)
Total CO2, kg/year	sum of (265)…(271) =			1521.09	(272)

TER = 16.91 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 60

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.3	(1a) x	2.56	(2a) =	187.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.3	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.44	0.43	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.2	x1/[1/(1.4)+ 0.04]		=	8.22			(27)
Windows Type 2			3.7	x1/[1/(1.4)+ 0.04]		=	4.91			(27)
Windows Type 3			2.31	x1/[1/(1.4)+ 0.04]		=	3.06			(27)
Floor			73.3	x	0.13	=	9.529			(28)
Walls Type1	52.59	15.91	36.68	x	0.18	=	6.6			(29)
Walls Type2	17.17	2.42	14.75	x	0.18	=	2.66			(29)
Total area of elements, m²			143.07							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 42.3 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8937.45 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.92 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 48.22 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	37.07	36.83	36.6	35.51	35.3	34.35	34.35	34.18	34.72	35.3	35.72	36.15	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	85.29	85.05	84.82	83.73	83.53	82.57	82.57	82.4	82.94	83.53	83.94	84.37	

Average = Sum(39)$_{1...12}$ /12= 83.73 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.16	1.16	1.16	1.14	1.14	1.13	1.13	1.12	1.13	1.14	1.15	1.15

Average = Sum(40)$_{1...12}$ /12= 1.14 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.38 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.32	94.75	91.17	87.6	84.02	80.44	80.44	84.02	87.6	91.17	94.75	98.32

Total = Sum(44)$_{1...12}$ = 1072.6 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.81	127.52	131.59	114.73	110.08	94.99	88.03	101.01	102.22	119.12	130.03	141.21

Total = Sum(45)$_{1...12}$ = 1406.35 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.87	19.13	19.74	17.21	16.51	14.25	13.2	15.15	15.33	17.87	19.5	21.18

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.1	43.61	46.46	43.2	42.82	39.67	40.99	42.82	43.2	46.46	46.72	50.1	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31	

Output from water heater (annual)$_{1...12}$ 1942.5 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.01	53.3	55.37	48.95	47.31	41.5	39.52	44.29	44.79	51.22	54.92	59.48	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.28	16.24	13.2	10	7.47	6.31	6.82	8.86	11.89	15.1	17.62	18.79	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.87	207	201.64	190.24	175.84	162.31	153.27	151.14	156.5	167.91	182.3	195.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	(71)

Water heating gains (Table 5)

(72)m=	82	79.32	74.42	67.98	63.58	57.64	53.11	59.53	62.2	68.85	76.27	79.94	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	366	363.41	350.12	329.07	307.75	287.11	274.05	280.39	291.45	312.71	337.05	355.42	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.31	x	36.79	x	0.63	x	0.7	=	25.98	(79)
Southwest$_{0.9x}$	0.77	x	2.31	x	62.67	x	0.63	x	0.7	=	44.25	(79)
Southwest$_{0.9x}$	0.77	x	2.31	x	85.75	x	0.63	x	0.7	=	60.54	(79)
Southwest$_{0.9x}$	0.77	x	2.31	x	106.25	x	0.63	x	0.7	=	75.01	(79)
Southwest$_{0.9x}$	0.77	x	2.31	x	119.01	x	0.63	x	0.7	=	84.02	(79)

TER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.31	x	118.15		0.63	x	0.7	=	83.41	(79)
Southwest 0.9x	0.77	x	2.31	x	113.91		0.63	x	0.7	=	80.42	(79)
Southwest 0.9x	0.77	x	2.31	x	104.39		0.63	x	0.7	=	73.7	(79)
Southwest 0.9x	0.77	x	2.31	x	92.85		0.63	x	0.7	=	65.55	(79)
Southwest 0.9x	0.77	x	2.31	x	69.27		0.63	x	0.7	=	48.9	(79)
Southwest 0.9x	0.77	x	2.31	x	44.07		0.63	x	0.7	=	31.11	(79)
Southwest 0.9x	0.77	x	2.31	x	31.49		0.63	x	0.7	=	22.23	(79)
Northwest 0.9x	0.77	x	6.2	x	11.28	x	0.63	x	0.7	=	21.38	(81)
Northwest 0.9x	0.77	x	3.7	x	11.28	x	0.63	x	0.7	=	25.52	(81)
Northwest 0.9x	0.77	x	6.2	x	22.97	x	0.63	x	0.7	=	43.52	(81)
Northwest 0.9x	0.77	x	3.7	x	22.97	x	0.63	x	0.7	=	51.94	(81)
Northwest 0.9x	0.77	x	6.2	x	41.38	x	0.63	x	0.7	=	78.4	(81)
Northwest 0.9x	0.77	x	3.7	x	41.38	x	0.63	x	0.7	=	93.58	(81)
Northwest 0.9x	0.77	x	6.2	x	67.96	x	0.63	x	0.7	=	128.76	(81)
Northwest 0.9x	0.77	x	3.7	x	67.96	x	0.63	x	0.7	=	153.68	(81)
Northwest 0.9x	0.77	x	6.2	x	91.35	x	0.63	x	0.7	=	173.08	(81)
Northwest 0.9x	0.77	x	3.7	x	91.35	x	0.63	x	0.7	=	206.58	(81)
Northwest 0.9x	0.77	x	6.2	x	97.38	x	0.63	x	0.7	=	184.52	(81)
Northwest 0.9x	0.77	x	3.7	x	97.38	x	0.63	x	0.7	=	220.24	(81)
Northwest 0.9x	0.77	x	6.2	x	91.1	x	0.63	x	0.7	=	172.62	(81)
Northwest 0.9x	0.77	x	3.7	x	91.1	x	0.63	x	0.7	=	206.03	(81)
Northwest 0.9x	0.77	x	6.2	x	72.63	x	0.63	x	0.7	=	137.61	(81)
Northwest 0.9x	0.77	x	3.7	x	72.63	x	0.63	x	0.7	=	164.25	(81)
Northwest 0.9x	0.77	x	6.2	x	50.42	x	0.63	x	0.7	=	95.54	(81)
Northwest 0.9x	0.77	x	3.7	x	50.42	x	0.63	x	0.7	=	114.03	(81)
Northwest 0.9x	0.77	x	6.2	x	28.07	x	0.63	x	0.7	=	53.18	(81)
Northwest 0.9x	0.77	x	3.7	x	28.07	x	0.63	x	0.7	=	63.47	(81)
Northwest 0.9x	0.77	x	6.2	x	14.2	x	0.63	x	0.7	=	26.9	(81)
Northwest 0.9x	0.77	x	3.7	x	14.2	x	0.63	x	0.7	=	32.11	(81)
Northwest 0.9x	0.77	x	6.2	x	9.21	x	0.63	x	0.7	=	17.46	(81)
Northwest 0.9x	0.77	x	3.7	x	9.21	x	0.63	x	0.7	=	20.84	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	72.87	139.7	232.52	357.46	463.68	488.17	459.06	375.56	275.12	165.56	90.12	60.53	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	438.88	503.11	582.64	686.52	771.43	775.29	733.12	655.94	566.57	478.26	427.17	415.94	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.84	0.65	0.49	0.56	0.84	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.74	19.89	20.16	20.54	20.83	20.97	20.99	20.99	20.88	20.49	20.05	19.72	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.95	19.95	19.95	19.97	19.97	19.98	19.98	19.98	19.98	19.97	19.96	19.96	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.93	0.79	0.56	0.38	0.45	0.77	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.27	18.49	18.89	19.43	19.81	19.96	19.98	19.98	19.88	19.37	18.73	18.24	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.65	18.85	19.22	19.71	20.07	20.22	20.24	20.24	20.13	19.66	19.07	18.62	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.65	18.85	19.22	19.71	20.07	20.22	20.24	20.24	20.13	19.66	19.07	18.62	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.79	0.58	0.41	0.48	0.78	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	437.17	499.09	570.02	636.1	610.72	449.84	298.71	312.27	441.96	459.85	423.87	414.7	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1223.98	1186.76	1078.81	905.52	699.49	463.97	300.58	316.23	500.54	756.4	1005.12	1217.04	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	585.39	462.12	378.53	193.98	66.05	0	0	0	0	220.63	418.5	596.94	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2922.15 (98)

Space heating requirement in kWh/m²/year 39.87 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	585.39	462.12	378.53	193.98	66.05	0	0	0	0	220.63	418.5	596.94	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	626.75	494.77	405.28	207.69	70.72	0	0	0	0	236.22	448.07	639.13	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3128.64 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31

Efficiency of water heater 80.3 (216)

(217)m= 87.64 | 87.43 | 86.9 | 85.57 | 83.1 | 80.3 | 80.3 | 80.3 | 80.3 | 85.77 | 87.15 | 87.72 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 223.55 | 195.74 | 204.89 | 184.56 | 183.99 | 167.7 | 160.67 | 179.11 | 181.09 | 193.04 | 202.83 | 218.09

Total = Sum(219a)$_{1...12}$ = 2295.26 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		3128.64	
Water heating fuel used		2295.26	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		322.83	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	675.79	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	495.78	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1171.56	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	167.55	(268)
Total CO2, kg/year	sum of (265)…(271) =			1378.04	(272)

TER = 18.8 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 61

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.47	(1a) x	2.56	(2a) =	180.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.47	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.17	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)			0	(9)
Additional infiltration		[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0	(12)
If no draught lobby, enter 0.05, else enter 0			0	(13)
Percentage of windows and doors draught stripped			0	(14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5	(17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.42	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered			2	(19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.39	0.38	0.34	0.34	0.33	0.35	0.38	0.4	0.42

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.58	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.58	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.93	x1/[1/(1.4)+ 0.04]		=	9.19			(27)
Windows Type 2			4.13	x1/[1/(1.4)+ 0.04]		=	5.48			(27)
Floor			70.475	x	0.13	=	9.16175			(28)
Walls Type1	31.35	15.19	16.16	x	0.18	=	2.91			(29)
Walls Type2	17.17	2.42	14.75	x	0.18	=	2.66			(29)
Total area of elements, m²			119							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 37.29 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8277.84 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.54 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 40.83 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	35.83	35.59	35.36	34.28	34.08	33.13	33.13	32.96	33.5	34.08	34.49	34.91	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	76.66	76.42	76.19	75.11	74.91	73.96	73.96	73.79	74.33	74.91	75.32	75.74	

Average = Sum(39)$_{1...12}$ /12= 75.11 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.09	1.08	1.08	1.07	1.06	1.05	1.05	1.05	1.05	1.06	1.07	1.07	

Average = Sum(40)$_{1...12}$ /12= 1.07 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.82 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	96.6	93.09	89.57	86.06	82.55	79.04	79.04	82.55	86.06	89.57	93.09	96.6	

Total = Sum(44)$_{1...12}$ = 1053.82 (44)

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	143.25	125.29	129.29	112.72	108.16	93.33	86.48	99.24	100.43	117.04	127.76	138.73	

Total = Sum(45)$_{1...12}$ = 1381.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.49	18.79	19.39	16.91	16.22	14	12.97	14.89	15.06	17.56	19.16	20.81	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.23	42.85	45.65	42.44	42.07	38.98	40.28	42.07	42.44	45.65	45.91	49.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	

Output from water heater (annual)$_{1...12}$ 1908.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	59.94	52.37	54.4	48.09	46.48	40.78	38.82	43.51	44	50.33	53.96	58.44	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.71	15.73	12.79	9.68	7.24	6.11	6.6	8.58	11.52	14.63	17.07	18.2	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.4	200.46	195.27	184.23	170.29	157.18	148.43	146.37	151.56	162.6	176.55	189.65	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	(71)

Water heating gains (Table 5)

(72)m=	80.56	77.93	73.12	66.79	62.47	56.63	52.18	58.49	61.11	67.64	74.94	78.54	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	356.54	353.99	341.05	320.57	299.86	279.79	267.08	273.3	284.06	304.74	328.42	346.26	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	6.93	x	11.28	x	0.63	x	0.7	=	23.9	(81)
Northwest 0.9x	0.77	x	4.13	x	11.28	x	0.63	x	0.7	=	28.48	(81)
Northwest 0.9x	0.77	x	6.93	x	22.97	x	0.63	x	0.7	=	48.64	(81)
Northwest 0.9x	0.77	x	4.13	x	22.97	x	0.63	x	0.7	=	57.98	(81)
Northwest 0.9x	0.77	x	6.93	x	41.38	x	0.63	x	0.7	=	87.64	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.13	x	41.38	x	0.63	x	0.7	=	104.46	(81)
Northwest 0.9x	0.77	x	6.93	x	67.96	x	0.63	x	0.7	=	143.92	(81)
Northwest 0.9x	0.77	x	4.13	x	67.96	x	0.63	x	0.7	=	171.55	(81)
Northwest 0.9x	0.77	x	6.93	x	91.35	x	0.63	x	0.7	=	193.46	(81)
Northwest 0.9x	0.77	x	4.13	x	91.35	x	0.63	x	0.7	=	230.59	(81)
Northwest 0.9x	0.77	x	6.93	x	97.38	x	0.63	x	0.7	=	206.25	(81)
Northwest 0.9x	0.77	x	4.13	x	97.38	x	0.63	x	0.7	=	245.83	(81)
Northwest 0.9x	0.77	x	6.93	x	91.1	x	0.63	x	0.7	=	192.94	(81)
Northwest 0.9x	0.77	x	4.13	x	91.1	x	0.63	x	0.7	=	229.97	(81)
Northwest 0.9x	0.77	x	6.93	x	72.63	x	0.63	x	0.7	=	153.82	(81)
Northwest 0.9x	0.77	x	4.13	x	72.63	x	0.63	x	0.7	=	183.34	(81)
Northwest 0.9x	0.77	x	6.93	x	50.42	x	0.63	x	0.7	=	106.79	(81)
Northwest 0.9x	0.77	x	4.13	x	50.42	x	0.63	x	0.7	=	127.28	(81)
Northwest 0.9x	0.77	x	6.93	x	28.07	x	0.63	x	0.7	=	59.44	(81)
Northwest 0.9x	0.77	x	4.13	x	28.07	x	0.63	x	0.7	=	70.85	(81)
Northwest 0.9x	0.77	x	6.93	x	14.2	x	0.63	x	0.7	=	30.07	(81)
Northwest 0.9x	0.77	x	4.13	x	14.2	x	0.63	x	0.7	=	35.84	(81)
Northwest 0.9x	0.77	x	6.93	x	9.21	x	0.63	x	0.7	=	19.51	(81)
Northwest 0.9x	0.77	x	4.13	x	9.21	x	0.63	x	0.7	=	23.26	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	52.38	106.62	192.09	315.47	424.05	452.08	422.92	337.15	234.07	130.3	65.91	42.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	408.92	460.61	533.14	636.04	723.91	731.88	690	610.46	518.12	435.03	394.33	389.03	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.83	0.62	0.47	0.55	0.84	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.82	19.96	20.22	20.59	20.87	20.98	21	20.99	20.89	20.52	20.12	19.81	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.01	20.01	20.02	20.03	20.03	20.04	20.04	20.04	20.04	20.03	20.03	20.02	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.93	0.77	0.54	0.37	0.44	0.77	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.44	18.64	19.02	19.55	19.91	20.03	20.04	20.04	19.95	19.47	18.88	18.42	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.81	18.99	19.34	19.83	20.16	20.28	20.3	20.3	20.21	19.75	19.21	18.79	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.81	18.99	19.34	19.83	20.16	20.28	20.3	20.3	20.21	19.75	19.21	18.79	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.78	0.56	0.39	0.47	0.78	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	407.57	457.59	523.1	590.32	566.04	411.2	272.41	284.95	405.56	420.3	391.75	388.04	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1112.45	1077.06	978.47	820.78	634	420.36	273.52	287.53	453.85	685.48	912.01	1105.26	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	524.43	416.28	338.8	165.92	50.56	0	0	0	0	197.3	374.58	533.61	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2601.48 (98)

Space heating requirement in kWh/m²/year 36.91 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	524.43	416.28	338.8	165.92	50.56	0	0	0	0	197.3	374.58	533.61	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	561.49	445.7	362.74	177.65	54.13	0	0	0	0	211.24	401.05	571.32	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2785.31 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	

Efficiency of water heater 80.3 (216)

(217)m=	87.45	87.24	86.69	85.22	82.62	80.3	80.3	80.3	80.3	85.54	86.94	87.53	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	220.11	192.72	201.8	182.07	181.81	164.77	157.86	175.97	177.92	190.19	199.76	214.73	

Total = Sum(219a)$_{1...12}$ = 2259.71 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2785.31

TER WorkSheet: New dwelling design stage

Water heating fuel used		2259.71	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		312.74	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	601.63	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	488.1	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1089.73	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	162.31	(268)
Total CO2, kg/year		sum of (265)…(271) =			1290.96	(272)

TER = 18.32 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 62

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.12	(1a) x	2.56	(2a) =	130.85	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.12	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.85	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.49	x1/[1/(1.4)+ 0.04]		=	8.6			(27)
Windows Type 2			3.87	x1/[1/(1.4)+ 0.04]		=	5.13			(27)
Floor			51.115	x	0.13	=	6.64495			(28)
Walls Type1	25.24	10.36	14.88	x	0.18	=	2.68			(29)
Walls Type2	33.85	2.42	31.43	x	0.18	=	5.66			(29)
Total area of elements, m²			110.2							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.14 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6409.87 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 2.73 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 33.86 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.71	25.55	25.39	24.65	24.52	23.88	23.88	23.76	24.12	24.52	24.79	25.09	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	59.57	59.41	59.25	58.52	58.38	57.74	57.74	57.62	57.99	58.38	58.66	58.95	

Average = Sum(39)$_{1...12}$ /12= 58.52 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.17	1.16	1.16	1.14	1.14	1.13	1.13	1.13	1.13	1.14	1.15	1.15	

Average = Sum(40)$_{1...12}$ /12= 1.14 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.12 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	82.63	79.63	76.62	73.62	70.61	67.61	67.61	70.61	73.62	76.62	79.63	82.63	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 901.44 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	122.54	107.18	110.6	96.42	92.52	79.84	73.98	84.89	85.91	100.12	109.28	118.67	

Total = Sum(45)$_{1...12}$ = 1181.94 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	18.38	16.08	16.59	14.46	13.88	11.98	11.1	12.73	12.89	15.02	16.39	17.8	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.11	36.65	39.05	36.3	35.98	33.34	34.45	35.98	36.3	39.05	39.27	42.11	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78	

Output from water heater (annual)$_{1...12}$ 1632.53 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.27	44.8	46.53	41.14	39.76	34.88	33.21	37.22	37.64	43.05	46.15	49.99	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.46	11.96	9.72	7.36	5.5	4.65	5.02	6.52	8.76	11.12	12.98	13.83	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	150.13	151.69	147.76	139.4	128.85	118.94	112.31	110.76	114.68	123.04	133.59	143.51	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	(71)

Water heating gains (Table 5)

(72)m=	68.91	66.66	62.55	57.13	53.44	48.45	44.64	50.03	52.28	57.86	64.1	67.19	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	284.35	282.15	271.88	255.74	239.64	223.87	213.82	219.16	227.56	243.87	262.51	276.37	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	6.49	x	11.28	x	0.63	x	0.7	=	22.38	(81)
Northwest 0.9x	0.77	x	3.87	x	11.28	x	0.63	x	0.7	=	13.34	(81)
Northwest 0.9x	0.77	x	6.49	x	22.97	x	0.63	x	0.7	=	45.55	(81)
Northwest 0.9x	0.77	x	3.87	x	22.97	x	0.63	x	0.7	=	27.16	(81)
Northwest 0.9x	0.77	x	6.49	x	41.38	x	0.63	x	0.7	=	82.07	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.87	x	41.38	x	0.63	x	0.7	=	48.94	(81)
Northwest 0.9x	0.77	x	6.49	x	67.96	x	0.63	x	0.7	=	134.79	(81)
Northwest 0.9x	0.77	x	3.87	x	67.96	x	0.63	x	0.7	=	80.37	(81)
Northwest 0.9x	0.77	x	6.49	x	91.35	x	0.63	x	0.7	=	181.18	(81)
Northwest 0.9x	0.77	x	3.87	x	91.35	x	0.63	x	0.7	=	108.04	(81)
Northwest 0.9x	0.77	x	6.49	x	97.38	x	0.63	x	0.7	=	193.16	(81)
Northwest 0.9x	0.77	x	3.87	x	97.38	x	0.63	x	0.7	=	115.18	(81)
Northwest 0.9x	0.77	x	6.49	x	91.1	x	0.63	x	0.7	=	180.69	(81)
Northwest 0.9x	0.77	x	3.87	x	91.1	x	0.63	x	0.7	=	107.75	(81)
Northwest 0.9x	0.77	x	6.49	x	72.63	x	0.63	x	0.7	=	144.05	(81)
Northwest 0.9x	0.77	x	3.87	x	72.63	x	0.63	x	0.7	=	85.9	(81)
Northwest 0.9x	0.77	x	6.49	x	50.42	x	0.63	x	0.7	=	100.01	(81)
Northwest 0.9x	0.77	x	3.87	x	50.42	x	0.63	x	0.7	=	59.63	(81)
Northwest 0.9x	0.77	x	6.49	x	28.07	x	0.63	x	0.7	=	55.67	(81)
Northwest 0.9x	0.77	x	3.87	x	28.07	x	0.63	x	0.7	=	33.2	(81)
Northwest 0.9x	0.77	x	6.49	x	14.2	x	0.63	x	0.7	=	28.16	(81)
Northwest 0.9x	0.77	x	3.87	x	14.2	x	0.63	x	0.7	=	16.79	(81)
Northwest 0.9x	0.77	x	6.49	x	9.21	x	0.63	x	0.7	=	18.28	(81)
Northwest 0.9x	0.77	x	3.87	x	9.21	x	0.63	x	0.7	=	10.9	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	35.72	72.72	131.01	215.16	289.22	308.33	288.44	229.95	159.64	88.86	44.95	29.17	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	320.07	354.87	402.89	470.9	528.85	532.21	502.26	449.1	387.2	332.73	307.46	305.54	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.85	0.66	0.5	0.57	0.85	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.76	19.89	20.15	20.52	20.82	20.96	20.99	20.99	20.87	20.48	20.06	19.74	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.95	19.95	19.95	19.96	19.97	19.98	19.98	19.98	19.97	19.97	19.96	19.96	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.94	0.79	0.57	0.39	0.45	0.78	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.3	18.5	18.88	19.41	19.8	19.95	19.97	19.97	19.87	19.36	18.75	18.28	(90)

fLA = Living area ÷ (4) = 0.37 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.84	19.02	19.35	19.82	20.18	20.33	20.35	20.35	20.24	19.78	19.24	18.82	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.84	19.02	19.35	19.82	20.18	20.33	20.35	20.35	20.24	19.78	19.24	18.82	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.81	0.6	0.43	0.5	0.8	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	318.64	352.03	394.81	439.37	426.27	319.04	214.96	224.01	309.18	320.7	304.9	304.45	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	866.42	838.61	761.43	639.13	495.01	330.77	216.66	227.55	355.95	535.71	712.12	861.97	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	407.55	326.98	272.77	143.82	51.14	0	0	0	0	159.97	293.19	414.79	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2070.22 (98)

Space heating requirement in kWh/m²/year 40.5 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	407.55	326.98	272.77	143.82	51.14	0	0	0	0	159.97	293.19	414.79	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	436.35	350.08	292.04	153.99	54.76	0	0	0	0	171.27	313.91	444.1	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2216.5 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78

Efficiency of water heater 80.3 (216)

(217)m=	87.24	87.05	86.54	85.25	82.94	80.3	80.3	80.3	80.3	85.4	86.73	87.33	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	188.73	165.21	172.91	155.68	154.94	140.94	135.03	150.53	152.19	162.95	171.28	184.11	

Total = Sum(219a)$_{1...12}$ = 1934.5 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2216.5

TER WorkSheet: New dwelling design stage

Water heating fuel used			1934.5	
Electricity for pumps, fans and electric keep-hot				
central heating pump:		30		(230c)
boiler with a fan-assisted flue		45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		75	(231)
Electricity for lighting			237.72	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	478.76	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	417.85	(264)
Space and water heating	(261) + (262) + (263) + (264) =				896.62	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	123.37	(268)
Total CO2, kg/year		sum of (265)…(271) =			1058.92	(272)

TER = 20.72 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 63

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	77.53	(1a) x	2.56	(2a) =	198.47	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	77.53	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		198.47	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.15 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.43	0.43	0.42	0.38	0.37	0.32	0.32	0.32	0.34	0.37	0.38	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.61	x1/[1/(1.4)+ 0.04]		=	8.76			(27)
Windows Type 2			3.94	x1/[1/(1.4)+ 0.04]		=	5.22			(27)
Windows Type 3			2.47	x1/[1/(1.4)+ 0.04]		=	3.27			(27)
Walls Type1	54.38	16.96	37.42	x	0.18	=	6.74			(29)
Walls Type2	14.93	2.42	12.51	x	0.18	=	2.25			(29)
Total area of elements, m²			69.31							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.89 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 848.86 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.74 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 37.64 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	38.94	38.7	38.46	37.35	37.15	36.18	36.18	36.01	36.56	37.15	37.57	38	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	76.58	76.33	76.1	74.99	74.79	73.82	73.82	73.64	74.19	74.79	75.2	75.64	

Average = Sum(39)$_{1...12}$ /12= 74.99 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.99	0.98	0.98	0.97	0.96	0.95	0.95	0.95	0.96	0.96	0.97	0.98

Average = Sum(40)$_{1...12}$ /12= 0.97 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.41 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 91.54 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	100.69	97.03	93.37	89.71	86.05	82.39	82.39	86.05	89.71	93.37	97.03	100.69	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1098.47 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	149.33	130.6	134.77	117.49	112.74	97.28	90.15	103.45	104.68	122	133.17	144.61

Total = Sum(45)$_{1...12}$ = 1440.27 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	22.4	19.59	20.22	17.62	16.91	14.59	13.52	15.52	15.7	18.3	19.98	21.69

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	44.66	47.58	44.24	43.85	40.63	41.98	43.85	44.24	47.58	47.85	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	

Output from water heater (annual)$_{1...12}$ 1988.65 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	62.39	54.59	56.71	50.13	48.45	42.5	40.47	45.36	45.87	52.46	56.24	60.82	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	19.11	16.97	13.8	10.45	7.81	6.59	7.12	9.26	12.43	15.78	18.42	19.64	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	214.2	216.42	210.82	198.89	183.84	169.7	160.24	158.02	163.62	175.55	190.6	204.75	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	(71)

Water heating gains (Table 5)

(72)m=	83.86	81.24	76.22	69.62	65.12	59.03	54.4	60.97	63.7	70.51	78.11	81.75	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	379.37	376.84	363.05	341.18	318.98	297.54	283.98	290.46	301.97	324.05	349.35	368.35	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.47	x	11.28	x	0.63	x	0.7	=	8.52	(75)
Northeast 0.9x	0.77	x	2.47	x	22.97	x	0.63	x	0.7	=	17.34	(75)
Northeast 0.9x	0.77	x	2.47	x	41.38	x	0.63	x	0.7	=	31.24	(75)
Northeast 0.9x	0.77	x	2.47	x	67.96	x	0.63	x	0.7	=	51.3	(75)
Northeast 0.9x	0.77	x	2.47	x	91.35	x	0.63	x	0.7	=	68.95	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.47	x	97.38	x	0.63	x	0.7	=	73.51	(75)
Northeast 0.9x	0.77	x	2.47	x	91.1	x	0.63	x	0.7	=	68.77	(75)
Northeast 0.9x	0.77	x	2.47	x	72.63	x	0.63	x	0.7	=	54.82	(75)
Northeast 0.9x	0.77	x	2.47	x	50.42	x	0.63	x	0.7	=	38.06	(75)
Northeast 0.9x	0.77	x	2.47	x	28.07	x	0.63	x	0.7	=	21.19	(75)
Northeast 0.9x	0.77	x	2.47	x	14.2	x	0.63	x	0.7	=	10.72	(75)
Northeast 0.9x	0.77	x	2.47	x	9.21	x	0.63	x	0.7	=	6.96	(75)
Southeast 0.9x	0.77	x	6.61	x	36.79	x	0.63	x	0.7	=	74.33	(77)
Southeast 0.9x	0.77	x	3.94	x	36.79	x	0.63	x	0.7	=	88.61	(77)
Southeast 0.9x	0.77	x	6.61	x	62.67	x	0.63	x	0.7	=	126.61	(77)
Southeast 0.9x	0.77	x	3.94	x	62.67	x	0.63	x	0.7	=	150.93	(77)
Southeast 0.9x	0.77	x	6.61	x	85.75	x	0.63	x	0.7	=	173.23	(77)
Southeast 0.9x	0.77	x	3.94	x	85.75	x	0.63	x	0.7	=	206.51	(77)
Southeast 0.9x	0.77	x	6.61	x	106.25	x	0.63	x	0.7	=	214.64	(77)
Southeast 0.9x	0.77	x	3.94	x	106.25	x	0.63	x	0.7	=	255.88	(77)
Southeast 0.9x	0.77	x	6.61	x	119.01	x	0.63	x	0.7	=	240.41	(77)
Southeast 0.9x	0.77	x	3.94	x	119.01	x	0.63	x	0.7	=	286.61	(77)
Southeast 0.9x	0.77	x	6.61	x	118.15	x	0.63	x	0.7	=	238.68	(77)
Southeast 0.9x	0.77	x	3.94	x	118.15	x	0.63	x	0.7	=	284.53	(77)
Southeast 0.9x	0.77	x	6.61	x	113.91	x	0.63	x	0.7	=	230.11	(77)
Southeast 0.9x	0.77	x	3.94	x	113.91	x	0.63	x	0.7	=	274.32	(77)
Southeast 0.9x	0.77	x	6.61	x	104.39	x	0.63	x	0.7	=	210.88	(77)
Southeast 0.9x	0.77	x	3.94	x	104.39	x	0.63	x	0.7	=	251.4	(77)
Southeast 0.9x	0.77	x	6.61	x	92.85	x	0.63	x	0.7	=	187.57	(77)
Southeast 0.9x	0.77	x	3.94	x	92.85	x	0.63	x	0.7	=	223.61	(77)
Southeast 0.9x	0.77	x	6.61	x	69.27	x	0.63	x	0.7	=	139.93	(77)
Southeast 0.9x	0.77	x	3.94	x	69.27	x	0.63	x	0.7	=	166.81	(77)
Southeast 0.9x	0.77	x	6.61	x	44.07	x	0.63	x	0.7	=	89.03	(77)
Southeast 0.9x	0.77	x	3.94	x	44.07	x	0.63	x	0.7	=	106.13	(77)
Southeast 0.9x	0.77	x	6.61	x	31.49	x	0.63	x	0.7	=	63.61	(77)
Southeast 0.9x	0.77	x	3.94	x	31.49	x	0.63	x	0.7	=	75.83	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	171.45	294.88	410.98	521.81	595.97	596.72	573.2	517.1	449.24	327.93	205.88	146.39	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	550.83	671.71	774.03	862.99	914.96	894.26	857.18	807.56	751.21	651.98	555.22	514.74	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.96	0.87	0.72	0.52	0.38	0.42	0.66	0.92	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.09	20.29	20.55	20.81	20.95	20.99	21	21	20.98	20.77	20.38	20.05	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.1	20.1	20.11	20.11	20.12	20.12	20.13	20.12	20.11	20.11	20.1	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.66	0.45	0.3	0.34	0.58	0.89	0.98	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.88	19.18	19.54	19.9	20.07	20.12	20.12	20.12	20.1	19.87	19.32	18.84	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.15	19.42	19.76	20.1	20.26	20.31	20.31	20.32	20.29	20.07	19.55	19.1	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.15	19.42	19.76	20.1	20.26	20.31	20.31	20.32	20.29	20.07	19.55	19.1	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.94	0.84	0.67	0.47	0.32	0.36	0.6	0.89	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	546.18	655.95	726.43	725.57	613.61	418.78	273.94	287.89	449.01	577.42	543.81	511.63	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1136.82	1108.52	1009.16	839.76	640.19	421.51	274.18	288.33	459.5	707.95	936.05	1127.29	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	439.44	304.13	210.35	82.22	19.78	0	0	0	0	97.11	282.41	458.05	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1893.49 (98)

Space heating requirement in kWh/m²/year 24.42 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	439.44	304.13	210.35	82.22	19.78	0	0	0	0	97.11	282.41	458.05	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	470.49	325.62	225.22	88.03	21.17	0	0	0	0	103.97	302.37	490.42	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2027.29 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57

Efficiency of water heater 80.3 (216)

(217)m=	86.98	86.43	85.41	83.44	81.32	80.3	80.3	80.3	80.3	83.71	86.17	87.12

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	230.28	202.79	213.49	193.83	192.56	171.75	164.55	183.43	185.46	202.59	210.08	224.48

Total = Sum(219a)$_{1...12}$ = 2375.28 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2027.29	
Water heating fuel used		2375.28	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		337.42	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	437.89	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	513.06	(264)
Space and water heating	(261) + (262) + (263) + (264) =			950.96	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	175.12	(268)
Total CO2, kg/year	sum of (265)…(271) =			1165	(272)

TER = 15.03 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 64

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.94	(1a) x	2.56	(2a) =	130.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.94	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.24	x1/[1/(1.4)+ 0.04]		=	6.95			(27)
Windows Type 2			3.12	x1/[1/(1.4)+ 0.04]		=	4.14			(27)
Windows Type 3			1.95	x1/[1/(1.4)+ 0.04]		=	2.59			(27)
Walls Type1	24.35	10.31	14.04	x	0.18	=	2.53			(29)
Walls Type2	39.32	2.42	36.9	x	0.18	=	6.64			(29)
Total area of elements, m²			63.67							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 25.26 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 865.9 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 1.52 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 26.78 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.63	25.47	25.31	24.58	24.44	23.8	23.8	23.68	24.05	24.44	24.72	25.01	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	52.41	52.25	52.09	51.36	51.22	50.58	50.58	50.46	50.83	51.22	51.5	51.79	

Average = Sum(39)$_{1...12}$ /12= 51.36 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.03	1.03	1.02	1.01	1.01	0.99	0.99	0.99	1	1.01	1.01	1.02	
Average = Sum(40)$_{1...12}$ /12=													1.01 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	82.5	79.5	76.5	73.5	70.5	67.5	67.5	70.5	73.5	76.5	79.5	82.5	
Total = Sum(44)$_{1...12}$ =													900.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.35	107.01	110.42	96.27	92.37	79.71	73.86	84.76	85.77	99.96	109.11	118.49	
Total = Sum(45)$_{1...12}$ =													1180.06 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.35	16.05	16.56	14.44	13.86	11.96	11.08	12.71	12.87	14.99	16.37	17.77	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.04	36.59	38.98	36.25	35.93	33.29	34.4	35.93	36.25	38.98	39.21	42.04	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53	

Output from water heater (annual)$_{1...12}$ 1629.95 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.19	44.73	46.46	41.07	39.69	34.83	33.16	37.16	37.58	42.98	46.08	49.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.42	11.92	9.7	7.34	5.49	4.63	5.01	6.51	8.73	11.09	12.94	13.8	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.69	151.24	147.33	138.99	128.48	118.59	111.98	110.43	114.35	122.68	133.2	143.08	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	(71)

Water heating gains (Table 5)

(72)m=	68.8	66.56	62.45	57.04	53.35	48.37	44.57	49.95	52.19	57.77	64	67.08	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	283.69	281.49	271.24	255.15	239.08	223.36	213.33	218.66	227.04	243.31	261.91	275.73	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	1.95	x	11.28	x	0.63	x	0.7	=	6.72	(75)
Northeast 0.9x	0.77	x	1.95	x	22.97	x	0.63	x	0.7	=	13.69	(75)
Northeast 0.9x	0.77	x	1.95	x	41.38	x	0.63	x	0.7	=	24.66	(75)
Northeast 0.9x	0.77	x	1.95	x	67.96	x	0.63	x	0.7	=	40.5	(75)
Northeast 0.9x	0.77	x	1.95	x	91.35	x	0.63	x	0.7	=	54.44	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	1.95	x	97.38	x	0.63	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	1.95	x	91.1	x	0.63	x	0.7	=	54.29	(75)
Northeast 0.9x	0.77	x	1.95	x	72.63	x	0.63	x	0.7	=	43.28	(75)
Northeast 0.9x	0.77	x	1.95	x	50.42	x	0.63	x	0.7	=	30.05	(75)
Northeast 0.9x	0.77	x	1.95	x	28.07	x	0.63	x	0.7	=	16.73	(75)
Northeast 0.9x	0.77	x	1.95	x	14.2	x	0.63	x	0.7	=	8.46	(75)
Northeast 0.9x	0.77	x	1.95	x	9.21	x	0.63	x	0.7	=	5.49	(75)
Southeast 0.9x	0.77	x	5.24	x	36.79	x	0.63	x	0.7	=	58.92	(77)
Southeast 0.9x	0.77	x	3.12	x	36.79	x	0.63	x	0.7	=	35.08	(77)
Southeast 0.9x	0.77	x	5.24	x	62.67	x	0.63	x	0.7	=	100.37	(77)
Southeast 0.9x	0.77	x	3.12	x	62.67	x	0.63	x	0.7	=	59.76	(77)
Southeast 0.9x	0.77	x	5.24	x	85.75	x	0.63	x	0.7	=	137.33	(77)
Southeast 0.9x	0.77	x	3.12	x	85.75	x	0.63	x	0.7	=	81.77	(77)
Southeast 0.9x	0.77	x	5.24	x	106.25	x	0.63	x	0.7	=	170.15	(77)
Southeast 0.9x	0.77	x	3.12	x	106.25	x	0.63	x	0.7	=	101.31	(77)
Southeast 0.9x	0.77	x	5.24	x	119.01	x	0.63	x	0.7	=	190.59	(77)
Southeast 0.9x	0.77	x	3.12	x	119.01	x	0.63	x	0.7	=	113.48	(77)
Southeast 0.9x	0.77	x	5.24	x	118.15	x	0.63	x	0.7	=	189.21	(77)
Southeast 0.9x	0.77	x	3.12	x	118.15	x	0.63	x	0.7	=	112.66	(77)
Southeast 0.9x	0.77	x	5.24	x	113.91	x	0.63	x	0.7	=	182.42	(77)
Southeast 0.9x	0.77	x	3.12	x	113.91	x	0.63	x	0.7	=	108.61	(77)
Southeast 0.9x	0.77	x	5.24	x	104.39	x	0.63	x	0.7	=	167.17	(77)
Southeast 0.9x	0.77	x	3.12	x	104.39	x	0.63	x	0.7	=	99.54	(77)
Southeast 0.9x	0.77	x	5.24	x	92.85	x	0.63	x	0.7	=	148.69	(77)
Southeast 0.9x	0.77	x	3.12	x	92.85	x	0.63	x	0.7	=	88.54	(77)
Southeast 0.9x	0.77	x	5.24	x	69.27	x	0.63	x	0.7	=	110.93	(77)
Southeast 0.9x	0.77	x	3.12	x	69.27	x	0.63	x	0.7	=	66.05	(77)
Southeast 0.9x	0.77	x	5.24	x	44.07	x	0.63	x	0.7	=	70.58	(77)
Southeast 0.9x	0.77	x	3.12	x	44.07	x	0.63	x	0.7	=	42.02	(77)
Southeast 0.9x	0.77	x	5.24	x	31.49	x	0.63	x	0.7	=	50.43	(77)
Southeast 0.9x	0.77	x	3.12	x	31.49	x	0.63	x	0.7	=	30.02	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	100.73	173.81	243.75	311.96	358.5	359.9	345.32	309.99	267.28	193.7	121.06	85.94	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	384.41	455.3	514.99	567.11	597.59	583.26	558.65	528.65	494.32	437.01	382.97	361.67	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.88	0.74	0.55	0.4	0.44	0.68	0.92	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.07	20.26	20.51	20.77	20.93	20.99	21	21	20.97	20.75	20.36	20.04	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.06	20.06	20.06	20.08	20.08	20.09	20.09	20.09	20.09	20.08	20.07	20.07	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.85	0.68	0.47	0.32	0.35	0.6	0.89	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.83	19.11	19.46	19.83	20.02	20.08	20.09	20.09	20.06	19.81	19.26	18.79	(90)

fLA = Living area ÷ (4) = 0.28 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.18	19.43	19.75	20.09	20.28	20.34	20.34	20.34	20.32	20.07	19.57	19.14	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.18	19.43	19.75	20.09	20.28	20.34	20.34	20.34	20.32	20.07	19.57	19.14	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.94	0.85	0.7	0.49	0.34	0.38	0.62	0.89	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	380.39	444.02	484.61	484.29	415.41	287.37	189.08	198.56	306.37	388.62	374.03	358.83	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	779.8	759.12	690.32	574.81	439.27	290.2	189.36	199.05	316	485.27	642.23	773.71	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	297.16	211.74	153.05	65.17	17.75	0	0	0	0	71.91	193.1	308.67	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1318.56 (98)

Space heating requirement in kWh/m²/year 25.88 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	297.16	211.74	153.05	65.17	17.75	0	0	0	0	71.91	193.1	308.67	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	318.16	226.7	163.87	69.78	19	0	0	0	0	76.99	206.75	330.48	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1411.74 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53

Efficiency of water heater 80.3 (216)

(217)m= 86.52 | 86.03 | 85.11 | 83.37 | 81.41 | 80.3 | 80.3 | 80.3 | 80.3 | 83.48 | 85.72 | 86.67 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 189.99 | 166.92 | 175.54 | 158.95 | 157.6 | 140.72 | 134.82 | 150.29 | 151.95 | 166.43 | 173.03 | 185.22

Total = Sum(219a)$_{1...12}$ = 1951.47 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1411.74	
Water heating fuel used		1951.47	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		237.05	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	304.94	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	421.52	(264)
Space and water heating	(261) + (262) + (263) + (264) =			726.45	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	123.03	(268)
Total CO2, kg/year	sum of (265)…(271) =			888.41	(272)

TER = 17.44 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 65

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	56.64	(1a) x	2.56	(2a) =	145	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	56.64	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		145	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.14 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.39 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.33 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.42	0.41	0.4	0.36	0.35	0.31	0.31	0.31	0.33	0.35	0.37	0.39

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.58	0.58	0.57	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.58	0.58	0.57	0.56	0.55	0.55	0.55	0.55	0.56	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.96	x1/[1/(1.4)+ 0.04]		=	7.9			(27)
Windows Type 2			3.55	x1/[1/(1.4)+ 0.04]		=	4.71			(27)
Windows Type 3			2.22	x1/[1/(1.4)+ 0.04]		=	2.94			(27)
Floor			56.64	x	0.13	=	7.3632			(28)
Walls Type1	48.55	11.73	36.82	x	0.18	=	6.63			(29)
Walls Type2	29.38	2.42	26.96	x	0.18	=	4.85			(29)
Total area of elements, m²			134.57							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 36.81 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 5332.24 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.32 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 41.14 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	28.15	27.99	27.83	27.07	26.93	26.27	26.27	26.15	26.53	26.93	27.22	27.52	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	69.29	69.13	68.97	68.21	68.07	67.41	67.41	67.29	67.67	68.07	68.36	68.66	

Average = Sum(39)$_{1...12}$ /12= 68.21 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.22	1.22	1.22	1.2	1.2	1.19	1.19	1.19	1.19	1.2	1.21	1.21

Average = Sum(40)$_{1...12}$ /12= 1.2 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.89 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 78.97 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	86.87	83.71	80.55	77.39	74.24	71.08	71.08	74.24	77.39	80.55	83.71	86.87

Total = Sum(44)$_{1...12}$ = 947.69 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	128.83	112.67	116.27	101.37	97.26	83.93	77.77	89.25	90.31	105.25	114.89	124.76

Total = Sum(45)$_{1...12}$ = 1242.57 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.32	16.9	17.44	15.2	14.59	12.59	11.67	13.39	13.55	15.79	17.23	18.71

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	44.27	38.53	41.05	38.17	37.83	35.05	36.22	37.83	38.17	41.05	41.28	44.27	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	173.1	151.2	157.32	139.53	135.09	118.98	113.99	127.08	128.48	146.3	156.17	169.03	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	173.1	151.2	157.32	139.53	135.09	118.98	113.99	127.08	128.48	146.3	156.17	169.03	

Output from water heater (annual)$_{1...12}$ 1716.28 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	53.9	47.1	48.92	43.25	41.8	36.67	34.91	39.13	39.57	45.26	48.52	52.55	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	14.71	13.07	10.63	8.05	6.01	5.08	5.49	7.13	9.57	12.15	14.18	15.12	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	164.4	166.11	161.81	152.66	141.1	130.24	122.99	121.29	125.58	134.74	146.29	157.15	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	(71)

Water heating gains (Table 5)

(72)m=	72.45	70.08	65.76	60.06	56.18	50.93	46.93	52.6	54.96	60.83	67.39	70.63	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	305.84	303.54	292.47	275.04	257.57	240.53	229.68	235.29	244.39	262	282.14	297.18	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.22	x	11.28	x	0.63	x	0.7	=	7.66	(75)
Northeast 0.9x	0.77	x	2.22	x	22.97	x	0.63	x	0.7	=	15.58	(75)
Northeast 0.9x	0.77	x	2.22	x	41.38	x	0.63	x	0.7	=	28.07	(75)
Northeast 0.9x	0.77	x	2.22	x	67.96	x	0.63	x	0.7	=	46.11	(75)
Northeast 0.9x	0.77	x	2.22	x	91.35	x	0.63	x	0.7	=	61.97	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.22	x	97.38	x	0.63	x	0.7	=	66.07	(75)
Northeast 0.9x	0.77	x	2.22	x	91.1	x	0.63	x	0.7	=	61.81	(75)
Northeast 0.9x	0.77	x	2.22	x	72.63	x	0.63	x	0.7	=	49.27	(75)
Northeast 0.9x	0.77	x	2.22	x	50.42	x	0.63	x	0.7	=	34.21	(75)
Northeast 0.9x	0.77	x	2.22	x	28.07	x	0.63	x	0.7	=	19.04	(75)
Northeast 0.9x	0.77	x	2.22	x	14.2	x	0.63	x	0.7	=	9.63	(75)
Northeast 0.9x	0.77	x	2.22	x	9.21	x	0.63	x	0.7	=	6.25	(75)
Southeast 0.9x	0.77	x	5.96	x	36.79	x	0.63	x	0.7	=	67.02	(77)
Southeast 0.9x	0.77	x	3.55	x	36.79	x	0.63	x	0.7	=	39.92	(77)
Southeast 0.9x	0.77	x	5.96	x	62.67	x	0.63	x	0.7	=	114.16	(77)
Southeast 0.9x	0.77	x	3.55	x	62.67	x	0.63	x	0.7	=	68	(77)
Southeast 0.9x	0.77	x	5.96	x	85.75	x	0.63	x	0.7	=	156.19	(77)
Southeast 0.9x	0.77	x	3.55	x	85.75	x	0.63	x	0.7	=	93.04	(77)
Southeast 0.9x	0.77	x	5.96	x	106.25	x	0.63	x	0.7	=	193.53	(77)
Southeast 0.9x	0.77	x	3.55	x	106.25	x	0.63	x	0.7	=	115.28	(77)
Southeast 0.9x	0.77	x	5.96	x	119.01	x	0.63	x	0.7	=	216.77	(77)
Southeast 0.9x	0.77	x	3.55	x	119.01	x	0.63	x	0.7	=	129.12	(77)
Southeast 0.9x	0.77	x	5.96	x	118.15	x	0.63	x	0.7	=	215.2	(77)
Southeast 0.9x	0.77	x	3.55	x	118.15	x	0.63	x	0.7	=	128.18	(77)
Southeast 0.9x	0.77	x	5.96	x	113.91	x	0.63	x	0.7	=	207.48	(77)
Southeast 0.9x	0.77	x	3.55	x	113.91	x	0.63	x	0.7	=	123.58	(77)
Southeast 0.9x	0.77	x	5.96	x	104.39	x	0.63	x	0.7	=	190.14	(77)
Southeast 0.9x	0.77	x	3.55	x	104.39	x	0.63	x	0.7	=	113.26	(77)
Southeast 0.9x	0.77	x	5.96	x	92.85	x	0.63	x	0.7	=	169.13	(77)
Southeast 0.9x	0.77	x	3.55	x	92.85	x	0.63	x	0.7	=	100.74	(77)
Southeast 0.9x	0.77	x	5.96	x	69.27	x	0.63	x	0.7	=	126.17	(77)
Southeast 0.9x	0.77	x	3.55	x	69.27	x	0.63	x	0.7	=	75.15	(77)
Southeast 0.9x	0.77	x	5.96	x	44.07	x	0.63	x	0.7	=	80.27	(77)
Southeast 0.9x	0.77	x	3.55	x	44.07	x	0.63	x	0.7	=	47.81	(77)
Southeast 0.9x	0.77	x	5.96	x	31.49	x	0.63	x	0.7	=	57.35	(77)
Southeast 0.9x	0.77	x	3.55	x	31.49	x	0.63	x	0.7	=	34.16	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	114.59	197.73	277.3	354.91	407.86	409.46	392.87	352.67	304.07	220.36	137.72	97.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	420.43	501.27	569.77	629.96	665.44	649.99	622.56	587.96	548.46	482.36	419.86	394.95	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.99	0.97	0.92	0.81	0.63	0.47	0.52	0.76	0.94	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.79	19.99	20.27	20.6	20.84	20.96	20.99	20.99	20.91	20.59	20.12	19.75	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.9	19.9	19.91	19.92	19.92	19.93	19.93	19.93	19.92	19.92	19.91	19.91	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.96	0.89	0.75	0.54	0.36	0.4	0.67	0.92	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.31	18.6	19	19.46	19.77	19.91	19.93	19.93	19.86	19.46	18.8	18.26	(90)

fLA = Living area ÷ (4) = 0.3 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.75	19.01	19.38	19.8	20.09	20.22	20.24	20.24	20.18	19.8	19.2	18.71	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.75	19.01	19.38	19.8	20.09	20.22	20.24	20.24	20.18	19.8	19.2	18.71	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.89	0.76	0.56	0.39	0.44	0.69	0.92	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	416.57	491.04	543.54	560.47	505.98	367.16	244.05	255.95	380.18	442.42	411.91	392.17	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1001.45	975.64	888.15	743.52	571.28	378.95	245.63	258.57	411.12	625.98	826.85	996.05	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	435.15	325.65	256.39	131.79	48.58	0	0	0	0	136.56	298.76	449.29	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2082.17 (98)

Space heating requirement in kWh/m²/year 36.76 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	435.15	325.65	256.39	131.79	48.58	0	0	0	0	136.56	298.76	449.29	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	465.9	348.66	274.51	141.11	52.01	0	0	0	0	146.21	319.87	481.04	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2229.3 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	173.1	151.2	157.32	139.53	135.09	118.98	113.99	127.08	128.48	146.3	156.17	169.03

Efficiency of water heater 80.3 (216)

(217)m= 87.28 | 86.93 | 86.27 | 84.91 | 82.75 | 80.3 | 80.3 | 80.3 | 80.3 | 84.88 | 86.66 | 87.39 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 198.33 | 173.93 | 182.35 | 164.34 | 163.26 | 148.17 | 141.96 | 158.25 | 160 | 172.36 | 180.22 | 193.41

Total = Sum(219a)$_{1...12}$ = 2036.59 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2229.3	
Water heating fuel used		2036.59	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		259.82	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	481.53	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	439.9	(264)
Space and water heating	(261) + (262) + (263) + (264) =			921.43	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	134.85	(268)
Total CO2, kg/year	sum of (265)…(271) =			1095.2	(272)

TER = 19.34 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 66

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	64.03	(1a) x	2.56	(2a) =	163.91	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	64.03	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		163.91	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.12 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.37 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.32 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.4	0.4	0.39	0.35	0.34	0.3	0.3	0.29	0.32	0.34	0.36	0.37

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.58	0.58	0.58	0.56	0.56	0.55	0.55	0.54	0.55	0.56	0.56	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.58	0.58	0.58	0.56	0.56	0.55	0.55	0.54	0.55	0.56	0.56	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.2	x	1/[1/(1.4)+ 0.04]	=	8.22			(27)
Windows Type 2			3.69	x	1/[1/(1.4)+ 0.04]	=	4.89			(27)
Floor			13.616	x	0.13	=	1.77008			(28)
Walls Type1	47.15	13.58	33.57	x	0.18	=	6.04			(29)
Walls Type2	31.49	2.42	29.07	x	0.18	=	5.23			(29)
Total area of elements, m²			92.25							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.47 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 2086.05 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.46 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 38.93 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	31.44	31.27	31.1	30.32	30.17	29.49	29.49	29.36	29.75	30.17	30.47	30.78	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	70.37	70.2	70.03	69.25	69.1	68.42	68.42	68.29	68.68	69.1	69.4	69.71	

Average = Sum(39)$_{1...12}$ /12= 69.25 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.1	1.1	1.09	1.08	1.08	1.07	1.07	1.07	1.07	1.08	1.08	1.09

Average = Sum(40)$_{1...12}$ /12= 1.08 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.09 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 83.91 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	92.3	88.94	85.58	82.23	78.87	75.52	75.52	78.87	82.23	85.58	88.94	92.3

Total = Sum(44)$_{1...12}$ = 1006.88 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	136.87	119.71	123.53	107.7	103.34	89.17	82.63	94.82	95.95	111.82	122.07	132.56

Total = Sum(45)$_{1...12}$ = 1320.18 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	20.53	17.96	18.53	16.15	15.5	13.38	12.39	14.22	14.39	16.77	18.31	19.88

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.03	40.94	43.61	40.55	40.19	37.24	38.48	40.19	40.55	43.61	43.86	47.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	183.91	160.65	167.14	148.25	143.53	126.41	121.11	135.01	136.5	155.44	165.93	179.59	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	183.91	160.65	167.14	148.25	143.53	126.41	121.11	135.01	136.5	155.44	165.93	179.59	

Output from water heater (annual)$_{1...12}$ 1823.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	57.27	50.04	51.98	45.95	44.41	38.96	37.1	41.58	42.04	48.09	51.55	55.83	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.35	14.52	11.81	8.94	6.68	5.64	6.1	7.92	10.63	13.5	15.76	16.8	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	182.98	184.88	180.09	169.9	157.05	144.96	136.89	134.99	139.77	149.96	162.82	174.9	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	(71)

Water heating gains (Table 5)

(72)m=	76.97	74.46	69.86	63.82	59.69	54.11	49.86	55.88	58.39	64.63	71.6	75.04	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	333.69	331.25	319.15	300.05	280.81	262.11	250.24	256.19	266.19	285.49	307.57	324.14	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	6.2	x	36.79	x	0.63	x	0.7	=	69.72	(77)
Southeast 0.9x	0.77	x	3.69	x	36.79	x	0.63	x	0.7	=	82.99	(77)
Southeast 0.9x	0.77	x	6.2	x	62.67	x	0.63	x	0.7	=	118.75	(77)
Southeast 0.9x	0.77	x	3.69	x	62.67	x	0.63	x	0.7	=	141.36	(77)
Southeast 0.9x	0.77	x	6.2	x	85.75	x	0.63	x	0.7	=	162.48	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	3.69	x	85.75	x	0.63	x	0.7	=	193.41	(77)
Southeast 0.9x	0.77	x	6.2	x	106.25	x	0.63	x	0.7	=	201.33	(77)
Southeast 0.9x	0.77	x	3.69	x	106.25	x	0.63	x	0.7	=	239.64	(77)
Southeast 0.9x	0.77	x	6.2	x	119.01	x	0.63	x	0.7	=	225.5	(77)
Southeast 0.9x	0.77	x	3.69	x	119.01	x	0.63	x	0.7	=	268.42	(77)
Southeast 0.9x	0.77	x	6.2	x	118.15	x	0.63	x	0.7	=	223.87	(77)
Southeast 0.9x	0.77	x	3.69	x	118.15	x	0.63	x	0.7	=	266.48	(77)
Southeast 0.9x	0.77	x	6.2	x	113.91	x	0.63	x	0.7	=	215.84	(77)
Southeast 0.9x	0.77	x	3.69	x	113.91	x	0.63	x	0.7	=	256.91	(77)
Southeast 0.9x	0.77	x	6.2	x	104.39	x	0.63	x	0.7	=	197.8	(77)
Southeast 0.9x	0.77	x	3.69	x	104.39	x	0.63	x	0.7	=	235.44	(77)
Southeast 0.9x	0.77	x	6.2	x	92.85	x	0.63	x	0.7	=	175.94	(77)
Southeast 0.9x	0.77	x	3.69	x	92.85	x	0.63	x	0.7	=	209.42	(77)
Southeast 0.9x	0.77	x	6.2	x	69.27	x	0.63	x	0.7	=	131.25	(77)
Southeast 0.9x	0.77	x	3.69	x	69.27	x	0.63	x	0.7	=	156.23	(77)
Southeast 0.9x	0.77	x	6.2	x	44.07	x	0.63	x	0.7	=	83.5	(77)
Southeast 0.9x	0.77	x	3.69	x	44.07	x	0.63	x	0.7	=	99.4	(77)
Southeast 0.9x	0.77	x	6.2	x	31.49	x	0.63	x	0.7	=	59.66	(77)
Southeast 0.9x	0.77	x	3.69	x	31.49	x	0.63	x	0.7	=	71.02	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	152.7	260.11	355.89	440.97	493.92	490.35	472.75	433.24	385.36	287.48	182.9	130.68	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	486.39	591.36	675.05	741.02	774.73	752.46	722.99	689.43	651.55	572.96	490.48	454.82	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.89	0.75	0.57	0.41	0.45	0.69	0.92	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.98	20.19	20.45	20.73	20.91	20.98	21	21	20.96	20.71	20.29	19.93	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20	20	20.01	20.02	20.02	20.03	20.03	20.03	20.02	20.02	20.01	20.01	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.86	0.7	0.49	0.32	0.36	0.6	0.89	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.65	18.96	19.34	19.72	19.94	20.02	20.03	20.03	19.99	19.71	19.11	18.6	(90)

fLA = Living area ÷ (4) = 0.24 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.98	19.26	19.61	19.97	20.18	20.25	20.26	20.26	20.23	19.96	19.4	18.93	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.98	19.26	19.61	19.97	20.18	20.25	20.26	20.26	20.23	19.96	19.4	18.93	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.94	0.85	0.71	0.51	0.35	0.38	0.62	0.89	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	481.27	575.71	633.13	633.31	546.46	381.32	250.07	262.91	405.44	508.31	478.87	451.28	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1032.79	1008.06	918.11	766.52	585.8	386.81	250.65	263.87	421.05	646.54	853.51	1026.49	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	410.33	290.54	212.03	95.91	29.27	0	0	0	0	102.84	269.74	427.96	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1838.62 (98)

Space heating requirement in kWh/m²/year 28.72 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	410.33	290.54	212.03	95.91	29.27	0	0	0	0	102.84	269.74	427.96	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	439.33	311.07	227.01	102.69	31.34	0	0	0	0	110.11	288.8	458.2	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1968.54 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	183.91	160.65	167.14	148.25	143.53	126.41	121.11	135.01	136.5	155.44	165.93	179.59

Efficiency of water heater 80.3 (216)

(217)m=	87.01	86.53	85.65	83.99	81.85	80.3	80.3	80.3	80.3	84.04	86.27	87.16	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	211.36	185.67	195.15	176.52	175.36	157.43	150.83	168.14	169.99	184.96	192.34	206.05	

Total = Sum(219a)$_{1...12}$ = 2173.77 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1968.54

TER WorkSheet: New dwelling design stage

Water heating fuel used		2173.77	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		288.68	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	425.2	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	469.54	(264)
Space and water heating	(261) + (262) + (263) + (264) =				894.74	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	149.83	(268)
Total CO2, kg/year		sum of (265)…(271) =			1083.49	(272)

TER = 16.92 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 67

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.54	(1a) x	2.56	(2a) =	131.94	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.54	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.94	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.32	0.32	0.32	0.34	0.37	0.38	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.56	x	1/[1/(1.4)+ 0.04]	=	8.7			(27)
Windows Type 2			3.91	x	1/[1/(1.4)+ 0.04]	=	5.18			(27)
Walls Type1	31.45	10.47	20.98	x	0.18	=	3.78			(29)
Walls Type2	32.9	2.42	30.48	x	0.18	=	5.49			(29)
Total area of elements, m²			64.34							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 25.56 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 874.73 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 2.06 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 27.62 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.89	25.73	25.58	24.84	24.7	24.06	24.06	23.94	24.31	24.7	24.98	25.27	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	53.52	53.36	53.2	52.46	52.33	51.68	51.68	51.56	51.93	52.33	52.6	52.9	

Average = Sum(39)$_{1...12}$ /12= 52.46 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.04	1.04	1.03	1.02	1.02	1	1	1	1.01	1.02	1.02	1.03

Average = Sum(40)$_{1...12}$ /12= 1.02 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.96	79.94	76.93	73.91	70.89	67.88	67.88	70.89	73.91	76.93	79.94	82.96

Total = Sum(44)$_{1...12}$ = 905.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	123.03	107.6	111.03	96.8	92.88	80.15	74.27	85.23	86.25	100.51	109.72	119.15

Total = Sum(45)$_{1...12}$ = 1186.62 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.45	16.14	16.66	14.52	13.93	12.02	11.14	12.78	12.94	15.08	16.46	17.87

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.28	36.8	39.2	36.45	36.13	33.47	34.59	36.13	36.45	39.2	39.42	42.28	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	

Output from water heater (annual)$_{1...12}$ 1639.01 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.48	44.98	46.72	41.3	39.92	35.02	33.34	37.37	37.79	43.22	46.34	50.18	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.56	12.04	9.79	7.41	5.54	4.68	5.06	6.57	8.82	11.2	13.07	13.93	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.23	152.8	148.85	140.43	129.8	119.81	113.14	111.57	115.53	123.94	134.57	144.56	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	(71)

Water heating gains (Table 5)

(72)m=	69.19	66.93	62.79	57.36	53.65	48.64	44.82	50.23	52.48	58.09	64.36	67.45	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	286.01	283.8	273.47	257.23	241.02	225.16	215.04	220.4	228.86	245.27	264.03	277.98	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	6.56	x	36.79	x	0.63	x	0.7	=	73.77	(77)
Southeast 0.9x	0.77	x	3.91	x	36.79	x	0.63	x	0.7	=	43.97	(77)
Southeast 0.9x	0.77	x	6.56	x	62.67	x	0.63	x	0.7	=	125.65	(77)
Southeast 0.9x	0.77	x	3.91	x	62.67	x	0.63	x	0.7	=	74.89	(77)
Southeast 0.9x	0.77	x	6.56	x	85.75	x	0.63	x	0.7	=	171.92	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	3.91	x	85.75	x	0.63	x	0.7	=	102.47	(77)
Southeast 0.9x	0.77	x	6.56	x	106.25	x	0.63	x	0.7	=	213.02	(77)
Southeast 0.9x	0.77	x	3.91	x	106.25	x	0.63	x	0.7	=	126.97	(77)
Southeast 0.9x	0.77	x	6.56	x	119.01	x	0.63	x	0.7	=	238.6	(77)
Southeast 0.9x	0.77	x	3.91	x	119.01	x	0.63	x	0.7	=	142.21	(77)
Southeast 0.9x	0.77	x	6.56	x	118.15	x	0.63	x	0.7	=	236.87	(77)
Southeast 0.9x	0.77	x	3.91	x	118.15	x	0.63	x	0.7	=	141.18	(77)
Southeast 0.9x	0.77	x	6.56	x	113.91	x	0.63	x	0.7	=	228.37	(77)
Southeast 0.9x	0.77	x	3.91	x	113.91	x	0.63	x	0.7	=	136.12	(77)
Southeast 0.9x	0.77	x	6.56	x	104.39	x	0.63	x	0.7	=	209.28	(77)
Southeast 0.9x	0.77	x	3.91	x	104.39	x	0.63	x	0.7	=	124.74	(77)
Southeast 0.9x	0.77	x	6.56	x	92.85	x	0.63	x	0.7	=	186.15	(77)
Southeast 0.9x	0.77	x	3.91	x	92.85	x	0.63	x	0.7	=	110.95	(77)
Southeast 0.9x	0.77	x	6.56	x	69.27	x	0.63	x	0.7	=	138.87	(77)
Southeast 0.9x	0.77	x	3.91	x	69.27	x	0.63	x	0.7	=	82.77	(77)
Southeast 0.9x	0.77	x	6.56	x	44.07	x	0.63	x	0.7	=	88.35	(77)
Southeast 0.9x	0.77	x	3.91	x	44.07	x	0.63	x	0.7	=	52.66	(77)
Southeast 0.9x	0.77	x	6.56	x	31.49	x	0.63	x	0.7	=	63.13	(77)
Southeast 0.9x	0.77	x	3.91	x	31.49	x	0.63	x	0.7	=	37.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	117.73	200.54	274.39	339.98	380.81	378.05	364.48	334.03	297.1	221.64	141.02	100.75	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	403.74	484.34	547.85	597.21	621.83	603.21	579.53	554.43	525.97	466.91	405.05	378.73	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.73	0.54	0.39	0.43	0.65	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.08	20.29	20.53	20.79	20.94	20.99	21	21	20.97	20.77	20.38	20.05	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.05	20.05	20.06	20.07	20.07	20.08	20.08	20.08	20.08	20.07	20.07	20.06	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.94	0.84	0.67	0.47	0.31	0.34	0.58	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.84	19.14	19.49	19.84	20.01	20.08	20.08	20.08	20.06	19.83	19.28	18.8	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.15	19.42	19.75	20.07	20.25	20.3	20.31	20.31	20.29	20.06	19.56	19.11	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.15	19.42	19.75	20.07	20.25	20.3	20.31	20.31	20.29	20.06	19.56	19.11	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.84	0.68	0.48	0.33	0.36	0.6	0.87	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	398.76	469.77	509.8	501.25	424.45	292.07	191.5	201.24	313.04	406.85	393.78	375.25	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	794.97	774.97	704.88	586.24	447.13	294.8	191.75	201.68	321.29	495.23	655.29	788.67	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	294.78	205.09	145.14	61.19	16.87	0	0	0	0	65.75	188.29	307.59	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1284.71 (98)

Space heating requirement in kWh/m²/year 24.93 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	294.78	205.09	145.14	61.19	16.87	0	0	0	0	65.75	188.29	307.59	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	315.61	219.58	155.4	65.51	18.07	0	0	0	0	70.4	201.6	329.32	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1375.49 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42

Efficiency of water heater 80.3 (216)

(217)m=	86.49	85.93	84.96	83.23	81.35	80.3	80.3	80.3	80.3	83.28	85.64	86.65	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	191.12	168.03	176.82	160.11	158.58	141.5	135.57	151.13	152.8	167.77	174.15	186.29	

Total = Sum(219a)$_{1...12}$ = 1963.87 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1375.49

TER WorkSheet: New dwelling design stage

Water heating fuel used		1963.87	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		239.41	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	297.11	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	424.19	(264)
Space and water heating	(261) + (262) + (263) + (264) =				721.3	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	124.25	(268)
Total CO2, kg/year		sum of (265)…(271) =			884.48	(272)

TER = 17.16 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 68

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.98	(1a) x	2.56	(2a) =	189.38	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.98	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		189.38	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.43	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.47	x1/[1/(1.4)+ 0.04]		=	7.25			(27)
Windows Type 2			3.26	x1/[1/(1.4)+ 0.04]		=	4.32			(27)
Windows Type 3			2.04	x1/[1/(1.4)+ 0.04]		=	2.7			(27)
Walls Type1	57.81	16.07	41.74	x	0.18	=	7.51			(29)
Walls Type2	35.86	2.42	33.44	x	0.18	=	6.02			(29)
Total area of elements, m²			93.67							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 37.26 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1277.98 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.56 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 42.81 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	37.37	37.13	36.9	35.8	35.6	34.65	34.65	34.47	35.01	35.6	36.01	36.45	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	80.18	79.95	79.71	78.62	78.41	77.46	77.46	77.28	77.83	78.41	78.83	79.26	

Average = Sum(39)$_{1...12}$ /12= 78.62 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.08	1.08	1.08	1.06	1.06	1.05	1.05	1.04	1.05	1.06	1.07	1.07	

Average = Sum(40)$_{1...12}$ /12= 1.06 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.34 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.74 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	98.72	95.13	91.54	87.95	84.36	80.77	80.77	84.36	87.95	91.54	95.13	98.72	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1076.93 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	146.4	128.04	132.13	115.19	110.53	95.38	88.38	101.42	102.63	119.6	130.56	141.78	

Total = Sum(45)$_{1...12}$ = 1412.03 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.96	19.21	19.82	17.28	16.58	14.31	13.26	15.21	15.39	17.94	19.58	21.27	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.31	43.79	46.65	43.37	42.99	39.83	41.16	42.99	43.37	46.65	46.91	50.31	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	

Output from water heater (annual)$_{1...12}$ 1950.34 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.25	53.52	55.59	49.14	47.5	41.67	39.68	44.47	44.97	51.43	55.14	59.72	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.42	16.36	13.3	10.07	7.53	6.36	6.87	8.93	11.98	15.21	17.75	18.93	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	206.4	208.54	203.14	191.65	177.15	163.52	154.41	152.27	157.67	169.16	183.66	197.29	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	(71)

Water heating gains (Table 5)

(72)m=	82.33	79.64	74.72	68.26	63.84	57.88	53.33	59.77	62.45	69.13	76.58	80.27	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	368.22	365.62	352.25	331.06	309.6	288.83	275.69	282.04	293.18	314.58	339.08	357.56	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	5.47	x	36.79	x	0.63	x	0.7	=	61.51	(77)
Southeast 0.9x	0.77	x	3.26	x	36.79	x	0.63	x	0.7	=	73.32	(77)
Southeast 0.9x	0.77	x	5.47	x	62.67	x	0.63	x	0.7	=	104.77	(77)
Southeast 0.9x	0.77	x	3.26	x	62.67	x	0.63	x	0.7	=	124.88	(77)
Southeast 0.9x	0.77	x	5.47	x	85.75	x	0.63	x	0.7	=	143.35	(77)

TER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	3.26	x	85.75	x	0.63	x	0.7	=	170.87	(77)
Southeast	0.9x	0.77	x	5.47	x	106.25	x	0.63	x	0.7	=	177.62	(77)
Southeast	0.9x	0.77	x	3.26	x	106.25	x	0.63	x	0.7	=	211.72	(77)
Southeast	0.9x	0.77	x	5.47	x	119.01	x	0.63	x	0.7	=	198.95	(77)
Southeast	0.9x	0.77	x	3.26	x	119.01	x	0.63	x	0.7	=	237.14	(77)
Southeast	0.9x	0.77	x	5.47	x	118.15	x	0.63	x	0.7	=	197.51	(77)
Southeast	0.9x	0.77	x	3.26	x	118.15	x	0.63	x	0.7	=	235.43	(77)
Southeast	0.9x	0.77	x	5.47	x	113.91	x	0.63	x	0.7	=	190.42	(77)
Southeast	0.9x	0.77	x	3.26	x	113.91	x	0.63	x	0.7	=	226.98	(77)
Southeast	0.9x	0.77	x	5.47	x	104.39	x	0.63	x	0.7	=	174.51	(77)
Southeast	0.9x	0.77	x	3.26	x	104.39	x	0.63	x	0.7	=	208.01	(77)
Southeast	0.9x	0.77	x	5.47	x	92.85	x	0.63	x	0.7	=	155.22	(77)
Southeast	0.9x	0.77	x	3.26	x	92.85	x	0.63	x	0.7	=	185.02	(77)
Southeast	0.9x	0.77	x	5.47	x	69.27	x	0.63	x	0.7	=	115.79	(77)
Southeast	0.9x	0.77	x	3.26	x	69.27	x	0.63	x	0.7	=	138.02	(77)
Southeast	0.9x	0.77	x	5.47	x	44.07	x	0.63	x	0.7	=	73.67	(77)
Southeast	0.9x	0.77	x	3.26	x	44.07	x	0.63	x	0.7	=	87.81	(77)
Southeast	0.9x	0.77	x	5.47	x	31.49	x	0.63	x	0.7	=	52.64	(77)
Southeast	0.9x	0.77	x	3.26	x	31.49	x	0.63	x	0.7	=	62.74	(77)
Southwest	0.9x	0.77	x	2.04	x	36.79		0.63	x	0.7	=	45.88	(79)
Southwest	0.9x	0.77	x	2.04	x	62.67		0.63	x	0.7	=	78.15	(79)
Southwest	0.9x	0.77	x	2.04	x	85.75		0.63	x	0.7	=	106.93	(79)
Southwest	0.9x	0.77	x	2.04	x	106.25		0.63	x	0.7	=	132.49	(79)
Southwest	0.9x	0.77	x	2.04	x	119.01		0.63	x	0.7	=	148.39	(79)
Southwest	0.9x	0.77	x	2.04	x	118.15		0.63	x	0.7	=	147.32	(79)
Southwest	0.9x	0.77	x	2.04	x	113.91		0.63	x	0.7	=	142.03	(79)
Southwest	0.9x	0.77	x	2.04	x	104.39		0.63	x	0.7	=	130.16	(79)
Southwest	0.9x	0.77	x	2.04	x	92.85		0.63	x	0.7	=	115.78	(79)
Southwest	0.9x	0.77	x	2.04	x	69.27		0.63	x	0.7	=	86.37	(79)
Southwest	0.9x	0.77	x	2.04	x	44.07		0.63	x	0.7	=	54.95	(79)
Southwest	0.9x	0.77	x	2.04	x	31.49		0.63	x	0.7	=	39.26	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	180.7	307.8	421.15	521.82	584.49	580.26	559.43	512.68	456.01	340.19	216.44	154.64	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	548.93	673.42	773.4	852.88	894.08	869.09	835.12	794.73	749.2	654.76	555.52	512.21	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.88	0.75	0.56	0.41	0.44	0.68	0.92	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.98	20.2	20.47	20.75	20.92	20.99	21	21	20.96	20.72	20.29	19.94	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.01	20.02	20.02	20.03	20.03	20.04	20.04	20.05	20.04	20.03	20.03	20.02	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.85	0.69	0.48	0.32	0.35	0.6	0.89	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.67	18.98	19.36	19.75	19.96	20.04	20.04	20.05	20.01	19.74	19.13	18.62	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.99	19.28	19.64	20	20.2	20.27	20.28	20.28	20.25	19.98	19.42	18.94	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.99	19.28	19.64	20	20.2	20.27	20.28	20.28	20.25	19.98	19.42	18.94	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.94	0.85	0.7	0.5	0.34	0.38	0.62	0.89	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	543.65	656.31	725.69	726.72	624.95	433.76	284.38	298.86	462.19	581.15	543.15	508.62	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1178.01	1149.75	1047.08	872.46	666.35	439.19	284.93	299.8	478.46	735.48	971.14	1168.71	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	471.96	331.59	239.11	104.93	30.8	0	0	0	0	114.82	308.16	491.11	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2092.49 (98)

Space heating requirement in kWh/m²/year 28.29 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	471.96	331.59	239.11	104.93	30.8	0	0	0	0	114.82	308.16	491.11	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	505.31	355.03	256.01	112.35	32.97	0	0	0	0	122.94	329.93	525.81	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2240.35 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	

Efficiency of water heater: 80.3 (216)

(217)m=

87.17	86.68	85.78	84.04	81.83	80.3	80.3	80.3	80.3	84.14	86.43	87.31	(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=

225.64	198.23	208.4	188.68	187.61	168.38	161.32	179.83	181.82	197.59	205.34	220	

Total = Sum(219a)$_{1...12}$ = 2322.84 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2240.35	
Water heating fuel used		2322.84	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		325.23	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	483.92	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	501.73	(264)
Space and water heating	(261) + (262) + (263) + (264) =			985.65	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	168.79	(268)
Total CO2, kg/year	sum of (265)…(271) =			1193.37	(272)

TER = 16.13 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 69

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.3	(1a) x	2.56	(2a) =	187.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.3	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.44	0.43	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.2	x1/[1/(1.4)+ 0.04]		=	8.22			(27)
Windows Type 2			3.7	x1/[1/(1.4)+ 0.04]		=	4.91			(27)
Windows Type 3			2.31	x1/[1/(1.4)+ 0.04]		=	3.06			(27)
Walls Type1	56.92	15.91	41.01	x	0.18	=	7.38			(29)
Walls Type2	22.18	2.42	19.76	x	0.18	=	3.56			(29)
Total area of elements, m²			79.1							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 34.45 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1033.04 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.88 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 38.33 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	37.07	36.83	36.6	35.51	35.3	34.35	34.35	34.18	34.72	35.3	35.72	36.15	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	75.4	75.16	74.93	73.84	73.64	72.68	72.68	72.51	73.05	73.64	74.05	74.48	

Average = Sum(39)$_{1...12}$ /12= 73.84 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.03	1.03	1.02	1.01	1	0.99	0.99	0.99	1	1	1.01	1.02

Average = Sum(40)$_{1...12}$ /12= 1.01 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.38 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.32	94.75	91.17	87.6	84.02	80.44	80.44	84.02	87.6	91.17	94.75	98.32

Total = Sum(44)$_{1...12}$ = 1072.6 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.81	127.52	131.59	114.73	110.08	94.99	88.03	101.01	102.22	119.12	130.03	141.21

Total = Sum(45)$_{1...12}$ = 1406.35 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.87	19.13	19.74	17.21	16.51	14.25	13.2	15.15	15.33	17.87	19.5	21.18

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.1	43.61	46.46	43.2	42.82	39.67	40.99	42.82	43.2	46.46	46.72	50.1	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31	

Output from water heater (annual)$_{1...12}$ 1942.5 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.01	53.3	55.37	48.95	47.31	41.5	39.52	44.29	44.79	51.22	54.92	59.48	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.28	16.24	13.2	10	7.47	6.31	6.82	8.86	11.89	15.1	17.62	18.79	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.87	207	201.64	190.24	175.84	162.31	153.27	151.14	156.5	167.91	182.3	195.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	(71)

Water heating gains (Table 5)

(72)m=	82	79.32	74.42	67.98	63.58	57.64	53.11	59.53	62.2	68.85	76.27	79.94	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	366	363.41	350.12	329.07	307.75	287.11	274.05	280.39	291.45	312.71	337.05	355.42	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.31	x	36.79	x	0.63	x	0.7	=	25.98	(79)
Southwest$_{0.9x}$	0.77	x	2.31	x	62.67	x	0.63	x	0.7	=	44.25	(79)
Southwest$_{0.9x}$	0.77	x	2.31	x	85.75	x	0.63	x	0.7	=	60.54	(79)
Southwest$_{0.9x}$	0.77	x	2.31	x	106.25	x	0.63	x	0.7	=	75.01	(79)
Southwest$_{0.9x}$	0.77	x	2.31	x	119.01	x	0.63	x	0.7	=	84.02	(79)

TER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.31	x	118.15		0.63	x	0.7	=	83.41	(79)
Southwest 0.9x	0.77	x	2.31	x	113.91		0.63	x	0.7	=	80.42	(79)
Southwest 0.9x	0.77	x	2.31	x	104.39		0.63	x	0.7	=	73.7	(79)
Southwest 0.9x	0.77	x	2.31	x	92.85		0.63	x	0.7	=	65.55	(79)
Southwest 0.9x	0.77	x	2.31	x	69.27		0.63	x	0.7	=	48.9	(79)
Southwest 0.9x	0.77	x	2.31	x	44.07		0.63	x	0.7	=	31.11	(79)
Southwest 0.9x	0.77	x	2.31	x	31.49		0.63	x	0.7	=	22.23	(79)
Northwest 0.9x	0.77	x	6.2	x	11.28	x	0.63	x	0.7	=	21.38	(81)
Northwest 0.9x	0.77	x	3.7	x	11.28	x	0.63	x	0.7	=	25.52	(81)
Northwest 0.9x	0.77	x	6.2	x	22.97	x	0.63	x	0.7	=	43.52	(81)
Northwest 0.9x	0.77	x	3.7	x	22.97	x	0.63	x	0.7	=	51.94	(81)
Northwest 0.9x	0.77	x	6.2	x	41.38	x	0.63	x	0.7	=	78.4	(81)
Northwest 0.9x	0.77	x	3.7	x	41.38	x	0.63	x	0.7	=	93.58	(81)
Northwest 0.9x	0.77	x	6.2	x	67.96	x	0.63	x	0.7	=	128.76	(81)
Northwest 0.9x	0.77	x	3.7	x	67.96	x	0.63	x	0.7	=	153.68	(81)
Northwest 0.9x	0.77	x	6.2	x	91.35	x	0.63	x	0.7	=	173.08	(81)
Northwest 0.9x	0.77	x	3.7	x	91.35	x	0.63	x	0.7	=	206.58	(81)
Northwest 0.9x	0.77	x	6.2	x	97.38	x	0.63	x	0.7	=	184.52	(81)
Northwest 0.9x	0.77	x	3.7	x	97.38	x	0.63	x	0.7	=	220.24	(81)
Northwest 0.9x	0.77	x	6.2	x	91.1	x	0.63	x	0.7	=	172.62	(81)
Northwest 0.9x	0.77	x	3.7	x	91.1	x	0.63	x	0.7	=	206.03	(81)
Northwest 0.9x	0.77	x	6.2	x	72.63	x	0.63	x	0.7	=	137.61	(81)
Northwest 0.9x	0.77	x	3.7	x	72.63	x	0.63	x	0.7	=	164.25	(81)
Northwest 0.9x	0.77	x	6.2	x	50.42	x	0.63	x	0.7	=	95.54	(81)
Northwest 0.9x	0.77	x	3.7	x	50.42	x	0.63	x	0.7	=	114.03	(81)
Northwest 0.9x	0.77	x	6.2	x	28.07	x	0.63	x	0.7	=	53.18	(81)
Northwest 0.9x	0.77	x	3.7	x	28.07	x	0.63	x	0.7	=	63.47	(81)
Northwest 0.9x	0.77	x	6.2	x	14.2	x	0.63	x	0.7	=	26.9	(81)
Northwest 0.9x	0.77	x	3.7	x	14.2	x	0.63	x	0.7	=	32.11	(81)
Northwest 0.9x	0.77	x	6.2	x	9.21	x	0.63	x	0.7	=	17.46	(81)
Northwest 0.9x	0.77	x	3.7	x	9.21	x	0.63	x	0.7	=	20.84	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	72.87	139.7	232.52	357.46	463.68	488.17	459.06	375.56	275.12	165.56	90.12	60.53	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	438.88	503.11	582.64	686.52	771.43	775.29	733.12	655.94	566.57	478.26	427.17	415.94	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.98	0.94	0.79	0.59	0.43	0.5	0.8	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.92	20.07	20.33	20.67	20.9	20.99	21	21	20.93	20.6	20.21	19.9	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.06	20.06	20.06	20.08	20.08	20.09	20.09	20.09	20.09	20.08	20.07	20.07	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.91	0.74	0.51	0.35	0.41	0.72	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.62	18.83	19.21	19.7	19.99	20.08	20.09	20.09	20.03	19.62	19.04	18.59	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.96	19.15	19.5	19.95	20.23	20.32	20.32	20.32	20.26	19.87	19.34	18.93	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.96	19.15	19.5	19.95	20.23	20.32	20.32	20.32	20.26	19.87	19.34	18.93	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.75	0.53	0.37	0.43	0.74	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	437.23	498.95	568.48	625.57	578.41	409.74	270.13	283.17	418.02	456.78	423.77	414.76	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1105.16	1071.39	974	815.84	627.95	415.44	270.73	284.58	450.31	682.84	906.63	1097.35	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	496.95	384.68	301.7	137	36.86	0	0	0	0	168.19	347.66	507.85	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2380.88 (98)

Space heating requirement in kWh/m²/year 32.48 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	496.95	384.68	301.7	137	36.86	0	0	0	0	168.19	347.66	507.85	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	532.06	411.86	323.02	146.68	39.47	0	0	0	0	180.08	372.23	543.73	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2549.13 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31

Efficiency of water heater 80.3 (216)

(217)m= 87.3 | 87.03 | 86.37 | 84.7 | 82.08 | 80.3 | 80.3 | 80.3 | 80.3 | 85.09 | 86.72 | 87.39 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 224.42 | 196.64 | 206.16 | 186.46 | 186.28 | 167.7 | 160.67 | 179.11 | 181.09 | 194.6 | 203.82 | 218.91

Total = Sum(219a)$_{1...12}$ = 2305.85 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2549.13	
Water heating fuel used		2305.85	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		322.83	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	550.61	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	498.06	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1048.68	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	167.55	(268)
Total CO2, kg/year	sum of (265)…(271) =			1255.15	(272)

TER = 17.12 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 70

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.47	(1a) x	2.56	(2a) =	180.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.47	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.17	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)			0	(9)
Additional infiltration		[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0	(12)
If no draught lobby, enter 0.05, else enter 0			0	(13)
Percentage of windows and doors draught stripped			0	(14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5	(17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.42	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered			2	(19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.39	0.38	0.34	0.34	0.33	0.35	0.38	0.4	0.42

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.58	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.58	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.93	x	1/[1/(1.4)+ 0.04]	=	9.19			(27)
Windows Type 2			4.13	x	1/[1/(1.4)+ 0.04]	=	5.48			(27)
Walls Type1	31.35	15.19	16.16	x	0.18	=	2.91			(29)
Walls Type2	17.17	2.42	14.75	x	0.18	=	2.66			(29)
Total area of elements, m²			48.53							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 28.12 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 525.59 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 2.01 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 30.13 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	35.83	35.59	35.36	34.28	34.08	33.13	33.13	32.96	33.5	34.08	34.49	34.91	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	65.96	65.73	65.5	64.41	64.21	63.27	63.27	63.09	63.63	64.21	64.62	65.05	

Average = Sum(39)$_{1...12}$ /12= 64.41 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.94	0.93	0.93	0.91	0.91	0.9	0.9	0.9	0.9	0.91	0.92	0.92

Average = Sum(40)$_{1...12}$ /12= 0.91 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.82 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.6	93.09	89.57	86.06	82.55	79.04	79.04	82.55	86.06	89.57	93.09	96.6

Total = Sum(44)$_{1...12}$ = 1053.82 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.25	125.29	129.29	112.72	108.16	93.33	86.48	99.24	100.43	117.04	127.76	138.73

Total = Sum(45)$_{1...12}$ = 1381.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.49	18.79	19.39	16.91	16.22	14	12.97	14.89	15.06	17.56	19.16	20.81

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.23	42.85	45.65	42.44	42.07	38.98	40.28	42.07	42.44	45.65	45.91	49.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	

Output from water heater (annual)$_{1...12}$ 1908.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	59.94	52.37	54.4	48.09	46.48	40.78	38.82	43.51	44	50.33	53.96	58.44	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.71	15.73	12.79	9.68	7.24	6.11	6.6	8.58	11.52	14.63	17.07	18.2	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.4	200.46	195.27	184.23	170.29	157.18	148.43	146.37	151.56	162.6	176.55	189.65	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	(71)

Water heating gains (Table 5)

(72)m=	80.56	77.93	73.12	66.79	62.47	56.63	52.18	58.49	61.11	67.64	74.94	78.54	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	356.54	353.99	341.05	320.57	299.86	279.79	267.08	273.3	284.06	304.74	328.42	346.26	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	6.93	x	11.28	x	0.63	x	0.7	=	23.9	(81)
Northwest 0.9x	0.77	x	4.13	x	11.28	x	0.63	x	0.7	=	28.48	(81)
Northwest 0.9x	0.77	x	6.93	x	22.97	x	0.63	x	0.7	=	48.64	(81)
Northwest 0.9x	0.77	x	4.13	x	22.97	x	0.63	x	0.7	=	57.98	(81)
Northwest 0.9x	0.77	x	6.93	x	41.38	x	0.63	x	0.7	=	87.64	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.13	x	41.38	x	0.63	x	0.7	=	104.46	(81)
Northwest 0.9x	0.77	x	6.93	x	67.96	x	0.63	x	0.7	=	143.92	(81)
Northwest 0.9x	0.77	x	4.13	x	67.96	x	0.63	x	0.7	=	171.55	(81)
Northwest 0.9x	0.77	x	6.93	x	91.35	x	0.63	x	0.7	=	193.46	(81)
Northwest 0.9x	0.77	x	4.13	x	91.35	x	0.63	x	0.7	=	230.59	(81)
Northwest 0.9x	0.77	x	6.93	x	97.38	x	0.63	x	0.7	=	206.25	(81)
Northwest 0.9x	0.77	x	4.13	x	97.38	x	0.63	x	0.7	=	245.83	(81)
Northwest 0.9x	0.77	x	6.93	x	91.1	x	0.63	x	0.7	=	192.94	(81)
Northwest 0.9x	0.77	x	4.13	x	91.1	x	0.63	x	0.7	=	229.97	(81)
Northwest 0.9x	0.77	x	6.93	x	72.63	x	0.63	x	0.7	=	153.82	(81)
Northwest 0.9x	0.77	x	4.13	x	72.63	x	0.63	x	0.7	=	183.34	(81)
Northwest 0.9x	0.77	x	6.93	x	50.42	x	0.63	x	0.7	=	106.79	(81)
Northwest 0.9x	0.77	x	4.13	x	50.42	x	0.63	x	0.7	=	127.28	(81)
Northwest 0.9x	0.77	x	6.93	x	28.07	x	0.63	x	0.7	=	59.44	(81)
Northwest 0.9x	0.77	x	4.13	x	28.07	x	0.63	x	0.7	=	70.85	(81)
Northwest 0.9x	0.77	x	6.93	x	14.2	x	0.63	x	0.7	=	30.07	(81)
Northwest 0.9x	0.77	x	4.13	x	14.2	x	0.63	x	0.7	=	35.84	(81)
Northwest 0.9x	0.77	x	6.93	x	9.21	x	0.63	x	0.7	=	19.51	(81)
Northwest 0.9x	0.77	x	4.13	x	9.21	x	0.63	x	0.7	=	23.26	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	52.38	106.62	192.09	315.47	424.05	452.08	422.92	337.15	234.07	130.3	65.91	42.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	408.92	460.61	533.14	636.04	723.91	731.88	690	610.46	518.12	435.03	394.33	389.03	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.93	0.76	0.55	0.4	0.47	0.78	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.04	20.17	20.41	20.74	20.94	20.99	21	21	20.95	20.66	20.3	20.02	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.14	20.14	20.14	20.16	20.16	20.17	20.17	20.17	20.17	20.16	20.15	20.15	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.91	0.71	0.48	0.33	0.39	0.71	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.84	19.04	19.39	19.85	20.1	20.17	20.17	20.17	20.13	19.76	19.23	18.83	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.17	19.34	19.66	20.09	20.33	20.39	20.39	20.39	20.35	20	19.52	19.15	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.17	19.34	19.66	20.09	20.33	20.39	20.39	20.39	20.35	20	19.52	19.15	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.72	0.5	0.35	0.41	0.73	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	407.6	457.41	521.25	576.41	523.92	363.61	239.72	251.33	376.11	416.65	391.58	388.09	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	980.58	949.13	862.23	720.96	554.01	366.21	239.95	251.96	397.64	603.65	802.56	972.37	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	426.29	330.44	253.69	104.08	22.38	0	0	0	0	139.13	295.91	434.71	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2006.63 (98)

Space heating requirement in kWh/m²/year 28.47 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	426.29	330.44	253.69	104.08	22.38	0	0	0	0	139.13	295.91	434.71	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	456.42	353.79	271.61	111.44	23.97	0	0	0	0	148.96	316.82	465.43	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2148.42 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96

Efficiency of water heater 80.3 (216)

(217)m=	87	86.72	85.99	84.07	81.48	80.3	80.3	80.3	80.3	84.66	86.38	87.09	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	221.25	193.88	203.45	184.56	184.36	164.77	157.86	175.97	177.92	192.16	201.04	215.82	

Total = Sum(219a)$_{1...12}$ = 2273.03 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2148.42

TER WorkSheet: New dwelling design stage

Water heating fuel used			2273.03	
Electricity for pumps, fans and electric keep-hot				
central heating pump:		30		(230c)
boiler with a fan-assisted flue		45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		75	(231)
Electricity for lighting			312.74	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	464.06	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	490.98	(264)
Space and water heating	(261) + (262) + (263) + (264) =				955.03	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	162.31	(268)
Total CO2, kg/year	sum of (265)…(271) =				1156.27	(272)

TER = 16.41 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 71

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.12	(1a) x	2.56	(2a) =	130.85	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.12	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.85	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.49	x	1/[1/(1.4)+ 0.04]	=	8.6			(27)
Windows Type 2			3.87	x	1/[1/(1.4)+ 0.04]	=	5.13			(27)
Walls Type1	25.24	10.36	14.88	x	0.18	=	2.68			(29)
Walls Type2	33.85	2.42	31.43	x	0.18	=	5.66			(29)
Total area of elements, m²			59.09							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 24.49 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 787.22 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 1.45 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 25.94 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.71	25.55	25.39	24.65	24.52	23.88	23.88	23.76	24.12	24.52	24.79	25.09	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	51.65	51.49	51.33	50.6	50.46	49.82	49.82	49.7	50.07	50.46	50.74	51.03	

Average = Sum(39)$_{1...12}$ /12= 50.6 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.01	1.01	1	0.99	0.99	0.97	0.97	0.97	0.98	0.99	0.99	1

Average = Sum(40)$_{1...12}$ /12= 0.99 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.12 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.63	79.63	76.62	73.62	70.61	67.61	67.61	70.61	73.62	76.62	79.63	82.63

Total = Sum(44)$_{1...12}$ = 901.44 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.54	107.18	110.6	96.42	92.52	79.84	73.98	84.89	85.91	100.12	109.28	118.67

Total = Sum(45)$_{1...12}$ = 1181.94 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.38	16.08	16.59	14.46	13.88	11.98	11.1	12.73	12.89	15.02	16.39	17.8

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.11	36.65	39.05	36.3	35.98	33.34	34.45	35.98	36.3	39.05	39.27	42.11	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78	

Output from water heater (annual)$_{1...12}$ 1632.53 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.27	44.8	46.53	41.14	39.76	34.88	33.21	37.22	37.64	43.05	46.15	49.99	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.46	11.96	9.72	7.36	5.5	4.65	5.02	6.52	8.76	11.12	12.98	13.83	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	150.13	151.69	147.76	139.4	128.85	118.94	112.31	110.76	114.68	123.04	133.59	143.51	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	(71)

Water heating gains (Table 5)

(72)m=	68.91	66.66	62.55	57.13	53.44	48.45	44.64	50.03	52.28	57.86	64.1	67.19	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	284.35	282.15	271.88	255.74	239.64	223.87	213.82	219.16	227.56	243.87	262.51	276.37	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	6.49	x	11.28	x	0.63	x	0.7	=	22.38	(81)
Northwest 0.9x	0.77	x	3.87	x	11.28	x	0.63	x	0.7	=	13.34	(81)
Northwest 0.9x	0.77	x	6.49	x	22.97	x	0.63	x	0.7	=	45.55	(81)
Northwest 0.9x	0.77	x	3.87	x	22.97	x	0.63	x	0.7	=	27.16	(81)
Northwest 0.9x	0.77	x	6.49	x	41.38	x	0.63	x	0.7	=	82.07	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.87	x	41.38	x	0.63	x	0.7	=	48.94	(81)
Northwest 0.9x	0.77	x	6.49	x	67.96	x	0.63	x	0.7	=	134.79	(81)
Northwest 0.9x	0.77	x	3.87	x	67.96	x	0.63	x	0.7	=	80.37	(81)
Northwest 0.9x	0.77	x	6.49	x	91.35	x	0.63	x	0.7	=	181.18	(81)
Northwest 0.9x	0.77	x	3.87	x	91.35	x	0.63	x	0.7	=	108.04	(81)
Northwest 0.9x	0.77	x	6.49	x	97.38	x	0.63	x	0.7	=	193.16	(81)
Northwest 0.9x	0.77	x	3.87	x	97.38	x	0.63	x	0.7	=	115.18	(81)
Northwest 0.9x	0.77	x	6.49	x	91.1	x	0.63	x	0.7	=	180.69	(81)
Northwest 0.9x	0.77	x	3.87	x	91.1	x	0.63	x	0.7	=	107.75	(81)
Northwest 0.9x	0.77	x	6.49	x	72.63	x	0.63	x	0.7	=	144.05	(81)
Northwest 0.9x	0.77	x	3.87	x	72.63	x	0.63	x	0.7	=	85.9	(81)
Northwest 0.9x	0.77	x	6.49	x	50.42	x	0.63	x	0.7	=	100.01	(81)
Northwest 0.9x	0.77	x	3.87	x	50.42	x	0.63	x	0.7	=	59.63	(81)
Northwest 0.9x	0.77	x	6.49	x	28.07	x	0.63	x	0.7	=	55.67	(81)
Northwest 0.9x	0.77	x	3.87	x	28.07	x	0.63	x	0.7	=	33.2	(81)
Northwest 0.9x	0.77	x	6.49	x	14.2	x	0.63	x	0.7	=	28.16	(81)
Northwest 0.9x	0.77	x	3.87	x	14.2	x	0.63	x	0.7	=	16.79	(81)
Northwest 0.9x	0.77	x	6.49	x	9.21	x	0.63	x	0.7	=	18.28	(81)
Northwest 0.9x	0.77	x	3.87	x	9.21	x	0.63	x	0.7	=	10.9	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	35.72	72.72	131.01	215.16	289.22	308.33	288.44	229.95	159.64	88.86	44.95	29.17	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	320.07	354.87	402.89	470.9	528.85	532.21	502.26	449.1	387.2	332.73	307.46	305.54	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.8	0.59	0.43	0.5	0.8	0.97	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.98	20.1	20.34	20.68	20.91	20.99	21	21	20.93	20.62	20.24	19.96	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.07	20.08	20.08	20.09	20.09	20.1	20.1	20.11	20.1	20.09	20.09	20.08	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.74	0.51	0.35	0.41	0.73	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.71	18.89	19.24	19.72	20.01	20.1	20.1	20.1	20.05	19.65	19.11	18.68	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.02	19.19	19.52	19.96	20.23	20.32	20.33	20.33	20.27	19.89	19.39	19	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	19.02	19.19	19.52	19.96	20.23	20.32	20.33	20.33	20.27	19.89	19.39	19	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.75	0.53	0.37	0.43	0.74	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	318.59	351.74	393.19	429.92	397.35	281.22	185.31	194.29	286.92	317.47	304.6	304.43	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	760.47	736.05	668.33	559.52	430.6	284.92	185.7	195.2	308.82	468.86	623.75	755.39	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	328.76	258.25	204.71	93.31	24.74	0	0	0	0	112.64	229.78	335.51	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1587.71 (98)

Space heating requirement in kWh/m²/year 31.06 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	328.76	258.25	204.71	93.31	24.74	0	0	0	0	112.64	229.78	335.51	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	351.99	276.5	219.17	99.91	26.49	0	0	0	0	120.6	246.02	359.22	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1699.9 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78

Efficiency of water heater 80.3 (216)

(217)m=	86.76	86.51	85.84	84.18	81.78	80.3	80.3	80.3	80.3	84.52	86.15	86.86	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.78	166.26	174.33	157.66	157.14	140.94	135.03	150.53	152.19	164.64	172.44	185.11	

Total = Sum(219a)$_{1...12}$ = 1946.05 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1699.9

TER WorkSheet: New dwelling design stage

Water heating fuel used		1946.05	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		237.72	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	367.18	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	420.35	(264)
Space and water heating	(261) + (262) + (263) + (264) =				787.53	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	123.37	(268)
Total CO2, kg/year		sum of (265)…(271) =			949.83	(272)

TER = 18.58 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 72

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	55.28	(1a) x	2.56	(2a) =	141.52	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	55.28	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		141.52	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.14 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.39 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.33 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.42	0.42	0.41	0.37	0.36	0.32	0.32	0.31	0.33	0.36	0.37	0.39

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.58	0.57	0.56	0.55	0.55	0.55	0.56	0.56	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.58	0.57	0.56	0.55	0.55	0.55	0.56	0.56	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Floor			55.286	x	0.13	=	7.18718			(28)
Walls Type1	47.86	9.24	38.62	x	0.18	=	6.95			(29)
Walls Type2	19.92	2.42	17.5	x	0.18	=	3.15			(29)
Total area of elements, m²			123.06							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.96 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 5100.42 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.26 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 38.22 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	27.55	27.39	27.23	26.48	26.34	25.68	25.68	25.56	25.93	26.34	26.62	26.92	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	65.77	65.61	65.45	64.7	64.56	63.9	63.9	63.78	64.15	64.56	64.84	65.14	

Average = Sum(39)$_{1...12}$ /12= 64.7 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.19	1.19	1.18	1.17	1.17	1.16	1.16	1.15	1.16	1.17	1.17	1.18

Average = Sum(40)$_{1...12}$ /12= 1.17 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.85 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 78.03 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	85.84	82.71	79.59	76.47	73.35	70.23	70.23	73.35	76.47	79.59	82.71	85.84

Total = Sum(44)$_{1...12}$ = 936.38 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	127.29	111.33	114.88	100.16	96.1	82.93	76.85	88.18	89.24	104	113.52	123.27

Total = Sum(45)$_{1...12}$ = 1227.75 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.09	16.7	17.23	15.02	14.42	12.44	11.53	13.23	13.39	15.6	17.03	18.49

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	43.74	38.07	40.56	37.71	37.38	34.63	35.79	37.38	37.71	40.56	40.79	43.74	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	171.03	149.4	155.44	137.87	133.48	117.56	112.63	125.56	126.95	144.56	154.31	167.02	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	171.03	149.4	155.44	137.87	133.48	117.56	112.63	125.56	126.95	144.56	154.31	167.02	

Output from water heater (annual)$_{1...12}$ 1695.81 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	53.26	46.53	48.34	42.73	41.3	36.23	34.5	38.67	39.1	44.72	47.94	51.92	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	14.84	13.18	10.72	8.12	6.07	5.12	5.53	7.19	9.66	12.26	14.31	15.25	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	160.91	162.58	158.37	149.41	138.1	127.48	120.38	118.71	122.92	131.87	143.18	153.81	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	(71)

Water heating gains (Table 5)

(72)m=	71.59	69.25	64.97	59.35	55.51	50.32	46.37	51.97	54.3	60.11	66.59	69.79	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	301.02	298.69	287.74	270.56	253.36	236.6	225.96	231.55	240.56	257.92	277.76	292.53	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.63	x	0.7	=	31.86	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.63	x	0.7	=	64.85	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.63	x	0.7	=	116.85	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.63	x	0.7	=	191.9	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.63	x	0.7	=	257.95	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.63	x	0.7	=	275	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.63	x	0.7	=	257.26	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.63	x	0.7	=	205.09	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.63	x	0.7	=	142.38	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.63	x	0.7	=	79.26	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.63	x	0.7	=	40.09	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.63	x	0.7	=	26.02	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	31.86	64.85	116.85	191.9	257.95	275	257.26	205.09	142.38	79.26	40.09	26.02	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	332.88	363.54	404.59	462.46	511.31	511.61	483.22	436.64	382.94	337.18	317.85	318.55	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.97	0.89	0.73	0.57	0.64	0.89	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.71	19.83	20.07	20.43	20.76	20.94	20.99	20.98	20.83	20.42	20.01	19.69	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.93	19.93	19.93	19.94	19.95	19.96	19.96	19.96	19.95	19.95	19.94	19.94	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.96	0.85	0.64	0.44	0.51	0.82	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.21	18.39	18.75	19.27	19.7	19.91	19.95	19.95	19.8	19.26	18.66	18.19	(90)

fLA = Living area ÷ (4) = 0.23 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.56	18.72	19.05	19.54	19.95	20.15	20.19	20.18	20.04	19.53	18.97	18.53	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.56	18.72	19.05	19.54	19.95	20.15	20.19	20.18	20.04	19.53	18.97	18.53	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	1	0.99	0.98	0.95	0.85	0.66	0.47	0.54	0.83	0.97	0.99	1	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	331.52	361.06	398.16	439.12	433.91	335.15	226.46	235.69	318.22	327.01	315.49	317.5	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	937.58	906.73	821.63	688.21	532.28	354.71	229.39	241.38	381.06	576.66	769.89	933.65	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	450.91	366.69	315.06	179.35	73.19	0	0	0	0	185.74	327.17	458.41	

TER WorkSheet: New dwelling design stage

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ =	2356.51	(98)
Space heating requirement in kWh/m²/year	42.63	(99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system	0	(201)
Fraction of space heat from main system(s) (202) = 1 – (201) =	1	(202)
Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] =	1	(204)
Efficiency of main space heating system 1	93.4	(206)
Efficiency of secondary/supplementary heating system, %	0	(208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	450.91	366.69	315.06	179.35	73.19	0	0	0	0	185.74	327.17	458.41	
(211)m = {[(98)m x (204)] } x 100 ÷ (206) (211)	482.77	392.6	337.33	192.02	78.36	0	0	0	0	198.86	350.29	490.81	

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 2523.03 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	171.03	149.4	155.44	137.87	133.48	117.56	112.63	125.56	126.95	144.56	154.31	167.02	

Efficiency of water heater 80.3 (216)

(217)m=	87.38	87.22	86.79	85.71	83.61	80.3	80.3	80.3	80.3	85.68	86.9	87.46	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	195.74	171.28	179.09	160.85	159.65	146.4	140.27	156.36	158.09	168.71	177.58	190.96	

Total = Sum(219a)$_{1...12}$ = 2004.99 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2523.03
Water heating fuel used		2004.99
Electricity for pumps, fans and electric keep-hot		
central heating pump:	30	(230c)
boiler with a fan-assisted flue	45	(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75 (231)
Electricity for lighting		262.09 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216 =	544.98 (261)

TER WorkSheet: New dwelling design stage

Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	433.08	(264)
Space and water heating	(261) + (262) + (263) + (264) =			978.05	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	136.03	(268)
Total CO2, kg/year	sum of (265)…(271) =			1153	(272)

TER = 20.86 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 73

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	66.43	(1a) x	2.56	(2a) =	170.06	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	66.43	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		170.06	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.12	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)			0	(9)
Additional infiltration		[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0	(12)
If no draught lobby, enter 0.05, else enter 0			0	(13)
Percentage of windows and doors draught stripped			0	(14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5	(17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.37	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered			2	(19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.31	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.4	0.39	0.38	0.34	0.34	0.3	0.3	0.29	0.31	0.34	0.35	0.37

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.58	0.58	0.57	0.56	0.56	0.54	0.54	0.54	0.55	0.56	0.56	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.58	0.58	0.57	0.56	0.56	0.54	0.54	0.54	0.55	0.56	0.56	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.53	x1/[1/(1.4)+ 0.04]		=	7.33			(27)
Windows Type 2			3.3	x1/[1/(1.4)+ 0.04]		=	4.37			(27)
Windows Type 3			2.06	x1/[1/(1.4)+ 0.04]		=	2.73			(27)
Floor			66.431	x	0.13	=	8.636029			(28)
Walls Type1	37.25	14.19	23.06	x	0.18	=	4.15			(29)
Walls Type2	32.9	2.42	30.48	x	0.18	=	5.49			(29)
Total area of elements, m²			136.57							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.5 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 5892.37 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.01 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 43.51 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	32.51	32.34	32.17	31.37	31.23	30.53	30.53	30.4	30.8	31.23	31.53	31.84	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	76.03	75.85	75.68	74.89	74.74	74.05	74.05	73.92	74.31	74.74	75.04	75.36	

Average = Sum(39)$_{1...12}$ /12= 74.89 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.14	1.14	1.14	1.13	1.13	1.11	1.11	1.11	1.12	1.13	1.13	1.13

Average = Sum(40)$_{1...12}$ /12= 1.13 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.16 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 85.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	93.96	90.54	87.12	83.71	80.29	76.87	76.87	80.29	83.71	87.12	90.54	93.96

Total = Sum(44)$_{1...12}$ = 1024.98 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	139.34	121.86	125.75	109.63	105.2	90.78	84.12	96.53	97.68	113.84	124.26	134.94

Total = Sum(45)$_{1...12}$ = 1343.92 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	20.9	18.28	18.86	16.45	15.78	13.62	12.62	14.48	14.65	17.08	18.64	20.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.88	41.67	44.4	41.28	40.92	37.91	39.17	40.92	41.28	44.4	44.65	47.88	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82	

Output from water heater (annual)$_{1...12}$ 1856.27 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	58.3	50.94	52.91	46.77	45.21	39.66	37.76	42.32	42.8	48.95	52.48	56.84	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.86	14.98	12.18	9.22	6.89	5.82	6.29	8.17	10.97	13.93	16.26	17.33	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	188.83	190.79	185.85	175.34	162.07	149.6	141.26	139.3	144.24	154.75	168.02	180.49	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	(71)

Water heating gains (Table 5)

(72)m=	78.36	75.8	71.12	64.96	60.76	55.08	50.76	56.89	59.44	65.79	72.89	76.39	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	342.39	339.91	327.49	307.87	288.07	268.85	256.65	262.71	273	292.82	315.51	332.57	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.06	x	36.79	x	0.63	x	0.7	=	23.16	(79)
Southwest$_{0.9x}$	0.77	x	2.06	x	62.67	x	0.63	x	0.7	=	39.46	(79)
Southwest$_{0.9x}$	0.77	x	2.06	x	85.75	x	0.63	x	0.7	=	53.99	(79)
Southwest$_{0.9x}$	0.77	x	2.06	x	106.25	x	0.63	x	0.7	=	66.89	(79)
Southwest$_{0.9x}$	0.77	x	2.06	x	119.01	x	0.63	x	0.7	=	74.92	(79)

TER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.06	x	118.15		0.63	x	0.7	=	74.38	(79)
Southwest 0.9x	0.77	x	2.06	x	113.91		0.63	x	0.7	=	71.71	(79)
Southwest 0.9x	0.77	x	2.06	x	104.39		0.63	x	0.7	=	65.72	(79)
Southwest 0.9x	0.77	x	2.06	x	92.85		0.63	x	0.7	=	58.46	(79)
Southwest 0.9x	0.77	x	2.06	x	69.27		0.63	x	0.7	=	43.61	(79)
Southwest 0.9x	0.77	x	2.06	x	44.07		0.63	x	0.7	=	27.75	(79)
Southwest 0.9x	0.77	x	2.06	x	31.49		0.63	x	0.7	=	19.82	(79)
Northwest 0.9x	0.77	x	5.53	x	11.28	x	0.63	x	0.7	=	19.07	(81)
Northwest 0.9x	0.77	x	3.3	x	11.28	x	0.63	x	0.7	=	22.76	(81)
Northwest 0.9x	0.77	x	5.53	x	22.97	x	0.63	x	0.7	=	38.81	(81)
Northwest 0.9x	0.77	x	3.3	x	22.97	x	0.63	x	0.7	=	46.32	(81)
Northwest 0.9x	0.77	x	5.53	x	41.38	x	0.63	x	0.7	=	69.93	(81)
Northwest 0.9x	0.77	x	3.3	x	41.38	x	0.63	x	0.7	=	83.46	(81)
Northwest 0.9x	0.77	x	5.53	x	67.96	x	0.63	x	0.7	=	114.85	(81)
Northwest 0.9x	0.77	x	3.3	x	67.96	x	0.63	x	0.7	=	137.07	(81)
Northwest 0.9x	0.77	x	5.53	x	91.35	x	0.63	x	0.7	=	154.38	(81)
Northwest 0.9x	0.77	x	3.3	x	91.35	x	0.63	x	0.7	=	184.25	(81)
Northwest 0.9x	0.77	x	5.53	x	97.38	x	0.63	x	0.7	=	164.58	(81)
Northwest 0.9x	0.77	x	3.3	x	97.38	x	0.63	x	0.7	=	196.43	(81)
Northwest 0.9x	0.77	x	5.53	x	91.1	x	0.63	x	0.7	=	153.96	(81)
Northwest 0.9x	0.77	x	3.3	x	91.1	x	0.63	x	0.7	=	183.76	(81)
Northwest 0.9x	0.77	x	5.53	x	72.63	x	0.63	x	0.7	=	122.74	(81)
Northwest 0.9x	0.77	x	3.3	x	72.63	x	0.63	x	0.7	=	146.49	(81)
Northwest 0.9x	0.77	x	5.53	x	50.42	x	0.63	x	0.7	=	85.21	(81)
Northwest 0.9x	0.77	x	3.3	x	50.42	x	0.63	x	0.7	=	101.7	(81)
Northwest 0.9x	0.77	x	5.53	x	28.07	x	0.63	x	0.7	=	47.43	(81)
Northwest 0.9x	0.77	x	3.3	x	28.07	x	0.63	x	0.7	=	56.61	(81)
Northwest 0.9x	0.77	x	5.53	x	14.2	x	0.63	x	0.7	=	23.99	(81)
Northwest 0.9x	0.77	x	3.3	x	14.2	x	0.63	x	0.7	=	28.64	(81)
Northwest 0.9x	0.77	x	5.53	x	9.21	x	0.63	x	0.7	=	15.57	(81)
Northwest 0.9x	0.77	x	3.3	x	9.21	x	0.63	x	0.7	=	18.59	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	64.99	124.6	207.38	318.81	413.55	435.4	409.43	334.95	245.37	147.66	80.37	53.98	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	407.38	464.51	534.87	626.68	701.62	704.24	666.09	597.67	518.37	440.48	395.89	386.55	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.83	0.64	0.48	0.56	0.83	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.78	19.93	20.19	20.56	20.84	20.97	20.99	20.99	20.88	20.51	20.08	19.75	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.96	19.97	19.97	19.98	19.98	19.99	19.99	19.99	19.99	19.98	19.98	19.97	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.93	0.78	0.55	0.38	0.44	0.76	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.34	18.55	18.94	19.46	19.83	19.97	19.99	19.99	19.89	19.4	18.79	18.31	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.69	18.89	19.25	19.73	20.08	20.22	20.24	20.23	20.14	19.68	19.11	18.66	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.69	18.89	19.25	19.73	20.08	20.22	20.24	20.23	20.14	19.68	19.11	18.66	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.79	0.57	0.4	0.47	0.77	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	405.63	460.47	522.52	578.59	551.22	404.1	267.69	280.16	399.85	422.21	392.51	385.26	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1094.32	1061.4	965.11	811.32	626.39	415.84	269.2	283.36	448.74	678.4	900.9	1089.86	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	512.39	403.83	329.29	167.56	55.93	0	0	0	0	190.6	366.04	524.23	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2549.86 (98)

Space heating requirement in kWh/m²/year 38.38 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	512.39	403.83	329.29	167.56	55.93	0	0	0	0	190.6	366.04	524.23	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	548.59	432.36	352.56	179.4	59.88	0	0	0	0	204.07	391.9	561.27	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2730.04 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82

Efficiency of water heater 80.3 (216)

(217)m=	87.46	87.24	86.69	85.32	82.86	80.3	80.3	80.3	80.3	85.52	86.95	87.55

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	214.07	187.46	196.28	176.89	176.33	160.26	153.54	171.16	173.05	185.02	194.27	208.81

Total = Sum(219a)$_{1...12}$ = 2197.14 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2730.04	
Water heating fuel used		2197.14	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		297.79	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	589.69	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	474.58	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1064.27	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	154.55	(268)
Total CO2, kg/year	sum of (265)…(271) =			1257.75	(272)

TER = 18.93 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 74

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	77.64	(1a) x	2.56	(2a) =	198.76	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	77.64	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		198.76	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.15 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.43	0.43	0.42	0.37	0.37	0.32	0.32	0.32	0.34	0.37	0.38	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.62	x1/[1/(1.4)+ 0.04]		=	8.78			(27)
Windows Type 2			3.95	x1/[1/(1.4)+ 0.04]		=	5.24			(27)
Windows Type 3			2.47	x1/[1/(1.4)+ 0.04]		=	3.27			(27)
Floor			74.146	x	0.13	=	9.63898			(28)
Walls Type1	54.34	16.99	37.35	x	0.18	=	6.72			(29)
Walls Type2	14.93	2.42	12.51	x	0.18	=	2.25			(29)
Total area of elements, m²			143.42							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.56 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6408.59 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.79 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 51.34 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	38.99	38.75	38.51	37.4	37.2	36.23	36.23	36.05	36.6	37.2	37.62	38.05	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	90.33	90.09	89.86	88.75	88.54	87.58	87.58	87.4	87.95	88.54	88.96	89.4	

Average = Sum(39)$_{1...12}$ /12= 88.75 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.16	1.16	1.16	1.14	1.14	1.13	1.13	1.13	1.13	1.14	1.15	1.15

Average = Sum(40)$_{1...12}$ /12= 1.14 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.42 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 91.59 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	100.75	97.09	93.43	89.76	86.1	82.43	82.43	86.1	89.76	93.43	97.09	100.75

Total = Sum(44)$_{1...12}$ = 1099.12 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	149.41	130.68	134.85	117.56	112.8	97.34	90.2	103.51	104.74	122.07	133.25	144.7

Total = Sum(45)$_{1...12}$ = 1441.12 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	22.41	19.6	20.23	17.63	16.92	14.6	13.53	15.53	15.71	18.31	19.99	21.7

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	44.69	47.61	44.27	43.87	40.65	42.01	43.87	44.27	47.61	47.88	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	200.37	175.37	182.46	161.83	156.68	137.99	132.21	147.38	149.01	169.68	181.13	195.66	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	200.37	175.37	182.46	161.83	156.68	137.99	132.21	147.38	149.01	169.68	181.13	195.66	

Output from water heater (annual)$_{1...12}$ 1989.76 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	62.42	54.62	56.74	50.16	48.48	42.53	40.49	45.38	45.89	52.49	56.27	60.85	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	19.13	16.99	13.82	10.46	7.82	6.6	7.13	9.27	12.44	15.8	18.44	19.66	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	214.44	216.66	211.06	199.12	184.05	169.89	160.42	158.2	163.81	175.74	190.81	204.98	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	(71)

Water heating gains (Table 5)

(72)m=	83.9	81.28	76.26	69.66	65.16	59.07	54.43	61	63.74	70.55	78.16	81.79	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	379.71	377.18	363.38	341.49	319.27	297.8	284.23	290.72	302.24	324.34	349.66	368.67	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.47	x	11.28	x	0.63	x	0.7	=	8.52	(75)
Northeast 0.9x	0.77	x	2.47	x	22.97	x	0.63	x	0.7	=	17.34	(75)
Northeast 0.9x	0.77	x	2.47	x	41.38	x	0.63	x	0.7	=	31.24	(75)
Northeast 0.9x	0.77	x	2.47	x	67.96	x	0.63	x	0.7	=	51.3	(75)
Northeast 0.9x	0.77	x	2.47	x	91.35	x	0.63	x	0.7	=	68.95	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.47	x	97.38	x	0.63	x	0.7	=	73.51	(75)
Northeast 0.9x	0.77	x	2.47	x	91.1	x	0.63	x	0.7	=	68.77	(75)
Northeast 0.9x	0.77	x	2.47	x	72.63	x	0.63	x	0.7	=	54.82	(75)
Northeast 0.9x	0.77	x	2.47	x	50.42	x	0.63	x	0.7	=	38.06	(75)
Northeast 0.9x	0.77	x	2.47	x	28.07	x	0.63	x	0.7	=	21.19	(75)
Northeast 0.9x	0.77	x	2.47	x	14.2	x	0.63	x	0.7	=	10.72	(75)
Northeast 0.9x	0.77	x	2.47	x	9.21	x	0.63	x	0.7	=	6.96	(75)
Northwest 0.9x	0.77	x	6.62	x	11.28	x	0.63	x	0.7	=	22.83	(81)
Northwest 0.9x	0.77	x	3.95	x	11.28	x	0.63	x	0.7	=	27.24	(81)
Northwest 0.9x	0.77	x	6.62	x	22.97	x	0.63	x	0.7	=	46.47	(81)
Northwest 0.9x	0.77	x	3.95	x	22.97	x	0.63	x	0.7	=	55.45	(81)
Northwest 0.9x	0.77	x	6.62	x	41.38	x	0.63	x	0.7	=	83.72	(81)
Northwest 0.9x	0.77	x	3.95	x	41.38	x	0.63	x	0.7	=	99.9	(81)
Northwest 0.9x	0.77	x	6.62	x	67.96	x	0.63	x	0.7	=	137.49	(81)
Northwest 0.9x	0.77	x	3.95	x	67.96	x	0.63	x	0.7	=	164.07	(81)
Northwest 0.9x	0.77	x	6.62	x	91.35	x	0.63	x	0.7	=	184.81	(81)
Northwest 0.9x	0.77	x	3.95	x	91.35	x	0.63	x	0.7	=	220.54	(81)
Northwest 0.9x	0.77	x	6.62	x	97.38	x	0.63	x	0.7	=	197.02	(81)
Northwest 0.9x	0.77	x	3.95	x	97.38	x	0.63	x	0.7	=	235.12	(81)
Northwest 0.9x	0.77	x	6.62	x	91.1	x	0.63	x	0.7	=	184.31	(81)
Northwest 0.9x	0.77	x	3.95	x	91.1	x	0.63	x	0.7	=	219.95	(81)
Northwest 0.9x	0.77	x	6.62	x	72.63	x	0.63	x	0.7	=	146.94	(81)
Northwest 0.9x	0.77	x	3.95	x	72.63	x	0.63	x	0.7	=	175.35	(81)
Northwest 0.9x	0.77	x	6.62	x	50.42	x	0.63	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	3.95	x	50.42	x	0.63	x	0.7	=	121.73	(81)
Northwest 0.9x	0.77	x	6.62	x	28.07	x	0.63	x	0.7	=	56.78	(81)
Northwest 0.9x	0.77	x	3.95	x	28.07	x	0.63	x	0.7	=	67.76	(81)
Northwest 0.9x	0.77	x	6.62	x	14.2	x	0.63	x	0.7	=	28.72	(81)
Northwest 0.9x	0.77	x	3.95	x	14.2	x	0.63	x	0.7	=	34.28	(81)
Northwest 0.9x	0.77	x	6.62	x	9.21	x	0.63	x	0.7	=	18.64	(81)
Northwest 0.9x	0.77	x	3.95	x	9.21	x	0.63	x	0.7	=	22.25	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	58.59	119.25	214.85	352.85	474.3	505.66	473.03	377.11	261.8	145.74	73.72	47.84	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	438.3	496.43	578.24	694.34	793.57	803.46	757.26	667.83	564.04	470.08	423.38	416.52	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.85	0.66	0.5	0.58	0.86	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.71	19.85	20.12	20.5	20.82	20.96	20.99	20.98	20.86	20.44	20.01	19.69	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.95	19.95	19.95	19.97	19.97	19.98	19.98	19.98	19.97	19.97	19.96	19.96	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.94	0.8	0.57	0.39	0.46	0.8	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.22	18.43	18.82	19.38	19.79	19.95	19.98	19.97	19.85	19.31	18.68	18.2	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.61	18.79	19.16	19.67	20.06	20.21	20.24	20.23	20.11	19.6	19.02	18.58	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.61	18.79	19.16	19.67	20.06	20.21	20.24	20.23	20.11	19.6	19.02	18.58	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.94	0.8	0.59	0.42	0.49	0.81	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	436.96	493.45	568.41	650.17	638.45	475.29	316.29	330.09	455.52	456.17	420.89	415.53	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1292.26	1251.63	1137.35	956.03	740.07	491.65	318.53	335.07	528.77	796.97	1060.84	1285.79	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	636.34	509.49	423.29	220.22	75.61	0	0	0	0	253.56	460.76	647.47	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3226.75 (98)

Space heating requirement in kWh/m²/year 41.56 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	636.34	509.49	423.29	220.22	75.61	0	0	0	0	253.56	460.76	647.47	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	681.31	545.5	453.2	235.79	80.95	0	0	0	0	271.47	493.32	693.23	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3454.76 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	200.37	175.37	182.46	161.83	156.68	137.99	132.21	147.38	149.01	169.68	181.13	195.66

Efficiency of water heater 80.3 (216)

(217)m=	87.76	87.58	87.1	85.83	83.33	80.3	80.3	80.3	80.3	86.06	87.3	87.84

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	228.33	200.24	209.48	188.55	188.02	171.85	164.64	183.54	185.57	197.16	207.47	222.75

Total = Sum(219a)$_{1...12}$ = 2347.6 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		3454.76	
Water heating fuel used		2347.6	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		337.79	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	746.23	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	507.08	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1253.31	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	175.32	(268)
Total CO2, kg/year	sum of (265)…(271) =			1467.55	(272)

TER = 18.9 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 75

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	77.53	(1a) x	2.56	(2a) =	198.47	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	77.53	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		198.47	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) = 30 ÷ (5) =	0.15	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)		0	(9)
Additional infiltration	[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction		0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0		0	(12)
If no draught lobby, enter 0.05, else enter 0		0	(13)
Percentage of windows and doors draught stripped		0	(14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area		5	(17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)	0.4	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered		2	(19)
Shelter factor	(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =	0.34	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.43	0.43	0.42	0.38	0.37	0.32	0.32	0.32	0.34	0.37	0.38	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.61	x1/[1/(1.4)+ 0.04]		=	8.76			(27)
Windows Type 2			3.94	x1/[1/(1.4)+ 0.04]		=	5.22			(27)
Windows Type 3			2.47	x1/[1/(1.4)+ 0.04]		=	3.27			(27)
Walls Type1	54.38	16.96	37.42	x	0.18	=	6.74			(29)
Walls Type2	14.93	2.42	12.51	x	0.18	=	2.25			(29)
Roof	77.53	0	77.53	x	0.13	=	10.08			(30)
Total area of elements, m²			146.84							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.97 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1546.61 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.32 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 49.29 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	38.94	38.7	38.46	37.35	37.15	36.18	36.18	36.01	36.56	37.15	37.57	38	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	88.23	87.99	87.75	86.64	86.44	85.47	85.47	85.3	85.85	86.44	86.86	87.29	

Average = Sum(39)$_{1...12}$ /12= 86.64 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.14	1.13	1.13	1.12	1.11	1.1	1.1	1.1	1.11	1.11	1.12	1.13	
Average = Sum(40)$_{1...12}$ /12=													1.12 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.41 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 91.54 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	100.69	97.03	93.37	89.71	86.05	82.39	82.39	86.05	89.71	93.37	97.03	100.69	
Total = Sum(44)$_{1...12}$ =													1098.47 (44)
Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)													
(45)m=	149.33	130.6	134.77	117.49	112.74	97.28	90.15	103.45	104.68	122	133.17	144.61	
Total = Sum(45)$_{1...12}$ =													1440.27 (45)
If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)													
(46)m=	22.4	19.59	20.22	17.62	16.91	14.59	13.52	15.52	15.7	18.3	19.98	21.69	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)
If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)
If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H													
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	44.66	47.58	44.24	43.85	40.63	41.98	43.85	44.24	47.58	47.85	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	

Output from water heater (annual)$_{1...12}$ 1988.65 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	62.39	54.59	56.71	50.13	48.45	42.5	40.47	45.36	45.87	52.46	56.24	60.82	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	19.11	16.97	13.8	10.45	7.81	6.59	7.12	9.26	12.43	15.78	18.42	19.64	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	214.2	216.42	210.82	198.89	183.84	169.7	160.24	158.02	163.62	175.55	190.6	204.75	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	(71)

Water heating gains (Table 5)

(72)m=	83.86	81.24	76.22	69.62	65.12	59.03	54.4	60.97	63.7	70.51	78.11	81.75	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	379.37	376.84	363.05	341.18	318.98	297.54	283.98	290.46	301.97	324.05	349.35	368.35	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.47	x	11.28	x	0.63	x	0.7	=	8.52	(75)
Northeast 0.9x	0.77	x	2.47	x	22.97	x	0.63	x	0.7	=	17.34	(75)
Northeast 0.9x	0.77	x	2.47	x	41.38	x	0.63	x	0.7	=	31.24	(75)
Northeast 0.9x	0.77	x	2.47	x	67.96	x	0.63	x	0.7	=	51.3	(75)
Northeast 0.9x	0.77	x	2.47	x	91.35	x	0.63	x	0.7	=	68.95	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.47	x	97.38	x	0.63	x	0.7	=	73.51	(75)
Northeast 0.9x	0.77	x	2.47	x	91.1	x	0.63	x	0.7	=	68.77	(75)
Northeast 0.9x	0.77	x	2.47	x	72.63	x	0.63	x	0.7	=	54.82	(75)
Northeast 0.9x	0.77	x	2.47	x	50.42	x	0.63	x	0.7	=	38.06	(75)
Northeast 0.9x	0.77	x	2.47	x	28.07	x	0.63	x	0.7	=	21.19	(75)
Northeast 0.9x	0.77	x	2.47	x	14.2	x	0.63	x	0.7	=	10.72	(75)
Northeast 0.9x	0.77	x	2.47	x	9.21	x	0.63	x	0.7	=	6.96	(75)
Southeast 0.9x	0.77	x	6.61	x	36.79	x	0.63	x	0.7	=	74.33	(77)
Southeast 0.9x	0.77	x	3.94	x	36.79	x	0.63	x	0.7	=	88.61	(77)
Southeast 0.9x	0.77	x	6.61	x	62.67	x	0.63	x	0.7	=	126.61	(77)
Southeast 0.9x	0.77	x	3.94	x	62.67	x	0.63	x	0.7	=	150.93	(77)
Southeast 0.9x	0.77	x	6.61	x	85.75	x	0.63	x	0.7	=	173.23	(77)
Southeast 0.9x	0.77	x	3.94	x	85.75	x	0.63	x	0.7	=	206.51	(77)
Southeast 0.9x	0.77	x	6.61	x	106.25	x	0.63	x	0.7	=	214.64	(77)
Southeast 0.9x	0.77	x	3.94	x	106.25	x	0.63	x	0.7	=	255.88	(77)
Southeast 0.9x	0.77	x	6.61	x	119.01	x	0.63	x	0.7	=	240.41	(77)
Southeast 0.9x	0.77	x	3.94	x	119.01	x	0.63	x	0.7	=	286.61	(77)
Southeast 0.9x	0.77	x	6.61	x	118.15	x	0.63	x	0.7	=	238.68	(77)
Southeast 0.9x	0.77	x	3.94	x	118.15	x	0.63	x	0.7	=	284.53	(77)
Southeast 0.9x	0.77	x	6.61	x	113.91	x	0.63	x	0.7	=	230.11	(77)
Southeast 0.9x	0.77	x	3.94	x	113.91	x	0.63	x	0.7	=	274.32	(77)
Southeast 0.9x	0.77	x	6.61	x	104.39	x	0.63	x	0.7	=	210.88	(77)
Southeast 0.9x	0.77	x	3.94	x	104.39	x	0.63	x	0.7	=	251.4	(77)
Southeast 0.9x	0.77	x	6.61	x	92.85	x	0.63	x	0.7	=	187.57	(77)
Southeast 0.9x	0.77	x	3.94	x	92.85	x	0.63	x	0.7	=	223.61	(77)
Southeast 0.9x	0.77	x	6.61	x	69.27	x	0.63	x	0.7	=	139.93	(77)
Southeast 0.9x	0.77	x	3.94	x	69.27	x	0.63	x	0.7	=	166.81	(77)
Southeast 0.9x	0.77	x	6.61	x	44.07	x	0.63	x	0.7	=	89.03	(77)
Southeast 0.9x	0.77	x	3.94	x	44.07	x	0.63	x	0.7	=	106.13	(77)
Southeast 0.9x	0.77	x	6.61	x	31.49	x	0.63	x	0.7	=	63.61	(77)
Southeast 0.9x	0.77	x	3.94	x	31.49	x	0.63	x	0.7	=	75.83	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	171.45	294.88	410.98	521.81	595.97	596.72	573.2	517.1	449.24	327.93	205.88	146.39	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	550.83	671.71	774.03	862.99	914.96	894.26	857.18	807.56	751.21	651.98	555.22	514.74	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.97	0.91	0.78	0.59	0.44	0.48	0.73	0.94	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.88	20.09	20.36	20.68	20.89	20.98	21	20.99	20.94	20.65	20.2	19.84	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.97	19.97	19.97	19.99	19.99	20	20	20	19.99	19.99	19.98	19.98	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.96	0.88	0.72	0.51	0.34	0.38	0.64	0.91	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.49	18.79	19.19	19.63	19.89	19.99	20	20	19.95	19.6	18.96	18.44	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.79	19.07	19.44	19.85	20.11	20.2	20.22	20.22	20.17	19.83	19.23	18.74	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.79	19.07	19.44	19.85	20.11	20.2	20.22	20.22	20.17	19.83	19.23	18.74	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.87	0.73	0.53	0.36	0.4	0.66	0.91	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	546.4	658.01	735.28	754.49	666.39	470.02	308.03	323.73	494.21	592.79	545.23	511.7	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1278.31	1246.92	1135.89	949.13	726.57	478.85	309.01	325.45	520.97	797.98	1053.88	1269.61	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	544.54	395.75	298.05	140.14	44.77	0	0	0	0	152.66	366.23	563.88	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2506.03 (98)

Space heating requirement in kWh/m²/year 32.32 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	544.54	395.75	298.05	140.14	44.77	0	0	0	0	152.66	366.23	563.88	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	583.02	423.71	319.12	150.04	47.94	0	0	0	0	163.44	392.11	603.73	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2683.11 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57

Efficiency of water heater 80.3 (216)

(217)m=	87.44	87.04	86.28	84.69	82.35	80.3	80.3	80.3	80.3	84.79	86.79	87.56

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	229.05	201.36	211.34	190.97	190.16	171.75	164.55	183.43	185.46	200	208.58	223.35

Total = Sum(219a)$_{1...12}$ = 2359.98 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2683.11	
Water heating fuel used		2359.98	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		337.42	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	579.55	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	509.76	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1089.31	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	175.12	(268)
Total CO2, kg/year	sum of (265)…(271) =			1303.35	(272)

TER = 16.81 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 76

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.94	(1a) x	2.56	(2a) =	130.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.94	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)			0	(9)
Additional infiltration		[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0	(12)
If no draught lobby, enter 0.05, else enter 0			0	(13)
Percentage of windows and doors draught stripped			0	(14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5	(17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered			2	(19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.34	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.24	x1/[1/(1.4)+ 0.04]		=	6.95			(27)
Windows Type 2			3.12	x1/[1/(1.4)+ 0.04]		=	4.14			(27)
Windows Type 3			1.95	x1/[1/(1.4)+ 0.04]		=	2.59			(27)
Walls Type1	24.35	10.31	14.04	x	0.18	=	2.53			(29)
Walls Type2	39.32	2.42	36.9	x	0.18	=	6.64			(29)
Roof	50.94	0	50.94	x	0.13	=	6.62			(30)
Total area of elements, m²			114.61							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.88 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1324.4 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.96 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.84 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.63	25.47	25.31	24.58	24.44	23.8	23.8	23.68	24.05	24.44	24.72	25.01	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	61.47	61.31	61.15	60.42	60.28	59.64	59.64	59.52	59.89	60.28	60.56	60.85	

Average = Sum(39)$_{1...12}$ /12= 60.42 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.21	1.2	1.2	1.19	1.18	1.17	1.17	1.17	1.18	1.18	1.19	1.19

Average = Sum(40)$_{1...12}$ /12= 1.19 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	82.5	79.5	76.5	73.5	70.5	67.5	67.5	70.5	73.5	76.5	79.5	82.5	

Total = Sum(44)$_{1...12}$ = 900.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.35	107.01	110.42	96.27	92.37	79.71	73.86	84.76	85.77	99.96	109.11	118.49	

Total = Sum(45)$_{1...12}$ = 1180.06 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.35	16.05	16.56	14.44	13.86	11.96	11.08	12.71	12.87	14.99	16.37	17.77	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.04	36.59	38.98	36.25	35.93	33.29	34.4	35.93	36.25	38.98	39.21	42.04	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53	

Output from water heater (annual)$_{1...12}$ 1629.95 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.19	44.73	46.46	41.07	39.69	34.83	33.16	37.16	37.58	42.98	46.08	49.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.42	11.92	9.7	7.34	5.49	4.63	5.01	6.51	8.73	11.09	12.94	13.8	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.69	151.24	147.33	138.99	128.48	118.59	111.98	110.43	114.35	122.68	133.2	143.08	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	(71)

Water heating gains (Table 5)

(72)m=	68.8	66.56	62.45	57.04	53.35	48.37	44.57	49.95	52.19	57.77	64	67.08	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	283.69	281.49	271.24	255.15	239.08	223.36	213.33	218.66	227.04	243.31	261.91	275.73	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	1.95	x	11.28	x	0.63	x	0.7	=	6.72	(75)
Northeast 0.9x	0.77	x	1.95	x	22.97	x	0.63	x	0.7	=	13.69	(75)
Northeast 0.9x	0.77	x	1.95	x	41.38	x	0.63	x	0.7	=	24.66	(75)
Northeast 0.9x	0.77	x	1.95	x	67.96	x	0.63	x	0.7	=	40.5	(75)
Northeast 0.9x	0.77	x	1.95	x	91.35	x	0.63	x	0.7	=	54.44	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	1.95	x	97.38	x	0.63	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	1.95	x	91.1	x	0.63	x	0.7	=	54.29	(75)
Northeast 0.9x	0.77	x	1.95	x	72.63	x	0.63	x	0.7	=	43.28	(75)
Northeast 0.9x	0.77	x	1.95	x	50.42	x	0.63	x	0.7	=	30.05	(75)
Northeast 0.9x	0.77	x	1.95	x	28.07	x	0.63	x	0.7	=	16.73	(75)
Northeast 0.9x	0.77	x	1.95	x	14.2	x	0.63	x	0.7	=	8.46	(75)
Northeast 0.9x	0.77	x	1.95	x	9.21	x	0.63	x	0.7	=	5.49	(75)
Southeast 0.9x	0.77	x	5.24	x	36.79	x	0.63	x	0.7	=	58.92	(77)
Southeast 0.9x	0.77	x	3.12	x	36.79	x	0.63	x	0.7	=	35.08	(77)
Southeast 0.9x	0.77	x	5.24	x	62.67	x	0.63	x	0.7	=	100.37	(77)
Southeast 0.9x	0.77	x	3.12	x	62.67	x	0.63	x	0.7	=	59.76	(77)
Southeast 0.9x	0.77	x	5.24	x	85.75	x	0.63	x	0.7	=	137.33	(77)
Southeast 0.9x	0.77	x	3.12	x	85.75	x	0.63	x	0.7	=	81.77	(77)
Southeast 0.9x	0.77	x	5.24	x	106.25	x	0.63	x	0.7	=	170.15	(77)
Southeast 0.9x	0.77	x	3.12	x	106.25	x	0.63	x	0.7	=	101.31	(77)
Southeast 0.9x	0.77	x	5.24	x	119.01	x	0.63	x	0.7	=	190.59	(77)
Southeast 0.9x	0.77	x	3.12	x	119.01	x	0.63	x	0.7	=	113.48	(77)
Southeast 0.9x	0.77	x	5.24	x	118.15	x	0.63	x	0.7	=	189.21	(77)
Southeast 0.9x	0.77	x	3.12	x	118.15	x	0.63	x	0.7	=	112.66	(77)
Southeast 0.9x	0.77	x	5.24	x	113.91	x	0.63	x	0.7	=	182.42	(77)
Southeast 0.9x	0.77	x	3.12	x	113.91	x	0.63	x	0.7	=	108.61	(77)
Southeast 0.9x	0.77	x	5.24	x	104.39	x	0.63	x	0.7	=	167.17	(77)
Southeast 0.9x	0.77	x	3.12	x	104.39	x	0.63	x	0.7	=	99.54	(77)
Southeast 0.9x	0.77	x	5.24	x	92.85	x	0.63	x	0.7	=	148.69	(77)
Southeast 0.9x	0.77	x	3.12	x	92.85	x	0.63	x	0.7	=	88.54	(77)
Southeast 0.9x	0.77	x	5.24	x	69.27	x	0.63	x	0.7	=	110.93	(77)
Southeast 0.9x	0.77	x	3.12	x	69.27	x	0.63	x	0.7	=	66.05	(77)
Southeast 0.9x	0.77	x	5.24	x	44.07	x	0.63	x	0.7	=	70.58	(77)
Southeast 0.9x	0.77	x	3.12	x	44.07	x	0.63	x	0.7	=	42.02	(77)
Southeast 0.9x	0.77	x	5.24	x	31.49	x	0.63	x	0.7	=	50.43	(77)
Southeast 0.9x	0.77	x	3.12	x	31.49	x	0.63	x	0.7	=	30.02	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	100.73	173.81	243.75	311.96	358.5	359.9	345.32	309.99	267.28	193.7	121.06	85.94	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	384.41	455.3	514.99	567.11	597.59	583.26	558.65	528.65	494.32	437.01	382.97	361.67	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.99	0.97	0.92	0.8	0.62	0.46	0.51	0.75	0.94	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.82	20.02	20.29	20.61	20.85	20.97	20.99	20.99	20.92	20.61	20.15	19.79	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.91	19.92	19.92	19.93	19.93	19.94	19.94	19.95	19.94	19.93	19.93	19.92	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.96	0.89	0.75	0.53	0.36	0.4	0.66	0.92	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.37	18.65	19.04	19.5	19.8	19.92	19.94	19.94	19.88	19.5	18.86	18.33	(90)

fLA = Living area ÷ (4) = 0.28 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.78	19.03	19.39	19.81	20.09	20.22	20.24	20.24	20.17	19.81	19.22	18.74	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.78	19.03	19.39	19.81	20.09	20.22	20.24	20.24	20.17	19.81	19.22	18.74	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.89	0.76	0.56	0.39	0.43	0.68	0.91	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	380.62	445.53	490.4	502.75	451.25	325.46	215.64	226.28	338.53	399.08	375.21	358.92	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	889.9	866.61	788.51	659.17	505.93	334.94	216.87	228.3	363.73	555.1	733.93	884.47	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	378.91	282.96	221.8	112.62	40.68	0	0	0	0	116.08	258.27	391.01	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1802.33 (98)

Space heating requirement in kWh/m²/year 35.38 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	378.91	282.96	221.8	112.62	40.68	0	0	0	0	116.08	258.27	391.01	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	405.68	302.96	237.47	120.58	43.55	0	0	0	0	124.29	276.52	418.64	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1929.69 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53

Efficiency of water heater: 80.3 (216)

(217)m= 87.09 | 86.73 | 86.04 | 84.64 | 82.52 | 80.3 | 80.3 | 80.3 | 80.3 | 84.6 | 86.43 | 87.21 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 188.77 | 165.57 | 173.64 | 156.55 | 155.47 | 140.72 | 134.82 | 150.29 | 151.95 | 164.23 | 171.59 | 184.08

Total = Sum(219a)$_{1...12}$ = 1937.69 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1929.69	
Water heating fuel used		1937.69	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		237.05	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	416.81	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	418.54	(264)
Space and water heating	(261) + (262) + (263) + (264) =			835.35	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	123.03	(268)
Total CO2, kg/year	sum of (265)…(271) =			997.31	(272)

TER = 19.58 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 77

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.4	(1a) x	2.56	(2a) =	131.58	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.4	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.58	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.32	0.32	0.32	0.34	0.37	0.38	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.3	x1/[1/(1.4)+ 0.04]		=	7.03			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Windows Type 3			1.98	x1/[1/(1.4)+ 0.04]		=	2.62			(27)
Walls Type1	24.33	10.44	13.89	x	0.18	=	2.5			(29)
Walls Type2	34.01	2.42	31.59	x	0.18	=	5.69			(29)
Roof	51.39	0	51.39	x	0.13	=	6.68			(30)
Total area of elements, m²			109.73							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.13 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1235.63 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.85 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 34.98 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.83	25.67	25.51	24.78	24.64	24	24	23.88	24.25	24.64	24.92	25.21	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	60.81	60.65	60.5	59.76	59.62	58.98	58.98	58.86	59.23	59.62	59.9	60.19	

Average = Sum(39)$_{1...12}$ /12= 59.76 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.18	1.18	1.18	1.16	1.16	1.15	1.15	1.15	1.15	1.16	1.17	1.17	

Average = Sum(40)$_{1...12}$ /12= 1.16 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.73 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.32 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	82.85	79.84	76.82	73.81	70.8	67.79	67.79	70.8	73.81	76.82	79.84	82.85	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 903.82 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	122.86	107.46	110.89	96.67	92.76	80.05	74.17	85.12	86.13	100.38	109.57	118.99	

Total = Sum(45)$_{1...12}$ = 1185.06 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	18.43	16.12	16.63	14.5	13.91	12.01	11.13	12.77	12.92	15.06	16.44	17.85	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.22	36.75	39.15	36.4	36.08	33.43	34.54	36.08	36.4	39.15	39.37	42.22	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.08	144.21	150.04	133.07	128.84	113.48	108.72	121.19	122.53	139.53	148.94	161.21	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.08	144.21	150.04	133.07	128.84	113.48	108.72	121.19	122.53	139.53	148.94	161.21	

Output from water heater (annual)$_{1...12}$ 1636.84 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.41	44.92	46.66	41.24	39.86	34.97	33.3	37.32	37.74	43.16	46.28	50.12	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.52	12.01	9.77	7.4	5.53	4.67	5.04	6.55	8.8	11.17	13.04	13.9	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	150.86	152.43	148.48	140.09	129.48	119.52	112.86	111.3	115.24	123.64	134.24	144.21	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	(71)

Water heating gains (Table 5)

(72)m=	69.1	66.84	62.71	57.28	53.58	48.57	44.76	50.16	52.42	58.02	64.27	67.36	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	285.45	283.25	272.93	256.73	240.56	224.73	214.63	219.99	228.43	244.8	263.52	277.44	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	1.98	x	11.28	x	0.63	x	0.7	=	6.83	(75)
Northeast 0.9x	0.77	x	1.98	x	22.97	x	0.63	x	0.7	=	13.9	(75)
Northeast 0.9x	0.77	x	1.98	x	41.38	x	0.63	x	0.7	=	25.04	(75)
Northeast 0.9x	0.77	x	1.98	x	67.96	x	0.63	x	0.7	=	41.12	(75)
Northeast 0.9x	0.77	x	1.98	x	91.35	x	0.63	x	0.7	=	55.27	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	1.98	x	97.38	x	0.63	x	0.7	=	58.93	(75)
Northeast 0.9x	0.77	x	1.98	x	91.1	x	0.63	x	0.7	=	55.13	(75)
Northeast 0.9x	0.77	x	1.98	x	72.63	x	0.63	x	0.7	=	43.95	(75)
Northeast 0.9x	0.77	x	1.98	x	50.42	x	0.63	x	0.7	=	30.51	(75)
Northeast 0.9x	0.77	x	1.98	x	28.07	x	0.63	x	0.7	=	16.98	(75)
Northeast 0.9x	0.77	x	1.98	x	14.2	x	0.63	x	0.7	=	8.59	(75)
Northeast 0.9x	0.77	x	1.98	x	9.21	x	0.63	x	0.7	=	5.58	(75)
Southeast 0.9x	0.77	x	5.3	x	36.79	x	0.63	x	0.7	=	59.6	(77)
Southeast 0.9x	0.77	x	3.16	x	36.79	x	0.63	x	0.7	=	35.53	(77)
Southeast 0.9x	0.77	x	5.3	x	62.67	x	0.63	x	0.7	=	101.52	(77)
Southeast 0.9x	0.77	x	3.16	x	62.67	x	0.63	x	0.7	=	60.53	(77)
Southeast 0.9x	0.77	x	5.3	x	85.75	x	0.63	x	0.7	=	138.9	(77)
Southeast 0.9x	0.77	x	3.16	x	85.75	x	0.63	x	0.7	=	82.81	(77)
Southeast 0.9x	0.77	x	5.3	x	106.25	x	0.63	x	0.7	=	172.1	(77)
Southeast 0.9x	0.77	x	3.16	x	106.25	x	0.63	x	0.7	=	102.61	(77)
Southeast 0.9x	0.77	x	5.3	x	119.01	x	0.63	x	0.7	=	192.77	(77)
Southeast 0.9x	0.77	x	3.16	x	119.01	x	0.63	x	0.7	=	114.93	(77)
Southeast 0.9x	0.77	x	5.3	x	118.15	x	0.63	x	0.7	=	191.37	(77)
Southeast 0.9x	0.77	x	3.16	x	118.15	x	0.63	x	0.7	=	114.1	(77)
Southeast 0.9x	0.77	x	5.3	x	113.91	x	0.63	x	0.7	=	184.5	(77)
Southeast 0.9x	0.77	x	3.16	x	113.91	x	0.63	x	0.7	=	110.01	(77)
Southeast 0.9x	0.77	x	5.3	x	104.39	x	0.63	x	0.7	=	169.09	(77)
Southeast 0.9x	0.77	x	3.16	x	104.39	x	0.63	x	0.7	=	100.81	(77)
Southeast 0.9x	0.77	x	5.3	x	92.85	x	0.63	x	0.7	=	150.4	(77)
Southeast 0.9x	0.77	x	3.16	x	92.85	x	0.63	x	0.7	=	89.67	(77)
Southeast 0.9x	0.77	x	5.3	x	69.27	x	0.63	x	0.7	=	112.2	(77)
Southeast 0.9x	0.77	x	3.16	x	69.27	x	0.63	x	0.7	=	66.89	(77)
Southeast 0.9x	0.77	x	5.3	x	44.07	x	0.63	x	0.7	=	71.38	(77)
Southeast 0.9x	0.77	x	3.16	x	44.07	x	0.63	x	0.7	=	42.56	(77)
Southeast 0.9x	0.77	x	5.3	x	31.49	x	0.63	x	0.7	=	51	(77)
Southeast 0.9x	0.77	x	3.16	x	31.49	x	0.63	x	0.7	=	30.41	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	101.96	175.94	246.75	315.83	362.98	364.4	349.64	313.85	270.58	196.07	122.53	86.99	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	387.41	459.19	519.69	572.57	603.54	589.13	564.27	533.83	499	440.87	386.06	364.43	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.99	0.97	0.91	0.8	0.61	0.45	0.5	0.74	0.94	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.86	20.05	20.32	20.64	20.86	20.97	20.99	20.99	20.93	20.62	20.18	19.82	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.93	19.94	19.94	19.95	19.95	19.96	19.96	19.96	19.96	19.95	19.95	19.94	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.96	0.89	0.74	0.53	0.35	0.39	0.66	0.91	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.43	18.71	19.1	19.54	19.83	19.94	19.96	19.96	19.91	19.54	18.91	18.38	(90)

fLA = Living area ÷ (4) = 0.35 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.93	19.18	19.52	19.92	20.19	20.3	20.32	20.32	20.26	19.92	19.35	18.88	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.93	19.18	19.52	19.92	20.19	20.3	20.32	20.32	20.26	19.92	19.35	18.88	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.89	0.75	0.56	0.39	0.43	0.68	0.91	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	383.7	449.47	494.88	506.95	454.07	327.46	218.31	228.84	340.95	402.58	378.39	361.75	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	889.41	865.93	787.91	658.73	506.16	336.35	219.47	230.76	365.03	555.53	733.8	883.87	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	376.25	279.86	218.01	109.28	38.75	0	0	0	0	113.79	255.9	388.45	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1780.31 (98)

Space heating requirement in kWh/m²/year 34.64 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	376.25	279.86	218.01	109.28	38.75	0	0	0	0	113.79	255.9	388.45	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	402.84	299.64	233.42	117.01	41.49	0	0	0	0	121.84	273.98	415.9	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1906.11 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	165.08	144.21	150.04	133.07	128.84	113.48	108.72	121.19	122.53	139.53	148.94	161.21

Efficiency of water heater 80.3 (216)

(217)m=	87.06	86.69	85.99	84.56	82.43	80.3	80.3	80.3	80.3	84.54	86.4	87.18

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.62	166.34	174.48	157.37	156.3	141.31	135.39	150.93	152.59	165.04	172.39	184.91

Total = Sum(219a)$_{1...12}$ = 1946.67 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1906.11	
Water heating fuel used		1946.67	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		238.83	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	411.72	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	420.48	(264)
Space and water heating	(261) + (262) + (263) + (264) =			832.2	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	123.95	(268)
Total CO2, kg/year	sum of (265)…(271) =			995.08	(272)

TER = 19.36 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 78

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	49.58	(1a) x	2.56	(2a) =	126.92	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	49.58	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		126.92	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.16 (8)

If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)

Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)		0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =		0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Windows Type 2			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Floor			38.452	x	0.13	=	4.99876			(28)
Walls Type1	17.48	7.51	9.97	x	0.18	=	1.79			(29)
Walls Type2	22.47	2.42	20.05	x	0.18	=	3.61			(29)
Roof	49.58	0	49.58	x	0.13	=	6.45			(30)
Total area of elements, m²			127.98							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 29.22 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 3840.42 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.77 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 33 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.03	24.87	24.71	23.98	23.85	23.21	23.21	23.09	23.45	23.85	24.12	24.41	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	58.02	57.86	57.71	56.98	56.84	56.21	56.21	56.09	56.45	56.84	57.12	57.41	

Average = Sum(39)$_{1...12}$ /12= 56.98 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.17	1.17	1.16	1.15	1.15	1.13	1.13	1.13	1.14	1.15	1.15	1.16

Average = Sum(40)$_{1...12}$ /12= 1.15 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.68 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.04 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	81.45	78.49	75.53	72.56	69.6	66.64	66.64	69.6	72.56	75.53	78.49	81.45

Total = Sum(44)$_{1...12}$ = 888.53 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	120.79	105.64	109.01	95.04	91.19	78.69	72.92	83.68	84.68	98.68	107.72	116.97

Total = Sum(45)$_{1...12}$ = 1165 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.12	15.85	16.35	14.26	13.68	11.8	10.94	12.55	12.7	14.8	16.16	17.55

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.51	36.13	38.49	35.78	35.47	32.86	33.96	35.47	35.78	38.49	38.71	41.51	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	162.29	141.77	147.5	130.82	126.66	111.56	106.88	119.14	120.46	137.17	146.42	158.48	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	162.29	141.77	147.5	130.82	126.66	111.56	106.88	119.14	120.46	137.17	146.42	158.48	

Output from water heater (annual)$_{1...12}$ 1609.15 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.54	44.16	45.87	40.55	39.19	34.38	32.74	36.69	37.1	42.43	45.49	49.27	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.74	12.21	9.93	7.52	5.62	4.74	5.12	6.66	8.94	11.35	13.25	14.13	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	146.14	147.65	143.83	135.7	125.43	115.77	109.33	107.81	111.63	119.77	130.04	139.69	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	(71)

Water heating gains (Table 5)

(72)m=	67.93	65.71	61.65	56.31	52.67	47.75	44	49.31	51.53	57.03	63.18	66.22	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	278.97	276.73	266.57	250.69	234.88	219.43	209.62	214.95	223.27	239.32	257.64	271.2	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.63	x	0.7	=	9.97	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.63	x	0.7	=	20.28	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.63	x	0.7	=	36.55	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.63	x	0.7	=	60.02	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.63	x	0.7	=	80.68	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.63	x	0.7	=	86.01	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.63	x	0.7	=	80.46	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.63	x	0.7	=	64.15	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.63	x	0.7	=	44.53	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.63	x	0.7	=	24.79	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.63	x	0.7	=	12.54	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.63	x	0.7	=	8.14	(75)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.63	x	0.7	=	51.95	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.63	x	0.7	=	88.49	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.63	x	0.7	=	121.08	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.63	x	0.7	=	150.02	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.63	x	0.7	=	168.03	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.63	x	0.7	=	166.82	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.63	x	0.7	=	160.83	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.63	x	0.7	=	147.39	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.63	x	0.7	=	131.1	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.63	x	0.7	=	97.8	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.63	x	0.7	=	62.22	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.63	x	0.7	=	44.46	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	61.92	108.78	157.62	210.04	248.71	252.83	241.29	211.54	175.63	122.59	74.76	52.6	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	340.89	385.51	424.2	460.73	483.6	472.27	450.91	426.49	398.9	361.91	332.4	323.8	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.95	0.87	0.71	0.54	0.59	0.83	0.97	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.81	19.96	20.21	20.52	20.79	20.95	20.99	20.98	20.89	20.54	20.12	19.79	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.94	19.95	19.95	19.96	19.96	19.97	19.97	19.98	19.97	19.96	19.96	19.95	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.93	0.82	0.61	0.42	0.46	0.75	0.95	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.37	18.59	18.95	19.41	19.76	19.94	19.97	19.97	19.88	19.44	18.83	18.34	(90)

fLA = Living area ÷ (4) = 0.36 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.89	19.09	19.4	19.81	20.14	20.3	20.34	20.34	20.24	19.84	19.3	18.86	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.89	19.09	19.4	19.81	20.14	20.3	20.34	20.34	20.24	19.84	19.3	18.86	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.99	0.97	0.93	0.83	0.65	0.46	0.51	0.77	0.95	0.99	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	338.63	380.67	412.7	429.09	401.78	304.76	207.78	216.97	307.82	342.62	328.11	322.11	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	846.72	821.04	744.62	621.68	479.5	320.65	210.12	220.76	346.77	525.09	696.8	841.82	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	378.02	295.93	246.94	138.67	57.83	0	0	0	0	135.76	265.46	386.67	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1905.26 (98)

Space heating requirement in kWh/m²/year 38.43 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	378.02	295.93	246.94	138.67	57.83	0	0	0	0	135.76	265.46	386.67	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	404.73	316.84	264.39	148.47	61.91	0	0	0	0	145.35	284.21	413.99	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2039.9 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	162.29	141.77	147.5	130.82	126.66	111.56	106.88	119.14	120.46	137.17	146.42	158.48

Efficiency of water heater 80.3 (216)

(217)m=	87.11	86.86	86.34	85.2	83.21	80.3	80.3	80.3	80.3	85.03	86.53	87.21	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	186.31	163.21	170.84	153.55	152.21	138.92	133.1	148.37	150.01	161.33	169.22	181.72	

Total = Sum(219a)$_{1...12}$ = 1908.79 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2039.9

TER WorkSheet: New dwelling design stage

Water heating fuel used		1908.79	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		242.72	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	440.62	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	412.3	(264)
Space and water heating	(261) + (262) + (263) + (264) =				852.92	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	125.97	(268)
Total CO2, kg/year		sum of (265)…(271) =			1017.81	(272)

TER = 20.53 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 79

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.98	(1a) x	2.56	(2a) =	130.51	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.98	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.51	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.34	0.37	0.39	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.52	x	1/[1/(1.4)+ 0.04]	=	9.97			(27)
Windows Type 2			2.8	x	1/[1/(1.4)+ 0.04]	=	3.71			(27)
Walls Type1	26.3	10.32	15.98	x	0.18	=	2.88			(29)
Walls Type2	25.88	2.42	23.45	x	0.18	=	4.22			(29)
Roof	50.98	0	50.98	x	0.13	=	6.63			(30)
Total area of elements, m²			103.16							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 29.83 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1129.26 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.08 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 33.91 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.65	25.49	25.33	24.59	24.46	23.82	23.82	23.7	24.06	24.46	24.74	25.03	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	59.55	59.39	59.24	58.5	58.36	57.72	57.72	57.61	57.97	58.36	58.64	58.93	

Average = Sum(39)$_{1...12}$ /12= 58.5 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.17	1.17	1.16	1.15	1.14	1.13	1.13	1.13	1.14	1.14	1.15	1.16	
Average = Sum(40)$_{1...12}$ /12=													1.15 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.03 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	82.53	79.53	76.53	73.52	70.52	67.52	67.52	70.52	73.52	76.53	79.53	82.53	
Total = Sum(44)$_{1...12}$ =													900.3 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.39	107.04	110.46	96.3	92.4	79.73	73.89	84.78	85.8	99.99	109.14	118.52	
Total = Sum(45)$_{1...12}$ =													1180.44 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.36	16.06	16.57	14.44	13.86	11.96	11.08	12.72	12.87	15	16.37	17.78	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.06	36.6	39	36.26	35.94	33.3	34.41	35.94	36.26	39	39.22	42.06	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.44	143.64	149.45	132.56	128.34	113.03	108.29	120.72	122.06	138.98	148.36	160.58	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.44	143.64	149.45	132.56	128.34	113.03	108.29	120.72	122.06	138.98	148.36	160.58	

Output from water heater (annual)$_{1...12}$ 1630.46 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.21	44.74	46.48	41.08	39.71	34.84	33.17	37.18	37.59	43	46.1	49.92	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.43	11.93	9.7	7.34	5.49	4.63	5.01	6.51	8.74	11.09	12.95	13.8	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.78	151.33	147.41	139.08	128.55	118.66	112.05	110.5	114.41	122.75	133.28	143.17	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	(71)

Water heating gains (Table 5)

(72)m=	68.83	66.58	62.47	57.06	53.37	48.38	44.58	49.97	52.21	57.79	64.02	67.1	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	283.82	281.62	271.37	255.27	239.2	223.46	213.42	218.76	227.15	243.42	262.03	275.86	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.52	x	36.79	x	0.63	x	0.7	=	84.56	(77)
Southeast 0.9x	0.77	x	2.8	x	36.79	x	0.63	x	0.7	=	31.49	(77)
Southeast 0.9x	0.77	x	7.52	x	62.67	x	0.63	x	0.7	=	144.04	(77)
Southeast 0.9x	0.77	x	2.8	x	62.67	x	0.63	x	0.7	=	53.63	(77)
Southeast 0.9x	0.77	x	7.52	x	85.75	x	0.63	x	0.7	=	197.08	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.8	x	85.75	x	0.63	x	0.7	=	73.38	(77)
Southeast 0.9x	0.77	x	7.52	x	106.25	x	0.63	x	0.7	=	244.19	(77)
Southeast 0.9x	0.77	x	2.8	x	106.25	x	0.63	x	0.7	=	90.92	(77)
Southeast 0.9x	0.77	x	7.52	x	119.01	x	0.63	x	0.7	=	273.51	(77)
Southeast 0.9x	0.77	x	2.8	x	119.01	x	0.63	x	0.7	=	101.84	(77)
Southeast 0.9x	0.77	x	7.52	x	118.15	x	0.63	x	0.7	=	271.53	(77)
Southeast 0.9x	0.77	x	2.8	x	118.15	x	0.63	x	0.7	=	101.1	(77)
Southeast 0.9x	0.77	x	7.52	x	113.91	x	0.63	x	0.7	=	261.79	(77)
Southeast 0.9x	0.77	x	2.8	x	113.91	x	0.63	x	0.7	=	97.47	(77)
Southeast 0.9x	0.77	x	7.52	x	104.39	x	0.63	x	0.7	=	239.91	(77)
Southeast 0.9x	0.77	x	2.8	x	104.39	x	0.63	x	0.7	=	89.33	(77)
Southeast 0.9x	0.77	x	7.52	x	92.85	x	0.63	x	0.7	=	213.39	(77)
Southeast 0.9x	0.77	x	2.8	x	92.85	x	0.63	x	0.7	=	79.45	(77)
Southeast 0.9x	0.77	x	7.52	x	69.27	x	0.63	x	0.7	=	159.19	(77)
Southeast 0.9x	0.77	x	2.8	x	69.27	x	0.63	x	0.7	=	59.27	(77)
Southeast 0.9x	0.77	x	7.52	x	44.07	x	0.63	x	0.7	=	101.28	(77)
Southeast 0.9x	0.77	x	2.8	x	44.07	x	0.63	x	0.7	=	37.71	(77)
Southeast 0.9x	0.77	x	7.52	x	31.49	x	0.63	x	0.7	=	72.37	(77)
Southeast 0.9x	0.77	x	2.8	x	31.49	x	0.63	x	0.7	=	26.94	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	116.05	197.67	270.46	335.11	375.35	372.64	359.26	329.24	292.85	218.46	139	99.31	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	399.86	479.29	541.82	590.38	614.55	596.1	572.69	548	519.99	461.88	401.02	375.17	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.9	0.78	0.6	0.44	0.48	0.71	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.9	20.11	20.38	20.67	20.88	20.98	21	20.99	20.94	20.67	20.23	19.87	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.95	19.95	19.95	19.96	19.96	19.97	19.97	19.98	19.97	19.96	19.96	19.96	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.87	0.72	0.51	0.34	0.37	0.63	0.9	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.51	18.81	19.19	19.6	19.86	19.96	19.97	19.97	19.93	19.61	18.99	18.46	(90)

fLA = Living area ÷ (4) = 0.31 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.94	19.21	19.55	19.93	20.17	20.27	20.29	20.29	20.24	19.93	19.37	18.89	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.94	19.21	19.55	19.93	20.17	20.27	20.29	20.29	20.24	19.93	19.37	18.89	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.94	0.87	0.73	0.54	0.37	0.41	0.65	0.9	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	395.29	466.77	510.56	513.1	450.33	320.23	211.98	222.55	337.77	413.44	391.32	371.91	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	871.59	849.69	773.27	645.37	494.46	327.42	212.85	223.94	356.05	544.71	719.36	865.74	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	354.36	257.32	195.46	95.24	32.83	0	0	0	0	97.66	236.19	367.41	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1636.48 (98)

Space heating requirement in kWh/m²/year 32.1 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	354.36	257.32	195.46	95.24	32.83	0	0	0	0	97.66	236.19	367.41	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	379.4	275.5	209.27	101.97	35.15	0	0	0	0	104.56	252.88	393.37	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1752.12 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.44	143.64	149.45	132.56	128.34	113.03	108.29	120.72	122.06	138.98	148.36	160.58

Efficiency of water heater 80.3 (216)

(217)m=	86.93	86.5	85.73	84.23	82.17	80.3	80.3	80.3	80.3	84.18	86.22	87.07	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.16	166.06	174.33	157.37	156.19	140.76	134.86	150.34	152	165.1	172.08	184.43	

Total = Sum(219a)$_{1...12}$ = 1942.67 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1752.12

TER WorkSheet: New dwelling design stage

Water heating fuel used			1942.67	
Electricity for pumps, fans and electric keep-hot				
central heating pump:		30		(230c)
boiler with a fan-assisted flue		45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		75	(231)
Electricity for lighting			237.18	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	378.46	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	419.62	(264)
Space and water heating	(261) + (262) + (263) + (264) =				798.07	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	123.1	(268)
Total CO2, kg/year	sum of (265)…(271) =				960.1	(272)

TER = 18.83 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 80

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.54	(1a) x	2.56	(2a) =	131.94	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.54	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.94	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.15 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.32	0.32	0.32	0.34	0.37	0.38	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.56	x	1/[1/(1.4)+ 0.04]	=	8.7			(27)
Windows Type 2			3.91	x	1/[1/(1.4)+ 0.04]	=	5.18			(27)
Walls Type1	31.45	10.47	20.98	x	0.18	=	3.78			(29)
Walls Type2	32.9	2.42	30.48	x	0.18	=	5.49			(29)
Roof	51.54	0	51.54	x	0.13	=	6.7			(30)
Total area of elements, m²			115.89							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 32.26 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1338.6 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.12 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 36.39 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.89	25.73	25.58	24.84	24.7	24.06	24.06	23.94	24.31	24.7	24.98	25.27	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	62.28	62.12	61.96	61.23	61.09	60.45	60.45	60.33	60.69	61.09	61.37	61.66	

Average = Sum(39)$_{1...12}$ /12= 61.23 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.21	1.21	1.2	1.19	1.19	1.17	1.17	1.17	1.18	1.19	1.19	1.2

Average = Sum(40)$_{1...12}$ /12= 1.19 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.96	79.94	76.93	73.91	70.89	67.88	67.88	70.89	73.91	76.93	79.94	82.96

Total = Sum(44)$_{1...12}$ = 905.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	123.03	107.6	111.03	96.8	92.88	80.15	74.27	85.23	86.25	100.51	109.72	119.15

Total = Sum(45)$_{1...12}$ = 1186.62 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.45	16.14	16.66	14.52	13.93	12.02	11.14	12.78	12.94	15.08	16.46	17.87

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.28	36.8	39.2	36.45	36.13	33.47	34.59	36.13	36.45	39.2	39.42	42.28	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	

Output from water heater (annual)$_{1...12}$ 1639.01 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.48	44.98	46.72	41.3	39.92	35.02	33.34	37.37	37.79	43.22	46.34	50.18	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.56	12.04	9.79	7.41	5.54	4.68	5.06	6.57	8.82	11.2	13.07	13.93	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.23	152.8	148.85	140.43	129.8	119.81	113.14	111.57	115.53	123.94	134.57	144.56	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	(71)

Water heating gains (Table 5)

(72)m=	69.19	66.93	62.79	57.36	53.65	48.64	44.82	50.23	52.48	58.09	64.36	67.45	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	286.01	283.8	273.47	257.23	241.02	225.16	215.04	220.4	228.86	245.27	264.03	277.98	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	6.56	x	36.79	x	0.63	x	0.7	=	73.77	(77)
Southeast 0.9x	0.77	x	3.91	x	36.79	x	0.63	x	0.7	=	43.97	(77)
Southeast 0.9x	0.77	x	6.56	x	62.67	x	0.63	x	0.7	=	125.65	(77)
Southeast 0.9x	0.77	x	3.91	x	62.67	x	0.63	x	0.7	=	74.89	(77)
Southeast 0.9x	0.77	x	6.56	x	85.75	x	0.63	x	0.7	=	171.92	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	3.91	x	85.75	x	0.63	x	0.7	=	102.47	(77)
Southeast 0.9x	0.77	x	6.56	x	106.25	x	0.63	x	0.7	=	213.02	(77)
Southeast 0.9x	0.77	x	3.91	x	106.25	x	0.63	x	0.7	=	126.97	(77)
Southeast 0.9x	0.77	x	6.56	x	119.01	x	0.63	x	0.7	=	238.6	(77)
Southeast 0.9x	0.77	x	3.91	x	119.01	x	0.63	x	0.7	=	142.21	(77)
Southeast 0.9x	0.77	x	6.56	x	118.15	x	0.63	x	0.7	=	236.87	(77)
Southeast 0.9x	0.77	x	3.91	x	118.15	x	0.63	x	0.7	=	141.18	(77)
Southeast 0.9x	0.77	x	6.56	x	113.91	x	0.63	x	0.7	=	228.37	(77)
Southeast 0.9x	0.77	x	3.91	x	113.91	x	0.63	x	0.7	=	136.12	(77)
Southeast 0.9x	0.77	x	6.56	x	104.39	x	0.63	x	0.7	=	209.28	(77)
Southeast 0.9x	0.77	x	3.91	x	104.39	x	0.63	x	0.7	=	124.74	(77)
Southeast 0.9x	0.77	x	6.56	x	92.85	x	0.63	x	0.7	=	186.15	(77)
Southeast 0.9x	0.77	x	3.91	x	92.85	x	0.63	x	0.7	=	110.95	(77)
Southeast 0.9x	0.77	x	6.56	x	69.27	x	0.63	x	0.7	=	138.87	(77)
Southeast 0.9x	0.77	x	3.91	x	69.27	x	0.63	x	0.7	=	82.77	(77)
Southeast 0.9x	0.77	x	6.56	x	44.07	x	0.63	x	0.7	=	88.35	(77)
Southeast 0.9x	0.77	x	3.91	x	44.07	x	0.63	x	0.7	=	52.66	(77)
Southeast 0.9x	0.77	x	6.56	x	31.49	x	0.63	x	0.7	=	63.13	(77)
Southeast 0.9x	0.77	x	3.91	x	31.49	x	0.63	x	0.7	=	37.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	117.73	200.54	274.39	339.98	380.81	378.05	364.48	334.03	297.1	221.64	141.02	100.75	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	403.74	484.34	547.85	597.21	621.83	603.21	579.53	554.43	525.97	466.91	405.05	378.73	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.91	0.79	0.61	0.45	0.49	0.73	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.85	20.06	20.33	20.64	20.86	20.97	20.99	20.99	20.93	20.64	20.18	19.81	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.91	19.92	19.92	19.93	19.93	19.94	19.94	19.94	19.94	19.93	19.93	19.92	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.88	0.73	0.52	0.35	0.38	0.64	0.9	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.4	18.7	19.1	19.53	19.81	19.92	19.94	19.94	19.89	19.54	18.89	18.35	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.76	19.04	19.41	19.81	20.07	20.19	20.2	20.2	20.15	19.81	19.22	18.72	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.76	19.04	19.41	19.81	20.07	20.19	20.2	20.2	20.15	19.81	19.22	18.72	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.94	0.87	0.74	0.55	0.37	0.41	0.66	0.9	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	399.08	471.79	516.92	521.49	460.53	328.9	216.75	227.75	345.83	419.27	395.31	375.4	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	900.83	878.54	799.66	667.73	511.31	337.59	217.83	229.45	367.21	562.73	743.52	895.13	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	373.3	273.33	210.36	105.29	37.78	0	0	0	0	106.73	250.71	386.68	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1744.19 (98)

Space heating requirement in kWh/m²/year 33.84 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	373.3	273.33	210.36	105.29	37.78	0	0	0	0	106.73	250.71	386.68	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	399.68	292.65	225.22	112.73	40.45	0	0	0	0	114.27	268.43	414.01	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1867.45 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42

Efficiency of water heater 80.3 (216)

(217)m=	87.04	86.63	85.9	84.47	82.38	80.3	80.3	80.3	80.3	84.38	86.35	87.17	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.92	166.67	174.9	157.76	156.59	141.5	135.57	151.13	152.8	165.57	172.72	185.18	

Total = Sum(219a)$_{1...12}$ = 1950.3 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1867.45

TER WorkSheet: New dwelling design stage

Water heating fuel used		1950.3	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		239.41	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	403.37	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	421.26	(264)
Space and water heating	(261) + (262) + (263) + (264) =				824.63	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	38.93	(267)
Electricity for lighting	(232) x		0.519	=	124.25	(268)
Total CO2, kg/year		sum of (265)…(271) =			987.81	(272)

TER = 19.17 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 81

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.98	(1a) x	2.56	(2a) =	189.38	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.98	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		189.38	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.43	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.47	x	1/[1/(1.4)+ 0.04]	=	7.25			(27)
Windows Type 2			3.26	x	1/[1/(1.4)+ 0.04]	=	4.32			(27)
Windows Type 3			2.04	x	1/[1/(1.4)+ 0.04]	=	2.7			(27)
Walls Type1	57.81	16.07	41.74	x	0.18	=	7.51			(29)
Walls Type2	35.86	2.42	33.44	x	0.18	=	6.02			(29)
Roof	73.98	0	73.98	x	0.13	=	9.62			(30)
Total area of elements, m²			167.64							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 46.87 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1943.78 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.77 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 52.64 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	37.37	37.13	36.9	35.8	35.6	34.65	34.65	34.47	35.01	35.6	36.01	36.45	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	90.01	89.78	89.54	88.45	88.24	87.29	87.29	87.11	87.66	88.24	88.66	89.09	

Average = Sum(39)$_{1...12}$ /12= 88.45 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.22	1.21	1.21	1.2	1.19	1.18	1.18	1.18	1.18	1.19	1.2	1.2	
Average = Sum(40)$_{1...12}$ /12=													1.2 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.34 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.74 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	98.72	95.13	91.54	87.95	84.36	80.77	80.77	84.36	87.95	91.54	95.13	98.72	
Total = Sum(44)$_{1...12}$ =													1076.93 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.4	128.04	132.13	115.19	110.53	95.38	88.38	101.42	102.63	119.6	130.56	141.78	
Total = Sum(45)$_{1...12}$ =													1412.03 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.96	19.21	19.82	17.28	16.58	14.31	13.26	15.21	15.39	17.94	19.58	21.27	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)
If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.31	43.79	46.65	43.37	42.99	39.83	41.16	42.99	43.37	46.65	46.91	50.31	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	

Output from water heater (annual)$_{1...12}$ 1950.34 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.25	53.52	55.59	49.14	47.5	41.67	39.68	44.47	44.97	51.43	55.14	59.72	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.42	16.36	13.3	10.07	7.53	6.36	6.87	8.93	11.98	15.21	17.75	18.93	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	206.4	208.54	203.14	191.65	177.15	163.52	154.41	152.27	157.67	169.16	183.66	197.29	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	(71)

Water heating gains (Table 5)

(72)m=	82.33	79.64	74.72	68.26	63.84	57.88	53.33	59.77	62.45	69.13	76.58	80.27	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	368.22	365.62	352.25	331.06	309.6	288.83	275.69	282.04	293.18	314.58	339.08	357.56	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	5.47	x	36.79	x	0.63	x	0.7	=	61.51	(77)
Southeast 0.9x	0.77	x	3.26	x	36.79	x	0.63	x	0.7	=	73.32	(77)
Southeast 0.9x	0.77	x	5.47	x	62.67	x	0.63	x	0.7	=	104.77	(77)
Southeast 0.9x	0.77	x	3.26	x	62.67	x	0.63	x	0.7	=	124.88	(77)
Southeast 0.9x	0.77	x	5.47	x	85.75	x	0.63	x	0.7	=	143.35	(77)

TER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	3.26	x	85.75	x	0.63	x	0.7	=	170.87	(77)
Southeast 0.9x	0.77	x	5.47	x	106.25	x	0.63	x	0.7	=	177.62	(77)
Southeast 0.9x	0.77	x	3.26	x	106.25	x	0.63	x	0.7	=	211.72	(77)
Southeast 0.9x	0.77	x	5.47	x	119.01	x	0.63	x	0.7	=	198.95	(77)
Southeast 0.9x	0.77	x	3.26	x	119.01	x	0.63	x	0.7	=	237.14	(77)
Southeast 0.9x	0.77	x	5.47	x	118.15	x	0.63	x	0.7	=	197.51	(77)
Southeast 0.9x	0.77	x	3.26	x	118.15	x	0.63	x	0.7	=	235.43	(77)
Southeast 0.9x	0.77	x	5.47	x	113.91	x	0.63	x	0.7	=	190.42	(77)
Southeast 0.9x	0.77	x	3.26	x	113.91	x	0.63	x	0.7	=	226.98	(77)
Southeast 0.9x	0.77	x	5.47	x	104.39	x	0.63	x	0.7	=	174.51	(77)
Southeast 0.9x	0.77	x	3.26	x	104.39	x	0.63	x	0.7	=	208.01	(77)
Southeast 0.9x	0.77	x	5.47	x	92.85	x	0.63	x	0.7	=	155.22	(77)
Southeast 0.9x	0.77	x	3.26	x	92.85	x	0.63	x	0.7	=	185.02	(77)
Southeast 0.9x	0.77	x	5.47	x	69.27	x	0.63	x	0.7	=	115.79	(77)
Southeast 0.9x	0.77	x	3.26	x	69.27	x	0.63	x	0.7	=	138.02	(77)
Southeast 0.9x	0.77	x	5.47	x	44.07	x	0.63	x	0.7	=	73.67	(77)
Southeast 0.9x	0.77	x	3.26	x	44.07	x	0.63	x	0.7	=	87.81	(77)
Southeast 0.9x	0.77	x	5.47	x	31.49	x	0.63	x	0.7	=	52.64	(77)
Southeast 0.9x	0.77	x	3.26	x	31.49	x	0.63	x	0.7	=	62.74	(77)
Southwest 0.9x	0.77	x	2.04	x	36.79		0.63	x	0.7	=	45.88	(79)
Southwest 0.9x	0.77	x	2.04	x	62.67		0.63	x	0.7	=	78.15	(79)
Southwest 0.9x	0.77	x	2.04	x	85.75		0.63	x	0.7	=	106.93	(79)
Southwest 0.9x	0.77	x	2.04	x	106.25		0.63	x	0.7	=	132.49	(79)
Southwest 0.9x	0.77	x	2.04	x	119.01		0.63	x	0.7	=	148.39	(79)
Southwest 0.9x	0.77	x	2.04	x	118.15		0.63	x	0.7	=	147.32	(79)
Southwest 0.9x	0.77	x	2.04	x	113.91		0.63	x	0.7	=	142.03	(79)
Southwest 0.9x	0.77	x	2.04	x	104.39		0.63	x	0.7	=	130.16	(79)
Southwest 0.9x	0.77	x	2.04	x	92.85		0.63	x	0.7	=	115.78	(79)
Southwest 0.9x	0.77	x	2.04	x	69.27		0.63	x	0.7	=	86.37	(79)
Southwest 0.9x	0.77	x	2.04	x	44.07		0.63	x	0.7	=	54.95	(79)
Southwest 0.9x	0.77	x	2.04	x	31.49		0.63	x	0.7	=	39.26	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	180.7	307.8	421.15	521.82	584.49	580.26	559.43	512.68	456.01	340.19	216.44	154.64	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	548.93	673.42	773.4	852.88	894.08	869.09	835.12	794.73	749.2	654.76	555.52	512.21	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.99	0.97	0.91	0.79	0.61	0.45	0.5	0.73	0.94	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.8	20.02	20.31	20.63	20.86	20.97	20.99	20.99	20.93	20.62	20.14	19.76	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.91	19.91	19.91	19.92	19.93	19.94	19.94	19.94	19.93	19.93	19.92	19.92	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.88	0.73	0.52	0.35	0.39	0.65	0.91	0.98	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.33	18.65	19.06	19.51	19.8	19.92	19.93	19.93	19.88	19.51	18.83	18.28	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.69	18.99	19.37	19.78	20.06	20.18	20.19	20.19	20.14	19.78	19.16	18.64	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.69	18.99	19.37	19.78	20.06	20.18	20.19	20.19	20.14	19.78	19.16	18.64	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.88	0.74	0.55	0.37	0.41	0.66	0.9	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	543.78	657.87	732.19	746.95	663.07	473.98	312.22	328	496.91	592.54	544.2	508.63	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1295.28	1264.53	1152.12	962.76	737.55	486.73	313.8	330.57	529.32	810.01	1068.79	1286.65	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	559.12	407.68	312.42	155.38	55.42	0	0	0	0	161.79	377.7	578.84	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2608.36 (98)

Space heating requirement in kWh/m²/year 35.26 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	559.12	407.68	312.42	155.38	55.42	0	0	0	0	161.79	377.7	578.84	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	598.63	436.49	334.5	166.36	59.33	0	0	0	0	173.23	404.39	619.75	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2792.68 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08

Efficiency of water heater 80.3 (216)

(217)m= 87.53 | 87.15 | 86.44 | 85 | 82.75 | 80.3 | 80.3 | 80.3 | 80.3 | 84.98 | 86.91 | 87.65 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 224.71 | 197.16 | 206.81 | 186.54 | 185.51 | 168.38 | 161.32 | 179.83 | 181.82 | 195.63 | 204.21 | 219.14

Total = Sum(219a)$_{1...12}$ = 2311.08 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2792.68	
Water heating fuel used		2311.08	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		325.23	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	603.22	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	499.19	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1102.41	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	168.79	(268)
Total CO2, kg/year	sum of (265)…(271) =			1310.13	(272)

TER = 17.71 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 82

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.98	(1a) x	2.56	(2a) =	189.38	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.98	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		189.38	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.43	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			5.47	x1/[1/(1.4)+ 0.04]		=	7.25			(27)
Windows Type 2			3.26	x1/[1/(1.4)+ 0.04]		=	4.32			(27)
Windows Type 3			2.04	x1/[1/(1.4)+ 0.04]		=	2.7			(27)
Walls Type1	57.81	16.07	41.74	x	0.18	=	7.51			(29)
Walls Type2	35.86	2.42	33.44	x	0.18	=	6.02			(29)
Roof	73.3	0	73.3	x	0.13	=	9.53			(30)
Total area of elements, m²			166.97							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 46.79 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1937.68 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.99 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 52.78 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	37.37	37.13	36.9	35.8	35.6	34.65	34.65	34.47	35.01	35.6	36.01	36.45	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	90.15	89.91	89.68	88.58	88.38	87.43	87.43	87.25	87.79	88.38	88.79	89.23	

Average = Sum(39)$_{1...12}$ /12= 88.58 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.22	1.22	1.21	1.2	1.19	1.18	1.18	1.18	1.19	1.19	1.2	1.21	

Average = Sum(40)$_{1...12}$ /12= 1.2 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.34 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.74 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	98.72	95.13	91.54	87.95	84.36	80.77	80.77	84.36	87.95	91.54	95.13	98.72	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1076.93 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	146.4	128.04	132.13	115.19	110.53	95.38	88.38	101.42	102.63	119.6	130.56	141.78	

Total = Sum(45)$_{1...12}$ = 1412.03 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.96	19.21	19.82	17.28	16.58	14.31	13.26	15.21	15.39	17.94	19.58	21.27	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.31	43.79	46.65	43.37	42.99	39.83	41.16	42.99	43.37	46.65	46.91	50.31	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	

Output from water heater (annual)$_{1...12}$ 1950.34 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.25	53.52	55.59	49.14	47.5	41.67	39.68	44.47	44.97	51.43	55.14	59.72	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.42	16.36	13.3	10.07	7.53	6.36	6.87	8.93	11.98	15.21	17.75	18.93	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	206.4	208.54	203.14	191.65	177.15	163.52	154.41	152.27	157.67	169.16	183.66	197.29	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	(71)

Water heating gains (Table 5)

(72)m=	82.33	79.64	74.72	68.26	63.84	57.88	53.33	59.77	62.45	69.13	76.58	80.27	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	368.22	365.62	352.25	331.06	309.6	288.83	275.69	282.04	293.18	314.58	339.08	357.56	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.04	x	36.79	x	0.63	x	0.7	=	45.88	(79)
Southwest$_{0.9x}$	0.77	x	2.04	x	62.67	x	0.63	x	0.7	=	78.15	(79)
Southwest$_{0.9x}$	0.77	x	2.04	x	85.75	x	0.63	x	0.7	=	106.93	(79)
Southwest$_{0.9x}$	0.77	x	2.04	x	106.25	x	0.63	x	0.7	=	132.49	(79)
Southwest$_{0.9x}$	0.77	x	2.04	x	119.01	x	0.63	x	0.7	=	148.39	(79)

TER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.04	x	118.15		0.63	x	0.7	=	147.32	(79)
Southwest 0.9x	0.77	x	2.04	x	113.91		0.63	x	0.7	=	142.03	(79)
Southwest 0.9x	0.77	x	2.04	x	104.39		0.63	x	0.7	=	130.16	(79)
Southwest 0.9x	0.77	x	2.04	x	92.85		0.63	x	0.7	=	115.78	(79)
Southwest 0.9x	0.77	x	2.04	x	69.27		0.63	x	0.7	=	86.37	(79)
Southwest 0.9x	0.77	x	2.04	x	44.07		0.63	x	0.7	=	54.95	(79)
Southwest 0.9x	0.77	x	2.04	x	31.49		0.63	x	0.7	=	39.26	(79)
Northwest 0.9x	0.77	x	5.47	x	11.28	x	0.63	x	0.7	=	18.86	(81)
Northwest 0.9x	0.77	x	3.26	x	11.28	x	0.63	x	0.7	=	22.48	(81)
Northwest 0.9x	0.77	x	5.47	x	22.97	x	0.63	x	0.7	=	38.39	(81)
Northwest 0.9x	0.77	x	3.26	x	22.97	x	0.63	x	0.7	=	45.76	(81)
Northwest 0.9x	0.77	x	5.47	x	41.38	x	0.63	x	0.7	=	69.17	(81)
Northwest 0.9x	0.77	x	3.26	x	41.38	x	0.63	x	0.7	=	82.45	(81)
Northwest 0.9x	0.77	x	5.47	x	67.96	x	0.63	x	0.7	=	113.6	(81)
Northwest 0.9x	0.77	x	3.26	x	67.96	x	0.63	x	0.7	=	135.41	(81)
Northwest 0.9x	0.77	x	5.47	x	91.35	x	0.63	x	0.7	=	152.7	(81)
Northwest 0.9x	0.77	x	3.26	x	91.35	x	0.63	x	0.7	=	182.02	(81)
Northwest 0.9x	0.77	x	5.47	x	97.38	x	0.63	x	0.7	=	162.8	(81)
Northwest 0.9x	0.77	x	3.26	x	97.38	x	0.63	x	0.7	=	194.05	(81)
Northwest 0.9x	0.77	x	5.47	x	91.1	x	0.63	x	0.7	=	152.29	(81)
Northwest 0.9x	0.77	x	3.26	x	91.1	x	0.63	x	0.7	=	181.53	(81)
Northwest 0.9x	0.77	x	5.47	x	72.63	x	0.63	x	0.7	=	121.41	(81)
Northwest 0.9x	0.77	x	3.26	x	72.63	x	0.63	x	0.7	=	144.72	(81)
Northwest 0.9x	0.77	x	5.47	x	50.42	x	0.63	x	0.7	=	84.29	(81)
Northwest 0.9x	0.77	x	3.26	x	50.42	x	0.63	x	0.7	=	100.47	(81)
Northwest 0.9x	0.77	x	5.47	x	28.07	x	0.63	x	0.7	=	46.92	(81)
Northwest 0.9x	0.77	x	3.26	x	28.07	x	0.63	x	0.7	=	55.93	(81)
Northwest 0.9x	0.77	x	5.47	x	14.2	x	0.63	x	0.7	=	23.73	(81)
Northwest 0.9x	0.77	x	3.26	x	14.2	x	0.63	x	0.7	=	28.29	(81)
Northwest 0.9x	0.77	x	5.47	x	9.21	x	0.63	x	0.7	=	15.4	(81)
Northwest 0.9x	0.77	x	3.26	x	9.21	x	0.63	x	0.7	=	18.36	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	87.22	162.3	258.55	381.5	483.11	504.17	475.86	396.29	300.53	189.22	106.97	73.03	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	455.45	527.92	610.8	712.55	792.71	793	751.54	678.34	593.72	503.79	446.05	430.59	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.84	0.66	0.5	0.57	0.84	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.68	19.84	20.12	20.5	20.81	20.96	20.99	20.98	20.86	20.46	20.01	19.66	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.91	19.91	19.91	19.92	19.92	19.93	19.93	19.94	19.93	19.92	19.92	19.92	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.93	0.79	0.57	0.39	0.45	0.76	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.16	18.39	18.8	19.34	19.74	19.91	19.93	19.93	19.82	19.3	18.64	18.12	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.53	18.75	19.13	19.63	20	20.17	20.19	20.19	20.08	19.58	18.98	18.5	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.53	18.75	19.13	19.63	20	20.17	20.19	20.19	20.08	19.58	18.98	18.5	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.8	0.59	0.41	0.48	0.78	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	453.4	522.98	596.02	658.73	631.24	468.55	311.53	325.62	460.52	482.27	442.08	429.1	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1282.93	1245.17	1132.3	950.47	733.89	486.58	314.05	330.61	524.9	794.07	1054.45	1276.1	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	617.17	485.31	398.99	210.06	76.38	0	0	0	0	231.98	440.91	630.17	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3090.96 (98)

Space heating requirement in kWh/m²/year 41.78 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	617.17	485.31	398.99	210.06	76.38	0	0	0	0	231.98	440.91	630.17	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	660.78	519.61	427.18	224.9	81.78	0	0	0	0	248.38	472.06	674.7	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3309.38 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08

Efficiency of water heater 80.3 (216)

(217)m= 87.73 | 87.52 | 87.01 | 85.76 | 83.4 | 80.3 | 80.3 | 80.3 | 80.3 | 85.89 | 87.25 | 87.82 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 224.21 | 196.32 | 205.45 | 184.89 | 184.08 | 168.38 | 161.32 | 179.83 | 181.82 | 193.56 | 203.4 | 218.73

Total = Sum(219a)$_{1...12}$ = 2302 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		3309.38	
Water heating fuel used		2302	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		325.23	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	714.83	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	497.23	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1212.06	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	168.79	(268)
Total CO2, kg/year	sum of (265)…(271) =			1419.78	(272)

TER = 19.19 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 83

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.47	(1a) x	2.56	(2a) =	180.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.47	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.17 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.42 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.39	0.38	0.34	0.34	0.33	0.35	0.38	0.4	0.42

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.58	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.58	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.59	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.93	x	1/[1/(1.4)+ 0.04]	=	9.19			(27)
Windows Type 2			4.13	x	1/[1/(1.4)+ 0.04]	=	5.48			(27)
Walls Type1	31.35	15.19	16.16	x	0.18	=	2.91			(29)
Walls Type2	17.17	2.42	14.75	x	0.18	=	2.66			(29)
Roof	70.47	0	70.47	x	0.13	=	9.16			(30)
Total area of elements, m²			119							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 37.29 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1159.86 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.76 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 42.05 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	35.83	35.59	35.36	34.28	34.08	33.13	33.13	32.96	33.5	34.08	34.49	34.91	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	77.88	77.64	77.41	76.33	76.12	75.18	75.18	75.01	75.54	76.12	76.53	76.96	

Average = Sum(39)$_{1...12}$ /12= 76.33 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.11	1.1	1.1	1.08	1.08	1.07	1.07	1.06	1.07	1.08	1.09	1.09	

Average = Sum(40)$_{1...12}$ /12= 1.08 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.82 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	96.6	93.09	89.57	86.06	82.55	79.04	79.04	82.55	86.06	89.57	93.09	96.6	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1053.82 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	143.25	125.29	129.29	112.72	108.16	93.33	86.48	99.24	100.43	117.04	127.76	138.73	

Total = Sum(45)$_{1...12}$ = 1381.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.49	18.79	19.39	16.91	16.22	14	12.97	14.89	15.06	17.56	19.16	20.81	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.23	42.85	45.65	42.44	42.07	38.98	40.28	42.07	42.44	45.65	45.91	49.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	

Output from water heater (annual)$_{1...12}$ 1908.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	59.94	52.37	54.4	48.09	46.48	40.78	38.82	43.51	44	50.33	53.96	58.44	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.71	15.73	12.79	9.68	7.24	6.11	6.6	8.58	11.52	14.63	17.07	18.2	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.4	200.46	195.27	184.23	170.29	157.18	148.43	146.37	151.56	162.6	176.55	189.65	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	(71)

Water heating gains (Table 5)

(72)m=	80.56	77.93	73.12	66.79	62.47	56.63	52.18	58.49	61.11	67.64	74.94	78.54	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	356.54	353.99	341.05	320.57	299.86	279.79	267.08	273.3	284.06	304.74	328.42	346.26	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	6.93	x	11.28	x	0.63	x	0.7	=	23.9	(81)
Northwest 0.9x	0.77	x	4.13	x	11.28	x	0.63	x	0.7	=	28.48	(81)
Northwest 0.9x	0.77	x	6.93	x	22.97	x	0.63	x	0.7	=	48.64	(81)
Northwest 0.9x	0.77	x	4.13	x	22.97	x	0.63	x	0.7	=	57.98	(81)
Northwest 0.9x	0.77	x	6.93	x	41.38	x	0.63	x	0.7	=	87.64	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.13	x	41.38	x	0.63	x	0.7	=	104.46	(81)
Northwest 0.9x	0.77	x	6.93	x	67.96	x	0.63	x	0.7	=	143.92	(81)
Northwest 0.9x	0.77	x	4.13	x	67.96	x	0.63	x	0.7	=	171.55	(81)
Northwest 0.9x	0.77	x	6.93	x	91.35	x	0.63	x	0.7	=	193.46	(81)
Northwest 0.9x	0.77	x	4.13	x	91.35	x	0.63	x	0.7	=	230.59	(81)
Northwest 0.9x	0.77	x	6.93	x	97.38	x	0.63	x	0.7	=	206.25	(81)
Northwest 0.9x	0.77	x	4.13	x	97.38	x	0.63	x	0.7	=	245.83	(81)
Northwest 0.9x	0.77	x	6.93	x	91.1	x	0.63	x	0.7	=	192.94	(81)
Northwest 0.9x	0.77	x	4.13	x	91.1	x	0.63	x	0.7	=	229.97	(81)
Northwest 0.9x	0.77	x	6.93	x	72.63	x	0.63	x	0.7	=	153.82	(81)
Northwest 0.9x	0.77	x	4.13	x	72.63	x	0.63	x	0.7	=	183.34	(81)
Northwest 0.9x	0.77	x	6.93	x	50.42	x	0.63	x	0.7	=	106.79	(81)
Northwest 0.9x	0.77	x	4.13	x	50.42	x	0.63	x	0.7	=	127.28	(81)
Northwest 0.9x	0.77	x	6.93	x	28.07	x	0.63	x	0.7	=	59.44	(81)
Northwest 0.9x	0.77	x	4.13	x	28.07	x	0.63	x	0.7	=	70.85	(81)
Northwest 0.9x	0.77	x	6.93	x	14.2	x	0.63	x	0.7	=	30.07	(81)
Northwest 0.9x	0.77	x	4.13	x	14.2	x	0.63	x	0.7	=	35.84	(81)
Northwest 0.9x	0.77	x	6.93	x	9.21	x	0.63	x	0.7	=	19.51	(81)
Northwest 0.9x	0.77	x	4.13	x	9.21	x	0.63	x	0.7	=	23.26	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	52.38	106.62	192.09	315.47	424.05	452.08	422.92	337.15	234.07	130.3	65.91	42.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	408.92	460.61	533.14	636.04	723.91	731.88	690	610.46	518.12	435.03	394.33	389.03	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.83	0.63	0.47	0.55	0.84	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.8	19.94	20.2	20.57	20.86	20.97	21	20.99	20.89	20.51	20.1	19.78	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20	20	20	20.01	20.02	20.03	20.03	20.03	20.02	20.02	20.01	20.01	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.93	0.78	0.55	0.37	0.44	0.77	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.39	18.59	18.98	19.51	19.88	20.01	20.03	20.03	19.93	19.43	18.84	18.37	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.77	18.96	19.31	19.8	20.14	20.27	20.29	20.29	20.19	19.72	19.17	18.75	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.77	18.96	19.31	19.8	20.14	20.27	20.29	20.29	20.19	19.72	19.17	18.75	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.79	0.57	0.4	0.47	0.79	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	407.56	457.6	523.23	591.4	569.77	416.09	275.94	288.51	408.15	420.56	391.76	388.03	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1127.1	1091.27	991.37	831.8	642.8	426.36	277.22	291.45	460	694.52	924.15	1120.03	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	535.34	425.83	348.3	173.09	54.33	0	0	0	0	203.83	383.32	544.61	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2668.64 (98)

Space heating requirement in kWh/m²/year 37.87 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	535.34	425.83	348.3	173.09	54.33	0	0	0	0	203.83	383.32	544.61	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	573.16	455.92	372.91	185.32	58.17	0	0	0	0	218.23	410.41	583.09	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2857.21 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96

Efficiency of water heater 80.3 (216)

(217)m=	87.49	87.29	86.75	85.33	82.76	80.3	80.3	80.3	80.3	85.62	86.99	87.57	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	220	192.61	201.65	181.84	181.52	164.77	157.86	175.97	177.92	190.01	199.64	214.63	

Total = Sum(219a)$_{1...12}$ = 2258.43 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2857.21

TER WorkSheet: New dwelling design stage

Water heating fuel used			2258.43	
Electricity for pumps, fans and electric keep-hot				
central heating pump:		30		(230c)
boiler with a fan-assisted flue		45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		75	(231)
Electricity for lighting			312.74	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	617.16	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	487.82	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1104.98	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	162.31	(268)
Total CO2, kg/year	sum of (265)…(271) =				1306.22	(272)

TER = 18.53 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 84

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	74.52	(1a) x	2.56	(2a) =	190.77	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	74.52	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		190.77	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

		Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)			
Number of storeys in the dwelling (ns)			0 (9)
Additional infiltration		[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35			
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0 (12)
If no draught lobby, enter 0.05, else enter 0			0 (13)
Percentage of windows and doors draught stripped			0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5 (17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used			
Number of sides sheltered			2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.44	0.43	0.42	0.38	0.37	0.33	0.33	0.32	0.35	0.37	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.32	x1/[1/(1.4)+ 0.04]		=	8.38			(27)
Windows Type 2			3.77	x1/[1/(1.4)+ 0.04]		=	5			(27)
Windows Type 3			2.36	x1/[1/(1.4)+ 0.04]		=	3.13			(27)
Floor			24.906	x	0.13	=	3.23778			(28)
Walls Type1	44.28	16.22	28.06	x	0.18	=	5.05			(29)
Walls Type2	57.23	2.42	54.81	x	0.18	=	9.87			(29)
Roof	74.52	0	74.52	x	0.13	=	9.69			(30)
Total area of elements, m²			200.93							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 51.76 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 3947.33 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.3 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 58.06 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	37.61	37.37	37.14	36.04	35.84	34.88	34.88	34.7	35.25	35.84	36.25	36.68	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	95.67	95.43	95.2	94.11	93.9	92.95	92.95	92.77	93.31	93.9	94.31	94.75	

Average = Sum(39)$_{1...12}$ /12= 94.1 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.28	1.28	1.28	1.26	1.26	1.25	1.25	1.24	1.25	1.26	1.27	1.27	
Average = Sum(40)$_{1...12}$ /12=													1.26 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.35 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 90.03 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	99.03	95.43	91.83	88.23	84.63	81.02	81.02	84.63	88.23	91.83	95.43	99.03	
Total = Sum(44)$_{1...12}$ =													1080.33 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.86	128.44	132.54	115.55	110.88	95.68	88.66	101.74	102.95	119.98	130.97	142.23	
Total = Sum(45)$_{1...12}$ =													1416.49 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	22.03	19.27	19.88	17.33	16.63	14.35	13.3	15.26	15.44	18	19.65	21.33	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.46	43.92	46.79	43.51	43.12	39.96	41.29	43.12	43.51	46.79	47.06	50.46	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	197.32	172.37	179.34	159.06	154	135.64	129.95	144.86	146.46	166.78	178.03	192.69	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	197.32	172.37	179.34	159.06	154	135.64	129.95	144.86	146.46	166.78	178.03	192.69	

Output from water heater (annual)$_{1...12}$ 1956.5 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.45	53.69	55.77	49.3	47.65	41.8	39.8	44.61	45.11	51.59	55.31	59.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.52	16.45	13.38	10.13	7.57	6.39	6.91	8.98	12.05	15.3	17.86	19.04	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	207.6	209.76	204.33	192.77	178.18	164.47	155.31	153.16	158.59	170.14	184.73	198.44	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	(71)

Water heating gains (Table 5)

(72)m=	82.59	79.89	74.96	68.47	64.04	58.06	53.5	59.96	62.65	69.35	76.82	80.52	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	369.98	367.36	353.93	332.63	311.06	290.18	276.98	283.35	294.55	316.05	340.67	359.26	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	6.32	x	11.28	x	0.63	x	0.7	=	21.79	(81)
Northwest 0.9x	0.77	x	3.77	x	11.28	x	0.63	x	0.7	=	26	(81)
Northwest 0.9x	0.77	x	2.36	x	11.28	x	0.63	x	0.7	=	8.14	(81)
Northwest 0.9x	0.77	x	6.32	x	22.97	x	0.63	x	0.7	=	44.36	(81)
Northwest 0.9x	0.77	x	3.77	x	22.97	x	0.63	x	0.7	=	52.92	(81)

TER WorkSheet: New dwelling design stage

Northwest	0.9x	0.77	x	2.36	x	22.97	x	0.63	x	0.7	=	16.56	(81)
Northwest	0.9x	0.77	x	6.32	x	41.38	x	0.63	x	0.7	=	79.92	(81)
Northwest	0.9x	0.77	x	3.77	x	41.38	x	0.63	x	0.7	=	95.35	(81)
Northwest	0.9x	0.77	x	2.36	x	41.38	x	0.63	x	0.7	=	29.84	(81)
Northwest	0.9x	0.77	x	6.32	x	67.96	x	0.63	x	0.7	=	131.25	(81)
Northwest	0.9x	0.77	x	3.77	x	67.96	x	0.63	x	0.7	=	156.59	(81)
Northwest	0.9x	0.77	x	2.36	x	67.96	x	0.63	x	0.7	=	49.01	(81)
Northwest	0.9x	0.77	x	6.32	x	91.35	x	0.63	x	0.7	=	176.43	(81)
Northwest	0.9x	0.77	x	3.77	x	91.35	x	0.63	x	0.7	=	210.49	(81)
Northwest	0.9x	0.77	x	2.36	x	91.35	x	0.63	x	0.7	=	65.88	(81)
Northwest	0.9x	0.77	x	6.32	x	97.38	x	0.63	x	0.7	=	188.1	(81)
Northwest	0.9x	0.77	x	3.77	x	97.38	x	0.63	x	0.7	=	224.41	(81)
Northwest	0.9x	0.77	x	2.36	x	97.38	x	0.63	x	0.7	=	70.24	(81)
Northwest	0.9x	0.77	x	6.32	x	91.1	x	0.63	x	0.7	=	175.96	(81)
Northwest	0.9x	0.77	x	3.77	x	91.1	x	0.63	x	0.7	=	209.93	(81)
Northwest	0.9x	0.77	x	2.36	x	91.1	x	0.63	x	0.7	=	65.71	(81)
Northwest	0.9x	0.77	x	6.32	x	72.63	x	0.63	x	0.7	=	140.28	(81)
Northwest	0.9x	0.77	x	3.77	x	72.63	x	0.63	x	0.7	=	167.36	(81)
Northwest	0.9x	0.77	x	2.36	x	72.63	x	0.63	x	0.7	=	52.38	(81)
Northwest	0.9x	0.77	x	6.32	x	50.42	x	0.63	x	0.7	=	97.39	(81)
Northwest	0.9x	0.77	x	3.77	x	50.42	x	0.63	x	0.7	=	116.19	(81)
Northwest	0.9x	0.77	x	2.36	x	50.42	x	0.63	x	0.7	=	36.37	(81)
Northwest	0.9x	0.77	x	6.32	x	28.07	x	0.63	x	0.7	=	54.21	(81)
Northwest	0.9x	0.77	x	3.77	x	28.07	x	0.63	x	0.7	=	64.68	(81)
Northwest	0.9x	0.77	x	2.36	x	28.07	x	0.63	x	0.7	=	20.24	(81)
Northwest	0.9x	0.77	x	6.32	x	14.2	x	0.63	x	0.7	=	27.42	(81)
Northwest	0.9x	0.77	x	3.77	x	14.2	x	0.63	x	0.7	=	32.71	(81)
Northwest	0.9x	0.77	x	2.36	x	14.2	x	0.63	x	0.7	=	10.24	(81)
Northwest	0.9x	0.77	x	6.32	x	9.21	x	0.63	x	0.7	=	17.8	(81)
Northwest	0.9x	0.77	x	3.77	x	9.21	x	0.63	x	0.7	=	21.23	(81)
Northwest	0.9x	0.77	x	2.36	x	9.21	x	0.63	x	0.7	=	6.65	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	55.93	113.85	205.12	336.86	452.81	482.74	451.59	360.01	249.94	139.13	70.37	45.68	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	425.91	481.21	559.04	669.49	763.86	772.92	728.57	643.37	544.49	455.18	411.05	404.93	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.87	0.7	0.54	0.63	0.89	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.56	19.7	19.98	20.39	20.75	20.94	20.98	20.97	20.8	20.35	19.89	19.54	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.85	19.86	19.86	19.87	19.87	19.88	19.88	19.88	19.88	19.87	19.87	19.86	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.95	0.83	0.61	0.41	0.49	0.82	0.98	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	17.94	18.15	18.56	19.15	19.62	19.84	19.88	19.87	19.71	19.1	18.43	17.91	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.34	18.53	18.92	19.46	19.91	20.11	20.15	20.15	19.98	19.41	18.79	18.32	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.34	18.53	18.92	19.46	19.91	20.11	20.15	20.15	19.98	19.41	18.79	18.32	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.94	0.83	0.63	0.45	0.53	0.83	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	424.44	478.12	549.66	630.79	631.93	485.01	325.93	338.62	450.75	442.21	408.44	403.83	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1343.51	1301.21	1181.97	993.91	770.46	512.58	330.32	347.64	548.98	827.49	1103	1337.74	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	683.79	553.11	470.44	261.45	103.07	0	0	0	0	286.65	500.09	694.83	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3553.41 (98)

Space heating requirement in kWh/m²/year 47.69 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	683.79	553.11	470.44	261.45	103.07	0	0	0	0	286.65	500.09	694.83	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	732.11	592.2	503.68	279.92	110.35	0	0	0	0	306.91	535.42	743.93	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3804.51 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	197.32	172.37	179.34	159.06	154	135.64	129.95	144.86	146.46	166.78	178.03	192.69

Efficiency of water heater 80.3 (216)

(217)m= 87.92 | 87.78 | 87.37 | 86.29 | 84.07 | 80.3 | 80.3 | 80.3 | 80.3 | 86.4 | 87.51 | 88 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 224.43 | 196.37 | 205.27 | 184.33 | 183.19 | 168.91 | 161.83 | 180.4 | 182.39 | 193.02 | 203.44 | 218.97

Total = Sum(219a)$_{1...12}$ = 2302.56 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		3804.51	
Water heating fuel used		2302.56	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		75	(231)
Electricity for lighting		327.1	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	821.77	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	497.35	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1319.13	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	169.76	(268)
Total CO2, kg/year	sum of (265)…(271) =			1527.82	(272)

TER = 20.5 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 85

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	72.83	(1a) x	2.56	(2a) =	186.43	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	72.83	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.43	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans = (6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.16	(8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)			0	(9)
Additional infiltration		[(9)-1]x0.1 =	0	(10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction			0	(11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0			0	(12)
If no draught lobby, enter 0.05, else enter 0			0	(13)
Percentage of windows and doors draught stripped			0	(14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =	0	(15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =	0	(16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area			5	(17)
If based on air permeability value, then (18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.41	(18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered			2	(19)
Shelter factor		(20) = 1 - [0.075 x (19)] =	0.85	(20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =	0.35	(21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.45	0.44	0.43	0.38	0.38	0.33	0.33	0.32	0.35	0.38	0.39	0.41

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.6	0.6	0.59	0.57	0.57	0.56	0.56	0.55	0.56	0.57	0.58	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			7.2	x	1/[1/(1.4)+ 0.04]	=	9.55			(27)
Windows Type 2			4.29	x	1/[1/(1.4)+ 0.04]	=	5.69			(27)
Floor			16.55	x	0.13	=	2.1515			(28)
Walls Type1	31.76	15.78	15.98	x	0.18	=	2.88			(29)
Walls Type2	34.04	2.42	31.62	x	0.18	=	5.69			(29)
Roof	72.83	0	72.83	x	0.13	=	9.47			(30)
Total area of elements, m²			155.17							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.53 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 2705.78 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.53 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 48.05 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	36.86	36.63	36.39	35.3	35.1	34.15	34.15	33.97	34.51	35.1	35.51	35.94	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	84.91	84.68	84.45	83.35	83.15	82.2	82.2	82.02	82.57	83.15	83.56	83.99	

Average = Sum(39)$_{1...12}$ /12= 83.35 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.17	1.16	1.16	1.14	1.14	1.13	1.13	1.13	1.13	1.14	1.15	1.15	
Average = Sum(40)$_{1...12}$ /12=													1.14 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.31 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.13 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	98.04	94.48	90.91	87.34	83.78	80.21	80.21	83.78	87.34	90.91	94.48	98.04	
Total = Sum(44)$_{1...12}$ =													1069.53 (44)
Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)													
(45)m=	145.39	127.16	131.22	114.4	109.77	94.72	87.77	100.72	101.92	118.78	129.66	140.8	
Total = Sum(45)$_{1...12}$ =													1402.32 (45)
If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)													
(46)m=	21.81	19.07	19.68	17.16	16.47	14.21	13.17	15.11	15.29	17.82	19.45	21.12	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)
If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H													
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.96	43.48	46.33	43.07	42.69	39.56	40.88	42.69	43.07	46.33	46.59	49.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.35	170.64	177.54	157.47	152.46	134.28	128.65	143.41	145	165.11	176.25	190.76	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.35	170.64	177.54	157.47	152.46	134.28	128.65	143.41	145	165.11	176.25	190.76	

Output from water heater (annual)$_{1...12}$ 1936.94 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.83	53.15	55.21	48.81	47.17	41.38	39.4	44.16	44.66	51.08	54.76	59.31	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.19	16.15	13.14	9.94	7.43	6.28	6.78	8.81	11.83	15.02	17.53	18.69	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	203.8	205.92	200.59	189.24	174.92	161.46	152.47	150.35	155.68	167.03	181.35	194.81	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	(71)

Water heating gains (Table 5)

(72)m=	81.76	79.09	74.21	67.79	63.4	57.48	52.96	59.36	62.03	68.65	76.06	79.71	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	364.44	361.85	348.62	327.66	306.45	285.9	272.9	279.22	290.23	311.39	335.63	353.9	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.2	x	11.28	x	0.63	x	0.7	=	24.83	(81)
Northwest 0.9x	0.77	x	4.29	x	11.28	x	0.63	x	0.7	=	29.59	(81)
Northwest 0.9x	0.77	x	7.2	x	22.97	x	0.63	x	0.7	=	50.54	(81)
Northwest 0.9x	0.77	x	4.29	x	22.97	x	0.63	x	0.7	=	60.22	(81)
Northwest 0.9x	0.77	x	7.2	x	41.38	x	0.63	x	0.7	=	91.05	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.29	x	41.38	x	0.63	x	0.7	=	108.5	(81)
Northwest 0.9x	0.77	x	7.2	x	67.96	x	0.63	x	0.7	=	149.53	(81)
Northwest 0.9x	0.77	x	4.29	x	67.96	x	0.63	x	0.7	=	178.19	(81)
Northwest 0.9x	0.77	x	7.2	x	91.35	x	0.63	x	0.7	=	201	(81)
Northwest 0.9x	0.77	x	4.29	x	91.35	x	0.63	x	0.7	=	239.52	(81)
Northwest 0.9x	0.77	x	7.2	x	97.38	x	0.63	x	0.7	=	214.29	(81)
Northwest 0.9x	0.77	x	4.29	x	97.38	x	0.63	x	0.7	=	255.36	(81)
Northwest 0.9x	0.77	x	7.2	x	91.1	x	0.63	x	0.7	=	200.46	(81)
Northwest 0.9x	0.77	x	4.29	x	91.1	x	0.63	x	0.7	=	238.88	(81)
Northwest 0.9x	0.77	x	7.2	x	72.63	x	0.63	x	0.7	=	159.81	(81)
Northwest 0.9x	0.77	x	4.29	x	72.63	x	0.63	x	0.7	=	190.44	(81)
Northwest 0.9x	0.77	x	7.2	x	50.42	x	0.63	x	0.7	=	110.95	(81)
Northwest 0.9x	0.77	x	4.29	x	50.42	x	0.63	x	0.7	=	132.21	(81)
Northwest 0.9x	0.77	x	7.2	x	28.07	x	0.63	x	0.7	=	61.76	(81)
Northwest 0.9x	0.77	x	4.29	x	28.07	x	0.63	x	0.7	=	73.6	(81)
Northwest 0.9x	0.77	x	7.2	x	14.2	x	0.63	x	0.7	=	31.24	(81)
Northwest 0.9x	0.77	x	4.29	x	14.2	x	0.63	x	0.7	=	37.23	(81)
Northwest 0.9x	0.77	x	7.2	x	9.21	x	0.63	x	0.7	=	20.28	(81)
Northwest 0.9x	0.77	x	4.29	x	9.21	x	0.63	x	0.7	=	24.16	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	54.41	110.76	199.55	327.72	440.52	469.64	439.34	350.25	243.16	135.36	68.47	44.44	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	418.85	472.61	548.17	655.39	746.97	755.55	712.24	629.47	533.39	446.75	404.09	398.34	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.85	0.66	0.5	0.58	0.86	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.71	19.85	20.12	20.51	20.82	20.96	20.99	20.99	20.86	20.45	20.02	19.69	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.95	19.95	19.95	19.96	19.97	19.98	19.98	19.98	19.97	19.97	19.96	19.96	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.94	0.8	0.57	0.39	0.46	0.79	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.23	18.44	18.83	19.39	19.79	19.95	19.97	19.97	19.86	19.32	18.69	18.21	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.61	18.8	19.16	19.67	20.06	20.21	20.24	20.23	20.11	19.61	19.03	18.59	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.61	18.8	19.16	19.67	20.06	20.21	20.24	20.23	20.11	19.61	19.03	18.59	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.94	0.8	0.59	0.42	0.49	0.8	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	417.47	469.6	538.49	612.91	600.02	446.07	296.74	309.74	428.97	432.9	401.54	397.32	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1215.23	1176.8	1069.12	898.02	694.88	461.32	298.81	314.33	496.44	748.87	997.04	1208.64	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	593.53	475.24	394.79	205.28	70.58	0	0	0	0	235.08	428.76	603.62	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3006.88 (98)

Space heating requirement in kWh/m²/year 41.29 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	593.53	475.24	394.79	205.28	70.58	0	0	0	0	235.08	428.76	603.62	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	635.47	508.83	422.69	219.78	75.57	0	0	0	0	251.69	459.06	646.28	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3219.36 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	195.35	170.64	177.54	157.47	152.46	134.28	128.65	143.41	145	165.11	176.25	190.76

Efficiency of water heater 80.3 (216)

(217)m=	87.67	87.49	87.01	85.72	83.24	80.3	80.3	80.3	80.3	85.94	87.2	87.75	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	222.83	195.04	204.06	183.71	183.15	167.22	160.21	178.6	180.57	192.12	202.11	217.4	

Total = Sum(219a)$_{1...12}$ = 2287.02 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 3219.36

TER WorkSheet: New dwelling design stage

Water heating fuel used			2287.02	
Electricity for pumps, fans and electric keep-hot				
central heating pump:		30		(230c)
boiler with a fan-assisted flue		45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		75	(231)
Electricity for lighting			321.17	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	695.38	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	494	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1189.38	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	166.69	(268)
Total CO2, kg/year	sum of (265)…(271) =				1394.99	(272)

TER = 19.16 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 86

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	66.43	(1a) x	2.56	(2a) =	170.06	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	66.43	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		170.06	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							2	x 10 =	20	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	20	÷ (5) =	0.12 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.37 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.31 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.4	0.39	0.38	0.34	0.34	0.3	0.3	0.29	0.31	0.34	0.35	0.37

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.58	0.58	0.57	0.56	0.56	0.54	0.54	0.54	0.55	0.56	0.56	0.57	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.58	0.58	0.57	0.56	0.56	0.54	0.54	0.54	0.55	0.56	0.56	0.57	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.47	x	1/[1/(1.4)+ 0.04]	=	8.58			(27)
Windows Type 2			3.86	x	1/[1/(1.4)+ 0.04]	=	5.12			(27)
Walls Type1	37.25	14.19	23.06	x	0.18	=	4.15			(29)
Walls Type2	32.9	2.42	30.48	x	0.18	=	5.49			(29)
Roof	66.43	0	66.43	x	0.13	=	8.64			(30)
Total area of elements, m²			136.57							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.5 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1507.92 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.81 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 44.31 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	32.51	32.34	32.17	31.37	31.23	30.53	30.53	30.4	30.8	31.23	31.53	31.84	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	76.83	76.65	76.49	75.69	75.54	74.85	74.85	74.72	75.11	75.54	75.84	76.16	

Average = Sum(39)$_{1...12}$ /12= 75.69 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.16	1.15	1.15	1.14	1.14	1.13	1.13	1.12	1.13	1.14	1.14	1.15	
Average = Sum(40)$_{1...12}$ /12=													1.14 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.16 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 85.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	93.96	90.54	87.12	83.71	80.29	76.87	76.87	80.29	83.71	87.12	90.54	93.96	
Total = Sum(44)$_{1...12}$ =													1024.98 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	139.34	121.86	125.75	109.63	105.2	90.78	84.12	96.53	97.68	113.84	124.26	134.94	
Total = Sum(45)$_{1...12}$ =													1343.92 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	20.9	18.28	18.86	16.45	15.78	13.62	12.62	14.48	14.65	17.08	18.64	20.24	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.88	41.67	44.4	41.28	40.92	37.91	39.17	40.92	41.28	44.4	44.65	47.88	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82	

Output from water heater (annual)$_{1...12}$ 1856.27 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	58.3	50.94	52.91	46.77	45.21	39.66	37.76	42.32	42.8	48.95	52.48	56.84	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.86	14.98	12.18	9.22	6.89	5.82	6.29	8.17	10.97	13.93	16.26	17.33	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	188.83	190.79	185.85	175.34	162.07	149.6	141.26	139.3	144.24	154.75	168.02	180.49	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	(71)

Water heating gains (Table 5)

(72)m=	78.36	75.8	71.12	64.96	60.76	55.08	50.76	56.89	59.44	65.79	72.89	76.39	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	342.39	339.91	327.49	307.87	288.07	268.85	256.65	262.71	273	292.82	315.51	332.57	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	6.47	x	11.28	x	0.63	x	0.7	=	22.31	(81)
Northwest 0.9x	0.77	x	3.86	x	11.28	x	0.63	x	0.7	=	26.62	(81)
Northwest 0.9x	0.77	x	6.47	x	22.97	x	0.63	x	0.7	=	45.41	(81)
Northwest 0.9x	0.77	x	3.86	x	22.97	x	0.63	x	0.7	=	54.19	(81)
Northwest 0.9x	0.77	x	6.47	x	41.38	x	0.63	x	0.7	=	81.82	(81)

TER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.86	x	41.38	x	0.63	x	0.7	=	97.63	(81)
Northwest 0.9x	0.77	x	6.47	x	67.96	x	0.63	x	0.7	=	134.37	(81)
Northwest 0.9x	0.77	x	3.86	x	67.96	x	0.63	x	0.7	=	160.33	(81)
Northwest 0.9x	0.77	x	6.47	x	91.35	x	0.63	x	0.7	=	180.62	(81)
Northwest 0.9x	0.77	x	3.86	x	91.35	x	0.63	x	0.7	=	215.52	(81)
Northwest 0.9x	0.77	x	6.47	x	97.38	x	0.63	x	0.7	=	192.56	(81)
Northwest 0.9x	0.77	x	3.86	x	97.38	x	0.63	x	0.7	=	229.76	(81)
Northwest 0.9x	0.77	x	6.47	x	91.1	x	0.63	x	0.7	=	180.14	(81)
Northwest 0.9x	0.77	x	3.86	x	91.1	x	0.63	x	0.7	=	214.94	(81)
Northwest 0.9x	0.77	x	6.47	x	72.63	x	0.63	x	0.7	=	143.61	(81)
Northwest 0.9x	0.77	x	3.86	x	72.63	x	0.63	x	0.7	=	171.35	(81)
Northwest 0.9x	0.77	x	6.47	x	50.42	x	0.63	x	0.7	=	99.7	(81)
Northwest 0.9x	0.77	x	3.86	x	50.42	x	0.63	x	0.7	=	118.96	(81)
Northwest 0.9x	0.77	x	6.47	x	28.07	x	0.63	x	0.7	=	55.5	(81)
Northwest 0.9x	0.77	x	3.86	x	28.07	x	0.63	x	0.7	=	66.22	(81)
Northwest 0.9x	0.77	x	6.47	x	14.2	x	0.63	x	0.7	=	28.07	(81)
Northwest 0.9x	0.77	x	3.86	x	14.2	x	0.63	x	0.7	=	33.5	(81)
Northwest 0.9x	0.77	x	6.47	x	9.21	x	0.63	x	0.7	=	18.22	(81)
Northwest 0.9x	0.77	x	3.86	x	9.21	x	0.63	x	0.7	=	21.74	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	48.93	99.6	179.45	294.7	396.14	422.32	395.07	314.96	218.66	121.72	61.57	39.96	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	391.32	439.51	506.94	602.57	684.2	691.17	651.73	577.67	491.66	414.54	377.08	372.52	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.85	0.66	0.5	0.58	0.86	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.74	19.88	20.14	20.52	20.82	20.96	20.99	20.99	20.86	20.46	20.04	19.72	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.95	19.96	19.96	19.97	19.97	19.98	19.98	19.98	19.98	19.97	19.97	19.96	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.94	0.8	0.57	0.39	0.46	0.79	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.27	18.47	18.86	19.4	19.8	19.96	19.98	19.97	19.86	19.34	18.72	18.25	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.64	18.82	19.18	19.68	20.06	20.21	20.23	20.22	20.11	19.62	19.05	18.61	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

TER WorkSheet: New dwelling design stage

(93)m=	18.64	18.82	19.18	19.68	20.06	20.21	20.23	20.22	20.11	19.62	19.05	18.61	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.8	0.59	0.41	0.49	0.8	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	389.9	436.46	497.43	562.18	547.26	406.02	269.7	281.76	392.49	400.78	374.45	371.46	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1101.46	1067.03	969.69	815.89	631.17	419.53	271.51	285.76	451.46	681.02	906.07	1097.36	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	529.4	423.74	351.36	182.67	62.43	0	0	0	0	208.5	382.77	540.07	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2680.94 (98)

Space heating requirement in kWh/m²/year 40.36 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	529.4	423.74	351.36	182.67	62.43	0	0	0	0	208.5	382.77	540.07	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	566.81	453.69	376.19	195.58	66.84	0	0	0	0	223.23	409.81	578.24	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2870.38 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82

Efficiency of water heater 80.3 (216)

(217)m=	87.52	87.34	86.84	85.53	83.08	80.3	80.3	80.3	80.3	85.75	87.05	87.61	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	213.9	187.24	195.94	176.44	175.87	160.26	153.54	171.16	173.05	184.54	194.04	208.67	

Total = Sum(219a)$_{1...12}$ = 2194.65 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2870.38

TER WorkSheet: New dwelling design stage

Water heating fuel used		2194.65	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		297.79	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	620	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	474.04	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1094.05	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	38.93	(267)
Electricity for lighting	(232)	x	0.519	=	154.55	(268)
Total CO2, kg/year	sum of (265)…(271) =				1287.52	(272)

TER = 19.38 (273)

TER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 87

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	77.53	(1a) x	2.56	(2a) =	198.47	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	77.53	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		198.47	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							3	x 10 =	30	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	30	÷ (5) =	0.15 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				5 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.4 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.34 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

TER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.43	0.43	0.42	0.38	0.37	0.32	0.32	0.32	0.34	0.37	0.38	0.4

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 0 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.59	0.59	0.59	0.57	0.57	0.55	0.55	0.55	0.56	0.57	0.57	0.58	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1	=	2.42			(26)
Windows Type 1			6.61	x1/[1/(1.4)+ 0.04]		=	8.76			(27)
Windows Type 2			3.94	x1/[1/(1.4)+ 0.04]		=	5.22			(27)
Windows Type 3			2.47	x1/[1/(1.4)+ 0.04]		=	3.27			(27)
Walls Type1	54.38	16.96	37.42	x	0.18	=	6.74			(29)
Walls Type2	14.93	2.42	12.51	x	0.18	=	2.25			(29)
Roof	77.64	0	77.64	x	0.13	=	10.09			(30)
Total area of elements, m²			146.95							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.99 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1547.62 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.31 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 49.3 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	38.94	38.7	38.46	37.35	37.15	36.18	36.18	36.01	36.56	37.15	37.57	38	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	88.24	88	87.76	86.65	86.45	85.48	85.48	85.3	85.85	86.45	86.87	87.3	

Average = Sum(39)$_{1...12}$ /12= 86.65 (39)

TER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.14	1.14	1.13	1.12	1.12	1.1	1.1	1.1	1.11	1.12	1.12	1.13	
Average = Sum(40)$_{1...12}$ /12=													1.12 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.41 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 91.54 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	100.69	97.03	93.37	89.71	86.05	82.39	82.39	86.05	89.71	93.37	97.03	100.69	
Total = Sum(44)$_{1...12}$ =													1098.47 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	149.33	130.6	134.77	117.49	112.74	97.28	90.15	103.45	104.68	122	133.17	144.61	
Total = Sum(45)$_{1...12}$ =													1440.27 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	22.4	19.59	20.22	17.62	16.91	14.59	13.52	15.52	15.7	18.3	19.98	21.69	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)
If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

TER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	44.66	47.58	44.24	43.85	40.63	41.98	43.85	44.24	47.58	47.85	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	

Output from water heater (annual)$_{1...12}$ 1988.65 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	62.39	54.59	56.71	50.13	48.45	42.5	40.47	45.36	45.87	52.46	56.24	60.82	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	19.11	16.97	13.8	10.45	7.81	6.59	7.12	9.26	12.43	15.78	18.42	19.64	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	214.2	216.42	210.82	198.89	183.84	169.7	160.24	158.02	163.62	175.55	190.6	204.75	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	(71)

Water heating gains (Table 5)

(72)m=	83.86	81.24	76.22	69.62	65.12	59.03	54.4	60.97	63.7	70.51	78.11	81.75	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	379.37	376.84	363.05	341.18	318.98	297.54	283.98	290.46	301.97	324.05	349.35	368.35	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.47	x	11.28	x	0.63	x	0.7	=	8.52	(75)
Northeast 0.9x	0.77	x	2.47	x	22.97	x	0.63	x	0.7	=	17.34	(75)
Northeast 0.9x	0.77	x	2.47	x	41.38	x	0.63	x	0.7	=	31.24	(75)
Northeast 0.9x	0.77	x	2.47	x	67.96	x	0.63	x	0.7	=	51.3	(75)
Northeast 0.9x	0.77	x	2.47	x	91.35	x	0.63	x	0.7	=	68.95	(75)

TER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.47	x	97.38	x	0.63	x	0.7	=	73.51	(75)
Northeast 0.9x	0.77	x	2.47	x	91.1	x	0.63	x	0.7	=	68.77	(75)
Northeast 0.9x	0.77	x	2.47	x	72.63	x	0.63	x	0.7	=	54.82	(75)
Northeast 0.9x	0.77	x	2.47	x	50.42	x	0.63	x	0.7	=	38.06	(75)
Northeast 0.9x	0.77	x	2.47	x	28.07	x	0.63	x	0.7	=	21.19	(75)
Northeast 0.9x	0.77	x	2.47	x	14.2	x	0.63	x	0.7	=	10.72	(75)
Northeast 0.9x	0.77	x	2.47	x	9.21	x	0.63	x	0.7	=	6.96	(75)
Northwest 0.9x	0.77	x	6.61	x	11.28	x	0.63	x	0.7	=	22.79	(81)
Northwest 0.9x	0.77	x	3.94	x	11.28	x	0.63	x	0.7	=	27.17	(81)
Northwest 0.9x	0.77	x	6.61	x	22.97	x	0.63	x	0.7	=	46.4	(81)
Northwest 0.9x	0.77	x	3.94	x	22.97	x	0.63	x	0.7	=	55.31	(81)
Northwest 0.9x	0.77	x	6.61	x	41.38	x	0.63	x	0.7	=	83.59	(81)
Northwest 0.9x	0.77	x	3.94	x	41.38	x	0.63	x	0.7	=	99.65	(81)
Northwest 0.9x	0.77	x	6.61	x	67.96	x	0.63	x	0.7	=	137.28	(81)
Northwest 0.9x	0.77	x	3.94	x	67.96	x	0.63	x	0.7	=	163.65	(81)
Northwest 0.9x	0.77	x	6.61	x	91.35	x	0.63	x	0.7	=	184.53	(81)
Northwest 0.9x	0.77	x	3.94	x	91.35	x	0.63	x	0.7	=	219.98	(81)
Northwest 0.9x	0.77	x	6.61	x	97.38	x	0.63	x	0.7	=	196.73	(81)
Northwest 0.9x	0.77	x	3.94	x	97.38	x	0.63	x	0.7	=	234.52	(81)
Northwest 0.9x	0.77	x	6.61	x	91.1	x	0.63	x	0.7	=	184.03	(81)
Northwest 0.9x	0.77	x	3.94	x	91.1	x	0.63	x	0.7	=	219.39	(81)
Northwest 0.9x	0.77	x	6.61	x	72.63	x	0.63	x	0.7	=	146.71	(81)
Northwest 0.9x	0.77	x	3.94	x	72.63	x	0.63	x	0.7	=	174.9	(81)
Northwest 0.9x	0.77	x	6.61	x	50.42	x	0.63	x	0.7	=	101.85	(81)
Northwest 0.9x	0.77	x	3.94	x	50.42	x	0.63	x	0.7	=	121.42	(81)
Northwest 0.9x	0.77	x	6.61	x	28.07	x	0.63	x	0.7	=	56.7	(81)
Northwest 0.9x	0.77	x	3.94	x	28.07	x	0.63	x	0.7	=	67.59	(81)
Northwest 0.9x	0.77	x	6.61	x	14.2	x	0.63	x	0.7	=	28.68	(81)
Northwest 0.9x	0.77	x	3.94	x	14.2	x	0.63	x	0.7	=	34.19	(81)
Northwest 0.9x	0.77	x	6.61	x	9.21	x	0.63	x	0.7	=	18.61	(81)
Northwest 0.9x	0.77	x	3.94	x	9.21	x	0.63	x	0.7	=	22.19	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	58.48	119.04	214.47	352.23	473.46	504.76	472.2	376.44	261.34	145.48	73.59	47.76	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	437.86	495.88	577.52	693.41	792.45	802.3	756.17	666.9	563.31	469.53	422.93	416.11	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.84	0.65	0.49	0.57	0.86	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.74	19.88	20.15	20.53	20.83	20.97	20.99	20.99	20.87	20.47	20.04	19.72	(87)

TER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.97	19.97	19.97	19.99	19.99	20	20	20	19.99	19.99	19.98	19.98	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.94	0.79	0.56	0.38	0.46	0.79	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.29	18.49	18.88	19.43	19.83	19.98	20	20	19.89	19.36	18.74	18.27	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.61	18.79	19.16	19.67	20.05	20.19	20.21	20.21	20.1	19.6	19.02	18.58	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.61	18.79	19.16	19.67	20.05	20.19	20.21	20.21	20.1	19.6	19.02	18.58	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.8	0.58	0.41	0.48	0.8	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	436.52	492.85	567.41	647.34	630.77	464.53	307.18	321.14	449.81	455.07	420.4	415.12	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1262.23	1222.6	1111	933.58	721.78	478.19	308.92	325.14	515.1	777.85	1035.71	1255.63	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	614.33	490.39	404.43	206.09	67.71	0	0	0	0	240.15	443.03	625.34	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3091.47 (98)

Space heating requirement in kWh/m²/year 39.88 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 93.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	614.33	490.39	404.43	206.09	67.71	0	0	0	0	240.15	443.03	625.34	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	657.74	525.04	433.01	220.66	72.5	0	0	0	0	257.12	474.33	669.53	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3309.93 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

TER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57

Efficiency of water heater 80.3 (216)

(217)m=	87.69	87.5	87	85.66	83.1	80.3	80.3	80.3	80.3	85.93	87.22	87.77

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	228.4	200.29	209.6	188.8	188.43	171.75	164.55	183.43	185.46	197.35	207.55	222.82

Total = Sum(219a)$_{1...12}$ = 2348.43 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		3309.93	
Water heating fuel used		2348.43	
Electricity for pumps, fans and electric keep-hot			
central heating pump:	30		(230c)
boiler with a fan-assisted flue	45		(230e)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	75	(231)
Electricity for lighting		337.42	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	714.94	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	507.26	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1222.21	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	38.93	(267)
Electricity for lighting	(232) x	0.519	=	175.12	(268)
Total CO2, kg/year	sum of (265)…(271) =			1436.25	(272)

TER = 18.53 (273)

eight associates

Appendix
Energy Assessment
Bourne Court

LEAN Scenario

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 1

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	93.3	(1a) x	2.56	(2a) =	238.85	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	93.3	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		238.85	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 3			7.75	x	1/[1/(1.4)+ 0.04]	=	10.27			(27)
Windows Type 4			4.31	x	1/[1/(1.4)+ 0.04]	=	5.71			(27)
Floor			93.3	x	0.12	=	11.196			(28)
Walls Type1	66.49	30.78	35.71	x	0.16	=	5.71			(29)
Walls Type2	20.61	2.42	18.19	x	0.14	=	2.57			(29)
Total area of elements, m²			180.4							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 63.68 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11179.22 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.42 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 72.09 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	26.01	25.68	25.34	23.67	23.33	21.66	21.66	21.32	22.33	23.33	24	24.67	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	98.1	97.77	97.43	95.76	95.42	93.75	93.75	93.41	94.42	95.42	96.09	96.76	

Average = Sum(39)$_{1...12}$ /12= 95.68 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.05	1.05	1.04	1.03	1.02	1	1	1	1.01	1.02	1.03	1.04

Average = Sum(40)$_{1...12}$ /12= 1.03 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.67 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 97.57 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	107.33	103.43	99.52	95.62	91.72	87.81	87.81	91.72	95.62	99.52	103.43	107.33	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1170.85 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	159.16	139.21	143.65	125.24	120.17	103.69	96.09	110.26	111.58	130.04	141.94	154.14

Total = Sum(45)$_{1...12}$ = 1535.17 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.87	20.88	21.55	18.79	18.03	15.55	14.41	16.54	16.74	19.51	21.29	23.12

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.72	47.15	46.74	43.31	44.75	46.74	47.15	50.72	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	210.12	185.23	194.36	172.39	166.9	147	140.84	157	158.73	180.75	191.26	205.1	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	210.12	185.23	194.36	172.39	166.9	147	140.84	157	158.73	180.75	191.26	205.1	

Output from water heater (annual)$_{1...12}$ 2109.7 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	65.66	57.79	60.44	53.43	51.64	45.3	43.14	48.35	48.89	55.92	59.53	63.99	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.84	19.4	15.78	11.95	8.93	7.54	8.15	10.59	14.21	18.04	21.06	22.45	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	245.02	247.56	241.16	227.52	210.3	194.11	183.3	180.76	187.17	200.81	218.03	234.21	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	(71)

Water heating gains (Table 5)

(72)m=	88.26	86	81.24	74.21	69.41	62.92	57.98	64.98	67.9	75.16	82.67	86.01	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	421.14	418.99	404.2	379.69	354.66	330.6	315.45	322.36	335.3	360.03	387.78	408.69	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.31	x	11.28	x	0.55	x	0.7	=	12.97	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.31	x	22.97	x	0.55	x	0.7	=	26.41	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.31	x	41.38	x	0.55	x	0.7	=	47.58	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.31	x	67.96	x	0.55	x	0.7	=	78.14	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.31	x	91.35	x	0.55	x	0.7	=	105.04	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.31	x	97.38	x	0.55	x	0.7	=	111.99	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.31	x	91.1	x	0.55	x	0.7	=	104.76	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.31	x	72.63	x	0.55	x	0.7	=	83.52	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.31	x	50.42	x	0.55	x	0.7	=	57.98	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.31	x	28.07	x	0.55	x	0.7	=	32.28	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.31	x	14.2	x	0.55	x	0.7	=	16.33	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.31	x	9.21	x	0.55	x	0.7	=	10.6	(75)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	28.54	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	58.09	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	104.66	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	171.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	231.04	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	246.32	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	230.42	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	183.7	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	127.53	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	70.99	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	35.91	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	23.31	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	92.66	188.61	339.81	558.07	750.16	799.75	748.15	596.43	414.07	230.49	116.59	75.67	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	513.8	607.6	744.01	937.76	1104.82	1130.35	1063.6	918.79	749.37	590.53	504.37	484.36	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.92	0.74	0.52	0.39	0.46	0.78	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.85	20.01	20.3	20.7	20.93	20.99	21	21	20.93	20.57	20.14	19.83	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.04	20.04	20.05	20.06	20.06	20.08	20.08	20.08	20.07	20.06	20.06	20.05	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.9	0.68	0.45	0.31	0.37	0.71	0.96	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.49	18.73	19.16	19.72	20	20.07	20.08	20.08	20.02	19.56	18.94	18.47	(90)

fLA = Living area ÷ (4) = 0.19 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.75	18.97	19.37	19.9	20.17	20.25	20.25	20.25	20.19	19.75	19.16	18.72	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.6	18.82	19.22	19.75	20.02	20.1	20.1	20.1	20.04	19.6	19.01	18.57	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	1	0.99	0.97	0.89	0.68	0.45	0.31	0.38	0.7	0.96	0.99	1	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	512.36	603.31	724.71	831.09	753.58	511.75	327.86	344.92	528.04	565.03	501.24	483.37	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	1402.4	1360.59	1239.56	1038.92	794.37	515.19	328.17	345.81	561.05	858.78	1144.8	1390.93	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	662.19	508.9	383.05	149.64	30.35	0	0	0	0	218.55	463.37	675.23	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3091.26 (98)

Space heating requirement in kWh/m²/year 33.13 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

DER WorkSheet: New dwelling design stage

Fraction of space heat from main system(s)	(202) = 1 – (201) =	1 (202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1 (204)
Efficiency of main space heating system 1		90.4 (206)
Efficiency of secondary/supplementary heating system, %		0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	662.19	508.9	383.05	149.64	30.35	0	0	0	0	218.55	463.37	675.23	
(211)m = {[(98)m x (204)] } x 100 ÷ (206) (211)	732.51	562.94	423.72	165.53	33.57	0	0	0	0	241.76	512.57	746.93	

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 3419.54 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	210.12	185.23	194.36	172.39	166.9	147	140.84	157	158.73	180.75	191.26	205.1	

Efficiency of water heater 80.3 (216)

(217)m=	87.74	87.46	86.73	84.7	81.7	80.3	80.3	80.3	80.3	85.53	87.2	87.83	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	239.48	211.78	224.11	203.54	204.28	183.06	175.39	195.52	197.68	211.33	219.34	233.53	

Total = Sum(219a)$_{1...12}$ = 2499.04 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		3419.54
Water heating fuel used		2499.04
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	218.55	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		248.55 (231)
Electricity for lighting		385.77 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216	=	738.62 (261)
Space heating (secondary)	(215) x	0.519	=	0 (263)
Water heating	(219) x	0.216	=	539.79 (264)
Space and water heating	(261) + (262) + (263) + (264) =			1278.41 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	129 (267)
Electricity for lighting	(232) x	0.519	=	200.21 (268)

DER WorkSheet: New dwelling design stage

Total CO2, kg/year	sum of (265)…(271) =	1607.62	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =	17.23	(273)
EI rating (section 14)		84	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 2

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	84.24	(1a) x	2.56	(2a) =	215.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	84.24	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		215.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			84.24	x	0.12	=	10.1088			(28)
Walls Type1	35.77	16.99	18.78	x	0.16	=	3			(29)
Walls Type2	37.54	2.42	35.12	x	0.14	=	4.97			(29)
Total area of elements, m²			157.54							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.99 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 10182.6 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.42 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 52.41 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	23.48	23.18	22.88	21.37	21.07	19.55	19.55	19.25	20.16	21.07	21.67	22.27	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	75.89	75.59	75.29	73.78	73.47	71.96	71.96	71.66	72.57	73.47	74.08	74.68	

Average = Sum(39)$_{1...12}$ /12= 73.7 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.9	0.9	0.89	0.88	0.87	0.85	0.85	0.85	0.86	0.87	0.88	0.89

Average = Sum(40)$_{1...12}$ /12= 0.87 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.54 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 94.49 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	103.94	100.16	96.38	92.6	88.82	85.04	85.04	88.82	92.6	96.38	100.16	103.94	

Total = Sum(44)$_{1...12}$ = 1133.85 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	154.13	134.81	139.11	121.28	116.37	100.42	93.05	106.78	108.05	125.93	137.46	149.27	

Total = Sum(45)$_{1...12}$ = 1486.65 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.12	20.22	20.87	18.19	17.46	15.06	13.96	16.02	16.21	18.89	20.62	22.39	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.11	45.66	45.26	41.94	43.33	45.26	45.66	49.11	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	

Output from water heater (annual)$_{1...12}$ 2049.26 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	63.99	56.33	58.53	51.74	50.01	43.87	41.77	46.82	47.34	54.15	58.03	62.37	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	20.46	18.17	14.78	11.19	8.36	7.06	7.63	9.92	13.31	16.9	19.72	21.03	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	228.07	230.44	224.48	211.78	195.75	180.69	170.63	168.26	174.22	186.92	202.95	218.01	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	(71)

Water heating gains (Table 5)

(72)m=	86.01	83.82	78.67	71.86	67.21	60.93	56.15	62.93	65.76	72.78	80.6	83.83	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	398.62	396.51	382	358.91	335.41	312.76	298.48	305.18	317.36	340.68	367.35	386.95	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	449.76	500.62	569.57	666.95	749.48	754.21	711.44	634.4	545.92	467.91	431.7	428.72	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.82	0.6	0.44	0.52	0.82	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.04	20.16	20.38	20.7	20.92	20.99	21	21	20.94	20.64	20.3	20.03	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.17	20.17	20.17	20.19	20.19	20.21	20.21	20.21	20.2	20.19	20.19	20.18	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.94	0.77	0.53	0.36	0.43	0.76	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.88	19.05	19.37	19.83	20.11	20.2	20.21	20.21	20.15	19.76	19.26	18.87	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.13	19.29	19.59	20.02	20.29	20.37	20.38	20.38	20.32	19.95	19.48	19.12	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.98	19.14	19.44	19.87	20.14	20.22	20.23	20.23	20.17	19.8	19.33	18.97	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	1	0.98	0.93	0.77	0.53	0.37	0.43	0.76	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	448.74	498.21	560.82	620.96	576.86	401.09	260.81	273.71	413.37	452.75	429.52	427.98	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1114.02	1076.38	974.45	809.37	620.06	404.57	261.08	274.42	440.7	676.2	906.3	1103.04	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	494.97	388.53	307.74	135.65	32.14	0	0	0	0	166.24	343.28	502.24	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2370.8 (98)

Space heating requirement in kWh/m²/year 28.14 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	494.97	388.53	307.74	135.65	32.14	0	0	0	0	166.24	343.28	502.24	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	547.54	429.79	340.42	150.06	35.55	0	0	0	0	183.9	379.73	555.58	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2622.56 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23

Efficiency of water heater 80.3 (216)

(217)m=	87.19	86.93	86.28	84.53	81.82	80.3	80.3	80.3	80.3	84.92	86.56	87.27	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	235.23	208.03	218.15	197.49	197.55	177.28	169.85	189.34	191.43	206.12	215.76	229.43	

Total = Sum(219a)$_{1...12}$ = 2435.65 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2622.56

DER WorkSheet: New dwelling design stage

Water heating fuel used			2435.65	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		197.32		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		227.32	(231)
Electricity for lighting			361.31	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	566.47	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	526.1	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1092.57	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	117.98	(267)
Electricity for lighting	(232) x		0.519	=	187.52	(268)
Total CO2, kg/year		sum of (265)…(271) =			1398.07	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			16.6	(273)
EI rating (section 14)					86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 3

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.63	(1a) x	2.56	(2a) =	183.37	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.37	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			71.63	x	0.12	=	8.595599			(28)
Walls Type1	31.08	16.99	14.09	x	0.16	=	2.25			(29)
Walls Type2	25.62	2.42	23.2	x	0.14	=	3.28			(29)
Total area of elements, m²			128.32							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 40.04 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8513.14 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 47.85 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.97	19.71	19.45	18.17	17.91	16.63	16.63	16.37	17.14	17.91	18.43	18.94	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	67.82	67.56	67.3	66.01	65.76	64.47	64.47	64.21	64.99	65.76	66.27	66.79	

Average = Sum(39)$_{1...12}$ /12= 65.95 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.95	0.94	0.94	0.92	0.92	0.9	0.9	0.9	0.91	0.92	0.93	0.93

Average = Sum(40)$_{1...12}$ /12= 0.92 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.47 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	97.32	93.78	90.24	86.7	83.16	79.62	79.62	83.16	86.7	90.24	93.78	97.32

Total = Sum(44)$_{1...12}$ = 1061.64 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	144.32	126.22	130.25	113.55	108.96	94.02	87.13	99.98	101.17	117.91	128.7	139.76

Total = Sum(45)$_{1...12}$ = 1391.97 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.65	18.93	19.54	17.03	16.34	14.1	13.07	15	15.18	17.69	19.31	20.96

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.59	43.16	45.98	42.76	42.38	39.27	40.57	42.38	42.76	45.98	46.25	49.59	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	

Output from water heater (annual)$_{1...12}$ 1922.64 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.38	52.76	54.8	48.45	46.82	41.08	39.11	43.84	44.33	50.7	54.36	58.87	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.93	15.92	12.95	9.8	7.33	6.19	6.68	8.69	11.66	14.81	17.28	18.42	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.07	203.16	197.9	186.71	172.58	159.3	150.42	148.34	153.6	164.79	178.92	192.2	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	(71)

Water heating gains (Table 5)

(72)m=	81.16	78.51	73.66	67.29	62.93	57.05	52.57	58.92	61.57	68.15	75.49	79.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.43	357.87	344.78	324.07	303.11	282.81	269.96	276.22	287.1	308.02	331.97	350.02	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	411.58	461.97	532.36	632.12	717.19	724.26	682.92	605.44	515.66	435.25	396.33	391.79	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.78	0.56	0.41	0.48	0.79	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.02	20.15	20.39	20.72	20.93	20.99	21	21	20.95	20.64	20.28	20	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.13	20.13	20.13	20.15	20.15	20.17	20.17	20.17	20.16	20.15	20.15	20.14	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.92	0.73	0.49	0.34	0.4	0.72	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.81	19	19.35	19.82	20.09	20.16	20.17	20.17	20.12	19.73	19.2	18.79	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.13	19.3	19.62	20.06	20.31	20.38	20.39	20.39	20.34	19.97	19.49	19.11	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.98	19.15	19.47	19.91	20.16	20.23	20.24	20.24	20.19	19.82	19.34	18.96	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.73	0.5	0.34	0.41	0.73	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	410.25	458.82	520.91	575.24	524.04	360.45	234.25	245.88	374.04	416.94	393.56	390.83	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	995.26	962.61	872.96	726.73	556.32	363.08	234.46	246.46	395.58	606.57	811.07	985.94	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	435.25	338.55	261.93	109.07	24.02	0	0	0	0	141.09	300.61	442.76	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2053.29 (98)

Space heating requirement in kWh/m²/year 28.67 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	435.25	338.55	261.93	109.07	24.02	0	0	0	0	141.09	300.61	442.76	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	481.48	374.5	289.74	120.66	26.57	0	0	0	0	156.07	332.54	489.78	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2271.34 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36

Efficiency of water heater 80.3 (216)

(217)m=	87.03	86.76	86.05	84.16	81.55	80.3	80.3	80.3	80.3	84.68	86.4	87.12	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	222.82	195.23	204.81	185.72	185.58	165.99	159.03	177.28	179.24	193.55	202.48	217.36	

Total = Sum(219a)$_{1...12}$ = 2289.08 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2271.34

DER WorkSheet: New dwelling design stage

Water heating fuel used		2289.08	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	167.79		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	197.79	(231)
Electricity for lighting		316.57	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	490.61	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	494.44	(264)
Space and water heating	(261) + (262) + (263) + (264) =				985.05	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	102.65	(267)
Electricity for lighting	(232) x		0.519	=	164.3	(268)
Total CO2, kg/year		sum of (265)…(271) =			1252	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			17.48	(273)
EI rating (section 14)					86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 4

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.54	(1a) x	2.56	(2a) =	131.94	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.54	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.94	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			51.54	x	0.12	=	6.1848			(28)
Walls Type1	24.61	12.37	12.24	x	0.16	=	1.96			(29)
Walls Type2	39.63	2.42	37.21	x	0.14	=	5.26			(29)
Total area of elements, m²			115.78							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.19 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6510.05 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 41 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.37	14.18	14	13.07	12.89	11.96	11.96	11.78	12.33	12.89	13.26	13.63	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	55.36	55.18	54.99	54.07	53.88	52.96	52.96	52.77	53.33	53.88	54.25	54.62	

Average = Sum(39)$_{1...12}$ /12= 54.02 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.07	1.07	1.07	1.05	1.05	1.03	1.03	1.02	1.03	1.05	1.05	1.06

Average = Sum(40)$_{1...12}$ /12= 1.05 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.96	79.94	76.93	73.91	70.89	67.88	67.88	70.89	73.91	76.93	79.94	82.96

Total = Sum(44)$_{1...12}$ = 905.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	123.03	107.6	111.03	96.8	92.88	80.15	74.27	85.23	86.25	100.51	109.72	119.15

Total = Sum(45)$_{1...12}$ = 1186.62 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.45	16.14	16.66	14.52	13.93	12.02	11.14	12.78	12.94	15.08	16.46	17.87

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.28	36.8	39.2	36.45	36.13	33.47	34.59	36.13	36.45	39.2	39.42	42.28	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	

Output from water heater (annual)$_{1...12}$ 1639.01 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.48	44.98	46.72	41.3	39.92	35.02	33.34	37.37	37.79	43.22	46.34	50.18	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.48	11.98	9.74	7.37	5.51	4.65	5.03	6.54	8.77	11.14	13	13.86	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.23	152.8	148.85	140.43	129.8	119.81	113.14	111.57	115.53	123.94	134.57	144.56	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	(71)

Water heating gains (Table 5)

(72)m=	69.19	66.93	62.79	57.36	53.65	48.64	44.82	50.23	52.48	58.09	64.36	67.45	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	285.93	283.74	273.41	257.19	240.99	225.14	215.02	220.37	228.81	245.21	263.96	277.9	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	13.91	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	28.31	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	51.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	83.77	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	112.6	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	120.04	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	112.29	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	89.52	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	62.15	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	34.6	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	17.5	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	11.36	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	37.24	75.8	136.57	224.28	301.48	321.41	300.67	239.7	166.41	92.63	46.85	30.41	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	323.17	359.54	409.98	481.47	542.47	546.54	515.68	460.06	395.22	337.84	310.81	308.31	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.81	0.6	0.45	0.52	0.81	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.89	20.02	20.27	20.63	20.88	20.98	21	20.99	20.91	20.57	20.17	19.87	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.02	20.02	20.03	20.04	20.05	20.06	20.06	20.06	20.05	20.05	20.04	20.03	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.76	0.52	0.35	0.42	0.74	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.54	18.73	19.1	19.61	19.94	20.05	20.06	20.06	19.99	19.54	18.97	18.52	(90)

fLA = Living area ÷ (4) = 0.3 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.94	19.12	19.45	19.92	20.22	20.33	20.34	20.34	20.27	19.85	19.33	18.93	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.79	18.97	19.3	19.77	20.07	20.18	20.19	20.19	20.12	19.7	19.18	18.78	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.76	0.53	0.37	0.43	0.75	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	321.63	356.31	400.12	440.45	410.94	290.83	189.72	198.96	294.79	322.55	307.88	307.15	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	802.48	776.36	704.16	587.58	451.16	295.51	190.21	200.11	320.82	490.51	655.58	796.29	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	357.75	282.27	226.21	105.93	29.93	0	0	0	0	124.96	250.34	363.92	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1741.31 (98)

Space heating requirement in kWh/m²/year 33.79 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	357.75	282.27	226.21	105.93	29.93	0	0	0	0	124.96	250.34	363.92	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	395.75	312.25	250.23	117.18	33.11	0	0	0	0	138.23	276.93	402.56	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1926.23 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42

Efficiency of water heater 80.3 (216)

(217)m=	86.94	86.71	86.08	84.48	82.03	80.3	80.3	80.3	80.3	84.77	86.35	87.04	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	190.13	166.53	174.53	157.73	157.28	141.5	135.57	151.13	152.8	164.81	172.73	185.46	

Total = Sum(219a)$_{1...12}$ = 1950.19 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1926.23

DER WorkSheet: New dwelling design stage

Water heating fuel used		1950.19	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	120.73		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	150.73	(231)
Electricity for lighting		238.1	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	416.07	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	421.24	(264)
Space and water heating	(261) + (262) + (263) + (264) =				837.31	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	78.23	(267)
Electricity for lighting	(232) x		0.519	=	123.58	(268)
Total CO2, kg/year		sum of (265)…(271) =			1039.11	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			20.16	(273)
EI rating (section 14)					86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 5

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	87.91	(1a) x	2.56	(2a) =	225.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	87.91	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		225.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			87.91	x	0.12	=	10.5492			(28)
Walls Type1	24.61	19.88	4.73	x	0.16	=	0.76			(29)
Walls Type2	39.63	2.42	37.21	x	0.14	=	5.26			(29)
Roof	10.54	0	10.54	x	0.12	=	1.26			(30)
Total area of elements, m²			162.69							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 47.58 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 10477.94 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.14 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 56.72 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	24.51	24.19	23.88	22.3	21.98	20.4	20.4	20.09	21.04	21.98	22.61	23.25	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	81.23	80.91	80.59	79.02	78.7	77.12	77.12	76.81	77.75	78.7	79.33	79.96	

Average = Sum(39)$_{1...12}$ /12= 78.94 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.92	0.92	0.92	0.9	0.9	0.88	0.88	0.87	0.88	0.9	0.9	0.91

Average = Sum(40)$_{1...12}$ /12= 0.9 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.6 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 95.86 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	105.44	101.61	97.77	93.94	90.1	86.27	86.27	90.1	93.94	97.77	101.61	105.44

Total = Sum(44)$_{1...12}$ = 1150.27 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	156.37	136.76	141.12	123.03	118.05	101.87	94.4	108.32	109.62	127.75	139.45	151.43

Total = Sum(45)$_{1...12}$ = 1508.18 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.45	20.51	21.17	18.46	17.71	15.28	14.16	16.25	16.44	19.16	20.92	22.71

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.82	46.33	45.92	42.54	43.96	45.92	46.33	49.82	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39	

Output from water heater (annual)$_{1...12}$ 2076.08 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	64.73	56.98	59.38	52.49	50.73	44.51	42.38	47.5	48.03	54.93	58.7	63.09	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	20.96	18.62	15.14	11.46	8.57	7.23	7.82	10.16	13.64	17.32	20.21	21.55	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	235.18	237.62	231.47	218.38	201.85	186.32	175.94	173.5	179.65	192.74	209.27	224.8	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	(71)

Water heating gains (Table 5)

(72)m=	87	84.79	79.81	72.9	68.19	61.82	56.96	63.84	66.71	73.83	81.52	84.8	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	408.09	405.97	391.36	367.68	343.55	320.31	305.66	312.44	324.94	348.83	375.94	396.09	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast	0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast	0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast	0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast	0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast	0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast	0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast	0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast	0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast	0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast	0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast	0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast	0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast	0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast	0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast	0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast	0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast	0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast	0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)
Southeast	0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast	0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast	0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast	0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast	0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)
Southeast	0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast	0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast	0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast	0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast	0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast	0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast	0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	79.52	152.43	253.69	389.97	505.84	532.55	500.79	409.71	300.15	180.64	98.34	66.05	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	487.6	558.4	645.05	757.66	849.39	852.86	806.45	722.15	625.09	529.47	474.28	462.14	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.79	0.57	0.42	0.49	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.03	20.17	20.41	20.73	20.93	20.99	21	21	20.95	20.66	20.3	20.01	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.15	20.15	20.15	20.17	20.17	20.19	20.19	20.19	20.18	20.17	20.17	20.16	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.92	0.74	0.5	0.34	0.4	0.72	0.96	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.84	19.04	19.39	19.85	20.11	20.18	20.19	20.19	20.14	19.77	19.24	18.83	(90)

fLA = Living area ÷ (4) = 0.23 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.12	19.3	19.63	20.05	20.3	20.37	20.37	20.38	20.33	19.98	19.48	19.1	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.97	19.15	19.48	19.9	20.15	20.22	20.22	20.23	20.18	19.83	19.33	18.95	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.74	0.5	0.35	0.41	0.72	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	486.26	554.75	631.31	690.91	626.31	430.26	279.23	293.2	449.38	506.7	471.25	461.2	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1191.17	1153.13	1045.74	869.35	664.79	433.32	279.46	293.81	472.63	726.18	970.51	1179.46	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	524.46	402.11	308.34	128.48	28.63	0	0	0	0	163.3	359.46	534.38	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2449.16 (98)

Space heating requirement in kWh/m²/year 27.86 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	524.46	402.11	308.34	128.48	28.63	0	0	0	0	163.3	359.46	534.38	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	580.15	444.82	341.08	142.12	31.67	0	0	0	0	180.64	397.64	591.13	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2709.25 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39

Efficiency of water heater: 80.3 (216)

(217)m= 87.29 | 86.98 | 86.25 | 84.37 | 81.66 | 80.3 | 80.3 | 80.3 | 80.3 | 84.84 | 86.65 | 87.38 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 237.51 | 210.14 | 221.38 | 200.74 | 200.81 | 179.85 | 172.31 | 192.08 | 194.2 | 209.3 | 217.85 | 231.62

Total = Sum(219a)$_{1...12}$ = 2467.8 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2709.25	
Water heating fuel used		2467.8	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	226.51		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		256.51	(231)
Electricity for lighting		370.21	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	585.2	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	533.04	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1118.24	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	133.13	(267)
Electricity for lighting	(232) x	0.519	=	192.14	(268)
Total CO2, kg/year	sum of (265)…(271) =			1443.51	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			16.42	(273)
EI rating (section 14)				85	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 6

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.7	(1a) x	2.56	(2a) =	180.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.7	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			70.697	x	0.12	=	8.48364			(28)
Walls Type1	51.4	20.19	31.21	x	0.16	=	4.99			(29)
Walls Type2	16.74	2.42	14.32	x	0.14	=	2.03			(29)
Total area of elements, m²			138.83							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 45.66 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8550.61 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 11.36 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 57.01 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.71	19.46	19.2	17.93	17.68	16.41	16.41	16.16	16.92	17.68	18.19	18.69	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	76.72	76.47	76.21	74.95	74.69	73.42	73.42	73.17	73.93	74.69	75.2	75.71	

Average = Sum(39)$_{1...12}$ /12= 74.88 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.09	1.08	1.08	1.06	1.06	1.04	1.04	1.03	1.05	1.06	1.06	1.07

Average = Sum(40)$_{1...12}$ /12= 1.06 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.94 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.74	93.22	89.7	86.19	82.67	79.15	79.15	82.67	86.19	89.7	93.22	96.74

Total = Sum(44)$_{1...12}$ = 1055.33 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.46	125.47	129.48	112.88	108.31	93.46	86.61	99.38	100.57	117.21	127.94	138.93

Total = Sum(45)$_{1...12}$ = 1383.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.52	18.82	19.42	16.93	16.25	14.02	12.99	14.91	15.09	17.58	19.19	20.84

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.3	42.91	45.71	42.5	42.13	39.03	40.33	42.13	42.5	45.71	45.97	49.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	

Output from water heater (annual)$_{1...12}$ 1911.23 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.03	52.45	54.48	48.16	46.55	40.84	38.88	43.58	44.07	50.4	54.03	58.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.73	15.75	12.81	9.7	7.25	6.12	6.61	8.6	11.54	14.65	17.1	18.23	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.92	200.98	195.78	184.71	170.73	157.59	148.81	146.75	151.95	163.03	177	190.14	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	(71)

Water heating gains (Table 5)

(72)m=	80.68	78.05	73.22	66.89	62.56	56.72	52.26	58.57	61.2	67.74	75.05	78.66	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	357.27	354.72	341.76	321.24	300.48	280.37	267.63	273.86	284.64	305.36	329.09	346.97	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast 0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast 0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast 0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast 0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast 0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast 0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast 0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast 0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast 0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)
Southwest 0.9x	0.77	x	8.06	x	36.79		0.55	x	0.7	=	79.12	(79)
Southwest 0.9x	0.77	x	4.62	x	36.79		0.55	x	0.7	=	90.71	(79)
Southwest 0.9x	0.77	x	8.06	x	62.67		0.55	x	0.7	=	134.78	(79)
Southwest 0.9x	0.77	x	4.62	x	62.67		0.55	x	0.7	=	154.51	(79)
Southwest 0.9x	0.77	x	8.06	x	85.75		0.55	x	0.7	=	184.41	(79)
Southwest 0.9x	0.77	x	4.62	x	85.75		0.55	x	0.7	=	211.4	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	4.62	x	106.25		0.55	x	0.7	=	261.94	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	4.62	x	119.01		0.55	x	0.7	=	293.39	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	4.62	x	118.15		0.55	x	0.7	=	291.27	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	4.62	x	113.91		0.55	x	0.7	=	280.82	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	4.62	x	104.39		0.55	x	0.7	=	257.35	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	4.62	x	92.85		0.55	x	0.7	=	228.91	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	4.62	x	69.27		0.55	x	0.7	=	170.76	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	4.62	x	44.07		0.55	x	0.7	=	108.65	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	4.62	x	31.49		0.55	x	0.7	=	77.63	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	198.2	337.61	461.93	572.36	641.09	636.45	613.61	562.33	500.17	373.13	237.4	169.62	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	555.48	692.33	803.69	893.59	941.57	916.82	881.24	836.19	784.81	678.49	566.49	516.59	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.85	0.69	0.51	0.37	0.4	0.63	0.89	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.02	20.26	20.53	20.8	20.94	20.99	21	21	20.98	20.77	20.34	19.98	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.01	20.02	20.02	20.03	20.04	20.05	20.05	20.05	20.05	20.04	20.03	20.02	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.81	0.64	0.43	0.29	0.32	0.55	0.86	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.72	19.06	19.45	19.82	19.99	20.05	20.05	20.05	20.03	19.79	19.2	18.67	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.07	19.39	19.74	20.08	20.25	20.3	20.31	20.31	20.28	20.06	19.51	19.03	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.92	19.24	19.59	19.93	20.1	20.15	20.16	20.16	20.13	19.91	19.36	18.88	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.92	0.81	0.64	0.44	0.3	0.33	0.56	0.85	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	548.47	668.47	736.87	722.51	601.73	404.91	260.93	274.61	436.89	579.04	549.61	511.86	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1121.92	1096.27	998.01	826.98	627.13	407.63	261.17	275.03	446.11	695.26	921.88	1111.05	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	426.65	287.48	194.29	75.22	18.9	0	0	0	0	86.47	268.04	445.79	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1802.84 (98)

Space heating requirement in kWh/m²/year 25.5 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	426.65	287.48	194.29	75.22	18.9	0	0	0	0	86.47	268.04	445.79	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	471.96	318.01	214.92	83.2	20.91	0	0	0	0	95.65	296.5	493.13	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1994.29 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23

Efficiency of water heater 80.3 (216)

(217)m=	86.99	86.39	85.31	83.34	81.31	80.3	80.3	80.3	80.3	83.54	86.14	87.15

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	221.57	194.91	205.35	186.45	185.01	165	158.09	176.23	178.17	195.03	201.9	216

Total = Sum(219a)$_{1...12}$ = 2283.71 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1994.29
Water heating fuel used		2283.71
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	165.6	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		195.6 (231)
Electricity for lighting		313.18 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216 =	430.77 (261)
Space heating (secondary)	(215) x	0.519 =	0 (263)
Water heating	(219) x	0.216 =	493.28 (264)
Space and water heating	(261) + (262) + (263) + (264) =		924.05 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519 =	101.52 (267)
Electricity for lighting	(232) x	0.519 =	162.54 (268)
Total CO2, kg/year	sum of (265)…(271) =		1188.11 (272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =		16.81 (273)
EI rating (section 14)			86 (274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 7

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.46	(1a) x	2.56	(2a) =	129.18	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.46	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.18	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			50.46	x	0.12	=	6.0552			(28)
Walls Type1	24.7	13.84	10.86	x	0.16	=	1.74			(29)
Walls Type2	19.12	2.42	16.7	x	0.14	=	2.36			(29)
Total area of elements, m²			94.28							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.89 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6019.12 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 39.69 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.07	13.89	13.71	12.8	12.62	11.71	11.71	11.53	12.07	12.62	12.98	13.34	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	53.76	53.58	53.4	52.49	52.31	51.41	51.41	51.22	51.77	52.31	52.67	53.04	

Average = Sum(39)$_{1...12}$ /12= 52.45 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.07	1.06	1.06	1.04	1.04	1.02	1.02	1.02	1.03	1.04	1.04	1.05

Average = Sum(40)$_{1...12}$ /12= 1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.66 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.13	79.14	76.15	73.17	70.18	67.2	67.2	70.18	73.17	76.15	79.14	82.13

Total = Sum(44)$_{1...12}$ = 895.94 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.79	106.52	109.92	95.83	91.95	79.35	73.53	84.37	85.38	99.5	108.62	117.95

Total = Sum(45)$_{1...12}$ = 1174.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.37	13.79	11.9	11.03	12.66	12.81	14.93	16.29	17.69

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.85	36.43	38.81	36.08	35.76	33.14	34.24	35.76	36.08	38.81	39.03	41.85	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	

Output from water heater (annual)$_{1...12}$ 1622.57 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.96	44.52	46.25	40.88	39.52	34.67	33.01	37	37.41	42.79	45.87	49.68	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.23	11.75	9.56	7.24	5.41	4.57	4.93	6.41	8.61	10.93	12.76	13.6	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.43	149.97	146.09	137.82	127.39	117.59	111.04	109.5	113.38	121.65	132.08	141.88	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	(71)

Water heating gains (Table 5)

(72)m=	68.49	66.26	62.16	56.78	53.11	48.15	44.37	49.72	51.96	57.51	63.71	66.78	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.71	279.53	269.37	253.4	237.47	221.86	211.9	217.2	225.51	241.64	260.1	273.81	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast 0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast 0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast 0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast 0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast 0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast 0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast 0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast 0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast 0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)
Southwest 0.9x	0.77	x	8.06	x	36.79		0.55	x	0.7	=	79.12	(79)
Southwest 0.9x	0.77	x	2.89	x	36.79		0.55	x	0.7	=	28.37	(79)
Southwest 0.9x	0.77	x	8.06	x	62.67		0.55	x	0.7	=	134.78	(79)
Southwest 0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	48.33	(79)
Southwest 0.9x	0.77	x	8.06	x	85.75		0.55	x	0.7	=	184.41	(79)
Southwest 0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	66.12	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	81.93	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	91.77	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	135.86	231.43	316.65	392.34	439.46	436.28	420.62	385.47	342.86	255.78	162.73	116.27	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	417.57	510.96	586.01	645.74	676.93	658.14	632.52	602.67	568.37	497.42	422.83	390.08	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.93	0.84	0.68	0.49	0.36	0.39	0.61	0.88	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.09	20.31	20.57	20.82	20.95	20.99	21	21	20.98	20.8	20.4	20.05	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.03	20.04	20.05	20.05	20.07	20.07	20.07	20.06	20.05	20.05	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.92	0.8	0.62	0.42	0.28	0.31	0.53	0.84	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.83	19.15	19.52	19.86	20.01	20.06	20.07	20.07	20.05	19.84	19.29	18.78	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.24	19.53	19.86	20.17	20.32	20.37	20.37	20.37	20.35	20.16	19.65	19.2	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.09	19.38	19.71	20.02	20.17	20.22	20.22	20.22	20.2	20.01	19.5	19.05	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.98	0.96	0.91	0.8	0.63	0.44	0.29	0.32	0.55	0.84	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	411.13	490.98	533.27	516.3	426.9	287.11	186.07	195.63	310.3	418.19	407.91	385.61	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	795.19	776.01	705.65	583.97	443.02	288.8	186.21	195.89	315.94	492.05	653.32	787.38	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	285.75	191.54	128.25	48.72	12	0	0	0	0	54.95	176.7	298.91	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1196.82 (98)

Space heating requirement in kWh/m²/year 23.72 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	285.75	191.54	128.25	48.72	12	0	0	0	0	54.95	176.7	298.91	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	316.09	211.88	141.87	53.9	13.27	0	0	0	0	60.79	195.46	330.66	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1323.92 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8

Efficiency of water heater 80.3 (216)

(217)m= 86.44 | 85.79 | 84.68 | 82.8 | 81.08 | 80.3 | 80.3 | 80.3 | 80.3 | 82.93 | 85.5 | 86.61 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 189.31 | 166.63 | 175.63 | 159.33 | 157.52 | 140.08 | 134.21 | 149.61 | 151.26 | 166.77 | 172.68 | 184.52

Total = Sum(219a)$_{1...12}$ = 1947.55 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1323.92	
Water heating fuel used		1947.55	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.2		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		148.2	(231)
Electricity for lighting		233.69	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	285.97	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	420.67	(264)
Space and water heating	(261) + (262) + (263) + (264) =			706.64	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	76.91	(267)
Electricity for lighting	(232) x	0.519	=	121.29	(268)
Total CO2, kg/year	sum of (265)…(271) =			904.84	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			17.93	(273)
EI rating (section 14)				87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 8

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.46	(1a) x	2.56	(2a) =	129.18	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.46	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.18	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			50.46	x	0.12	=	6.0552			(28)
Walls Type1	24.7	13.84	10.86	x	0.16	=	1.74			(29)
Walls Type2	33.62	2.42	31.2	x	0.14	=	4.41			(29)
Total area of elements, m²			108.78							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.94 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6265.57 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 41.74 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.07	13.89	13.71	12.8	12.62	11.71	11.71	11.53	12.07	12.62	12.98	13.34	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	55.81	55.63	55.45	54.54	54.36	53.46	53.46	53.28	53.82	54.36	54.72	55.09	

Average = Sum(39)$_{1...12}$ /12= 54.5 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.11	1.1	1.1	1.08	1.08	1.06	1.06	1.06	1.07	1.08	1.08	1.09

Average = Sum(40)$_{1...12}$ /12= 1.08 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.66 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.13	79.14	76.15	73.17	70.18	67.2	67.2	70.18	73.17	76.15	79.14	82.13

Total = Sum(44)$_{1...12}$ = 895.94 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.79	106.52	109.92	95.83	91.95	79.35	73.53	84.37	85.38	99.5	108.62	117.95

Total = Sum(45)$_{1...12}$ = 1174.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.37	13.79	11.9	11.03	12.66	12.81	14.93	16.29	17.69

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.85	36.43	38.81	36.08	35.76	33.14	34.24	35.76	36.08	38.81	39.03	41.85	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	

Output from water heater (annual)$_{1...12}$ 1622.57 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.96	44.52	46.25	40.88	39.52	34.67	33.01	37	37.41	42.79	45.87	49.68	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.23	11.75	9.56	7.24	5.41	4.57	4.93	6.41	8.61	10.93	12.76	13.6	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.43	149.97	146.09	137.82	127.39	117.59	111.04	109.5	113.38	121.65	132.08	141.88	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	(71)

Water heating gains (Table 5)

(72)m=	68.49	66.26	62.16	56.78	53.11	48.15	44.37	49.72	51.96	57.51	63.71	66.78	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.71	279.53	269.37	253.4	237.47	221.86	211.9	217.2	225.51	241.64	260.1	273.81	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(79)

DER WorkSheet: New dwelling design stage

Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	66.12	(79)
Southwest	0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	81.93	(79)
Southwest	0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	91.77	(79)
Southwest	0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest	0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest	0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest	0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest	0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest	0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest	0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest	0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)
Southwest	0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)
Northwest	0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(81)
Northwest	0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(81)
Northwest	0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(81)
Northwest	0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(81)
Northwest	0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(81)
Northwest	0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(81)
Northwest	0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(81)
Northwest	0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(81)
Northwest	0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(81)
Northwest	0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(81)
Northwest	0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(81)
Northwest	0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(83)m=	116.19	200.81	282.43	362.81	418.13	420.27	403.03	360.98	310.15	224.01	139.7	99.1	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(84)m=	397.9	480.34	551.8	616.21	655.6	642.13	614.93	578.17	535.65	465.65	399.8	372.91	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.72	0.52	0.38	0.42	0.66	0.91	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(87)m=	19.99	20.2	20.48	20.76	20.93	20.99	21	21	20.97	20.73	20.31	19.96	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20	20	20	20.02	20.02	20.03	20.03	20.04	20.03	20.02	20.01	20.01	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.83	0.66	0.45	0.3	0.33	0.58	0.88	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.67	18.98	19.36	19.76	19.96	20.03	20.03	20.04	20	19.73	19.14	18.63	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.1	19.38	19.73	20.09	20.28	20.34	20.35	20.35	20.32	20.06	19.52	19.06	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.95	19.23	19.58	19.94	20.13	20.19	20.2	20.2	20.17	19.91	19.37	18.91	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.66	0.46	0.31	0.35	0.59	0.87	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	392.97	466.01	512.93	512.06	435.06	296.31	192.16	202.03	317.17	407.04	388.86	369.44	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	817.88	797.14	725.17	602.14	458.15	298.97	192.42	202.49	326.66	506.2	671.69	810.53	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	316.13	222.52	157.91	64.86	17.18	0	0	0	0	73.78	203.64	328.17	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1384.19 (98)

Space heating requirement in kWh/m²/year 27.43 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	316.13	222.52	157.91	64.86	17.18	0	0	0	0	73.78	203.64	328.17	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	349.7	246.15	174.68	71.75	19	0	0	0	0	81.61	225.26	363.03	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1531.18 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8

Efficiency of water heater 80.3 (216)

(217)m= 86.68 | 86.16 | 85.2 | 83.37 | 81.38 | 80.3 | 80.3 | 80.3 | 80.3 | 83.55 | 85.86 | 86.82 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 188.79 | 165.91 | 174.56 | 158.23 | 156.94 | 140.08 | 134.21 | 149.61 | 151.26 | 165.55 | 171.96 | 184.05

Total = Sum(219a)$_{1...12}$ = 1941.15 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1531.18	
Water heating fuel used		1941.15	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.2		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		148.2	(231)
Electricity for lighting		233.69	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	330.74	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	419.29	(264)
Space and water heating	(261) + (262) + (263) + (264) =			750.02	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	76.91	(267)
Electricity for lighting	(232) x	0.519	=	121.29	(268)
Total CO2, kg/year	sum of (265)…(271) =			948.22	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			18.79	(273)
EI rating (section 14)				87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 9

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.04	(1a) x	2.56	(2a) =	186.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.04	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			73.04	x	0.12	=	8.7648			(28)
Walls Type1	36.47	17.3	19.17	x	0.16	=	3.07			(29)
Walls Type2	41.48	2.42	39.06	x	0.14	=	5.52			(29)
Total area of elements, m²			150.99							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.68 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 9024.31 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.11 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 51.79 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.36	20.1	19.84	18.53	18.26	16.95	16.95	16.69	17.48	18.26	18.79	19.31	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	72.15	71.89	71.63	70.32	70.05	68.74	68.74	68.48	69.27	70.05	70.58	71.1	

Average = Sum(39)$_{1...12}$ /12= 70.25 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.99	0.98	0.98	0.96	0.96	0.94	0.94	0.94	0.95	0.96	0.97	0.97	

Average = Sum(40)$_{1...12}$ /12= 0.96 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.24 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	98.17	94.6	91.03	87.46	83.89	80.32	80.32	83.89	87.46	91.03	94.6	98.17	

Total = Sum(44)$_{1...12}$ = 1070.92 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	145.58	127.32	131.39	114.55	109.91	94.84	87.89	100.85	102.06	118.94	129.83	140.99	

Total = Sum(45)$_{1...12}$ = 1404.14 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.84	19.1	19.71	17.18	16.49	14.23	13.18	15.13	15.31	17.84	19.47	21.15	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.03	43.54	46.39	43.13	42.75	39.61	40.93	42.75	43.13	46.39	46.65	50.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	

Output from water heater (annual)$_{1...12}$ 1939.46 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.91	53.22	55.28	48.87	47.23	41.44	39.45	44.22	44.72	51.14	54.83	59.38	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.21	16.18	13.16	9.96	7.44	6.29	6.79	8.83	11.85	15.04	17.56	18.72	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.29	206.41	201.06	189.69	175.34	161.84	152.83	150.71	156.05	167.42	181.78	195.27	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	(71)

Water heating gains (Table 5)

(72)m=	81.87	79.2	74.31	67.87	63.48	57.55	53.03	59.44	62.11	68.74	76.15	79.82	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	365.13	362.54	349.29	328.29	307.03	286.45	273.42	279.74	290.77	311.97	336.26	354.57	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	169.83	289.28	395.81	490.43	549.32	545.35	525.77	481.84	428.58	319.72	203.42	145.34	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	534.96	651.83	745.1	818.72	856.35	831.79	799.19	761.58	719.35	631.69	539.67	499.91	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.72	0.52	0.38	0.41	0.64	0.91	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.11	20.32	20.56	20.81	20.95	20.99	21	21	20.98	20.79	20.4	20.07	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.1	20.1	20.11	20.12	20.13	20.13	20.14	20.13	20.12	20.11	20.11	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.66	0.45	0.3	0.34	0.57	0.88	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.91	19.21	19.57	19.91	20.07	20.13	20.13	20.14	20.11	19.9	19.35	18.87	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.24	19.51	19.84	20.16	20.31	20.36	20.37	20.37	20.35	20.14	19.64	19.2	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.09	19.36	19.69	20.01	20.16	20.21	20.22	20.22	20.2	19.99	19.49	19.05	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.67	0.46	0.31	0.34	0.58	0.87	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	529.65	634.1	694.28	681.44	569.51	383.72	248.55	261.3	414.59	549.71	526.55	496.33	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1066.99	1039.74	944.61	781.07	592.79	385.92	248.72	261.6	422.41	657.79	874.38	1055.86	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	399.78	272.59	186.24	71.74	17.32	0	0	0	0	80.41	250.44	416.29	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1694.81 (98)

Space heating requirement in kWh/m²/year 23.2 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	399.78	272.59	186.24	71.74	17.32	0	0	0	0	80.41	250.44	416.29	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	442.24	301.54	206.02	79.36	19.16	0	0	0	0	88.95	277.03	460.5	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1874.79 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01

Efficiency of water heater 80.3 (216)

(217)m=	86.81	86.22	85.17	83.21	81.22	80.3	80.3	80.3	80.3	83.35	85.93	86.96	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	225.32	198.17	208.73	189.5	187.95	167.44	160.42	178.83	180.81	198.36	205.37	219.65	

Total = Sum(219a)$_{1...12}$ = 2320.55 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1874.79

DER WorkSheet: New dwelling design stage

Water heating fuel used		2320.55	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	171.09		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	201.09	(231)
Electricity for lighting		321.63	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	404.96	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	501.24	(264)
Space and water heating	(261) + (262) + (263) + (264) =				906.19	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	104.37	(267)
Electricity for lighting	(232) x		0.519	=	166.93	(268)
Total CO2, kg/year		sum of (265)…(271) =			1177.49	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			16.12	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 10

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.73	(1a) x	2.56	(2a) =	188.75	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.73	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.75	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			73.73	x	0.12	=	8.8476			(28)
Walls Type1	31.87	17.3	14.57	x	0.16	=	2.33			(29)
Walls Type2	46.82	2.42	44.4	x	0.14	=	6.28			(29)
Total area of elements, m²			152.42							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.78 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 9112.79 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 51.58 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.55	20.29	20.03	18.7	18.44	17.11	17.11	16.85	17.64	18.44	18.97	19.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	72.14	71.87	71.61	70.29	70.02	68.7	68.7	68.43	69.23	70.02	70.55	71.08	

Average = Sum(39)$_{1...12}$ /12= 70.22 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.98	0.97	0.97	0.95	0.95	0.93	0.93	0.93	0.94	0.95	0.96	0.96

Average = Sum(40)$_{1...12}$ /12= 0.95 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.61 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.57	94.99	91.41	87.82	84.24	80.65	80.65	84.24	87.82	91.41	94.99	98.57

Total = Sum(44)$_{1...12}$ = 1075.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.18	127.85	131.93	115.02	110.37	95.24	88.25	101.27	102.48	119.43	130.37	141.57

Total = Sum(45)$_{1...12}$ = 1409.96 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.93	19.18	19.79	17.25	16.55	14.29	13.24	15.19	15.37	17.91	19.56	21.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.23	43.72	46.58	43.31	42.93	39.77	41.1	42.93	43.31	46.58	46.84	50.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.2	145.79	166.01	177.21	191.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.2	145.79	166.01	177.21	191.8	

Output from water heater (annual)$_{1...12}$ 1947.49 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.16	53.44	55.51	49.07	47.43	41.61	39.62	44.4	44.9	51.36	55.06	59.63	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.35	16.3	13.26	10.04	7.5	6.33	6.84	8.89	11.94	15.16	17.69	18.86	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.84	207.98	202.59	191.14	176.67	163.08	153.99	151.86	157.24	168.7	183.16	196.76	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	(71)

Water heating gains (Table 5)

(72)m=	82.21	79.53	74.61	68.16	63.75	57.79	53.25	59.68	62.36	69.03	76.47	80.15	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.4	364.8	351.46	330.32	308.92	288.2	275.08	281.43	292.54	313.88	338.32	356.77	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	169.83	289.28	395.81	490.43	549.32	545.35	525.77	481.84	428.58	319.72	203.42	145.34	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	537.23	654.08	747.27	820.75	858.24	833.55	800.86	763.27	721.12	633.6	541.74	502.11	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.72	0.52	0.38	0.41	0.64	0.91	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.12	20.32	20.57	20.82	20.95	20.99	21	21	20.98	20.8	20.41	20.09	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.1	20.1	20.11	20.12	20.13	20.14	20.14	20.14	20.13	20.13	20.12	20.11	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.66	0.45	0.3	0.34	0.57	0.88	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.93	19.23	19.58	19.92	20.08	20.14	20.14	20.14	20.12	19.91	19.37	18.89	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.25	19.53	19.85	20.17	20.32	20.37	20.37	20.37	20.35	20.15	19.65	19.21	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.1	19.38	19.7	20.02	20.17	20.22	20.22	20.22	20.2	20	19.5	19.06	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.66	0.46	0.31	0.34	0.58	0.87	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	531.97	636.47	696.56	683.11	570.22	383.83	248.65	261.39	414.93	551.36	528.68	498.57	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1067.86	1040.45	945.14	781.29	592.87	385.93	248.81	261.67	422.46	658.04	874.89	1056.61	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	398.7	271.47	184.95	70.69	16.85	0	0	0	0	79.37	249.27	415.18	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1686.48 (98)

Space heating requirement in kWh/m²/year 22.87 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	398.7	271.47	184.95	70.69	16.85	0	0	0	0	79.37	249.27	415.18	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	441.04	300.3	204.59	78.2	18.64	0	0	0	0	87.8	275.74	459.27	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1865.58 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.2	145.79	166.01	177.21	191.8

Efficiency of water heater 80.3 (216)

(217)m=	86.8	86.2	85.14	83.17	81.2	80.3	80.3	80.3	80.3	83.31	85.91	86.94	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	226.29	199.04	209.67	190.37	188.79	168.13	161.08	179.57	181.55	199.26	206.28	220.6	

Total = Sum(219a)$_{1...12}$ = 2330.64 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1865.58

DER WorkSheet: New dwelling design stage

Water heating fuel used		2330.64	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	172.71		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	202.71	(231)
Electricity for lighting		324.08	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	402.96	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	503.42	(264)
Space and water heating	(261) + (262) + (263) + (264) =				906.38	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	105.2	(267)
Electricity for lighting	(232) x		0.519	=	168.2	(268)
Total CO2, kg/year		sum of (265)…(271) =			1179.79	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			16	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat11

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	52.19	(1a) x	2.56	(2a) =	133.61	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	52.19	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		133.61	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			52.19	x	0.12	=	6.2628			(28)
Walls Type1	24.97	17.3	7.67	x	0.16	=	1.23			(29)
Walls Type2	39.92	2.42	37.5	x	0.14	=	5.3			(29)
Total area of elements, m²			117.08							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.12 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6508.79 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 46.92 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.55	14.36	14.17	13.24	13.05	12.11	12.11	11.93	12.49	13.05	13.43	13.8	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	61.47	61.28	61.1	60.16	59.97	59.03	59.03	58.85	59.41	59.97	60.35	60.72	

Average = Sum(39)$_{1...12}$ /12= 60.11 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.18	1.17	1.17	1.15	1.15	1.13	1.13	1.13	1.14	1.15	1.16	1.16

Average = Sum(40)$_{1...12}$ /12= 1.15 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.75 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.87 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	83.46	80.43	77.39	74.36	71.32	68.29	68.29	71.32	74.36	77.39	80.43	83.46

Total = Sum(44)$_{1...12}$ = 910.48 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	123.77	108.25	111.7	97.39	93.44	80.64	74.72	85.74	86.77	101.12	110.38	119.86

Total = Sum(45)$_{1...12}$ = 1193.79 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.57	16.24	16.76	14.61	14.02	12.1	11.21	12.86	13.02	15.17	16.56	17.98

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.53	37.02	39.44	36.67	36.34	33.68	34.8	36.34	36.67	39.44	39.66	42.53	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	166.3	145.27	151.14	134.06	129.79	114.31	109.52	122.09	123.44	140.56	150.04	162.4	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	166.3	145.27	151.14	134.06	129.79	114.31	109.52	122.09	123.44	140.56	150.04	162.4	

Output from water heater (annual)$_{1...12}$ 1648.9 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.79	45.25	47	41.55	40.16	35.23	33.54	37.6	38.02	43.48	46.62	50.49	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.63	12.11	9.85	7.46	5.57	4.7	5.08	6.61	8.87	11.26	13.14	14.01	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	152.92	154.51	150.51	141.99	131.25	121.15	114.4	112.81	116.81	125.33	136.07	146.17	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	(71)

Water heating gains (Table 5)

(72)m=	69.61	67.33	63.17	57.71	53.97	48.93	45.09	50.53	52.8	58.44	64.75	67.86	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	288.48	286.27	275.85	259.48	243.11	227.1	216.89	222.27	230.8	247.35	266.28	280.36	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	169.83	289.28	395.81	490.43	549.32	545.35	525.77	481.84	428.58	319.72	203.42	145.34	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	458.31	575.55	671.66	749.9	792.44	772.45	742.67	704.11	659.38	567.07	469.7	425.7	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.92	0.82	0.66	0.48	0.35	0.38	0.6	0.87	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.97	20.23	20.52	20.8	20.94	20.99	21	21	20.97	20.77	20.32	19.93	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.94	19.94	19.94	19.96	19.96	19.98	19.98	19.98	19.97	19.96	19.96	19.95	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.9	0.78	0.6	0.41	0.27	0.3	0.52	0.83	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.6	18.97	19.38	19.75	19.91	19.97	19.98	19.98	19.95	19.72	19.11	18.54	(90)

fLA = Living area ÷ (4) = 0.32 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.04	19.37	19.74	20.08	20.24	20.29	20.3	20.3	20.27	20.05	19.49	18.98	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.89	19.22	19.59	19.93	20.09	20.14	20.15	20.15	20.12	19.9	19.34	18.83	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.98	0.95	0.9	0.78	0.61	0.42	0.28	0.31	0.53	0.83	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	449.96	548.75	601.59	584.12	483.02	324.8	209.23	220.25	350.33	469.08	450.69	419.94	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	896.57	877.62	799.85	663.48	502.99	327.19	209.46	220.66	357.91	557.83	738.58	888.35	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	332.28	221	147.5	57.14	14.86	0	0	0	0	66.02	207.28	348.5	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1394.58 (98)

Space heating requirement in kWh/m²/year 26.72 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	332.28	221	147.5	57.14	14.86	0	0	0	0	66.02	207.28	348.5	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	367.56	244.47	163.16	63.21	16.44	0	0	0	0	73.04	229.29	385.5	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1542.67 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	166.3	145.27	151.14	134.06	129.79	114.31	109.52	122.09	123.44	140.56	150.04	162.4

Efficiency of water heater 80.3 (216)

(217)m=	86.76	86.1	84.99	83.07	81.23	80.3	80.3	80.3	80.3	83.27	85.87	86.92	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	191.68	168.71	177.84	161.37	159.78	142.36	136.39	152.04	153.72	168.79	174.74	186.82	

Total = Sum(219a)$_{1...12}$ = 1974.22 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1542.67

DER WorkSheet: New dwelling design stage

Water heating fuel used			1974.22	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		122.25		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		152.25	(231)
Electricity for lighting			240.76	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	333.22	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	426.43	(264)
Space and water heating	(261) + (262) + (263) + (264) =				759.65	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	79.02	(267)
Electricity for lighting	(232) x		0.519	=	124.95	(268)
Total CO2, kg/year		sum of (265)…(271) =			963.62	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			18.46	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 12

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.42	(1a) x	2.56	(2a) =	187.95	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.42	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.95	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x	1/[1/(1.4)+ 0.04]	=	10.69			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Windows Type 3			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Windows Type 4			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Floor			73.418	x	0.12	=	8.81016			(28)
Walls Type1	52.05	23.08	28.97	x	0.16	=	4.64			(29)
Walls Type2	17.46	2.42	15.04	x	0.14	=	2.13			(29)
Total area of elements, m²			142.93							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 49.56 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8824.22 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 12.32 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 61.88 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.47	20.2	19.94	18.62	18.36	17.04	17.04	16.78	17.57	18.36	18.89	19.41	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	82.34	82.08	81.82	80.5	80.24	78.92	78.92	78.65	79.44	80.24	80.76	81.29	

Average = Sum(39)$_{1...12}$ /12= 80.43 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.12	1.12	1.11	1.1	1.09	1.07	1.07	1.07	1.08	1.09	1.1	1.11

Average = Sum(40)$_{1...12}$ /12= 1.1 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.45 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.39	94.81	91.24	87.66	84.08	80.5	80.5	84.08	87.66	91.24	94.81	98.39

Total = Sum(44)$_{1...12}$ = 1073.36 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.91	127.61	131.69	114.81	110.16	95.06	88.09	101.08	102.29	119.21	130.12	141.31

Total = Sum(45)$_{1...12}$ = 1407.34 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.89	19.14	19.75	17.22	16.52	14.26	13.21	15.16	15.34	17.88	19.52	21.2

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.14	43.64	46.49	43.23	42.85	39.7	41.02	42.85	43.23	46.49	46.76	50.14	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	

Output from water heater (annual)$_{1...12}$ 1943.87 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.05	53.34	55.41	48.98	47.34	41.53	39.54	44.32	44.82	51.26	54.96	59.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.29	16.24	13.21	10	7.48	6.31	6.82	8.86	11.9	15.11	17.63	18.8	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.14	207.27	201.9	190.48	176.07	162.52	153.47	151.34	156.7	168.12	182.54	196.09	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	(71)

Water heating gains (Table 5)

(72)m=	82.06	79.38	74.47	68.03	63.63	57.68	53.15	59.57	62.25	68.9	76.33	80	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	366.38	363.78	350.48	329.41	308.07	287.41	274.33	280.67	291.74	313.02	337.39	355.78	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast	0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast	0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast	0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast	0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast	0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast	0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast	0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast	0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast	0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast	0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast	0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)
Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)
Southwest	0.9x	0.77	x	2.89	x	36.79		0.55	x	0.7	=	28.37	(79)
Southwest	0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	48.33	(79)
Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	66.12	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	81.93	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	91.77	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	206.9	355.32	493.84	624.75	711.52	711.54	683.85	618.33	539.05	394.77	248.35	176.72	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	573.28	719.1	844.32	954.16	1019.59	998.95	958.18	899	830.79	707.79	585.74	532.5	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.85	0.69	0.5	0.36	0.4	0.63	0.9	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.96	20.21	20.5	20.79	20.94	20.99	21	21	20.97	20.74	20.29	19.92	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.98	19.99	19.99	20	20.01	20.02	20.02	20.02	20.02	20.01	20	19.99	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.81	0.63	0.43	0.28	0.32	0.55	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.62	18.97	19.38	19.78	19.96	20.02	20.02	20.02	20	19.74	19.11	18.57	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.96	19.28	19.66	20.03	20.2	20.26	20.27	20.27	20.24	19.99	19.41	18.91	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.81	19.13	19.51	19.88	20.05	20.11	20.12	20.12	20.09	19.84	19.26	18.76	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	0.99	0.97	0.92	0.81	0.63	0.43	0.29	0.32	0.56	0.86	0.97	0.99	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	566.29	695.05	774.73	768.57	642.63	431.85	277.16	291.87	464.78	607.59	569.04	527.79	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	1194.58	1168.04	1064.62	883.79	670.15	434.84	277.43	292.37	475.85	741.32	981.98	1183.43	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	467.45	317.85	215.68	82.96	20.48	0	0	0	0	99.5	297.32	487.79	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1989.03 (98)

Space heating requirement in kWh/m²/year 27.09 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

DER WorkSheet: New dwelling design stage

Fraction of space heat from main system(s)	(202) = 1 – (201) =	1	(202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1	(204)
Efficiency of main space heating system 1		90.4	(206)
Efficiency of secondary/supplementary heating system, %		0	(208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	467.45	317.85	215.68	82.96	20.48	0	0	0	0	99.5	297.32	487.79	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)	517.09	351.6	238.59	91.76	22.65	0	0	0	0	110.06	328.89	539.6	(211)

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 2200.25 (211)

Space heating fuel (secondary), kWh/month = {[(98)m x (201)] } x 100 ÷ (208)													
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

Output from water heater (calculated above)	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	
Efficiency of water heater													80.3 (216)
(217)m=	87.16	86.59	85.53	83.51	81.37	80.3	80.3	80.3	80.3	83.81	86.35	87.3	(217)
Fuel for water heating, kWh/month (219)m = (64)m x 100 ÷ (217)m													
(219)m=	224.93	197.78	208.32	189.24	188.03	167.82	160.79	179.24	181.22	197.7	204.85	219.28	

Total = Sum(219a)$_{1...12}$ = 2319.19 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2200.25	
Water heating fuel used		2319.19	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	171.97		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		201.97	(231)
Electricity for lighting		322.98	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	475.25	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	500.95	(264)
Space and water heating	(261) + (262) + (263) + (264) =				976.2	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	104.82	(267)
Electricity for lighting	(232) x		0.519	=	167.63	(268)

DER WorkSheet: New dwelling design stage

Total CO2, kg/year	sum of (265)…(271) =	1248.65	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =	17.01	(273)
EI rating (section 14)		86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 13

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	89.09	(1a) x	2.56	(2a) =	228.06	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	89.09	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		228.06	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=

0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31

(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=

0	0	0	0	0	0	0	0	0	0	0	0

(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=

0	0	0	0	0	0	0	0	0	0	0	0

(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=

0	0	0	0	0	0	0	0	0	0	0	0

(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=

0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31

(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Windows Type 4			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			89.086	x	0.12	=	10.69032			(28)
Walls Type1	67.1	21.89	45.21	x	0.16	=	7.23			(29)
Walls Type2	23.57	2.42	21.15	x	0.14	=	2.99			(29)
Roof	10.26	0	10.26	x	0.12	=	1.23			(30)
Total area of elements, m²			190.02							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 54.56 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11019.93 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 15.4 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 69.95 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

DER WorkSheet: New dwelling design stage

(38)m=	24.84	24.52	24.2	22.6	22.28	20.68	20.68	20.36	21.32	22.28	22.92	23.56	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	94.79	94.47	94.15	92.55	92.23	90.63	90.63	90.31	91.27	92.23	92.87	93.51	

Average = Sum(39)$_{1...12}$ /12= 92.47 (39)

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.06	1.06	1.06	1.04	1.04	1.02	1.02	1.01	1.02	1.04	1.04	1.05	

Average = Sum(40)$_{1...12}$ /12= 1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.61 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 96.26 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	105.88	102.03	98.18	94.33	90.48	86.63	86.63	90.48	94.33	98.18	102.03	105.88	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1155.11 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	157.02	137.33	141.72	123.55	118.55	102.3	94.8	108.78	110.08	128.29	140.04	152.07	

Total = Sum(45)$_{1...12}$ = 1514.53 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.55	20.6	21.26	18.53	17.78	15.35	14.22	16.32	16.51	19.24	21.01	22.81	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

DER WorkSheet: New dwelling design stage

Primary circuit loss (annual) from Table 3 | 0 | (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.03	46.52	46.11	42.72	44.15	46.11	46.52	50.03	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	207.98	183.36	191.75	170.07	164.66	145.02	138.94	154.89	156.6	178.32	189.35	203.03	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	207.98	183.36	191.75	170.07	164.66	145.02	138.94	154.89	156.6	178.32	189.35	203.03	

Output from water heater (annual)$_{1...12}$ | 2083.98 | (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	64.95	57.17	59.63	52.71	50.95	44.7	42.56	47.7	48.23	55.16	58.89	63.3	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.16	18.8	15.29	11.57	8.65	7.3	7.89	10.26	13.77	17.48	20.4	21.75	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	237.39	239.85	233.64	220.43	203.75	188.07	177.59	175.13	181.34	194.55	211.23	226.91	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	(71)

Water heating gains (Table 5)

(72)m=	87.3	85.08	80.15	73.21	68.48	62.08	57.2	64.11	66.99	74.14	81.79	85.08	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	411.04	408.92	394.27	370.4	346.07	322.64	307.88	314.69	327.29	351.37	378.62	398.94	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(79)

DER WorkSheet: New dwelling design stage

Southwest	0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	48.33	(79)
Southwest	0.9x	0.77	x	4.62	x	62.67		0.55	x	0.7	=	77.25	(79)
Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	66.12	(79)
Southwest	0.9x	0.77	x	4.62	x	85.75		0.55	x	0.7	=	105.7	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	81.93	(79)
Southwest	0.9x	0.77	x	4.62	x	106.25		0.55	x	0.7	=	130.97	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	91.77	(79)
Southwest	0.9x	0.77	x	4.62	x	119.01		0.55	x	0.7	=	146.7	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest	0.9x	0.77	x	4.62	x	118.15		0.55	x	0.7	=	145.64	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest	0.9x	0.77	x	4.62	x	113.91		0.55	x	0.7	=	140.41	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest	0.9x	0.77	x	4.62	x	104.39		0.55	x	0.7	=	128.68	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest	0.9x	0.77	x	4.62	x	92.85		0.55	x	0.7	=	114.45	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest	0.9x	0.77	x	4.62	x	69.27		0.55	x	0.7	=	85.38	(79)
Southwest	0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest	0.9x	0.77	x	4.62	x	44.07		0.55	x	0.7	=	54.32	(79)
Southwest	0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)
Southwest	0.9x	0.77	x	4.62	x	31.49		0.55	x	0.7	=	38.81	(79)
Northwest	0.9x	0.77	x	8.06	x	11.28	x	0.55	x	0.7	=	24.26	(81)
Northwest	0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest	0.9x	0.77	x	8.06	x	22.97	x	0.55	x	0.7	=	49.39	(81)
Northwest	0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest	0.9x	0.77	x	8.06	x	41.38	x	0.55	x	0.7	=	88.98	(81)
Northwest	0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest	0.9x	0.77	x	8.06	x	67.96	x	0.55	x	0.7	=	146.14	(81)
Northwest	0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest	0.9x	0.77	x	8.06	x	91.35	x	0.55	x	0.7	=	196.43	(81)
Northwest	0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest	0.9x	0.77	x	8.06	x	97.38	x	0.55	x	0.7	=	209.42	(81)
Northwest	0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest	0.9x	0.77	x	8.06	x	91.1	x	0.55	x	0.7	=	195.91	(81)
Northwest	0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest	0.9x	0.77	x	8.06	x	72.63	x	0.55	x	0.7	=	156.18	(81)
Northwest	0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest	0.9x	0.77	x	8.06	x	50.42	x	0.55	x	0.7	=	108.43	(81)
Northwest	0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest	0.9x	0.77	x	8.06	x	28.07	x	0.55	x	0.7	=	60.36	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	8.06	x	14.2	x	0.55	x	0.7	=	30.53	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	8.06	x	9.21	x	0.55	x	0.7	=	19.81	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	117.01	213.69	330.58	473.62	588.93	610.37	577.76	487.81	379.49	246.48	142.77	98.44	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	528.06	622.61	724.85	844.03	934.99	933.01	885.64	802.5	706.78	597.85	521.4	497.39	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.98	0.94	0.81	0.6	0.45	0.51	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.87	20.03	20.3	20.65	20.89	20.98	21	20.99	20.93	20.59	20.17	19.85	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.03	20.04	20.05	20.05	20.07	20.07	20.07	20.06	20.05	20.05	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.75	0.52	0.35	0.41	0.72	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.52	18.76	19.15	19.64	19.95	20.06	20.07	20.07	20.01	19.58	18.97	18.49	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.86	19.08	19.44	19.89	20.18	20.29	20.3	20.3	20.24	19.83	19.27	18.83	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.71	18.93	19.29	19.74	20.03	20.14	20.15	20.15	20.09	19.68	19.12	18.68	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	1	0.99	0.97	0.91	0.75	0.53	0.36	0.42	0.72	0.95	0.99	1	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	526.04	616.83	705.27	766.52	703.53	494.42	321.01	337.12	509.5	567.39	516.95	495.99	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	1365.45	1325.24	1203.84	1003.61	768.7	501.98	321.75	338.73	546.32	837.74	1116.31	1354.12	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	624.52	476.05	370.94	170.7	48.49	0	0	0	0	201.14	431.54	638.45	

Total per year (kWh/year) = Sum(98)$_{1\ldots5,9\ldots12}$ = 2961.83 (98)

Space heating requirement in kWh/m²/year 33.25 (99)

DER WorkSheet: New dwelling design stage

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system		0 (201)
Fraction of space heat from main system(s)	(202) = 1 – (201) =	1 (202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1 (204)
Efficiency of main space heating system 1		90.4 (206)
Efficiency of secondary/supplementary heating system, %		0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	624.52	476.05	370.94	170.7	48.49	0	0	0	0	201.14	431.54	638.45	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	690.84	526.6	410.33	188.83	53.63	0	0	0	0	222.5	477.36	706.25	

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 3276.36 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

Output from water heater (calculated above)

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
207.98	183.36	191.75	170.07	164.66	145.02	138.94	154.89	156.6	178.32	189.35	203.03

Efficiency of water heater 80.3 (216)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(217)m=	87.65	87.35	86.68	85.06	82.39	80.3	80.3	80.3	80.3	85.35	87.06	87.74

(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(219)m=	237.3	209.93	221.2	199.94	199.84	180.6	173.03	192.89	195.02	208.92	217.49	231.4

Total = Sum(219a)$_{1...12}$ = 2467.57 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		3276.36
Water heating fuel used		2467.57
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	208.68	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	238.68 (231)
Electricity for lighting		373.75 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216	=	707.69 (261)
Space heating (secondary)	(215) x	0.519	=	0 (263)
Water heating	(219) x	0.216	=	533 (264)
Space and water heating	(261) + (262) + (263) + (264) =			1240.69 (265)

DER WorkSheet: New dwelling design stage

Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	123.87	(267)
Electricity for lighting	(232)	x	0.519	=	193.98	(268)
Total CO2, kg/year			sum of (265)…(271) =		1558.54	(272)
Dwelling CO2 Emission Rate			(272) ÷ (4) =		17.49	(273)
EI rating (section 14)					84	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 14

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	89.3	(1a) x	2.56	(2a) =	228.61	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	89.3	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		228.61	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Floor			89.3	x	0.12	=	10.716			(28)
Walls Type1	46.68	17.54	29.14	x	0.16	=	4.66			(29)
Walls Type2	43.8	2.42	41.38	x	0.14	=	5.85			(29)
Total area of elements, m²			179.78							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 47.87 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11021.84 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.11 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 55.98 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	24.9	24.57	24.25	22.65	22.33	20.73	20.73	20.41	21.37	22.33	22.97	23.61	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	80.88	80.56	80.24	78.63	78.31	76.71	76.71	76.39	77.35	78.31	78.95	79.6	

Average = Sum(39)$_{1...12}$ /12= 78.55 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.91	0.9	0.9	0.88	0.88	0.86	0.86	0.86	0.87	0.88	0.88	0.89

Average = Sum(40)$_{1...12}$ /12= 0.88 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.62 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 96.33 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	105.96	102.11	98.26	94.4	90.55	86.7	86.7	90.55	94.4	98.26	102.11	105.96

Total = Sum(44)$_{1...12}$ = 1155.96 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	157.14	137.44	141.82	123.64	118.64	102.38	94.87	108.86	110.16	128.38	140.14	152.18

Total = Sum(45)$_{1...12}$ = 1515.65 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.57	20.62	21.27	18.55	17.8	15.36	14.23	16.33	16.52	19.26	21.02	22.83

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.07	46.56	46.14	42.75	44.18	46.14	46.56	50.07	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	208.1	183.46	191.89	170.2	164.78	145.13	139.05	155	156.72	178.45	189.45	203.14	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	208.1	183.46	191.89	170.2	164.78	145.13	139.05	155	156.72	178.45	189.45	203.14	

Output from water heater (annual)$_{1...12}$ 2085.39 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	64.99	57.2	59.67	52.75	50.98	44.73	42.59	47.73	48.27	55.2	58.93	63.34	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.39	19	15.45	11.7	8.74	7.38	7.98	10.37	13.92	17.67	20.62	21.98	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	237.78	240.25	234.03	220.8	204.09	188.38	177.89	175.42	181.64	194.88	211.59	227.29	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	(71)

Water heating gains (Table 5)

(72)m=	87.35	85.13	80.21	73.26	68.53	62.12	57.24	64.16	67.04	74.2	81.84	85.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	411.77	409.62	394.93	371	346.6	323.13	308.35	315.19	327.84	351.99	379.29	399.65	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	8.06	x	11.28	x	0.55	x	0.7	=	24.26	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	28.54	(81)
Northwest 0.9x	0.77	x	8.06	x	22.97	x	0.55	x	0.7	=	49.39	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	58.09	(81)
Northwest 0.9x	0.77	x	8.06	x	41.38	x	0.55	x	0.7	=	88.98	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	104.66	(81)
Northwest 0.9x	0.77	x	8.06	x	67.96	x	0.55	x	0.7	=	146.14	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	171.88	(81)
Northwest 0.9x	0.77	x	8.06	x	91.35	x	0.55	x	0.7	=	196.43	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	231.04	(81)
Northwest 0.9x	0.77	x	8.06	x	97.38	x	0.55	x	0.7	=	209.42	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	246.32	(81)
Northwest 0.9x	0.77	x	8.06	x	91.1	x	0.55	x	0.7	=	195.91	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	230.42	(81)
Northwest 0.9x	0.77	x	8.06	x	72.63	x	0.55	x	0.7	=	156.18	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	183.7	(81)
Northwest 0.9x	0.77	x	8.06	x	50.42	x	0.55	x	0.7	=	108.43	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	127.53	(81)
Northwest 0.9x	0.77	x	8.06	x	28.07	x	0.55	x	0.7	=	60.36	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	70.99	(81)
Northwest 0.9x	0.77	x	8.06	x	14.2	x	0.55	x	0.7	=	30.53	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	35.91	(81)
Northwest 0.9x	0.77	x	8.06	x	9.21	x	0.55	x	0.7	=	19.81	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	23.31	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(83)m=	52.8	107.48	193.64	318.02	427.48	455.74	426.33	339.88	235.96	131.35	66.44	43.12	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(84)m=	464.57	517.1	588.57	689.02	774.07	778.86	734.68	655.06	563.79	483.34	445.73	442.77	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.83	0.62	0.46	0.53	0.84	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(87)m=	20.02	20.14	20.36	20.68	20.91	20.99	21	21	20.93	20.63	20.28	20.01	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(88)m=	20.16	20.17	20.17	20.18	20.19	20.2	20.2	20.21	20.2	20.19	20.18	20.17	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(89)m=	1	1	0.99	0.95	0.79	0.55	0.38	0.44	0.78	0.98	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(90)m=	18.84	19.01	19.34	19.8	20.1	20.2	20.2	20.2	20.14	19.74	19.23	18.83	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(92)m=	19.17	19.32	19.62	20.04	20.32	20.41	20.42	20.42	20.36	19.98	19.52	19.16	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.02	19.17	19.47	19.89	20.17	20.26	20.27	20.27	20.21	19.83	19.37	19.01	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	1	0.99	0.94	0.79	0.55	0.38	0.45	0.78	0.97	1	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	463.66	514.97	580.77	647.1	610.07	429.73	281.16	294.73	438.16	469.81	443.82	442.13	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1190.22	1149.74	1040.59	864.36	663.44	434.4	281.54	295.72	472.46	722.76	968.47	1178.6	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	540.56	426.56	342.11	156.42	39.71	0	0	0	0	188.19	377.75	547.93	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2619.24 (98)

Space heating requirement in kWh/m²/year 29.33 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	540.56	426.56	342.11	156.42	39.71	0	0	0	0	188.19	377.75	547.93	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	597.96	471.86	378.44	173.04	43.92	0	0	0	0	208.18	417.87	606.12	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2897.39 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	208.1	183.46	191.89	170.2	164.78	145.13	139.05	155	156.72	178.45	189.45	203.14

Efficiency of water heater 80.3 (216)

(217)m=	87.35	87.11	86.49	84.84	82.08	80.3	80.3	80.3	80.3	85.19	86.76	87.43	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	238.25	210.62	221.86	200.61	200.76	180.74	173.16	193.03	195.16	209.49	218.38	232.36	

Total = Sum(219a)$_{1...12}$ = 2474.42 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2897.39

DER WorkSheet: New dwelling design stage

Water heating fuel used		2474.42	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	209.18		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	239.18	(231)
Electricity for lighting		377.76	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	625.84	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	534.48	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1160.31	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	124.13	(267)
Electricity for lighting	(232) x		0.519	=	196.06	(268)
Total CO2, kg/year		sum of (265)…(271) =			1480.5	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			16.58	(273)
EI rating (section 14)					85	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 15

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	87.91	(1a) x	2.56	(2a) =	225.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	87.91	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		225.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Floor			87.918	x	0.12	=	10.55016			(28)
Walls Type1	35.76	15.8	19.96	x	0.16	=	3.19			(29)
Walls Type2	40.33	2.42	37.91	x	0.14	=	5.36			(29)
Total area of elements, m²			164							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.44 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 10654.65 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.83 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 52.27 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	24.51	24.19	23.88	22.3	21.98	20.4	20.4	20.09	21.04	21.98	22.61	23.25	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	76.78	76.47	76.15	74.57	74.26	72.68	72.68	72.36	73.31	74.26	74.89	75.52	

Average = Sum(39)$_{1...12}$ /12= 74.49 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.87	0.87	0.87	0.85	0.84	0.83	0.83	0.82	0.83	0.84	0.85	0.86

Average = Sum(40)$_{1...12}$ /12= 0.85 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.6 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 95.86 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	105.44	101.61	97.77	93.94	90.1	86.27	86.27	90.1	93.94	97.77	101.61	105.44	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1150.27 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	156.37	136.76	141.12	123.03	118.05	101.87	94.4	108.32	109.62	127.75	139.45	151.43

Total = Sum(45)$_{1...12}$ = 1508.18 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.45	20.51	21.17	18.46	17.71	15.28	14.16	16.25	16.44	19.16	20.92	22.71

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.82	46.33	45.92	42.54	43.96	45.92	46.33	49.82	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39	

Output from water heater (annual)$_{1...12}$ 2076.08 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	64.73	56.98	59.38	52.49	50.73	44.51	42.38	47.5	48.03	54.93	58.7	63.09	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.42	19.02	15.47	11.71	8.76	7.39	7.99	10.38	13.93	17.69	20.65	22.01	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	235.18	237.62	231.47	218.38	201.85	186.32	175.94	173.5	179.65	192.74	209.27	224.8	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	(71)

Water heating gains (Table 5)

(72)m=	87	84.79	79.81	72.9	68.19	61.82	56.96	63.84	66.71	73.83	81.52	84.8	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	408.54	406.38	391.69	367.93	343.74	320.47	305.83	312.66	325.23	349.21	376.38	396.56	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	47.56	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	96.82	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	174.43	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	286.47	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	385.07	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	410.53	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	384.04	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	306.16	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	212.55	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	118.32	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	59.85	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	38.84	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	47.56	96.82	174.43	286.47	385.07	410.53	384.04	306.16	212.55	118.32	59.85	38.84	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	456.11	503.19	566.13	654.4	728.81	730.99	689.87	618.82	537.78	467.53	436.23	435.4	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.84	0.62	0.46	0.53	0.84	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.07	20.18	20.39	20.69	20.91	20.99	21	21	20.94	20.65	20.32	20.06	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.19	20.19	20.2	20.21	20.21	20.23	20.23	20.23	20.22	20.21	20.21	20.2	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.95	0.8	0.55	0.38	0.45	0.78	0.98	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.93	19.09	19.4	19.84	20.13	20.22	20.23	20.23	20.17	19.79	19.3	18.92	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.22	19.37	19.65	20.06	20.33	20.42	20.42	20.42	20.37	20	19.56	19.21	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.07	19.22	19.5	19.91	20.18	20.27	20.27	20.27	20.22	19.85	19.41	19.06	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	1	1	0.99	0.94	0.8	0.56	0.39	0.45	0.78	0.97	1	1	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	455.23	501.19	559.02	616.73	579.64	407.72	266.67	279.58	418.04	454.49	434.36	434.77	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	1133.87	1094.7	989.92	820.8	629.51	411.84	266.98	280.39	448.37	687.23	921.78	1122.24	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	504.91	398.84	320.59	146.93	37.1	0	0	0	0	173.16	350.94	511.47	

DER WorkSheet: New dwelling design stage

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ =	2443.94	(98)
Space heating requirement in kWh/m²/year	27.8	(99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system	0	(201)
Fraction of space heat from main system(s) (202) = 1 – (201) =	1	(202)
Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] =	1	(204)
Efficiency of main space heating system 1	90.4	(206)
Efficiency of secondary/supplementary heating system, %	0	(208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	504.91	398.84	320.59	146.93	37.1	0	0	0	0	173.16	350.94	511.47	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)	558.53	441.19	354.64	162.53	41.04	0	0	0	0	191.55	388.21	565.79	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$=	2703.47	(211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0

Total (kWh/year) =Sum(215)$_{1...5,10....12}$=	0	(215)

Water heating

Output from water heater (calculated above)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39

Efficiency of water heater	80.3	(216)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(217)m=	87.21	86.96	86.35	84.7	81.99	80.3	80.3	80.3	80.3	84.99	86.59	87.29	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(219)m=	237.74	210.19	221.14	199.96	199.99	179.85	172.31	192.08	194.2	208.94	218	231.87

Total = Sum(219a)$_{1...12}$ =	2466.25	(219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2703.47	
Water heating fuel used		2466.25	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	205.92		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		235.92	(231)
Electricity for lighting		378.27	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	583.95	(261)

DER WorkSheet: New dwelling design stage

Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	532.71	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1116.66	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	122.44	(267)
Electricity for lighting	(232) x	0.519	=	196.32	(268)
Total CO2, kg/year	sum of (265)…(271) =			1435.43	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			16.33	(273)
EI rating (section 14)				86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 16

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	95.34	(1a) x	2.56	(2a) =	244.07	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	95.34	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		244.07	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Floor			95.34	x	0.12	=	11.4408			(28)
Walls Type1	52.82	18.69	34.13	x	0.16	=	5.46			(29)
Walls Type2	30.82	2.42	28.4	x	0.14	=	4.02			(29)
Total area of elements, m²			178.98							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 49.08 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11550.41 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 12.42 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 61.5 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	26.58	26.24	25.89	24.18	23.84	22.13	22.13	21.79	22.81	23.84	24.53	25.21	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	88.08	87.74	87.4	85.68	85.34	83.63	83.63	83.29	84.32	85.34	86.03	86.71	

Average = Sum(39)$_{1...12}$ /12= 85.6 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.92	0.92	0.92	0.9	0.9	0.88	0.88	0.87	0.88	0.9	0.9	0.91

Average = Sum(40)$_{1...12}$ /12= 0.9 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.69 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 98.13 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	107.95	104.02	100.1	96.17	92.25	88.32	88.32	92.25	96.17	100.1	104.02	107.95

Total = Sum(44)$_{1...12}$ = 1177.62 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	160.08	140.01	144.48	125.96	120.86	104.29	96.64	110.9	112.22	130.79	142.76	155.03

Total = Sum(45)$_{1...12}$ = 1544.04 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	24.01	21	21.67	18.89	18.13	15.64	14.5	16.64	16.83	19.62	21.41	23.25

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.96	47.43	47.01	43.56	45.01	47.01	47.43	50.96	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	211.04	186.04	195.44	173.39	167.87	147.85	141.65	157.91	159.65	181.75	192.08	205.99	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	211.04	186.04	195.44	173.39	167.87	147.85	141.65	157.91	159.65	181.75	192.08	205.99	

Output from water heater (annual)$_{1...12}$ 2120.66 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	65.97	58.06	60.78	53.74	51.94	45.57	43.39	48.63	49.17	56.23	59.8	64.29	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	22.37	19.86	16.16	12.23	9.14	7.72	8.34	10.84	14.55	18.48	21.56	22.99	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	248.57	251.15	244.65	230.81	213.34	196.92	185.96	183.38	189.88	203.72	221.18	237.6	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	(71)

Water heating gains (Table 5)

(72)m=	88.67	86.4	81.69	74.64	69.81	63.29	58.31	65.36	68.29	75.57	83.05	86.41	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	425.98	423.79	408.87	384.06	358.67	334.31	318.99	325.96	339.1	364.14	392.18	413.38	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	47.56	(81)
Northwest 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	96.82	(81)
Northwest 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	174.43	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	286.47	(81)
Northwest 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	385.07	(81)
Northwest 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	410.53	(81)
Northwest 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	384.04	(81)
Northwest 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	306.16	(81)
Northwest 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	212.55	(81)
Northwest 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	118.32	(81)
Northwest 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	59.85	(81)
Northwest 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	38.84	(81)
Northwest 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	56.26	114.53	206.34	338.87	455.5	485.62	454.28	362.16	251.43	139.96	70.79	45.95	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	482.24	538.32	615.21	722.92	814.18	819.93	773.28	688.12	590.53	504.1	462.97	459.32	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.85	0.64	0.47	0.55	0.86	0.99	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.98	20.1	20.33	20.65	20.89	20.99	21	21	20.92	20.6	20.24	19.97	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.15	20.15	20.15	20.17	20.17	20.19	20.19	20.19	20.18	20.17	20.17	20.16	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.95	0.8	0.56	0.39	0.46	0.79	0.98	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.77	18.94	19.27	19.75	20.07	20.18	20.19	20.19	20.11	19.68	19.16	18.76	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.08	19.23	19.54	19.97	20.28	20.38	20.39	20.39	20.32	19.91	19.44	19.07	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.93	19.08	19.39	19.82	20.13	20.23	20.24	20.24	20.17	19.76	19.29	18.92	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	1	0.99	0.94	0.8	0.57	0.39	0.46	0.79	0.98	1	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	481.42	536.36	607.92	683.06	652.92	464.62	303.88	318.51	468.28	491.64	461.24	458.74	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1288.26	1244.5	1126.35	936.08	719.11	470.9	304.41	319.89	511.53	781.94	1048.29	1276.14	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	600.29	475.87	385.71	182.18	49.24	0	0	0	0	215.98	422.67	608.15	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2940.1 (98)

Space heating requirement in kWh/m²/year 30.84 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	600.29	475.87	385.71	182.18	49.24	0	0	0	0	215.98	422.67	608.15	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	664.04	526.41	426.67	201.53	54.47	0	0	0	0	238.92	467.56	672.73	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3252.32 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	211.04	186.04	195.44	173.39	167.87	147.85	141.65	157.91	159.65	181.75	192.08	205.99

Efficiency of water heater 80.3 (216)

(217)m=	87.54	87.31	86.73	85.18	82.39	80.3	80.3	80.3	80.3	85.49	86.98	87.61	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	241.09	213.07	225.34	203.56	203.76	184.12	176.4	196.65	198.82	212.6	220.83	235.12	

Total = Sum(219a)$_{1...12}$ = 2511.36 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 3252.32

DER WorkSheet: New dwelling design stage

Water heating fuel used		2511.36	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	223.32		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	253.32	(231)
Electricity for lighting		394.98	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	702.5	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	542.45	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1244.95	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	131.48	(267)
Electricity for lighting	(232) x		0.519	=	205	(268)
Total CO2, kg/year		sum of (265)…(271) =			1581.43	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			16.59	(273)
EI rating (section 14)					85	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 17

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.76	(1a) x	2.56	(2a) =	188.83	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.76	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.83	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Windows Type 3			4.31	x1/[1/(1.4)+ 0.04]		=	5.71			(27)
Floor			2.464	x	0.12	=	0.29568			(28)
Walls Type1	56.59	19.87	36.72	x	0.16	=	5.87			(29)
Walls Type2	12.58	2.42	10.16	x	0.14	=	1.44			(29)
Total area of elements, m²			71.63							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 37.34 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 981.73 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.98 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 44.32 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.56	20.3	20.03	18.71	18.44	17.12	17.12	16.86	17.65	18.44	18.97	19.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	64.89	64.62	64.36	63.03	62.77	61.44	61.44	61.18	61.97	62.77	63.3	63.83	

Average = Sum(39)$_{1...12}$ /12= 62.97 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.88	0.88	0.87	0.85	0.85	0.83	0.83	0.83	0.84	0.85	0.86	0.87

Average = Sum(40)$_{1...12}$ /12= 0.85 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.63 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.59	95.01	91.42	87.84	84.25	80.67	80.67	84.25	87.84	91.42	95.01	98.59

Total = Sum(44)$_{1...12}$ = 1075.55 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.21	127.88	131.96	115.04	110.39	95.25	88.27	101.29	102.5	119.45	130.39	141.6

Total = Sum(45)$_{1...12}$ = 1410.22 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.93	19.18	19.79	17.26	16.56	14.29	13.24	15.19	15.37	17.92	19.56	21.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.24	43.73	46.59	43.32	42.93	39.78	41.11	42.93	43.32	46.59	46.85	50.24	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84	

Output from water heater (annual)$_{1...12}$ 1947.85 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.18	53.45	55.52	49.08	47.44	41.62	39.63	44.41	44.91	51.36	55.07	59.64	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.36	16.3	13.26	10.04	7.5	6.34	6.85	8.9	11.94	15.16	17.7	18.87	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.91	208.05	202.66	191.2	176.73	163.13	154.05	151.91	157.29	168.76	183.23	196.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	(71)

Water heating gains (Table 5)

(72)m=	82.22	79.54	74.63	68.17	63.76	57.8	53.26	59.69	62.37	69.04	76.48	80.16	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.5	364.9	351.56	330.42	309	288.28	275.16	281.51	292.62	313.97	338.42	356.86	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	4.31	x	11.28	x	0.55	x	0.7	=	12.97	(75)
Northeast 0.9x	0.77	x	4.31	x	22.97	x	0.55	x	0.7	=	26.41	(75)
Northeast 0.9x	0.77	x	4.31	x	41.38	x	0.55	x	0.7	=	47.58	(75)
Northeast 0.9x	0.77	x	4.31	x	67.96	x	0.55	x	0.7	=	78.14	(75)
Northeast 0.9x	0.77	x	4.31	x	91.35	x	0.55	x	0.7	=	105.04	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.31	x	97.38	x	0.55	x	0.7	=	111.99	(75)
Northeast 0.9x	0.77	x	4.31	x	91.1	x	0.55	x	0.7	=	104.76	(75)
Northeast 0.9x	0.77	x	4.31	x	72.63	x	0.55	x	0.7	=	83.52	(75)
Northeast 0.9x	0.77	x	4.31	x	50.42	x	0.55	x	0.7	=	57.98	(75)
Northeast 0.9x	0.77	x	4.31	x	28.07	x	0.55	x	0.7	=	32.28	(75)
Northeast 0.9x	0.77	x	4.31	x	14.2	x	0.55	x	0.7	=	16.33	(75)
Northeast 0.9x	0.77	x	4.31	x	9.21	x	0.55	x	0.7	=	10.6	(75)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	59.82	121.76	219.37	360.26	484.26	516.28	482.97	385.03	267.3	148.8	75.26	48.85	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	427.32	486.66	570.92	690.68	793.26	804.55	758.12	666.53	559.92	462.76	413.68	405.71	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.98	0.9	0.71	0.49	0.36	0.42	0.73	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.12	20.25	20.5	20.81	20.97	21	21	21	20.97	20.72	20.37	20.1	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.18	20.19	20.19	20.21	20.21	20.22	20.22	20.23	20.22	20.21	20.2	20.2	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.88	0.66	0.43	0.29	0.35	0.66	0.95	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19	19.2	19.55	20	20.18	20.22	20.22	20.23	20.2	19.89	19.38	18.99	(90)

fLA = Living area ÷ (4) = 0.24 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.27	19.45	19.78	20.19	20.37	20.41	20.41	20.41	20.39	20.09	19.62	19.26	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.12	19.3	19.63	20.04	20.22	20.26	20.26	20.26	20.24	19.94	19.47	19.11	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.87	0.66	0.43	0.3	0.35	0.66	0.94	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	425.83	482.68	554.37	602.54	520.29	346.96	224.92	236.21	369.83	437.09	410.35	404.67	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	961.59	930.75	845.19	702.45	534.82	347.77	224.98	236.37	380.21	586.19	782.9	951.35	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	398.6	301.1	216.37	71.94	10.81	0	0	0	0	110.93	268.24	406.73	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1784.72 (98)

Space heating requirement in kWh/m²/year 24.2 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	398.6	301.1	216.37	71.94	10.81	0	0	0	0	110.93	268.24	406.73	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	440.93	333.08	239.35	79.58	11.96	0	0	0	0	122.71	296.72	449.92	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1974.25 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84

Efficiency of water heater 80.3 (216)

(217)m= 86.8 | 86.45 | 85.54 | 83.2 | 80.9 | 80.3 | 80.3 | 80.3 | 80.3 | 84.06 | 86.09 | 86.9 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 226.34 | 198.5 | 208.74 | 190.33 | 189.53 | 168.16 | 161.11 | 179.6 | 181.59 | 197.52 | 205.88 | 220.76

Total = Sum(219a)$_{1...12}$ = 2328.06 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1974.25	
Water heating fuel used		2328.06	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	172.78		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		202.78	(231)
Electricity for lighting		324.19	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	426.44	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	502.86	(264)
Space and water heating	(261) + (262) + (263) + (264) =			929.3	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	105.24	(267)
Electricity for lighting	(232) x	0.519	=	168.26	(268)
Total CO2, kg/year	sum of (265)…(271) =			1202.8	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			16.31	(273)
EI rating (section 14)				86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 18

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	84.24	(1a) x	2.56	(2a) =	215.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	84.24	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		215.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	35.61	16.99	18.62	x	0.16	=	2.98			(29)
Walls Type2	20.82	2.42	18.4	x	0.14	=	2.6			(29)
Total area of elements, m²			56.43							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.49 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 629.29 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.56 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 36.06 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	23.48	23.18	22.88	21.37	21.07	19.55	19.55	19.25	20.16	21.07	21.67	22.27	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	59.54	59.24	58.94	57.43	57.12	55.61	55.61	55.31	56.22	57.12	57.73	58.33	

Average = Sum(39)$_{1...12}$ /12= 57.35 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.71	0.7	0.7	0.68	0.68	0.66	0.66	0.66	0.67	0.68	0.69	0.69

Average = Sum(40)$_{1...12}$ /12= 0.68 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.54 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 94.49 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	103.94	100.16	96.38	92.6	88.82	85.04	85.04	88.82	92.6	96.38	100.16	103.94

Total = Sum(44)$_{1...12}$ = 1133.85 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	154.13	134.81	139.11	121.28	116.37	100.42	93.05	106.78	108.05	125.93	137.46	149.27

Total = Sum(45)$_{1...12}$ = 1486.65 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.12	20.22	20.87	18.19	17.46	15.06	13.96	16.02	16.21	18.89	20.62	22.39

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.11	45.66	45.26	41.94	43.33	45.26	45.66	49.11	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	

Output from water heater (annual)$_{1...12}$ 2049.26 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	63.99	56.33	58.53	51.74	50.01	43.87	41.77	46.82	47.34	54.15	58.03	62.37	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	20.46	18.17	14.78	11.19	8.36	7.06	7.63	9.92	13.31	16.9	19.72	21.03	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	228.07	230.44	224.48	211.78	195.75	180.69	170.63	168.26	174.22	186.92	202.95	218.01	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	(71)

Water heating gains (Table 5)

(72)m=	86.01	83.82	78.67	71.86	67.21	60.93	56.15	62.93	65.76	72.78	80.6	83.83	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	398.62	396.51	382	358.91	335.41	312.76	298.48	305.18	317.36	340.68	367.35	386.95	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	449.76	500.62	569.57	666.95	749.48	754.21	711.44	634.4	545.92	467.91	431.7	428.72	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.98	0.9	0.69	0.47	0.34	0.4	0.7	0.96	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.34	20.45	20.64	20.89	20.99	21	21	21	20.99	20.82	20.55	20.33	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.33	20.34	20.34	20.36	20.36	20.38	20.38	20.38	20.37	20.36	20.35	20.35	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.88	0.65	0.43	0.3	0.35	0.64	0.95	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.44	19.6	19.88	20.23	20.35	20.38	20.38	20.38	20.36	20.16	19.76	19.43	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.63	19.78	20.05	20.37	20.49	20.51	20.51	20.51	20.5	20.3	19.93	19.63	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.48	19.63	19.9	20.22	20.34	20.36	20.36	20.36	20.35	20.15	19.78	19.48	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.87	0.65	0.42	0.29	0.35	0.64	0.94	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	448.6	497.44	555.55	583.37	486.8	320.18	209.16	219.2	347.42	440.94	428.72	427.91	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	903.98	872.74	789.61	650.22	493.35	320.37	209.17	219.23	351.28	545.62	731.8	891.13	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	338.8	252.2	174.14	48.14	4.87	0	0	0	0	77.88	218.21	344.64	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1458.88 (98)

Space heating requirement in kWh/m²/year 17.32 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	338.8	252.2	174.14	48.14	4.87	0	0	0	0	77.88	218.21	344.64	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	374.78	278.98	192.63	53.25	5.39	0	0	0	0	86.15	241.39	381.24	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1613.81 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23

Efficiency of water heater 80.3 (216)

(217)m=	86.31	85.89	84.86	82.36	80.56	80.3	80.3	80.3	80.3	83.16	85.44	86.41	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	237.63	210.54	221.81	202.7	200.62	177.28	169.85	189.34	191.43	210.48	218.59	231.73	

Total = Sum(219a)$_{1...12}$ = 2462.01 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1613.81

DER WorkSheet: New dwelling design stage

Water heating fuel used			2462.01	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		197.32		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		227.32	(231)
Electricity for lighting			361.31	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	348.58	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	531.79	(264)
Space and water heating	(261) + (262) + (263) + (264) =				880.38	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	117.98	(267)
Electricity for lighting	(232) x		0.519	=	187.52	(268)
Total CO2, kg/year		sum of (265)…(271) =			1185.88	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			14.08	(273)
EI rating (section 14)					88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 19

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.63	(1a) x	2.56	(2a) =	183.37	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.37	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	31.08	16.99	14.09	x	0.16	=	2.25			(29)
Walls Type2	25.62	2.42	23.2	x	0.14	=	3.28			(29)
Total area of elements, m²			56.69							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.45 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 633.84 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.39 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.84 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.97	19.71	19.45	18.17	17.91	16.63	16.63	16.37	17.14	17.91	18.43	18.94	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	55.81	55.55	55.29	54.01	53.75	52.46	52.46	52.21	52.98	53.75	54.26	54.78	

Average = Sum(39)$_{1...12}$ /12= 53.94 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.78	0.78	0.77	0.75	0.75	0.73	0.73	0.73	0.74	0.75	0.76	0.76	

Average = Sum(40)$_{1...12}$ /12= 0.75 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.47 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	97.32	93.78	90.24	86.7	83.16	79.62	79.62	83.16	86.7	90.24	93.78	97.32	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1061.64 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	144.32	126.22	130.25	113.55	108.96	94.02	87.13	99.98	101.17	117.91	128.7	139.76	

Total = Sum(45)$_{1...12}$ = 1391.97 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.65	18.93	19.54	17.03	16.34	14.1	13.07	15	15.18	17.69	19.31	20.96	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.59	43.16	45.98	42.76	42.38	39.27	40.57	42.38	42.76	45.98	46.25	49.59	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	

Output from water heater (annual)$_{1...12}$ 1922.64 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.38	52.76	54.8	48.45	46.82	41.08	39.11	43.84	44.33	50.7	54.36	58.87	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.93	15.92	12.95	9.8	7.33	6.19	6.68	8.69	11.66	14.81	17.28	18.42	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.07	203.16	197.9	186.71	172.58	159.3	150.42	148.34	153.6	164.79	178.92	192.2	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	(71)

Water heating gains (Table 5)

(72)m=	81.16	78.51	73.66	67.29	62.93	57.05	52.57	58.92	61.57	68.15	75.49	79.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.43	357.87	344.78	324.07	303.11	282.81	269.96	276.22	287.1	308.02	331.97	350.02	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	411.58	461.97	532.36	632.12	717.19	724.26	682.92	605.44	515.66	435.25	396.33	391.79	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.98	0.89	0.68	0.46	0.34	0.4	0.69	0.96	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.27	20.39	20.61	20.87	20.98	21	21	21	20.99	20.8	20.49	20.25	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.27	20.27	20.28	20.29	20.3	20.31	20.31	20.32	20.31	20.3	20.29	20.28	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.87	0.63	0.41	0.29	0.34	0.63	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.28	19.46	19.78	20.15	20.28	20.31	20.31	20.32	20.3	20.07	19.62	19.27	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.54	19.71	20	20.34	20.47	20.49	20.49	20.5	20.48	20.26	19.85	19.53	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.39	19.56	19.85	20.19	20.32	20.34	20.34	20.35	20.33	20.11	19.7	19.38	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.86	0.64	0.42	0.29	0.34	0.63	0.94	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	410.11	458.08	516.06	544.16	455.8	301.01	196.39	205.95	325.2	407.31	392.84	390.76	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	842.2	814.09	737.87	609.83	463.14	301.3	196.41	206	329.97	511.1	683.88	831.59	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	321.47	239.24	165.02	47.28	5.46	0	0	0	0	77.22	209.55	327.97	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1393.22 (98)

Space heating requirement in kWh/m²/year 19.45 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	321.47	239.24	165.02	47.28	5.46	0	0	0	0	77.22	209.55	327.97	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	355.61	264.64	182.55	52.3	6.04	0	0	0	0	85.42	231.8	362.8	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1541.17 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36

Efficiency of water heater 80.3 (216)

(217)m=	86.32	85.92	84.89	82.44	80.61	80.3	80.3	80.3	80.3	83.28	85.51	86.42	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	224.65	197.14	207.61	189.61	187.73	165.99	159.03	177.28	179.24	196.8	204.6	219.11	

Total = Sum(219a)$_{1...12}$ = 2308.79 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1541.17

DER WorkSheet: New dwelling design stage

Water heating fuel used		2308.79	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	167.79		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	197.79	(231)
Electricity for lighting		316.57	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	332.89	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	498.7	(264)
Space and water heating	(261) + (262) + (263) + (264) =				831.59	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	102.65	(267)
Electricity for lighting	(232) x		0.519	=	164.3	(268)
Total CO2, kg/year		sum of (265)…(271) =			1098.54	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			15.34	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 20

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	58.62	(1a) x	2.56	(2a) =	150.07	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	58.62	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		150.07	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =		0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			7.078	x	0.12	=	0.84936			(28)
Walls Type1	37.03	16.99	20.04	x	0.16	=	3.21			(29)
Walls Type2	26.11	2.42	23.69	x	0.14	=	3.35			(29)
Total area of elements, m²			70.22							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.32 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1274.24 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.77 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 39.09 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	16.34	16.13	15.92	14.87	14.66	13.61	13.61	13.4	14.03	14.66	15.08	15.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	55.43	55.22	55.01	53.96	53.75	52.7	52.7	52.49	53.12	53.75	54.17	54.59	

Average = Sum(39)$_{1...12}$ /12= 53.91 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.95	0.94	0.94	0.92	0.92	0.9	0.9	0.9	0.91	0.92	0.92	0.93

Average = Sum(40)$_{1...12}$ /12= 0.92 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.94 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 80.33 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	88.36	85.15	81.94	78.72	75.51	72.3	72.3	75.51	78.72	81.94	85.15	88.36

Total = Sum(44)$_{1...12}$ = 963.97 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	131.04	114.61	118.27	103.11	98.93	85.37	79.11	90.78	91.86	107.06	116.86	126.91

Total = Sum(45)$_{1...12}$ = 1263.92 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.66	17.19	17.74	15.47	14.84	12.81	11.87	13.62	13.78	16.06	17.53	19.04

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	45.03	39.19	41.75	38.82	38.48	35.65	36.84	38.48	38.82	41.75	41.99	45.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94	

Output from water heater (annual)$_{1...12}$ 1745.77 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	54.83	47.91	49.76	43.99	42.52	37.3	35.51	39.8	40.25	46.04	49.36	53.45	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	15.11	13.42	10.91	8.26	6.18	5.21	5.63	7.32	9.83	12.48	14.56	15.53	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	169.45	171.21	166.78	157.35	145.44	134.25	126.77	125.01	129.44	138.88	150.79	161.98	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	(71)

Water heating gains (Table 5)

(72)m=	73.69	71.29	66.88	61.1	57.14	51.81	47.74	53.5	55.9	61.88	68.55	71.85	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	313.39	311.05	299.71	281.84	263.9	246.4	235.28	240.97	250.31	268.37	289.03	304.49	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	364.54	415.16	487.28	589.89	677.97	687.85	648.24	570.19	478.87	395.6	353.39	346.25	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.9	0.7	0.49	0.36	0.42	0.72	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.06	20.21	20.47	20.79	20.96	21	21	21	20.97	20.7	20.33	20.05	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.13	20.13	20.13	20.15	20.15	20.17	20.17	20.17	20.16	20.15	20.15	20.14	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.87	0.65	0.43	0.29	0.35	0.65	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.88	19.08	19.46	19.92	20.12	20.17	20.17	20.17	20.14	19.81	19.28	18.86	(90)

fLA = Living area ÷ (4) = 0.3 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.23	19.42	19.76	20.18	20.37	20.42	20.42	20.42	20.39	20.08	19.59	19.22	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.08	19.27	19.61	20.03	20.22	20.27	20.27	20.27	20.24	19.93	19.44	19.07	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.87	0.65	0.43	0.3	0.36	0.66	0.94	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	362.82	410.83	470.77	510.51	443.26	297.59	193.24	202.91	315.39	371.08	349.74	345.02	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	819.52	793.71	721.35	600.74	458.06	298.59	193.32	203.13	326.01	501.37	668.62	811.57	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	339.78	257.3	186.43	64.97	11.01	0	0	0	0	96.94	229.59	347.11	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1533.14 (98)

Space heating requirement in kWh/m²/year 26.15 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	339.78	257.3	186.43	64.97	11.01	0	0	0	0	96.94	229.59	347.11	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	375.87	284.62	206.23	71.87	12.18	0	0	0	0	107.24	253.98	383.97	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1695.95 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94

Efficiency of water heater 80.3 (216)

(217)m=	86.68	86.34	85.44	83.22	80.97	80.3	80.3	80.3	80.3	84	85.98	86.78	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	203.13	178.14	187.3	170.55	169.71	150.72	144.4	160.97	162.75	177.16	184.76	198.12	

Total = Sum(219a)$_{1...12}$ = 2087.71 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1695.95

DER WorkSheet: New dwelling design stage

Water heating fuel used			2087.71	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		137.31		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		167.31	(231)
Electricity for lighting			266.79	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	366.32	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	450.94	(264)
Space and water heating	(261) + (262) + (263) + (264) =				817.27	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	86.83	(267)
Electricity for lighting	(232) x		0.519	=	138.47	(268)
Total CO2, kg/year		sum of (265)…(271) =			1042.57	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			17.79	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 21

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.71	(1a) x	2.56	(2a) =	183.58	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.71	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.58	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	54.82	19.88	34.94	x	0.16	=	5.59			(29)
Walls Type2	34.97	2.42	32.55	x	0.14	=	4.6			(29)
Total area of elements, m²			89.79							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.94 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1147.31 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.4 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 46.34 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.99	19.73	19.48	18.19	17.93	16.64	16.64	16.39	17.16	17.93	18.45	18.96	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	66.33	66.07	65.82	64.53	64.27	62.98	62.98	62.73	63.5	64.27	64.79	65.3	

Average = Sum(39)$_{1...12}$ /12= 64.46 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.92	0.92	0.92	0.9	0.9	0.88	0.88	0.87	0.89	0.9	0.9	0.91

Average = Sum(40)$_{1...12}$ /12= 0.9 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.51 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	97.37	93.83	90.28	86.74	83.2	79.66	79.66	83.2	86.74	90.28	93.83	97.37

Total = Sum(44)$_{1...12}$ = 1062.17 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	144.39	126.28	130.31	113.61	109.01	94.07	87.17	100.03	101.22	117.97	128.77	139.83

Total = Sum(45)$_{1...12}$ = 1392.67 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.66	18.94	19.55	17.04	16.35	14.11	13.08	15	15.18	17.69	19.32	20.98

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.62	43.19	46.01	42.78	42.4	39.29	40.6	42.4	42.78	46.01	46.27	49.62	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45	

Output from water heater (annual)$_{1...12}$ 1923.61 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.41	52.79	54.83	48.47	46.85	41.1	39.13	43.86	44.35	50.73	54.38	58.9	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.94	15.94	12.96	9.81	7.33	6.19	6.69	8.7	11.67	14.82	17.3	18.44	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.25	203.34	198.08	186.88	172.73	159.44	150.56	148.47	153.74	164.94	179.08	192.37	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	(71)

Water heating gains (Table 5)

(72)m=	81.2	78.55	73.7	67.32	62.97	57.08	52.6	58.95	61.6	68.18	75.53	79.17	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.7	358.13	345.04	324.31	303.34	283.02	270.15	276.42	287.31	308.24	332.22	350.28	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01		(75)
Northeast	0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51		(75)
Northeast	0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53		(75)
Northeast	0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88		(75)
Northeast	0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19		(75)
Northeast	0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37		(75)
Northeast	0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08		(75)
Northeast	0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37		(75)
Northeast	0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59		(75)
Northeast	0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17		(75)
Northeast	0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05		(75)
Northeast	0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26		(75)
Northeast	0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3		(75)
Northeast	0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04		(75)
Northeast	0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19		(75)
Northeast	0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36		(75)
Northeast	0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35		(75)
Northeast	0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05		(75)
Northeast	0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72		(75)
Southeast	0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37		(77)
Southeast	0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33		(77)
Southeast	0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12		(77)
Southeast	0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93		(77)
Southeast	0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77		(77)
Southeast	0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1		(77)
Southeast	0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83		(77)
Southeast	0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49		(77)
Southeast	0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6		(77)
Southeast	0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41		(77)
Southeast	0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98		(77)
Southeast	0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28		(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	79.52	152.43	253.69	389.97	505.84	532.55	500.79	409.71	300.15	180.64	98.34	66.05	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	440.22	510.57	598.73	714.28	809.18	815.57	770.95	686.14	587.46	488.88	430.55	416.33	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.9	0.71	0.49	0.36	0.42	0.71	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.09	20.24	20.49	20.81	20.96	21	21	21	20.97	20.72	20.35	20.07	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.15	20.15	20.15	20.17	20.17	20.19	20.19	20.19	20.18	20.17	20.16	20.16	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.87	0.65	0.43	0.29	0.35	0.64	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.92	19.15	19.52	19.95	20.14	20.18	20.19	20.19	20.16	19.86	19.32	18.9	(90)

fLA = Living area ÷ (4) = 0.28 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.25	19.45	19.79	20.19	20.37	20.41	20.42	20.42	20.39	20.1	19.61	19.23	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.1	19.3	19.64	20.04	20.22	20.26	20.27	20.27	20.24	19.95	19.46	19.08	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.96	0.86	0.66	0.44	0.3	0.35	0.65	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	438.25	504.94	577.17	616.34	530.65	355.58	230.79	242.37	379.06	455.82	426.05	414.96	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	981.75	951.79	864.96	719.05	547.63	356.7	230.88	242.59	389.81	601.02	800.98	971.72	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	404.37	300.28	214.11	73.95	12.63	0	0	0	0	108.03	269.94	414.23	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1797.55 (98)

Space heating requirement in kWh/m²/year 25.07 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	404.37	300.28	214.11	73.95	12.63	0	0	0	0	108.03	269.94	414.23	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	447.31	332.17	236.85	81.8	13.97	0	0	0	0	119.5	298.61	458.22	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1988.44 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45

Efficiency of water heater 80.3 (216)

(217)m= 86.86 | 86.48 | 85.54 | 83.29 | 81 | 80.3 | 80.3 | 80.3 | 80.3 | 84.03 | 86.14 | 86.97 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 223.36 | 195.97 | 206.13 | 187.77 | 186.94 | 166.07 | 159.11 | 177.37 | 179.33 | 195.14 | 203.21 | 217.84

Total = Sum(219a)$_{1...12}$ = 2298.23 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1988.44	
Water heating fuel used		2298.23	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	184.77		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		214.77	(231)
Electricity for lighting		316.86	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	429.5	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	496.42	(264)
Space and water heating	(261) + (262) + (263) + (264) =			925.92	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	111.47	(267)
Electricity for lighting	(232) x	0.519	=	164.45	(268)
Total CO2, kg/year	sum of (265)…(271) =			1201.84	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			16.76	(273)
EI rating (section 14)				86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 22

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.7	(1a) x	2.56	(2a) =	180.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.7	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	54.73	20.19	34.54	x	0.16	=	5.53			(29)
Walls Type2	22.23	2.42	19.81	x	0.14	=	2.8			(29)
Total area of elements, m²			76.96							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 38.48 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 923.92 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 45.28 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.71	19.46	19.2	17.93	17.68	16.41	16.41	16.16	16.92	17.68	18.19	18.69	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	64.99	64.74	64.48	63.21	62.96	61.69	61.69	61.44	62.2	62.96	63.47	63.97	

Average = Sum(39)$_{1...12}$ /12= 63.15 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.92	0.92	0.91	0.89	0.89	0.87	0.87	0.87	0.88	0.89	0.9	0.9

Average = Sum(40)$_{1...12}$ /12= 0.89 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.94 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.74	93.22	89.7	86.19	82.67	79.15	79.15	82.67	86.19	89.7	93.22	96.74

Total = Sum(44)$_{1...12}$ = 1055.33 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.46	125.47	129.48	112.88	108.31	93.46	86.61	99.38	100.57	117.21	127.94	138.93

Total = Sum(45)$_{1...12}$ = 1383.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.52	18.82	19.42	16.93	16.25	14.02	12.99	14.91	15.09	17.58	19.19	20.84

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.3	42.91	45.71	42.5	42.13	39.03	40.33	42.13	42.5	45.71	45.97	49.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	

Output from water heater (annual)$_{1...12}$ 1911.23 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.03	52.45	54.48	48.16	46.55	40.84	38.88	43.58	44.07	50.4	54.03	58.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.73	15.75	12.81	9.7	7.25	6.12	6.61	8.6	11.54	14.65	17.1	18.23	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.92	200.98	195.78	184.71	170.73	157.59	148.81	146.75	151.95	163.03	177	190.14	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	(71)

Water heating gains (Table 5)

(72)m=	80.68	78.05	73.22	66.89	62.56	56.72	52.26	58.57	61.2	67.74	75.05	78.66	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	357.27	354.72	341.76	321.24	300.48	280.37	267.63	273.86	284.64	305.36	329.09	346.97	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast 0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast 0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast 0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast 0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast 0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast 0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast 0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast 0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast 0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)
Southwest 0.9x	0.77	x	8.06	x	36.79		0.55	x	0.7	=	79.12	(79)
Southwest 0.9x	0.77	x	4.62	x	36.79		0.55	x	0.7	=	90.71	(79)
Southwest 0.9x	0.77	x	8.06	x	62.67		0.55	x	0.7	=	134.78	(79)
Southwest 0.9x	0.77	x	4.62	x	62.67		0.55	x	0.7	=	154.51	(79)
Southwest 0.9x	0.77	x	8.06	x	85.75		0.55	x	0.7	=	184.41	(79)
Southwest 0.9x	0.77	x	4.62	x	85.75		0.55	x	0.7	=	211.4	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	4.62	x	106.25		0.55	x	0.7	=	261.94	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	4.62	x	119.01		0.55	x	0.7	=	293.39	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	4.62	x	118.15		0.55	x	0.7	=	291.27	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	4.62	x	113.91		0.55	x	0.7	=	280.82	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	4.62	x	104.39		0.55	x	0.7	=	257.35	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	4.62	x	92.85		0.55	x	0.7	=	228.91	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	4.62	x	69.27		0.55	x	0.7	=	170.76	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	4.62	x	44.07		0.55	x	0.7	=	108.65	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	4.62	x	31.49		0.55	x	0.7	=	77.63	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	198.2	337.61	461.93	572.36	641.09	636.45	613.61	562.33	500.17	373.13	237.4	169.62	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	555.48	692.33	803.69	893.59	941.57	916.82	881.24	836.19	784.81	678.49	566.49	516.59	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.91	0.79	0.61	0.43	0.31	0.34	0.54	0.85	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.26	20.49	20.72	20.91	20.98	21	21	21	20.99	20.89	20.54	20.22	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.15	20.15	20.16	20.17	20.18	20.19	20.19	20.19	20.18	20.18	20.17	20.16	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.89	0.75	0.56	0.38	0.25	0.28	0.48	0.81	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.17	19.5	19.83	20.08	20.16	20.19	20.19	20.19	20.18	20.06	19.6	19.13	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.47	19.77	20.07	20.31	20.38	20.41	20.41	20.41	20.4	20.28	19.85	19.42	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.32	19.62	19.92	20.16	20.23	20.26	20.26	20.26	20.25	20.13	19.7	19.27	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.89	0.75	0.56	0.38	0.26	0.28	0.48	0.8	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	547.35	661.74	713.96	667.47	530	348.57	225.72	237.18	380.34	544.97	544.89	511.25	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	975.97	952.72	865.36	711.55	537.25	349.07	225.75	237.24	382.53	600.23	799.75	964.25	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	318.89	195.54	112.64	31.73	5.39	0	0	0	0	41.11	183.5	337.04	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1225.84 (98)

Space heating requirement in kWh/m²/year 17.34 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	318.89	195.54	112.64	31.73	5.39	0	0	0	0	41.11	183.5	337.04	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	352.76	216.3	124.6	35.1	5.97	0	0	0	0	45.48	202.99	372.83	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1356.02 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23

Efficiency of water heater 80.3 (216)

(217)m=	86.31	85.43	83.97	81.85	80.61	80.3	80.3	80.3	80.3	82.15	85.19	86.5

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	223.33	197.1	208.63	189.84	186.62	165	158.09	176.23	178.17	198.32	204.15	217.61

Total = Sum(219a)$_{1...12}$ = 2303.09 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1356.02	
Water heating fuel used		2303.09	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	165.6		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		195.6	(231)
Electricity for lighting		313.18	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	292.9	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	497.47	(264)
Space and water heating	(261) + (262) + (263) + (264) =			790.37	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	101.52	(267)
Electricity for lighting	(232) x	0.519	=	162.54	(268)
Total CO2, kg/year	sum of (265)…(271) =			1054.43	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			14.91	(273)
EI rating (section 14)				88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 23

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.46	(1a) x	2.56	(2a) =	129.18	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.46	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.18	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	24.7	10.95	13.75	x	0.16	=	2.2			(29)
Walls Type2	19.12	2.42	16.7	x	0.14	=	2.36			(29)
Total area of elements, m²			43.82							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 22.47 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 517.65 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.42 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 25.89 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.07	13.89	13.71	12.8	12.62	11.71	11.71	11.53	12.07	12.62	12.98	13.34	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	39.96	39.77	39.59	38.69	38.51	37.6	37.6	37.42	37.96	38.51	38.87	39.23	

Average = Sum(39)$_{1...12}$ /12= 38.64 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.79	0.79	0.78	0.77	0.76	0.75	0.75	0.74	0.75	0.76	0.77	0.78

Average = Sum(40)$_{1...12}$ /12= 0.77 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.66 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.13	79.14	76.15	73.17	70.18	67.2	67.2	70.18	73.17	76.15	79.14	82.13

Total = Sum(44)$_{1...12}$ = 895.94 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.79	106.52	109.92	95.83	91.95	79.35	73.53	84.37	85.38	99.5	108.62	117.95

Total = Sum(45)$_{1...12}$ = 1174.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.37	13.79	11.9	11.03	12.66	12.81	14.93	16.29	17.69

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.85	36.43	38.81	36.08	35.76	33.14	34.24	35.76	36.08	38.81	39.03	41.85	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	

Output from water heater (annual)$_{1...12}$ 1622.57 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.96	44.52	46.25	40.88	39.52	34.67	33.01	37	37.41	42.79	45.87	49.68	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.24	11.76	9.57	7.24	5.41	4.57	4.94	6.42	8.62	10.94	12.77	13.61	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.43	149.97	146.09	137.82	127.39	117.59	111.04	109.5	113.38	121.65	132.08	141.88	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	(71)

Water heating gains (Table 5)

(72)m=	68.49	66.26	62.16	56.78	53.11	48.15	44.37	49.72	51.96	57.51	63.71	66.78	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.72	279.54	269.37	253.41	237.47	221.87	211.9	217.2	225.51	241.65	260.11	273.82	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	85.75	0.55	x	0.7	=	66.12	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25	0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	2.89	x	106.25	0.55	x	0.7	=	81.93	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01	0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	2.89	x	119.01	0.55	x	0.7	=	91.77	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15	0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	2.89	x	118.15	0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91	0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91	0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39	0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39	0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85	0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85	0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27	0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27	0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07	0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07	0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49	0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49	0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	107.49	183.1	250.53	310.42	347.69	345.18	332.79	304.98	271.27	202.37	128.75	91.99	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	389.21	462.65	519.9	563.82	585.17	567.04	544.69	522.18	496.78	444.02	388.86	365.81	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.91	0.78	0.6	0.42	0.3	0.33	0.52	0.83	0.97	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.44	20.62	20.8	20.94	20.99	21	21	21	21	20.93	20.67	20.41	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.26	20.26	20.27	20.28	20.29	20.3	20.3	20.3	20.29	20.29	20.28	20.27	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.89	0.75	0.56	0.38	0.26	0.28	0.47	0.79	0.96	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.52	19.78	20.03	20.22	20.28	20.3	20.3	20.3	20.29	20.22	19.87	19.49	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.82	20.05	20.28	20.46	20.51	20.53	20.53	20.53	20.52	20.45	20.14	19.79	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.67	19.9	20.13	20.31	20.36	20.38	20.38	20.38	20.37	20.3	19.99	19.64	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.98	0.95	0.89	0.75	0.57	0.38	0.26	0.29	0.48	0.79	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	382.76	441.74	462.29	421.54	330.79	217.18	142.12	148.99	237.52	350.33	371.88	361.39	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	614.16	596.66	539.78	441.45	333.52	217.31	142.13	149.01	238.17	373.59	500.84	605.72	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	172.16	104.11	57.65	14.33	2.03	0	0	0	0	17.31	92.85	181.78	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 642.23 (98)

Space heating requirement in kWh/m²/year 12.73 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	172.16	104.11	57.65	14.33	2.03	0	0	0	0	17.31	92.85	181.78	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	190.45	115.16	63.77	15.85	2.25	0	0	0	0	19.14	102.71	201.09	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 710.43 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	

Efficiency of water heater 80.3 (216)

(217)m=	85.18	84.27	82.89	81.19	80.44	80.3	80.3	80.3	80.3	81.31	83.92	85.38	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	192.12	169.64	179.43	162.48	158.77	140.08	134.21	149.61	151.26	170.1	175.94	187.17	

Total = Sum(219a)$_{1...12}$ = 1970.82 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 710.43

DER WorkSheet: New dwelling design stage

Water heating fuel used		1970.82	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.2		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	148.2	(231)
Electricity for lighting		233.89	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	153.45	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	425.7	(264)
Space and water heating	(261) + (262) + (263) + (264) =				579.15	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	76.91	(267)
Electricity for lighting	(232) x		0.519	=	121.39	(268)
Total CO2, kg/year		sum of (265)…(271) =			777.45	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			15.41	(273)
EI rating (section 14)					89	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 24

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	49.88	(1a) x	2.56	(2a) =	127.71	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	49.88	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		127.71	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	24.52	10.95	13.57	x	0.16	=	2.17			(29)
Walls Type2	18.94	2.42	16.52	x	0.14	=	2.34			(29)
Total area of elements, m²			43.46							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 22.41 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 511.5 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.41 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 25.82 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	13.91	13.73	13.55	12.65	12.47	11.58	11.58	11.4	11.94	12.47	12.83	13.19	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	39.73	39.55	39.37	38.48	38.3	37.4	37.4	37.22	37.76	38.3	38.66	39.01	

Average = Sum(39)$_{1...12}$ /12= 38.43 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.8	0.79	0.79	0.77	0.77	0.75	0.75	0.75	0.76	0.77	0.77	0.78	

Average = Sum(40)$_{1...12}$ /12= 0.77 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.69 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 74.26 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	81.69	78.72	75.74	72.77	69.8	66.83	66.83	69.8	72.77	75.74	78.72	81.69	

Total = Sum(44)$_{1...12}$ = 891.11 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	121.14	105.95	109.33	95.31	91.46	78.92	73.13	83.92	84.92	98.97	108.03	117.31	

Total = Sum(45)$_{1...12}$ = 1168.39 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	18.17	15.89	16.4	14.3	13.72	11.84	10.97	12.59	12.74	14.85	16.2	17.6	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.63	36.23	38.6	35.89	35.57	32.96	34.06	35.57	35.89	38.6	38.82	41.63	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	

Output from water heater (annual)$_{1...12}$ 1613.83 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.68	44.29	46	40.66	39.3	34.48	32.83	36.8	37.21	42.56	45.62	49.41	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.1	11.64	9.47	7.17	5.36	4.52	4.89	6.35	8.53	10.83	12.63	13.47	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	146.94	148.46	144.62	136.44	126.11	116.41	109.92	108.4	112.24	120.42	130.75	140.45	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	(71)

Water heating gains (Table 5)

(72)m=	68.12	65.9	61.83	56.48	52.83	47.89	44.13	49.46	51.68	57.2	63.37	66.42	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	279.47	277.3	267.21	251.38	235.6	220.12	210.24	215.51	223.75	239.75	258.05	271.64	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	85.75	0.55	x	0.7	=	66.12	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25	0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	2.89	x	106.25	0.55	x	0.7	=	81.93	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01	0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	2.89	x	119.01	0.55	x	0.7	=	91.77	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15	0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	2.89	x	118.15	0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91	0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91	0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39	0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39	0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85	0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85	0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27	0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27	0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07	0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07	0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49	0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49	0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	107.49	183.1	250.53	310.42	347.69	345.18	332.79	304.98	271.27	202.37	128.75	91.99	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	386.96	460.4	517.74	561.8	583.29	565.3	543.03	520.49	495.02	442.11	386.8	363.63	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.91	0.78	0.6	0.42	0.3	0.33	0.52	0.83	0.97	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.44	20.61	20.8	20.94	20.99	21	21	21	21	20.93	20.67	20.41	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.26	20.26	20.26	20.28	20.28	20.3	20.3	20.3	20.29	20.28	20.28	20.27	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.89	0.74	0.56	0.38	0.25	0.28	0.47	0.79	0.96	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.51	19.77	20.03	20.22	20.27	20.3	20.3	20.3	20.29	20.21	19.87	19.48	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.82	20.05	20.28	20.46	20.51	20.53	20.53	20.53	20.52	20.45	20.13	19.79	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.67	19.9	20.13	20.31	20.36	20.38	20.38	20.38	20.37	20.3	19.98	19.64	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.98	0.95	0.89	0.75	0.56	0.38	0.26	0.28	0.48	0.79	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	380.44	439.3	459.77	419.21	328.98	216.03	141.37	148.21	236.24	348.34	369.7	359.16	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	610.59	593.26	536.75	439.03	331.71	216.17	141.38	148.22	236.9	371.55	498.03	602.25	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	171.24	103.46	57.27	14.27	2.03	0	0	0	0	17.27	92.4	180.86	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 638.8 (98)

Space heating requirement in kWh/m²/year 12.81 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	171.24	103.46	57.27	14.27	2.03	0	0	0	0	17.27	92.4	180.86	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	189.42	114.45	63.35	15.79	2.25	0	0	0	0	19.1	102.21	200.07	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 706.64 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	

Efficiency of water heater 80.3 (216)

(217)m=	85.18	84.27	82.88	81.19	80.44	80.3	80.3	80.3	80.3	81.31	83.92	85.38	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	191.08	168.73	178.47	161.6	157.91	139.33	133.49	148.81	150.45	169.18	174.99	186.16	

Total = Sum(219a)$_{1...12}$ = 1960.19 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		706.64

DER WorkSheet: New dwelling design stage

Water heating fuel used		1960.19	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	116.85		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	146.85	(231)
Electricity for lighting		231.44	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	152.63	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	423.4	(264)
Space and water heating	(261) + (262) + (263) + (264) =				576.04	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	76.22	(267)
Electricity for lighting	(232) x		0.519	=	120.12	(268)
Total CO2, kg/year		sum of (265)…(271) =			772.37	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			15.48	(273)
EI rating (section 14)					89	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 25

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.49	(1a) x	2.56	(2a) =	129.25	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.49	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.25	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			50.498	x	0.12	=	6.05976			(28)
Walls Type1	15.41	10.95	4.46	x	0.16	=	0.71			(29)
Walls Type2	48.46	2.42	46.04	x	0.14	=	6.51			(29)
Total area of elements, m²			114.36							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.19 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 4645.8 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 2.77 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 33.96 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.08	13.89	13.71	12.81	12.63	11.72	11.72	11.54	12.08	12.63	12.99	13.35	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	48.04	47.85	47.67	46.77	46.59	45.68	45.68	45.5	46.04	46.59	46.95	47.31	

Average = Sum(39)$_{1...12}$ /12= 46.72 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.95	0.95	0.94	0.93	0.92	0.9	0.9	0.9	0.91	0.92	0.93	0.94

Average = Sum(40)$_{1...12}$ /12= 0.93 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.68 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.15	79.16	76.18	73.19	70.2	67.21	67.21	70.2	73.19	76.18	79.16	82.15

Total = Sum(44)$_{1...12}$ = 896.19 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.83	106.55	109.95	95.86	91.98	79.37	73.55	84.4	85.41	99.53	108.65	117.98

Total = Sum(45)$_{1...12}$ = 1175.05 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.38	13.8	11.91	11.03	12.66	12.81	14.93	16.3	17.7

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.86	36.44	38.82	36.09	35.77	33.15	34.25	35.77	36.09	38.82	39.04	41.86	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85	

Output from water heater (annual)$_{1...12}$ 1623.02 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.97	44.54	46.26	40.9	39.53	34.68	33.02	37.01	37.42	42.8	45.88	49.7	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.25	11.77	9.57	7.25	5.42	4.57	4.94	6.42	8.62	10.95	12.78	13.62	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.51	150.05	146.16	137.9	127.46	117.65	111.1	109.56	113.44	121.71	132.15	141.95	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	(71)

Water heating gains (Table 5)

(72)m=	68.51	66.28	62.18	56.8	53.13	48.16	44.38	49.74	51.97	57.53	63.73	66.79	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.84	279.66	269.49	253.51	237.57	221.96	211.99	217.29	225.6	241.75	260.22	273.94	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast 0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast 0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast 0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast 0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast 0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast 0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast 0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast 0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast 0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)
Southwest 0.9x	0.77	x	8.06	x	36.79		0.55	x	0.7	=	79.12	(79)
Southwest 0.9x	0.77	x	8.06	x	62.67		0.55	x	0.7	=	134.78	(79)
Southwest 0.9x	0.77	x	8.06	x	85.75		0.55	x	0.7	=	184.41	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	107.49	183.1	250.53	310.42	347.69	345.18	332.79	304.98	271.27	202.37	128.75	91.99	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	389.33	462.76	520.01	563.93	585.26	567.13	544.78	522.27	496.87	444.12	388.97	365.93	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.86	0.7	0.51	0.37	0.4	0.62	0.89	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.2	20.39	20.62	20.84	20.96	21	21	21	20.98	20.83	20.47	20.17	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.13	20.13	20.15	20.15	20.16	20.16	20.17	20.16	20.15	20.14	20.14	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.83	0.65	0.45	0.3	0.33	0.55	0.86	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.07	19.34	19.66	19.97	20.11	20.16	20.16	20.17	20.15	19.97	19.48	19.03	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.44	19.68	19.97	20.26	20.39	20.43	20.44	20.44	20.42	20.25	19.81	19.4	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.29	19.53	19.82	20.11	20.24	20.28	20.29	20.29	20.27	20.1	19.66	19.25	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.82	0.66	0.46	0.31	0.34	0.56	0.86	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	384.4	448.21	481.36	464.64	384.45	258.44	168.32	176.78	279.97	380.14	377.31	362.49	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	719.85	700.25	635.2	524.15	397.82	259.62	168.41	176.93	284.12	442.52	589.47	712.08	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	249.57	169.37	114.46	42.84	9.95	0	0	0	0	46.41	152.75	260.09	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1045.45 (98)

Space heating requirement in kWh/m²/year 20.71 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	249.57	169.37	114.46	42.84	9.95	0	0	0	0	46.41	152.75	260.09	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	276.08	187.36	126.61	47.39	11	0	0	0	0	51.34	168.98	287.72	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1156.48 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85

Efficiency of water heater 80.3 (216)

(217)m=	86.11	85.48	84.4	82.56	80.95	80.3	80.3	80.3	80.3	82.62	85.14	86.27	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	190.09	167.28	176.27	159.82	157.81	140.12	134.25	149.65	151.31	167.46	173.47	185.29	

Total = Sum(219a)$_{1...12}$ = 1952.82 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1156.48

DER WorkSheet: New dwelling design stage

Water heating fuel used		1952.82	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.27		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	148.27	(231)
Electricity for lighting		234.02	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	249.8	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	421.81	(264)
Space and water heating	(261) + (262) + (263) + (264) =				671.61	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	76.95	(267)
Electricity for lighting	(232) x		0.519	=	121.46	(268)
Total CO2, kg/year		sum of (265)…(271) =			870.01	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			17.23	(273)
EI rating (section 14)					88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 26

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.04	(1a) x	2.56	(2a) =	186.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.04	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	36.47	17.3	19.17	x	0.16	=	3.07			(29)
Walls Type2	41.48	2.42	39.06	x	0.14	=	5.52			(29)
Total area of elements, m²			77.95							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 34.92 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 989.91 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.63 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 39.54 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.36	20.1	19.84	18.53	18.26	16.95	16.95	16.69	17.48	18.26	18.79	19.31	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	59.91	59.64	59.38	58.07	57.81	56.5	56.5	56.23	57.02	57.81	58.33	58.86	

Average = Sum(39)$_{1...12}$ /12= 58 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.82	0.82	0.81	0.8	0.79	0.77	0.77	0.77	0.78	0.79	0.8	0.81

Average = Sum(40)$_{1...12}$ /12= 0.79 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.24 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.17	94.6	91.03	87.46	83.89	80.32	80.32	83.89	87.46	91.03	94.6	98.17

Total = Sum(44)$_{1...12}$ = 1070.92 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.58	127.32	131.39	114.55	109.91	94.84	87.89	100.85	102.06	118.94	129.83	140.99

Total = Sum(45)$_{1...12}$ = 1404.14 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.84	19.1	19.71	17.18	16.49	14.23	13.18	15.13	15.31	17.84	19.47	21.15

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.03	43.54	46.39	43.13	42.75	39.61	40.93	42.75	43.13	46.39	46.65	50.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	

Output from water heater (annual)$_{1...12}$ 1939.46 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.91	53.22	55.28	48.87	47.23	41.44	39.45	44.22	44.72	51.14	54.83	59.38	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.21	16.18	13.16	9.96	7.44	6.29	6.79	8.83	11.85	15.04	17.56	18.72	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.29	206.41	201.06	189.69	175.34	161.84	152.83	150.71	156.05	167.42	181.78	195.27	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	(71)

Water heating gains (Table 5)

(72)m=	81.87	79.2	74.31	67.87	63.48	57.55	53.03	59.44	62.11	68.74	76.15	79.82	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	365.13	362.54	349.29	328.29	307.03	286.45	273.42	279.74	290.77	311.97	336.26	354.57	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	169.83	289.28	395.81	490.43	549.32	545.35	525.77	481.84	428.58	319.72	203.42	145.34	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	534.96	651.83	745.1	818.72	856.35	831.79	799.19	761.58	719.35	631.69	539.67	499.91	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.92	0.8	0.62	0.43	0.31	0.34	0.54	0.85	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.36	20.55	20.76	20.93	20.99	21	21	21	21	20.91	20.61	20.33	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.24	20.24	20.24	20.26	20.26	20.28	20.28	20.28	20.27	20.26	20.25	20.25	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.91	0.76	0.57	0.39	0.26	0.29	0.49	0.81	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.38	19.67	19.96	20.19	20.25	20.28	20.28	20.28	20.27	20.17	19.76	19.35	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.65	19.91	20.18	20.39	20.45	20.47	20.47	20.48	20.47	20.37	20	19.61	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.5	19.76	20.03	20.24	20.3	20.32	20.32	20.33	20.32	20.22	19.85	19.46	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.9	0.76	0.57	0.39	0.26	0.29	0.49	0.81	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	528.41	627.29	670.84	622.78	492.12	323.04	210.33	220.72	353.09	512.21	521.41	495.61	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	910.54	886.32	803.31	658.4	497.23	323.31	210.35	220.74	354.43	556.22	743.46	898.41	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	284.31	174.06	98.56	25.65	3.8	0	0	0	0	32.74	159.88	299.68	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1078.68 (98)

Space heating requirement in kWh/m²/year 14.77 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	284.31	174.06	98.56	25.65	3.8	0	0	0	0	32.74	159.88	299.68	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	314.5	192.55	109.02	28.37	4.2	0	0	0	0	36.22	176.86	331.51	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1193.23 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01

Efficiency of water heater 80.3 (216)

(217)m=	85.99	85.1	83.63	81.58	80.52	80.3	80.3	80.3	80.3	81.81	84.8	86.18	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	227.47	200.79	212.57	193.29	189.6	167.44	160.42	178.83	180.81	202.08	208.1	221.64	

Total = Sum(219a)$_{1...12}$ = 2343.03 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1193.23

DER WorkSheet: New dwelling design stage

Water heating fuel used		2343.03	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	171.09		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	201.09	(231)
Electricity for lighting		321.63	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	257.74	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	506.09	(264)
Space and water heating	(261) + (262) + (263) + (264) =				763.83	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	104.37	(267)
Electricity for lighting	(232) x		0.519	=	166.93	(268)
Total CO2, kg/year		sum of (265)…(271) =			1035.12	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			14.17	(273)
EI rating (section 14)					88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 27

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.73	(1a) x	2.56	(2a) =	188.75	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.73	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.75	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	31.87	17.3	14.57	x	0.16	=	2.33			(29)
Walls Type2	39.15	2.42	36.73	x	0.14	=	5.2			(29)
Total area of elements, m²			71.02							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.85 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 872.08 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.64 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 38.49 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.55	20.29	20.03	18.7	18.44	17.11	17.11	16.85	17.64	18.44	18.97	19.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	59.05	58.78	58.52	57.19	56.93	55.6	55.6	55.34	56.13	56.93	57.46	57.99	

Average = Sum(39)$_{1...12}$ /12= 57.13 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.8	0.8	0.79	0.78	0.77	0.75	0.75	0.75	0.76	0.77	0.78	0.79

Average = Sum(40)$_{1...12}$ /12= 0.77 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.61 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.57	94.99	91.4	87.82	84.24	80.65	80.65	84.24	87.82	91.4	94.99	98.57

Total = Sum(44)$_{1...12}$ = 1075.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.18	127.85	131.93	115.02	110.37	95.24	88.25	101.27	102.48	119.43	130.37	141.57

Total = Sum(45)$_{1...12}$ = 1409.95 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.93	19.18	19.79	17.25	16.55	14.29	13.24	15.19	15.37	17.91	19.55	21.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.23	43.72	46.58	43.31	42.93	39.77	41.1	42.93	43.31	46.58	46.84	50.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8	

Output from water heater (annual)$_{1...12}$ 1947.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.16	53.44	55.51	49.07	47.43	41.61	39.62	44.4	44.9	51.35	55.06	59.63	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.35	16.3	13.26	10.04	7.5	6.33	6.84	8.89	11.94	15.16	17.69	18.86	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.84	207.98	202.59	191.13	176.67	163.07	153.99	151.86	157.24	168.7	183.16	196.76	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	(71)

Water heating gains (Table 5)

(72)m=	82.21	79.53	74.61	68.15	63.75	57.79	53.25	59.68	62.36	69.03	76.47	80.15	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.4	364.8	351.46	330.32	308.91	288.2	275.08	281.43	292.54	313.88	338.32	356.76	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	169.83	289.28	395.81	490.43	549.32	545.35	525.77	481.84	428.58	319.72	203.42	145.34	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	537.23	654.08	747.27	820.75	858.24	833.54	800.86	763.27	721.12	633.6	541.74	502.1	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.92	0.79	0.61	0.43	0.31	0.33	0.53	0.84	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.38	20.58	20.78	20.94	20.99	21	21	21	21	20.92	20.63	20.35	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.25	20.26	20.26	20.27	20.28	20.29	20.29	20.3	20.29	20.28	20.27	20.27	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.9	0.75	0.56	0.38	0.26	0.28	0.48	0.81	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.44	19.72	20	20.21	20.27	20.29	20.29	20.3	20.28	20.2	19.81	19.4	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.69	19.95	20.21	20.41	20.46	20.48	20.48	20.49	20.48	20.39	20.03	19.66	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.54	19.8	20.06	20.26	20.31	20.33	20.33	20.34	20.33	20.24	19.88	19.51	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.9	0.75	0.57	0.38	0.26	0.29	0.48	0.8	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	530.56	628.78	670.23	618.14	486.12	318.59	207.6	217.8	348.47	509.51	522.85	497.74	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	899.95	875.77	793.43	649.56	490.36	318.8	207.61	217.82	349.54	548.91	734.34	887.61	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	274.83	165.98	91.66	22.62	3.15	0	0	0	0	29.31	152.27	290.06	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1029.88 (98)

Space heating requirement in kWh/m²/year 13.97 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	274.83	165.98	91.66	22.62	3.15	0	0	0	0	29.31	152.27	290.06	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	304.01	183.6	101.39	25.02	3.49	0	0	0	0	32.43	168.44	320.87	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1139.25 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8

Efficiency of water heater 80.3 (216)

(217)m=	85.9	84.97	83.46	81.44	80.48	80.3	80.3	80.3	80.3	81.67	84.67	86.09	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	228.66	201.93	213.88	194.42	190.47	168.13	161.08	179.57	181.55	203.27	209.29	222.79	

Total = Sum(219a)$_{1...12}$ = 2355.04 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1139.25

DER WorkSheet: New dwelling design stage

Water heating fuel used		2355.04	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	172.7		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	202.7	(231)
Electricity for lighting		324.08	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	246.08	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	508.69	(264)
Space and water heating	(261) + (262) + (263) + (264) =				754.77	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	105.2	(267)
Electricity for lighting	(232) x		0.519	=	168.2	(268)
Total CO2, kg/year		sum of (265)…(271) =			1028.17	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			13.95	(273)
EI rating (section 14)					88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 28

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	58.88	(1a) x	2.56	(2a) =	150.74	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	58.88	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		150.74	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			6.686	x	0.12	=	0.8023199			(28)
Walls Type1	31.19	15.57	15.62	x	0.16	=	2.5			(29)
Walls Type2	39.09	2.42	36.67	x	0.14	=	5.19			(29)
Total area of elements, m²			76.96							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 32.52 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1390.28 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.41 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 37.93 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	16.42	16.2	15.99	14.94	14.72	13.67	13.67	13.46	14.09	14.72	15.15	15.57	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	54.35	54.13	53.92	52.87	52.65	51.6	51.6	51.39	52.02	52.65	53.08	53.5	

Average = Sum(39)$_{1...12}$ /12= 52.81 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.92	0.92	0.92	0.9	0.89	0.88	0.88	0.87	0.88	0.89	0.9	0.91

Average = Sum(40)$_{1...12}$ /12= 0.9 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.95 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 80.51 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	88.56	85.34	82.12	78.9	75.68	72.46	72.46	75.68	78.9	82.12	85.34	88.56

Total = Sum(44)$_{1...12}$ = 966.12 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	131.33	114.86	118.53	103.34	99.15	85.56	79.29	90.98	92.07	107.3	117.12	127.19

Total = Sum(45)$_{1...12}$ = 1266.73 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.7	17.23	17.78	15.5	14.87	12.83	11.89	13.65	13.81	16.09	17.57	19.08

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	45.13	39.28	41.85	38.91	38.57	35.73	36.92	38.57	38.91	41.85	42.09	45.13	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32	

Output from water heater (annual)$_{1...12}$ 1749.66 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	54.95	48.01	49.87	44.09	42.61	37.38	35.59	39.89	40.34	46.14	49.47	53.57	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	15.17	13.47	10.96	8.29	6.2	5.23	5.66	7.35	9.87	12.53	14.62	15.59	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	170.12	171.89	167.44	157.97	146.01	134.78	127.27	125.51	129.95	139.42	151.38	162.62	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	(71)

Water heating gains (Table 5)

(72)m=	73.86	71.45	67.03	61.23	57.27	51.92	47.84	53.62	56.03	62.01	68.7	72.01	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	314.39	312.05	300.68	282.74	264.73	247.18	236.02	241.72	251.1	269.21	289.95	305.46	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast	0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)
Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast	0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast	0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast	0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast	0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast	0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast	0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast	0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast	0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast	0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)
Southeast	0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	152.85	260.36	356.23	441.39	494.39	490.81	473.2	433.65	385.72	287.75	183.08	130.81	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	467.24	572.41	656.9	724.13	759.12	737.99	709.21	675.38	636.82	556.96	473.03	436.26	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.92	0.8	0.63	0.45	0.32	0.35	0.56	0.85	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.26	20.47	20.71	20.9	20.98	21	21	21	20.99	20.88	20.54	20.22	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.15	20.15	20.15	20.17	20.17	20.19	20.19	20.19	20.18	20.17	20.17	20.16	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.9	0.76	0.58	0.39	0.26	0.29	0.49	0.81	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.17	19.48	19.8	20.07	20.16	20.19	20.19	20.19	20.18	20.05	19.59	19.13	(90)

fLA = Living area ÷ (4) = 0.34 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.54	19.82	20.11	20.35	20.43	20.46	20.46	20.46	20.45	20.33	19.91	19.5	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.39	19.67	19.96	20.2	20.28	20.31	20.31	20.31	20.3	20.18	19.76	19.35	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.9	0.77	0.59	0.4	0.27	0.3	0.5	0.81	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	460.29	548.48	589.41	554.53	444.34	294.08	191.47	201.04	320.32	453.69	455.33	431.59	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	820.12	799.42	725.69	597.26	451.95	294.64	191.51	201.1	322.62	504.36	671.92	810.5	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	267.71	168.63	101.4	30.77	5.66	0	0	0	0	37.7	155.95	281.91	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1049.73 (98)

Space heating requirement in kWh/m²/year 17.83 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	267.71	168.63	101.4	30.77	5.66	0	0	0	0	37.7	155.95	281.91	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	296.14	186.54	112.17	34.04	6.27	0	0	0	0	41.7	172.51	311.85	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1161.21 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32

Efficiency of water heater 80.3 (216)

(217)m= 86.1 | 85.28 | 83.93 | 81.93 | 80.66 | 80.3 | 80.3 | 80.3 | 80.3 | 82.15 | 85 | 86.28 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 204.96 | 180.76 | 191.08 | 173.62 | 170.75 | 151.05 | 144.72 | 161.33 | 163.11 | 181.55 | 187.31 | 199.71

Total = Sum(219a)$_{1...12}$ = 2109.95 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1161.21	
Water heating fuel used		2109.95	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	137.93		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		167.93	(231)
Electricity for lighting		267.84	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	250.82	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	455.75	(264)
Space and water heating	(261) + (262) + (263) + (264) =			706.57	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	87.15	(267)
Electricity for lighting	(232) x	0.519	=	139.01	(268)
Total CO2, kg/year	sum of (265)…(271) =			932.73	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			15.84	(273)
EI rating (section 14)				88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 29

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.42	(1a) x	2.56	(2a) =	187.95	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.42	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.95	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Windows Type 4			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	52.48	23.08	29.4	x	0.16	=	4.7			(29)
Walls Type2	22.71	2.42	20.29	x	0.14	=	2.87			(29)
Total area of elements, m²			75.19							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 41.56 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 844.75 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.24 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 48.81 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.47	20.2	19.94	18.62	18.36	17.04	17.04	16.78	17.57	18.36	18.89	19.41	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	69.27	69.01	68.75	67.43	67.16	65.85	65.85	65.58	66.37	67.16	67.69	68.22	

Average = Sum(39)$_{1...12}$ /12= 67.36 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.94	0.94	0.94	0.92	0.91	0.9	0.9	0.89	0.9	0.91	0.92	0.93

Average = Sum(40)$_{1...12}$ /12= 0.92 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.45 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.39	94.81	91.24	87.66	84.08	80.5	80.5	84.08	87.66	91.24	94.81	98.39

Total = Sum(44)$_{1...12}$ = 1073.36 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.91	127.61	131.69	114.81	110.16	95.06	88.09	101.08	102.29	119.21	130.12	141.31

Total = Sum(45)$_{1...12}$ = 1407.34 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.89	19.14	19.75	17.22	16.52	14.26	13.21	15.16	15.34	17.88	19.52	21.2

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.14	43.64	46.49	43.23	42.85	39.7	41.02	42.85	43.23	46.49	46.76	50.14	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	

Output from water heater (annual)$_{1...12}$ 1943.87 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.05	53.34	55.41	48.98	47.34	41.53	39.54	44.32	44.82	51.26	54.96	59.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.29	16.24	13.21	10	7.48	6.31	6.82	8.86	11.9	15.11	17.63	18.8	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.14	207.27	201.9	190.48	176.07	162.52	153.47	151.34	156.7	168.12	182.54	196.09	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	(71)

Water heating gains (Table 5)

(72)m=	82.06	79.38	74.47	68.03	63.63	57.68	53.15	59.57	62.25	68.9	76.33	80	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	366.38	363.78	350.48	329.41	308.07	287.41	274.33	280.67	291.74	313.02	337.39	355.78	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast	0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast	0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast	0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast	0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast	0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast	0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast	0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast	0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast	0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast	0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast	0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)
Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)
Southwest	0.9x	0.77	x	2.89	x	36.79		0.55	x	0.7	=	28.37	(79)
Southwest	0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	48.33	(79)
Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	66.12	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	81.93	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	91.77	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	44.07	0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49	0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	206.9	355.32	493.84	624.75	711.52	711.54	683.85	618.33	539.05	394.77	248.35	176.72	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	573.28	719.1	844.32	954.16	1019.59	998.95	958.18	899	830.79	707.79	585.74	532.5	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.92	0.78	0.6	0.42	0.3	0.34	0.54	0.85	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.22	20.45	20.7	20.91	20.98	21	21	21	20.99	20.87	20.51	20.18	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.13	20.13	20.14	20.15	20.15	20.17	20.17	20.17	20.16	20.15	20.15	20.14	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.9	0.74	0.55	0.37	0.25	0.28	0.48	0.81	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.1	19.44	19.79	20.06	20.14	20.17	20.17	20.17	20.16	20.03	19.53	19.05	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.38	19.69	20.01	20.27	20.35	20.38	20.38	20.38	20.37	20.24	19.78	19.33	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.23	19.54	19.86	20.12	20.2	20.23	20.23	20.23	20.22	20.09	19.63	19.18	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.89	0.74	0.55	0.37	0.25	0.28	0.49	0.81	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	565.31	688.56	751.06	708.61	563.37	369.97	238.83	251.1	403.44	573.02	564.64	527.29	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1034.23	1010.32	918.77	756.52	570.97	370.49	238.86	251.17	406.05	637.21	847.95	1022.15	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	348.87	216.22	124.78	34.49	5.66	0	0	0	0	47.76	203.98	368.18	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1349.95 (98)

Space heating requirement in kWh/m²/year 18.39 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

DER WorkSheet: New dwelling design stage

Fraction of space heat from main system(s)	(202) = 1 – (201) =	1 (202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1 (204)
Efficiency of main space heating system 1		90.4 (206)
Efficiency of secondary/supplementary heating system, %		0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	348.87	216.22	124.78	34.49	5.66	0	0	0	0	47.76	203.98	368.18	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)	385.92	239.18	138.03	38.16	6.26	0	0	0	0	52.83	225.64	407.28	(211)

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 1493.31 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Output from water heater (calculated above)	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45
Efficiency of water heater												80.3 (216)
(217)m=	86.49	85.64	84.17	81.94	80.62	80.3	80.3	80.3	80.3	82.36	85.41	86.67 (217)
Fuel for water heating, kWh/month (219)m = (64)m x 100 ÷ (217)m												
(219)m=	226.68	199.97	211.68	192.87	189.78	167.82	160.79	179.24	181.22	201.19	207.1	220.89

Total = Sum(219a)$_{1...12}$ = 2339.23 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1493.31
Water heating fuel used		2339.23
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	171.97	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		201.97 (231)
Electricity for lighting		322.98 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216 =	322.55 (261)
Space heating (secondary)	(215) x	0.519 =	0 (263)
Water heating	(219) x	0.216 =	505.27 (264)
Space and water heating	(261) + (262) + (263) + (264) =		827.83 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519 =	104.82 (267)
Electricity for lighting	(232) x	0.519 =	167.63 (268)

DER WorkSheet: New dwelling design stage

Total CO2, kg/year	sum of (265)…(271) =	1100.28	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =	14.99	(273)
EI rating (section 14)		88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 30

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	72.68	(1a) x	2.56	(2a) =	186.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	72.68	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	55.67	20.19	35.48	x	0.16	=	5.68			(29)
Walls Type2	22.71	2.42	20.29	x	0.14	=	2.87			(29)
Total area of elements, m²			78.38							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 38.7 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 948.04 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.84 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 44.54 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.26	20	19.74	18.43	18.17	16.87	16.87	16.61	17.39	18.17	18.7	19.22	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	64.8	64.54	64.28	62.97	62.71	61.41	61.41	61.15	61.93	62.71	63.23	63.76	

Average = Sum(39)$_{1...12}$ /12= 62.91 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.89	0.89	0.88	0.87	0.86	0.84	0.84	0.84	0.85	0.86	0.87	0.88	

Average = Sum(40)$_{1...12}$ /12= 0.87 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.31 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.05 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	97.95	94.39	90.83	87.26	83.7	80.14	80.14	83.7	87.26	90.83	94.39	97.95	

Total = Sum(44)$_{1...12}$ = 1068.55 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	145.26	127.04	131.1	114.29	109.67	94.63	87.69	100.63	101.83	118.67	129.54	140.67	

Total = Sum(45)$_{1...12}$ = 1401.04 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.79	19.06	19.66	17.14	16.45	14.2	13.15	15.09	15.27	17.8	19.43	21.1	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.91	43.44	46.28	43.03	42.65	39.52	40.84	42.65	43.03	46.28	46.55	49.91	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59	

Output from water heater (annual)$_{1...12}$ 1935.17 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.78	53.1	55.16	48.76	47.13	41.35	39.37	44.12	44.62	51.03	54.71	59.25	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.14	16.11	13.1	9.92	7.41	6.26	6.76	8.79	11.8	14.98	17.49	18.64	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	203.46	205.57	200.25	188.92	174.63	161.19	152.21	150.1	155.42	166.75	181.05	194.48	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	(71)

Water heating gains (Table 5)

(72)m=	81.69	79.02	74.14	67.72	63.34	57.43	52.91	59.3	61.97	68.59	75.99	79.64	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	363.93	361.34	348.13	327.21	306.03	285.51	272.53	278.84	289.83	310.96	335.16	353.41	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)
Northwest 0.9x	0.77	x	8.06	x	11.28	x	0.55	x	0.7	=	24.26	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	8.06	x	22.97	x	0.55	x	0.7	=	49.39	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	8.06	x	41.38	x	0.55	x	0.7	=	88.98	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	8.06	x	67.96	x	0.55	x	0.7	=	146.14	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	8.06	x	91.35	x	0.55	x	0.7	=	196.43	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	8.06	x	97.38	x	0.55	x	0.7	=	209.42	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	8.06	x	91.1	x	0.55	x	0.7	=	195.91	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	8.06	x	72.63	x	0.55	x	0.7	=	156.18	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	8.06	x	50.42	x	0.55	x	0.7	=	108.43	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	8.06	x	28.07	x	0.55	x	0.7	=	60.36	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	8.06	x	14.2	x	0.55	x	0.7	=	30.53	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	8.06	x	9.21	x	0.55	x	0.7	=	19.81	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	80.45	154.33	257.11	395.59	513.39	540.6	508.33	415.72	304.32	182.96	99.51	66.81	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	444.38	515.68	605.25	722.8	819.42	826.12	780.86	694.56	594.15	493.92	434.67	420.22	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.89	0.69	0.47	0.35	0.4	0.69	0.95	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.13	20.29	20.54	20.83	20.97	21	21	21	20.98	20.75	20.39	20.11	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.17	20.18	20.18	20.2	20.2	20.21	20.21	20.22	20.21	20.2	20.19	20.19	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.86	0.64	0.42	0.28	0.34	0.62	0.93	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.01	19.23	19.6	20.01	20.17	20.21	20.21	20.22	20.19	19.92	19.4	18.99	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.29	19.5	19.83	20.22	20.38	20.41	20.41	20.41	20.39	20.13	19.65	19.28	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.14	19.35	19.68	20.07	20.23	20.26	20.26	20.26	20.24	19.98	19.5	19.13	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.96	0.85	0.64	0.42	0.29	0.34	0.63	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	442.37	509.79	581.99	615.67	521.83	346.91	224.87	236.18	372.27	457.93	429.96	418.83	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	961.94	932.56	847.41	703.4	534.64	347.65	224.92	236.33	380.32	588.15	784.2	951.57	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	386.56	284.1	197.47	63.17	9.54	0	0	0	0	96.88	255.06	396.37	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1689.14 (98)

Space heating requirement in kWh/m²/year 23.24 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	386.56	284.1	197.47	63.17	9.54	0	0	0	0	96.88	255.06	396.37	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	427.61	314.27	218.44	69.87	10.55	0	0	0	0	107.17	282.14	438.46	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1868.52 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59

Efficiency of water heater 80.3 (216)

(217)m= 86.74 | 86.33 | 85.32 | 82.96 | 80.83 | 80.3 | 80.3 | 80.3 | 80.3 | 83.76 | 85.98 | 86.85 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 225.01 | 197.49 | 207.9 | 189.66 | 188.44 | 167.07 | 160.07 | 178.43 | 180.41 | 196.94 | 204.8 | 219.44

Total = Sum(219a)$_{1...12}$ = 2315.64 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1868.52	
Water heating fuel used		2315.64	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	170.24		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		200.24	(231)
Electricity for lighting		320.33	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	403.6	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	500.18	(264)
Space and water heating	(261) + (262) + (263) + (264) =			903.78	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	103.92	(267)
Electricity for lighting	(232) x	0.519	=	166.25	(268)
Total CO2, kg/year	sum of (265)…(271) =			1173.95	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			16.15	(273)
EI rating (section 14)				87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 31

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	66.61	(1a) x	2.56	(2a) =	170.53	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	66.61	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		170.53	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x	1/[1/(1.4)+ 0.04]	=	10.69			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	31.65	14.38	17.27	x	0.16	=	2.76			(29)
Walls Type2	32.4	2.42	29.98	x	0.14	=	4.24			(29)
Total area of elements, m²			64.05							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 29.46 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 803.18 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.17 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 33.63 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	18.57	18.33	18.09	16.9	16.66	15.46	15.46	15.22	15.94	16.66	17.14	17.61	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	52.2	51.96	51.72	50.53	50.29	49.09	49.09	48.85	49.57	50.29	50.77	51.24	

Average = Sum(39)$_{1...12}$ /12= 50.47 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.78	0.78	0.78	0.76	0.75	0.74	0.74	0.73	0.74	0.75	0.76	0.77

Average = Sum(40)$_{1...12}$ /12= 0.76 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.16 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 85.53 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	94.08	90.66	87.24	83.82	80.4	76.98	76.98	80.4	83.82	87.24	90.66	94.08

Total = Sum(44)$_{1...12}$ = 1026.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	139.52	122.03	125.92	109.78	105.34	90.9	84.23	96.65	97.81	113.99	124.43	135.12

Total = Sum(45)$_{1...12}$ = 1345.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	20.93	18.3	18.89	16.47	15.8	13.63	12.63	14.5	14.67	17.1	18.66	20.27

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.94	41.73	44.46	41.34	40.97	37.96	39.23	40.97	41.34	44.46	44.71	47.94	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06	

Output from water heater (annual)$_{1...12}$ 1858.74 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	58.38	51.01	52.98	46.84	45.27	39.71	37.81	42.38	42.86	49.01	52.55	56.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.89	15	12.2	9.24	6.91	5.83	6.3	8.19	10.99	13.95	16.29	17.36	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	189.27	191.24	186.29	175.75	162.45	149.95	141.6	139.63	144.58	155.12	168.42	180.92	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	(71)

Water heating gains (Table 5)

(72)m=	78.46	75.9	71.21	65.05	60.84	55.16	50.82	56.96	59.52	65.88	72.98	76.5	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	343.05	340.56	328.12	308.46	288.62	269.35	257.14	263.2	273.51	293.37	316.11	333.2	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	8.06	x	11.28	x	0.55	x	0.7	=	24.26	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	8.06	x	22.97	x	0.55	x	0.7	=	49.39	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	8.06	x	41.38	x	0.55	x	0.7	=	88.98	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	8.06	x	67.96	x	0.55	x	0.7	=	146.14	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	8.06	x	91.35	x	0.55	x	0.7	=	196.43	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	8.06	x	97.38	x	0.55	x	0.7	=	209.42	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	8.06	x	91.1	x	0.55	x	0.7	=	195.91	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	8.06	x	72.63	x	0.55	x	0.7	=	156.18	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	8.06	x	50.42	x	0.55	x	0.7	=	108.43	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	8.06	x	28.07	x	0.55	x	0.7	=	60.36	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	8.06	x	14.2	x	0.55	x	0.7	=	30.53	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	8.06	x	9.21	x	0.55	x	0.7	=	19.81	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	43.29	88.12	158.76	260.72	350.46	373.63	349.52	278.64	193.45	107.68	54.47	35.35	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	386.33	428.67	486.88	569.18	639.08	642.99	606.66	541.85	466.96	401.06	370.58	368.55	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.98	0.91	0.71	0.49	0.36	0.41	0.71	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.27	20.38	20.59	20.85	20.98	21	21	21	20.98	20.79	20.49	20.25	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.27	20.27	20.27	20.29	20.29	20.31	20.31	20.31	20.3	20.29	20.29	20.28	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.88	0.66	0.44	0.3	0.35	0.65	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.28	19.45	19.75	20.13	20.27	20.31	20.31	20.31	20.29	20.05	19.62	19.27	(90)

fLA = Living area ÷ (4) = 0.37 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.64	19.79	20.06	20.39	20.53	20.56	20.56	20.56	20.55	20.32	19.94	19.63	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.49	19.64	19.91	20.24	20.38	20.41	20.41	20.41	20.4	20.17	19.79	19.48	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.88	0.67	0.44	0.31	0.36	0.66	0.94	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	384.95	425.27	473.73	500.65	427.01	284.86	187.13	196.03	306.2	377.53	367.39	367.56	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	792.9	765.85	693.46	573.13	436.58	285.29	187.15	196.1	312.04	481.38	644.07	783	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	303.51	228.87	163.48	52.18	7.11	0	0	0	0	77.27	199.21	309.09	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1340.72 (98)

Space heating requirement in kWh/m²/year 20.13 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	303.51	228.87	163.48	52.18	7.11	0	0	0	0	77.27	199.21	309.09	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	335.74	253.18	180.84	57.72	7.87	0	0	0	0	85.47	220.36	341.91	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1483.1 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06

Efficiency of water heater 80.3 (216)

(217)m=	86.26	85.89	84.95	82.67	80.72	80.3	80.3	80.3	80.3	83.35	85.46	86.36	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	217.33	190.65	200.57	182.79	181.26	160.47	153.74	171.39	173.28	190.09	197.9	211.98	

Total = Sum(219a)$_{1...12}$ = 2231.44 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1483.1

DER WorkSheet: New dwelling design stage

Water heating fuel used		2231.44	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	156.04		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	186.04	(231)
Electricity for lighting		298.32	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	320.35	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	481.99	(264)
Space and water heating	(261) + (262) + (263) + (264) =				802.34	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	96.55	(267)
Electricity for lighting	(232) x		0.519	=	154.83	(268)
Total CO2, kg/year		sum of (265)…(271) =			1053.73	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			15.82	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 32

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.61	(1a) x	2.56	(2a) =	132.12	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.61	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		132.12	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	25.19	9.48	15.71	x	0.16	=	2.51			(29)
Walls Type2	25.13	2.42	22.71	x	0.14	=	3.21			(29)
Total area of elements, m²			50.32							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 21.68 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 653.12 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.36 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 25.04 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.39	14.2	14.02	13.09	12.91	11.98	11.98	11.79	12.35	12.91	13.28	13.65	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	39.43	39.24	39.05	38.13	37.94	37.02	37.02	36.83	37.39	37.94	38.31	38.68	

Average = Sum(39)$_{1...12}$ /12= 38.08 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.76	0.76	0.76	0.74	0.74	0.72	0.72	0.71	0.72	0.74	0.74	0.75

Average = Sum(40)$_{1...12}$ /12= 0.74 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.47 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	83.01	79.99	76.98	73.96	70.94	67.92	67.92	70.94	73.96	76.98	79.99	83.01

Total = Sum(44)$_{1...12}$ = 905.59 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	123.1	107.67	111.1	96.86	92.94	80.2	74.32	85.28	86.3	100.58	109.79	119.22

Total = Sum(45)$_{1...12}$ = 1187.37 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.47	16.15	16.67	14.53	13.94	12.03	11.15	12.79	12.95	15.09	16.47	17.88

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.3	36.82	39.23	36.47	36.15	33.49	34.61	36.15	36.47	39.23	39.45	42.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52	

Output from water heater (annual)$_{1...12}$ 1640.04 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.51	45	46.75	41.32	39.94	35.04	33.36	37.39	37.81	43.25	46.37	50.22	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.74	12.21	9.93	7.52	5.62	4.74	5.12	6.66	8.94	11.35	13.25	14.13	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.41	152.98	149.02	140.59	129.95	119.95	113.27	111.7	115.66	124.09	134.73	144.73	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	(71)

Water heating gains (Table 5)

(72)m=	69.23	66.97	62.83	57.4	53.68	48.67	44.84	50.26	52.52	58.13	64.4	67.5	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	286.45	284.22	273.84	257.57	241.32	225.43	215.3	220.68	229.18	245.63	264.44	278.41	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	9.51	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	19.36	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	34.89	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	57.29	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	77.01	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	82.11	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	76.81	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	61.23	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	42.51	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	23.66	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	11.97	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	7.77	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	28.54	58.09	104.66	171.88	231.04	246.32	230.42	183.7	127.53	70.99	35.91	23.31	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	314.98	342.31	378.5	429.45	472.36	471.74	445.73	404.38	356.71	316.62	300.35	301.72	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.91	0.72	0.5	0.37	0.42	0.7	0.95	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.33	20.43	20.62	20.86	20.98	21	21	21	20.99	20.82	20.54	20.32	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.28	20.29	20.29	20.31	20.31	20.33	20.33	20.33	20.32	20.31	20.3	20.3	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.88	0.68	0.45	0.31	0.36	0.64	0.93	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.38	19.53	19.8	20.15	20.29	20.32	20.33	20.33	20.31	20.1	19.7	19.37	(90)

fLA = Living area ÷ (4) = 0.47 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.83	19.96	20.19	20.49	20.62	20.64	20.65	20.65	20.63	20.44	20.1	19.82	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.68	19.81	20.04	20.34	20.47	20.49	20.5	20.5	20.48	20.29	19.95	19.67	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.89	0.69	0.46	0.32	0.37	0.66	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	313.49	339.08	367.84	380.31	324.54	217.81	144.17	150.83	234.36	295.85	297.01	300.61	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	606.26	584.92	528.78	436.01	332.58	218.19	144.19	150.89	238.54	367.69	492.33	598.42	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	217.82	165.2	119.74	40.1	5.99	0	0	0	0	53.45	140.63	221.56	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 964.49 (98)

Space heating requirement in kWh/m²/year 18.69 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	217.82	165.2	119.74	40.1	5.99	0	0	0	0	53.45	140.63	221.56	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	240.95	182.75	132.46	44.36	6.62	0	0	0	0	59.13	155.56	245.09	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1066.92 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52

Efficiency of water heater 80.3 (216)

(217)m=	85.75	85.39	84.48	82.43	80.7	80.3	80.3	80.3	80.3	82.86	84.9	85.85	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	192.91	169.21	177.94	161.76	159.97	141.59	135.65	151.22	152.89	168.72	175.77	188.15	

Total = Sum(219a)$_{1...12}$ = 1975.78 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1066.92

DER WorkSheet: New dwelling design stage

Water heating fuel used		1975.78	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	120.89		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	150.89	(231)
Electricity for lighting		242.71	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	230.45	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	426.77	(264)
Space and water heating	(261) + (262) + (263) + (264) =				657.22	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	78.31	(267)
Electricity for lighting	(232) x		0.519	=	125.97	(268)
Total CO2, kg/year		sum of (265)…(271) =			861.5	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			16.69	(273)
EI rating (section 14)					88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 33

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.63	(1a) x	2.56	(2a) =	129.62	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.62	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	24.86	9.48	15.38	x	0.16	=	2.46			(29)
Walls Type2	19.11	2.42	16.69	x	0.14	=	2.36			(29)
Total area of elements, m²			43.97							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 20.78 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 545.17 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.3 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 24.08 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.12	13.93	13.75	12.84	12.66	11.75	11.75	11.57	12.12	12.66	13.02	13.39	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	38.19	38.01	37.83	36.92	36.74	35.83	35.83	35.65	36.19	36.74	37.1	37.47	

Average = Sum(39)$_{1...12}$ /12= 36.88 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.75	0.75	0.75	0.73	0.73	0.71	0.71	0.7	0.71	0.73	0.73	0.74	

Average = Sum(40)$_{1...12}$ /12= 0.73 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.71 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.78 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	82.26	79.27	76.28	73.29	70.29	67.3	67.3	70.29	73.29	76.28	79.27	82.26	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 897.38 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	121.99	106.69	110.1	95.98	92.1	79.48	73.65	84.51	85.52	99.66	108.79	118.14	

Total = Sum(45)$_{1...12}$ = 1176.6 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	18.3	16	16.51	14.4	13.81	11.92	11.05	12.68	12.83	14.95	16.32	17.72	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.92	36.49	38.87	36.14	35.82	33.19	34.3	35.82	36.14	38.87	39.09	41.92	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06	

Output from water heater (annual)$_{1...12}$ 1625.17 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.04	44.6	46.32	40.95	39.58	34.72	33.06	37.05	37.47	42.86	45.95	49.76	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.48	11.97	9.73	7.37	5.51	4.65	5.02	6.53	8.77	11.13	12.99	13.85	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.87	150.42	146.52	138.24	127.78	117.94	111.37	109.83	113.72	122.01	132.47	142.3	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	(71)

Water heating gains (Table 5)

(72)m=	68.6	66.36	62.26	56.88	53.2	48.23	44.44	49.8	52.04	57.6	63.81	66.88	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	282.58	280.38	270.15	254.11	238.11	222.45	212.47	217.8	226.16	242.37	260.91	274.67	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	9.51	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	19.36	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	34.89	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	57.29	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	77.01	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	82.11	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	76.81	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	61.23	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	42.51	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	23.66	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	11.97	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	7.77	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	28.54	58.09	104.66	171.88	231.04	246.32	230.42	183.7	127.53	70.99	35.91	23.31	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	311.12	338.47	374.81	425.99	469.15	468.77	442.89	401.49	353.69	313.36	296.82	297.97	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.9	0.71	0.49	0.36	0.41	0.69	0.95	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.35	20.45	20.64	20.87	20.98	21	21	21	20.99	20.83	20.56	20.33	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.29	20.3	20.3	20.32	20.32	20.33	20.33	20.34	20.33	20.32	20.31	20.31	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.88	0.66	0.44	0.3	0.35	0.63	0.93	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.41	19.56	19.84	20.17	20.3	20.33	20.33	20.34	20.32	20.12	19.73	19.41	(90)

fLA = Living area ÷ (4) = 0.48 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.86	19.99	20.22	20.51	20.63	20.66	20.66	20.66	20.64	20.47	20.13	19.85	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.71	19.84	20.07	20.36	20.48	20.51	20.51	20.51	20.49	20.32	19.98	19.7	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.99	0.97	0.88	0.67	0.45	0.32	0.36	0.64	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	309.56	335.07	363.44	373.7	315.92	211.29	139.93	146.38	227.93	291.33	293.3	296.83	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	588.68	567.97	513.48	423.15	322.55	211.58	139.95	146.42	231.38	356.94	477.94	580.91	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	207.66	156.51	111.63	35.6	4.94	0	0	0	0	48.81	132.94	211.36	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 909.45 (98)

Space heating requirement in kWh/m²/year 17.96 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	207.66	156.51	111.63	35.6	4.94	0	0	0	0	48.81	132.94	211.36	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	229.71	173.13	123.48	39.38	5.46	0	0	0	0	54	147.06	233.8	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1006.03 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06

Efficiency of water heater 80.3 (216)

(217)m=	85.65	85.28	84.34	82.25	80.63	80.3	80.3	80.3	80.3	82.71	84.78	85.75	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	191.37	167.9	176.63	160.64	158.64	140.31	134.42	149.85	151.51	167.5	174.42	186.65	

Total = Sum(219a)$_{1...12}$ = 1959.84 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1006.03

DER WorkSheet: New dwelling design stage

Water heating fuel used		1959.84	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.6		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	148.6	(231)
Electricity for lighting		237.98	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	217.3	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	423.33	(264)
Space and water heating	(261) + (262) + (263) + (264) =				640.63	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	77.12	(267)
Electricity for lighting	(232) x		0.519	=	123.51	(268)
Total CO2, kg/year		sum of (265)…(271) =			841.26	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			16.62	(273)
EI rating (section 14)					88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 34

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.03	(1a) x	2.56	(2a) =	130.63	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.03	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.63	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Walls Type1	25.06	9.48	15.58	x	0.16	=	2.49			(29)
Walls Type2	19.31	2.42	16.89	x	0.14	=	2.39			(29)
Total area of elements, m²			44.37							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 20.84 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 551.97 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.34 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 24.18 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.23	14.04	13.86	12.94	12.76	11.84	11.84	11.66	12.21	12.76	13.13	13.49	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	38.4	38.22	38.04	37.12	36.94	36.02	36.02	35.84	36.39	36.94	37.3	37.67	

Average = Sum(39)$_{1...12}$ /12= 37.08 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.75	0.75	0.75	0.73	0.72	0.71	0.71	0.7	0.71	0.72	0.73	0.74

Average = Sum(40)$_{1...12}$ /12= 0.73 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.06 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.56	79.56	76.56	73.56	70.55	67.55	67.55	70.55	73.56	76.56	79.56	82.56

Total = Sum(44)$_{1...12}$ = 900.7 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.44	107.09	110.5	96.34	92.44	79.77	73.92	84.82	85.83	100.03	109.19	118.58

Total = Sum(45)$_{1...12}$ = 1180.95 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.37	16.06	16.58	14.45	13.87	11.97	11.09	12.72	12.88	15	16.38	17.79

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.07	36.62	39.01	36.27	35.95	33.31	34.42	35.95	36.27	39.01	39.24	42.07	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65	

Output from water heater (annual)$_{1...12}$ 1631.18 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.23	44.76	46.5	41.1	39.72	34.85	33.18	37.19	37.61	43.01	46.12	49.95	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.58	12.06	9.81	7.43	5.55	4.69	5.07	6.58	8.84	11.22	13.1	13.96	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.9	151.45	147.53	139.19	128.66	118.76	112.14	110.59	114.51	122.85	133.38	143.28	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	(71)

Water heating gains (Table 5)

(72)m=	68.86	66.61	62.49	57.09	53.39	48.4	44.6	49.99	52.23	57.81	64.05	67.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	284.14	281.93	271.65	255.51	239.41	223.65	213.61	218.96	227.38	243.69	262.33	276.18	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	9.51	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	19.36	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	34.89	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	57.29	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	77.01	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	82.11	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	76.81	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	61.23	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	42.51	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	23.66	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	11.97	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	7.77	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	28.54	58.09	104.66	171.88	231.04	246.32	230.42	183.7	127.53	70.99	35.91	23.31	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	312.68	340.02	376.3	427.39	470.45	469.97	444.04	402.66	354.91	314.68	298.24	299.49	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.9	0.71	0.49	0.36	0.41	0.69	0.95	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.35	20.45	20.64	20.87	20.98	21	21	21	20.99	20.83	20.56	20.34	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.29	20.3	20.3	20.32	20.32	20.34	20.34	20.34	20.33	20.32	20.31	20.31	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.88	0.66	0.44	0.3	0.35	0.63	0.93	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.41	19.57	19.84	20.17	20.3	20.33	20.34	20.34	20.32	20.13	19.74	19.41	(90)

fLA = Living area ÷ (4) = 0.48 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.86	19.99	20.22	20.51	20.63	20.65	20.65	20.66	20.64	20.46	20.13	19.85	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.71	19.84	20.07	20.36	20.48	20.5	20.5	20.51	20.49	20.31	19.98	19.7	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.88	0.67	0.45	0.32	0.37	0.65	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	311.13	336.65	365.02	375.39	317.51	212.36	140.62	147.1	229.08	292.72	294.75	298.35	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	591.85	571.01	516.2	425.36	324.23	212.65	140.64	147.14	232.56	358.8	480.48	584.02	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	208.86	157.49	112.48	35.98	5	0	0	0	0	49.16	133.72	212.54	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 915.24 (98)

Space heating requirement in kWh/m²/year 17.94 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	208.86	157.49	112.48	35.98	5	0	0	0	0	49.16	133.72	212.54	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	231.03	174.22	124.42	39.8	5.53	0	0	0	0	54.38	147.93	235.12	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1012.43 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65

Efficiency of water heater 80.3 (216)

(217)m=	85.65	85.28	84.35	82.26	80.64	80.3	80.3	80.3	80.3	82.71	84.79	85.76	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	192.07	168.51	177.27	161.21	159.22	140.82	134.92	150.41	152.07	168.1	175.05	187.33	

Total = Sum(219a)$_{1...12}$ = 1966.99 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1012.43

DER WorkSheet: New dwelling design stage

Water heating fuel used		1966.99	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	119.52		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	149.52	(231)
Electricity for lighting		239.88	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	218.68	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	424.87	(264)
Space and water heating	(261) + (262) + (263) + (264) =				643.55	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	77.6	(267)
Electricity for lighting	(232) x		0.519	=	124.5	(268)
Total CO2, kg/year		sum of (265)…(271) =			845.66	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			16.57	(273)
EI rating (section 14)					88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 35

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.86	(1a) x	2.56	(2a) =	183.97	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.86	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.97	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Walls Type1	36.57	12.64	23.93	x	0.16	=	3.83			(29)
Walls Type2	26	2.42	23.58	x	0.14	=	3.33			(29)
Total area of elements, m²			62.57							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 27.31 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 807.6 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.88 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 32.19 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.03	19.78	19.52	18.23	17.97	16.68	16.68	16.42	17.2	17.97	18.49	19	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	52.22	51.96	51.7	50.41	50.16	48.87	48.87	48.61	49.38	50.16	50.67	51.19	

Average = Sum(39)$_{1...12}$ /12= 50.35 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.73	0.72	0.72	0.7	0.7	0.68	0.68	0.68	0.69	0.7	0.71	0.71	
Average = Sum(40)$_{1...12}$ /12=													0.7 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.6 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	97.46	93.91	90.37	86.83	83.28	79.74	79.74	83.28	86.83	90.37	93.91	97.46	
Total = Sum(44)$_{1...12}$ =													1063.18 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	144.53	126.41	130.44	113.72	109.12	94.16	87.25	100.12	101.32	118.08	128.89	139.97	
Total = Sum(45)$_{1...12}$ =													1394 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.68	18.96	19.57	17.06	16.37	14.12	13.09	15.02	15.2	17.71	19.33	21	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.66	43.23	46.05	42.82	42.44	39.32	40.63	42.44	42.82	46.05	46.31	49.66	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63	

Output from water heater (annual)$_{1...12}$ 1925.45 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.47	52.84	54.88	48.52	46.89	41.14	39.17	43.9	44.39	50.77	54.43	58.96	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.43	16.37	13.31	10.08	7.53	6.36	6.87	8.93	11.99	15.22	17.77	18.94	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.6	203.7	198.42	187.2	173.03	159.72	150.82	148.73	154	165.23	179.39	192.71	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	(71)

Water heating gains (Table 5)

(72)m=	81.28	78.63	73.77	67.38	63.03	57.14	52.65	59.01	61.66	68.24	75.6	79.24	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	361.67	359.04	345.86	325.02	303.95	283.57	270.7	277.03	288.01	309.05	333.12	351.24	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	38.05	77.45	139.55	229.18	308.06	328.42	307.23	244.93	170.04	94.65	47.88	31.07	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	399.72	436.5	485.41	554.19	612.01	611.99	577.93	521.95	458.04	403.7	381	382.32	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.92	0.74	0.51	0.37	0.43	0.72	0.96	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.33	20.43	20.62	20.86	20.98	21	21	21	20.99	20.81	20.54	20.32	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.32	20.32	20.32	20.34	20.34	20.36	20.36	20.36	20.35	20.34	20.34	20.33	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.9	0.69	0.46	0.32	0.37	0.66	0.95	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.41	19.56	19.83	20.18	20.32	20.36	20.36	20.36	20.34	20.12	19.73	19.41	(90)

fLA = Living area ÷ (4) = 0.34 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.72	19.86	20.1	20.41	20.55	20.58	20.58	20.58	20.56	20.36	20	19.72	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.57	19.71	19.95	20.26	20.4	20.43	20.43	20.43	20.41	20.21	19.85	19.57	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.9	0.7	0.46	0.32	0.38	0.67	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	398.49	433.63	474.76	497.49	426.17	284.31	186.99	195.78	306.42	382.05	378.1	381.44	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	797.57	769.34	695.24	572.68	436.15	284.7	187.01	195.84	311.67	481.88	646.26	786.66	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	296.92	225.6	164.04	54.14	7.42	0	0	0	0	74.28	193.08	301.48	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1316.96 (98)

Space heating requirement in kWh/m²/year 18.33 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	296.92	225.6	164.04	54.14	7.42	0	0	0	0	74.28	193.08	301.48	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	328.45	249.55	181.46	59.89	8.21	0	0	0	0	82.16	213.59	333.5	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1456.81 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63

Efficiency of water heater 80.3 (216)

(217)m=	86.12	85.77	84.87	82.67	80.72	80.3	80.3	80.3	80.3	83.2	85.3	86.21	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	225.5	197.78	207.96	189.34	187.75	166.23	159.26	177.54	179.5	197.28	205.41	219.96	

Total = Sum(219a)$_{1...12}$ = 2313.51 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1456.81

DER WorkSheet: New dwelling design stage

Water heating fuel used		2313.51	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	168.33		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	198.33	(231)
Electricity for lighting		325.42	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	314.67	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	499.72	(264)
Space and water heating	(261) + (262) + (263) + (264) =				814.39	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	102.93	(267)
Electricity for lighting	(232) x		0.519	=	168.89	(268)
Total CO2, kg/year		sum of (265)…(271) =			1086.22	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			15.12	(273)
EI rating (section 14)					88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 36

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.76	(1a) x	2.56	(2a) =	188.83	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.76	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.83	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 3			4.31	x	1/[1/(1.4)+ 0.04]	=	5.71			(27)
Walls Type1	56.59	19.87	36.72	x	0.16	=	5.87			(29)
Walls Type2	12.58	2.42	10.16	x	0.14	=	1.44			(29)
Roof	73.76	0	73.76	x	0.12	=	8.85			(30)
Total area of elements, m²			142.93							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 45.89 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1460.78 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 12.08 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 57.98 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.56	20.3	20.03	18.71	18.44	17.12	17.12	16.86	17.65	18.44	18.97	19.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	78.54	78.27	78.01	76.68	76.42	75.1	75.1	74.83	75.63	76.42	76.95	77.48	

Average = Sum(39)$_{1...12}$ /12= 76.62 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.06	1.06	1.06	1.04	1.04	1.02	1.02	1.01	1.03	1.04	1.04	1.05

Average = Sum(40)$_{1...12}$ /12= 1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.63 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.59	95.01	91.42	87.84	84.25	80.67	80.67	84.25	87.84	91.42	95.01	98.59

Total = Sum(44)$_{1...12}$ = 1075.55 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.21	127.88	131.96	115.04	110.39	95.25	88.27	101.29	102.5	119.45	130.39	141.6

Total = Sum(45)$_{1...12}$ = 1410.22 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.93	19.18	19.79	17.26	16.56	14.29	13.24	15.19	15.37	17.92	19.56	21.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.24	43.73	46.59	43.32	42.93	39.78	41.11	42.93	43.32	46.59	46.85	50.24	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84	

Output from water heater (annual)$_{1...12}$ 1947.85 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.18	53.45	55.52	49.08	47.44	41.62	39.63	44.41	44.91	51.36	55.07	59.64	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.36	16.3	13.26	10.04	7.5	6.34	6.85	8.9	11.94	15.16	17.7	18.87	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.91	208.05	202.66	191.2	176.73	163.13	154.05	151.91	157.29	168.76	183.23	196.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	(71)

Water heating gains (Table 5)

(72)m=	82.22	79.54	74.63	68.17	63.76	57.8	53.26	59.69	62.37	69.04	76.48	80.16	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.5	364.9	351.56	330.42	309	288.28	275.16	281.51	292.62	313.97	338.42	356.86	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	4.31	x	11.28	x	0.55	x	0.7	=	12.97	(75)
Northeast 0.9x	0.77	x	4.31	x	22.97	x	0.55	x	0.7	=	26.41	(75)
Northeast 0.9x	0.77	x	4.31	x	41.38	x	0.55	x	0.7	=	47.58	(75)
Northeast 0.9x	0.77	x	4.31	x	67.96	x	0.55	x	0.7	=	78.14	(75)
Northeast 0.9x	0.77	x	4.31	x	91.35	x	0.55	x	0.7	=	105.04	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	4.31	x	97.38	x	0.55	x	0.7	=	111.99		(75)
Northeast	0.9x	0.77	x	4.31	x	91.1	x	0.55	x	0.7	=	104.76		(75)
Northeast	0.9x	0.77	x	4.31	x	72.63	x	0.55	x	0.7	=	83.52		(75)
Northeast	0.9x	0.77	x	4.31	x	50.42	x	0.55	x	0.7	=	57.98		(75)
Northeast	0.9x	0.77	x	4.31	x	28.07	x	0.55	x	0.7	=	32.28		(75)
Northeast	0.9x	0.77	x	4.31	x	14.2	x	0.55	x	0.7	=	16.33		(75)
Northeast	0.9x	0.77	x	4.31	x	9.21	x	0.55	x	0.7	=	10.6		(75)
Northwest	0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82		(81)
Northwest	0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03		(81)
Northwest	0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62		(81)
Northwest	0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73		(81)
Northwest	0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01		(81)
Northwest	0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77		(81)
Northwest	0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53		(81)
Northwest	0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59		(81)
Northwest	0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19		(81)
Northwest	0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03		(81)
Northwest	0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08		(81)
Northwest	0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21		(81)
Northwest	0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59		(81)
Northwest	0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62		(81)
Northwest	0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05		(81)
Northwest	0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46		(81)
Northwest	0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3		(81)
Northwest	0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02		(81)
Northwest	0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19		(81)
Northwest	0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33		(81)
Northwest	0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35		(81)
Northwest	0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94		(81)
Northwest	0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72		(81)
Northwest	0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54		(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	59.82	121.76	219.37	360.26	484.26	516.28	482.97	385.03	267.3	148.8	75.26	48.85	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	427.32	486.66	570.92	690.68	793.26	804.55	758.12	666.53	559.92	462.76	413.68	405.71	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.8	0.58	0.43	0.51	0.82	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.86	20	20.27	20.64	20.9	20.99	21	20.99	20.91	20.55	20.15	19.84	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.03	20.04	20.05	20.05	20.07	20.07	20.07	20.06	20.05	20.05	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.74	0.5	0.34	0.41	0.74	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.5	18.71	19.1	19.63	19.96	20.06	20.07	20.07	20	19.53	18.94	18.48	(90)

fLA = Living area ÷ (4) = 0.24 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.82	19.02	19.38	19.87	20.18	20.28	20.29	20.29	20.22	19.78	19.23	18.81	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.67	18.87	19.23	19.72	20.03	20.13	20.14	20.14	20.07	19.63	19.08	18.66	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.74	0.51	0.35	0.42	0.74	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	425.84	483.12	558.18	629.41	587.05	410.24	265.44	278.72	415.95	444.19	410.74	404.64	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1128.96	1093.21	992.95	830.08	636.87	415.44	265.96	280.02	451.25	689.82	921.66	1120.11	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	523.12	409.98	323.47	144.48	37.07	0	0	0	0	182.74	367.86	532.31	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2521.04 (98)

Space heating requirement in kWh/m²/year 34.18 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	523.12	409.98	323.47	144.48	37.07	0	0	0	0	182.74	367.86	532.31	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	578.67	453.52	357.82	159.82	41.01	0	0	0	0	202.15	406.93	588.84	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2788.76 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84

Efficiency of water heater: 80.3 (216)

(217)m= 87.4 | 87.17 | 86.53 | 84.82 | 82.09 | 80.3 | 80.3 | 80.3 | 80.3 | 85.29 | 86.85 | 87.48 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 224.78 | 196.87 | 206.34 | 186.7 | 186.78 | 168.16 | 161.11 | 179.6 | 181.59 | 194.67 | 204.08 | 219.28

Total = Sum(219a)$_{1...12}$ = 2309.97 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2788.76	
Water heating fuel used		2309.97	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	172.78		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		202.78	(231)
Electricity for lighting		324.19	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	602.37	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	498.95	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1101.33	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	105.24	(267)
Electricity for lighting	(232) x	0.519	=	168.26	(268)
Total CO2, kg/year	sum of (265)…(271) =			1374.82	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			18.64	(273)
EI rating (section 14)				84	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 37

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	84.24	(1a) x	2.56	(2a) =	215.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	84.24	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		215.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x	1/[1/(1.4)+ 0.04]	=	10.27			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Walls Type1	35.61	16.99	18.62	x	0.16	=	2.98			(29)
Walls Type2	20.82	2.42	18.4	x	0.14	=	2.6			(29)
Roof	84.25	0	84.25	x	0.12	=	10.11			(30)
Total area of elements, m²			140.67							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 41.6 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1387.5 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.82 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 51.42 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	23.48	23.18	22.88	21.37	21.07	19.55	19.55	19.25	20.16	21.07	21.67	22.27	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	74.91	74.6	74.3	72.79	72.49	70.97	70.97	70.67	71.58	72.49	73.09	73.7	

Average = Sum(39)$_{1...12}$ /12= 72.71 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.89	0.89	0.88	0.86	0.86	0.84	0.84	0.84	0.85	0.86	0.87	0.87

Average = Sum(40)$_{1...12}$ /12= 0.86 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.54 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 94.49 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	103.94	100.16	96.38	92.6	88.82	85.04	85.04	88.82	92.6	96.38	100.16	103.94

Total = Sum(44)$_{1...12}$ = 1133.85 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	154.13	134.81	139.11	121.28	116.37	100.42	93.05	106.78	108.05	125.93	137.46	149.27

Total = Sum(45)$_{1...12}$ = 1486.65 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.12	20.22	20.87	18.19	17.46	15.06	13.96	16.02	16.21	18.89	20.62	22.39

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.11	45.66	45.26	41.94	43.33	45.26	45.66	49.11	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	

Output from water heater (annual)$_{1...12}$ 2049.26 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	63.99	56.33	58.53	51.74	50.01	43.87	41.77	46.82	47.34	54.15	58.03	62.37	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	20.46	18.17	14.78	11.19	8.36	7.06	7.63	9.92	13.31	16.9	19.72	21.03	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	228.07	230.44	224.48	211.78	195.75	180.69	170.63	168.26	174.22	186.92	202.95	218.01	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	(71)

Water heating gains (Table 5)

(72)m=	86.01	83.82	78.67	71.86	67.21	60.93	56.15	62.93	65.76	72.78	80.6	83.83	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	398.62	396.51	382	358.91	335.41	312.76	298.48	305.18	317.36	340.68	367.35	386.95	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	449.76	500.62	569.57	666.95	749.48	754.21	711.44	634.4	545.92	467.91	431.7	428.72	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.81	0.59	0.44	0.51	0.82	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.06	20.18	20.4	20.71	20.93	20.99	21	21	20.94	20.65	20.31	20.05	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.18	20.18	20.18	20.2	20.2	20.22	20.22	20.22	20.21	20.2	20.2	20.19	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.94	0.77	0.52	0.36	0.42	0.75	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.91	19.08	19.4	19.86	20.13	20.21	20.22	20.22	20.17	19.79	19.29	18.9	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.16	19.32	19.62	20.04	20.3	20.38	20.39	20.39	20.33	19.97	19.51	19.15	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.01	19.17	19.47	19.89	20.15	20.23	20.24	20.24	20.18	19.82	19.36	19	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	1	0.98	0.93	0.76	0.53	0.36	0.43	0.75	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	448.74	498.19	560.66	619.68	572.76	396.57	257.83	270.59	410.34	452.39	429.51	427.98	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1101.72	1064.46	963.64	800.14	612.7	399.63	258.06	271.21	435.54	668.61	896.1	1090.62	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	485.82	380.53	299.82	129.93	29.72	0	0	0	0	160.87	335.95	493	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2315.63 (98)

Space heating requirement in kWh/m²/year 27.49 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	485.82	380.53	299.82	129.93	29.72	0	0	0	0	160.87	335.95	493	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	537.41	420.94	331.66	143.73	32.87	0	0	0	0	177.96	371.62	545.36	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2561.54 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23

Efficiency of water heater 80.3 (216)

(217)m=	87.15	86.88	86.22	84.43	81.72	80.3	80.3	80.3	80.3	84.84	86.51	87.23	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	235.34	208.14	218.31	197.73	197.79	177.28	169.85	189.34	191.43	206.32	215.89	229.54	

Total = Sum(219a)$_{1...12}$ = 2436.96 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2561.54

DER WorkSheet: New dwelling design stage

Water heating fuel used			2436.96	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		197.32		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		227.32	(231)
Electricity for lighting			361.31	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	553.29	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	526.38	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1079.68	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	117.98	(267)
Electricity for lighting	(232) x		0.519	=	187.52	(268)
Total CO2, kg/year		sum of (265)…(271) =			1385.18	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			16.44	(273)
EI rating (section 14)					86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 38

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.63	(1a) x	2.56	(2a) =	183.37	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.37	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	31.08	16.99	14.09	x	0.16	=	2.25			(29)
Walls Type2	25.62	2.42	23.2	x	0.14	=	3.28			(29)
Roof	71.63	0	71.63	x	0.12	=	8.6			(30)
Total area of elements, m²			128.33							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 40.04 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1278.53 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.93 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 48.98 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.97	19.71	19.45	18.17	17.91	16.63	16.63	16.37	17.14	17.91	18.43	18.94	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	68.95	68.69	68.43	67.15	66.89	65.6	65.6	65.35	66.12	66.89	67.4	67.92	

Average = Sum(39)$_{1...12}$ /12= 67.08 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.96	0.96	0.96	0.94	0.93	0.92	0.92	0.91	0.92	0.93	0.94	0.95	
Average = Sum(40)$_{1...12}$ /12=													0.94 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.47 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	97.32	93.78	90.24	86.7	83.16	79.62	79.62	83.16	86.7	90.24	93.78	97.32	
Total = Sum(44)$_{1...12}$ =													1061.64 (44)
Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)													
(45)m=	144.32	126.22	130.25	113.55	108.96	94.02	87.13	99.98	101.17	117.91	128.7	139.76	
Total = Sum(45)$_{1...12}$ =													1391.97 (45)
If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)													
(46)m=	21.65	18.93	19.54	17.03	16.34	14.1	13.07	15	15.18	17.69	19.31	20.96	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)
If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)
If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H													
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.59	43.16	45.98	42.76	42.38	39.27	40.57	42.38	42.76	45.98	46.25	49.59	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	

Output from water heater (annual)$_{1...12}$ 1922.64 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.38	52.76	54.8	48.45	46.82	41.08	39.11	43.84	44.33	50.7	54.36	58.87	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.93	15.92	12.95	9.8	7.33	6.19	6.68	8.69	11.66	14.81	17.28	18.42	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.07	203.16	197.9	186.71	172.58	159.3	150.42	148.34	153.6	164.79	178.92	192.2	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	(71)

Water heating gains (Table 5)

(72)m=	81.16	78.51	73.66	67.29	62.93	57.05	52.57	58.92	61.57	68.15	75.49	79.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.43	357.87	344.78	324.07	303.11	282.81	269.96	276.22	287.1	308.02	331.97	350.02	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	411.58	461.97	532.36	632.12	717.19	724.26	682.92	605.44	515.66	435.25	396.33	391.79	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.79	0.57	0.42	0.49	0.8	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.99	20.12	20.37	20.7	20.92	20.99	21	21	20.94	20.63	20.26	19.98	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.11	20.12	20.12	20.14	20.14	20.15	20.15	20.16	20.15	20.14	20.13	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.92	0.74	0.5	0.34	0.4	0.73	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.76	18.95	19.31	19.79	20.07	20.15	20.15	20.16	20.1	19.7	19.17	18.75	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.09	19.26	19.59	20.03	20.29	20.37	20.38	20.38	20.32	19.95	19.46	19.07	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.94	19.11	19.44	19.88	20.14	20.22	20.23	20.23	20.17	19.8	19.31	18.92	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.74	0.5	0.35	0.41	0.73	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	410.25	458.85	521.16	577.04	529.1	365.68	237.66	249.46	377.66	417.45	393.59	390.83	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1009.28	976.2	885.3	737.33	564.79	368.74	237.93	250.14	401.51	615.24	822.69	1000.07	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	445.68	347.66	270.92	115.41	26.55	0	0	0	0	147.16	308.96	453.28	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2115.61 (98)

Space heating requirement in kWh/m²/year 29.54 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	445.68	347.66	270.92	115.41	26.55	0	0	0	0	147.16	308.96	453.28	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	493.01	384.58	299.69	127.66	29.37	0	0	0	0	162.78	341.77	501.41	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2340.27 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36

Efficiency of water heater 80.3 (216)

(217)m=	87.08	86.82	86.13	84.3	81.66	80.3	80.3	80.3	80.3	84.78	86.47	87.17	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	222.68	195.09	204.61	185.42	185.32	165.99	159.03	177.28	179.24	193.31	202.33	217.23	

Total = Sum(219a)$_{1...12}$ = 2287.53 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2340.27

DER WorkSheet: New dwelling design stage

Water heating fuel used		2287.53	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	167.79		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	197.79	(231)
Electricity for lighting		316.57	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	505.5	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	494.11	(264)
Space and water heating	(261) + (262) + (263) + (264) =				999.61	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	102.65	(267)
Electricity for lighting	(232) x		0.519	=	164.3	(268)
Total CO2, kg/year		sum of (265)…(271) =			1266.56	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			17.68	(273)
EI rating (section 14)					85	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 39

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	58.62	(1a) x	2.56	(2a) =	150.07	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	58.62	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		150.07	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	37.03	16.99	20.04	x	0.16	=	3.21			(29)
Walls Type2	26.11	2.42	23.69	x	0.14	=	3.35			(29)
Roof	58.62	0	58.62	x	0.12	=	7.03			(30)
Total area of elements, m²			121.76							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.5 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1271.01 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.89 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 47.4 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	16.34	16.13	15.92	14.87	14.66	13.61	13.61	13.4	14.03	14.66	15.08	15.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	63.74	63.53	63.32	62.27	62.06	61.01	61.01	60.8	61.43	62.06	62.48	62.9	

Average = Sum(39)$_{1...12}$ /12= 62.22 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.09	1.08	1.08	1.06	1.06	1.04	1.04	1.04	1.05	1.06	1.07	1.07

Average = Sum(40)$_{1...12}$ /12= 1.06 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.94 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 80.33 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	88.36	85.15	81.94	78.72	75.51	72.3	72.3	75.51	78.72	81.94	85.15	88.36

Total = Sum(44)$_{1...12}$ = 963.97 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	131.04	114.61	118.27	103.11	98.93	85.37	79.11	90.78	91.86	107.06	116.86	126.91

Total = Sum(45)$_{1...12}$ = 1263.92 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.66	17.19	17.74	15.47	14.84	12.81	11.87	13.62	13.78	16.06	17.53	19.04

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	45.03	39.19	41.75	38.82	38.48	35.65	36.84	38.48	38.82	41.75	41.99	45.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94	

Output from water heater (annual)$_{1...12}$ 1745.77 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	54.83	47.91	49.76	43.99	42.52	37.3	35.51	39.8	40.25	46.04	49.36	53.45	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	15.11	13.42	10.91	8.26	6.18	5.21	5.63	7.32	9.83	12.48	14.56	15.53	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	169.45	171.21	166.78	157.35	145.44	134.25	126.77	125.01	129.44	138.88	150.79	161.98	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	(71)

Water heating gains (Table 5)

(72)m=	73.69	71.29	66.88	61.1	57.14	51.81	47.74	53.5	55.9	61.88	68.55	71.85	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	313.39	311.05	299.71	281.84	263.9	246.4	235.28	240.97	250.31	268.37	289.03	304.49	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	364.54	415.16	487.28	589.89	677.97	687.85	648.24	570.19	478.87	395.6	353.39	346.25	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.93	0.77	0.56	0.41	0.49	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.86	20.01	20.29	20.66	20.91	20.99	21	21	20.92	20.57	20.16	19.84	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.01	20.01	20.02	20.03	20.03	20.05	20.05	20.05	20.04	20.03	20.03	20.02	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.9	0.71	0.48	0.32	0.39	0.71	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.5	18.71	19.11	19.65	19.95	20.04	20.05	20.05	19.99	19.54	18.94	18.48	(90)

fLA = Living area ÷ (4) = 0.3 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.91	19.1	19.47	19.95	20.24	20.33	20.33	20.33	20.27	19.85	19.31	18.89	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.76	18.95	19.32	19.8	20.09	20.18	20.18	20.18	20.12	19.7	19.16	18.74	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.9	0.71	0.49	0.34	0.4	0.72	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	362.85	411.21	473.6	528.25	484.72	336.43	218.28	229.14	344.07	376.09	350.08	345.02	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	921.59	892.83	811.63	678.93	520.63	340.18	218.67	230.1	369.68	564.85	753.31	914.45	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	415.7	323.65	251.49	108.49	26.72	0	0	0	0	140.43	290.33	423.65	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1980.47 (98)

Space heating requirement in kWh/m²/year 33.78 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	415.7	323.65	251.49	108.49	26.72	0	0	0	0	140.43	290.33	423.65	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	459.85	358.02	278.2	120.01	29.56	0	0	0	0	155.35	321.16	468.64	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2190.78 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94

Efficiency of water heater 80.3 (216)

(217)m=	87.14	86.88	86.18	84.38	81.79	80.3	80.3	80.3	80.3	84.91	86.55	87.23	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	202.06	177.03	185.67	168.2	168.01	150.72	144.4	160.97	162.75	175.27	183.54	197.1	

Total = Sum(219a)$_{1...12}$ = 2075.72 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2190.78

DER WorkSheet: New dwelling design stage

Water heating fuel used		2075.72	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	137.31		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	167.31	(231)
Electricity for lighting		266.79	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	473.21	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	448.36	(264)
Space and water heating	(261) + (262) + (263) + (264) =				921.57	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	86.83	(267)
Electricity for lighting	(232) x		0.519	=	138.47	(268)
Total CO2, kg/year		sum of (265)…(271) =			1146.87	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			19.56	(273)
EI rating (section 14)					85	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 40

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.71	(1a) x	2.56	(2a) =	183.58	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.71	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.58	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	54.82	19.88	34.94	x	0.16	=	5.59			(29)
Walls Type2	34.97	2.42	32.55	x	0.14	=	4.6			(29)
Roof	71.71	0	71.71	x	0.12	=	8.61			(30)
Total area of elements, m²			161.5							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 48.54 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1792.7 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.98 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 56.53 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.99	19.73	19.48	18.19	17.93	16.64	16.64	16.39	17.16	17.93	18.45	18.96	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	76.52	76.26	76	74.72	74.46	73.17	73.17	72.91	73.69	74.46	74.97	75.49	

Average = Sum(39)$_{1...12}$ /12= 74.65 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.07	1.06	1.06	1.04	1.04	1.02	1.02	1.02	1.03	1.04	1.05	1.05

Average = Sum(40)$_{1...12}$ /12= 1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.51 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	97.37	93.83	90.28	86.74	83.2	79.66	79.66	83.2	86.74	90.28	93.83	97.37

Total = Sum(44)$_{1...12}$ = 1062.17 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	144.39	126.28	130.31	113.61	109.01	94.07	87.17	100.03	101.22	117.97	128.77	139.83

Total = Sum(45)$_{1...12}$ = 1392.67 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.66	18.94	19.55	17.04	16.35	14.11	13.08	15	15.18	17.69	19.32	20.98

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.62	43.19	46.01	42.78	42.4	39.29	40.6	42.4	42.78	46.01	46.27	49.62	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45	

Output from water heater (annual)$_{1...12}$ 1923.61 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.41	52.79	54.83	48.47	46.85	41.1	39.13	43.86	44.35	50.73	54.38	58.9	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.94	15.94	12.96	9.81	7.33	6.19	6.69	8.7	11.67	14.82	17.3	18.44	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.25	203.34	198.08	186.88	172.73	159.44	150.56	148.47	153.74	164.94	179.08	192.37	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	(71)

Water heating gains (Table 5)

(72)m=	81.2	78.55	73.7	67.32	62.97	57.08	52.6	58.95	61.6	68.18	75.53	79.17	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.7	358.13	345.04	324.31	303.34	283.02	270.15	276.42	287.31	308.24	332.22	350.28	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast	0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast	0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast	0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast	0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast	0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast	0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast	0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast	0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast	0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast	0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast	0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast	0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast	0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast	0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast	0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast	0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast	0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast	0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)
Southeast	0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast	0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast	0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast	0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast	0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)
Southeast	0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast	0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast	0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast	0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast	0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast	0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast	0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	79.52	152.43	253.69	389.97	505.84	532.55	500.79	409.71	300.15	180.64	98.34	66.05	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	440.22	510.57	598.73	714.28	809.18	815.57	770.95	686.14	587.46	488.88	430.55	416.33	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.93	0.77	0.56	0.42	0.48	0.78	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.88	20.04	20.32	20.68	20.91	20.99	21	21	20.93	20.6	20.18	19.86	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.03	20.03	20.05	20.05	20.07	20.07	20.07	20.06	20.05	20.05	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.9	0.72	0.49	0.33	0.39	0.7	0.95	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.54	18.77	19.17	19.68	19.97	20.06	20.07	20.07	20.01	19.59	18.98	18.52	(90)

fLA = Living area ÷ (4) = 0.28 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.92	19.13	19.49	19.96	20.24	20.32	20.33	20.33	20.27	19.87	19.32	18.9	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.77	18.98	19.34	19.81	20.09	20.17	20.18	20.18	20.12	19.72	19.17	18.75	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.89	0.72	0.49	0.34	0.4	0.71	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	438.28	505.52	581.16	639.15	581.74	403.2	261.44	274.55	416	463.03	426.52	414.95	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1107.14	1073.69	976.04	815.19	624.35	407.63	261.88	275.59	443.56	679.22	905.07	1098.09	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	497.63	381.81	293.79	126.75	31.7	0	0	0	0	160.85	344.56	508.25	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2345.35 (98)

Space heating requirement in kWh/m²/year 32.71 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	497.63	381.81	293.79	126.75	31.7	0	0	0	0	160.85	344.56	508.25	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	550.47	422.36	324.99	140.21	35.07	0	0	0	0	177.93	381.15	562.23	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2594.41 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45

Efficiency of water heater: 80.3 (216)

(217)m= 87.32 | 87.03 | 86.33 | 84.53 | 81.88 | 80.3 | 80.3 | 80.3 | 80.3 | 85 | 86.73 | 87.41 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 222.18 | 194.72 | 204.25 | 185.02 | 184.91 | 166.07 | 159.11 | 177.37 | 179.33 | 192.9 | 201.83 | 216.73

Total = Sum(219a)$_{1...12}$ = 2284.41 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2594.41	
Water heating fuel used		2284.41	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	184.77		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		214.77	(231)
Electricity for lighting		316.86	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	560.39	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	493.43	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1053.83	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	111.47	(267)
Electricity for lighting	(232) x	0.519	=	164.45	(268)
Total CO2, kg/year	sum of (265)…(271) =			1329.74	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			18.54	(273)
EI rating (section 14)				85	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 41

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.7	(1a) x	2.56	(2a) =	180.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.7	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x	1/[1/(1.4)+ 0.04]	=	10.69			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Windows Type 3			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Walls Type1	54.73	20.19	34.54	x	0.16	=	5.53			(29)
Walls Type2	22.23	2.42	19.81	x	0.14	=	2.8			(29)
Roof	70.7	0	70.7	x	0.12	=	8.48			(30)
Total area of elements, m²			147.65							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 46.97 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1560.19 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.34 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 56.3 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.71	19.46	19.2	17.93	17.68	16.41	16.41	16.16	16.92	17.68	18.19	18.69	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	76.01	75.76	75.5	74.23	73.98	72.71	72.71	72.46	73.22	73.98	74.49	75	

Average = Sum(39)$_{1...12}$ /12= 74.17 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.08	1.07	1.07	1.05	1.05	1.03	1.03	1.02	1.04	1.05	1.05	1.06

Average = Sum(40)$_{1...12}$ /12= 1.05 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.94 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.74	93.22	89.7	86.19	82.67	79.15	79.15	82.67	86.19	89.7	93.22	96.74

Total = Sum(44)$_{1...12}$ = 1055.33 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.46	125.47	129.48	112.88	108.31	93.46	86.61	99.38	100.57	117.21	127.94	138.93

Total = Sum(45)$_{1...12}$ = 1383.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.52	18.82	19.42	16.93	16.25	14.02	12.99	14.91	15.09	17.58	19.19	20.84

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.3	42.91	45.71	42.5	42.13	39.03	40.33	42.13	42.5	45.71	45.97	49.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	

Output from water heater (annual)$_{1...12}$ 1911.23 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.03	52.45	54.48	48.16	46.55	40.84	38.88	43.58	44.07	50.4	54.03	58.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.73	15.75	12.81	9.7	7.25	6.12	6.61	8.6	11.54	14.65	17.1	18.23	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.92	200.98	195.78	184.71	170.73	157.59	148.81	146.75	151.95	163.03	177	190.14	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	(71)

Water heating gains (Table 5)

(72)m=	80.68	78.05	73.22	66.89	62.56	56.72	52.26	58.57	61.2	67.74	75.05	78.66	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	357.27	354.72	341.76	321.24	300.48	280.37	267.63	273.86	284.64	305.36	329.09	346.97	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast 0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast 0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast 0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast 0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast 0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast 0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast 0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast 0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast 0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)
Southwest 0.9x	0.77	x	8.06	x	36.79		0.55	x	0.7	=	79.12	(79)
Southwest 0.9x	0.77	x	4.62	x	36.79		0.55	x	0.7	=	90.71	(79)
Southwest 0.9x	0.77	x	8.06	x	62.67		0.55	x	0.7	=	134.78	(79)
Southwest 0.9x	0.77	x	4.62	x	62.67		0.55	x	0.7	=	154.51	(79)
Southwest 0.9x	0.77	x	8.06	x	85.75		0.55	x	0.7	=	184.41	(79)
Southwest 0.9x	0.77	x	4.62	x	85.75		0.55	x	0.7	=	211.4	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	4.62	x	106.25		0.55	x	0.7	=	261.94	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	4.62	x	119.01		0.55	x	0.7	=	293.39	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	4.62	x	118.15		0.55	x	0.7	=	291.27	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	4.62	x	113.91		0.55	x	0.7	=	280.82	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	4.62	x	104.39		0.55	x	0.7	=	257.35	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	4.62	x	92.85		0.55	x	0.7	=	228.91	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	4.62	x	69.27		0.55	x	0.7	=	170.76	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	4.62	x	44.07		0.55	x	0.7	=	108.65	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	4.62	x	31.49		0.55	x	0.7	=	77.63	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	198.2	337.61	461.93	572.36	641.09	636.45	613.61	562.33	500.17	373.13	237.4	169.62	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	555.48	692.33	803.69	893.59	941.57	916.82	881.24	836.19	784.81	678.49	566.49	516.59	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.85	0.69	0.5	0.36	0.4	0.62	0.89	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.03	20.27	20.54	20.81	20.95	20.99	21	21	20.98	20.78	20.35	19.99	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.02	20.02	20.03	20.04	20.04	20.06	20.06	20.06	20.05	20.04	20.04	20.03	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.92	0.81	0.63	0.43	0.29	0.32	0.55	0.86	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.75	19.09	19.48	19.84	20	20.06	20.06	20.06	20.04	19.81	19.22	18.7	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.1	19.41	19.76	20.1	20.26	20.31	20.31	20.32	20.29	20.07	19.53	19.05	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.95	19.26	19.61	19.95	20.11	20.16	20.16	20.17	20.14	19.92	19.38	18.9	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.92	0.81	0.64	0.44	0.29	0.33	0.55	0.85	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	548.43	668.2	735.9	719.94	597.92	401.66	258.87	272.42	433.77	577.51	549.42	511.84	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1113.3	1087.8	990.21	820.21	621.83	404.16	259.09	272.8	442.36	689.7	914.68	1102.37	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	420.26	281.97	189.21	72.2	17.79	0	0	0	0	83.47	262.99	439.35	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1767.23 (98)

Space heating requirement in kWh/m²/year 25 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	420.26	281.97	189.21	72.2	17.79	0	0	0	0	83.47	262.99	439.35	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	464.89	311.91	209.3	79.86	19.68	0	0	0	0	92.33	290.91	486.01	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1954.9 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23

Efficiency of water heater 80.3 (216)

(217)m=	86.96	86.34	85.25	83.25	81.26	80.3	80.3	80.3	80.3	83.46	86.09	87.11

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	221.66	195.02	205.51	186.64	185.13	165	158.09	176.23	178.17	195.21	202.01	216.08

Total = Sum(219a)$_{1...12}$ = 2284.75 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1954.9	
Water heating fuel used		2284.75	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	165.6		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		195.6	(231)
Electricity for lighting		313.18	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	422.26	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	493.51	(264)
Space and water heating	(261) + (262) + (263) + (264) =			915.77	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	101.52	(267)
Electricity for lighting	(232) x	0.519	=	162.54	(268)
Total CO2, kg/year	sum of (265)…(271) =			1179.82	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			16.69	(273)
EI rating (section 14)				86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 42

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.46	(1a) x	2.56	(2a) =	129.18	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.46	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.18	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	24.7	10.95	13.75	x	0.16	=	2.2			(29)
Walls Type2	19.12	2.42	16.7	x	0.14	=	2.36			(29)
Roof	50.46	0	50.46	x	0.12	=	6.06			(30)
Total area of elements, m²			94.28							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 28.52 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 971.79 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.5 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 36.02 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.07	13.89	13.71	12.8	12.62	11.71	11.71	11.53	12.07	12.62	12.98	13.34	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	50.09	49.91	49.72	48.82	48.64	47.73	47.73	47.55	48.09	48.64	49	49.36	

Average = Sum(39)$_{1...12}$ /12= 48.77 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.99	0.99	0.99	0.97	0.96	0.95	0.95	0.94	0.95	0.96	0.97	0.98

Average = Sum(40)$_{1...12}$ /12= 0.97 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.66 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.13	79.14	76.15	73.17	70.18	67.2	67.2	70.18	73.17	76.15	79.14	82.13

Total = Sum(44)$_{1...12}$ = 895.94 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.79	106.52	109.92	95.83	91.95	79.35	73.53	84.37	85.38	99.5	108.62	117.95

Total = Sum(45)$_{1...12}$ = 1174.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.37	13.79	11.9	11.03	12.66	12.81	14.93	16.29	17.69

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.85	36.43	38.81	36.08	35.76	33.14	34.24	35.76	36.08	38.81	39.03	41.85	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	

Output from water heater (annual)$_{1...12}$ 1622.57 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.96	44.52	46.25	40.88	39.52	34.67	33.01	37	37.41	42.79	45.87	49.68	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.24	11.76	9.57	7.24	5.41	4.57	4.94	6.42	8.62	10.94	12.77	13.61	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.43	149.97	146.09	137.82	127.39	117.59	111.04	109.5	113.38	121.65	132.08	141.88	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	(71)

Water heating gains (Table 5)

(72)m=	68.49	66.26	62.16	56.78	53.11	48.15	44.37	49.72	51.96	57.51	63.71	66.78	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.72	279.54	269.37	253.41	237.47	221.87	211.9	217.2	225.51	241.65	260.11	273.82	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	66.12	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	81.93	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	91.77	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	107.49	183.1	250.53	310.42	347.69	345.18	332.79	304.98	271.27	202.37	128.75	91.99	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	389.21	462.65	519.9	563.82	585.17	567.04	544.69	522.18	496.78	444.02	388.86	365.81	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.73	0.53	0.38	0.42	0.65	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.14	20.33	20.57	20.81	20.95	20.99	21	21	20.98	20.8	20.42	20.11	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.09	20.1	20.11	20.11	20.13	20.13	20.13	20.12	20.11	20.11	20.1	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.67	0.46	0.31	0.34	0.57	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.95	19.23	19.57	19.9	20.07	20.12	20.13	20.13	20.11	19.9	19.38	18.92	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.34	19.59	19.89	20.2	20.35	20.41	20.41	20.42	20.39	20.19	19.72	19.31	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.19	19.44	19.74	20.05	20.2	20.26	20.26	20.27	20.24	20.04	19.57	19.16	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.84	0.68	0.47	0.32	0.35	0.58	0.87	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	384.48	448.97	484.08	472.02	395.73	268.29	174.71	183.54	289.56	384.96	377.93	362.49	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	745.81	725.65	658.49	544.28	413.61	270.09	174.86	183.79	295.43	459.25	611.18	738.2	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	268.83	185.93	129.76	52.03	13.3	0	0	0	0	55.27	167.94	279.53	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1152.6 (98)

Space heating requirement in kWh/m²/year 22.84 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	268.83	185.93	129.76	52.03	13.3	0	0	0	0	55.27	167.94	279.53	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	297.38	205.67	143.54	57.55	14.71	0	0	0	0	61.14	185.77	309.22	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1274.99 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8

Efficiency of water heater 80.3 (216)

(217)m=	86.29	85.71	84.71	82.92	81.16	80.3	80.3	80.3	80.3	82.95	85.38	86.45	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.64	166.77	175.57	159.09	157.37	140.08	134.21	149.61	151.26	166.75	172.93	184.86	

Total = Sum(219a)$_{1...12}$ = 1948.15 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1274.99

DER WorkSheet: New dwelling design stage

Water heating fuel used			1948.15	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		118.2		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		148.2	(231)
Electricity for lighting			233.89	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	275.4	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	420.8	(264)
Space and water heating	(261) + (262) + (263) + (264) =				696.2	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	76.91	(267)
Electricity for lighting	(232) x		0.519	=	121.39	(268)
Total CO2, kg/year		sum of (265)…(271) =			894.5	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			17.73	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 43

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	49.88	(1a) x	2.56	(2a) =	127.71	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	49.88	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		127.71	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	24.52	10.95	13.57	x	0.16	=	2.17			(29)
Walls Type2	18.94	2.42	16.52	x	0.14	=	2.34			(29)
Roof	49.88	0	49.88	x	0.12	=	5.99			(30)
Total area of elements, m²			93.34							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 28.4 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 960.46 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.48 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.88 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	13.91	13.73	13.55	12.65	12.47	11.58	11.58	11.4	11.94	12.47	12.83	13.19	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	49.78	49.6	49.42	48.53	48.35	47.45	47.45	47.28	47.81	48.35	48.71	49.07	

Average = Sum(39)$_{1...12}$ /12= 48.48 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1	0.99	0.99	0.97	0.97	0.95	0.95	0.95	0.96	0.97	0.98	0.98

Average = Sum(40)$_{1...12}$ /12= 0.97 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.69 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.26 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(44)m=	81.69	78.72	75.74	72.77	69.8	66.83	66.83	69.8	72.77	75.74	78.72	81.69

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 891.11 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.14	105.95	109.33	95.31	91.46	78.92	73.13	83.92	84.92	98.97	108.03	117.31

Total = Sum(45)$_{1...12}$ = 1168.39 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.17	15.89	16.4	14.3	13.72	11.84	10.97	12.59	12.74	14.85	16.2	17.6

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.63	36.23	38.6	35.89	35.57	32.96	34.06	35.57	35.89	38.6	38.82	41.63	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	

Output from water heater (annual)$_{1...12}$ 1613.83 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.68	44.29	46	40.66	39.3	34.48	32.83	36.8	37.21	42.56	45.62	49.41	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.1	11.64	9.47	7.17	5.36	4.52	4.89	6.35	8.53	10.83	12.63	13.47	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	146.94	148.46	144.62	136.44	126.11	116.41	109.92	108.4	112.24	120.42	130.75	140.45	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	(71)

Water heating gains (Table 5)

(72)m=	68.12	65.9	61.83	56.48	52.83	47.89	44.13	49.46	51.68	57.2	63.37	66.42	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	279.47	277.3	267.21	251.38	235.6	220.12	210.24	215.51	223.75	239.75	258.05	271.64	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	85.75	0.55	x	0.7	=	66.12	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25	0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	2.89	x	106.25	0.55	x	0.7	=	81.93	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01	0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	2.89	x	119.01	0.55	x	0.7	=	91.77	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15	0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	2.89	x	118.15	0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91	0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91	0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39	0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39	0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85	0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85	0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27	0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27	0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07	0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07	0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49	0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49	0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	107.49	183.1	250.53	310.42	347.69	345.18	332.79	304.98	271.27	202.37	128.75	91.99	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	386.96	460.4	517.74	561.8	583.29	565.3	543.03	520.49	495.02	442.11	386.8	363.63	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.72	0.53	0.38	0.42	0.64	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.13	20.33	20.56	20.81	20.95	20.99	21	21	20.98	20.8	20.42	20.1	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.09	20.09	20.11	20.11	20.12	20.12	20.13	20.12	20.11	20.1	20.1	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.67	0.46	0.31	0.34	0.57	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.94	19.22	19.56	19.9	20.06	20.12	20.12	20.13	20.1	19.89	19.37	18.91	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.34	19.59	19.89	20.2	20.35	20.41	20.41	20.42	20.39	20.19	19.72	19.3	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.19	19.44	19.74	20.05	20.2	20.26	20.26	20.27	20.24	20.04	19.57	19.15	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.84	0.67	0.47	0.32	0.35	0.58	0.87	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	382.16	446.55	481.55	469.42	393.42	266.73	173.71	182.48	287.85	382.76	375.75	360.26	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	741.15	721.21	654.52	541.07	411.18	268.53	173.86	182.73	293.71	456.54	607.47	733.64	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	267.09	184.57	128.69	51.59	13.21	0	0	0	0	54.89	166.84	277.79	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1144.67 (98)

Space heating requirement in kWh/m²/year 22.95 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	267.09	184.57	128.69	51.59	13.21	0	0	0	0	54.89	166.84	277.79	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	295.46	204.17	142.36	57.06	14.62	0	0	0	0	60.71	184.56	307.29	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1266.22 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	

Efficiency of water heater 80.3 (216)

(217)m=	86.29	85.71	84.7	82.91	81.15	80.3	80.3	80.3	80.3	82.94	85.37	86.44	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	188.62	165.88	174.64	158.24	156.53	139.33	133.49	148.81	150.45	165.86	172.01	183.87	

Total = Sum(219a)$_{1...12}$ = 1937.72 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1266.22

DER WorkSheet: New dwelling design stage

Water heating fuel used		1937.72	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	116.85		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	146.85	(231)
Electricity for lighting		231.44	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	273.5	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	418.55	(264)
Space and water heating	(261) + (262) + (263) + (264) =				692.05	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	76.22	(267)
Electricity for lighting	(232) x		0.519	=	120.12	(268)
Total CO2, kg/year		sum of (265)…(271) =			888.38	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			17.81	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 44

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.49	(1a) x	2.56	(2a) =	129.25	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.49	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.25	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	15.41	10.95	4.46	x	0.16	=	0.71			(29)
Walls Type2	48.46	2.42	46.04	x	0.14	=	6.51			(29)
Roof	50.5	0	50.5	x	0.12	=	6.06			(30)
Total area of elements, m²			114.36							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.19 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1312.93 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.97 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 37.16 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.08	13.89	13.71	12.81	12.63	11.72	11.72	11.54	12.08	12.63	12.99	13.35	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	51.24	51.06	50.88	49.97	49.79	48.88	48.88	48.7	49.25	49.79	50.15	50.52	

Average = Sum(39)$_{1...12}$ /12= 49.93 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.01	1.01	1.01	0.99	0.99	0.97	0.97	0.96	0.98	0.99	0.99	1	
											Average = Sum(40)$_{1...12}$ /12=	0.99	(40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.68 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	82.15	79.16	76.18	73.19	70.2	67.21	67.21	70.2	73.19	76.18	79.16	82.15	
											Total = Sum(44)$_{1...12}$ =	896.19	(44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.83	106.55	109.95	95.86	91.98	79.37	73.55	84.4	85.41	99.53	108.65	117.98	
											Total = Sum(45)$_{1...12}$ =	1175.05	(45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.38	13.8	11.91	11.03	12.66	12.81	14.93	16.3	17.7	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.86	36.44	38.82	36.09	35.77	33.15	34.25	35.77	36.09	38.82	39.04	41.86	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85	

Output from water heater (annual)$_{1...12}$ 1623.02 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.97	44.54	46.26	40.9	39.53	34.68	33.02	37.01	37.42	42.8	45.88	49.7	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.25	11.77	9.57	7.25	5.42	4.57	4.94	6.42	8.62	10.95	12.78	13.62	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.51	150.05	146.16	137.9	127.46	117.65	111.1	109.56	113.44	121.71	132.15	141.95	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	(71)

Water heating gains (Table 5)

(72)m=	68.51	66.28	62.18	56.8	53.13	48.16	44.38	49.74	51.97	57.53	63.73	66.79	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.84	279.66	269.49	253.51	237.57	221.96	211.99	217.29	225.6	241.75	260.22	273.94	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast 0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast 0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast 0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast 0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast 0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast 0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast 0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast 0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast 0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)
Southwest 0.9x	0.77	x	8.06	x	36.79		0.55	x	0.7	=	79.12	(79)
Southwest 0.9x	0.77	x	8.06	x	62.67		0.55	x	0.7	=	134.78	(79)
Southwest 0.9x	0.77	x	8.06	x	85.75		0.55	x	0.7	=	184.41	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	107.49	183.1	250.53	310.42	347.69	345.18	332.79	304.98	271.27	202.37	128.75	91.99	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	389.33	462.76	520.01	563.93	585.26	567.13	544.78	522.27	496.87	444.12	388.97	365.93	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.88	0.74	0.54	0.39	0.43	0.66	0.91	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.11	20.3	20.54	20.79	20.94	20.99	21	21	20.97	20.78	20.4	20.07	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.07	20.07	20.08	20.09	20.09	20.11	20.11	20.11	20.1	20.09	20.09	20.08	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.85	0.68	0.47	0.31	0.35	0.58	0.88	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.89	19.17	19.51	19.86	20.04	20.1	20.11	20.11	20.09	19.86	19.33	18.85	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.29	19.54	19.85	20.17	20.33	20.39	20.4	20.4	20.38	20.16	19.68	19.25	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.14	19.39	19.7	20.02	20.18	20.24	20.25	20.25	20.23	20.01	19.53	19.1	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.84	0.69	0.48	0.33	0.36	0.59	0.87	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	384.68	449.51	485.56	475.82	401.73	273.72	178.26	187.29	294.75	387.46	378.38	362.66	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	760.34	739.86	671.5	555.48	422.41	275.93	178.45	187.61	301.73	468.57	623.31	752.83	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	279.49	195.12	138.34	57.36	15.39	0	0	0	0	60.34	176.35	290.29	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1212.67 (98)

Space heating requirement in kWh/m²/year 24.02 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	279.49	195.12	138.34	57.36	15.39	0	0	0	0	60.34	176.35	290.29	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	309.17	215.84	153.03	63.45	17.02	0	0	0	0	66.75	195.08	321.12	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1341.45 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85	

Efficiency of water heater 80.3 (216)

(217)m=	86.39	85.83	84.87	83.11	81.28	80.3	80.3	80.3	80.3	83.12	85.5	86.53	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.49	166.59	175.29	158.76	157.18	140.12	134.25	149.65	151.31	166.45	172.74	184.72	

Total = Sum(219a)$_{1...12}$ = 1946.54 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1341.45

DER WorkSheet: New dwelling design stage

Water heating fuel used		1946.54	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.27		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	148.27	(231)
Electricity for lighting		234.02	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	289.75	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	420.45	(264)
Space and water heating	(261) + (262) + (263) + (264) =				710.21	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	76.95	(267)
Electricity for lighting	(232) x		0.519	=	121.46	(268)
Total CO2, kg/year		sum of (265)…(271) =			908.61	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			18	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 45

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.04	(1a) x	2.56	(2a) =	186.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.04	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	36.47	17.3	19.17	x	0.16	=	3.07			(29)
Walls Type2	41.48	2.42	39.06	x	0.14	=	5.52			(29)
Roof	73.04	0	73.04	x	0.12	=	8.76			(30)
Total area of elements, m²			150.99							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.68 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1647.24 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.78 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 51.46 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.36	20.1	19.84	18.53	18.26	16.95	16.95	16.69	17.48	18.26	18.79	19.31	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	71.82	71.56	71.3	69.99	69.72	68.41	68.41	68.15	68.94	69.72	70.25	70.77	

Average = Sum(39)$_{1...12}$ /12= 69.92 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.98	0.98	0.98	0.96	0.95	0.94	0.94	0.93	0.94	0.95	0.96	0.97

Average = Sum(40)$_{1...12}$ /12= 0.96 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.24 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.17	94.6	91.03	87.46	83.89	80.32	80.32	83.89	87.46	91.03	94.6	98.17

Total = Sum(44)$_{1...12}$ = 1070.92 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.58	127.32	131.39	114.55	109.91	94.84	87.89	100.85	102.06	118.94	129.83	140.99

Total = Sum(45)$_{1...12}$ = 1404.14 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.84	19.1	19.71	17.18	16.49	14.23	13.18	15.13	15.31	17.84	19.47	21.15

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.03	43.54	46.39	43.13	42.75	39.61	40.93	42.75	43.13	46.39	46.65	50.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	

Output from water heater (annual)$_{1...12}$ 1939.46 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.91	53.22	55.28	48.87	47.23	41.44	39.45	44.22	44.72	51.14	54.83	59.38	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.21	16.18	13.16	9.96	7.44	6.29	6.79	8.83	11.85	15.04	17.56	18.72	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.29	206.41	201.06	189.69	175.34	161.84	152.83	150.71	156.05	167.42	181.78	195.27	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	(71)

Water heating gains (Table 5)

(72)m=	81.87	79.2	74.31	67.87	63.48	57.55	53.03	59.44	62.11	68.74	76.15	79.82	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	365.13	362.54	349.29	328.29	307.03	286.45	273.42	279.74	290.77	311.97	336.26	354.57	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	169.83	289.28	395.81	490.43	549.32	545.35	525.77	481.84	428.58	319.72	203.42	145.34	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	534.96	651.83	745.1	818.72	856.35	831.79	799.19	761.58	719.35	631.69	539.67	499.91	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.71	0.52	0.38	0.41	0.64	0.91	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.11	20.32	20.57	20.82	20.95	20.99	21	21	20.98	20.8	20.41	20.08	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.1	20.1	20.1	20.12	20.12	20.14	20.14	20.14	20.13	20.12	20.12	20.11	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.66	0.45	0.3	0.33	0.57	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.93	19.23	19.58	19.92	20.08	20.13	20.14	20.14	20.12	19.9	19.36	18.89	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.25	19.52	19.85	20.16	20.32	20.37	20.37	20.37	20.35	20.15	19.65	19.21	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.1	19.37	19.7	20.01	20.17	20.22	20.22	20.22	20.2	20	19.5	19.06	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.66	0.46	0.31	0.34	0.57	0.87	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	529.63	633.99	693.88	680.29	567.72	382.16	247.56	260.25	413.1	549.01	526.46	496.32	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1062.89	1035.72	940.93	777.89	590.29	384.28	247.72	260.54	420.63	655.16	870.95	1051.73	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	396.74	269.97	183.81	70.27	16.79	0	0	0	0	78.97	248.03	413.23	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1677.81 (98)

Space heating requirement in kWh/m²/year 22.97 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	396.74	269.97	183.81	70.27	16.79	0	0	0	0	78.97	248.03	413.23	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	438.88	298.63	203.33	77.73	18.57	0	0	0	0	87.36	274.37	457.11	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1855.99 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01

Efficiency of water heater 80.3 (216)

(217)m=	86.8	86.2	85.14	83.16	81.2	80.3	80.3	80.3	80.3	83.31	85.91	86.94	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	225.36	198.23	208.81	189.6	188.01	167.44	160.42	178.83	180.81	198.45	205.43	219.7	

Total = Sum(219a)$_{1...12}$ = 2321.08 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1855.99

DER WorkSheet: New dwelling design stage

Water heating fuel used		2321.08	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	171.09		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	201.09	(231)
Electricity for lighting		321.63	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	400.89	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	501.35	(264)
Space and water heating	(261) + (262) + (263) + (264) =				902.25	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	104.37	(267)
Electricity for lighting	(232) x		0.519	=	166.93	(268)
Total CO2, kg/year		sum of (265)…(271) =			1173.54	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			16.07	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 46

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.73	(1a) x	2.56	(2a) =	188.75	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.73	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.75	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	31.87	17.3	14.57	x	0.16	=	2.33			(29)
Walls Type2	39.15	2.42	36.73	x	0.14	=	5.2			(29)
Roof	73.73	0	73.73	x	0.12	=	8.85			(30)
Total area of elements, m²			144.75							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 42.7 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1535.64 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.19 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 50.89 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.55	20.29	20.03	18.7	18.44	17.11	17.11	16.85	17.64	18.44	18.97	19.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	71.44	71.18	70.91	69.59	69.32	68	68	67.74	68.53	69.32	69.85	70.38	

Average = Sum(39)$_{1...12}$ /12= 69.52 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.97	0.97	0.96	0.94	0.94	0.92	0.92	0.92	0.93	0.94	0.95	0.95

Average = Sum(40)$_{1...12}$ /12= 0.94 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.61 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.57	94.99	91.4	87.82	84.24	80.65	80.65	84.24	87.82	91.4	94.99	98.57

Total = Sum(44)$_{1...12}$ = 1075.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.18	127.85	131.93	115.02	110.37	95.24	88.25	101.27	102.48	119.43	130.37	141.57

Total = Sum(45)$_{1...12}$ = 1409.95 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.93	19.18	19.79	17.25	16.55	14.29	13.24	15.19	15.37	17.91	19.55	21.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.23	43.72	46.58	43.31	42.93	39.77	41.1	42.93	43.31	46.58	46.84	50.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8	

Output from water heater (annual)$_{1...12}$ 1947.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.16	53.44	55.51	49.07	47.43	41.61	39.62	44.4	44.9	51.35	55.06	59.63	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.35	16.3	13.26	10.04	7.5	6.33	6.84	8.89	11.94	15.16	17.69	18.86	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.84	207.98	202.59	191.13	176.67	163.07	153.99	151.86	157.24	168.7	183.16	196.76	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	(71)

Water heating gains (Table 5)

(72)m=	82.21	79.53	74.61	68.15	63.75	57.79	53.25	59.68	62.36	69.03	76.47	80.15	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.4	364.8	351.46	330.32	308.91	288.2	275.08	281.43	292.54	313.88	338.32	356.76	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	169.83	289.28	395.81	490.43	549.32	545.35	525.77	481.84	428.58	319.72	203.42	145.34	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	537.23	654.08	747.27	820.75	858.24	833.54	800.86	763.27	721.12	633.6	541.74	502.1	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.71	0.52	0.37	0.41	0.64	0.9	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.13	20.34	20.58	20.83	20.95	20.99	21	21	20.98	20.8	20.42	20.1	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.11	20.11	20.12	20.13	20.13	20.15	20.15	20.15	20.14	20.13	20.13	20.12	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.83	0.66	0.45	0.3	0.33	0.57	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.96	19.26	19.6	19.94	20.09	20.15	20.15	20.15	20.13	19.92	19.39	18.92	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.28	19.55	19.87	20.18	20.33	20.37	20.38	20.38	20.36	20.16	19.67	19.24	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.13	19.4	19.72	20.03	20.18	20.22	20.23	20.23	20.21	20.01	19.52	19.09	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.66	0.46	0.31	0.34	0.57	0.87	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	531.93	636.23	695.67	680.61	566.39	380.53	246.54	259.15	411.73	549.84	528.5	498.54	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1059.16	1031.93	937.33	774.52	587.57	382.44	246.69	259.41	418.68	652.45	867.63	1047.85	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	392.26	265.91	179.79	67.61	15.76	0	0	0	0	76.34	244.17	408.68	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1650.53 (98)

Space heating requirement in kWh/m²/year 22.39 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	392.26	265.91	179.79	67.61	15.76	0	0	0	0	76.34	244.17	408.68	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	433.91	294.15	198.89	74.79	17.43	0	0	0	0	84.45	270.1	452.08	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1825.81 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8	

Efficiency of water heater 80.3 (216)

(217)m=	86.76	86.15	85.07	83.08	81.14	80.3	80.3	80.3	80.3	83.23	85.86	86.91	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	226.39	199.15	209.84	190.58	188.91	168.13	161.08	179.57	181.55	199.46	206.4	220.69	

Total = Sum(219a)$_{1...12}$ = 2331.76 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1825.81

DER WorkSheet: New dwelling design stage

Water heating fuel used		2331.76	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	172.7		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	202.7	(231)
Electricity for lighting		324.08	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	394.37	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	503.66	(264)
Space and water heating	(261) + (262) + (263) + (264) =				898.04	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	105.2	(267)
Electricity for lighting	(232) x		0.519	=	168.2	(268)
Total CO2, kg/year		sum of (265)…(271) =			1171.44	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			15.89	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 47

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	58.88	(1a) x	2.56	(2a) =	150.74	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	58.88	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		150.74	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	31.19	15.57	15.62	x	0.16	=	2.5			(29)
Walls Type2	39.09	2.42	36.67	x	0.14	=	5.19			(29)
Roof	58.88	0	58.88	x	0.12	=	7.07			(30)
Total area of elements, m²			129.16							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 38.78 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1418.78 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.28 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 47.06 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	16.42	16.2	15.99	14.94	14.72	13.67	13.67	13.46	14.09	14.72	15.15	15.57	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	63.47	63.26	63.05	61.99	61.78	60.73	60.73	60.52	61.15	61.78	62.21	62.63	

Average = Sum(39)$_{1...12}$ /12= 61.94 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.08	1.07	1.07	1.05	1.05	1.03	1.03	1.03	1.04	1.05	1.06	1.06	
Average = Sum(40)$_{1...12}$ /12=													1.05 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.95 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 80.51 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	88.56	85.34	82.12	78.9	75.68	72.46	72.46	75.68	78.9	82.12	85.34	88.56	
Total = Sum(44)$_{1...12}$ =													966.12 (44)
Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)													
(45)m=	131.33	114.86	118.53	103.34	99.15	85.56	79.29	90.98	92.07	107.3	117.12	127.19	
Total = Sum(45)$_{1...12}$ =													1266.73 (45)
If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)													
(46)m=	19.7	17.23	17.78	15.5	14.87	12.83	11.89	13.65	13.81	16.09	17.57	19.08	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	45.13	39.28	41.85	38.91	38.57	35.73	36.92	38.57	38.91	41.85	42.09	45.13	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32	

Output from water heater (annual)$_{1...12}$ 1749.66 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	54.95	48.01	49.87	44.09	42.61	37.38	35.59	39.89	40.34	46.14	49.47	53.57	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	15.17	13.47	10.96	8.29	6.2	5.23	5.66	7.35	9.87	12.53	14.62	15.59	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	170.12	171.89	167.44	157.97	146.01	134.78	127.27	125.51	129.95	139.42	151.38	162.62	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	(71)

Water heating gains (Table 5)

(72)m=	73.86	71.45	67.03	61.23	57.27	51.92	47.84	53.62	56.03	62.01	68.7	72.01	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	314.39	312.05	300.68	282.74	264.73	247.18	236.02	241.72	251.1	269.21	289.95	305.46	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast	0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)
Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast	0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast	0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast	0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast	0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast	0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast	0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast	0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast	0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast	0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)
Southeast	0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	152.85	260.36	356.23	441.39	494.39	490.81	473.2	433.65	385.72	287.75	183.08	130.81	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	467.24	572.41	656.9	724.13	759.12	737.99	709.21	675.38	636.82	556.96	473.03	436.26	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.86	0.71	0.52	0.38	0.41	0.64	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.04	20.26	20.52	20.79	20.94	20.99	21	21	20.97	20.77	20.35	20	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.02	20.02	20.02	20.04	20.04	20.06	20.06	20.06	20.05	20.04	20.04	20.03	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.82	0.65	0.45	0.3	0.33	0.56	0.86	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.75	19.07	19.45	19.81	19.99	20.05	20.06	20.06	20.03	19.8	19.22	18.71	(90)

fLA = Living area ÷ (4) = 0.34 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.19	19.47	19.81	20.14	20.31	20.37	20.37	20.38	20.35	20.13	19.6	19.14	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.04	19.32	19.66	19.99	20.16	20.22	20.22	20.23	20.2	19.98	19.45	18.99	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.92	0.82	0.66	0.46	0.31	0.34	0.57	0.86	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	461.24	553.47	605.81	594.63	498.93	338.53	219.87	231.12	364.43	479.05	459.04	432.13	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	935.35	912.53	829.94	687.77	522.7	341.21	220.12	231.54	373.05	579.24	768.38	926.4	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	352.74	241.29	166.75	67.07	17.69	0	0	0	0	74.54	222.72	367.74	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1510.54 (98)

Space heating requirement in kWh/m²/year 25.65 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	352.74	241.29	166.75	67.07	17.69	0	0	0	0	74.54	222.72	367.74	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	390.2	266.91	184.46	74.19	19.57	0	0	0	0	82.46	246.38	406.79	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1670.95 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32

Efficiency of water heater 80.3 (216)

(217)m= 86.76 | 86.17 | 85.15 | 83.28 | 81.33 | 80.3 | 80.3 | 80.3 | 80.3 | 83.41 | 85.9 | 86.91 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 203.39 | 178.87 | 188.35 | 170.8 | 169.33 | 151.05 | 144.72 | 161.33 | 163.11 | 178.82 | 185.35 | 198.27

Total = Sum(219a)$_{1...12}$ = 2093.39 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1670.95	
Water heating fuel used		2093.39	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	137.93		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		167.93	(231)
Electricity for lighting		267.84	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	360.93	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	452.17	(264)
Space and water heating	(261) + (262) + (263) + (264) =			813.1	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	87.15	(267)
Electricity for lighting	(232) x	0.519	=	139.01	(268)
Total CO2, kg/year	sum of (265)…(271) =			1039.26	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			17.65	(273)
EI rating (section 14)				87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 48

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.42	(1a) x	2.56	(2a) =	187.95	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.42	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.95	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Windows Type 4			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	52.48	23.08	29.4	x	0.16	=	4.7			(29)
Walls Type2	22.71	2.42	20.29	x	0.14	=	2.87			(29)
Roof	73.42	0	73.42	x	0.12	=	8.81			(30)
Total area of elements, m²			148.61							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 50.37 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1505.51 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 10.78 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 61.15 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.47	20.2	19.94	18.62	18.36	17.04	17.04	16.78	17.57	18.36	18.89	19.41	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	81.62	81.35	81.09	79.77	79.51	78.19	78.19	77.93	78.72	79.51	80.04	80.56	

Average = Sum(39)$_{1...12}$ /12= 79.74 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.11	1.11	1.1	1.09	1.08	1.07	1.07	1.06	1.07	1.08	1.09	1.1	

Average = Sum(40)$_{1...12}$ /12= 1.09 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.45 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	98.39	94.81	91.24	87.66	84.08	80.5	80.5	84.08	87.66	91.24	94.81	98.39	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1073.36 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	145.91	127.61	131.69	114.81	110.16	95.06	88.09	101.08	102.29	119.21	130.12	141.31	

Total = Sum(45)$_{1...12}$ = 1407.34 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.89	19.14	19.75	17.22	16.52	14.26	13.21	15.16	15.34	17.88	19.52	21.2	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.14	43.64	46.49	43.23	42.85	39.7	41.02	42.85	43.23	46.49	46.76	50.14	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	

Output from water heater (annual)$_{1...12}$ 1943.87 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.05	53.34	55.41	48.98	47.34	41.53	39.54	44.32	44.82	51.26	54.96	59.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.29	16.24	13.21	10	7.48	6.31	6.82	8.86	11.9	15.11	17.63	18.8	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.14	207.27	201.9	190.48	176.07	162.52	153.47	151.34	156.7	168.12	182.54	196.09	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	(71)

Water heating gains (Table 5)

(72)m=	82.06	79.38	74.47	68.03	63.63	57.68	53.15	59.57	62.25	68.9	76.33	80	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	366.38	363.78	350.48	329.41	308.07	287.41	274.33	280.67	291.74	313.02	337.39	355.78	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast	0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast	0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast	0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast	0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast	0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast	0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast	0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast	0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast	0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast	0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast	0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)
Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)
Southwest	0.9x	0.77	x	2.89	x	36.79		0.55	x	0.7	=	28.37	(79)
Southwest	0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	48.33	(79)
Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	66.12	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	81.93	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	91.77	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	44.07	0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49	0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	206.9	355.32	493.84	624.75	711.52	711.54	683.85	618.33	539.05	394.77	248.35	176.72	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	573.28	719.1	844.32	954.16	1019.59	998.95	958.18	899	830.79	707.79	585.74	532.5	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.85	0.68	0.49	0.36	0.4	0.63	0.9	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.98	20.22	20.51	20.79	20.94	20.99	21	21	20.97	20.75	20.31	19.94	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.99	19.99	20	20.01	20.01	20.03	20.03	20.03	20.02	20.01	20.01	20	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.81	0.62	0.42	0.28	0.31	0.55	0.86	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.65	19	19.41	19.79	19.97	20.02	20.03	20.03	20.01	19.75	19.14	18.6	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.98	19.3	19.68	20.04	20.21	20.27	20.27	20.27	20.25	20	19.43	18.93	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.83	19.15	19.53	19.89	20.06	20.12	20.12	20.12	20.1	19.85	19.28	18.78	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	0.99	0.97	0.92	0.8	0.63	0.43	0.29	0.32	0.56	0.86	0.97	0.99	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	566.26	694.82	773.82	766.02	638.78	428.58	275.11	289.69	461.7	606.19	568.88	527.78	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	1185.9	1159.51	1056.76	876.95	664.79	431.35	275.36	290.15	472.08	735.74	974.74	1174.69	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	461.01	312.27	210.51	79.87	19.35	0	0	0	0	96.38	292.22	481.3	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1952.92 (98)

Space heating requirement in kWh/m²/year 26.6 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

DER WorkSheet: New dwelling design stage

Fraction of space heat from main system(s)	(202) = 1 – (201) =	1	(202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1	(204)
Efficiency of main space heating system 1		90.4	(206)
Efficiency of secondary/supplementary heating system, %		0	(208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	461.01	312.27	210.51	79.87	19.35	0	0	0	0	96.38	292.22	481.3	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)	509.97	345.44	232.87	88.35	21.41	0	0	0	0	106.62	323.25	532.42	(211)

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 2160.31 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Output from water heater (calculated above)	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45
Efficiency of water heater												80.3 (216)
(217)m=	87.13	86.54	85.47	83.43	81.32	80.3	80.3	80.3	80.3	83.74	86.31	87.28 (217)
Fuel for water heating, kWh/month (219)m = (64)m x 100 ÷ (217)m												
(219)m=	225.01	197.88	208.47	189.43	188.15	167.82	160.79	179.24	181.22	197.87	204.95	219.36

Total = Sum(219a)$_{1...12}$ = 2320.17 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2160.31	
Water heating fuel used		2320.17	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	171.97		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	201.97	(231)
Electricity for lighting		322.98	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	466.63	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	501.16	(264)
Space and water heating	(261) + (262) + (263) + (264) =				967.78	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	104.82	(267)
Electricity for lighting	(232) x		0.519	=	167.63	(268)

DER WorkSheet: New dwelling design stage

Total CO2, kg/year	sum of (265)…(271) =	1240.23	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =	16.89	(273)
EI rating (section 14)		86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 49

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	72.68	(1a) x	2.56	(2a) =	186.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	72.68	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x	1/[1/(1.4)+ 0.04]	=	10.69			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Windows Type 3			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Walls Type1	55.67	20.19	35.48	x	0.16	=	5.68			(29)
Walls Type2	22.71	2.42	20.29	x	0.14	=	2.87			(29)
Roof	72.68	0	72.68	x	0.12	=	8.72			(30)
Total area of elements, m²			151.05							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 47.42 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1602.12 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.02 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 56.44 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.26	20	19.74	18.43	18.17	16.87	16.87	16.61	17.39	18.17	18.7	19.22	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	76.71	76.44	76.18	74.88	74.62	73.31	73.31	73.05	73.83	74.62	75.14	75.66	

Average = Sum(39)$_{1...12}$ /12= 74.81 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.06	1.05	1.05	1.03	1.03	1.01	1.01	1.01	1.02	1.03	1.03	1.04

Average = Sum(40)$_{1...12}$ /12= 1.03 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.31 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.05 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	97.95	94.39	90.83	87.26	83.7	80.14	80.14	83.7	87.26	90.83	94.39	97.95

Total = Sum(44)$_{1...12}$ = 1068.55 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.26	127.04	131.1	114.29	109.67	94.63	87.69	100.63	101.83	118.67	129.54	140.67

Total = Sum(45)$_{1...12}$ = 1401.04 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.79	19.06	19.66	17.14	16.45	14.2	13.15	15.09	15.27	17.8	19.43	21.1

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.91	43.44	46.28	43.03	42.65	39.52	40.84	42.65	43.03	46.28	46.55	49.91	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59	

Output from water heater (annual)$_{1...12}$ 1935.17 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.78	53.1	55.16	48.76	47.13	41.35	39.37	44.12	44.62	51.03	54.71	59.25	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.14	16.11	13.1	9.92	7.41	6.26	6.76	8.79	11.8	14.98	17.49	18.64	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	203.46	205.57	200.25	188.92	174.63	161.19	152.21	150.1	155.42	166.75	181.05	194.48	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	(71)

Water heating gains (Table 5)

(72)m=	81.69	79.02	74.14	67.72	63.34	57.43	52.91	59.3	61.97	68.59	75.99	79.64	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	363.93	361.34	348.13	327.21	306.03	285.51	272.53	278.84	289.83	310.96	335.16	353.41	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)
Northwest 0.9x	0.77	x	8.06	x	11.28	x	0.55	x	0.7	=	24.26	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	8.06	x	22.97	x	0.55	x	0.7	=	49.39	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	8.06	x	41.38	x	0.55	x	0.7	=	88.98	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	8.06	x	67.96	x	0.55	x	0.7	=	146.14	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	8.06	x	91.35	x	0.55	x	0.7	=	196.43	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	8.06	x	97.38	x	0.55	x	0.7	=	209.42	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	8.06	x	91.1	x	0.55	x	0.7	=	195.91	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	8.06	x	72.63	x	0.55	x	0.7	=	156.18	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	8.06	x	50.42	x	0.55	x	0.7	=	108.43	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	8.06	x	28.07	x	0.55	x	0.7	=	60.36	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	8.06	x	14.2	x	0.55	x	0.7	=	30.53	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	8.06	x	9.21	x	0.55	x	0.7	=	19.81	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	80.45	154.33	257.11	395.59	513.39	540.6	508.33	415.72	304.32	182.96	99.51	66.81	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	444.38	515.68	605.25	722.8	819.42	826.12	780.86	694.56	594.15	493.92	434.67	420.22	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.92	0.77	0.56	0.41	0.48	0.78	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.9	20.06	20.33	20.69	20.91	20.99	21	21	20.94	20.61	20.19	19.88	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.04	20.04	20.04	20.06	20.06	20.08	20.08	20.08	20.07	20.06	20.06	20.05	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.9	0.71	0.48	0.33	0.39	0.7	0.95	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.57	18.8	19.19	19.7	19.98	20.07	20.08	20.08	20.02	19.61	19.01	18.54	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.9	19.11	19.48	19.95	20.22	20.3	20.31	20.31	20.25	19.86	19.3	18.88	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.75	18.96	19.33	19.8	20.07	20.15	20.16	20.16	20.1	19.71	19.15	18.73	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.89	0.71	0.49	0.33	0.39	0.7	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	442.43	510.55	587.21	644.98	584.25	402.82	260.33	273.55	417.18	467.31	430.58	418.83	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1108.32	1074.91	977.19	815.93	624.3	406.8	260.71	274.46	442.99	679.48	905.72	1099.12	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	495.42	379.25	290.14	123.08	29.79	0	0	0	0	157.85	342.1	506.13	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2323.78 (98)

Space heating requirement in kWh/m²/year 31.97 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	495.42	379.25	290.14	123.08	29.79	0	0	0	0	157.85	342.1	506.13	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	548.03	419.52	320.96	136.16	32.96	0	0	0	0	174.62	378.43	559.88	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2570.55 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59

Efficiency of water heater 80.3 (216)

(217)m= 87.3 | 87.01 | 86.28 | 84.44 | 81.8 | 80.3 | 80.3 | 80.3 | 80.3 | 84.94 | 86.69 | 87.39 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 223.57 | 195.95 | 205.58 | 186.32 | 186.22 | 167.07 | 160.07 | 178.43 | 180.41 | 194.2 | 203.12 | 218.08

Total = Sum(219a)$_{1...12}$ = 2299.02 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2570.55
Water heating fuel used		2299.02
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	170.24	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		200.24 (231)
Electricity for lighting		320.33 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216 =	555.24 (261)
Space heating (secondary)	(215) x	0.519 =	0 (263)
Water heating	(219) x	0.216 =	496.59 (264)
Space and water heating	(261) + (262) + (263) + (264) =		1051.83 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519 =	103.92 (267)
Electricity for lighting	(232) x	0.519 =	166.25 (268)
Total CO2, kg/year	sum of (265)…(271) =		1322 (272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =		18.19 (273)
EI rating (section 14)			85 (274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 50

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	66.61	(1a) x	2.56	(2a) =	170.53	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	66.61	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		170.53	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Walls Type1	31.65	14.38	17.27	x	0.16	=	2.76			(29)
Walls Type2	32.4	2.42	29.98	x	0.14	=	4.24			(29)
Roof	66.61	0	66.61	x	0.12	=	7.99			(30)
Total area of elements, m²			130.66							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 37.45 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1402.72 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.26 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 45.71 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	18.57	18.33	18.09	16.9	16.66	15.46	15.46	15.22	15.94	16.66	17.14	17.61	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	64.28	64.04	63.8	62.6	62.36	61.17	61.17	60.93	61.65	62.36	62.84	63.32	

Average = Sum(39)$_{1...12}$ /12= 62.54 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.96	0.96	0.94	0.94	0.92	0.92	0.91	0.93	0.94	0.94	0.95

Average = Sum(40)$_{1...12}$ /12= 0.94 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.16 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 85.53 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	94.08	90.66	87.24	83.82	80.4	76.98	76.98	80.4	83.82	87.24	90.66	94.08

Total = Sum(44)$_{1...12}$ = 1026.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	139.52	122.03	125.92	109.78	105.34	90.9	84.23	96.65	97.81	113.99	124.43	135.12

Total = Sum(45)$_{1...12}$ = 1345.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	20.93	18.3	18.89	16.47	15.8	13.63	12.63	14.5	14.67	17.1	18.66	20.27

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.94	41.73	44.46	41.34	40.97	37.96	39.23	40.97	41.34	44.46	44.71	47.94	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06	

Output from water heater (annual)$_{1...12}$ 1858.74 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	58.38	51.01	52.98	46.84	45.27	39.71	37.81	42.38	42.86	49.01	52.55	56.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.89	15	12.2	9.24	6.91	5.83	6.3	8.19	10.99	13.95	16.29	17.36	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	189.27	191.24	186.29	175.75	162.45	149.95	141.6	139.63	144.58	155.12	168.42	180.92	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	(71)

Water heating gains (Table 5)

(72)m=	78.46	75.9	71.21	65.05	60.84	55.16	50.82	56.96	59.52	65.88	72.98	76.5	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	343.05	340.56	328.12	308.46	288.62	269.35	257.14	263.2	273.51	293.37	316.11	333.2	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	8.06	x	11.28	x	0.55	x	0.7	=	24.26	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	8.06	x	22.97	x	0.55	x	0.7	=	49.39	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	8.06	x	41.38	x	0.55	x	0.7	=	88.98	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	8.06	x	67.96	x	0.55	x	0.7	=	146.14	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	8.06	x	91.35	x	0.55	x	0.7	=	196.43	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	8.06	x	97.38	x	0.55	x	0.7	=	209.42	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	8.06	x	91.1	x	0.55	x	0.7	=	195.91	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	8.06	x	72.63	x	0.55	x	0.7	=	156.18	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	8.06	x	50.42	x	0.55	x	0.7	=	108.43	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	8.06	x	28.07	x	0.55	x	0.7	=	60.36	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	8.06	x	14.2	x	0.55	x	0.7	=	30.53	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	8.06	x	9.21	x	0.55	x	0.7	=	19.81	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	43.29	88.12	158.76	260.72	350.46	373.63	349.52	278.64	193.45	107.68	54.47	35.35	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	386.33	428.67	486.88	569.18	639.08	642.99	606.66	541.85	466.96	401.06	370.58	368.55	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.81	0.6	0.44	0.51	0.81	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20	20.12	20.35	20.68	20.91	20.99	21	21	20.93	20.62	20.26	19.98	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.11	20.12	20.12	20.13	20.14	20.15	20.15	20.16	20.15	20.14	20.13	20.12	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.93	0.76	0.52	0.36	0.42	0.75	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.76	18.94	19.29	19.76	20.05	20.14	20.15	20.15	20.09	19.69	19.16	18.75	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.1	19.27	19.58	20.01	20.29	20.38	20.38	20.38	20.32	19.95	19.47	19.09	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.95	19.12	19.43	19.86	20.14	20.23	20.23	20.23	20.17	19.8	19.32	18.94	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.76	0.53	0.37	0.43	0.75	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	385.03	425.82	477.4	525.05	486.67	340.42	221.93	232.82	349.38	385.37	367.97	367.59	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	941.8	910.38	824.77	686.24	526.17	344.12	222.25	233.63	374.41	573.57	767.64	933.32	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	414.24	325.63	258.44	116.06	29.39	0	0	0	0	140.02	287.77	420.9	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1992.44 (98)

Space heating requirement in kWh/m²/year 29.91 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	414.24	325.63	258.44	116.06	29.39	0	0	0	0	140.02	287.77	420.9	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	458.23	360.21	285.89	128.38	32.51	0	0	0	0	154.89	318.33	465.6	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2204.03 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06

Efficiency of water heater 80.3 (216)

(217)m=	86.99	86.75	86.1	84.4	81.83	80.3	80.3	80.3	80.3	84.74	86.38	87.08	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	215.5	188.77	197.89	179.06	178.79	160.47	153.74	171.39	173.28	186.97	195.81	210.22	

Total = Sum(219a)$_{1...12}$ = 2211.89 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2204.03

DER WorkSheet: New dwelling design stage

Water heating fuel used		2211.89	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	156.04		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	186.04	(231)
Electricity for lighting		298.32	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	476.07	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	477.77	(264)
Space and water heating	(261) + (262) + (263) + (264) =				953.84	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	96.55	(267)
Electricity for lighting	(232) x		0.519	=	154.83	(268)
Total CO2, kg/year		sum of (265)…(271) =			1205.22	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			18.09	(273)
EI rating (section 14)					86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 51

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.61	(1a) x	2.56	(2a) =	132.12	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.61	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		132.12	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	25.19	9.48	15.71	x	0.16	=	2.51			(29)
Walls Type2	25.13	2.42	22.71	x	0.14	=	3.21			(29)
Roof	51.61	0	51.61	x	0.12	=	6.19			(30)
Total area of elements, m²			101.93							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 27.87 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1117.59 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.35 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.22 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.39	14.2	14.02	13.09	12.91	11.98	11.98	11.79	12.35	12.91	13.28	13.65	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	49.61	49.43	49.24	48.31	48.13	47.2	47.2	47.02	47.57	48.13	48.5	48.87	

Average = Sum(39)$_{1...12}$ /12= 48.27 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.96	0.95	0.94	0.93	0.91	0.91	0.91	0.92	0.93	0.94	0.95

Average = Sum(40)$_{1...12}$ /12= 0.94 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.47 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	83.01	79.99	76.98	73.96	70.94	67.92	67.92	70.94	73.96	76.98	79.99	83.01

Total = Sum(44)$_{1...12}$ = 905.59 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	123.1	107.67	111.1	96.86	92.94	80.2	74.32	85.28	86.3	100.58	109.79	119.22

Total = Sum(45)$_{1...12}$ = 1187.37 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.47	16.15	16.67	14.53	13.94	12.03	11.15	12.79	12.95	15.09	16.47	17.88

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.3	36.82	39.23	36.47	36.15	33.49	34.61	36.15	36.47	39.23	39.45	42.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52	

Output from water heater (annual)$_{1...12}$ 1640.04 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.51	45	46.75	41.32	39.94	35.04	33.36	37.39	37.81	43.25	46.37	50.22	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.74	12.21	9.93	7.52	5.62	4.74	5.12	6.66	8.94	11.35	13.25	14.13	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.41	152.98	149.02	140.59	129.95	119.95	113.27	111.7	115.66	124.09	134.73	144.73	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	(71)

Water heating gains (Table 5)

(72)m=	69.23	66.97	62.83	57.4	53.68	48.67	44.84	50.26	52.52	58.13	64.4	67.5	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	286.45	284.22	273.84	257.57	241.32	225.43	215.3	220.68	229.18	245.63	264.44	278.41	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	9.51	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	19.36	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	34.89	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	57.29	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	77.01	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	82.11	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	76.81	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	61.23	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	42.51	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	23.66	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	11.97	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	7.77	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	28.54	58.09	104.66	171.88	231.04	246.32	230.42	183.7	127.53	70.99	35.91	23.31	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	314.98	342.31	378.5	429.45	472.36	471.74	445.73	404.38	356.71	316.62	300.35	301.72	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.83	0.62	0.46	0.53	0.82	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.03	20.14	20.36	20.67	20.9	20.99	21	21	20.93	20.64	20.29	20.02	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.12	20.12	20.14	20.14	20.16	20.16	20.16	20.15	20.14	20.13	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.94	0.78	0.55	0.38	0.44	0.75	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.82	18.98	19.3	19.75	20.04	20.15	20.15	20.16	20.09	19.71	19.21	18.81	(90)

fLA = Living area ÷ (4) = 0.35 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.25	19.39	19.67	20.07	20.34	20.44	20.45	20.45	20.39	20.04	19.59	19.23	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.1	19.24	19.52	19.92	20.19	20.29	20.3	20.3	20.24	19.89	19.44	19.08	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.79	0.56	0.39	0.45	0.76	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	313.67	339.76	371.22	399.61	372.18	264.82	174.41	182.69	271.06	303.65	297.81	300.72	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	734.06	708.86	641.26	532.49	408.8	268.71	174.77	183.52	292.13	447.08	598.55	727.43	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	312.77	248.04	200.91	95.67	27.24	0	0	0	0	106.71	216.53	317.47	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1525.34 (98)

Space heating requirement in kWh/m²/year 29.56 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	312.77	248.04	200.91	95.67	27.24	0	0	0	0	106.71	216.53	317.47	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	345.98	274.38	222.24	105.83	30.13	0	0	0	0	118.04	239.52	351.18	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1687.32 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52

Efficiency of water heater 80.3 (216)

(217)m=	86.63	86.4	85.78	84.23	81.89	80.3	80.3	80.3	80.3	84.38	85.99	86.72	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	190.93	167.23	175.25	158.3	157.63	141.59	135.65	151.22	152.89	165.68	173.55	186.25	

Total = Sum(219a)$_{1...12}$ = 1956.18 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1687.32

DER WorkSheet: New dwelling design stage

Water heating fuel used		1956.18	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	120.89		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	150.89	(231)
Electricity for lighting		242.71	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	364.46	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	422.54	(264)
Space and water heating	(261) + (262) + (263) + (264) =				787	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	78.31	(267)
Electricity for lighting	(232) x		0.519	=	125.97	(268)
Total CO2, kg/year		sum of (265)…(271) =			991.27	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			19.21	(273)
EI rating (section 14)					86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 52

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.63	(1a) x	2.56	(2a) =	129.62	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.62	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	24.86	9.48	15.38	x	0.16	=	2.46			(29)
Walls Type2	19.11	2.42	16.69	x	0.14	=	2.36			(29)
Roof	50.63	0	50.63	x	0.12	=	6.08			(30)
Total area of elements, m²			94.6							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 26.85 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1000.85 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.67 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 34.53 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.12	13.93	13.75	12.84	12.66	11.75	11.75	11.57	12.12	12.66	13.02	13.39	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	48.64	48.46	48.28	47.37	47.19	46.28	46.28	46.1	46.64	47.19	47.55	47.91	

Average = Sum(39)$_{1...12}$ /12= 47.32 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.96	0.95	0.94	0.93	0.91	0.91	0.91	0.92	0.93	0.94	0.95

Average = Sum(40)$_{1...12}$ /12= 0.93 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.71 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.78 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.26	79.27	76.28	73.29	70.29	67.3	67.3	70.29	73.29	76.28	79.27	82.26

Total = Sum(44)$_{1...12}$ = 897.38 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.99	106.69	110.1	95.98	92.1	79.48	73.65	84.51	85.52	99.66	108.79	118.14

Total = Sum(45)$_{1...12}$ = 1176.6 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.3	16	16.51	14.4	13.81	11.92	11.05	12.68	12.83	14.95	16.32	17.72

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.92	36.49	38.87	36.14	35.82	33.19	34.3	35.82	36.14	38.87	39.09	41.92	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06	

Output from water heater (annual)$_{1...12}$ 1625.17 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.04	44.6	46.32	40.95	39.58	34.72	33.06	37.05	37.47	42.86	45.95	49.76	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.48	11.97	9.73	7.37	5.51	4.65	5.02	6.53	8.77	11.13	12.99	13.85	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.87	150.42	146.52	138.24	127.78	117.94	111.37	109.83	113.72	122.01	132.47	142.3	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	(71)

Water heating gains (Table 5)

(72)m=	68.6	66.36	62.26	56.88	53.2	48.23	44.44	49.8	52.04	57.6	63.81	66.88	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	282.58	280.38	270.15	254.11	238.11	222.45	212.47	217.8	226.16	242.37	260.91	274.67	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	9.51	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	19.36	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	34.89	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	57.29	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	77.01	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	82.11	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	76.81	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	61.23	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	42.51	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	23.66	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	11.97	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	7.77	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	28.54	58.09	104.66	171.88	231.04	246.32	230.42	183.7	127.53	70.99	35.91	23.31	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	311.12	338.47	374.81	425.99	469.15	468.77	442.89	401.49	353.69	313.36	296.82	297.97	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.83	0.62	0.46	0.52	0.81	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.04	20.15	20.37	20.67	20.9	20.99	21	21	20.93	20.64	20.29	20.02	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.12	20.12	20.14	20.14	20.16	20.16	20.16	20.15	20.14	20.13	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.93	0.78	0.54	0.37	0.43	0.75	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.82	18.99	19.31	19.76	20.05	20.15	20.15	20.16	20.1	19.72	19.22	18.81	(90)

fLA = Living area ÷ (4) = 0.36 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.26	19.41	19.69	20.09	20.35	20.45	20.46	20.46	20.4	20.05	19.61	19.25	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.11	19.26	19.54	19.94	20.2	20.3	20.31	20.31	20.25	19.9	19.46	19.1	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.78	0.56	0.39	0.45	0.75	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	309.78	335.86	367.32	395.25	366.85	260.17	171.3	179.45	266.9	300.1	294.23	296.96	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	720.42	695.75	629.5	522.8	401.3	263.76	171.64	180.21	286.8	438.93	587.49	713.88	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	305.51	241.85	195.07	91.83	25.63	0	0	0	0	103.29	211.14	310.19	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1484.52 (98)

Space heating requirement in kWh/m²/year 29.32 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	305.51	241.85	195.07	91.83	25.63	0	0	0	0	103.29	211.14	310.19	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	337.96	267.53	215.78	101.59	28.35	0	0	0	0	114.26	233.57	343.13	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1642.17 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06

Efficiency of water heater 80.3 (216)

(217)m=	86.6	86.36	85.73	84.16	81.83	80.3	80.3	80.3	80.3	84.32	85.95	86.69	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.28	165.79	173.76	157	156.33	140.31	134.42	149.85	151.51	164.29	172.06	184.64	

Total = Sum(219a)$_{1...12}$ = 1939.23 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1642.17

DER WorkSheet: New dwelling design stage

Water heating fuel used		1939.23	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.6		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	148.6	(231)
Electricity for lighting		237.98	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	354.71	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	418.87	(264)
Space and water heating	(261) + (262) + (263) + (264) =				773.58	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	77.12	(267)
Electricity for lighting	(232) x		0.519	=	123.51	(268)
Total CO2, kg/year		sum of (265)…(271) =			974.21	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			19.24	(273)
EI rating (section 14)					86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 53

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.03	(1a) x	2.56	(2a) =	130.63	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.03	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.63	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Walls Type1	25.06	9.48	15.58	x	0.16	=	2.49			(29)
Walls Type2	19.31	2.42	16.89	x	0.14	=	2.39			(29)
Roof	50.03	0	50.03	x	0.12	=	6			(30)
Total area of elements, m²			94.4							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 26.84 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1002.21 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.7 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 34.54 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.23	14.04	13.86	12.94	12.76	11.84	11.84	11.66	12.21	12.76	13.13	13.49	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	48.76	48.58	48.4	47.48	47.3	46.38	46.38	46.2	46.75	47.3	47.66	48.03	

Average = Sum(39)$_{1...12}$ /12= 47.43 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.95	0.95	0.93	0.93	0.91	0.91	0.91	0.92	0.93	0.93	0.94

Average = Sum(40)$_{1...12}$ /12= 0.93 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.06 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.56	79.56	76.56	73.56	70.55	67.55	67.55	70.55	73.56	76.56	79.56	82.56

Total = Sum(44)$_{1...12}$ = 900.7 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.44	107.09	110.5	96.34	92.44	79.77	73.92	84.82	85.83	100.03	109.19	118.58

Total = Sum(45)$_{1...12}$ = 1180.95 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.37	16.06	16.58	14.45	13.87	11.97	11.09	12.72	12.88	15	16.38	17.79

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.07	36.62	39.01	36.27	35.95	33.31	34.42	35.95	36.27	39.01	39.24	42.07	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65	

Output from water heater (annual)$_{1...12}$ 1631.18 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.23	44.76	46.5	41.1	39.72	34.85	33.18	37.19	37.61	43.01	46.12	49.95	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.58	12.06	9.81	7.43	5.55	4.69	5.07	6.58	8.84	11.22	13.1	13.96	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.9	151.45	147.53	139.19	128.66	118.76	112.14	110.59	114.51	122.85	133.38	143.28	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	(71)

Water heating gains (Table 5)

(72)m=	68.86	66.61	62.49	57.09	53.39	48.4	44.6	49.99	52.23	57.81	64.05	67.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	284.14	281.93	271.65	255.51	239.41	223.65	213.61	218.96	227.38	243.69	262.33	276.18	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	9.51	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	19.36	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	34.89	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	57.29	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	77.01	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	82.11	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	76.81	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	61.23	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	42.51	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	23.66	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	11.97	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	7.77	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	28.54	58.09	104.66	171.88	231.04	246.32	230.42	183.7	127.53	70.99	35.91	23.31	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	312.68	340.02	376.3	427.39	470.45	469.97	444.04	402.66	354.91	314.68	298.24	299.49	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.83	0.62	0.46	0.52	0.81	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.04	20.15	20.37	20.68	20.9	20.99	21	21	20.94	20.64	20.3	20.03	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.12	20.13	20.14	20.14	20.16	20.16	20.16	20.15	20.14	20.14	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.93	0.78	0.54	0.37	0.43	0.75	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.84	19	19.32	19.76	20.05	20.15	20.16	20.16	20.1	19.73	19.23	18.83	(90)

fLA = Living area ÷ (4) = 0.36 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.27	19.41	19.69	20.09	20.36	20.45	20.46	20.46	20.4	20.06	19.61	19.26	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.12	19.26	19.54	19.94	20.21	20.3	20.31	20.31	20.25	19.91	19.46	19.11	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.78	0.56	0.39	0.45	0.75	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	311.35	337.43	368.84	396.69	368.02	260.84	171.71	179.88	267.79	301.41	295.67	298.48	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	722.52	697.74	631.26	524.16	402.3	264.38	172.04	180.63	287.51	440.1	589.12	715.92	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	305.91	242.13	195.24	91.78	25.51	0	0	0	0	103.19	211.29	310.57	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1485.62 (98)

Space heating requirement in kWh/m²/year 29.11 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	305.91	242.13	195.24	91.78	25.51	0	0	0	0	103.19	211.29	310.57	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	338.39	267.85	215.97	101.53	28.21	0	0	0	0	114.15	233.73	343.55	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1643.38 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65

Efficiency of water heater 80.3 (216)

(217)m=	86.59	86.35	85.72	84.15	81.81	80.3	80.3	80.3	80.3	84.31	85.94	86.68	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.99	166.41	174.42	157.6	156.93	140.82	134.92	150.41	152.07	164.92	172.71	185.33	

Total = Sum(219a)$_{1...12}$ = 1946.53 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1643.38

DER WorkSheet: New dwelling design stage

Water heating fuel used			1946.53	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		119.52		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		149.52	(231)
Electricity for lighting			239.88	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	354.97	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	420.45	(264)
Space and water heating	(261) + (262) + (263) + (264) =				775.42	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	77.6	(267)
Electricity for lighting	(232) x		0.519	=	124.5	(268)
Total CO2, kg/year		sum of (265)…(271) =			977.52	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			19.16	(273)
EI rating (section 14)					86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 54

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.86	(1a) x	2.56	(2a) =	183.97	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.86	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.97	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	36.57	12.64	23.93	x	0.16	=	3.83			(29)
Walls Type2	26	2.42	23.58	x	0.14	=	3.33			(29)
Roof	71.86	0	71.86	x	0.12	=	8.62			(30)
Total area of elements, m²			134.43							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 35.93 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1454.36 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.29 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 45.22 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.03	19.78	19.52	18.23	17.97	16.68	16.68	16.42	17.2	17.97	18.49	19	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	65.26	65	64.74	63.45	63.19	61.9	61.9	61.64	62.42	63.19	63.71	64.22	

Average = Sum(39)$_{1...12}$ /12= 63.39 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.91	0.9	0.9	0.88	0.88	0.86	0.86	0.86	0.87	0.88	0.89	0.89	

Average = Sum(40)$_{1...12}$ /12= 0.88 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.6 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	97.46	93.91	90.37	86.83	83.28	79.74	79.74	83.28	86.83	90.37	93.91	97.46	

Total = Sum(44)$_{1...12}$ = 1063.18 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	144.53	126.41	130.44	113.72	109.12	94.16	87.25	100.12	101.32	118.08	128.89	139.97	

Total = Sum(45)$_{1...12}$ = 1394 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.68	18.96	19.57	17.06	16.37	14.12	13.09	15.02	15.2	17.71	19.33	21	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.66	43.23	46.05	42.82	42.44	39.32	40.63	42.44	42.82	46.05	46.31	49.66	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63	

Output from water heater (annual)$_{1...12}$ 1925.45 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.47	52.84	54.88	48.52	46.89	41.14	39.17	43.9	44.39	50.77	54.43	58.96	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.43	16.37	13.31	10.08	7.53	6.36	6.87	8.93	11.99	15.22	17.77	18.94	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.6	203.7	198.42	187.2	173.03	159.72	150.82	148.73	154	165.23	179.39	192.71	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	(71)

Water heating gains (Table 5)

(72)m=	81.28	78.63	73.77	67.38	63.03	57.14	52.65	59.01	61.66	68.24	75.6	79.24	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	361.67	359.04	345.86	325.02	303.95	283.57	270.7	277.03	288.01	309.05	333.12	351.24	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	38.05	77.45	139.55	229.18	308.06	328.42	307.23	244.93	170.04	94.65	47.88	31.07	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	399.72	436.5	485.41	554.19	612.01	611.99	577.93	521.95	458.04	403.7	381	382.32	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.84	0.63	0.47	0.54	0.84	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.06	20.16	20.37	20.68	20.9	20.99	21	21	20.93	20.64	20.31	20.04	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.16	20.16	20.17	20.18	20.19	20.2	20.2	20.2	20.19	20.19	20.18	20.17	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.95	0.8	0.56	0.39	0.45	0.77	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.89	19.05	19.35	19.8	20.09	20.19	20.2	20.2	20.14	19.76	19.27	18.88	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.18	19.33	19.61	20.02	20.3	20.39	20.4	20.4	20.34	19.98	19.53	19.18	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.03	19.18	19.46	19.87	20.15	20.24	20.25	20.25	20.19	19.83	19.38	19.03	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.99	0.94	0.8	0.56	0.39	0.45	0.77	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	398.61	434.2	478.16	520.51	487.77	345.11	225.75	236.71	353.54	390.39	378.76	381.5	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	961.47	928.22	839.26	696.03	533.76	349.38	226.1	237.56	380.24	583.3	782.36	952.15	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	418.77	331.98	268.66	126.38	34.22	0	0	0	0	143.53	290.59	424.56	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2038.68 (98)

Space heating requirement in kWh/m²/year 28.37 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	418.77	331.98	268.66	126.38	34.22	0	0	0	0	143.53	290.59	424.56	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	463.24	367.24	297.19	139.8	37.85	0	0	0	0	158.77	321.45	469.65	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2255.18 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63

Efficiency of water heater 80.3 (216)

(217)m=	86.94	86.71	86.11	84.52	81.99	80.3	80.3	80.3	80.3	84.72	86.32	87.02	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	223.37	195.63	204.97	185.21	184.85	166.23	159.26	177.54	179.5	193.74	202.98	217.92	

Total = Sum(219a)$_{1...12}$ = 2291.2 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2255.18

DER WorkSheet: New dwelling design stage

Water heating fuel used			2291.2	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		168.33		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		198.33	(231)
Electricity for lighting			325.42	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	487.12	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	494.9	(264)
Space and water heating	(261) + (262) + (263) + (264) =				982.02	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	102.93	(267)
Electricity for lighting	(232) x		0.519	=	168.89	(268)
Total CO2, kg/year		sum of (265)…(271) =			1253.84	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			17.45	(273)
EI rating (section 14)					86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 55

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	91.9	(1a) x	2.56	(2a) =	235.26	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	91.9	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		235.26	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²	U-value W/m2K	A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04] =	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04] =	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04] =	3.83			(27)
Floor			91.9	x 0.12 =	11.028			(28)
Walls	82.84	22.77	60.07	x 0.16 =	9.61			(29)
Total area of elements, m²			174.74					(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 50.83 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11130.17 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 18.92 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 69.75 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.62	25.29	24.96	23.31	22.98	21.33	21.33	21	21.99	22.98	23.64	24.3	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	95.37	95.04	94.71	93.06	92.73	91.08	91.08	90.75	91.74	92.73	93.39	94.05	

Average = Sum(39)$_{1...12}$ /12= 92.98 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.04	1.03	1.03	1.01	1.01	0.99	0.99	0.99	1	1.01	1.02	1.02	

Average = Sum(40)$_{1...12}$ /12= 1.01 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.65 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 97.16 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	106.87	102.99	99.1	95.21	91.33	87.44	87.44	91.33	95.21	99.1	102.99	106.87	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1165.89 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	158.49	138.62	143.04	124.71	119.66	103.26	95.68	109.8	111.11	129.48	141.34	153.49	

Total = Sum(45)$_{1...12}$ = 1528.67 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	23.77	20.79	21.46	18.71	17.95	15.49	14.35	16.47	16.67	19.42	21.2	23.02	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.5	46.96	46.54	43.12	44.56	46.54	46.96	50.5	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	209.45	184.64	193.54	171.66	166.2	146.38	140.24	156.34	158.06	179.99	190.66	204.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	209.45	184.64	193.54	171.66	166.2	146.38	140.24	156.34	158.06	179.99	190.66	204.45	

Output from water heater (annual)$_{1...12}$ 2101.6 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	65.44	57.6	60.19	53.2	51.42	45.11	42.95	48.14	48.68	55.68	59.33	63.77	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.62	19.2	15.62	11.82	8.84	7.46	8.06	10.48	14.07	17.86	20.85	22.22	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	242.53	245.05	238.7	225.2	208.16	192.14	181.44	178.92	185.27	198.77	215.81	231.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	(71)

Water heating gains (Table 5)

(72)m=	87.95	85.71	80.89	73.89	69.11	62.66	57.73	64.71	67.61	74.84	82.4	85.72	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	417.87	415.72	400.98	376.68	351.88	328.02	313	319.87	332.71	357.23	384.82	405.53	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	17.4	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	35.42	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	63.81	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	104.8	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	140.87	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	150.18	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	140.49	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	112	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	77.76	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	43.28	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	21.89	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	14.21	(75)
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	184.19	319.52	452.53	586.44	680.34	685.76	656.84	585.2	498.65	357.27	221.67	156.94	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	602.06	735.24	853.51	963.12	1032.22	1013.78	969.84	905.08	831.36	714.5	606.48	562.48	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.97	0.91	0.76	0.56	0.41	0.46	0.71	0.94	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.96	20.16	20.43	20.73	20.92	20.99	21	21	20.96	20.7	20.27	19.93	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.05	20.05	20.06	20.07	20.08	20.09	20.09	20.09	20.08	20.08	20.07	20.06	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.96	0.88	0.71	0.49	0.33	0.37	0.64	0.92	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.67	18.96	19.35	19.78	20	20.08	20.09	20.09	20.06	19.74	19.13	18.64	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.96	19.23	19.59	19.99	20.21	20.28	20.29	20.29	20.25	19.95	19.38	18.92	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.81	19.08	19.44	19.84	20.06	20.13	20.14	20.14	20.1	19.8	19.23	18.77	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.87	0.71	0.49	0.33	0.37	0.64	0.91	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	598.42	722.89	814.21	838.12	729.06	499.08	322.03	338.77	531.31	651.91	597.58	560.05	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1383.54	1347.38	1225.29	1017.74	774.9	503.94	322.45	339.57	550.84	852.93	1133.07	1370.57	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	584.13	419.66	305.85	129.33	34.11	0	0	0	0	149.56	385.55	603.03	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2611.2 (98)

Space heating requirement in kWh/m²/year 28.41 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	584.13	419.66	305.85	129.33	34.11	0	0	0	0	149.56	385.55	603.03	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	646.16	464.22	338.33	143.06	37.73	0	0	0	0	165.44	426.49	667.07	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2888.5 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	209.45	184.64	193.54	171.66	166.2	146.38	140.24	156.34	158.06	179.99	190.66	204.45

Efficiency of water heater: 80.3 (216)

(217)m=

	87.5	87.05	86.2	84.35	81.86	80.3	80.3	80.3	80.3	84.59	86.79	87.61

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=

	239.38	212.1	224.53	203.51	203.03	182.29	174.65	194.69	196.84	212.78	219.68	233.36

Total = Sum(219a)$_{1...12}$ = 2496.84 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2888.5	
Water heating fuel used		2496.84	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	236.79		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		266.79	(231)
Electricity for lighting		381.85	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	623.92	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	539.32	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1163.23	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	138.47	(267)
Electricity for lighting	(232) x	0.519	=	198.18	(268)
Total CO2, kg/year	sum of (265)…(271) =			1499.88	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			16.32	(273)
EI rating (section 14)				85	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 56

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	65.29	(1a) x	2.56	(2a) =	167.14	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	65.29	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		167.14	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			65.29	x	0.12	=	7.8348			(28)
Walls Type1	43.35	15.26	28.09	x	0.16	=	4.5			(29)
Walls Type2	25.26	2.42	22.84	x	0.16	=	3.65			(29)
Total area of elements, m²			133.9							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.6 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8047.73 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.75 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 48.35 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	18.2	17.97	17.73	16.56	16.33	15.15	15.15	14.92	15.62	16.33	16.8	17.26	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	66.55	66.32	66.08	64.91	64.68	63.5	63.5	63.27	63.97	64.68	65.14	65.61	

Average = Sum(39)$_{1...12}$ /12= 64.85 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.02	1.02	1.01	0.99	0.99	0.97	0.97	0.97	0.98	0.99	1	1

Average = Sum(40)$_{1...12}$ /12= 0.99 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.13 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 84.71 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	93.18	89.79	86.4	83.01	79.62	76.24	76.24	79.62	83.01	86.4	89.79	93.18	

Total = Sum(44)$_{1...12}$ = 1016.48 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	138.18	120.85	124.71	108.72	104.32	90.02	83.42	95.73	96.87	112.89	123.23	133.82	

Total = Sum(45)$_{1...12}$ = 1332.76 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	20.73	18.13	18.71	16.31	15.65	13.5	12.51	14.36	14.53	16.93	18.48	20.07	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.48	41.33	44.03	40.94	40.58	37.6	38.85	40.58	40.94	44.03	44.28	47.48	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	185.66	162.18	168.74	149.66	144.9	127.62	122.27	136.3	137.81	156.92	167.51	181.3	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	185.66	162.18	168.74	149.66	144.9	127.62	122.27	136.3	137.81	156.92	167.51	181.3	

Output from water heater (annual)$_{1...12}$ 1840.87 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	57.82	50.52	52.47	46.39	44.83	39.33	37.45	41.97	42.44	48.54	52.04	56.37	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.59	14.73	11.98	9.07	6.78	5.72	6.19	8.04	10.79	13.7	15.99	17.05	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	186.07	188	183.13	172.77	159.7	147.41	139.2	137.27	142.13	152.49	165.57	177.86	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	(71)

Water heating gains (Table 5)

(72)m=	77.71	75.17	70.53	64.42	60.26	54.63	50.34	56.41	58.95	65.25	72.28	75.76	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	338.26	335.8	323.54	304.17	284.63	265.66	253.62	259.62	269.77	289.34	311.74	328.56	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast	0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast	0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast	0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast	0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast	0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast	0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast	0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast	0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast	0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast	0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast	0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast	0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast	0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast	0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast	0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast	0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast	0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast	0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast	0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast	0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	130.13	224.56	314.92	403.07	463.21	465.03	446.19	400.53	345.32	250.25	156.4	111.03	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	468.39	560.35	638.46	707.24	747.85	730.69	699.81	660.15	615.1	539.59	468.14	439.59	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.96	0.89	0.74	0.55	0.4	0.44	0.68	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.05	20.24	20.49	20.77	20.93	20.99	21	21	20.97	20.74	20.34	20.02	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.07	20.07	20.07	20.09	20.09	20.11	20.11	20.11	20.1	20.09	20.09	20.08	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.86	0.69	0.47	0.32	0.35	0.61	0.9	0.98	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.81	19.09	19.45	19.83	20.03	20.1	20.11	20.11	20.08	19.81	19.25	18.77	(90)

fLA = Living area ÷ (4) = 0.31 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.19	19.44	19.77	20.12	20.31	20.38	20.38	20.38	20.35	20.1	19.59	19.16	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.04	19.29	19.62	19.97	20.16	20.23	20.23	20.23	20.2	19.95	19.44	19.01	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.94	0.86	0.69	0.48	0.33	0.37	0.62	0.89	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	464.29	548	603.18	605.8	518.75	354.32	230.43	242.12	379.41	482.45	458.61	436.75	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	981.11	954.59	867.12	718.8	547.26	357.31	230.69	242.59	390.51	604.78	803.86	971.62	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	384.51	273.23	196.37	81.36	21.21	0	0	0	0	91.02	248.58	397.94	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1694.21 (98)

Space heating requirement in kWh/m²/year 25.95 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	384.51	273.23	196.37	81.36	21.21	0	0	0	0	91.02	248.58	397.94	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	425.34	302.25	217.22	90	23.46	0	0	0	0	100.69	274.98	440.2	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1874.13 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	185.66	162.18	168.74	149.66	144.9	127.62	122.27	136.3	137.81	156.92	167.51	181.3

Efficiency of water heater 80.3 (216)

(217)m= 86.84 | 86.35 | 85.43 | 83.59 | 81.46 | 80.3 | 80.3 | 80.3 | 80.3 | 83.73 | 86.04 | 86.98 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 213.79 | 187.81 | 197.51 | 179.05 | 177.87 | 158.93 | 152.26 | 169.74 | 171.61 | 187.4 | 194.68 | 208.45

Total = Sum(219a)$_{1...12}$ = 2199.1 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1874.13	
Water heating fuel used		2199.1	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	168.23		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		198.23	(231)
Electricity for lighting		292.95	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	404.81	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	475.01	(264)
Space and water heating	(261) + (262) + (263) + (264) =			879.82	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	102.88	(267)
Electricity for lighting	(232) x	0.519	=	152.04	(268)
Total CO2, kg/year	sum of (265)…(271) =			1134.74	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			17.38	(273)
EI rating (section 14)				86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 57

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.41	(1a) x	2.56	(2a) =	129.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.41	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			50.41	x	0.12	=	6.0492			(28)
Walls Type1	24.71	12.37	12.34	x	0.16	=	1.97			(29)
Walls Type2	43.27	2.42	40.85	x	0.16	=	6.54			(29)
Total area of elements, m²			118.39							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 34.35 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6449.33 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.1 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 40.45 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.05	13.87	13.69	12.79	12.61	11.7	11.7	11.52	12.06	12.61	12.97	13.33	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	54.5	54.32	54.14	53.23	53.05	52.15	52.15	51.97	52.51	53.05	53.42	53.78	

Average = Sum(39)$_{1...12}$ /12= 53.19 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.08	1.08	1.07	1.06	1.05	1.03	1.03	1.03	1.04	1.05	1.06	1.07

Average = Sum(40)$_{1...12}$ /12= 1.06 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.63 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.09	79.1	76.12	73.13	70.15	67.16	67.16	70.15	73.13	76.12	79.1	82.09

Total = Sum(44)$_{1...12}$ = 895.52 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.74	106.47	109.87	95.79	91.91	79.31	73.49	84.33	85.34	99.46	108.57	117.89

Total = Sum(45)$_{1...12}$ = 1174.17 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.26	15.97	16.48	14.37	13.79	11.9	11.02	12.65	12.8	14.92	16.28	17.68

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.83	36.41	38.79	36.07	35.75	33.12	34.23	35.75	36.07	38.79	39.01	41.83	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.57	142.88	148.66	131.85	127.66	112.43	107.72	120.08	121.41	138.25	147.58	159.73	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.57	142.88	148.66	131.85	127.66	112.43	107.72	120.08	121.41	138.25	147.58	159.73	

Output from water heater (annual)$_{1...12}$ 1621.81 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.94	44.5	46.23	40.87	39.5	34.65	32.99	36.98	37.39	42.77	45.85	49.66	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.22	11.74	9.55	7.23	5.4	4.56	4.93	6.41	8.6	10.92	12.75	13.59	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.3	149.84	145.96	137.7	127.28	117.49	110.94	109.41	113.28	121.54	131.96	141.76	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	(71)

Water heating gains (Table 5)

(72)m=	68.46	66.23	62.14	56.76	53.09	48.13	44.35	49.7	51.93	57.48	63.68	66.74	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.51	279.34	269.18	253.22	237.31	221.71	211.75	217.05	225.35	241.48	259.92	273.62	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	121.43	206.85	283.02	350.67	392.78	389.94	375.94	344.53	306.45	228.61	145.45	103.92	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	402.95	486.19	552.19	603.89	630.09	611.65	587.7	561.58	531.8	470.09	405.37	377.54	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.73	0.54	0.39	0.42	0.65	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.04	20.25	20.51	20.77	20.93	20.99	21	21	20.97	20.76	20.35	20	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.02	20.02	20.02	20.04	20.04	20.05	20.05	20.06	20.05	20.04	20.03	20.03	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.84	0.67	0.46	0.31	0.34	0.57	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.75	19.06	19.42	19.79	19.98	20.05	20.05	20.06	20.03	19.78	19.21	18.71	(90)

fLA = Living area ÷ (4) = 0.4 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.27	19.54	19.86	20.19	20.36	20.43	20.43	20.43	20.41	20.18	19.67	19.23	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.12	19.39	19.71	20.04	20.21	20.28	20.28	20.28	20.26	20.03	19.52	19.08	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.84	0.68	0.48	0.33	0.36	0.59	0.87	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	397.75	470.94	512.57	504.53	427.55	293.11	191.8	201.41	314.5	408.3	393.66	373.9	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	807.61	786.86	715.1	592.83	451.58	296.01	192.09	201.88	323.29	500.04	663.4	800.07	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	304.93	212.3	150.68	63.58	17.88	0	0	0	0	68.25	194.21	317.07	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1328.9 (98)

Space heating requirement in kWh/m²/year 26.36 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	304.93	212.3	150.68	63.58	17.88	0	0	0	0	68.25	194.21	317.07	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	337.31	234.84	166.68	70.33	19.78	0	0	0	0	75.5	214.83	350.75	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1470.03 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.57	142.88	148.66	131.85	127.66	112.43	107.72	120.08	121.41	138.25	147.58	159.73

Efficiency of water heater 80.3 (216)

(217)m=	86.6	86.05	85.09	83.33	81.42	80.3	80.3	80.3	80.3	83.38	85.74	86.74	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	188.88	166.05	174.72	158.23	156.79	140.02	134.15	149.54	151.19	165.81	172.11	184.13	

Total = Sum(219a)$_{1...12}$ = 1941.62 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1470.03

DER WorkSheet: New dwelling design stage

Water heating fuel used			1941.62	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		129.89		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		159.89	(231)
Electricity for lighting			233.49	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	317.53	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	419.39	(264)
Space and water heating	(261) + (262) + (263) + (264) =				736.92	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	82.98	(267)
Electricity for lighting	(232) x		0.519	=	121.18	(268)
Total CO2, kg/year		sum of (265)…(271) =			941.08	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			18.67	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 58

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.54	(1a) x	2.56	(2a) =	131.94	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.54	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.94	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			51.54	x	0.12	=	6.1848			(28)
Walls Type1	24.71	12.37	12.34	x	0.16	=	1.97			(29)
Walls Type2	39.57	2.42	37.15	x	0.16	=	5.94			(29)
Total area of elements, m²			115.82							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.89 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6510.73 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.11 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 40 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.37	14.18	14	13.07	12.89	11.96	11.96	11.78	12.33	12.89	13.26	13.63	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	54.37	54.18	54	53.07	52.89	51.96	51.96	51.78	52.33	52.89	53.26	53.63	

Average = Sum(39)$_{1...12}$ /12= 53.02 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.05	1.05	1.05	1.03	1.03	1.01	1.01	1	1.02	1.03	1.03	1.04

Average = Sum(40)$_{1...12}$ /12= 1.03 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.96	79.94	76.93	73.91	70.89	67.88	67.88	70.89	73.91	76.93	79.94	82.96

Total = Sum(44)$_{1...12}$ = 905.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	123.03	107.6	111.03	96.8	92.88	80.15	74.27	85.23	86.25	100.51	109.72	119.15

Total = Sum(45)$_{1...12}$ = 1186.62 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.45	16.14	16.66	14.52	13.93	12.02	11.14	12.78	12.94	15.08	16.46	17.87

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.28	36.8	39.2	36.45	36.13	33.47	34.59	36.13	36.45	39.2	39.42	42.28	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	

Output from water heater (annual)$_{1...12}$ 1639.01 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.48	44.98	46.72	41.3	39.92	35.02	33.34	37.37	37.79	43.22	46.34	50.18	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.48	11.98	9.74	7.37	5.51	4.65	5.03	6.54	8.77	11.14	13	13.86	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.23	152.8	148.85	140.43	129.8	119.81	113.14	111.57	115.53	123.94	134.57	144.56	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	(71)

Water heating gains (Table 5)

(72)m=	69.19	66.93	62.79	57.36	53.65	48.64	44.82	50.23	52.48	58.09	64.36	67.45	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	285.93	283.74	273.41	257.19	240.99	225.14	215.02	220.37	228.81	245.21	263.96	277.9	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	121.43	206.85	283.02	350.67	392.78	389.94	375.94	344.53	306.45	228.61	145.45	103.92	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	407.37	490.58	556.43	607.86	633.77	615.07	590.96	564.89	535.26	473.81	409.41	381.82	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.72	0.53	0.39	0.42	0.65	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.07	20.27	20.53	20.79	20.94	20.99	21	21	20.97	20.77	20.37	20.03	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.04	20.04	20.04	20.06	20.06	20.08	20.08	20.08	20.07	20.06	20.06	20.05	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.83	0.67	0.46	0.31	0.34	0.57	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.81	19.11	19.47	19.83	20.01	20.07	20.08	20.08	20.05	19.82	19.26	18.77	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.12	19.4	19.73	20.07	20.24	20.3	20.31	20.31	20.28	20.06	19.54	19.08	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.97	19.25	19.58	19.92	20.09	20.15	20.16	20.16	20.13	19.91	19.39	18.93	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.67	0.47	0.31	0.34	0.58	0.86	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	401.97	474.72	515.09	504.02	422.99	286.2	184.62	194.28	308.59	408.47	397.1	378.04	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	797.77	777.55	706.45	584.7	443.66	288.43	184.81	194.61	315.69	492.22	654.54	790.1	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	294.48	203.5	142.37	58.09	15.37	0	0	0	0	62.31	185.36	306.58	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1268.06 (98)

Space heating requirement in kWh/m²/year 24.6 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	294.48	203.5	142.37	58.09	15.37	0	0	0	0	62.31	185.36	306.58	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	325.75	225.11	157.49	64.26	17.01	0	0	0	0	68.93	205.04	339.13	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1402.72 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42

Efficiency of water heater 80.3 (216)

(217)m=	86.49	85.91	84.92	83.12	81.27	80.3	80.3	80.3	80.3	83.17	85.6	86.64	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	191.13	168.07	176.92	160.31	158.75	141.5	135.57	151.13	152.8	167.99	174.23	186.31	

Total = Sum(219a)$_{1...12}$ = 1964.7 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1402.72

DER WorkSheet: New dwelling design stage

Water heating fuel used			1964.7	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		132.8		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		162.8	(231)
Electricity for lighting			238.1	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	302.99	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	424.38	(264)
Space and water heating	(261) + (262) + (263) + (264) =				727.36	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	84.49	(267)
Electricity for lighting	(232) x		0.519	=	123.58	(268)
Total CO2, kg/year		sum of (265)…(271) =			935.43	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			18.15	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 59

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	89.93	(1a) x	2.56	(2a) =	230.23	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	89.93	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		230.23	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			89.933	x	0.12	=	10.79196			(28)
Walls Type1	66.42	22.77	43.65	x	0.16	=	6.98			(29)
Walls Type2	37.87	2.42	35.45	x	0.16	=	5.67			(29)
Roof	12.86	0	12.86	x	0.12	=	1.54			(30)
Total area of elements, m²			207.08							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 58.57 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11353.1 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 15.02 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 73.59 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.07	24.75	24.43	22.81	22.49	20.87	20.87	20.55	21.52	22.49	23.13	23.78	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	98.66	98.33	98.01	96.4	96.07	94.46	94.46	94.14	95.11	96.07	96.72	97.37	

Average = Sum(39)$_{1...12}$ /12= 96.32 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.1	1.09	1.09	1.07	1.07	1.05	1.05	1.05	1.06	1.07	1.08	1.08

Average = Sum(40)$_{1...12}$ /12= 1.07 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.62 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 96.54 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	106.19	102.33	98.47	94.61	90.75	86.89	86.89	90.75	94.61	98.47	102.33	106.19

Total = Sum(44)$_{1...12}$ = 1158.47 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	157.48	137.73	142.13	123.91	118.9	102.6	95.07	109.1	110.4	128.66	140.44	152.51

Total = Sum(45)$_{1...12}$ = 1518.94 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.62	20.66	21.32	18.59	17.83	15.39	14.26	16.36	16.56	19.3	21.07	22.88

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.18	46.66	46.24	42.85	44.28	46.24	46.66	50.18	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	208.44	183.76	192.31	170.57	165.14	145.45	139.35	155.34	157.06	178.84	189.76	203.47	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	208.44	183.76	192.31	170.57	165.14	145.45	139.35	155.34	157.06	178.84	189.76	203.47	

Output from water heater (annual)$_{1...12}$ 2089.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	65.1	57.3	59.8	52.86	51.09	44.83	42.68	47.84	48.37	55.32	59.03	63.45	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.3	18.92	15.39	11.65	8.71	7.35	7.94	10.33	13.86	17.6	20.54	21.9	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	238.95	241.43	235.19	221.88	205.09	189.31	178.77	176.29	182.54	195.84	212.63	228.41	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	(71)

Water heating gains (Table 5)

(72)m=	87.5	85.27	80.38	73.42	68.67	62.26	57.37	64.3	67.18	74.36	81.98	85.28	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	413.13	411	396.33	372.33	347.85	324.29	309.45	316.28	328.95	353.17	380.52	400.96	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)
Southwest	0.9x	0.77	x	2.89	x	36.79		0.55	x	0.7	=	56.74	(79)
Southwest	0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	96.65	(79)
Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	132.24	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	163.85	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	183.53	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	182.2	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	175.66	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	160.98	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	143.19	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	106.82	(79)
Southwest	0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	67.96	(79)
Southwest	0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	48.56	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	223.53	380.75	520.96	645.49	723.01	717.78	692.02	634.19	564.09	420.81	267.74	191.29	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	636.66	791.75	917.29	1017.82	1070.85	1042.07	1001.46	950.47	893.04	773.98	648.26	592.25	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.96	0.89	0.76	0.57	0.41	0.45	0.69	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.93	20.15	20.43	20.73	20.91	20.99	21	21	20.96	20.7	20.26	19.89	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20	20.01	20.01	20.02	20.03	20.04	20.04	20.04	20.04	20.03	20.02	20.02	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.86	0.7	0.49	0.32	0.36	0.61	0.9	0.98	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.59	18.91	19.31	19.72	19.95	20.03	20.04	20.04	20.01	19.7	19.07	18.54	(90)

fLA = Living area ÷ (4) = 0.23 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.89	19.19	19.56	19.95	20.17	20.25	20.26	20.26	20.22	19.93	19.34	18.85	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.74	19.04	19.41	19.8	20.02	20.1	20.11	20.11	20.07	19.78	19.19	18.7	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.94	0.85	0.7	0.49	0.33	0.37	0.61	0.89	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	631.37	773.32	863.45	870.03	748.48	513.16	330.64	348.08	548.7	690	635.3	588.72	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1424.67	1390.64	1265.52	1050.62	798.88	519.26	331.2	349.04	567.89	881.72	1169.29	1411.62	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	590.22	414.84	299.14	130.03	37.49	0	0	0	0	142.64	384.47	612.24	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2611.07 (98)

Space heating requirement in kWh/m²/year 29.03 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	590.22	414.84	299.14	130.03	37.49	0	0	0	0	142.64	384.47	612.24	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	652.89	458.89	330.91	143.84	41.48	0	0	0	0	157.79	425.3	677.26	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2888.35 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	208.44	183.76	192.31	170.57	165.14	145.45	139.35	155.34	157.06	178.84	189.76	203.47

Efficiency of water heater: 80.3 (216)

(217)m=	87.53	87.04	86.16	84.38	82	80.3	80.3	80.3	80.3	84.49	86.79	87.65

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	238.14	211.12	223.2	202.15	201.4	181.13	173.53	193.45	195.59	211.67	218.63	232.14

Total = Sum(219a)$_{1...12}$ = 2482.17 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2888.35
Water heating fuel used		2482.17
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	231.72	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		261.72 (231)
Electricity for lighting		376.22 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216 =	623.88 (261)
Space heating (secondary)	(215) x	0.519 =	0 (263)
Water heating	(219) x	0.216 =	536.15 (264)
Space and water heating	(261) + (262) + (263) + (264) =		1160.03 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519 =	135.84 (267)
Electricity for lighting	(232) x	0.519 =	195.26 (268)
Total CO2, kg/year	sum of (265)…(271) =		1491.12 (272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =		16.58 (273)
EI rating (section 14)			85 (274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 60

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.3	(1a) x	2.56	(2a) =	187.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.3	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			73.3	x	0.12	=	8.796			(28)
Walls Type1	52.59	19.88	32.71	x	0.16	=	5.23			(29)
Walls Type2	17.17	2.42	14.75	x	0.16	=	2.36			(29)
Total area of elements, m²			143.07							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 46.13 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8869.96 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 11.84 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 57.98 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.43	20.17	19.91	18.59	18.33	17.01	17.01	16.75	17.54	18.33	18.86	19.38	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	78.41	78.15	77.88	76.57	76.31	74.99	74.99	74.73	75.52	76.31	76.83	77.36	

Average = Sum(39)$_{1...12}$ /12= 76.5 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.07	1.07	1.06	1.04	1.04	1.02	1.02	1.02	1.03	1.04	1.05	1.06	

Average = Sum(40)$_{1...12}$ /12= 1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.38 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	98.32	94.75	91.17	87.6	84.02	80.44	80.44	84.02	87.6	91.17	94.75	98.32	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1072.6 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	145.81	127.52	131.59	114.73	110.08	94.99	88.03	101.01	102.22	119.12	130.03	141.21	

Total = Sum(45)$_{1...12}$ = 1406.35 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.87	19.13	19.74	17.21	16.51	14.25	13.2	15.15	15.33	17.87	19.5	21.18	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.1	43.61	46.46	43.2	42.82	39.67	40.99	42.82	43.2	46.46	46.72	50.1	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31	

Output from water heater (annual)$_{1...12}$ 1942.5 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.01	53.3	55.37	48.95	47.31	41.5	39.52	44.29	44.79	51.22	54.92	59.48	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.26	16.22	13.19	9.99	7.47	6.3	6.81	8.85	11.88	15.09	17.61	18.77	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.87	207	201.64	190.24	175.84	162.31	153.27	151.14	156.5	167.91	182.3	195.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	(71)

Water heating gains (Table 5)

(72)m=	82	79.32	74.42	67.98	63.58	57.64	53.11	59.53	62.2	68.85	76.27	79.94	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	365.99	363.4	350.11	329.06	307.74	287.11	274.05	280.38	291.44	312.69	337.04	355.4	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	79.52	152.43	253.69	389.97	505.84	532.55	500.79	409.71	300.15	180.64	98.34	66.05	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	445.51	515.83	603.8	719.03	813.58	819.65	774.84	690.09	591.59	493.33	435.37	421.45	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.93	0.78	0.57	0.42	0.49	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.88	20.03	20.3	20.66	20.9	20.99	21	21	20.93	20.59	20.17	19.85	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.03	20.03	20.05	20.05	20.06	20.06	20.07	20.06	20.05	20.04	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.91	0.73	0.49	0.33	0.4	0.71	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.52	18.75	19.15	19.66	19.96	20.06	20.06	20.07	20	19.57	18.97	18.5	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.87	19.08	19.45	19.92	20.21	20.3	20.31	20.31	20.24	19.84	19.28	18.85	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.72	18.93	19.3	19.77	20.06	20.15	20.16	20.16	20.09	19.69	19.13	18.7	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.9	0.73	0.5	0.34	0.41	0.71	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	443.61	510.93	586.86	646.55	591.43	411.04	266.13	279.53	422.92	468.24	431.44	420.1	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1130.96	1096.65	996.67	832.35	637.56	415.93	266.61	280.68	452.52	693.25	924.32	1121.81	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	511.38	393.6	304.89	133.78	34.32	0	0	0	0	167.41	354.87	522.07	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2422.34 (98)

Space heating requirement in kWh/m²/year 33.05 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	511.38	393.6	304.89	133.78	34.32	0	0	0	0	167.41	354.87	522.07	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	565.69	435.4	337.27	147.99	37.97	0	0	0	0	185.19	392.56	577.51	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2679.58 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31

Efficiency of water heater: 80.3 (216)

(217)m= 87.36 | 87.08 | 86.39 | 84.64 | 81.98 | 80.3 | 80.3 | 80.3 | 80.3 | 85.08 | 86.77 | 87.45 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 224.27 | 196.52 | 206.1 | 186.59 | 186.51 | 167.7 | 160.67 | 179.11 | 181.09 | 194.62 | 203.7 | 218.77

Total = Sum(219a)$_{1...12}$ = 2305.65 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2679.58
Water heating fuel used		2305.65
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	188.87	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		218.87 (231)
Electricity for lighting		322.56 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216 =	578.79 (261)
Space heating (secondary)	(215) x	0.519 =	0 (263)
Water heating	(219) x	0.216 =	498.02 (264)
Space and water heating	(261) + (262) + (263) + (264) =		1076.81 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519 =	113.59 (267)
Electricity for lighting	(232) x	0.519 =	167.41 (268)
Total CO2, kg/year	sum of (265)…(271) =		1357.81 (272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =		18.52 (273)
EI rating (section 14)			85 (274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 61

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.47	(1a) x	2.56	(2a) =	180.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.47	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			70.475	x	0.12	=	8.457			(28)
Walls Type1	31.35	16.99	14.36	x	0.16	=	2.3			(29)
Walls Type2	17.17	2.42	14.75	x	0.16	=	2.36			(29)
Total area of elements, m²			119							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.03 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8247.24 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.86 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 46.88 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.65	19.39	19.14	17.88	17.62	16.36	16.36	16.1	16.86	17.62	18.13	18.64	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	66.53	66.28	66.03	64.76	64.51	63.24	63.24	62.99	63.75	64.51	65.01	65.52	

Average = Sum(39)$_{1...12}$ /12= 64.7 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.94	0.94	0.94	0.92	0.92	0.9	0.9	0.89	0.9	0.92	0.92	0.93

Average = Sum(40)$_{1...12}$ /12= 0.92 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.82 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.6	93.09	89.57	86.06	82.55	79.04	79.04	82.55	86.06	89.57	93.09	96.6

Total = Sum(44)$_{1...12}$ = 1053.82 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.25	125.29	129.29	112.72	108.16	93.33	86.48	99.24	100.43	117.04	127.76	138.73

Total = Sum(45)$_{1...12}$ = 1381.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.49	18.79	19.39	16.91	16.22	14	12.97	14.89	15.06	17.56	19.16	20.81

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.23	42.85	45.65	42.44	42.07	38.98	40.28	42.07	42.44	45.65	45.91	49.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	

Output from water heater (annual)$_{1...12}$ 1908.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	59.94	52.37	54.4	48.09	46.48	40.78	38.82	43.51	44	50.33	53.96	58.44	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.69	15.71	12.78	9.67	7.23	6.1	6.6	8.57	11.51	14.61	17.05	18.18	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.4	200.46	195.27	184.23	170.29	157.18	148.43	146.37	151.56	162.6	176.55	189.65	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	(71)

Water heating gains (Table 5)

(72)m=	80.56	77.93	73.12	66.79	62.47	56.63	52.18	58.49	61.11	67.64	74.94	78.54	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	356.52	353.97	341.03	320.56	299.85	279.79	267.07	273.29	284.04	304.72	328.4	346.24	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	407.66	458.08	528.6	628.6	713.92	721.23	680.04	602.51	512.6	431.95	392.76	388	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.93	0.77	0.55	0.41	0.48	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.03	20.15	20.4	20.73	20.93	20.99	21	21	20.95	20.65	20.29	20.01	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.13	20.13	20.14	20.15	20.15	20.17	20.17	20.17	20.16	20.15	20.15	20.14	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.91	0.72	0.49	0.33	0.39	0.72	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.82	19.01	19.36	19.84	20.09	20.17	20.17	20.17	20.12	19.75	19.22	18.81	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.14	19.32	19.64	20.08	20.32	20.39	20.39	20.39	20.35	19.99	19.51	19.13	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.99	19.17	19.49	19.93	20.17	20.24	20.24	20.24	20.2	19.84	19.36	18.98	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.72	0.49	0.34	0.4	0.72	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	406.3	454.83	516.76	569.76	516.5	354.2	230.19	241.63	368.54	413.1	389.91	387.02	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	977.62	945.63	857.71	714.04	546.4	356.57	230.38	242.15	388.6	596.01	796.74	968.39	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	425.06	329.82	253.67	103.88	22.25	0	0	0	0	136.09	292.92	432.54	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1996.21 (98)

Space heating requirement in kWh/m²/year 28.33 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	425.06	329.82	253.67	103.88	22.25	0	0	0	0	136.09	292.92	432.54	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	470.2	364.84	280.6	114.91	24.61	0	0	0	0	150.54	324.02	478.47	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2208.2 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96

Efficiency of water heater 80.3 (216)

(217)m=	86.99	86.72	85.99	84.07	81.47	80.3	80.3	80.3	80.3	84.61	86.36	87.08	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	221.27	193.89	203.45	184.57	184.38	164.77	157.86	175.97	177.92	192.29	201.1	215.84	

Total = Sum(219a)$_{1...12}$ = 2273.3 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2208.2

DER WorkSheet: New dwelling design stage

Water heating fuel used			2273.3	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		181.59		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		211.59	(231)
Electricity for lighting			312.37	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	476.97	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	491.03	(264)
Space and water heating	(261) + (262) + (263) + (264) =				968	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	109.81	(267)
Electricity for lighting	(232) x		0.519	=	162.12	(268)
Total CO2, kg/year		sum of (265)…(271) =			1239.94	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			17.59	(273)
EI rating (section 14)					86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 62

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.12	(1a) x	2.56	(2a) =	130.85	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.12	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.85	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			51.115	x	0.12	=	6.1338			(28)
Walls Type1	25.24	12.37	12.87	x	0.16	=	2.06			(29)
Walls Type2	33.85	2.42	31.43	x	0.16	=	5.03			(29)
Total area of elements, m²			110.2							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.01 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6375.7 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.16 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 39.17 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.25	14.07	13.88	12.97	12.78	11.86	11.86	11.68	12.23	12.78	13.15	13.52	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	53.42	53.24	53.05	52.14	51.95	51.03	51.03	50.85	51.4	51.95	52.32	52.69	

Average = Sum(39)$_{1...12}$ /12= 52.09 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.05	1.04	1.04	1.02	1.02	1	1	0.99	1.01	1.02	1.02	1.03

Average = Sum(40)$_{1...12}$ /12= 1.02 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.12 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.63	79.63	76.62	73.62	70.61	67.61	67.61	70.61	73.62	76.62	79.63	82.63

Total = Sum(44)$_{1...12}$ = 901.44 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.54	107.18	110.6	96.42	92.52	79.84	73.98	84.89	85.91	100.12	109.28	118.67

Total = Sum(45)$_{1...12}$ = 1181.94 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.38	16.08	16.59	14.46	13.88	11.98	11.1	12.73	12.89	15.02	16.39	17.8

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.11	36.65	39.05	36.3	35.98	33.34	34.45	35.98	36.3	39.05	39.27	42.11	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78	

Output from water heater (annual)$_{1...12}$ 1632.53 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.27	44.8	46.53	41.14	39.76	34.88	33.21	37.22	37.64	43.05	46.15	49.99	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.38	11.89	9.67	7.32	5.47	4.62	4.99	6.49	8.71	11.06	12.9	13.76	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	150.13	151.69	147.76	139.4	128.85	118.94	112.31	110.76	114.68	123.04	133.59	143.51	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	(71)

Water heating gains (Table 5)

(72)m=	68.91	66.66	62.55	57.13	53.44	48.45	44.64	50.03	52.28	57.86	64.1	67.19	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	284.27	282.08	271.82	255.7	239.61	223.85	213.79	219.12	227.51	243.8	262.44	276.29	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	13.91	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	28.31	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	51.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	83.77	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	112.6	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	120.04	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	112.29	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	89.52	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	62.15	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	34.6	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	17.5	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	11.36	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	37.24	75.8	136.57	224.28	301.48	321.41	300.67	239.7	166.41	92.63	46.85	30.41	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	321.51	357.88	408.39	479.98	541.08	545.25	514.46	458.81	393.92	336.44	309.3	306.7	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.94	0.8	0.59	0.43	0.5	0.8	0.97	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.93	20.06	20.31	20.66	20.9	20.99	21	21	20.93	20.6	20.21	19.91	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.05	20.05	20.05	20.07	20.07	20.08	20.08	20.09	20.08	20.07	20.06	20.06	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.74	0.51	0.35	0.41	0.73	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.62	18.81	19.18	19.67	19.98	20.08	20.08	20.09	20.02	19.6	19.04	18.6	(90)

fLA = Living area ÷ (4) = 0.37 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.1	19.27	19.6	20.04	20.32	20.41	20.42	20.42	20.36	19.97	19.48	19.09	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.95	19.12	19.45	19.89	20.17	20.26	20.27	20.27	20.21	19.82	19.33	18.94	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.75	0.52	0.36	0.43	0.74	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	320	354.67	398.36	437.39	404.93	285.19	187.06	196.02	290.91	320.84	306.38	305.57	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	782.86	757.29	686.92	572.95	440.07	289.04	187.46	196.97	313.91	479.1	639.64	776.49	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	344.37	270.56	214.69	97.61	26.14	0	0	0	0	117.74	239.94	350.37	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1661.42 (98)

Space heating requirement in kWh/m²/year 32.5 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	344.37	270.56	214.69	97.61	26.14	0	0	0	0	117.74	239.94	350.37	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	380.94	299.29	237.49	107.97	28.92	0	0	0	0	130.25	265.43	387.57	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1837.86 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78

Efficiency of water heater 80.3 (216)

(217)m=	86.87	86.62	85.96	84.29	81.85	80.3	80.3	80.3	80.3	84.63	86.25	86.96	(217)
Fuel for water heating, kWh/month (219)m = (64)m x 100 ÷ (217)m													
(219)m=	189.55	166.05	174.08	157.46	157	140.94	135.03	150.53	152.19	164.43	172.23	184.89	

Total = Sum(219a)$_{1...12}$ = 1944.39 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1837.86

DER WorkSheet: New dwelling design stage

Water heating fuel used			1944.39	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		131.7		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		161.7	(231)
Electricity for lighting			236.37	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	396.98	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	419.99	(264)
Space and water heating	(261) + (262) + (263) + (264) =				816.96	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	83.92	(267)
Electricity for lighting	(232) x		0.519	=	122.68	(268)
Total CO2, kg/year		sum of (265)…(271) =			1023.56	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			20.02	(273)
EI rating (section 14)					86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 63

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	77.53	(1a) x	2.56	(2a) =	198.47	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	77.53	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		198.47	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	54.38	19.88	34.5	x	0.16	=	5.52			(29)
Walls Type2	14.93	2.42	12.51	x	0.16	=	2			(29)
Total area of elements, m²			69.31							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 37.27 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 799.22 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.63 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 43.9 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	21.61	21.34	21.06	19.67	19.39	17.99	17.99	17.72	18.55	19.39	19.94	20.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	65.51	65.23	64.96	63.56	63.29	61.89	61.89	61.62	62.45	63.29	63.84	64.4	

Average = Sum(39)$_{1...12}$ /12= 63.49 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.85	0.84	0.84	0.82	0.82	0.8	0.8	0.79	0.81	0.82	0.82	0.83	
Average = Sum(40)$_{1...12}$ /12=													0.82 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.41 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 91.54 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	100.69	97.03	93.37	89.71	86.05	82.39	82.39	86.05	89.71	93.37	97.03	100.69	
Total = Sum(44)$_{1...12}$ =													1098.47 (44)
Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)													
(45)m=	149.33	130.6	134.77	117.49	112.74	97.28	90.15	103.45	104.68	122	133.17	144.61	
Total = Sum(45)$_{1...12}$ =													1440.27 (45)
If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)													
(46)m=	22.4	19.59	20.22	17.62	16.91	14.59	13.52	15.52	15.7	18.3	19.98	21.69	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)
If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)
If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H													
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	44.66	47.58	44.24	43.85	40.63	41.98	43.85	44.24	47.58	47.85	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	

Output from water heater (annual)$_{1...12}$ 1988.65 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	62.39	54.59	56.71	50.13	48.45	42.5	40.47	45.36	45.87	52.46	56.24	60.82	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	19.1	16.96	13.79	10.44	7.81	6.59	7.12	9.26	12.42	15.77	18.41	19.63	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	214.2	216.42	210.82	198.89	183.84	169.7	160.24	158.02	163.62	175.55	190.6	204.75	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	(71)

Water heating gains (Table 5)

(72)m=	83.86	81.24	76.22	69.62	65.12	59.03	54.4	60.97	63.7	70.51	78.11	81.75	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	379.36	376.83	363.04	341.17	318.98	297.53	283.97	290.46	301.96	324.04	349.34	368.34	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	175.49	301.81	420.62	534.04	609.91	610.67	586.6	529.2	459.78	335.63	210.72	149.84	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	554.85	678.64	783.67	875.21	928.89	908.2	870.57	819.66	761.74	659.68	560.06	518.18	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.93	0.81	0.62	0.44	0.31	0.35	0.56	0.87	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.3	20.5	20.73	20.92	20.99	21	21	21	20.99	20.89	20.57	20.27	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.21	20.22	20.22	20.24	20.24	20.25	20.25	20.26	20.25	20.24	20.23	20.23	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.92	0.77	0.58	0.39	0.26	0.29	0.5	0.83	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.29	19.58	19.89	20.15	20.23	20.25	20.25	20.26	20.24	20.13	19.68	19.25	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.51	19.78	20.08	20.32	20.39	20.42	20.42	20.42	20.41	20.29	19.87	19.48	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.36	19.63	19.93	20.17	20.24	20.27	20.27	20.27	20.26	20.14	19.72	19.33	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.91	0.77	0.58	0.39	0.26	0.29	0.5	0.83	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	548.94	656.22	712.12	672.47	534.44	350.39	226.96	238.39	382.69	546.34	543.7	514.32	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	986.68	960.98	872.11	716.25	540.64	350.72	226.97	238.42	384.59	603.87	806	974.06	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	325.68	204.8	119.03	31.53	4.62	0	0	0	0	42.8	188.86	342.05	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1259.35 (98)

Space heating requirement in kWh/m²/year 16.24 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	325.68	204.8	119.03	31.53	4.62	0	0	0	0	42.8	188.86	342.05	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	360.26	226.55	131.67	34.87	5.11	0	0	0	0	47.34	208.91	378.37	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1393.09 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57

Efficiency of water heater 80.3 (216)

(217)m=	86.27	85.44	84.01	81.79	80.56	80.3	80.3	80.3	80.3	82.15	85.16	86.44

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	232.16	205.12	217.06	197.74	194.38	171.75	164.55	183.43	185.46	206.43	212.57	226.24

Total = Sum(219a)$_{1...12}$ = 2396.88 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1393.09	
Water heating fuel used		2396.88	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	199.76		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		229.76	(231)
Electricity for lighting		337.24	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	300.91	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	517.73	(264)
Space and water heating	(261) + (262) + (263) + (264) =			818.63	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	119.25	(267)
Electricity for lighting	(232) x	0.519	=	175.03	(268)
Total CO2, kg/year	sum of (265)…(271) =			1112.91	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			14.35	(273)
EI rating (section 14)				88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 64

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.94	(1a) x	2.56	(2a) =	130.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.94	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	24.35	15.26	9.09	x	0.16	=	1.45			(29)
Walls Type2	39.32	2.42	36.9	x	0.16	=	5.9			(29)
Total area of elements, m²			63.67							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 30.98 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 781.75 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.49 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 34.47 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.2	14.02	13.84	12.92	12.74	11.82	11.82	11.64	12.19	12.74	13.11	13.47	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	48.67	48.49	48.31	47.39	47.21	46.3	46.3	46.11	46.66	47.21	47.58	47.94	

Average = Sum(39)$_{1...12}$ /12= 47.35 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.95	0.95	0.93	0.93	0.91	0.91	0.91	0.92	0.93	0.93	0.94

Average = Sum(40)$_{1...12}$ /12= 0.93 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.5	79.5	76.5	73.5	70.5	67.5	67.5	70.5	73.5	76.5	79.5	82.5

Total = Sum(44)$_{1...12}$ = 900.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.35	107.01	110.42	96.27	92.37	79.71	73.86	84.76	85.77	99.96	109.11	118.49

Total = Sum(45)$_{1...12}$ = 1180.06 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.35	16.05	16.56	14.44	13.86	11.96	11.08	12.71	12.87	14.99	16.37	17.77

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.04	36.59	38.98	36.25	35.93	33.29	34.4	35.93	36.25	38.98	39.21	42.04	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53	

Output from water heater (annual)$_{1...12}$ 1629.95 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.19	44.73	46.46	41.07	39.69	34.83	33.16	37.16	37.58	42.98	46.08	49.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.34	11.85	9.64	7.3	5.46	4.61	4.98	6.47	8.68	11.02	12.87	13.72	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.69	151.24	147.33	138.99	128.48	118.59	111.98	110.43	114.35	122.68	133.2	143.08	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	(71)

Water heating gains (Table 5)

(72)m=	68.8	66.56	62.45	57.04	53.35	48.37	44.57	49.95	52.19	57.77	64	67.08	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	283.61	281.42	271.18	255.1	239.05	223.33	213.3	218.62	226.99	243.24	261.83	275.65	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	130.13	224.56	314.92	403.07	463.21	465.03	446.19	400.53	345.32	250.25	156.4	111.03	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	413.74	505.98	586.1	658.17	702.27	688.36	659.49	619.15	572.32	493.49	418.23	386.67	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.92	0.79	0.61	0.43	0.31	0.34	0.55	0.85	0.97	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.23	20.45	20.69	20.9	20.98	21	21	21	20.99	20.87	20.51	20.19	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.12	20.13	20.14	20.14	20.16	20.16	20.16	20.15	20.14	20.14	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.9	0.75	0.56	0.37	0.25	0.28	0.49	0.82	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.11	19.42	19.76	20.04	20.13	20.16	20.16	20.16	20.15	20.01	19.53	19.06	(90)

fLA = Living area ÷ (4) = 0.28 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.42	19.71	20.02	20.28	20.37	20.39	20.4	20.4	20.38	20.25	19.81	19.38	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.27	19.56	19.87	20.13	20.22	20.24	20.25	20.25	20.23	20.1	19.66	19.23	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.98	0.96	0.89	0.75	0.56	0.38	0.26	0.29	0.5	0.81	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	407.07	483.97	523.25	495.15	395.9	260.85	168.73	177.35	284.08	401.22	401.87	382.12	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	728.79	710.78	645.88	532.17	402.09	261.3	168.76	177.41	286.25	448.48	597.4	720.6	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	239.36	152.42	91.23	26.65	4.61	0	0	0	0	35.16	140.79	251.83	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 942.05 (98)

Space heating requirement in kWh/m²/year 18.49 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	239.36	152.42	91.23	26.65	4.61	0	0	0	0	35.16	140.79	251.83	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	264.78	168.6	100.92	29.48	5.1	0	0	0	0	38.89	155.74	278.57	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1042.09 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53

Efficiency of water heater 80.3 (216)

(217)m= 86 | 85.2 | 83.85 | 81.83 | 80.61 | 80.3 | 80.3 | 80.3 | 80.3 | 82.15 | 84.92 | 86.18 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 191.16 | 168.54 | 178.18 | 161.94 | 159.15 | 140.72 | 134.82 | 150.29 | 151.95 | 169.12 | 174.65 | 186.27

Total = Sum(219a)$_{1...12}$ = 1966.79 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1042.09	
Water heating fuel used		1966.79	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	131.27		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		161.27	(231)
Electricity for lighting		235.67	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	225.09	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	424.83	(264)
Space and water heating	(261) + (262) + (263) + (264) =			649.92	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	83.7	(267)
Electricity for lighting	(232) x	0.519	=	122.31	(268)
Total CO2, kg/year	sum of (265)…(271) =			855.93	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			16.8	(273)
EI rating (section 14)				88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 65

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	56.64	(1a) x	2.56	(2a) =	145	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	56.64	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		145	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			56.64	x	0.12	=	6.7968			(28)
Walls Type1	48.55	15.26	33.29	x	0.16	=	5.33			(29)
Walls Type2	29.38	2.42	26.96	x	0.16	=	4.31			(29)
Total area of elements, m²			134.57							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 40.06 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 5272.23 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.32 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 46.38 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	15.79	15.59	15.38	14.37	14.16	13.15	13.15	12.94	13.55	14.16	14.57	14.98	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	62.17	61.97	61.76	60.75	60.54	59.53	59.53	59.32	59.93	60.54	60.95	61.36	

Average = Sum(39)$_{1...12}$ /12= 60.69 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.1	1.09	1.09	1.07	1.07	1.05	1.05	1.05	1.06	1.07	1.08	1.08

Average = Sum(40)$_{1...12}$ /12= 1.07 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.89 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 78.97 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(44)m=	86.87	83.71	80.55	77.39	74.24	71.08	71.08	74.24	77.39	80.55	83.71	86.87

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 947.69 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	128.83	112.67	116.27	101.37	97.26	83.93	77.77	89.25	90.31	105.25	114.89	124.76

Total = Sum(45)$_{1...12}$ = 1242.57 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.32	16.9	17.44	15.2	14.59	12.59	11.67	13.39	13.55	15.79	17.23	18.71

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	44.27	38.53	41.05	38.17	37.83	35.05	36.22	37.83	38.17	41.05	41.28	44.27	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	173.1	151.2	157.32	139.53	135.09	118.98	113.99	127.08	128.48	146.3	156.17	169.03	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	173.1	151.2	157.32	139.53	135.09	118.98	113.99	127.08	128.48	146.3	156.17	169.03	

Output from water heater (annual)$_{1...12}$ 1716.28 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	53.9	47.1	48.92	43.25	41.8	36.67	34.91	39.13	39.57	45.26	48.52	52.55	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	14.66	13.02	10.59	8.01	5.99	5.06	5.47	7.1	9.54	12.11	14.13	15.06	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	164.4	166.11	161.81	152.66	141.1	130.24	122.99	121.29	125.58	134.74	146.29	157.15	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	(71)

Water heating gains (Table 5)

(72)m=	72.45	70.08	65.76	60.06	56.18	50.93	46.93	52.6	54.96	60.83	67.39	70.63	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	305.79	303.49	292.43	275.01	257.55	240.51	229.66	235.26	244.36	261.95	282.09	297.12	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	130.13	224.56	314.92	403.07	463.21	465.03	446.19	400.53	345.32	250.25	156.4	111.03	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	435.92	528.04	607.35	678.08	720.77	705.54	675.85	635.79	589.68	512.2	438.49	408.15	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.72	0.53	0.39	0.43	0.67	0.91	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.99	20.2	20.47	20.76	20.93	20.99	21	21	20.97	20.73	20.3	19.95	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20	20.01	20.01	20.02	20.03	20.04	20.04	20.04	20.04	20.03	20.02	20.01	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.66	0.46	0.3	0.34	0.59	0.88	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.67	18.98	19.36	19.76	19.96	20.03	20.04	20.04	20.01	19.74	19.14	18.63	(90)

fLA = Living area ÷ (4) = 0.3 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.06	19.34	19.69	20.06	20.25	20.32	20.33	20.33	20.3	20.03	19.49	19.02	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.91	19.19	19.54	19.91	20.1	20.17	20.18	20.18	20.15	19.88	19.34	18.87	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.84	0.67	0.47	0.31	0.35	0.6	0.88	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	430.95	513.19	566.36	566.76	482.44	328.51	212.58	223.57	351.65	449.88	427.28	404.68	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	908.4	885.48	805.53	668.79	508.68	331.5	212.86	224.08	362.32	561.92	745.76	900.17	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	355.23	250.18	177.95	73.46	19.52	0	0	0	0	83.36	229.3	368.64	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1557.64 (98)

Space heating requirement in kWh/m²/year 27.5 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	355.23	250.18	177.95	73.46	19.52	0	0	0	0	83.36	229.3	368.64	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	392.95	276.75	196.84	81.26	21.59	0	0	0	0	92.21	253.66	407.79	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1723.05 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

173.1	151.2	157.32	139.53	135.09	118.98	113.99	127.08	128.48	146.3	156.17	169.03

Efficiency of water heater 80.3 (216)

(217)m

86.82	86.31	85.36	83.52	81.45	80.3	80.3	80.3	80.3	83.69	86.02	86.96

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m

199.37	175.19	184.3	167.07	165.86	148.17	141.96	158.25	160	174.8	181.56	194.38

Total = Sum(219a)$_{1...12}$ = 2050.91 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1723.05	
Water heating fuel used		2050.91	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	145.94		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		175.94	(231)
Electricity for lighting		258.84	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	372.18	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	443	(264)
Space and water heating	(261) + (262) + (263) + (264) =				815.18	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	91.31	(267)
Electricity for lighting	(232) x		0.519	=	134.34	(268)
Total CO2, kg/year	sum of (265)…(271) =				1040.83	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =				18.38	(273)
EI rating (section 14)					86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 66

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	64.03	(1a) x	2.56	(2a) =	163.91	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	64.03	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		163.91	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			13.616	x	0.12	=	1.63392			(28)
Walls Type1	47.15	16.99	30.16	x	0.16	=	4.83			(29)
Walls Type2	31.49	2.42	29.07	x	0.16	=	4.65			(29)
Total area of elements, m²			92.25							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 37.02 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 2028.08 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.9 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 44.93 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	17.85	17.62	17.39	16.24	16.01	14.86	14.86	14.63	15.32	16.01	16.47	16.93	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	62.78	62.55	62.32	61.17	60.94	59.79	59.79	59.56	60.25	60.94	61.4	61.86	

Average = Sum(39)$_{1...12}$ /12= 61.11 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.98	0.98	0.97	0.96	0.95	0.93	0.93	0.93	0.94	0.95	0.96	0.97	

Average = Sum(40)$_{1...12}$ /12= 0.95 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.09 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 83.91 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	92.3	88.94	85.58	82.23	78.87	75.52	75.52	78.87	82.23	85.58	88.94	92.3	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1006.88 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	136.87	119.71	123.53	107.7	103.34	89.17	82.63	94.82	95.95	111.82	122.07	132.56	

Total = Sum(45)$_{1...12}$ = 1320.18 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	20.53	17.96	18.53	16.15	15.5	13.38	12.39	14.22	14.39	16.77	18.31	19.88	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.03	40.94	43.61	40.55	40.19	37.24	38.48	40.19	40.55	43.61	43.86	47.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	183.91	160.65	167.14	148.25	143.53	126.41	121.11	135.01	136.5	155.44	165.93	179.59	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	183.91	160.65	167.14	148.25	143.53	126.41	121.11	135.01	136.5	155.44	165.93	179.59	

Output from water heater (annual)$_{1...12}$ 1823.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	57.27	50.04	51.98	45.95	44.41	38.96	37.1	41.58	42.04	48.09	51.55	55.83	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.31	14.49	11.78	8.92	6.67	5.63	6.08	7.91	10.61	13.47	15.73	16.77	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	182.98	184.88	180.09	169.9	157.05	144.96	136.89	134.99	139.77	149.96	162.82	174.9	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	(71)

Water heating gains (Table 5)

(72)m=	76.97	74.46	69.86	63.82	59.69	54.11	49.86	55.88	58.39	64.63	71.6	75.04	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	333.66	331.22	319.13	300.03	280.8	262.1	250.22	256.17	266.17	285.46	307.54	324.11	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	166.79	284.1	388.72	481.64	539.48	535.58	516.35	473.2	420.9	313.99	199.77	142.73	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	500.44	615.32	707.85	781.67	820.27	797.67	766.58	729.38	687.07	599.45	507.31	466.84	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.93	0.83	0.66	0.48	0.34	0.37	0.59	0.88	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.16	20.38	20.63	20.86	20.97	21	21	21	20.99	20.84	20.46	20.13	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.1	20.1	20.11	20.12	20.12	20.14	20.14	20.14	20.13	20.12	20.12	20.11	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.92	0.79	0.61	0.41	0.28	0.31	0.52	0.84	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19	19.32	19.66	19.97	20.1	20.14	20.14	20.14	20.12	19.95	19.44	18.95	(90)

fLA = Living area ÷ (4) = 0.24 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.28	19.58	19.9	20.19	20.31	20.35	20.35	20.35	20.34	20.17	19.69	19.24	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.13	19.43	19.75	20.04	20.16	20.2	20.2	20.2	20.19	20.02	19.54	19.09	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.91	0.79	0.61	0.42	0.28	0.31	0.53	0.84	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	493.71	592.46	643.5	617.11	502.34	333.53	215.12	226.27	362.41	500.61	490.58	462.3	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	931.25	908.66	825.78	681.41	515.44	334.63	215.2	226.41	366.61	573.95	763.61	921.13	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	325.53	212.48	135.62	46.29	9.75	0	0	0	0	54.57	196.58	341.37	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1322.18 (98)

Space heating requirement in kWh/m²/year 20.65 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	325.53	212.48	135.62	46.29	9.75	0	0	0	0	54.57	196.58	341.37	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	360.1	235.05	150.02	51.21	10.78	0	0	0	0	60.36	217.46	377.62	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1462.59 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	183.91	160.65	167.14	148.25	143.53	126.41	121.11	135.01	136.5	155.44	165.93	179.59

Efficiency of water heater 80.3 (216)

(217)m=	86.47	85.76	84.53	82.49	80.87	80.3	80.3	80.3	80.3	82.7	85.48	86.64	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	212.68	187.33	197.73	179.71	177.47	157.43	150.83	168.14	169.99	187.95	194.11	207.27	

Total = Sum(219a)$_{1...12}$ = 2190.65 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1462.59

DER WorkSheet: New dwelling design stage

Water heating fuel used		2190.65	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	164.97		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	194.97	(231)
Electricity for lighting		288.08	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	315.92	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	473.18	(264)
Space and water heating	(261) + (262) + (263) + (264) =				789.1	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	101.19	(267)
Electricity for lighting	(232) x		0.519	=	149.52	(268)
Total CO2, kg/year		sum of (265)…(271) =			1039.81	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			16.24	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 67

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.54	(1a) x	2.56	(2a) =	131.94	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.54	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.94	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	31.45	12.37	19.08	x	0.16	=	3.05			(29)
Walls Type2	32.9	2.42	30.48	x	0.16	=	4.88			(29)
Total area of elements, m²			64.34							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 27.72 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 842.43 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.19 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 31.91 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.37	14.18	14	13.07	12.89	11.96	11.96	11.78	12.33	12.89	13.26	13.63	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	46.27	46.09	45.9	44.98	44.79	43.87	43.87	43.68	44.24	44.79	45.16	45.53	

Average = Sum(39)$_{1...12}$ /12= 44.93 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.9	0.89	0.89	0.87	0.87	0.85	0.85	0.85	0.86	0.87	0.88	0.88	

Average = Sum(40)$_{1...12}$ /12= 0.87 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	82.96	79.94	76.93	73.91	70.89	67.88	67.88	70.89	73.91	76.93	79.94	82.96	

Total = Sum(44)$_{1...12}$ = 905.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	123.03	107.6	111.03	96.8	92.88	80.15	74.27	85.23	86.25	100.51	109.72	119.15	

Total = Sum(45)$_{1...12}$ = 1186.62 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	18.45	16.14	16.66	14.52	13.93	12.02	11.14	12.78	12.94	15.08	16.46	17.87	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.28	36.8	39.2	36.45	36.13	33.47	34.59	36.13	36.45	39.2	39.42	42.28	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	

Output from water heater (annual)$_{1...12}$ 1639.01 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.48	44.98	46.72	41.3	39.92	35.02	33.34	37.37	37.79	43.22	46.34	50.18	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.48	11.98	9.74	7.37	5.51	4.65	5.03	6.54	8.77	11.14	13	13.86	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.23	152.8	148.85	140.43	129.8	119.81	113.14	111.57	115.53	123.94	134.57	144.56	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	(71)

Water heating gains (Table 5)

(72)m=	69.19	66.93	62.79	57.36	53.65	48.64	44.82	50.23	52.48	58.09	64.36	67.45	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	285.93	283.74	273.41	257.19	240.99	225.14	215.02	220.37	228.81	245.21	263.96	277.9	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	121.43	206.85	283.02	350.67	392.78	389.94	375.94	344.53	306.45	228.61	145.45	103.92	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	407.37	490.58	556.43	607.86	633.77	615.07	590.96	564.89	535.26	473.81	409.41	381.82	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.93	0.81	0.64	0.45	0.33	0.36	0.56	0.86	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.29	20.49	20.71	20.9	20.98	21	21	21	20.99	20.88	20.56	20.26	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.17	20.17	20.18	20.19	20.19	20.21	20.21	20.21	20.2	20.19	20.19	20.18	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.91	0.77	0.59	0.4	0.27	0.29	0.5	0.82	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.24	19.53	19.83	20.09	20.18	20.21	20.21	20.21	20.2	20.08	19.64	19.2	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.5	19.77	20.05	20.29	20.38	20.41	20.41	20.41	20.4	20.28	19.87	19.47	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.35	19.62	19.9	20.14	20.23	20.26	20.26	20.26	20.25	20.13	19.72	19.32	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.98	0.96	0.9	0.77	0.59	0.4	0.27	0.3	0.5	0.81	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	401.01	470.26	500.98	469.6	375.66	247.68	160.4	168.53	270.16	385.92	393.56	377.46	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	696.64	678.37	615.18	505.61	381.98	248.11	160.42	168.58	271.94	426.78	569.98	688.34	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	219.95	139.85	84.96	25.92	4.7	0	0	0	0	30.4	127.02	231.29	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 864.1 (98)

Space heating requirement in kWh/m²/year 16.77 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	219.95	139.85	84.96	25.92	4.7	0	0	0	0	30.4	127.02	231.29	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	243.3	154.71	93.99	28.68	5.2	0	0	0	0	33.63	140.51	255.86	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 955.87 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42

Efficiency of water heater 80.3 (216)

(217)m=	85.77	84.97	83.68	81.79	80.62	80.3	80.3	80.3	80.3	81.94	84.65	85.96	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	192.73	169.94	179.54	162.92	160.03	141.5	135.57	151.13	152.8	170.52	176.19	187.79	

Total = Sum(219a)$_{1...12}$ = 1980.64 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 955.87

DER WorkSheet: New dwelling design stage

Water heating fuel used		1980.64	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	132.8		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	162.8	(231)
Electricity for lighting		238.1	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	206.47	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	427.82	(264)
Space and water heating	(261) + (262) + (263) + (264) =				634.29	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	84.49	(267)
Electricity for lighting	(232) x		0.519	=	123.58	(268)
Total CO2, kg/year		sum of (265)…(271) =			842.36	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			16.34	(273)
EI rating (section 14)					88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 68

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.98	(1a) x	2.56	(2a) =	189.38	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.98	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		189.38	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	57.81	22.77	35.04	x	0.16	=	5.61			(29)
Walls Type2	35.86	2.42	33.44	x	0.16	=	5.35			(29)
Total area of elements, m²			93.67							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 44.53 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1164.08 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.31 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 52.84 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.62	20.36	20.09	18.76	18.5	17.17	17.17	16.91	17.7	18.5	19.03	19.56	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	73.47	73.2	72.93	71.61	71.34	70.01	70.01	69.75	70.54	71.34	71.87	72.4	

Average = Sum(39)$_{1...12}$ /12= 71.54 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.99	0.99	0.99	0.97	0.96	0.95	0.95	0.94	0.95	0.96	0.97	0.98

Average = Sum(40)$_{1...12}$ /12= 0.97 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.34 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.74 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.72	95.13	91.54	87.95	84.36	80.77	80.77	84.36	87.95	91.54	95.13	98.72

Total = Sum(44)$_{1...12}$ = 1076.93 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.4	128.04	132.13	115.19	110.53	95.38	88.38	101.42	102.63	119.6	130.56	141.78

Total = Sum(45)$_{1...12}$ = 1412.03 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.96	19.21	19.82	17.28	16.58	14.31	13.26	15.21	15.39	17.94	19.58	21.27

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.31	43.79	46.65	43.37	42.99	39.83	41.16	42.99	43.37	46.65	46.91	50.31	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	

Output from water heater (annual)$_{1...12}$ 1950.34 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.25	53.52	55.59	49.14	47.5	41.67	39.68	44.47	44.97	51.43	55.14	59.72	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.4	16.34	13.29	10.06	7.52	6.35	6.86	8.92	11.97	15.2	17.74	18.91	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	206.4	208.54	203.14	191.65	177.15	163.52	154.41	152.27	157.67	169.16	183.66	197.29	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	(71)

Water heating gains (Table 5)

(72)m=	82.33	79.64	74.72	68.26	63.84	57.88	53.33	59.77	62.45	69.13	76.58	80.27	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	368.21	365.61	352.24	331.05	309.59	288.82	275.68	282.04	293.17	314.56	339.06	357.55	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)
Southwest	0.9x	0.77	x	2.89	x	36.79		0.55	x	0.7	=	56.74	(79)
Southwest	0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	96.65	(79)
Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	132.24	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	163.85	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	183.53	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	182.2	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	175.66	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	160.98	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	143.19	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	106.82	(79)
Southwest	0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	67.96	(79)
Southwest	0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	48.56	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(83)m=	223.53	380.75	520.96	645.49	723.01	717.78	692.02	634.19	564.09	420.81	267.74	191.29	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(84)m=	591.74	746.36	873.2	976.55	1032.6	1006.6	967.7	916.23	857.26	735.37	606.8	548.84	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.92	0.8	0.62	0.44	0.32	0.35	0.56	0.86	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(87)m=	20.16	20.41	20.67	20.88	20.97	21	21	21	20.99	20.85	20.47	20.12	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.09	20.1	20.11	20.11	20.13	20.13	20.13	20.12	20.11	20.11	20.1	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.9	0.76	0.57	0.38	0.26	0.28	0.49	0.82	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.99	19.34	19.7	19.99	20.09	20.13	20.13	20.13	20.12	19.96	19.44	18.94	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.28	19.6	19.94	20.21	20.31	20.34	20.34	20.34	20.33	20.18	19.69	19.23	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.13	19.45	19.79	20.06	20.16	20.19	20.19	20.19	20.18	20.03	19.54	19.08	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.89	0.76	0.57	0.39	0.26	0.29	0.5	0.81	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	583.05	713.68	778.17	737.86	592.06	390.51	251.46	264.55	425.19	597.53	584.32	543.13	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1089.34	1065.19	969.09	799.12	603.47	391.42	251.52	264.67	428.94	672.87	894.32	1077.23	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	376.68	236.21	142.04	44.1	8.49	0	0	0	0	56.05	223.2	397.37	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1484.16 (98)

Space heating requirement in kWh/m²/year 20.06 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	376.68	236.21	142.04	44.1	8.49	0	0	0	0	56.05	223.2	397.37	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	416.68	261.29	157.13	48.79	9.4	0	0	0	0	62.01	246.91	439.56	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1641.76 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08

Efficiency of water heater: 80.3 (216)

(217)m= 86.66 | 85.85 | 84.48 | 82.3 | 80.77 | 80.3 | 80.3 | 80.3 | 80.3 | 82.63 | 85.63 | 86.84 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 226.98 | 200.14 | 211.62 | 192.66 | 190.06 | 168.38 | 161.32 | 179.83 | 181.82 | 201.21 | 207.25 | 221.19

Total = Sum(219a)$_{1...12}$ = 2342.46 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1641.76	
Water heating fuel used		2342.46	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	190.61		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		220.61	(231)
Electricity for lighting		324.96	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	354.62	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	505.97	(264)
Space and water heating	(261) + (262) + (263) + (264) =			860.59	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	114.5	(267)
Electricity for lighting	(232) x	0.519	=	168.65	(268)
Total CO2, kg/year	sum of (265)…(271) =			1143.75	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			15.46	(273)
EI rating (section 14)				87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 69

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.3	(1a) x	2.56	(2a) =	187.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.3	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	56.92	19.88	37.04	x	0.16	=	5.93			(29)
Walls Type2	22.18	2.42	19.76	x	0.16	=	3.16			(29)
Total area of elements, m²			79.1							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 38.83 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 965.55 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.76 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 45.59 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.43	20.17	19.91	18.59	18.33	17.01	17.01	16.75	17.54	18.33	18.86	19.38	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	66.03	65.76	65.5	64.18	63.92	62.6	62.6	62.34	63.13	63.92	64.45	64.97	

Average = Sum(39)$_{1...12}$ /12= 64.12 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.9	0.9	0.89	0.88	0.87	0.85	0.85	0.85	0.86	0.87	0.88	0.89

Average = Sum(40)$_{1...12}$ /12= 0.87 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.38 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	98.32	94.75	91.17	87.6	84.02	80.44	80.44	84.02	87.6	91.17	94.75	98.32	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1072.6 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.81	127.52	131.59	114.73	110.08	94.99	88.03	101.01	102.22	119.12	130.03	141.21

Total = Sum(45)$_{1...12}$ = 1406.35 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.87	19.13	19.74	17.21	16.51	14.25	13.2	15.15	15.33	17.87	19.5	21.18

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.1	43.61	46.46	43.2	42.82	39.67	40.99	42.82	43.2	46.46	46.72	50.1	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31	

Output from water heater (annual)$_{1...12}$ 1942.5 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.01	53.3	55.37	48.95	47.31	41.5	39.52	44.29	44.79	51.22	54.92	59.48	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.26	16.22	13.19	9.99	7.47	6.3	6.81	8.85	11.88	15.09	17.61	18.77	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.87	207	201.64	190.24	175.84	162.31	153.27	151.14	156.5	167.91	182.3	195.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	(71)

Water heating gains (Table 5)

(72)m=	82	79.32	74.42	67.98	63.58	57.64	53.11	59.53	62.2	68.85	76.27	79.94	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	365.99	363.4	350.11	329.06	307.74	287.11	274.05	280.38	291.44	312.69	337.04	355.4	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	79.52	152.43	253.69	389.97	505.84	532.55	500.79	409.71	300.15	180.64	98.34	66.05	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	445.51	515.83	603.8	719.03	813.58	819.65	774.84	690.09	591.59	493.33	435.37	421.45	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.89	0.7	0.49	0.36	0.41	0.71	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.12	20.27	20.52	20.82	20.97	21	21	21	20.98	20.74	20.38	20.1	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.17	20.17	20.17	20.19	20.19	20.21	20.21	20.21	20.2	20.19	20.19	20.18	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.87	0.65	0.43	0.29	0.34	0.64	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.98	19.2	19.56	19.99	20.16	20.2	20.21	20.21	20.18	19.89	19.37	18.96	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.27	19.48	19.81	20.2	20.37	20.41	20.41	20.41	20.39	20.11	19.63	19.26	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.12	19.33	19.66	20.05	20.22	20.26	20.26	20.26	20.24	19.96	19.48	19.11	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.96	0.86	0.65	0.43	0.3	0.35	0.64	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	443.57	510.24	582.08	618.96	529.51	353.42	229.19	240.71	378.06	459.47	430.88	420.1	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	978.81	948.75	861.94	715.81	544.63	354.35	229.25	240.88	387.49	598.47	798.04	968.46	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	398.22	294.67	208.22	69.73	11.25	0	0	0	0	103.42	264.36	407.98	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1757.85 (98)

Space heating requirement in kWh/m²/year 23.98 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	398.22	294.67	208.22	69.73	11.25	0	0	0	0	103.42	264.36	407.98	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	440.51	325.97	230.33	77.14	12.44	0	0	0	0	114.4	292.43	451.3	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1944.52 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31

Efficiency of water heater 80.3 (216)

(217)m= 86.8 | 86.41 | 85.45 | 83.15 | 80.92 | 80.3 | 80.3 | 80.3 | 80.3 | 83.9 | 86.06 | 86.91 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 225.7 | 198.06 | 208.38 | 189.94 | 188.95 | 167.7 | 160.67 | 179.11 | 181.09 | 197.35 | 205.38 | 220.12

Total = Sum(219a)$_{1...12}$ = 2322.46 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1944.52	
Water heating fuel used		2322.46	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	188.87		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		218.87	(231)
Electricity for lighting		322.56	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	420.02	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	501.65	(264)
Space and water heating	(261) + (262) + (263) + (264) =			921.67	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	113.59	(267)
Electricity for lighting	(232) x	0.519	=	167.41	(268)
Total CO2, kg/year	sum of (265)…(271) =			1202.67	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			16.41	(273)
EI rating (section 14)				86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 70

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.47	(1a) x	2.56	(2a) =	180.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.47	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	31.35	16.99	14.36	x	0.16	=	2.3			(29)
Walls Type2	17.17	2.42	14.75	x	0.16	=	2.36			(29)
Total area of elements, m²			48.53							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 30.57 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 494.99 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.61 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.18 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.65	19.39	19.14	17.88	17.62	16.36	16.36	16.1	16.86	17.62	18.13	18.64	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	54.83	54.58	54.32	53.06	52.81	51.54	51.54	51.29	52.05	52.81	53.31	53.82	

Average = Sum(39)$_{1...12}$ /12= 53 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.78	0.77	0.77	0.75	0.75	0.73	0.73	0.73	0.74	0.75	0.76	0.76

Average = Sum(40)$_{1...12}$ /12= 0.75 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.82 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.6	93.09	89.57	86.06	82.55	79.04	79.04	82.55	86.06	89.57	93.09	96.6

Total = Sum(44)$_{1...12}$ = 1053.82 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.25	125.29	129.29	112.72	108.16	93.33	86.48	99.24	100.43	117.04	127.76	138.73

Total = Sum(45)$_{1...12}$ = 1381.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.49	18.79	19.39	16.91	16.22	14	12.97	14.89	15.06	17.56	19.16	20.81

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.23	42.85	45.65	42.44	42.07	38.98	40.28	42.07	42.44	45.65	45.91	49.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	

Output from water heater (annual)$_{1...12}$ 1908.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	59.94	52.37	54.4	48.09	46.48	40.78	38.82	43.51	44	50.33	53.96	58.44	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.69	15.71	12.78	9.67	7.23	6.1	6.6	8.57	11.51	14.61	17.05	18.18	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.4	200.46	195.27	184.23	170.29	157.18	148.43	146.37	151.56	162.6	176.55	189.65	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	(71)

Water heating gains (Table 5)

(72)m=	80.56	77.93	73.12	66.79	62.47	56.63	52.18	58.49	61.11	67.64	74.94	78.54	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	356.52	353.97	341.03	320.56	299.85	279.79	267.07	273.29	284.04	304.72	328.4	346.24	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	407.66	458.08	528.6	628.6	713.92	721.23	680.04	602.51	512.6	431.95	392.76	388	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.89	0.67	0.46	0.33	0.39	0.68	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.27	20.39	20.61	20.88	20.98	21	21	21	20.99	20.8	20.5	20.26	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.27	20.28	20.28	20.29	20.3	20.31	20.31	20.32	20.31	20.3	20.29	20.28	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.86	0.63	0.41	0.28	0.33	0.62	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.29	19.47	19.79	20.16	20.28	20.31	20.31	20.32	20.3	20.07	19.63	19.28	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.55	19.72	20.01	20.35	20.47	20.5	20.5	20.5	20.48	20.27	19.87	19.54	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.4	19.57	19.86	20.2	20.32	20.35	20.35	20.35	20.33	20.12	19.72	19.39	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.86	0.63	0.41	0.28	0.34	0.62	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	406.16	454.05	511.68	537.89	448.61	295.98	193.17	202.56	320.06	403.16	389.16	386.95	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	828.19	800.62	725.75	599.71	455.31	296.23	193.18	202.61	324.44	502.7	672.55	817.72	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	313.99	232.9	159.27	44.51	4.98	0	0	0	0	74.06	204.04	320.49	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1354.25 (98)

Space heating requirement in kWh/m²/year 19.22 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	313.99	232.9	159.27	44.51	4.98	0	0	0	0	74.06	204.04	320.49	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	347.34	257.63	176.18	49.24	5.51	0	0	0	0	81.92	225.71	354.53	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1498.07 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96

Efficiency of water heater 80.3 (216)

(217)m=	86.28	85.87	84.82	82.35	80.59	80.3	80.3	80.3	80.3	83.21	85.46	86.38	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	223.1	195.8	206.25	188.41	186.4	164.77	157.86	175.97	177.92	195.51	203.21	217.59	

Total = Sum(219a)$_{1...12}$ = 2292.8 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1498.07

DER WorkSheet: New dwelling design stage

Water heating fuel used			2292.8	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		181.59		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		211.59	(231)
Electricity for lighting			312.37	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	323.58	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	495.25	(264)
Space and water heating	(261) + (262) + (263) + (264) =				818.83	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	109.81	(267)
Electricity for lighting	(232) x		0.519	=	162.12	(268)
Total CO2, kg/year		sum of (265)…(271) =			1090.76	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			15.48	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 71

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.12	(1a) x	2.56	(2a) =	130.85	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.12	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.85	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	25.24	12.37	12.87	x	0.16	=	2.06			(29)
Walls Type2	33.85	2.42	31.43	x	0.16	=	5.03			(29)
Total area of elements, m²			59.09							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 26.88 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 753.05 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.6 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 30.48 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.25	14.07	13.88	12.97	12.78	11.86	11.86	11.68	12.23	12.78	13.15	13.52	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	44.73	44.55	44.36	43.44	43.26	42.34	42.34	42.16	42.71	43.26	43.63	43.99	

Average = Sum(39)$_{1...12}$ /12= 43.4 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.88	0.87	0.87	0.85	0.85	0.83	0.83	0.82	0.84	0.85	0.85	0.86

Average = Sum(40)$_{1...12}$ /12= 0.85 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.12 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.63	79.63	76.62	73.62	70.61	67.61	67.61	70.61	73.62	76.62	79.63	82.63

Total = Sum(44)$_{1...12}$ = 901.44 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.54	107.18	110.6	96.42	92.52	79.84	73.98	84.89	85.91	100.12	109.28	118.67

Total = Sum(45)$_{1...12}$ = 1181.94 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.38	16.08	16.59	14.46	13.88	11.98	11.1	12.73	12.89	15.02	16.39	17.8

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.11	36.65	39.05	36.3	35.98	33.34	34.45	35.98	36.3	39.05	39.27	42.11	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78	

Output from water heater (annual)$_{1...12}$ 1632.53 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.27	44.8	46.53	41.14	39.76	34.88	33.21	37.22	37.64	43.05	46.15	49.99	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.38	11.89	9.67	7.32	5.47	4.62	4.99	6.49	8.71	11.06	12.9	13.76	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	150.13	151.69	147.76	139.4	128.85	118.94	112.31	110.76	114.68	123.04	133.59	143.51	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	(71)

Water heating gains (Table 5)

(72)m=	68.91	66.66	62.55	57.13	53.44	48.45	44.64	50.03	52.28	57.86	64.1	67.19	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	284.27	282.08	271.82	255.7	239.61	223.85	213.79	219.12	227.51	243.8	262.44	276.29	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	13.91	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	28.31	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	51.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	83.77	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	112.6	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	120.04	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	112.29	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	89.52	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	62.15	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	34.6	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	17.5	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	11.36	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	37.24	75.8	136.57	224.28	301.48	321.41	300.67	239.7	166.41	92.63	46.85	30.41	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	321.51	357.88	408.39	479.98	541.08	545.25	514.46	458.81	393.92	336.44	309.3	306.7	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.9	0.71	0.49	0.36	0.42	0.72	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.18	20.3	20.53	20.82	20.97	21	21	21	20.98	20.75	20.42	20.16	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.19	20.19	20.19	20.21	20.21	20.23	20.23	20.23	20.22	20.21	20.21	20.2	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.88	0.66	0.44	0.3	0.35	0.65	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.08	19.27	19.6	20.01	20.18	20.23	20.23	20.23	20.2	19.93	19.45	19.07	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.36	19.53	19.83	20.21	20.38	20.42	20.42	20.42	20.4	20.13	19.69	19.34	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.21	19.38	19.68	20.06	20.23	20.27	20.27	20.27	20.25	19.98	19.54	19.19	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.99	0.97	0.87	0.66	0.44	0.3	0.36	0.65	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	319.81	353.96	394.72	417.62	358.54	239.47	155.42	163.19	256.09	313.78	305.66	305.46	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	666.72	644.8	584.7	484.87	369	240.07	155.46	163.31	262.55	405.97	542.91	659.59	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	258.11	195.45	141.34	48.42	7.78	0	0	0	0	68.59	170.82	263.48	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1153.99 (98)

Space heating requirement in kWh/m²/year 22.58 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	258.11	195.45	141.34	48.42	7.78	0	0	0	0	68.59	170.82	263.48	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	285.52	216.21	156.35	53.57	8.61	0	0	0	0	75.87	188.96	291.46	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1276.53 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78

Efficiency of water heater 80.3 (216)

(217)m=	86.18	85.82	84.91	82.77	80.82	80.3	80.3	80.3	80.3	83.38	85.4	86.29	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	191.06	167.58	176.24	160.35	159.01	140.94	135.03	150.53	152.19	166.91	173.94	186.34	

Total = Sum(219a)$_{1...12}$ = 1960.12 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1276.53

DER WorkSheet: New dwelling design stage

Water heating fuel used		1960.12	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	131.7		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	161.7	(231)
Electricity for lighting		236.37	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	275.73	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	423.39	(264)
Space and water heating	(261) + (262) + (263) + (264) =				699.12	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	83.92	(267)
Electricity for lighting	(232) x		0.519	=	122.68	(268)
Total CO2, kg/year		sum of (265)…(271) =			905.72	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			17.72	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 72

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	55.28	(1a) x	2.56	(2a) =	141.52	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	55.28	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		141.52	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Floor			55.286	x	0.12	=	6.63432			(28)
Walls Type1	47.86	9.24	38.62	x	0.16	=	6.18			(29)
Walls Type2	19.92	2.42	17.5	x	0.16	=	2.8			(29)
Total area of elements, m²			123.06							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.25 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 5100.42 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.88 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 39.13 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	15.41	15.21	15.01	14.02	13.82	12.83	12.83	12.63	13.23	13.82	14.22	14.62	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	54.54	54.34	54.14	53.15	52.95	51.96	51.96	51.76	52.36	52.95	53.35	53.75	

Average = Sum(39)$_{1...12}$ /12= 53.1 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.99	0.98	0.98	0.96	0.96	0.94	0.94	0.94	0.95	0.96	0.97	0.97

Average = Sum(40)$_{1...12}$ /12= 0.96 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.85 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 78.03 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	85.84	82.71	79.59	76.47	73.35	70.23	70.23	73.35	76.47	79.59	82.71	85.84

Total = Sum(44)$_{1...12}$ = 936.38 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	127.29	111.33	114.88	100.16	96.1	82.93	76.85	88.18	89.24	104	113.52	123.27

Total = Sum(45)$_{1...12}$ = 1227.75 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.09	16.7	17.23	15.02	14.42	12.44	11.53	13.23	13.39	15.6	17.03	18.49

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	43.74	38.07	40.56	37.71	37.38	34.63	35.79	37.38	37.71	40.56	40.79	43.74	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	171.03	149.4	155.44	137.87	133.48	117.56	112.63	125.56	126.95	144.56	154.31	167.02	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	171.03	149.4	155.44	137.87	133.48	117.56	112.63	125.56	126.95	144.56	154.31	167.02	

Output from water heater (annual)$_{1...12}$ 1695.81 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	53.26	46.53	48.34	42.73	41.3	36.23	34.5	38.67	39.1	44.72	47.94	51.92	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	14.84	13.18	10.72	8.12	6.07	5.12	5.53	7.19	9.66	12.26	14.31	15.25	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	160.91	162.58	158.37	149.41	138.1	127.48	120.38	118.71	122.92	131.87	143.18	153.81	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	(71)

Water heating gains (Table 5)

(72)m=	71.59	69.25	64.97	59.35	55.51	50.32	46.37	51.97	54.3	60.11	66.59	69.79	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	301.02	298.69	287.74	270.56	253.36	236.6	225.96	231.55	240.56	257.92	277.76	292.53	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	27.82	56.62	102.01	167.53	225.19	240.08	224.59	179.05	124.3	69.19	35	22.72	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	328.83	355.31	389.75	438.09	478.56	476.68	450.55	410.6	364.86	327.11	312.76	315.25	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.87	0.67	0.5	0.57	0.85	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.98	20.09	20.3	20.61	20.86	20.98	21	20.99	20.91	20.59	20.24	19.97	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.1	20.1	20.12	20.12	20.13	20.13	20.14	20.13	20.12	20.11	20.11	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.95	0.82	0.59	0.41	0.47	0.79	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.73	18.89	19.2	19.65	19.98	20.12	20.13	20.13	20.05	19.64	19.13	18.72	(90)

fLA = Living area ÷ (4) = 0.23 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.02	19.16	19.45	19.87	20.19	20.32	20.33	20.33	20.25	19.86	19.38	19.01	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.87	19.01	19.3	19.72	20.04	20.17	20.18	20.18	20.1	19.71	19.23	18.86	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	1	0.99	0.98	0.94	0.82	0.59	0.41	0.47	0.78	0.96	0.99	1	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	327.56	352.94	383.31	412.69	391.02	283.18	185.55	194.52	286.07	315.36	310.36	314.28	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	794.46	766.97	693.2	575.28	441.44	289.26	186.13	195.78	314.23	482.33	647.37	787.73	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	347.37	278.23	230.56	117.06	37.51	0	0	0	0	124.23	242.65	352.24	

DER WorkSheet: New dwelling design stage

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ =	1729.85	(98)
Space heating requirement in kWh/m²/year	31.29	(99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system	0	(201)
Fraction of space heat from main system(s) (202) = 1 – (201) =	1	(202)
Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] =	1	(204)
Efficiency of main space heating system 1	90.4	(206)
Efficiency of secondary/supplementary heating system, %	0	(208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	347.37	278.23	230.56	117.06	37.51	0	0	0	0	124.23	242.65	352.24	
(211)m = {[(98)m x (204)] } x 100 ÷ (206) (211)	384.26	307.77	255.04	129.49	41.5	0	0	0	0	137.42	268.42	389.65	

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 1913.55 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
	171.03	149.4	155.44	137.87	133.48	117.56	112.63	125.56	126.95	144.56	154.31	167.02

Efficiency of water heater	80.3	(216)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(217)m=	86.8	86.59	86.04	84.64	82.32	80.3	80.3	80.3	80.3	84.67	86.19	86.89	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(219)m=	197.05	172.53	180.66	162.88	162.15	146.4	140.27	156.36	158.09	170.72	179.04	192.23

Total = Sum(219a)$_{1...12}$ = 2018.39 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1913.55
Water heating fuel used		2018.39
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	142.44	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		172.44 (231)
Electricity for lighting		262.09 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216 =	413.33 (261)

DER WorkSheet: New dwelling design stage

Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	435.97	(264)
Space and water heating	(261) + (262) + (263) + (264) =			849.3	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	89.49	(267)
Electricity for lighting	(232) x	0.519	=	136.03	(268)
Total CO2, kg/year	sum of (265)…(271) =			1074.82	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			19.44	(273)
EI rating (section 14)				86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 73

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	66.43	(1a) x	2.56	(2a) =	170.06	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	66.43	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		170.06	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			66.431	x	0.12	=	7.97172			(28)
Walls Type1	37.25	19.88	17.37	x	0.16	=	2.78			(29)
Walls Type2	32.9	2.42	30.48	x	0.16	=	4.88			(29)
Total area of elements, m²			136.57							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 45.37 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 5795.64 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.6 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 51.97 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	18.52	18.28	18.04	16.85	16.61	15.42	15.42	15.18	15.9	16.61	17.09	17.57	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	70.49	70.25	70.02	68.82	68.59	67.39	67.39	67.15	67.87	68.59	69.06	69.54	

Average = Sum(39)$_{1...12}$ /12= 68.76 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.06	1.06	1.05	1.04	1.03	1.01	1.01	1.01	1.02	1.03	1.04	1.05	
Average = Sum(40)$_{1...12}$ /12=													1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.16 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 85.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	93.96	90.54	87.12	83.71	80.29	76.87	76.87	80.29	83.71	87.12	90.54	93.96	
Total = Sum(44)$_{1...12}$ =													1024.98 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	139.34	121.86	125.75	109.63	105.2	90.78	84.12	96.53	97.68	113.84	124.26	134.94	
Total = Sum(45)$_{1...12}$ =													1343.92 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	20.9	18.28	18.86	16.45	15.78	13.62	12.62	14.48	14.65	17.08	18.64	20.24	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.88	41.67	44.4	41.28	40.92	37.91	39.17	40.92	41.28	44.4	44.65	47.88	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82	

Output from water heater (annual)$_{1...12}$ 1856.27 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	58.3	50.94	52.91	46.77	45.21	39.66	37.76	42.32	42.8	48.95	52.48	56.84	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.83	14.95	12.16	9.21	6.88	5.81	6.28	8.16	10.95	13.91	16.23	17.3	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	188.83	190.79	185.85	175.34	162.07	149.6	141.26	139.3	144.24	154.75	168.02	180.49	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	(71)

Water heating gains (Table 5)

(72)m=	78.36	75.8	71.12	64.96	60.76	55.08	50.76	56.89	59.44	65.79	72.89	76.39	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	342.37	339.88	327.47	307.85	288.06	268.84	256.64	262.7	272.98	292.8	315.49	332.54	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	79.52	152.43	253.69	389.97	505.84	532.55	500.79	409.71	300.15	180.64	98.34	66.05	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	421.88	492.32	581.16	697.82	793.89	801.38	757.44	672.41	573.14	473.44	413.82	398.58	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.91	0.74	0.53	0.39	0.46	0.75	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.91	20.08	20.36	20.71	20.93	20.99	21	21	20.94	20.63	20.21	19.89	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.04	20.04	20.05	20.06	20.07	20.07	20.07	20.07	20.06	20.05	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.88	0.68	0.46	0.31	0.37	0.67	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.58	18.82	19.23	19.73	19.99	20.07	20.07	20.07	20.02	19.63	19.03	18.56	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.91	19.13	19.51	19.98	20.22	20.29	20.3	20.3	20.25	19.88	19.32	18.89	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.76	18.98	19.36	19.83	20.07	20.14	20.15	20.15	20.1	19.73	19.17	18.74	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.99	0.96	0.88	0.68	0.46	0.32	0.37	0.68	0.94	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	419.69	486.45	560.46	610.69	543.63	370.76	238.97	251.25	387.36	443.62	409.2	397.03	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1019.46	989.44	900.31	751.91	574.29	373.63	239.24	251.91	407.33	625.96	833.55	1010.91	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	446.22	338	252.85	101.68	22.81	0	0	0	0	135.66	305.53	456.73	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2059.49 (98)

Space heating requirement in kWh/m²/year 31 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	446.22	338	252.85	101.68	22.81	0	0	0	0	135.66	305.53	456.73	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	493.61	373.9	279.71	112.48	25.23	0	0	0	0	150.07	337.98	505.23	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2278.2 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82

Efficiency of water heater 80.3 (216)

(217)m= 87.16 | 86.84 | 86.05 | 84.08 | 81.53 | 80.3 | 80.3 | 80.3 | 80.3 | 84.67 | 86.53 | 87.26 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 214.79 | 188.32 | 197.74 | 179.49 | 179.21 | 160.26 | 153.54 | 171.16 | 173.05 | 186.89 | 195.21 | 209.5

Total = Sum(219a)$_{1...12}$ = 2209.17 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2278.2
Water heating fuel used		2209.17
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	171.17	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		201.17 (231)
Electricity for lighting		297.29 (232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216 =	492.09 (261)
Space heating (secondary)	(215) x	0.519 =	0 (263)
Water heating	(219) x	0.216 =	477.18 (264)
Space and water heating	(261) + (262) + (263) + (264) =		969.27 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519 =	104.41 (267)
Electricity for lighting	(232) x	0.519 =	154.3 (268)
Total CO2, kg/year	sum of (265)…(271) =		1227.97 (272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =		18.49 (273)
EI rating (section 14)			85 (274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 74

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	77.64	(1a) x	2.56	(2a) =	198.76	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	77.64	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		198.76	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			74.146	x	0.12	=	8.89752			(28)
Walls Type1	54.34	19.88	34.46	x	0.16	=	5.51			(29)
Walls Type2	14.93	2.42	12.51	x	0.16	=	2			(29)
Total area of elements, m²			143.42							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 46.16 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6359.46 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 10.42 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 56.57 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	21.64	21.37	21.09	19.69	19.41	18.02	18.02	17.74	18.58	19.41	19.97	20.53	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	78.22	77.94	77.66	76.27	75.99	74.59	74.59	74.31	75.15	75.99	76.54	77.1	

Average = Sum(39)$_{1...12}$ /12= 76.2 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.01	1	1	0.98	0.98	0.96	0.96	0.96	0.97	0.98	0.99	0.99

Average = Sum(40)$_{1...12}$ /12= 0.98 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.42 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 91.59 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	100.75	97.09	93.43	89.76	86.1	82.43	82.43	86.1	89.76	93.43	97.09	100.75

Total = Sum(44)$_{1...12}$ = 1099.12 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	149.41	130.68	134.85	117.56	112.8	97.34	90.2	103.51	104.74	122.07	133.25	144.7

Total = Sum(45)$_{1...12}$ = 1441.12 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	22.41	19.6	20.23	17.63	16.92	14.6	13.53	15.53	15.71	18.31	19.99	21.7

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	44.69	47.61	44.27	43.87	40.65	42.01	43.87	44.27	47.61	47.88	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	200.37	175.37	182.46	161.83	156.68	137.99	132.21	147.38	149.01	169.68	181.13	195.66	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	200.37	175.37	182.46	161.83	156.68	137.99	132.21	147.38	149.01	169.68	181.13	195.66	

Output from water heater (annual)$_{1...12}$ 1989.76 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	62.42	54.62	56.74	50.16	48.48	42.53	40.49	45.38	45.89	52.49	56.27	60.85	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	19.12	16.98	13.81	10.45	7.81	6.6	7.13	9.27	12.44	15.79	18.43	19.65	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	214.44	216.66	211.06	199.12	184.05	169.89	160.42	158.2	163.81	175.74	190.81	204.98	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	(71)

Water heating gains (Table 5)

(72)m=	83.9	81.28	76.26	69.66	65.16	59.07	54.43	61	63.74	70.55	78.16	81.79	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	379.7	377.17	363.37	341.48	319.27	297.8	284.23	290.72	302.23	324.34	349.65	368.66	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	59.85	121.82	219.48	360.44	484.51	516.54	483.21	385.22	267.44	148.87	75.3	48.87	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	439.55	498.99	582.85	701.93	803.77	814.34	767.44	675.93	569.67	473.21	424.95	417.54	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.79	0.58	0.43	0.5	0.81	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.92	20.06	20.32	20.67	20.91	20.99	21	21	20.93	20.59	20.2	19.91	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.08	20.08	20.08	20.1	20.1	20.12	20.12	20.12	20.11	20.1	20.1	20.09	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.92	0.74	0.5	0.34	0.41	0.74	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.63	18.83	19.21	19.72	20.02	20.11	20.12	20.12	20.05	19.62	19.05	18.62	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.96	19.15	19.49	19.96	20.25	20.34	20.34	20.34	20.28	19.87	19.35	18.95	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.81	19	19.34	19.81	20.1	20.19	20.19	20.19	20.13	19.72	19.2	18.8	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.74	0.51	0.35	0.42	0.74	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	438.21	495.73	570.72	640.96	593.75	412.47	267.6	280.92	421.78	454.93	422.22	416.58	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1135.16	1098.67	997.28	832.34	638.23	416.63	267.99	281.92	453.06	692.88	925.96	1125.48	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	518.53	405.18	317.36	137.79	33.1	0	0	0	0	177.04	362.7	527.43	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2479.11 (98)

Space heating requirement in kWh/m²/year 31.93 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	518.53	405.18	317.36	137.79	33.1	0	0	0	0	177.04	362.7	527.43	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	573.59	448.21	351.06	152.43	36.61	0	0	0	0	195.84	401.21	583.44	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2742.38 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	200.37	175.37	182.46	161.83	156.68	137.99	132.21	147.38	149.01	169.68	181.13	195.66

Efficiency of water heater 80.3 (216)

(217)m= 87.34 | 87.09 | 86.43 | 84.65 | 81.9 | 80.3 | 80.3 | 80.3 | 80.3 | 85.16 | 86.77 | 87.42 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 229.42 | 201.36 | 211.1 | 191.18 | 191.32 | 171.85 | 164.64 | 183.54 | 185.57 | 199.25 | 208.76 | 223.8

Total = Sum(219a)$_{1...12}$ = 2361.78 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2742.38	
Water heating fuel used		2361.78	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	200.05		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		230.05	(231)
Electricity for lighting		337.62	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	592.35	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	510.14	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1102.5	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	119.4	(267)
Electricity for lighting	(232) x	0.519	=	175.22	(268)
Total CO2, kg/year	sum of (265)…(271) =			1397.12	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			17.99	(273)
EI rating (section 14)				85	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 75

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	77.53	(1a) x	2.56	(2a) =	198.47	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	77.53	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		198.47	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	54.38	19.88	34.5	x	0.16	=	5.52			(29)
Walls Type2	14.93	2.42	12.51	x	0.16	=	2			(29)
Roof	77.53	0	77.53	x	0.12	=	9.3			(30)
Total area of elements, m²			146.84							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 46.57 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1496.97 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.42 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 55.99 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	21.61	21.34	21.06	19.67	19.39	17.99	17.99	17.72	18.55	19.39	19.94	20.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	77.61	77.33	77.05	75.66	75.38	73.99	73.99	73.71	74.54	75.38	75.94	76.49	

Average = Sum(39)$_{1...12}$ /12= 75.59 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1	1	0.99	0.98	0.97	0.95	0.95	0.95	0.96	0.97	0.98	0.99

Average = Sum(40)$_{1...12}$ /12= 0.97 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.41 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 91.54 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	100.69	97.03	93.37	89.71	86.05	82.39	82.39	86.05	89.71	93.37	97.03	100.69	

Total = Sum(44)$_{1...12}$ = 1098.47 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	149.33	130.6	134.77	117.49	112.74	97.28	90.15	103.45	104.68	122	133.17	144.61	

Total = Sum(45)$_{1...12}$ = 1440.27 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	22.4	19.59	20.22	17.62	16.91	14.59	13.52	15.52	15.7	18.3	19.98	21.69	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	44.66	47.58	44.24	43.85	40.63	41.98	43.85	44.24	47.58	47.85	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	

Output from water heater (annual)$_{1...12}$ 1988.65 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	62.39	54.59	56.71	50.13	48.45	42.5	40.47	45.36	45.87	52.46	56.24	60.82	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	19.1	16.96	13.79	10.44	7.81	6.59	7.12	9.26	12.42	15.77	18.41	19.63	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	214.2	216.42	210.82	198.89	183.84	169.7	160.24	158.02	163.62	175.55	190.6	204.75	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	(71)

Water heating gains (Table 5)

(72)m=	83.86	81.24	76.22	69.62	65.12	59.03	54.4	60.97	63.7	70.51	78.11	81.75	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	379.36	376.83	363.04	341.17	318.98	297.53	283.97	290.46	301.96	324.04	349.34	368.34	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	175.49	301.81	420.62	534.04	609.91	610.67	586.6	529.2	459.78	335.63	210.72	149.84	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	554.85	678.64	783.67	875.21	928.89	908.2	870.57	819.66	761.74	659.68	560.06	518.18	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.98	0.96	0.87	0.71	0.52	0.37	0.41	0.65	0.91	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.07	20.28	20.54	20.81	20.95	20.99	21	21	20.98	20.77	20.37	20.04	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.08	20.09	20.09	20.1	20.11	20.12	20.12	20.12	20.12	20.11	20.1	20.09	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.66	0.45	0.3	0.33	0.58	0.88	0.98	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.85	19.16	19.53	19.89	20.06	20.12	20.12	20.12	20.1	19.86	19.3	18.81	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.12	19.4	19.75	20.09	20.26	20.31	20.31	20.31	20.29	20.06	19.53	19.08	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.97	19.25	19.6	19.94	20.11	20.16	20.16	20.16	20.14	19.91	19.38	18.93	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.66	0.45	0.3	0.34	0.58	0.88	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	549.82	661.54	732.25	727.51	609.59	409.08	263.42	277.17	441.4	578.66	547.6	514.8	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1138.48	1109.8	1009.12	835.48	633.63	411.27	263.59	277.49	450.31	701.9	932.81	1126.87	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	437.97	301.23	205.99	77.74	17.88	0	0	0	0	91.69	277.35	455.38	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1865.23 (98)

Space heating requirement in kWh/m²/year 24.06 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	437.97	301.23	205.99	77.74	17.88	0	0	0	0	91.69	277.35	455.38	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	484.48	333.21	227.87	86	19.78	0	0	0	0	101.42	306.8	503.74	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2063.3 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57

Efficiency of water heater 80.3 (216)

(217)m=	86.97	86.4	85.36	83.32	81.23	80.3	80.3	80.3	80.3	83.58	86.12	87.11

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	230.3	202.84	213.63	194.11	192.77	171.75	164.55	183.43	185.46	202.9	210.19	224.52

Total = Sum(219a)$_{1...12}$ = 2376.43 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2063.3	
Water heating fuel used		2376.43	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	199.76		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		229.76	(231)
Electricity for lighting		337.24	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	445.67	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	513.31	(264)
Space and water heating	(261) + (262) + (263) + (264) =			958.98	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	119.25	(267)
Electricity for lighting	(232) x	0.519	=	175.03	(268)
Total CO2, kg/year	sum of (265)…(271) =			1253.26	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			16.17	(273)
EI rating (section 14)				86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 76

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.94	(1a) x	2.56	(2a) =	130.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.94	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	24.35	15.26	9.09	x	0.16	=	1.45			(29)
Walls Type2	39.32	2.42	36.9	x	0.16	=	5.9			(29)
Roof	50.94	0	50.94	x	0.12	=	6.11			(30)
Total area of elements, m²			114.61							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 37.09 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1240.25 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.81 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 43.9 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.2	14.02	13.84	12.92	12.74	11.82	11.82	11.64	12.19	12.74	13.11	13.47	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	58.1	57.92	57.73	56.82	56.64	55.72	55.72	55.54	56.09	56.64	57	57.37	

Average = Sum(39)$_{1...12}$ /12= 56.77 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.14	1.14	1.13	1.12	1.11	1.09	1.09	1.09	1.1	1.11	1.12	1.13

Average = Sum(40)$_{1...12}$ /12= 1.11 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.5	79.5	76.5	73.5	70.5	67.5	67.5	70.5	73.5	76.5	79.5	82.5

Total = Sum(44)$_{1...12}$ = 900.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.35	107.01	110.42	96.27	92.37	79.71	73.86	84.76	85.77	99.96	109.11	118.49

Total = Sum(45)$_{1...12}$ = 1180.06 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.35	16.05	16.56	14.44	13.86	11.96	11.08	12.71	12.87	14.99	16.37	17.77

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.04	36.59	38.98	36.25	35.93	33.29	34.4	35.93	36.25	38.98	39.21	42.04	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53	

Output from water heater (annual)$_{1...12}$ 1629.95 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.19	44.73	46.46	41.07	39.69	34.83	33.16	37.16	37.58	42.98	46.08	49.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.34	11.85	9.64	7.3	5.46	4.61	4.98	6.47	8.68	11.02	12.87	13.72	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.69	151.24	147.33	138.99	128.48	118.59	111.98	110.43	114.35	122.68	133.2	143.08	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	(71)

Water heating gains (Table 5)

(72)m=	68.8	66.56	62.45	57.04	53.35	48.37	44.57	49.95	52.19	57.77	64	67.08	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	283.61	281.42	271.18	255.1	239.05	223.33	213.3	218.62	226.99	243.24	261.83	275.65	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	130.13	224.56	314.92	403.07	463.21	465.03	446.19	400.53	345.32	250.25	156.4	111.03	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	413.74	505.98	586.1	658.17	702.27	688.36	659.49	619.15	572.32	493.49	418.23	386.67	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.86	0.7	0.51	0.37	0.41	0.64	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.97	20.19	20.48	20.77	20.93	20.99	21	21	20.97	20.73	20.29	19.93	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.97	19.97	19.97	19.99	19.99	20.01	20.01	20.01	20	19.99	19.99	19.98	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.82	0.64	0.43	0.29	0.32	0.56	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.61	18.94	19.34	19.74	19.93	20	20.01	20.01	19.98	19.71	19.1	18.57	(90)

fLA = Living area ÷ (4) = 0.28 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.99	19.29	19.66	20.03	20.21	20.28	20.28	20.29	20.25	20	19.43	18.95	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.84	19.14	19.51	19.88	20.06	20.13	20.13	20.14	20.1	19.85	19.28	18.8	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.92	0.81	0.64	0.44	0.3	0.33	0.57	0.86	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	407.97	488.68	539.28	535.85	451.55	305.43	196.65	206.99	327.67	425.18	405.37	382.63	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	844.91	824.79	751.07	623.79	473.68	307.98	196.9	207.44	336.78	523.65	694.46	837.4	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	325.09	225.86	157.58	63.31	16.46	0	0	0	0	73.26	208.15	338.35	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1408.07 (98)

Space heating requirement in kWh/m²/year 27.64 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	325.09	225.86	157.58	63.31	16.46	0	0	0	0	73.26	208.15	338.35	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	359.61	249.85	174.31	70.04	18.21	0	0	0	0	81.05	230.25	374.28	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1557.6 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53

Efficiency of water heater 80.3 (216)

(217)m= 86.74 | 86.19 | 85.19 | 83.31 | 81.33 | 80.3 | 80.3 | 80.3 | 80.3 | 83.52 | 85.9 | 86.88 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 189.53 | 166.61 | 175.39 | 159.06 | 157.74 | 140.72 | 134.82 | 150.29 | 151.95 | 166.35 | 172.65 | 184.76

Total = Sum(219a)$_{1...12}$ = 1949.88 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1557.6	
Water heating fuel used		1949.88	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	131.27		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		161.27	(231)
Electricity for lighting		235.67	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	336.44	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	421.17	(264)
Space and water heating	(261) + (262) + (263) + (264) =			757.62	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	83.7	(267)
Electricity for lighting	(232) x	0.519	=	122.31	(268)
Total CO2, kg/year	sum of (265)…(271) =			963.63	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			18.92	(273)
EI rating (section 14)				87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 77

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.4	(1a) x	2.56	(2a) =	131.58	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.4	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.58	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	24.33	15.26	9.07	x	0.16	=	1.45			(29)
Walls Type2	34.01	2.42	31.59	x	0.16	=	5.05			(29)
Roof	51.39	0	51.39	x	0.12	=	6.17			(30)
Total area of elements, m²			109.73							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 36.29 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1153.69 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.52 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 42.81 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.33	14.14	13.96	13.04	12.85	11.93	11.93	11.75	12.3	12.85	13.22	13.59	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	57.14	56.95	56.77	55.85	55.66	54.74	54.74	54.55	55.11	55.66	56.03	56.4	

Average = Sum(39)$_{1...12}$ /12= 55.8 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.11	1.11	1.1	1.09	1.08	1.06	1.06	1.06	1.07	1.08	1.09	1.1

Average = Sum(40)$_{1...12}$ /12= 1.09 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.73 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.32 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(44)m=	82.85	79.84	76.82	73.81	70.8	67.79	67.79	70.8	73.81	76.82	79.84	82.85

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 903.82 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.86	107.46	110.89	96.67	92.76	80.05	74.17	85.12	86.13	100.38	109.57	118.99

Total = Sum(45)$_{1...12}$ = 1185.06 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.43	16.12	16.63	14.5	13.91	12.01	11.13	12.77	12.92	15.06	16.44	17.85

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.22	36.75	39.15	36.4	36.08	33.43	34.54	36.08	36.4	39.15	39.37	42.22	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.08	144.21	150.04	133.07	128.84	113.48	108.72	121.19	122.53	139.53	148.94	161.21	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.08	144.21	150.04	133.07	128.84	113.48	108.72	121.19	122.53	139.53	148.94	161.21	

Output from water heater (annual)$_{1...12}$ 1636.84 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.41	44.92	46.66	41.24	39.86	34.97	33.3	37.32	37.74	43.16	46.28	50.12	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.45	11.95	9.72	7.35	5.5	4.64	5.02	6.52	8.75	11.11	12.97	13.82	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	150.86	152.43	148.48	140.09	129.48	119.52	112.86	111.3	115.24	123.64	134.24	144.21	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	(71)

Water heating gains (Table 5)

(72)m=	69.1	66.84	62.71	57.28	53.58	48.57	44.76	50.16	52.42	58.02	64.27	67.36	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	285.38	283.19	272.88	256.69	240.53	224.7	214.61	219.95	228.38	244.74	263.45	277.36	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	130.13	224.56	314.92	403.07	463.21	465.03	446.19	400.53	345.32	250.25	156.4	111.03	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	415.51	507.74	587.8	659.76	703.75	689.73	660.79	620.48	573.7	494.99	419.85	388.39	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.85	0.69	0.5	0.36	0.4	0.64	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20	20.23	20.5	20.79	20.94	20.99	21	21	20.97	20.75	20.32	19.96	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.99	19.99	20	20.01	20.01	20.03	20.03	20.03	20.02	20.01	20.01	20	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.81	0.63	0.43	0.28	0.32	0.56	0.86	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.68	19.01	19.4	19.78	19.96	20.02	20.03	20.03	20	19.75	19.16	18.64	(90)

fLA = Living area ÷ (4) = 0.35 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.14	19.43	19.79	20.13	20.3	20.36	20.37	20.37	20.34	20.1	19.56	19.1	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.99	19.28	19.64	19.98	20.15	20.21	20.22	20.22	20.19	19.95	19.41	18.95	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.92	0.81	0.64	0.44	0.3	0.34	0.57	0.86	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	409.89	490.63	540.85	535.95	450.32	304.9	197.78	207.92	327.34	426.18	407.15	384.47	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	839.55	819.11	745.67	619.02	470.6	307.17	198	208.32	335.67	520.51	690.01	831.86	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	319.67	220.74	152.39	59.81	15.09	0	0	0	0	70.18	203.66	332.86	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1374.39 (98)

Space heating requirement in kWh/m²/year 26.74 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	319.67	220.74	152.39	59.81	15.09	0	0	0	0	70.18	203.66	332.86	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	353.61	244.18	168.57	66.16	16.7	0	0	0	0	77.63	225.29	368.2	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1520.35 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	165.08	144.21	150.04	133.07	128.84	113.48	108.72	121.19	122.53	139.53	148.94	161.21

Efficiency of water heater: 80.3 (216)

(217)m= 86.69 | 86.12 | 85.09 | 83.18 | 81.25 | 80.3 | 80.3 | 80.3 | 80.3 | 83.42 | 85.84 | 86.84 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 190.44 | 167.45 | 176.33 | 159.98 | 158.57 | 141.31 | 135.39 | 150.93 | 152.59 | 167.26 | 173.51 | 185.65

Total = Sum(219a)$_{1...12}$ = 1959.41 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1520.35	
Water heating fuel used		1959.41	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	132.43		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		162.43	(231)
Electricity for lighting		237.52	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	328.39	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	423.23	(264)
Space and water heating	(261) + (262) + (263) + (264) =			751.63	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	84.3	(267)
Electricity for lighting	(232) x	0.519	=	123.28	(268)
Total CO2, kg/year	sum of (265)…(271) =			959.21	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			18.66	(273)
EI rating (section 14)				87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 78

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	49.58	(1a) x	2.56	(2a) =	126.92	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	49.58	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		126.92	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Windows Type 2			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Floor			38.452	x	0.12	=	4.61424			(28)
Walls Type1	17.48	7.51	9.97	x	0.16	=	1.59			(29)
Walls Type2	22.47	2.42	20.05	x	0.16	=	3.21			(29)
Roof	49.58	0	49.58	x	0.12	=	5.95			(30)
Total area of elements, m²			127.98							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 28.71 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 3840.42 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.48 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.19 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	13.82	13.64	13.47	12.58	12.4	11.51	11.51	11.33	11.86	12.4	12.75	13.11	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	49.01	48.83	48.65	47.76	47.59	46.7	46.7	46.52	47.05	47.59	47.94	48.3	

Average = Sum(39)$_{1...12}$ /12= 47.72 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.99	0.98	0.98	0.96	0.96	0.94	0.94	0.94	0.95	0.96	0.97	0.97

Average = Sum(40)$_{1...12}$ /12= 0.96 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.68 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.04 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	81.45	78.49	75.53	72.56	69.6	66.64	66.64	69.6	72.56	75.53	78.49	81.45

Total = Sum(44)$_{1...12}$ = 888.53 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	120.79	105.64	109.01	95.04	91.19	78.69	72.92	83.68	84.68	98.68	107.72	116.97

Total = Sum(45)$_{1...12}$ = 1165 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.12	15.85	16.35	14.26	13.68	11.8	10.94	12.55	12.7	14.8	16.16	17.55

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.51	36.13	38.49	35.78	35.47	32.86	33.96	35.47	35.78	38.49	38.71	41.51	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	162.29	141.77	147.5	130.82	126.66	111.56	106.88	119.14	120.46	137.17	146.42	158.48	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	162.29	141.77	147.5	130.82	126.66	111.56	106.88	119.14	120.46	137.17	146.42	158.48	

Output from water heater (annual)$_{1...12}$ 1609.15 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.54	44.16	45.87	40.55	39.19	34.38	32.74	36.69	37.1	42.43	45.49	49.27	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.74	12.21	9.93	7.52	5.62	4.74	5.12	6.66	8.94	11.35	13.25	14.13	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	146.14	147.65	143.83	135.7	125.43	115.77	109.33	107.81	111.63	119.77	130.04	139.69	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	(71)

Water heating gains (Table 5)

(72)m=	67.93	65.71	61.65	56.31	52.67	47.75	44	49.31	51.53	57.03	63.18	66.22	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	278.97	276.73	266.57	250.69	234.88	219.43	209.62	214.95	223.27	239.32	257.64	271.2	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	54.05	94.96	137.61	183.37	217.13	220.73	210.65	184.68	153.33	107.02	65.27	45.92	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	333.02	371.7	404.18	434.06	452.01	440.16	420.27	399.63	376.6	346.34	322.91	317.12	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.94	0.84	0.66	0.49	0.53	0.78	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.05	20.19	20.4	20.67	20.88	20.98	21	21	20.94	20.68	20.32	20.03	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.1	20.1	20.11	20.12	20.13	20.13	20.14	20.13	20.12	20.11	20.1	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.93	0.8	0.58	0.39	0.43	0.71	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.83	19.03	19.33	19.73	20	20.12	20.13	20.13	20.08	19.75	19.24	18.81	(90)

fLA = Living area ÷ (4) = 0.36 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.27	19.44	19.72	20.07	20.32	20.43	20.44	20.44	20.39	20.09	19.63	19.25	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.12	19.29	19.57	19.92	20.17	20.28	20.29	20.29	20.24	19.94	19.48	19.1	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.99	0.97	0.92	0.8	0.59	0.41	0.45	0.72	0.94	0.99	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	330.87	367	392.58	400.06	361.77	259.79	171.97	180.26	272.11	324.44	318.49	315.52	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	726.32	702.94	635.83	526.39	403.02	265.22	172.49	181.17	289.03	444.35	593.5	719.67	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	294.21	225.76	180.97	90.96	30.69	0	0	0	0	89.21	198.01	300.69	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1410.5 (98)

Space heating requirement in kWh/m²/year 28.45 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	294.21	225.76	180.97	90.96	30.69	0	0	0	0	89.21	198.01	300.69	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	325.46	249.73	200.19	100.62	33.95	0	0	0	0	98.69	219.03	332.62	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1560.29 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	162.29	141.77	147.5	130.82	126.66	111.56	106.88	119.14	120.46	137.17	146.42	158.48

Efficiency of water heater 80.3 (216)

(217)m=	86.53	86.22	85.57	84.16	82.09	80.3	80.3	80.3	80.3	84	85.81	86.64	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	187.55	164.43	172.38	155.45	154.3	138.92	133.1	148.37	150.01	163.3	170.63	182.92	

Total = Sum(219a)$_{1...12}$ = 1921.37 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1560.29

DER WorkSheet: New dwelling design stage

Water heating fuel used		1921.37	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	127.74		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	157.74	(231)
Electricity for lighting		242.72	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	337.02	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	415.02	(264)
Space and water heating	(261) + (262) + (263) + (264) =				752.04	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	81.87	(267)
Electricity for lighting	(232) x		0.519	=	125.97	(268)
Total CO2, kg/year		sum of (265)…(271) =			959.88	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			19.36	(273)
EI rating (section 14)					86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 79

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.98	(1a) x	2.56	(2a) =	130.51	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.98	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.51	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x	1/[1/(1.4)+ 0.04]	=	10.27			(27)
Windows Type 2			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Walls Type1	26.3	10.64	15.66	x	0.16	=	2.51			(29)
Walls Type2	25.88	2.42	23.45	x	0.16	=	3.75			(29)
Roof	50.98	0	50.98	x	0.12	=	6.12			(30)
Total area of elements, m²			103.16							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 29.87 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1123.82 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.34 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 37.21 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.21	14.03	13.85	12.93	12.75	11.83	11.83	11.65	12.2	12.75	13.11	13.48	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	51.43	51.24	51.06	50.14	49.96	49.05	49.05	48.86	49.41	49.96	50.33	50.69	

Average = Sum(39)$_{1...12}$ /12= 50.1 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.01	1.01	1	0.98	0.98	0.96	0.96	0.96	0.97	0.98	0.99	0.99

Average = Sum(40)$_{1...12}$ /12= 0.98 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.03 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.53	79.53	76.53	73.52	70.52	67.52	67.52	70.52	73.52	76.53	79.53	82.53

Total = Sum(44)$_{1...12}$ = 900.3 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.39	107.04	110.46	96.3	92.4	79.73	73.89	84.78	85.8	99.99	109.14	118.52

Total = Sum(45)$_{1...12}$ = 1180.44 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.36	16.06	16.57	14.44	13.86	11.96	11.08	12.72	12.87	15	16.37	17.78

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.06	36.6	39	36.26	35.94	33.3	34.41	35.94	36.26	39	39.22	42.06	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.44	143.64	149.45	132.56	128.34	113.03	108.29	120.72	122.06	138.98	148.36	160.58	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.44	143.64	149.45	132.56	128.34	113.03	108.29	120.72	122.06	138.98	148.36	160.58	

Output from water heater (annual)$_{1...12}$ 1630.46 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.21	44.74	46.48	41.08	39.71	34.84	33.17	37.18	37.59	43	46.1	49.92	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.4	11.9	9.68	7.33	5.48	4.62	5	6.49	8.71	11.07	12.91	13.77	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.78	151.33	147.41	139.08	128.55	118.66	112.05	110.5	114.41	122.75	133.28	143.17	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	(71)

Water heating gains (Table 5)

(72)m=	68.83	66.58	62.47	57.06	53.37	48.38	44.58	49.97	52.21	57.79	64.02	67.1	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	283.78	281.59	271.34	255.25	239.18	223.45	213.41	218.74	227.12	243.39	262	275.82	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast	0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast	0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast	0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast	0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)
Southeast	0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast	0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast	0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast	0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast	0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast	0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast	0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast	0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast	0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast	0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast	0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast	0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast	0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast	0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	104.45	177.92	243.43	301.63	337.85	335.4	323.37	296.34	263.59	196.64	125.11	89.39	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	388.23	459.51	514.78	556.87	577.03	558.85	536.78	515.08	490.71	440.03	387.1	365.21	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.88	0.75	0.55	0.4	0.43	0.67	0.91	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.11	20.29	20.53	20.78	20.94	20.99	21	21	20.97	20.78	20.4	20.07	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.08	20.08	20.08	20.1	20.1	20.12	20.12	20.12	20.11	20.1	20.09	20.09	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.85	0.69	0.48	0.32	0.35	0.59	0.88	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.9	19.17	19.51	19.86	20.04	20.11	20.11	20.12	20.09	19.86	19.33	18.86	(90)

fLA = Living area ÷ (4) = 0.31 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.27	19.51	19.82	20.14	20.32	20.38	20.39	20.39	20.36	20.14	19.66	19.23	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.12	19.36	19.67	19.99	20.17	20.23	20.24	20.24	20.21	19.99	19.51	19.08	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.94	0.85	0.7	0.49	0.33	0.36	0.6	0.88	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	383.79	447.01	482.4	473.57	401.19	273.8	178.15	187.21	294.69	385.96	377	362.07	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	761.98	741.19	672.51	556.24	422.98	276.14	178.35	187.54	302	469.15	624.4	754.45	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	281.37	197.69	141.45	59.52	16.21	0	0	0	0	61.89	178.12	291.93	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1228.19 (98)

Space heating requirement in kWh/m²/year 24.09 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	281.37	197.69	141.45	59.52	16.21	0	0	0	0	61.89	178.12	291.93	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	311.25	218.69	156.47	65.84	17.93	0	0	0	0	68.46	197.04	322.93	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1358.61 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.44	143.64	149.45	132.56	128.34	113.03	108.29	120.72	122.06	138.98	148.36	160.58

Efficiency of water heater 80.3 (216)

(217)m=	86.39	85.86	84.91	83.18	81.32	80.3	80.3	80.3	80.3	83.16	85.51	86.54	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	190.34	167.31	176.01	159.36	157.82	140.76	134.86	150.34	152	167.12	173.5	185.56	

Total = Sum(219a)$_{1...12}$ = 1954.99 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1358.61

DER WorkSheet: New dwelling design stage

Water heating fuel used		1954.99	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	131.35		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	161.35	(231)
Electricity for lighting		236.56	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	293.46	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	422.28	(264)
Space and water heating	(261) + (262) + (263) + (264) =				715.74	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	83.74	(267)
Electricity for lighting	(232) x		0.519	=	122.78	(268)
Total CO2, kg/year		sum of (265)…(271) =			922.26	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			18.09	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 80

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.54	(1a) x	2.56	(2a) =	131.94	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.54	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.94	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x	1/[1/(1.4)+ 0.04]	=	10.27			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Walls Type1	31.45	12.37	19.08	x	0.16	=	3.05			(29)
Walls Type2	32.9	2.42	30.48	x	0.16	=	4.88			(29)
Roof	51.54	0	51.54	x	0.12	=	6.18			(30)
Total area of elements, m²			115.89							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.9 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1306.3 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.83 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 40.74 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.37	14.18	14	13.07	12.89	11.96	11.96	11.78	12.33	12.89	13.26	13.63	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	55.1	54.92	54.73	53.81	53.62	52.7	52.7	52.51	53.07	53.62	53.99	54.36	

Average = Sum(39)$_{1...12}$ /12= 53.76 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.07	1.07	1.06	1.04	1.04	1.02	1.02	1.02	1.03	1.04	1.05	1.05	

Average = Sum(40)$_{1...12}$ /12= 1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	82.96	79.94	76.93	73.91	70.89	67.88	67.88	70.89	73.91	76.93	79.94	82.96	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 905.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	123.03	107.6	111.03	96.8	92.88	80.15	74.27	85.23	86.25	100.51	109.72	119.15	

Total = Sum(45)$_{1...12}$ = 1186.62 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	18.45	16.14	16.66	14.52	13.93	12.02	11.14	12.78	12.94	15.08	16.46	17.87	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.28	36.8	39.2	36.45	36.13	33.47	34.59	36.13	36.45	39.2	39.42	42.28	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	

Output from water heater (annual)$_{1...12}$ 1639.01 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.48	44.98	46.72	41.3	39.92	35.02	33.34	37.37	37.79	43.22	46.34	50.18	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.48	11.98	9.74	7.37	5.51	4.65	5.03	6.54	8.77	11.14	13	13.86	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.23	152.8	148.85	140.43	129.8	119.81	113.14	111.57	115.53	123.94	134.57	144.56	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	(71)

Water heating gains (Table 5)

(72)m=	69.19	66.93	62.79	57.36	53.65	48.64	44.82	50.23	52.48	58.09	64.36	67.45	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	285.93	283.74	273.41	257.19	240.99	225.14	215.02	220.37	228.81	245.21	263.96	277.9	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	121.43	206.85	283.02	350.67	392.78	389.94	375.94	344.53	306.45	228.61	145.45	103.92	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	407.37	490.58	556.43	607.86	633.77	615.07	590.96	564.89	535.26	473.81	409.41	381.82	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.73	0.54	0.39	0.43	0.65	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.05	20.25	20.51	20.78	20.93	20.99	21	21	20.97	20.76	20.35	20.01	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.03	20.03	20.05	20.05	20.06	20.06	20.07	20.06	20.05	20.04	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.94	0.84	0.67	0.46	0.31	0.34	0.58	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.77	19.07	19.44	19.8	19.99	20.06	20.06	20.07	20.04	19.79	19.23	18.73	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.09	19.37	19.7	20.05	20.23	20.29	20.3	20.3	20.27	20.04	19.51	19.05	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.94	19.22	19.55	19.9	20.08	20.14	20.15	20.15	20.12	19.89	19.36	18.9	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.67	0.47	0.32	0.35	0.58	0.87	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	402.01	474.98	515.95	506.32	426.65	289.5	186.75	196.53	311.73	409.93	397.3	378.07	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	806.75	786.35	714.51	591.66	449.11	292.02	186.97	196.9	319.56	497.97	662.04	799.14	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	301.13	209.24	147.73	61.45	16.71	0	0	0	0	65.5	190.61	313.28	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1305.65 (98)

Space heating requirement in kWh/m²/year 25.33 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	301.13	209.24	147.73	61.45	16.71	0	0	0	0	65.5	190.61	313.28	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	333.1	231.46	163.42	67.97	18.49	0	0	0	0	72.46	210.85	346.55	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1444.3 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42

Efficiency of water heater 80.3 (216)

(217)m=	86.54	85.98	85.01	83.23	81.34	80.3	80.3	80.3	80.3	83.27	85.67	86.69	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	191.01	167.93	176.73	160.09	158.6	141.5	135.57	151.13	152.8	167.78	174.09	186.2	

Total = Sum(219a)$_{1...12}$ = 1963.42 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1444.3

DER WorkSheet: New dwelling design stage

Water heating fuel used			1963.42	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		132.8		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		162.8	(231)
Electricity for lighting			238.1	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	311.97	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	424.1	(264)
Space and water heating	(261) + (262) + (263) + (264) =				736.07	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	84.49	(267)
Electricity for lighting	(232) x		0.519	=	123.58	(268)
Total CO2, kg/year		sum of (265)…(271) =			944.14	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			18.32	(273)
EI rating (section 14)					87	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 81

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.98	(1a) x	2.56	(2a) =	189.38	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.98	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		189.38	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	57.81	22.77	35.04	x	0.16	=	5.61			(29)
Walls Type2	35.86	2.42	33.44	x	0.16	=	5.35			(29)
Roof	73.98	0	73.98	x	0.12	=	8.88			(30)
Total area of elements, m²			167.64							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 53.41 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1829.88 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.52 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 61.93 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.62	20.36	20.09	18.76	18.5	17.17	17.17	16.91	17.7	18.5	19.03	19.56	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	82.56	82.29	82.02	80.7	80.43	79.1	79.1	78.84	79.63	80.43	80.96	81.49	

Average = Sum(39)$_{1...12}$ /12= 80.63 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.12	1.11	1.11	1.09	1.09	1.07	1.07	1.07	1.08	1.09	1.09	1.1

Average = Sum(40)$_{1...12}$ /12= 1.09 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.34 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.74 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.72	95.13	91.54	87.95	84.36	80.77	80.77	84.36	87.95	91.54	95.13	98.72

Total = Sum(44)$_{1...12}$ = 1076.93 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.4	128.04	132.13	115.19	110.53	95.38	88.38	101.42	102.63	119.6	130.56	141.78

Total = Sum(45)$_{1...12}$ = 1412.03 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.96	19.21	19.82	17.28	16.58	14.31	13.26	15.21	15.39	17.94	19.58	21.27

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.31	43.79	46.65	43.37	42.99	39.83	41.16	42.99	43.37	46.65	46.91	50.31	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	

Output from water heater (annual)$_{1...12}$ 1950.34 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.25	53.52	55.59	49.14	47.5	41.67	39.68	44.47	44.97	51.43	55.14	59.72	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.4	16.34	13.29	10.06	7.52	6.35	6.86	8.92	11.97	15.2	17.74	18.91	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	206.4	208.54	203.14	191.65	177.15	163.52	154.41	152.27	157.67	169.16	183.66	197.29	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	(71)

Water heating gains (Table 5)

(72)m=	82.33	79.64	74.72	68.26	63.84	57.88	53.33	59.77	62.45	69.13	76.58	80.27	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	368.21	365.61	352.24	331.05	309.59	288.82	275.68	282.04	293.17	314.56	339.06	357.55	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)
Southwest	0.9x	0.77	x	2.89	x	36.79		0.55	x	0.7	=	56.74	(79)
Southwest	0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	96.65	(79)
Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	132.24	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	163.85	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	183.53	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	182.2	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	175.66	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	160.98	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	143.19	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	106.82	(79)
Southwest	0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	67.96	(79)
Southwest	0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	48.56	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	223.53	380.75	520.96	645.49	723.01	717.78	692.02	634.19	564.09	420.81	267.74	191.29	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	591.74	746.36	873.2	976.55	1032.6	1006.6	967.7	916.23	857.26	735.37	606.8	548.84	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.84	0.68	0.5	0.36	0.39	0.62	0.89	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.99	20.24	20.53	20.8	20.94	20.99	21	21	20.97	20.77	20.32	19.95	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.99	19.99	19.99	20.01	20.01	20.03	20.03	20.03	20.02	20.01	20.01	20	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.92	0.8	0.62	0.42	0.28	0.31	0.54	0.85	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.66	19.02	19.42	19.8	19.96	20.02	20.03	20.03	20	19.77	19.15	18.61	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.99	19.32	19.7	20.04	20.2	20.26	20.27	20.27	20.24	20.01	19.44	18.94	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.84	19.17	19.55	19.89	20.05	20.11	20.12	20.12	20.09	19.86	19.29	18.79	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.91	0.8	0.63	0.43	0.29	0.32	0.55	0.85	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	583.77	718.44	794.75	778.23	645.65	432.97	277.79	292.57	467.44	621.83	587.51	543.5	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1200.18	1174.32	1070.02	887.04	671.95	435.84	278.05	293.02	477.16	744.95	986.99	1188.68	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	458.61	306.36	204.81	78.34	19.56	0	0	0	0	91.6	287.63	480.01	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1926.92 (98)

Space heating requirement in kWh/m²/year 26.05 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	458.61	306.36	204.81	78.34	19.56	0	0	0	0	91.6	287.63	480.01	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	507.31	338.89	226.56	86.66	21.64	0	0	0	0	101.33	318.17	530.99	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2131.55 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08

Efficiency of water heater: 80.3 (216)

(217)m=	87.11	86.49	85.39	83.38	81.33	80.3	80.3	80.3	80.3	83.62	86.26	87.26

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	225.81	198.66	209.35	190.17	188.76	168.38	161.32	179.83	181.82	198.82	205.74	220.12

Total = Sum(219a)$_{1...12}$ = 2328.79 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2131.55	
Water heating fuel used		2328.79	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	190.61		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		220.61	(231)
Electricity for lighting		324.96	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	460.42	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	503.02	(264)
Space and water heating	(261) + (262) + (263) + (264) =			963.43	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	114.5	(267)
Electricity for lighting	(232) x	0.519	=	168.65	(268)
Total CO2, kg/year	sum of (265)…(271) =			1246.59	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			16.85	(273)
EI rating (section 14)				86	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 82

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.98	(1a) x	2.56	(2a) =	189.38	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.98	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		189.38	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	57.81	22.77	35.04	x	0.16	=	5.61			(29)
Walls Type2	35.86	2.42	33.44	x	0.16	=	5.35			(29)
Roof	73.3	0	73.3	x	0.12	=	8.8			(30)
Total area of elements, m²			166.97							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 53.33 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1823.78 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.43 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 62.75 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.62	20.36	20.09	18.76	18.5	17.17	17.17	16.91	17.7	18.5	19.03	19.56	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	83.38	83.11	82.85	81.52	81.25	79.92	79.92	79.66	80.46	81.25	81.78	82.31	

Average = Sum(39)$_{1...12}$ /12= 81.45 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.13	1.12	1.12	1.1	1.1	1.08	1.08	1.08	1.09	1.1	1.11	1.11

Average = Sum(40)$_{1...12}$ /12= 1.1 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.34 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.74 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.72	95.13	91.54	87.95	84.36	80.77	80.77	84.36	87.95	91.54	95.13	98.72

Total = Sum(44)$_{1...12}$ = 1076.93 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.4	128.04	132.13	115.19	110.53	95.38	88.38	101.42	102.63	119.6	130.56	141.78

Total = Sum(45)$_{1...12}$ = 1412.03 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.96	19.21	19.82	17.28	16.58	14.31	13.26	15.21	15.39	17.94	19.58	21.27

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.31	43.79	46.65	43.37	42.99	39.83	41.16	42.99	43.37	46.65	46.91	50.31	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	

Output from water heater (annual)$_{1...12}$ 1950.34 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.25	53.52	55.59	49.14	47.5	41.67	39.68	44.47	44.97	51.43	55.14	59.72	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.4	16.34	13.29	10.06	7.52	6.35	6.86	8.92	11.97	15.2	17.74	18.91	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	206.4	208.54	203.14	191.65	177.15	163.52	154.41	152.27	157.67	169.16	183.66	197.29	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	(71)

Water heating gains (Table 5)

(72)m=	82.33	79.64	74.72	68.26	63.84	57.88	53.33	59.77	62.45	69.13	76.58	80.27	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	368.21	365.61	352.24	331.05	309.59	288.82	275.68	282.04	293.17	314.56	339.06	357.55	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	56.74	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	96.65	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	132.24	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	163.85	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	183.53	(79)

DER WorkSheet: New dwelling design stage

Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	182.2		(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	175.66		(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	160.98		(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	143.19		(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	106.82		(79)
Southwest	0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	67.96		(79)
Southwest	0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	48.56		(79)
Northwest	0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33		(81)
Northwest	0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82		(81)
Northwest	0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49		(81)
Northwest	0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62		(81)
Northwest	0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56		(81)
Northwest	0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01		(81)
Northwest	0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51		(81)
Northwest	0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53		(81)
Northwest	0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88		(81)
Northwest	0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19		(81)
Northwest	0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37		(81)
Northwest	0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08		(81)
Northwest	0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37		(81)
Northwest	0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59		(81)
Northwest	0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17		(81)
Northwest	0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05		(81)
Northwest	0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26		(81)
Northwest	0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3		(81)
Northwest	0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04		(81)
Northwest	0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19		(81)
Northwest	0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36		(81)
Northwest	0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35		(81)
Northwest	0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05		(81)
Northwest	0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72		(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	107.89	200.76	319.81	471.9	597.6	623.65	588.63	490.2	371.75	234.05	132.32	90.33	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	476.1	566.37	672.05	802.95	907.19	912.47	864.31	772.24	664.92	548.61	471.38	447.88	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.91	0.75	0.55	0.4	0.47	0.76	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.83	20.01	20.3	20.67	20.91	20.99	21	21	20.93	20.59	20.14	19.8	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.98	19.98	19.98	20	20	20.02	20.02	20.02	20.01	20	20	19.99	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.88	0.7	0.47	0.32	0.37	0.68	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.42	18.69	19.11	19.63	19.92	20.01	20.02	20.02	19.96	19.54	18.9	18.39	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.77	19.01	19.41	19.89	20.16	20.25	20.26	20.26	20.2	19.8	19.2	18.74	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.62	18.86	19.26	19.74	20.01	20.1	20.11	20.11	20.05	19.65	19.05	18.59	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.99	0.96	0.88	0.7	0.48	0.32	0.38	0.68	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	473.47	558.91	646.52	703.45	631.35	434.66	279.85	294.28	451.39	512.51	465.77	446.03	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1193.93	1160.51	1056.85	883.65	675.45	439.5	280.34	295.41	478.72	735.17	977.53	1184.53	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	536.02	404.27	305.29	129.74	32.81	0	0	0	0	165.66	368.47	549.45	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2491.71 (98)

Space heating requirement in kWh/m²/year 33.68 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	536.02	404.27	305.29	129.74	32.81	0	0	0	0	165.66	368.47	549.45	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	592.94	447.2	337.71	143.52	36.3	0	0	0	0	183.25	407.6	607.79	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2756.32 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08

Efficiency of water heater: 80.3 (216)

(217)m= 87.45 | 87.13 | 86.39 | 84.55 | 81.91 | 80.3 | 80.3 | 80.3 | 80.3 | 85.04 | 86.85 | 87.55 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 224.94 | 197.2 | 206.94 | 187.53 | 187.42 | 168.38 | 161.32 | 179.83 | 181.82 | 195.49 | 204.34 | 219.4

Total = Sum(219a)$_{1...12}$ = 2314.63 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2756.32	
Water heating fuel used		2314.63	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	190.61		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		220.61	(231)
Electricity for lighting		324.96	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	595.36	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	499.96	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1095.33	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	114.5	(267)
Electricity for lighting	(232) x	0.519	=	168.65	(268)
Total CO2, kg/year	sum of (265)…(271) =			1378.48	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			18.63	(273)
EI rating (section 14)				84	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 83

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.47	(1a) x	2.56	(2a) =	180.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.47	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x	1/[1/(1.4)+ 0.04]	=	10.27			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Walls Type1	31.35	16.99	14.36	x	0.16	=	2.3			(29)
Walls Type2	17.17	2.42	14.75	x	0.16	=	2.36			(29)
Roof	70.47	0	70.47	x	0.12	=	8.46			(30)
Total area of elements, m²			119							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.03 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1129.26 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.88 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 47.9 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.65	19.39	19.14	17.88	17.62	16.36	16.36	16.1	16.86	17.62	18.13	18.64	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	67.55	67.3	67.05	65.78	65.53	64.26	64.26	64.01	64.77	65.53	66.03	66.54	

Average = Sum(39)$_{1...12}$ /12= 65.72 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.95	0.95	0.93	0.93	0.91	0.91	0.91	0.92	0.93	0.94	0.94

Average = Sum(40)$_{1...12}$ /12= 0.93 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.82 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.6	93.09	89.57	86.06	82.55	79.04	79.04	82.55	86.06	89.57	93.09	96.6

Total = Sum(44)$_{1...12}$ = 1053.82 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.25	125.29	129.29	112.72	108.16	93.33	86.48	99.24	100.43	117.04	127.76	138.73

Total = Sum(45)$_{1...12}$ = 1381.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.49	18.79	19.39	16.91	16.22	14	12.97	14.89	15.06	17.56	19.16	20.81

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.23	42.85	45.65	42.44	42.07	38.98	40.28	42.07	42.44	45.65	45.91	49.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	

Output from water heater (annual)$_{1...12}$ 1908.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	59.94	52.37	54.4	48.09	46.48	40.78	38.82	43.51	44	50.33	53.96	58.44	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.69	15.71	12.78	9.67	7.23	6.1	6.6	8.57	11.51	14.61	17.05	18.18	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.4	200.46	195.27	184.23	170.29	157.18	148.43	146.37	151.56	162.6	176.55	189.65	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	(71)

Water heating gains (Table 5)

(72)m=	80.56	77.93	73.12	66.79	62.47	56.63	52.18	58.49	61.11	67.64	74.94	78.54	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	356.52	353.97	341.03	320.56	299.85	279.79	267.07	273.29	284.04	304.72	328.4	346.24	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	407.66	458.08	528.6	628.6	713.92	721.23	680.04	602.51	512.6	431.95	392.76	388	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.78	0.56	0.41	0.49	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20	20.13	20.38	20.71	20.93	20.99	21	21	20.94	20.64	20.27	19.99	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.12	20.12	20.14	20.14	20.16	20.16	20.16	20.15	20.14	20.14	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.73	0.49	0.34	0.4	0.72	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.78	18.97	19.33	19.81	20.08	20.15	20.16	20.16	20.11	19.72	19.18	18.77	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.11	19.28	19.61	20.05	20.31	20.38	20.38	20.39	20.33	19.97	19.47	19.1	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.96	19.13	19.46	19.9	20.16	20.23	20.23	20.24	20.18	19.82	19.32	18.95	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.73	0.5	0.34	0.41	0.73	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	406.3	454.86	517	571.49	521.21	358.95	233.28	244.87	371.9	413.59	389.94	387.02	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	990.28	957.91	868.86	723.63	554.07	361.69	233.51	245.48	393.97	603.85	807.24	981.16	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	434.48	338.05	261.78	109.54	24.44	0	0	0	0	141.55	300.46	442.04	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2052.33 (98)

Space heating requirement in kWh/m²/year 29.12 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	434.48	338.05	261.78	109.54	24.44	0	0	0	0	141.55	300.46	442.04	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	480.62	373.95	289.58	121.17	27.04	0	0	0	0	156.59	332.36	488.98	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2270.28 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96

Efficiency of water heater 80.3 (216)

(217)m=	87.04	86.77	86.06	84.19	81.58	80.3	80.3	80.3	80.3	84.7	86.42	87.13	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	221.14	193.76	203.26	184.29	184.15	164.77	157.86	175.97	177.92	192.06	200.95	215.72	

Total = Sum(219a)$_{1...12}$ = 2271.87 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2270.28

DER WorkSheet: New dwelling design stage

Water heating fuel used			2271.87	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		181.59		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		211.59	(231)
Electricity for lighting			312.37	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	490.38	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	490.72	(264)
Space and water heating	(261) + (262) + (263) + (264) =				981.1	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	109.81	(267)
Electricity for lighting	(232) x		0.519	=	162.12	(268)
Total CO2, kg/year		sum of (265)…(271) =			1253.04	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			17.78	(273)
EI rating (section 14)					85	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 84

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	74.52	(1a) x	2.56	(2a) =	190.77	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	74.52	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		190.77	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			24.906	x	0.12	=	2.98872			(28)
Walls Type1	44.28	19.88	24.4	x	0.16	=	3.9			(29)
Walls Type2	57.23	2.42	54.81	x	0.16	=	8.77			(29)
Roof	74.52	0	74.52	x	0.12	=	8.94			(30)
Total area of elements, m²			200.93							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 54.35 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 3885.11 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 11.62 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 65.97 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.77	20.51	20.24	18.9	18.63	17.3	17.3	17.03	17.83	18.63	19.17	19.7	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	86.75	86.48	86.21	84.87	84.61	83.27	83.27	83	83.8	84.61	85.14	85.68	

Average = Sum(39)$_{1...12}$ /12= 84.84 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.16	1.16	1.16	1.14	1.14	1.12	1.12	1.11	1.12	1.14	1.14	1.15	
											Average = Sum(40)$_{1...12}$ /12=	1.14	(40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.35 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 90.03 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	99.03	95.43	91.83	88.23	84.63	81.02	81.02	84.63	88.23	91.83	95.43	99.03	
											Total = Sum(44)$_{1...12}$ =	1080.33	(44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.86	128.44	132.54	115.55	110.88	95.68	88.66	101.74	102.95	119.98	130.97	142.23	
											Total = Sum(45)$_{1...12}$ =	1416.49	(45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	22.03	19.27	19.88	17.33	16.63	14.35	13.3	15.26	15.44	18	19.65	21.33	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.46	43.92	46.79	43.51	43.12	39.96	41.29	43.12	43.51	46.79	47.06	50.46	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	197.32	172.37	179.34	159.06	154	135.64	129.95	144.86	146.46	166.78	178.03	192.69	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	197.32	172.37	179.34	159.06	154	135.64	129.95	144.86	146.46	166.78	178.03	192.69	

Output from water heater (annual)$_{1...12}$ 1956.5 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.45	53.69	55.77	49.3	47.65	41.8	39.8	44.61	45.11	51.59	55.31	59.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.51	16.44	13.37	10.12	7.57	6.39	6.9	8.97	12.04	15.29	17.84	19.02	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	207.6	209.76	204.33	192.77	178.18	164.47	155.31	153.16	158.59	170.14	184.73	198.44	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	(71)

Water heating gains (Table 5)

(72)m=	82.59	79.89	74.96	68.47	64.04	58.06	53.5	59.96	62.65	69.35	76.82	80.52	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	369.96	367.35	353.92	332.62	311.05	290.18	276.97	283.35	294.54	316.04	340.66	359.25	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)
Northwest 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	59.85	121.82	219.48	360.44	484.51	516.54	483.21	385.22	267.44	148.87	75.3	48.87	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	429.81	489.17	573.39	693.07	795.56	806.71	760.18	668.57	561.97	464.91	415.96	408.12	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.83	0.63	0.48	0.56	0.85	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.72	19.86	20.14	20.54	20.84	20.97	20.99	20.99	20.87	20.46	20.03	19.7	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.95	19.95	19.95	19.97	19.97	19.99	19.99	19.99	19.98	19.97	19.97	19.96	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.93	0.78	0.54	0.37	0.44	0.78	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.24	18.45	18.86	19.43	19.82	19.97	19.98	19.98	19.88	19.34	18.71	18.22	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.61	18.8	19.18	19.7	20.08	20.22	20.24	20.24	20.13	19.62	19.04	18.59	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.46	18.65	19.03	19.55	19.93	20.07	20.09	20.09	19.98	19.47	18.89	18.44	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.78	0.55	0.38	0.45	0.78	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	428.3	485.73	561.8	640.52	616.59	444.57	289.08	302.94	436.47	448.47	413.1	407.01	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1228.22	1189.37	1080.05	904.3	696.02	455.36	290.36	305.91	492.38	750.57	1003.59	1220.01	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	595.14	472.84	385.58	189.92	59.09	0	0	0	0	224.76	425.15	604.87	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2957.35 (98)

Space heating requirement in kWh/m²/year 39.69 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	595.14	472.84	385.58	189.92	59.09	0	0	0	0	224.76	425.15	604.87	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	658.34	523.06	426.52	210.09	65.37	0	0	0	0	248.63	470.3	669.1	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3271.4 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	197.32	172.37	179.34	159.06	154	135.64	129.95	144.86	146.46	166.78	178.03	192.69

Efficiency of water heater 80.3 (216)

(217)m= 87.65 | 87.46 | 86.93 | 85.5 | 82.87 | 80.3 | 80.3 | 80.3 | 80.3 | 85.8 | 87.16 | 87.73 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 225.12 | 197.08 | 206.3 | 186.04 | 185.84 | 168.91 | 161.83 | 180.4 | 182.39 | 194.37 | 204.25 | 219.63

Total = Sum(219a)$_{1...12}$ = 2312.17 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		3271.4	
Water heating fuel used		2312.17	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	192.01		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		222.01	(231)
Electricity for lighting		326.86	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	706.62	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	499.43	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1206.05	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	115.22	(267)
Electricity for lighting	(232) x	0.519	=	169.64	(268)
Total CO2, kg/year	sum of (265)…(271) =			1490.91	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			20.01	(273)
EI rating (section 14)				83	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 85

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	72.83	(1a) x	2.56	(2a) =	186.43	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	72.83	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.43	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x	1/[1/(1.4)+ 0.04]	=	10.27			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Floor			16.55	x	0.12	=	1.986			(28)
Walls Type1	31.76	16.99	14.77	x	0.16	=	2.36			(29)
Walls Type2	34.04	2.42	31.62	x	0.16	=	5.06			(29)
Roof	72.83	0	72.83	x	0.12	=	8.74			(30)
Total area of elements, m²			155.17							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 44.06 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 2685.21 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.29 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 52.35 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.3	20.04	19.78	18.47	18.21	16.9	16.9	16.64	17.43	18.21	18.73	19.26	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	72.65	72.39	72.13	70.82	70.56	69.25	69.25	68.99	69.78	70.56	71.08	71.61	

Average = Sum(39)$_{1...12}$ /12= 70.76 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1	0.99	0.99	0.97	0.97	0.95	0.95	0.95	0.96	0.97	0.98	0.98

Average = Sum(40)$_{1...12}$ /12= 0.97 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.31 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.13 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.04	94.48	90.91	87.34	83.78	80.21	80.21	83.78	87.34	90.91	94.48	98.04

Total = Sum(44)$_{1...12}$ = 1069.53 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.39	127.16	131.22	114.4	109.77	94.72	87.77	100.72	101.92	118.78	129.66	140.8

Total = Sum(45)$_{1...12}$ = 1402.32 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.81	19.07	19.68	17.16	16.47	14.21	13.17	15.11	15.29	17.82	19.45	21.12

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.96	43.48	46.33	43.07	42.69	39.56	40.88	42.69	43.07	46.33	46.59	49.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.35	170.64	177.54	157.47	152.46	134.28	128.65	143.41	145	165.11	176.25	190.76	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.35	170.64	177.54	157.47	152.46	134.28	128.65	143.41	145	165.11	176.25	190.76	

Output from water heater (annual)$_{1...12}$ 1936.94 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.83	53.15	55.21	48.81	47.17	41.38	39.4	44.16	44.66	51.08	54.76	59.31	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.17	16.14	13.12	9.94	7.43	6.27	6.78	8.81	11.82	15.01	17.52	18.67	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	203.8	205.92	200.59	189.24	174.92	161.46	152.47	150.35	155.68	167.03	181.35	194.81	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	(71)

Water heating gains (Table 5)

(72)m=	81.76	79.09	74.21	67.79	63.4	57.48	52.96	59.36	62.03	68.65	76.06	79.71	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	364.42	361.84	348.61	327.65	306.44	285.9	272.9	279.21	290.22	311.38	335.61	353.89	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	415.57	465.95	536.18	635.7	720.51	727.34	685.86	608.43	518.78	438.61	399.97	395.66	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.81	0.6	0.44	0.52	0.82	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.94	20.07	20.32	20.66	20.9	20.99	21	21	20.93	20.59	20.22	19.93	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.09	20.09	20.11	20.11	20.12	20.12	20.13	20.12	20.11	20.1	20.1	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.93	0.76	0.52	0.36	0.42	0.75	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.66	18.85	19.21	19.71	20.02	20.12	20.12	20.13	20.06	19.63	19.08	18.65	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.99	19.16	19.49	19.95	20.24	20.34	20.35	20.35	20.28	19.88	19.37	18.98	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.84	19.01	19.34	19.8	20.09	20.19	20.2	20.2	20.13	19.73	19.22	18.83	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.76	0.53	0.36	0.43	0.75	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	414.26	462.95	525.77	585.6	546.11	382.52	248.71	260.99	389.96	422.18	397.34	394.7	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1056.37	1021.72	926.43	772.15	592.33	387.05	249.13	262.04	420.77	643.9	861.4	1047.31	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	477.73	375.5	298.09	134.32	34.39	0	0	0	0	164.96	334.12	485.54	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2304.65 (98)

Space heating requirement in kWh/m²/year 31.65 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	477.73	375.5	298.09	134.32	34.39	0	0	0	0	164.96	334.12	485.54	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	528.46	415.37	329.75	148.59	38.05	0	0	0	0	182.48	369.61	537.1	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2549.39 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	195.35	170.64	177.54	157.47	152.46	134.28	128.65	143.41	145	165.11	176.25	190.76

Efficiency of water heater 80.3 (216)

(217)m=	87.22	86.98	86.35	84.65	81.99	80.3	80.3	80.3	80.3	85.05	86.64	87.3	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	223.98	196.18	205.62	186.02	185.96	167.22	160.21	178.6	180.57	194.13	203.44	218.51	

Total = Sum(219a)$_{1...12}$ = 2300.45 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2549.39

DER WorkSheet: New dwelling design stage

Water heating fuel used		2300.45	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	187.65		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	217.65	(231)
Electricity for lighting		320.87	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	550.67	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	496.9	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1047.57	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	112.96	(267)
Electricity for lighting	(232) x		0.519	=	166.53	(268)
Total CO2, kg/year		sum of (265)…(271) =			1327.06	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			18.22	(273)
EI rating (section 14)					85	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 86

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	66.43	(1a) x	2.56	(2a) =	170.06	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	66.43	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		170.06	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	37.25	16.99	20.26	x	0.16	=	3.24			(29)
Walls Type2	32.9	2.42	30.48	x	0.16	=	4.88			(29)
Roof	66.43	0	66.43	x	0.12	=	7.97			(30)
Total area of elements, m²			136.57							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 42 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1460.32 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.37 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 50.37 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	18.52	18.28	18.04	16.85	16.61	15.42	15.42	15.18	15.9	16.61	17.09	17.57	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	68.89	68.65	68.42	67.22	66.99	65.79	65.79	65.55	66.27	66.99	67.46	67.94	

Average = Sum(39)$_{1...12}$ /12= 67.16 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.04	1.03	1.03	1.01	1.01	0.99	0.99	0.99	1	1.01	1.02	1.02

Average = Sum(40)$_{1...12}$ /12= 1.01 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.16 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 85.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	93.96	90.54	87.12	83.71	80.29	76.87	76.87	80.29	83.71	87.12	90.54	93.96

Total = Sum(44)$_{1...12}$ = 1024.98 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	139.34	121.86	125.75	109.63	105.2	90.78	84.12	96.53	97.68	113.84	124.26	134.94

Total = Sum(45)$_{1...12}$ = 1343.92 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	20.9	18.28	18.86	16.45	15.78	13.62	12.62	14.48	14.65	17.08	18.64	20.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.88	41.67	44.4	41.28	40.92	37.91	39.17	40.92	41.28	44.4	44.65	47.88	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82	

Output from water heater (annual)$_{1...12}$ 1856.27 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	58.3	50.94	52.91	46.77	45.21	39.66	37.76	42.32	42.8	48.95	52.48	56.84	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.83	14.95	12.16	9.21	6.88	5.81	6.28	8.16	10.95	13.91	16.23	17.3	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	188.83	190.79	185.85	175.34	162.07	149.6	141.26	139.3	144.24	154.75	168.02	180.49	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	(71)

Water heating gains (Table 5)

(72)m=	78.36	75.8	71.12	64.96	60.76	55.08	50.76	56.89	59.44	65.79	72.89	76.39	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	342.37	339.88	327.47	307.85	288.06	268.84	256.64	262.7	272.98	292.8	315.49	332.54	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	393.51	443.99	515.04	615.9	702.13	710.28	669.61	591.92	501.54	420.03	379.84	374.3	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.79	0.58	0.43	0.5	0.81	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.91	20.04	20.3	20.66	20.9	20.99	21	21	20.92	20.58	20.19	19.89	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.05	20.06	20.06	20.07	20.08	20.09	20.09	20.09	20.09	20.08	20.07	20.06	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.74	0.5	0.34	0.41	0.74	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.59	18.79	19.17	19.68	19.99	20.08	20.09	20.09	20.03	19.59	19.01	18.57	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.91	19.1	19.45	19.92	20.21	20.31	20.31	20.32	20.25	19.83	19.31	18.9	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.76	18.95	19.3	19.77	20.06	20.16	20.16	20.17	20.1	19.68	19.16	18.75	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.74	0.51	0.35	0.42	0.74	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	392.02	440.56	503.17	560.64	518.88	361.42	234.14	245.85	369.23	402.09	376.88	373.22	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	996.45	964.48	875.45	730.81	560.28	365.56	234.53	246.84	397.46	608.48	813.26	988.32	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	449.7	352.07	276.97	122.52	30.8	0	0	0	0	153.55	314.19	457.64	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2157.45 (98)

Space heating requirement in kWh/m²/year 32.48 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	449.7	352.07	276.97	122.52	30.8	0	0	0	0	153.55	314.19	457.64	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	497.45	389.46	306.39	135.53	34.07	0	0	0	0	169.86	347.56	506.23	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2386.56 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82

Efficiency of water heater 80.3 (216)

(217)m=	87.18	86.93	86.27	84.53	81.89	80.3	80.3	80.3	80.3	84.98	86.59	87.27	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	214.75	188.12	197.23	178.53	178.42	160.26	153.54	171.16	173.05	186.21	195.06	209.49	

Total = Sum(219a)$_{1...12}$ = 2205.82 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2386.56

DER WorkSheet: New dwelling design stage

Water heating fuel used		2205.82	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	171.17		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	201.17	(231)
Electricity for lighting		297.29	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	515.5	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	476.46	(264)
Space and water heating	(261) + (262) + (263) + (264) =				991.95	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	104.41	(267)
Electricity for lighting	(232) x		0.519	=	154.3	(268)
Total CO2, kg/year		sum of (265)…(271) =			1250.65	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			18.83	(273)
EI rating (section 14)					85	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 87

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	77.53	(1a) x	2.56	(2a) =	198.47	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	77.53	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		198.47	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	54.38	19.88	34.5	x	0.16	=	5.52			(29)
Walls Type2	14.93	2.42	12.51	x	0.16	=	2			(29)
Roof	77.64	0	77.64	x	0.12	=	9.32			(30)
Total area of elements, m²			146.95							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 46.58 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1497.98 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.42 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 56.01 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	21.61	21.34	21.06	19.67	19.39	17.99	17.99	17.72	18.55	19.39	19.94	20.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	77.62	77.34	77.06	75.67	75.39	74	74	73.72	74.56	75.39	75.95	76.51	

Average = Sum(39)$_{1...12}$ /12= 75.6 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1	1	0.99	0.98	0.97	0.95	0.95	0.95	0.96	0.97	0.98	0.99

Average = Sum(40)$_{1...12}$ /12= 0.98 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.41 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 91.54 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	100.69	97.03	93.37	89.71	86.05	82.39	82.39	86.05	89.71	93.37	97.03	100.69	

Total = Sum(44)$_{1...12}$ = 1098.47 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	149.33	130.6	134.77	117.49	112.74	97.28	90.15	103.45	104.68	122	133.17	144.61	

Total = Sum(45)$_{1...12}$ = 1440.27 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	22.4	19.59	20.22	17.62	16.91	14.59	13.52	15.52	15.7	18.3	19.98	21.69	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	44.66	47.58	44.24	43.85	40.63	41.98	43.85	44.24	47.58	47.85	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	

Output from water heater (annual)$_{1...12}$ 1988.65 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	62.39	54.59	56.71	50.13	48.45	42.5	40.47	45.36	45.87	52.46	56.24	60.82	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	19.1	16.96	13.79	10.44	7.81	6.59	7.12	9.26	12.42	15.77	18.41	19.63	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	214.2	216.42	210.82	198.89	183.84	169.7	160.24	158.02	163.62	175.55	190.6	204.75	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	(71)

Water heating gains (Table 5)

(72)m=	83.86	81.24	76.22	69.62	65.12	59.03	54.4	60.97	63.7	70.51	78.11	81.75	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	379.36	376.83	363.04	341.17	318.98	297.53	283.97	290.46	301.96	324.04	349.34	368.34	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	59.85	121.82	219.48	360.44	484.51	516.54	483.21	385.22	267.44	148.87	75.3	48.87	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	439.21	498.65	582.52	701.61	803.49	814.07	767.18	675.68	569.4	472.92	424.64	417.21	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.79	0.57	0.42	0.5	0.81	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.93	20.07	20.32	20.68	20.92	20.99	21	21	20.93	20.6	20.21	19.92	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.08	20.09	20.09	20.1	20.11	20.12	20.12	20.12	20.12	20.11	20.1	20.09	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.92	0.74	0.5	0.34	0.41	0.74	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.65	18.85	19.22	19.73	20.03	20.11	20.12	20.12	20.06	19.63	19.07	18.63	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.93	19.11	19.46	19.94	20.22	20.31	20.31	20.31	20.25	19.84	19.32	18.91	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.78	18.96	19.31	19.79	20.07	20.16	20.16	20.16	20.1	19.69	19.17	18.76	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.73	0.5	0.34	0.41	0.73	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	437.85	495.31	570.08	639.06	589.27	407.33	263.27	276.56	418.15	454.1	421.84	416.24	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1123.76	1087.72	987.38	823.94	631.15	411.11	263.6	277.44	447.4	685.43	916.38	1114.11	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	510.32	398.1	310.47	133.11	31.16	0	0	0	0	172.11	356.07	519.22	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2430.55 (98)

Space heating requirement in kWh/m²/year 31.35 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	510.32	398.1	310.47	133.11	31.16	0	0	0	0	172.11	356.07	519.22	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	564.51	440.37	343.44	147.24	34.47	0	0	0	0	190.39	393.88	574.35	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2688.66 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57

Efficiency of water heater 80.3 (216)

(217)m=	87.3	87.05	86.38	84.57	81.82	80.3	80.3	80.3	80.3	85.09	86.72	87.39

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	229.41	201.33	211.1	191.25	191.39	171.75	164.55	183.43	185.46	199.3	208.73	223.79

Total = Sum(219a)$_{1...12}$ = 2361.47 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2688.66	
Water heating fuel used		2361.47	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	199.76		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		229.76	(231)
Electricity for lighting		337.24	(232)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	580.75	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	510.08	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1090.83	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	119.25	(267)
Electricity for lighting	(232) x	0.519	=	175.03	(268)
Total CO2, kg/year	sum of (265)…(271) =			1385.1	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			17.87	(273)
EI rating (section 14)				85	(274)

eight associates

Appendix
Energy Assessment
Bourne Court

GREEN Scenario

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 1

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	93.3	(1a) x	2.56	(2a) =	238.85	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	93.3	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		238.85	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 3			7.75	x	1/[1/(1.4)+ 0.04]	=	10.27			(27)
Windows Type 4			4.31	x	1/[1/(1.4)+ 0.04]	=	5.71			(27)
Floor			93.3	x	0.12	=	11.196			(28)
Walls Type1	66.49	30.78	35.71	x	0.16	=	5.71			(29)
Walls Type2	20.61	2.42	18.19	x	0.14	=	2.57			(29)
Total area of elements, m²			180.4							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 63.68 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11179.22 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.42 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 72.09 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	26.01	25.68	25.34	23.67	23.33	21.66	21.66	21.32	22.33	23.33	24	24.67	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	98.1	97.77	97.43	95.76	95.42	93.75	93.75	93.41	94.42	95.42	96.09	96.76	

Average = Sum(39)$_{1...12}$ /12= 95.68 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.05	1.05	1.04	1.03	1.02	1	1	1	1.01	1.02	1.03	1.04

Average = Sum(40)$_{1...12}$ /12= 1.03 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.67 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 97.57 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	107.33	103.43	99.52	95.62	91.72	87.81	87.81	91.72	95.62	99.52	103.43	107.33	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1170.85 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	159.16	139.21	143.65	125.24	120.17	103.69	96.09	110.26	111.58	130.04	141.94	154.14

Total = Sum(45)$_{1...12}$ = 1535.17 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.87	20.88	21.55	18.79	18.03	15.55	14.41	16.54	16.74	19.51	21.29	23.12

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.72	47.15	46.74	43.31	44.75	46.74	47.15	50.72	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	210.12	185.23	194.36	172.39	166.9	147	140.84	157	158.73	180.75	191.26	205.1	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	210.12	185.23	194.36	172.39	166.9	147	140.84	157	158.73	180.75	191.26	205.1	

Output from water heater (annual)$_{1...12}$ 2109.7 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	65.66	57.79	60.44	53.43	51.64	45.3	43.14	48.35	48.89	55.92	59.53	63.99	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	133.41	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.84	19.4	15.78	11.95	8.93	7.54	8.15	10.59	14.21	18.04	21.06	22.45	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	245.02	247.56	241.16	227.52	210.3	194.11	183.3	180.76	187.17	200.81	218.03	234.21	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	36.34	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	-106.73	(71)

Water heating gains (Table 5)

(72)m=	88.26	86	81.24	74.21	69.41	62.92	57.98	64.98	67.9	75.16	82.67	86.01	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	421.14	418.99	404.2	379.69	354.66	330.6	315.45	322.36	335.3	360.03	387.78	408.69	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.31	x	11.28	x	0.55	x	0.7	=	12.97	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.31	x	22.97	x	0.55	x	0.7	=	26.41	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.31	x	41.38	x	0.55	x	0.7	=	47.58	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.31	x	67.96	x	0.55	x	0.7	=	78.14	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.31	x	91.35	x	0.55	x	0.7	=	105.04	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.31	x	97.38	x	0.55	x	0.7	=	111.99	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.31	x	91.1	x	0.55	x	0.7	=	104.76	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.31	x	72.63	x	0.55	x	0.7	=	83.52	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.31	x	50.42	x	0.55	x	0.7	=	57.98	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.31	x	28.07	x	0.55	x	0.7	=	32.28	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.31	x	14.2	x	0.55	x	0.7	=	16.33	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.31	x	9.21	x	0.55	x	0.7	=	10.6	(75)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	28.54	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	58.09	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	104.66	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	171.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	231.04	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	246.32	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	230.42	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	183.7	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	127.53	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	70.99	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	35.91	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	23.31	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	92.66	188.61	339.81	558.07	750.16	799.75	748.15	596.43	414.07	230.49	116.59	75.67	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	513.8	607.6	744.01	937.76	1104.82	1130.35	1063.6	918.79	749.37	590.53	504.37	484.36	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.92	0.74	0.52	0.39	0.46	0.78	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.85	20.01	20.3	20.7	20.93	20.99	21	21	20.93	20.57	20.14	19.83	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.04	20.04	20.05	20.06	20.06	20.08	20.08	20.08	20.07	20.06	20.06	20.05	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.9	0.68	0.45	0.31	0.37	0.71	0.96	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.49	18.73	19.16	19.72	20	20.07	20.08	20.08	20.02	19.56	18.94	18.47	(90)

fLA = Living area ÷ (4) = 0.19 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.75	18.97	19.37	19.9	20.17	20.25	20.25	20.25	20.19	19.75	19.16	18.72	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.6	18.82	19.22	19.75	20.02	20.1	20.1	20.1	20.04	19.6	19.01	18.57	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	1	0.99	0.97	0.89	0.68	0.45	0.31	0.38	0.7	0.96	0.99	1	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	512.36	603.31	724.71	831.09	753.58	511.75	327.86	344.92	528.04	565.03	501.24	483.37	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	1402.4	1360.59	1239.56	1038.92	794.37	515.19	328.17	345.81	561.05	858.78	1144.8	1390.93	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	662.19	508.9	383.05	149.64	30.35	0	0	0	0	218.55	463.37	675.23	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 3091.26 (98)

Space heating requirement in kWh/m²/year 33.13 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

DER WorkSheet: New dwelling design stage

Fraction of space heat from main system(s)	(202) = 1 – (201) =	1 (202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1 (204)
Efficiency of main space heating system 1		90.4 (206)
Efficiency of secondary/supplementary heating system, %		0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	662.19	508.9	383.05	149.64	30.35	0	0	0	0	218.55	463.37	675.23	
(211)m = {[(98)m x (204)] } x 100 ÷ (206) (211)	732.51	562.94	423.72	165.53	33.57	0	0	0	0	241.76	512.57	746.93	

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 3419.54 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

Output from water heater (calculated above)	210.12	185.23	194.36	172.39	166.9	147	140.84	157	158.73	180.75	191.26	205.1	

Efficiency of water heater 80.3 (216)

(217)m=	87.74	87.46	86.73	84.7	81.7	80.3	80.3	80.3	80.3	85.53	87.2	87.83	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	239.48	211.78	224.11	203.54	204.28	183.06	175.39	195.52	197.68	211.33	219.34	233.53	

Total = Sum(219a)$_{1...12}$ = 2499.04 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		3419.54
Water heating fuel used		2499.04
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	218.55	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		248.55 (231)
Electricity for lighting		385.77 (232)
Electricity generated by PVs		-888.26 (233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216 =	738.62 (261)
Space heating (secondary)	(215) x	0.519 =	0 (263)
Water heating	(219) x	0.216 =	539.79 (264)
Space and water heating	(261) + (262) + (263) + (264) =		1278.41 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519 =	129 (267)

DER WorkSheet: New dwelling design stage

Electricity for lighting	(232) x	0.519	=	200.21	(268)
Energy saving/generation technologies Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			1146.62	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			12.29	(273)
EI rating (section 14)				89	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 2

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	84.24	(1a) x	2.56	(2a) =	215.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	84.24	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		215.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			84.24	x	0.12	=	10.1088			(28)
Walls Type1	35.77	16.99	18.78	x	0.16	=	3			(29)
Walls Type2	37.54	2.42	35.12	x	0.14	=	4.97			(29)
Total area of elements, m²			157.54							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.99 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 10182.6 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.42 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 52.41 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	23.48	23.18	22.88	21.37	21.07	19.55	19.55	19.25	20.16	21.07	21.67	22.27	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	75.89	75.59	75.29	73.78	73.47	71.96	71.96	71.66	72.57	73.47	74.08	74.68	

Average = Sum(39)$_{1...12}$ /12= 73.7 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.9	0.9	0.89	0.88	0.87	0.85	0.85	0.85	0.86	0.87	0.88	0.89

Average = Sum(40)$_{1...12}$ /12= 0.87 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.54 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 94.49 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	103.94	100.16	96.38	92.6	88.82	85.04	85.04	88.82	92.6	96.38	100.16	103.94	

Total = Sum(44)$_{1...12}$ = 1133.85 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	154.13	134.81	139.11	121.28	116.37	100.42	93.05	106.78	108.05	125.93	137.46	149.27	

Total = Sum(45)$_{1...12}$ = 1486.65 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.12	20.22	20.87	18.19	17.46	15.06	13.96	16.02	16.21	18.89	20.62	22.39	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.11	45.66	45.26	41.94	43.33	45.26	45.66	49.11	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	

Output from water heater (annual)$_{1...12}$ 2049.26 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	63.99	56.33	58.53	51.74	50.01	43.87	41.77	46.82	47.34	54.15	58.03	62.37	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	20.46	18.17	14.78	11.19	8.36	7.06	7.63	9.92	13.31	16.9	19.72	21.03	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	228.07	230.44	224.48	211.78	195.75	180.69	170.63	168.26	174.22	186.92	202.95	218.01	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	(71)

Water heating gains (Table 5)

(72)m=	86.01	83.82	78.67	71.86	67.21	60.93	56.15	62.93	65.76	72.78	80.6	83.83	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	398.62	396.51	382	358.91	335.41	312.76	298.48	305.18	317.36	340.68	367.35	386.95	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	449.76	500.62	569.57	666.95	749.48	754.21	711.44	634.4	545.92	467.91	431.7	428.72	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.82	0.6	0.44	0.52	0.82	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.04	20.16	20.38	20.7	20.92	20.99	21	21	20.94	20.64	20.3	20.03	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.17	20.17	20.17	20.19	20.19	20.21	20.21	20.21	20.2	20.19	20.19	20.18	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.94	0.77	0.53	0.36	0.43	0.76	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.88	19.05	19.37	19.83	20.11	20.2	20.21	20.21	20.15	19.76	19.26	18.87	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.13	19.29	19.59	20.02	20.29	20.37	20.38	20.38	20.32	19.95	19.48	19.12	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.98	19.14	19.44	19.87	20.14	20.22	20.23	20.23	20.17	19.8	19.33	18.97	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	1	0.98	0.93	0.77	0.53	0.37	0.43	0.76	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	448.74	498.21	560.82	620.96	576.86	401.09	260.81	273.71	413.37	452.75	429.52	427.98	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1114.02	1076.38	974.45	809.37	620.06	404.57	261.08	274.42	440.7	676.2	906.3	1103.04	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	494.97	388.53	307.74	135.65	32.14	0	0	0	0	166.24	343.28	502.24	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2370.8 (98)

Space heating requirement in kWh/m²/year 28.14 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	494.97	388.53	307.74	135.65	32.14	0	0	0	0	166.24	343.28	502.24	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	547.54	429.79	340.42	150.06	35.55	0	0	0	0	183.9	379.73	555.58	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2622.56 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23

Efficiency of water heater 80.3 (216)

(217)m=	87.19	86.93	86.28	84.53	81.82	80.3	80.3	80.3	80.3	84.92	86.56	87.27	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	235.23	208.03	218.15	197.49	197.55	177.28	169.85	189.34	191.43	206.12	215.76	229.43	

Total = Sum(219a)$_{1...12}$ = 2435.65 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2622.56

DER WorkSheet: New dwelling design stage

Water heating fuel used		2435.65	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	197.32		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	227.32	(231)
Electricity for lighting		361.31	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	566.47	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	526.1	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1092.57	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	117.98	(267)
Electricity for lighting	(232) x		0.519	=	187.52	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			937.07	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.12	(273)
EI rating (section 14)					90	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 3

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.63	(1a) x	2.56	(2a) =	183.37	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.37	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			71.63	x	0.12	=	8.595599			(28)
Walls Type1	31.08	16.99	14.09	x	0.16	=	2.25			(29)
Walls Type2	25.62	2.42	23.2	x	0.14	=	3.28			(29)
Total area of elements, m²			128.32							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 40.04 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8513.14 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 47.85 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.97	19.71	19.45	18.17	17.91	16.63	16.63	16.37	17.14	17.91	18.43	18.94	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	67.82	67.56	67.3	66.01	65.76	64.47	64.47	64.21	64.99	65.76	66.27	66.79	

Average = Sum(39)$_{1...12}$ /12= 65.95 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.95	0.94	0.94	0.92	0.92	0.9	0.9	0.9	0.91	0.92	0.93	0.93

Average = Sum(40)$_{1...12}$ /12= 0.92 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.47 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	97.32	93.78	90.24	86.7	83.16	79.62	79.62	83.16	86.7	90.24	93.78	97.32

Total = Sum(44)$_{1...12}$ = 1061.64 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	144.32	126.22	130.25	113.55	108.96	94.02	87.13	99.98	101.17	117.91	128.7	139.76

Total = Sum(45)$_{1...12}$ = 1391.97 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.65	18.93	19.54	17.03	16.34	14.1	13.07	15	15.18	17.69	19.31	20.96

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.59	43.16	45.98	42.76	42.38	39.27	40.57	42.38	42.76	45.98	46.25	49.59	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	

Output from water heater (annual)$_{1...12}$ 1922.64 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.38	52.76	54.8	48.45	46.82	41.08	39.11	43.84	44.33	50.7	54.36	58.87	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.93	15.92	12.95	9.8	7.33	6.19	6.68	8.69	11.66	14.81	17.28	18.42	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.07	203.16	197.9	186.71	172.58	159.3	150.42	148.34	153.6	164.79	178.92	192.2	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	(71)

Water heating gains (Table 5)

(72)m=	81.16	78.51	73.66	67.29	62.93	57.05	52.57	58.92	61.57	68.15	75.49	79.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.43	357.87	344.78	324.07	303.11	282.81	269.96	276.22	287.1	308.02	331.97	350.02	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	411.58	461.97	532.36	632.12	717.19	724.26	682.92	605.44	515.66	435.25	396.33	391.79	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.78	0.56	0.41	0.48	0.79	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.02	20.15	20.39	20.72	20.93	20.99	21	21	20.95	20.64	20.28	20	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.13	20.13	20.13	20.15	20.15	20.17	20.17	20.17	20.16	20.15	20.15	20.14	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.92	0.73	0.49	0.34	0.4	0.72	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.81	19	19.35	19.82	20.09	20.16	20.17	20.17	20.12	19.73	19.2	18.79	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.13	19.3	19.62	20.06	20.31	20.38	20.39	20.39	20.34	19.97	19.49	19.11	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.98	19.15	19.47	19.91	20.16	20.23	20.24	20.24	20.19	19.82	19.34	18.96	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.73	0.5	0.34	0.41	0.73	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	410.25	458.82	520.91	575.24	524.04	360.45	234.25	245.88	374.04	416.94	393.56	390.83	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	995.26	962.61	872.96	726.73	556.32	363.08	234.46	246.46	395.58	606.57	811.07	985.94	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	435.25	338.55	261.93	109.07	24.02	0	0	0	0	141.09	300.61	442.76	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2053.29 (98)

Space heating requirement in kWh/m²/year 28.67 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	435.25	338.55	261.93	109.07	24.02	0	0	0	0	141.09	300.61	442.76	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	481.48	374.5	289.74	120.66	26.57	0	0	0	0	156.07	332.54	489.78	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2271.34 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36

Efficiency of water heater 80.3 (216)

(217)m=	87.03	86.76	86.05	84.16	81.55	80.3	80.3	80.3	80.3	84.68	86.4	87.12	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	222.82	195.23	204.81	185.72	185.58	165.99	159.03	177.28	179.24	193.55	202.48	217.36	

Total = Sum(219a)$_{1...12}$ = 2289.08 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2271.34

DER WorkSheet: New dwelling design stage

Water heating fuel used		2289.08	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	167.79		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	197.79	(231)
Electricity for lighting		316.57	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	490.61	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	494.44	(264)
Space and water heating	(261) + (262) + (263) + (264) =				985.05	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	102.65	(267)
Electricity for lighting	(232) x		0.519	=	164.3	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			791	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.04	(273)
EI rating (section 14)					91	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 4

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.54	(1a) x	2.56	(2a) =	131.94	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.54	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.94	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			51.54	x	0.12	=	6.1848			(28)
Walls Type1	24.61	12.37	12.24	x	0.16	=	1.96			(29)
Walls Type2	39.63	2.42	37.21	x	0.14	=	5.26			(29)
Total area of elements, m²			115.78							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.19 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6510.05 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 41 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.37	14.18	14	13.07	12.89	11.96	11.96	11.78	12.33	12.89	13.26	13.63	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	55.36	55.18	54.99	54.07	53.88	52.96	52.96	52.77	53.33	53.88	54.25	54.62	

Average = Sum(39)$_{1...12}$ /12= 54.02 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.07	1.07	1.07	1.05	1.05	1.03	1.03	1.02	1.03	1.05	1.05	1.06

Average = Sum(40)$_{1...12}$ /12= 1.05 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.96	79.94	76.93	73.91	70.89	67.88	67.88	70.89	73.91	76.93	79.94	82.96

Total = Sum(44)$_{1...12}$ = 905.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	123.03	107.6	111.03	96.8	92.88	80.15	74.27	85.23	86.25	100.51	109.72	119.15

Total = Sum(45)$_{1...12}$ = 1186.62 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.45	16.14	16.66	14.52	13.93	12.02	11.14	12.78	12.94	15.08	16.46	17.87

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.28	36.8	39.2	36.45	36.13	33.47	34.59	36.13	36.45	39.2	39.42	42.28	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	

Output from water heater (annual)$_{1...12}$ 1639.01 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.48	44.98	46.72	41.3	39.92	35.02	33.34	37.37	37.79	43.22	46.34	50.18	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.48	11.98	9.74	7.37	5.51	4.65	5.03	6.54	8.77	11.14	13	13.86	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.23	152.8	148.85	140.43	129.8	119.81	113.14	111.57	115.53	123.94	134.57	144.56	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	(71)

Water heating gains (Table 5)

(72)m=	69.19	66.93	62.79	57.36	53.65	48.64	44.82	50.23	52.48	58.09	64.36	67.45	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	285.93	283.74	273.41	257.19	240.99	225.14	215.02	220.37	228.81	245.21	263.96	277.9	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	13.91	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	28.31	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	51.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	83.77	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	112.6	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	120.04	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	112.29	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	89.52	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	62.15	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	34.6	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	17.5	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	11.36	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	37.24	75.8	136.57	224.28	301.48	321.41	300.67	239.7	166.41	92.63	46.85	30.41	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	323.17	359.54	409.98	481.47	542.47	546.54	515.68	460.06	395.22	337.84	310.81	308.31	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.81	0.6	0.45	0.52	0.81	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.89	20.02	20.27	20.63	20.88	20.98	21	20.99	20.91	20.57	20.17	19.87	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.02	20.02	20.03	20.04	20.05	20.06	20.06	20.06	20.05	20.05	20.04	20.03	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.76	0.52	0.35	0.42	0.74	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.54	18.73	19.1	19.61	19.94	20.05	20.06	20.06	19.99	19.54	18.97	18.52	(90)

fLA = Living area ÷ (4) = 0.3 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.94	19.12	19.45	19.92	20.22	20.33	20.34	20.34	20.27	19.85	19.33	18.93	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.79	18.97	19.3	19.77	20.07	20.18	20.19	20.19	20.12	19.7	19.18	18.78	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.76	0.53	0.37	0.43	0.75	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	321.63	356.31	400.12	440.45	410.94	290.83	189.72	198.96	294.79	322.55	307.88	307.15	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	802.48	776.36	704.16	587.58	451.16	295.51	190.21	200.11	320.82	490.51	655.58	796.29	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	357.75	282.27	226.21	105.93	29.93	0	0	0	0	124.96	250.34	363.92	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1741.31 (98)

Space heating requirement in kWh/m²/year 33.79 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	357.75	282.27	226.21	105.93	29.93	0	0	0	0	124.96	250.34	363.92	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	395.75	312.25	250.23	117.18	33.11	0	0	0	0	138.23	276.93	402.56	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1926.23 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42

Efficiency of water heater 80.3 (216)

(217)m=	86.94	86.71	86.08	84.48	82.03	80.3	80.3	80.3	80.3	84.77	86.35	87.04	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	190.13	166.53	174.53	157.73	157.28	141.5	135.57	151.13	152.8	164.81	172.73	185.46	

Total = Sum(219a)$_{1...12}$ = 1950.19 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1926.23

DER WorkSheet: New dwelling design stage

Water heating fuel used		1950.19	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	120.73		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	150.73	(231)
Electricity for lighting		238.1	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	416.07	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	421.24	(264)
Space and water heating	(261) + (262) + (263) + (264) =				837.31	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	78.23	(267)
Electricity for lighting	(232) x		0.519	=	123.58	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			578.11	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.22	(273)
EI rating (section 14)					92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 5

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	87.91	(1a) x	2.56	(2a) =	225.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	87.91	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		225.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			87.91	x	0.12	=	10.5492			(28)
Walls Type1	24.61	19.88	4.73	x	0.16	=	0.76			(29)
Walls Type2	39.63	2.42	37.21	x	0.14	=	5.26			(29)
Roof	10.54	0	10.54	x	0.12	=	1.26			(30)
Total area of elements, m²			162.69							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 47.58 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 10477.94 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.14 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 56.72 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	24.51	24.19	23.88	22.3	21.98	20.4	20.4	20.09	21.04	21.98	22.61	23.25	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	81.23	80.91	80.59	79.02	78.7	77.12	77.12	76.81	77.75	78.7	79.33	79.96	

Average = Sum(39)$_{1...12}$ /12= 78.94 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.92	0.92	0.92	0.9	0.9	0.88	0.88	0.87	0.88	0.9	0.9	0.91

Average = Sum(40)$_{1...12}$ /12= 0.9 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.6 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 95.86 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	105.44	101.61	97.77	93.94	90.1	86.27	86.27	90.1	93.94	97.77	101.61	105.44

Total = Sum(44)$_{1...12}$ = 1150.27 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	156.37	136.76	141.12	123.03	118.05	101.87	94.4	108.32	109.62	127.75	139.45	151.43

Total = Sum(45)$_{1...12}$ = 1508.18 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.45	20.51	21.17	18.46	17.71	15.28	14.16	16.25	16.44	19.16	20.92	22.71

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.82	46.33	45.92	42.54	43.96	45.92	46.33	49.82	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39	

Output from water heater (annual)$_{1...12}$ 2076.08 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	64.73	56.98	59.38	52.49	50.73	44.51	42.38	47.5	48.03	54.93	58.7	63.09	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	20.96	18.62	15.14	11.46	8.57	7.23	7.82	10.16	13.64	17.32	20.21	21.55	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	235.18	237.62	231.47	218.38	201.85	186.32	175.94	173.5	179.65	192.74	209.27	224.8	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	(71)

Water heating gains (Table 5)

(72)m=	87	84.79	79.81	72.9	68.19	61.82	56.96	63.84	66.71	73.83	81.52	84.8	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	408.09	405.97	391.36	367.68	343.55	320.31	305.66	312.44	324.94	348.83	375.94	396.09	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast	0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast	0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast	0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast	0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast	0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast	0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast	0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast	0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast	0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast	0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast	0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast	0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast	0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast	0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast	0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast	0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast	0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast	0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)
Southeast	0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast	0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast	0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast	0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast	0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)
Southeast	0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast	0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast	0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast	0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast	0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast	0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast	0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	79.52	152.43	253.69	389.97	505.84	532.55	500.79	409.71	300.15	180.64	98.34	66.05	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	487.6	558.4	645.05	757.66	849.39	852.86	806.45	722.15	625.09	529.47	474.28	462.14	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.79	0.57	0.42	0.49	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.03	20.17	20.41	20.73	20.93	20.99	21	21	20.95	20.66	20.3	20.01	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.15	20.15	20.15	20.17	20.17	20.19	20.19	20.19	20.18	20.17	20.17	20.16	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.92	0.74	0.5	0.34	0.4	0.72	0.96	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.84	19.04	19.39	19.85	20.11	20.18	20.19	20.19	20.14	19.77	19.24	18.83	(90)

fLA = Living area ÷ (4) = 0.23 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.12	19.3	19.63	20.05	20.3	20.37	20.37	20.38	20.33	19.98	19.48	19.1	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.97	19.15	19.48	19.9	20.15	20.22	20.22	20.23	20.18	19.83	19.33	18.95	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.74	0.5	0.35	0.41	0.72	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	486.26	554.75	631.31	690.91	626.31	430.26	279.23	293.2	449.38	506.7	471.25	461.2	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1191.17	1153.13	1045.74	869.35	664.79	433.32	279.46	293.81	472.63	726.18	970.51	1179.46	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	524.46	402.11	308.34	128.48	28.63	0	0	0	0	163.3	359.46	534.38	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2449.16 (98)

Space heating requirement in kWh/m²/year 27.86 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	524.46	402.11	308.34	128.48	28.63	0	0	0	0	163.3	359.46	534.38	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	580.15	444.82	341.08	142.12	31.67	0	0	0	0	180.64	397.64	591.13	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2709.25 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39

Efficiency of water heater: 80.3 (216)

(217)m= 87.29 | 86.98 | 86.25 | 84.37 | 81.66 | 80.3 | 80.3 | 80.3 | 80.3 | 84.84 | 86.65 | 87.38 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 237.51 | 210.14 | 221.38 | 200.74 | 200.81 | 179.85 | 172.31 | 192.08 | 194.2 | 209.3 | 217.85 | 231.62

Total = Sum(219a)$_{1...12}$ = 2467.8 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2709.25	
Water heating fuel used		2467.8	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	226.51		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		256.51	(231)
Electricity for lighting		370.21	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	585.2	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	533.04	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1118.24	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	133.13	(267)
Electricity for lighting	(232)	x	0.519	=	192.14	(268)
Energy saving/generation technologies						
Item 1			0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =				982.5	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =				11.18	(273)
EI rating (section 14)					90	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 6

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.7	(1a) x	2.56	(2a) =	180.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.7	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			70.697	x	0.12	=	8.48364			(28)
Walls Type1	51.4	20.19	31.21	x	0.16	=	4.99			(29)
Walls Type2	16.74	2.42	14.32	x	0.14	=	2.03			(29)
Total area of elements, m²			138.83							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 45.66 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8550.61 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 11.36 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 57.01 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.71	19.46	19.2	17.93	17.68	16.41	16.41	16.16	16.92	17.68	18.19	18.69	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	76.72	76.47	76.21	74.95	74.69	73.42	73.42	73.17	73.93	74.69	75.2	75.71	

Average = Sum(39)$_{1...12}$ /12= 74.88 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.09	1.08	1.08	1.06	1.06	1.04	1.04	1.03	1.05	1.06	1.06	1.07

Average = Sum(40)$_{1...12}$ /12= 1.06 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.94 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.74	93.22	89.7	86.19	82.67	79.15	79.15	82.67	86.19	89.7	93.22	96.74

Total = Sum(44)$_{1...12}$ = 1055.33 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.46	125.47	129.48	112.88	108.31	93.46	86.61	99.38	100.57	117.21	127.94	138.93

Total = Sum(45)$_{1...12}$ = 1383.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.52	18.82	19.42	16.93	16.25	14.02	12.99	14.91	15.09	17.58	19.19	20.84

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.3	42.91	45.71	42.5	42.13	39.03	40.33	42.13	42.5	45.71	45.97	49.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	

Output from water heater (annual)$_{1...12}$ 1911.23 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.03	52.45	54.48	48.16	46.55	40.84	38.88	43.58	44.07	50.4	54.03	58.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.73	15.75	12.81	9.7	7.25	6.12	6.61	8.6	11.54	14.65	17.1	18.23	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.92	200.98	195.78	184.71	170.73	157.59	148.81	146.75	151.95	163.03	177	190.14	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	(71)

Water heating gains (Table 5)

(72)m=	80.68	78.05	73.22	66.89	62.56	56.72	52.26	58.57	61.2	67.74	75.05	78.66	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	357.27	354.72	341.76	321.24	300.48	280.37	267.63	273.86	284.64	305.36	329.09	346.97	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast 0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast 0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast 0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast 0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast 0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast 0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast 0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast 0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast 0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)
Southwest 0.9x	0.77	x	8.06	x	36.79		0.55	x	0.7	=	79.12	(79)
Southwest 0.9x	0.77	x	4.62	x	36.79		0.55	x	0.7	=	90.71	(79)
Southwest 0.9x	0.77	x	8.06	x	62.67		0.55	x	0.7	=	134.78	(79)
Southwest 0.9x	0.77	x	4.62	x	62.67		0.55	x	0.7	=	154.51	(79)
Southwest 0.9x	0.77	x	8.06	x	85.75		0.55	x	0.7	=	184.41	(79)
Southwest 0.9x	0.77	x	4.62	x	85.75		0.55	x	0.7	=	211.4	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	4.62	x	106.25		0.55	x	0.7	=	261.94	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	4.62	x	119.01		0.55	x	0.7	=	293.39	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	4.62	x	118.15		0.55	x	0.7	=	291.27	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	4.62	x	113.91		0.55	x	0.7	=	280.82	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	4.62	x	104.39		0.55	x	0.7	=	257.35	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	4.62	x	92.85		0.55	x	0.7	=	228.91	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	4.62	x	69.27		0.55	x	0.7	=	170.76	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	4.62	x	44.07		0.55	x	0.7	=	108.65	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	4.62	x	31.49		0.55	x	0.7	=	77.63	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	198.2	337.61	461.93	572.36	641.09	636.45	613.61	562.33	500.17	373.13	237.4	169.62	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	555.48	692.33	803.69	893.59	941.57	916.82	881.24	836.19	784.81	678.49	566.49	516.59	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.85	0.69	0.51	0.37	0.4	0.63	0.89	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.02	20.26	20.53	20.8	20.94	20.99	21	21	20.98	20.77	20.34	19.98	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.01	20.02	20.02	20.03	20.04	20.05	20.05	20.05	20.05	20.04	20.03	20.02	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.81	0.64	0.43	0.29	0.32	0.55	0.86	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.72	19.06	19.45	19.82	19.99	20.05	20.05	20.05	20.03	19.79	19.2	18.67	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.07	19.39	19.74	20.08	20.25	20.3	20.31	20.31	20.28	20.06	19.51	19.03	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.92	19.24	19.59	19.93	20.1	20.15	20.16	20.16	20.13	19.91	19.36	18.88	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.92	0.81	0.64	0.44	0.3	0.33	0.56	0.85	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	548.47	668.47	736.87	722.51	601.73	404.91	260.93	274.61	436.89	579.04	549.61	511.86	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1121.92	1096.27	998.01	826.98	627.13	407.63	261.17	275.03	446.11	695.26	921.88	1111.05	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	426.65	287.48	194.29	75.22	18.9	0	0	0	0	86.47	268.04	445.79	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1802.84 (98)

Space heating requirement in kWh/m²/year 25.5 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	426.65	287.48	194.29	75.22	18.9	0	0	0	0	86.47	268.04	445.79	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	471.96	318.01	214.92	83.2	20.91	0	0	0	0	95.65	296.5	493.13	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1994.29 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23

Efficiency of water heater 80.3 (216)

(217)m=	86.99	86.39	85.31	83.34	81.31	80.3	80.3	80.3	80.3	83.54	86.14	87.15

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	221.57	194.91	205.35	186.45	185.01	165	158.09	176.23	178.17	195.03	201.9	216

Total = Sum(219a)$_{1...12}$ = 2283.71 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1994.29	
Water heating fuel used		2283.71	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	165.6		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	195.6	(231)
Electricity for lighting		313.18	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	430.77	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	493.28	(264)
Space and water heating	(261) + (262) + (263) + (264) =			924.05	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	101.52	(267)
Electricity for lighting	(232) x	0.519	=	162.54	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			727.1	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			10.28	(273)
EI rating (section 14)				92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 7

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.46	(1a) x	2.56	(2a) =	129.18	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.46	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.18	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			50.46	x	0.12	=	6.0552			(28)
Walls Type1	24.7	13.84	10.86	x	0.16	=	1.74			(29)
Walls Type2	19.12	2.42	16.7	x	0.14	=	2.36			(29)
Total area of elements, m²			94.28							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.89 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6019.12 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 39.69 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.07	13.89	13.71	12.8	12.62	11.71	11.71	11.53	12.07	12.62	12.98	13.34	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	53.76	53.58	53.4	52.49	52.31	51.41	51.41	51.22	51.77	52.31	52.67	53.04	

Average = Sum(39)$_{1...12}$ /12= 52.45 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.07	1.06	1.06	1.04	1.04	1.02	1.02	1.02	1.03	1.04	1.04	1.05

Average = Sum(40)$_{1...12}$ /12= 1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.66 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.13	79.14	76.15	73.17	70.18	67.2	67.2	70.18	73.17	76.15	79.14	82.13

Total = Sum(44)$_{1...12}$ = 895.94 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.79	106.52	109.92	95.83	91.95	79.35	73.53	84.37	85.38	99.5	108.62	117.95

Total = Sum(45)$_{1...12}$ = 1174.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.37	13.79	11.9	11.03	12.66	12.81	14.93	16.29	17.69

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.85	36.43	38.81	36.08	35.76	33.14	34.24	35.76	36.08	38.81	39.03	41.85	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	

Output from water heater (annual)$_{1...12}$ 1622.57 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.96	44.52	46.25	40.88	39.52	34.67	33.01	37	37.41	42.79	45.87	49.68	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.23	11.75	9.56	7.24	5.41	4.57	4.93	6.41	8.61	10.93	12.76	13.6	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.43	149.97	146.09	137.82	127.39	117.59	111.04	109.5	113.38	121.65	132.08	141.88	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	(71)

Water heating gains (Table 5)

(72)m=	68.49	66.26	62.16	56.78	53.11	48.15	44.37	49.72	51.96	57.51	63.71	66.78	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.71	279.53	269.37	253.4	237.47	221.86	211.9	217.2	225.51	241.64	260.1	273.81	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast 0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast 0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast 0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast 0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast 0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast 0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast 0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast 0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast 0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)
Southwest 0.9x	0.77	x	8.06	x	36.79		0.55	x	0.7	=	79.12	(79)
Southwest 0.9x	0.77	x	2.89	x	36.79		0.55	x	0.7	=	28.37	(79)
Southwest 0.9x	0.77	x	8.06	x	62.67		0.55	x	0.7	=	134.78	(79)
Southwest 0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	48.33	(79)
Southwest 0.9x	0.77	x	8.06	x	85.75		0.55	x	0.7	=	184.41	(79)
Southwest 0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	66.12	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	81.93	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	91.77	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	135.86	231.43	316.65	392.34	439.46	436.28	420.62	385.47	342.86	255.78	162.73	116.27	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	417.57	510.96	586.01	645.74	676.93	658.14	632.52	602.67	568.37	497.42	422.83	390.08	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.93	0.84	0.68	0.49	0.36	0.39	0.61	0.88	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.09	20.31	20.57	20.82	20.95	20.99	21	21	20.98	20.8	20.4	20.05	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.03	20.04	20.05	20.05	20.07	20.07	20.07	20.06	20.05	20.05	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.92	0.8	0.62	0.42	0.28	0.31	0.53	0.84	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.83	19.15	19.52	19.86	20.01	20.06	20.07	20.07	20.05	19.84	19.29	18.78	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.24	19.53	19.86	20.17	20.32	20.37	20.37	20.37	20.35	20.16	19.65	19.2	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.09	19.38	19.71	20.02	20.17	20.22	20.22	20.22	20.2	20.01	19.5	19.05	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.98	0.96	0.91	0.8	0.63	0.44	0.29	0.32	0.55	0.84	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	411.13	490.98	533.27	516.3	426.9	287.11	186.07	195.63	310.3	418.19	407.91	385.61	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	795.19	776.01	705.65	583.97	443.02	288.8	186.21	195.89	315.94	492.05	653.32	787.38	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	285.75	191.54	128.25	48.72	12	0	0	0	0	54.95	176.7	298.91	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1196.82 (98)

Space heating requirement in kWh/m²/year 23.72 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	285.75	191.54	128.25	48.72	12	0	0	0	0	54.95	176.7	298.91	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	316.09	211.88	141.87	53.9	13.27	0	0	0	0	60.79	195.46	330.66	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1323.92 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8

Efficiency of water heater 80.3 (216)

(217)m= 86.44 | 85.79 | 84.68 | 82.8 | 81.08 | 80.3 | 80.3 | 80.3 | 80.3 | 82.93 | 85.5 | 86.61 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 189.31 | 166.63 | 175.63 | 159.33 | 157.52 | 140.08 | 134.21 | 149.61 | 151.26 | 166.77 | 172.68 | 184.52

Total = Sum(219a)$_{1...12}$ = 1947.55 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1323.92	
Water heating fuel used		1947.55	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.2		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		148.2	(231)
Electricity for lighting		233.69	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	285.97	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	420.67	(264)
Space and water heating	(261) + (262) + (263) + (264) =			706.64	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	76.91	(267)
Electricity for lighting	(232) x	0.519	=	121.29	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			443.83	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			8.8	(273)
EI rating (section 14)				94	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 8

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.46	(1a) x	2.56	(2a) =	129.18	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.46	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.18	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			50.46	x	0.12	=	6.0552			(28)
Walls Type1	24.7	13.84	10.86	x	0.16	=	1.74			(29)
Walls Type2	33.62	2.42	31.2	x	0.14	=	4.41			(29)
Total area of elements, m²			108.78							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.94 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6265.57 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 41.74 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.07	13.89	13.71	12.8	12.62	11.71	11.71	11.53	12.07	12.62	12.98	13.34	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	55.81	55.63	55.45	54.54	54.36	53.46	53.46	53.28	53.82	54.36	54.72	55.09	

Average = Sum(39)$_{1...12}$ /12= 54.5 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.11	1.1	1.1	1.08	1.08	1.06	1.06	1.06	1.07	1.08	1.08	1.09

Average = Sum(40)$_{1...12}$ /12= 1.08 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.66 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.13	79.14	76.15	73.17	70.18	67.2	67.2	70.18	73.17	76.15	79.14	82.13

Total = Sum(44)$_{1...12}$ = 895.94 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.79	106.52	109.92	95.83	91.95	79.35	73.53	84.37	85.38	99.5	108.62	117.95

Total = Sum(45)$_{1...12}$ = 1174.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.37	13.79	11.9	11.03	12.66	12.81	14.93	16.29	17.69

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.85	36.43	38.81	36.08	35.76	33.14	34.24	35.76	36.08	38.81	39.03	41.85	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	

Output from water heater (annual)$_{1...12}$ 1622.57 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.96	44.52	46.25	40.88	39.52	34.67	33.01	37	37.41	42.79	45.87	49.68	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.23	11.75	9.56	7.24	5.41	4.57	4.93	6.41	8.61	10.93	12.76	13.6	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.43	149.97	146.09	137.82	127.39	117.59	111.04	109.5	113.38	121.65	132.08	141.88	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	(71)

Water heating gains (Table 5)

(72)m=	68.49	66.26	62.16	56.78	53.11	48.15	44.37	49.72	51.96	57.51	63.71	66.78	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.71	279.53	269.37	253.4	237.47	221.86	211.9	217.2	225.51	241.64	260.1	273.81	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(79)

DER WorkSheet: New dwelling design stage

Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	66.12	(79)
Southwest	0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	81.93	(79)
Southwest	0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	91.77	(79)
Southwest	0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest	0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest	0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest	0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest	0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest	0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest	0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest	0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)
Southwest	0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)
Northwest	0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(81)
Northwest	0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(81)
Northwest	0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(81)
Northwest	0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(81)
Northwest	0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(81)
Northwest	0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(81)
Northwest	0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(81)
Northwest	0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(81)
Northwest	0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(81)
Northwest	0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(81)
Northwest	0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(81)
Northwest	0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(83)m=	116.19	200.81	282.43	362.81	418.13	420.27	403.03	360.98	310.15	224.01	139.7	99.1	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(84)m=	397.9	480.34	551.8	616.21	655.6	642.13	614.93	578.17	535.65	465.65	399.8	372.91	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.72	0.52	0.38	0.42	0.66	0.91	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(87)m=	19.99	20.2	20.48	20.76	20.93	20.99	21	21	20.97	20.73	20.31	19.96	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20	20	20	20.02	20.02	20.03	20.03	20.04	20.03	20.02	20.01	20.01	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.83	0.66	0.45	0.3	0.33	0.58	0.88	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.67	18.98	19.36	19.76	19.96	20.03	20.03	20.04	20	19.73	19.14	18.63	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.1	19.38	19.73	20.09	20.28	20.34	20.35	20.35	20.32	20.06	19.52	19.06	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.95	19.23	19.58	19.94	20.13	20.19	20.2	20.2	20.17	19.91	19.37	18.91	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.66	0.46	0.31	0.35	0.59	0.87	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	392.97	466.01	512.93	512.06	435.06	296.31	192.16	202.03	317.17	407.04	388.86	369.44	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	817.88	797.14	725.17	602.14	458.15	298.97	192.42	202.49	326.66	506.2	671.69	810.53	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	316.13	222.52	157.91	64.86	17.18	0	0	0	0	73.78	203.64	328.17	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1384.19 (98)

Space heating requirement in kWh/m²/year 27.43 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	316.13	222.52	157.91	64.86	17.18	0	0	0	0	73.78	203.64	328.17	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	349.7	246.15	174.68	71.75	19	0	0	0	0	81.61	225.26	363.03	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1531.18 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8

Efficiency of water heater 80.3 (216)

(217)m= 86.68 | 86.16 | 85.2 | 83.37 | 81.38 | 80.3 | 80.3 | 80.3 | 80.3 | 83.55 | 85.86 | 86.82 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 188.79 | 165.91 | 174.56 | 158.23 | 156.94 | 140.08 | 134.21 | 149.61 | 151.26 | 165.55 | 171.96 | 184.05

Total = Sum(219a)$_{1...12}$ = 1941.15 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1531.18	
Water heating fuel used		1941.15	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.2		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		148.2	(231)
Electricity for lighting		233.69	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	330.74	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	419.29	(264)
Space and water heating	(261) + (262) + (263) + (264) =				750.02	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	76.91	(267)
Electricity for lighting	(232)	x	0.519	=	121.29	(268)
Energy saving/generation technologies						
Item 1			0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =				487.22	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =				9.66	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 9

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.04	(1a) x	2.56	(2a) =	186.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.04	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			73.04	x	0.12	=	8.7648			(28)
Walls Type1	36.47	17.3	19.17	x	0.16	=	3.07			(29)
Walls Type2	41.48	2.42	39.06	x	0.14	=	5.52			(29)
Total area of elements, m²			150.99							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.68 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 9024.31 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.11 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 51.79 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.36	20.1	19.84	18.53	18.26	16.95	16.95	16.69	17.48	18.26	18.79	19.31	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	72.15	71.89	71.63	70.32	70.05	68.74	68.74	68.48	69.27	70.05	70.58	71.1	

Average = Sum(39)$_{1...12}$ /12= 70.25 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.99	0.98	0.98	0.96	0.96	0.94	0.94	0.94	0.95	0.96	0.97	0.97	

Average = Sum(40)$_{1...12}$ /12= 0.96 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.24 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	98.17	94.6	91.03	87.46	83.89	80.32	80.32	83.89	87.46	91.03	94.6	98.17	

Total = Sum(44)$_{1...12}$ = 1070.92 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	145.58	127.32	131.39	114.55	109.91	94.84	87.89	100.85	102.06	118.94	129.83	140.99	

Total = Sum(45)$_{1...12}$ = 1404.14 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.84	19.1	19.71	17.18	16.49	14.23	13.18	15.13	15.31	17.84	19.47	21.15	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.03	43.54	46.39	43.13	42.75	39.61	40.93	42.75	43.13	46.39	46.65	50.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	

Output from water heater (annual)$_{1...12}$ 1939.46 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.91	53.22	55.28	48.87	47.23	41.44	39.45	44.22	44.72	51.14	54.83	59.38	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.21	16.18	13.16	9.96	7.44	6.29	6.79	8.83	11.85	15.04	17.56	18.72	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.29	206.41	201.06	189.69	175.34	161.84	152.83	150.71	156.05	167.42	181.78	195.27	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	(71)

Water heating gains (Table 5)

(72)m=	81.87	79.2	74.31	67.87	63.48	57.55	53.03	59.44	62.11	68.74	76.15	79.82	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	365.13	362.54	349.29	328.29	307.03	286.45	273.42	279.74	290.77	311.97	336.26	354.57	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	169.83	289.28	395.81	490.43	549.32	545.35	525.77	481.84	428.58	319.72	203.42	145.34	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	534.96	651.83	745.1	818.72	856.35	831.79	799.19	761.58	719.35	631.69	539.67	499.91	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.72	0.52	0.38	0.41	0.64	0.91	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.11	20.32	20.56	20.81	20.95	20.99	21	21	20.98	20.79	20.4	20.07	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.1	20.1	20.11	20.12	20.13	20.13	20.14	20.13	20.12	20.11	20.11	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.66	0.45	0.3	0.34	0.57	0.88	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.91	19.21	19.57	19.91	20.07	20.13	20.13	20.14	20.11	19.9	19.35	18.87	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.24	19.51	19.84	20.16	20.31	20.36	20.37	20.37	20.35	20.14	19.64	19.2	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.09	19.36	19.69	20.01	20.16	20.21	20.22	20.22	20.2	19.99	19.49	19.05	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.67	0.46	0.31	0.34	0.58	0.87	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	529.65	634.1	694.28	681.44	569.51	383.72	248.55	261.3	414.59	549.71	526.55	496.33	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1066.99	1039.74	944.61	781.07	592.79	385.92	248.72	261.6	422.41	657.79	874.38	1055.86	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	399.78	272.59	186.24	71.74	17.32	0	0	0	0	80.41	250.44	416.29	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1694.81 (98)

Space heating requirement in kWh/m²/year 23.2 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	399.78	272.59	186.24	71.74	17.32	0	0	0	0	80.41	250.44	416.29	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	442.24	301.54	206.02	79.36	19.16	0	0	0	0	88.95	277.03	460.5	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1874.79 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01

Efficiency of water heater 80.3 (216)

(217)m=	86.81	86.22	85.17	83.21	81.22	80.3	80.3	80.3	80.3	83.35	85.93	86.96	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	225.32	198.17	208.73	189.5	187.95	167.44	160.42	178.83	180.81	198.36	205.37	219.65	

Total = Sum(219a)$_{1...12}$ = 2320.55 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1874.79

DER WorkSheet: New dwelling design stage

Water heating fuel used		2320.55	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	171.09		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	201.09	(231)
Electricity for lighting		321.63	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	404.96	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	501.24	(264)
Space and water heating	(261) + (262) + (263) + (264) =				906.19	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	104.37	(267)
Electricity for lighting	(232) x		0.519	=	166.93	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			716.48	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			9.81	(273)
EI rating (section 14)					92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 10

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.73	(1a) x	2.56	(2a) =	188.75	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.73	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.75	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			73.73	x	0.12	=	8.8476			(28)
Walls Type1	31.87	17.3	14.57	x	0.16	=	2.33			(29)
Walls Type2	46.82	2.42	44.4	x	0.14	=	6.28			(29)
Total area of elements, m²			152.42							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.78 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 9112.79 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 51.58 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.55	20.29	20.03	18.7	18.44	17.11	17.11	16.85	17.64	18.44	18.97	19.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	72.14	71.87	71.61	70.29	70.02	68.7	68.7	68.43	69.23	70.02	70.55	71.08	

Average = Sum(39)$_{1...12}$ /12= 70.22 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.98	0.97	0.97	0.95	0.95	0.93	0.93	0.93	0.94	0.95	0.96	0.96

Average = Sum(40)$_{1...12}$ /12= 0.95 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.61 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.57	94.99	91.41	87.82	84.24	80.65	80.65	84.24	87.82	91.41	94.99	98.57

Total = Sum(44)$_{1...12}$ = 1075.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.18	127.85	131.93	115.02	110.37	95.24	88.25	101.27	102.48	119.43	130.37	141.57

Total = Sum(45)$_{1...12}$ = 1409.96 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.93	19.18	19.79	17.25	16.55	14.29	13.24	15.19	15.37	17.91	19.56	21.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.23	43.72	46.58	43.31	42.93	39.77	41.1	42.93	43.31	46.58	46.84	50.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.2	145.79	166.01	177.21	191.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.2	145.79	166.01	177.21	191.8	

Output from water heater (annual)$_{1...12}$ 1947.49 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.16	53.44	55.51	49.07	47.43	41.61	39.62	44.4	44.9	51.36	55.06	59.63	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.35	16.3	13.26	10.04	7.5	6.33	6.84	8.89	11.94	15.16	17.69	18.86	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.84	207.98	202.59	191.14	176.67	163.08	153.99	151.86	157.24	168.7	183.16	196.76	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	(71)

Water heating gains (Table 5)

(72)m=	82.21	79.53	74.61	68.16	63.75	57.79	53.25	59.68	62.36	69.03	76.47	80.15	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.4	364.8	351.46	330.32	308.92	288.2	275.08	281.43	292.54	313.88	338.32	356.77	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	169.83	289.28	395.81	490.43	549.32	545.35	525.77	481.84	428.58	319.72	203.42	145.34	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	537.23	654.08	747.27	820.75	858.24	833.55	800.86	763.27	721.12	633.6	541.74	502.11	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.72	0.52	0.38	0.41	0.64	0.91	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.12	20.32	20.57	20.82	20.95	20.99	21	21	20.98	20.8	20.41	20.09	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.1	20.1	20.11	20.12	20.13	20.14	20.14	20.14	20.13	20.13	20.12	20.11	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.66	0.45	0.3	0.34	0.57	0.88	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.93	19.23	19.58	19.92	20.08	20.14	20.14	20.14	20.12	19.91	19.37	18.89	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.25	19.53	19.85	20.17	20.32	20.37	20.37	20.37	20.35	20.15	19.65	19.21	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.1	19.38	19.7	20.02	20.17	20.22	20.22	20.22	20.2	20	19.5	19.06	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.66	0.46	0.31	0.34	0.58	0.87	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	531.97	636.47	696.56	683.11	570.22	383.83	248.65	261.39	414.93	551.36	528.68	498.57	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1067.86	1040.45	945.14	781.29	592.87	385.93	248.81	261.67	422.46	658.04	874.89	1056.61	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	398.7	271.47	184.95	70.69	16.85	0	0	0	0	79.37	249.27	415.18	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1686.48 (98)

Space heating requirement in kWh/m²/year 22.87 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	398.7	271.47	184.95	70.69	16.85	0	0	0	0	79.37	249.27	415.18	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	441.04	300.3	204.59	78.2	18.64	0	0	0	0	87.8	275.74	459.27	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1865.58 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.2	145.79	166.01	177.21	191.8

Efficiency of water heater 80.3 (216)

(217)m=	86.8	86.2	85.14	83.17	81.2	80.3	80.3	80.3	80.3	83.31	85.91	86.94	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	226.29	199.04	209.67	190.37	188.79	168.13	161.08	179.57	181.55	199.26	206.28	220.6	

Total = Sum(219a)$_{1...12}$ = 2330.64 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1865.58

DER WorkSheet: New dwelling design stage

Water heating fuel used		2330.64	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	172.71		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	202.71	(231)
Electricity for lighting		324.08	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	402.96	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	503.42	(264)
Space and water heating	(261) + (262) + (263) + (264) =				906.38	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	105.2	(267)
Electricity for lighting	(232) x		0.519	=	168.2	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			718.78	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			9.75	(273)
EI rating (section 14)					92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat11

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	52.19	(1a) x	2.56	(2a) =	133.61	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	52.19	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		133.61	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			52.19	x	0.12	=	6.2628			(28)
Walls Type1	24.97	17.3	7.67	x	0.16	=	1.23			(29)
Walls Type2	39.92	2.42	37.5	x	0.14	=	5.3			(29)
Total area of elements, m²			117.08							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.12 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6508.79 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 46.92 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.55	14.36	14.17	13.24	13.05	12.11	12.11	11.93	12.49	13.05	13.43	13.8	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	61.47	61.28	61.1	60.16	59.97	59.03	59.03	58.85	59.41	59.97	60.35	60.72	

Average = Sum(39)$_{1...12}$ /12= 60.11 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.18	1.17	1.17	1.15	1.15	1.13	1.13	1.13	1.14	1.15	1.16	1.16

Average = Sum(40)$_{1...12}$ /12= 1.15 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.75 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.87 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	83.46	80.43	77.39	74.36	71.32	68.29	68.29	71.32	74.36	77.39	80.43	83.46

Total = Sum(44)$_{1...12}$ = 910.48 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	123.77	108.25	111.7	97.39	93.44	80.64	74.72	85.74	86.77	101.12	110.38	119.86

Total = Sum(45)$_{1...12}$ = 1193.79 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.57	16.24	16.76	14.61	14.02	12.1	11.21	12.86	13.02	15.17	16.56	17.98

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.53	37.02	39.44	36.67	36.34	33.68	34.8	36.34	36.67	39.44	39.66	42.53	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	166.3	145.27	151.14	134.06	129.79	114.31	109.52	122.09	123.44	140.56	150.04	162.4	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	166.3	145.27	151.14	134.06	129.79	114.31	109.52	122.09	123.44	140.56	150.04	162.4	

Output from water heater (annual)$_{1...12}$ 1648.9 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.79	45.25	47	41.55	40.16	35.23	33.54	37.6	38.02	43.48	46.62	50.49	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	87.73	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.63	12.11	9.85	7.46	5.57	4.7	5.08	6.61	8.87	11.26	13.14	14.01	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	152.92	154.51	150.51	141.99	131.25	121.15	114.4	112.81	116.81	125.33	136.07	146.17	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	31.77	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	-70.19	(71)

Water heating gains (Table 5)

(72)m=	69.61	67.33	63.17	57.71	53.97	48.93	45.09	50.53	52.8	58.44	64.75	67.86	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	288.48	286.27	275.85	259.48	243.11	227.1	216.89	222.27	230.8	247.35	266.28	280.36	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	169.83	289.28	395.81	490.43	549.32	545.35	525.77	481.84	428.58	319.72	203.42	145.34	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	458.31	575.55	671.66	749.9	792.44	772.45	742.67	704.11	659.38	567.07	469.7	425.7	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.92	0.82	0.66	0.48	0.35	0.38	0.6	0.87	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.97	20.23	20.52	20.8	20.94	20.99	21	21	20.97	20.77	20.32	19.93	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.94	19.94	19.94	19.96	19.96	19.98	19.98	19.98	19.97	19.96	19.96	19.95	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.9	0.78	0.6	0.41	0.27	0.3	0.52	0.83	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.6	18.97	19.38	19.75	19.91	19.97	19.98	19.98	19.95	19.72	19.11	18.54	(90)

fLA = Living area ÷ (4) = 0.32 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.04	19.37	19.74	20.08	20.24	20.29	20.3	20.3	20.27	20.05	19.49	18.98	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.89	19.22	19.59	19.93	20.09	20.14	20.15	20.15	20.12	19.9	19.34	18.83	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.98	0.95	0.9	0.78	0.61	0.42	0.28	0.31	0.53	0.83	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	449.96	548.75	601.59	584.12	483.02	324.8	209.23	220.25	350.33	469.08	450.69	419.94	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	896.57	877.62	799.85	663.48	502.99	327.19	209.46	220.66	357.91	557.83	738.58	888.35	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	332.28	221	147.5	57.14	14.86	0	0	0	0	66.02	207.28	348.5	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1394.58 (98)

Space heating requirement in kWh/m²/year 26.72 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	332.28	221	147.5	57.14	14.86	0	0	0	0	66.02	207.28	348.5	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	367.56	244.47	163.16	63.21	16.44	0	0	0	0	73.04	229.29	385.5	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1542.67 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	166.3	145.27	151.14	134.06	129.79	114.31	109.52	122.09	123.44	140.56	150.04	162.4

Efficiency of water heater 80.3 (216)

(217)m=	86.76	86.1	84.99	83.07	81.23	80.3	80.3	80.3	80.3	83.27	85.87	86.92	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	191.68	168.71	177.84	161.37	159.78	142.36	136.39	152.04	153.72	168.79	174.74	186.82	

Total = Sum(219a)$_{1...12}$ = 1974.22 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1542.67

DER WorkSheet: New dwelling design stage

Water heating fuel used			1974.22	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		122.25		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		152.25	(231)
Electricity for lighting			240.76	(232)
Electricity generated by PVs			-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

		Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	333.22	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	426.43	(264)
Space and water heating	(261) + (262) + (263) + (264) =				759.65	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	79.02	(267)
Electricity for lighting	(232)	x	0.519	=	124.95	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =				502.62	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =				9.63	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 12

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.42	(1a) x	2.56	(2a) =	187.95	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.42	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.95	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x	1/[1/(1.4)+ 0.04]	=	10.69			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Windows Type 3			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Windows Type 4			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Floor			73.418	x	0.12	=	8.81016			(28)
Walls Type1	52.05	23.08	28.97	x	0.16	=	4.64			(29)
Walls Type2	17.46	2.42	15.04	x	0.14	=	2.13			(29)
Total area of elements, m²			142.93							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 49.56 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8824.22 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 12.32 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 61.88 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.47	20.2	19.94	18.62	18.36	17.04	17.04	16.78	17.57	18.36	18.89	19.41	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	82.34	82.08	81.82	80.5	80.24	78.92	78.92	78.65	79.44	80.24	80.76	81.29	

Average = Sum(39)$_{1...12}$ /12= 80.43 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.12	1.12	1.11	1.1	1.09	1.07	1.07	1.07	1.08	1.09	1.1	1.11

Average = Sum(40)$_{1...12}$ /12= 1.1 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.45 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.39	94.81	91.24	87.66	84.08	80.5	80.5	84.08	87.66	91.24	94.81	98.39

Total = Sum(44)$_{1...12}$ = 1073.36 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.91	127.61	131.69	114.81	110.16	95.06	88.09	101.08	102.29	119.21	130.12	141.31

Total = Sum(45)$_{1...12}$ = 1407.34 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.89	19.14	19.75	17.22	16.52	14.26	13.21	15.16	15.34	17.88	19.52	21.2

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.14	43.64	46.49	43.23	42.85	39.7	41.02	42.85	43.23	46.49	46.76	50.14	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	

Output from water heater (annual)$_{1...12}$ 1943.87 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.05	53.34	55.41	48.98	47.34	41.53	39.54	44.32	44.82	51.26	54.96	59.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.29	16.24	13.21	10	7.48	6.31	6.82	8.86	11.9	15.11	17.63	18.8	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.14	207.27	201.9	190.48	176.07	162.52	153.47	151.34	156.7	168.12	182.54	196.09	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	(71)

Water heating gains (Table 5)

(72)m=	82.06	79.38	74.47	68.03	63.63	57.68	53.15	59.57	62.25	68.9	76.33	80	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	366.38	363.78	350.48	329.41	308.07	287.41	274.33	280.67	291.74	313.02	337.39	355.78	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast	0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast	0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast	0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast	0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast	0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast	0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast	0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast	0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast	0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast	0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast	0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)
Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)
Southwest	0.9x	0.77	x	2.89	x	36.79		0.55	x	0.7	=	28.37	(79)
Southwest	0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	48.33	(79)
Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	66.12	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	81.93	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	91.77	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	206.9	355.32	493.84	624.75	711.52	711.54	683.85	618.33	539.05	394.77	248.35	176.72	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	573.28	719.1	844.32	954.16	1019.59	998.95	958.18	899	830.79	707.79	585.74	532.5	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.85	0.69	0.5	0.36	0.4	0.63	0.9	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.96	20.21	20.5	20.79	20.94	20.99	21	21	20.97	20.74	20.29	19.92	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.98	19.99	19.99	20	20.01	20.02	20.02	20.02	20.02	20.01	20	19.99	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.81	0.63	0.43	0.28	0.32	0.55	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.62	18.97	19.38	19.78	19.96	20.02	20.02	20.02	20	19.74	19.11	18.57	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.96	19.28	19.66	20.03	20.2	20.26	20.27	20.27	20.24	19.99	19.41	18.91	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.81	19.13	19.51	19.88	20.05	20.11	20.12	20.12	20.09	19.84	19.26	18.76	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	0.99	0.97	0.92	0.81	0.63	0.43	0.29	0.32	0.56	0.86	0.97	0.99	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	566.29	695.05	774.73	768.57	642.63	431.85	277.16	291.87	464.78	607.59	569.04	527.79	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	1194.58	1168.04	1064.62	883.79	670.15	434.84	277.43	292.37	475.85	741.32	981.98	1183.43	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	467.45	317.85	215.68	82.96	20.48	0	0	0	0	99.5	297.32	487.79	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1989.03 (98)

Space heating requirement in kWh/m²/year 27.09 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

DER WorkSheet: New dwelling design stage

Fraction of space heat from main system(s)	(202) = 1 – (201) =	1 (202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1 (204)
Efficiency of main space heating system 1		90.4 (206)
Efficiency of secondary/supplementary heating system, %		0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	467.45	317.85	215.68	82.96	20.48	0	0	0	0	99.5	297.32	487.79	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)	517.09	351.6	238.59	91.76	22.65	0	0	0	0	110.06	328.89	539.6	(211)

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 2200.25 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Output from water heater (calculated above)	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45
Efficiency of water heater												80.3 (216)
(217)m=	87.16	86.59	85.53	83.51	81.37	80.3	80.3	80.3	80.3	83.81	86.35	87.3 (217)
Fuel for water heating, kWh/month (219)m = (64)m x 100 ÷ (217)m												
(219)m=	224.93	197.78	208.32	189.24	188.03	167.82	160.79	179.24	181.22	197.7	204.85	219.28

Total = Sum(219a)$_{1...12}$ = 2319.19 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2200.25
Water heating fuel used		2319.19
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	171.97	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		201.97 (231)
Electricity for lighting		322.98 (232)
Electricity generated by PVs		-888.26 (233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216 =	475.25 (261)
Space heating (secondary)	(215) x	0.519 =	0 (263)
Water heating	(219) x	0.216 =	500.95 (264)
Space and water heating	(261) + (262) + (263) + (264) =		976.2 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519 =	104.82 (267)

DER WorkSheet: New dwelling design stage

Electricity for lighting	(232) x	0.519	=	167.63	(268)
Energy saving/generation technologies Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			787.65	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			10.73	(273)
EI rating (section 14)				91	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 13

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	89.09	(1a) x	2.56	(2a) =	228.06	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	89.09	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		228.06	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=

0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31

(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=

0	0	0	0	0	0	0	0	0	0	0	0

(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=

0	0	0	0	0	0	0	0	0	0	0	0

(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=

0	0	0	0	0	0	0	0	0	0	0	0

(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=

0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31

(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Windows Type 4			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			89.086	x	0.12	=	10.69032			(28)
Walls Type1	67.1	21.89	45.21	x	0.16	=	7.23			(29)
Walls Type2	23.57	2.42	21.15	x	0.14	=	2.99			(29)
Roof	10.26	0	10.26	x	0.12	=	1.23			(30)
Total area of elements, m²			190.02							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 54.56 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11019.93 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 15.4 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 69.95 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

DER WorkSheet: New dwelling design stage

(38)m=	24.84	24.52	24.2	22.6	22.28	20.68	20.68	20.36	21.32	22.28	22.92	23.56	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	94.79	94.47	94.15	92.55	92.23	90.63	90.63	90.31	91.27	92.23	92.87	93.51	

Average = Sum(39)$_{1...12}$ /12= 92.47 (39)

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.06	1.06	1.06	1.04	1.04	1.02	1.02	1.01	1.02	1.04	1.04	1.05	

Average = Sum(40)$_{1...12}$ /12= 1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.61 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 96.26 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	105.88	102.03	98.18	94.33	90.48	86.63	86.63	90.48	94.33	98.18	102.03	105.88	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1155.11 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	157.02	137.33	141.72	123.55	118.55	102.3	94.8	108.78	110.08	128.29	140.04	152.07	

Total = Sum(45)$_{1...12}$ = 1514.53 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.55	20.6	21.26	18.53	17.78	15.35	14.22	16.32	16.51	19.24	21.01	22.81	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

DER WorkSheet: New dwelling design stage

Primary circuit loss (annual) from Table 3 | 0 | (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.03	46.52	46.11	42.72	44.15	46.11	46.52	50.03	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	207.98	183.36	191.75	170.07	164.66	145.02	138.94	154.89	156.6	178.32	189.35	203.03	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	207.98	183.36	191.75	170.07	164.66	145.02	138.94	154.89	156.6	178.32	189.35	203.03	

Output from water heater (annual)$_{1...12}$ | 2083.98 | (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	64.95	57.17	59.63	52.71	50.95	44.7	42.56	47.7	48.23	55.16	58.89	63.3	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	130.65	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.16	18.8	15.29	11.57	8.65	7.3	7.89	10.26	13.77	17.48	20.4	21.75	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	237.39	239.85	233.64	220.43	203.75	188.07	177.59	175.13	181.34	194.55	211.23	226.91	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	36.07	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	-104.52	(71)

Water heating gains (Table 5)

(72)m=	87.3	85.08	80.15	73.21	68.48	62.08	57.2	64.11	66.99	74.14	81.79	85.08	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	411.04	408.92	394.27	370.4	346.07	322.64	307.88	314.69	327.29	351.37	378.62	398.94	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(79)

DER WorkSheet: New dwelling design stage

Southwest	0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	48.33	(79)
Southwest	0.9x	0.77	x	4.62	x	62.67		0.55	x	0.7	=	77.25	(79)
Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	66.12	(79)
Southwest	0.9x	0.77	x	4.62	x	85.75		0.55	x	0.7	=	105.7	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	81.93	(79)
Southwest	0.9x	0.77	x	4.62	x	106.25		0.55	x	0.7	=	130.97	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	91.77	(79)
Southwest	0.9x	0.77	x	4.62	x	119.01		0.55	x	0.7	=	146.7	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest	0.9x	0.77	x	4.62	x	118.15		0.55	x	0.7	=	145.64	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest	0.9x	0.77	x	4.62	x	113.91		0.55	x	0.7	=	140.41	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest	0.9x	0.77	x	4.62	x	104.39		0.55	x	0.7	=	128.68	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest	0.9x	0.77	x	4.62	x	92.85		0.55	x	0.7	=	114.45	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest	0.9x	0.77	x	4.62	x	69.27		0.55	x	0.7	=	85.38	(79)
Southwest	0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest	0.9x	0.77	x	4.62	x	44.07		0.55	x	0.7	=	54.32	(79)
Southwest	0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)
Southwest	0.9x	0.77	x	4.62	x	31.49		0.55	x	0.7	=	38.81	(79)
Northwest	0.9x	0.77	x	8.06	x	11.28	x	0.55	x	0.7	=	24.26	(81)
Northwest	0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest	0.9x	0.77	x	8.06	x	22.97	x	0.55	x	0.7	=	49.39	(81)
Northwest	0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest	0.9x	0.77	x	8.06	x	41.38	x	0.55	x	0.7	=	88.98	(81)
Northwest	0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest	0.9x	0.77	x	8.06	x	67.96	x	0.55	x	0.7	=	146.14	(81)
Northwest	0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest	0.9x	0.77	x	8.06	x	91.35	x	0.55	x	0.7	=	196.43	(81)
Northwest	0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest	0.9x	0.77	x	8.06	x	97.38	x	0.55	x	0.7	=	209.42	(81)
Northwest	0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest	0.9x	0.77	x	8.06	x	91.1	x	0.55	x	0.7	=	195.91	(81)
Northwest	0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest	0.9x	0.77	x	8.06	x	72.63	x	0.55	x	0.7	=	156.18	(81)
Northwest	0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest	0.9x	0.77	x	8.06	x	50.42	x	0.55	x	0.7	=	108.43	(81)
Northwest	0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest	0.9x	0.77	x	8.06	x	28.07	x	0.55	x	0.7	=	60.36	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	8.06	x	14.2	x	0.55	x	0.7	=	30.53	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	8.06	x	9.21	x	0.55	x	0.7	=	19.81	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	117.01	213.69	330.58	473.62	588.93	610.37	577.76	487.81	379.49	246.48	142.77	98.44	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	528.06	622.61	724.85	844.03	934.99	933.01	885.64	802.5	706.78	597.85	521.4	497.39	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.98	0.94	0.81	0.6	0.45	0.51	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.87	20.03	20.3	20.65	20.89	20.98	21	20.99	20.93	20.59	20.17	19.85	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.03	20.04	20.05	20.05	20.07	20.07	20.07	20.06	20.05	20.05	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.75	0.52	0.35	0.41	0.72	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.52	18.76	19.15	19.64	19.95	20.06	20.07	20.07	20.01	19.58	18.97	18.49	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.86	19.08	19.44	19.89	20.18	20.29	20.3	20.3	20.24	19.83	19.27	18.83	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.71	18.93	19.29	19.74	20.03	20.14	20.15	20.15	20.09	19.68	19.12	18.68	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	1	0.99	0.97	0.91	0.75	0.53	0.36	0.42	0.72	0.95	0.99	1	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	526.04	616.83	705.27	766.52	703.53	494.42	321.01	337.12	509.5	567.39	516.95	495.99	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	1365.45	1325.24	1203.84	1003.61	768.7	501.98	321.75	338.73	546.32	837.74	1116.31	1354.12	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	624.52	476.05	370.94	170.7	48.49	0	0	0	0	201.14	431.54	638.45	

Total per year (kWh/year) = Sum(98)$_{1\ldots5,9\ldots12}$ = 2961.83 (98)

Space heating requirement in kWh/m²/year 33.25 (99)

DER WorkSheet: New dwelling design stage

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system		0 (201)
Fraction of space heat from main system(s)	(202) = 1 – (201) =	1 (202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1 (204)
Efficiency of main space heating system 1		90.4 (206)
Efficiency of secondary/supplementary heating system, %		0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	624.52	476.05	370.94	170.7	48.49	0	0	0	0	201.14	431.54	638.45	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	690.84	526.6	410.33	188.83	53.63	0	0	0	0	222.5	477.36	706.25	

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 3276.36 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

Output from water heater (calculated above)

Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
207.98	183.36	191.75	170.07	164.66	145.02	138.94	154.89	156.6	178.32	189.35	203.03

Efficiency of water heater 80.3 (216)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(217)m=	87.65	87.35	86.68	85.06	82.39	80.3	80.3	80.3	80.3	85.35	87.06	87.74

(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(219)m=	237.3	209.93	221.2	199.94	199.84	180.6	173.03	192.89	195.02	208.92	217.49	231.4

Total = Sum(219a)$_{1...12}$ = 2467.57 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		3276.36
Water heating fuel used		2467.57
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	208.68	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		238.68 (231)
Electricity for lighting		373.75 (232)
Electricity generated by PVs		-888.26 (233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216 =	707.69 (261)
Space heating (secondary)	(215) x	0.519 =	0 (263)
Water heating	(219) x	0.216 =	533 (264)

DER WorkSheet: New dwelling design stage

Space and water heating	(261) + (262) + (263) + (264) =			1240.69	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	123.87	(267)
Electricity for lighting	(232) x	0.519	=	193.98	(268)
Energy saving/generation technologies Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			1097.53	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			12.32	(273)
EI rating (section 14)				89	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 14

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	89.3	(1a) x	2.56	(2a) =	228.61	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	89.3	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		228.61	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Floor			89.3	x	0.12	=	10.716			(28)
Walls Type1	46.68	17.54	29.14	x	0.16	=	4.66			(29)
Walls Type2	43.8	2.42	41.38	x	0.14	=	5.85			(29)
Total area of elements, m²			179.78							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 47.87 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11021.84 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.11 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 55.98 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	24.9	24.57	24.25	22.65	22.33	20.73	20.73	20.41	21.37	22.33	22.97	23.61	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	80.88	80.56	80.24	78.63	78.31	76.71	76.71	76.39	77.35	78.31	78.95	79.6	

Average = Sum(39)$_{1...12}$ /12= 78.55 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.91	0.9	0.9	0.88	0.88	0.86	0.86	0.86	0.87	0.88	0.88	0.89

Average = Sum(40)$_{1...12}$ /12= 0.88 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.62 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 96.33 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	105.96	102.11	98.26	94.4	90.55	86.7	86.7	90.55	94.4	98.26	102.11	105.96

Total = Sum(44)$_{1...12}$ = 1155.96 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	157.14	137.44	141.82	123.64	118.64	102.38	94.87	108.86	110.16	128.38	140.14	152.18

Total = Sum(45)$_{1...12}$ = 1515.65 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.57	20.62	21.27	18.55	17.8	15.36	14.23	16.33	16.52	19.26	21.02	22.83

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.07	46.56	46.14	42.75	44.18	46.14	46.56	50.07	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	208.1	183.46	191.89	170.2	164.78	145.13	139.05	155	156.72	178.45	189.45	203.14	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	208.1	183.46	191.89	170.2	164.78	145.13	139.05	155	156.72	178.45	189.45	203.14	

Output from water heater (annual)$_{1...12}$ 2085.39 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	64.99	57.2	59.67	52.75	50.98	44.73	42.59	47.73	48.27	55.2	58.93	63.34	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	130.8	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.39	19	15.45	11.7	8.74	7.38	7.98	10.37	13.92	17.67	20.62	21.98	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	237.78	240.25	234.03	220.8	204.09	188.38	177.89	175.42	181.64	194.88	211.59	227.29	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	36.08	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	-104.64	(71)

Water heating gains (Table 5)

(72)m=	87.35	85.13	80.21	73.26	68.53	62.12	57.24	64.16	67.04	74.2	81.84	85.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	411.77	409.62	394.93	371	346.6	323.13	308.35	315.19	327.84	351.99	379.29	399.65	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	8.06	x	11.28	x	0.55	x	0.7	=	24.26	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	28.54	(81)
Northwest 0.9x	0.77	x	8.06	x	22.97	x	0.55	x	0.7	=	49.39	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	58.09	(81)
Northwest 0.9x	0.77	x	8.06	x	41.38	x	0.55	x	0.7	=	88.98	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	104.66	(81)
Northwest 0.9x	0.77	x	8.06	x	67.96	x	0.55	x	0.7	=	146.14	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	171.88	(81)
Northwest 0.9x	0.77	x	8.06	x	91.35	x	0.55	x	0.7	=	196.43	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	231.04	(81)
Northwest 0.9x	0.77	x	8.06	x	97.38	x	0.55	x	0.7	=	209.42	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	246.32	(81)
Northwest 0.9x	0.77	x	8.06	x	91.1	x	0.55	x	0.7	=	195.91	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	230.42	(81)
Northwest 0.9x	0.77	x	8.06	x	72.63	x	0.55	x	0.7	=	156.18	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	183.7	(81)
Northwest 0.9x	0.77	x	8.06	x	50.42	x	0.55	x	0.7	=	108.43	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	127.53	(81)
Northwest 0.9x	0.77	x	8.06	x	28.07	x	0.55	x	0.7	=	60.36	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	70.99	(81)
Northwest 0.9x	0.77	x	8.06	x	14.2	x	0.55	x	0.7	=	30.53	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	35.91	(81)
Northwest 0.9x	0.77	x	8.06	x	9.21	x	0.55	x	0.7	=	19.81	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	23.31	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(83)m=	52.8	107.48	193.64	318.02	427.48	455.74	426.33	339.88	235.96	131.35	66.44	43.12	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(84)m=	464.57	517.1	588.57	689.02	774.07	778.86	734.68	655.06	563.79	483.34	445.73	442.77	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.83	0.62	0.46	0.53	0.84	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(87)m=	20.02	20.14	20.36	20.68	20.91	20.99	21	21	20.93	20.63	20.28	20.01	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(88)m=	20.16	20.17	20.17	20.18	20.19	20.2	20.2	20.21	20.2	20.19	20.18	20.17	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(89)m=	1	1	0.99	0.95	0.79	0.55	0.38	0.44	0.78	0.98	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(90)m=	18.84	19.01	19.34	19.8	20.1	20.2	20.2	20.2	20.14	19.74	19.23	18.83	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(92)m=	19.17	19.32	19.62	20.04	20.32	20.41	20.42	20.42	20.36	19.98	19.52	19.16	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.02	19.17	19.47	19.89	20.17	20.26	20.27	20.27	20.21	19.83	19.37	19.01	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	1	0.99	0.94	0.79	0.55	0.38	0.45	0.78	0.97	1	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	463.66	514.97	580.77	647.1	610.07	429.73	281.16	294.73	438.16	469.81	443.82	442.13	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1190.22	1149.74	1040.59	864.36	663.44	434.4	281.54	295.72	472.46	722.76	968.47	1178.6	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	540.56	426.56	342.11	156.42	39.71	0	0	0	0	188.19	377.75	547.93	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2619.24 (98)

Space heating requirement in kWh/m²/year 29.33 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	540.56	426.56	342.11	156.42	39.71	0	0	0	0	188.19	377.75	547.93	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	597.96	471.86	378.44	173.04	43.92	0	0	0	0	208.18	417.87	606.12	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2897.39 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	208.1	183.46	191.89	170.2	164.78	145.13	139.05	155	156.72	178.45	189.45	203.14

Efficiency of water heater 80.3 (216)

(217)m=	87.35	87.11	86.49	84.84	82.08	80.3	80.3	80.3	80.3	85.19	86.76	87.43	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	238.25	210.62	221.86	200.61	200.76	180.74	173.16	193.03	195.16	209.49	218.38	232.36	

Total = Sum(219a)$_{1...12}$ = 2474.42 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2897.39

DER WorkSheet: New dwelling design stage

Water heating fuel used		2474.42	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	209.18		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	239.18	(231)
Electricity for lighting		377.76	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	625.84	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	534.48	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1160.31	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	124.13	(267)
Electricity for lighting	(232) x		0.519	=	196.06	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			1019.5	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.42	(273)
EI rating (section 14)					90	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 15

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	87.91	(1a) x	2.56	(2a) =	225.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	87.91	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		225.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Floor			87.918	x	0.12	=	10.55016			(28)
Walls Type1	35.76	15.8	19.96	x	0.16	=	3.19			(29)
Walls Type2	40.33	2.42	37.91	x	0.14	=	5.36			(29)
Total area of elements, m²			164							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.44 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 10654.65 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.83 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 52.27 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	24.51	24.19	23.88	22.3	21.98	20.4	20.4	20.09	21.04	21.98	22.61	23.25	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	76.78	76.47	76.15	74.57	74.26	72.68	72.68	72.36	73.31	74.26	74.89	75.52	

Average = Sum(39)$_{1...12}$ /12= 74.49 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.87	0.87	0.87	0.85	0.84	0.83	0.83	0.82	0.83	0.84	0.85	0.86

Average = Sum(40)$_{1...12}$ /12= 0.85 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.6 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 95.86 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	105.44	101.61	97.77	93.94	90.1	86.27	86.27	90.1	93.94	97.77	101.61	105.44	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1150.27 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	156.37	136.76	141.12	123.03	118.05	101.87	94.4	108.32	109.62	127.75	139.45	151.43

Total = Sum(45)$_{1...12}$ = 1508.18 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.45	20.51	21.17	18.46	17.71	15.28	14.16	16.25	16.44	19.16	20.92	22.71

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.82	46.33	45.92	42.54	43.96	45.92	46.33	49.82	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39	

Output from water heater (annual)$_{1...12}$ 2076.08 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	64.73	56.98	59.38	52.49	50.73	44.51	42.38	47.5	48.03	54.93	58.7	63.09	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	129.8	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.42	19.02	15.47	11.71	8.76	7.39	7.99	10.38	13.93	17.69	20.65	22.01	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	235.18	237.62	231.47	218.38	201.85	186.32	175.94	173.5	179.65	192.74	209.27	224.8	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	35.98	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	-103.84	(71)

Water heating gains (Table 5)

(72)m=	87	84.79	79.81	72.9	68.19	61.82	56.96	63.84	66.71	73.83	81.52	84.8	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	408.54	406.38	391.69	367.93	343.74	320.47	305.83	312.66	325.23	349.21	376.38	396.56	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	47.56	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	96.82	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	174.43	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	286.47	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	385.07	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	410.53	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	384.04	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	306.16	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	212.55	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	118.32	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	59.85	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	38.84	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	47.56	96.82	174.43	286.47	385.07	410.53	384.04	306.16	212.55	118.32	59.85	38.84	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	456.11	503.19	566.13	654.4	728.81	730.99	689.87	618.82	537.78	467.53	436.23	435.4	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.84	0.62	0.46	0.53	0.84	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.07	20.18	20.39	20.69	20.91	20.99	21	21	20.94	20.65	20.32	20.06	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.19	20.19	20.2	20.21	20.21	20.23	20.23	20.23	20.22	20.21	20.21	20.2	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.95	0.8	0.55	0.38	0.45	0.78	0.98	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.93	19.09	19.4	19.84	20.13	20.22	20.23	20.23	20.17	19.79	19.3	18.92	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.22	19.37	19.65	20.06	20.33	20.42	20.42	20.42	20.37	20	19.56	19.21	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.07	19.22	19.5	19.91	20.18	20.27	20.27	20.27	20.22	19.85	19.41	19.06	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	1	1	0.99	0.94	0.8	0.56	0.39	0.45	0.78	0.97	1	1	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	455.23	501.19	559.02	616.73	579.64	407.72	266.67	279.58	418.04	454.49	434.36	434.77	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	1133.87	1094.7	989.92	820.8	629.51	411.84	266.98	280.39	448.37	687.23	921.78	1122.24	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	504.91	398.84	320.59	146.93	37.1	0	0	0	0	173.16	350.94	511.47	

DER WorkSheet: New dwelling design stage

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ =	2443.94	(98)
Space heating requirement in kWh/m²/year	27.8	(99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system	0	(201)
Fraction of space heat from main system(s) (202) = 1 – (201) =	1	(202)
Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] =	1	(204)
Efficiency of main space heating system 1	90.4	(206)
Efficiency of secondary/supplementary heating system, %	0	(208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	504.91	398.84	320.59	146.93	37.1	0	0	0	0	173.16	350.94	511.47	
(211)m = {[(98)m x (204)] } x 100 ÷ (206) (211)	558.53	441.19	354.64	162.53	41.04	0	0	0	0	191.55	388.21	565.79	

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 2703.47 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
	207.32	182.79	190.95	169.36	163.97	144.42	138.36	154.24	155.94	177.57	188.76	202.39

Efficiency of water heater	80.3	(216)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(217)m=	87.21	86.96	86.35	84.7	81.99	80.3	80.3	80.3	80.3	84.99	86.59	87.29	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(219)m=	237.74	210.19	221.14	199.96	199.99	179.85	172.31	192.08	194.2	208.94	218	231.87

Total = Sum(219a)$_{1...12}$ = 2466.25 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2703.47
Water heating fuel used		2466.25
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	205.92	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		235.92 (231)
Electricity for lighting		378.27 (232)
Electricity generated by PVs		-888.26 (233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year

DER WorkSheet: New dwelling design stage

Space heating (main system 1)	(211) x	0.216	=	583.95	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	532.71	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1116.66	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	122.44	(267)
Electricity for lighting	(232) x	0.519	=	196.32	(268)
Energy saving/generation technologies Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			974.42	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			11.08	(273)
EI rating (section 14)				90	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 16

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	95.34	(1a) x	2.56	(2a) =	244.07	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	95.34	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		244.07	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Floor			95.34	x	0.12	=	11.4408			(28)
Walls Type1	52.82	18.69	34.13	x	0.16	=	5.46			(29)
Walls Type2	30.82	2.42	28.4	x	0.14	=	4.02			(29)
Total area of elements, m²			178.98							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 49.08 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11550.41 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 12.42 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 61.5 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	26.58	26.24	25.89	24.18	23.84	22.13	22.13	21.79	22.81	23.84	24.53	25.21	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	88.08	87.74	87.4	85.68	85.34	83.63	83.63	83.29	84.32	85.34	86.03	86.71	

Average = Sum(39)$_{1...12}$ /12= 85.6 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.92	0.92	0.92	0.9	0.9	0.88	0.88	0.87	0.88	0.9	0.9	0.91

Average = Sum(40)$_{1...12}$ /12= 0.9 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.69 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 98.13 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	107.95	104.02	100.1	96.17	92.25	88.32	88.32	92.25	96.17	100.1	104.02	107.95

Total = Sum(44)$_{1...12}$ = 1177.62 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	160.08	140.01	144.48	125.96	120.86	104.29	96.64	110.9	112.22	130.79	142.76	155.03

Total = Sum(45)$_{1...12}$ = 1544.04 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	24.01	21	21.67	18.89	18.13	15.64	14.5	16.64	16.83	19.62	21.41	23.25

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.96	47.43	47.01	43.56	45.01	47.01	47.43	50.96	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	211.04	186.04	195.44	173.39	167.87	147.85	141.65	157.91	159.65	181.75	192.08	205.99	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	211.04	186.04	195.44	173.39	167.87	147.85	141.65	157.91	159.65	181.75	192.08	205.99	

Output from water heater (annual)$_{1...12}$ 2120.66 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	65.97	58.06	60.78	53.74	51.94	45.57	43.39	48.63	49.17	56.23	59.8	64.29	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	134.6	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	22.37	19.86	16.16	12.23	9.14	7.72	8.34	10.84	14.55	18.48	21.56	22.99	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	248.57	251.15	244.65	230.81	213.34	196.92	185.96	183.38	189.88	203.72	221.18	237.6	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	36.46	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	-107.68	(71)

Water heating gains (Table 5)

(72)m=	88.67	86.4	81.69	74.64	69.81	63.29	58.31	65.36	68.29	75.57	83.05	86.41	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	425.98	423.79	408.87	384.06	358.67	334.31	318.99	325.96	339.1	364.14	392.18	413.38	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	47.56	(81)
Northwest 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	96.82	(81)
Northwest 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	174.43	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	286.47	(81)
Northwest 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	385.07	(81)
Northwest 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	410.53	(81)
Northwest 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	384.04	(81)
Northwest 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	306.16	(81)
Northwest 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	212.55	(81)
Northwest 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	118.32	(81)
Northwest 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	59.85	(81)
Northwest 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	38.84	(81)
Northwest 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	56.26	114.53	206.34	338.87	455.5	485.62	454.28	362.16	251.43	139.96	70.79	45.95	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	482.24	538.32	615.21	722.92	814.18	819.93	773.28	688.12	590.53	504.1	462.97	459.32	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.85	0.64	0.47	0.55	0.86	0.99	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.98	20.1	20.33	20.65	20.89	20.99	21	21	20.92	20.6	20.24	19.97	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.15	20.15	20.15	20.17	20.17	20.19	20.19	20.19	20.18	20.17	20.17	20.16	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.95	0.8	0.56	0.39	0.46	0.79	0.98	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.77	18.94	19.27	19.75	20.07	20.18	20.19	20.19	20.11	19.68	19.16	18.76	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.08	19.23	19.54	19.97	20.28	20.38	20.39	20.39	20.32	19.91	19.44	19.07	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.93	19.08	19.39	19.82	20.13	20.23	20.24	20.24	20.17	19.76	19.29	18.92	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	1	0.99	0.94	0.8	0.57	0.39	0.46	0.79	0.98	1	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	481.42	536.36	607.92	683.06	652.92	464.62	303.88	318.51	468.28	491.64	461.24	458.74	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1288.26	1244.5	1126.35	936.08	719.11	470.9	304.41	319.89	511.53	781.94	1048.29	1276.14	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	600.29	475.87	385.71	182.18	49.24	0	0	0	0	215.98	422.67	608.15	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2940.1 (98)

Space heating requirement in kWh/m²/year 30.84 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	600.29	475.87	385.71	182.18	49.24	0	0	0	0	215.98	422.67	608.15	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	664.04	526.41	426.67	201.53	54.47	0	0	0	0	238.92	467.56	672.73	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3252.32 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	211.04	186.04	195.44	173.39	167.87	147.85	141.65	157.91	159.65	181.75	192.08	205.99

Efficiency of water heater 80.3 (216)

(217)m=	87.54	87.31	86.73	85.18	82.39	80.3	80.3	80.3	80.3	85.49	86.98	87.61	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	241.09	213.07	225.34	203.56	203.76	184.12	176.4	196.65	198.82	212.6	220.83	235.12	

Total = Sum(219a)$_{1...12}$ = 2511.36 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 3252.32

DER WorkSheet: New dwelling design stage

Water heating fuel used		2511.36	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	223.32		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	253.32	(231)
Electricity for lighting		394.98	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	702.5	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	542.45	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1244.95	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	131.48	(267)
Electricity for lighting	(232) x		0.519	=	205	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			1120.42	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.75	(273)
EI rating (section 14)					89	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 17

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.76	(1a) x	2.56	(2a) =	188.83	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.76	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.83	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Windows Type 3			4.31	x1/[1/(1.4)+ 0.04]		=	5.71			(27)
Floor			2.464	x	0.12	=	0.29568			(28)
Walls Type1	56.59	19.87	36.72	x	0.16	=	5.87			(29)
Walls Type2	12.58	2.42	10.16	x	0.14	=	1.44			(29)
Total area of elements, m²			71.63							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 37.34 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 981.73 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.98 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 44.32 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.56	20.3	20.03	18.71	18.44	17.12	17.12	16.86	17.65	18.44	18.97	19.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	64.89	64.62	64.36	63.03	62.77	61.44	61.44	61.18	61.97	62.77	63.3	63.83	

Average = Sum(39)$_{1...12}$ /12= 62.97 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.88	0.88	0.87	0.85	0.85	0.83	0.83	0.83	0.84	0.85	0.86	0.87

Average = Sum(40)$_{1...12}$ /12= 0.85 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.63 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.59	95.01	91.42	87.84	84.25	80.67	80.67	84.25	87.84	91.42	95.01	98.59

Total = Sum(44)$_{1...12}$ = 1075.55 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.21	127.88	131.96	115.04	110.39	95.25	88.27	101.29	102.5	119.45	130.39	141.6

Total = Sum(45)$_{1...12}$ = 1410.22 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.93	19.18	19.79	17.26	16.56	14.29	13.24	15.19	15.37	17.92	19.56	21.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.24	43.73	46.59	43.32	42.93	39.78	41.11	42.93	43.32	46.59	46.85	50.24	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84	

Output from water heater (annual)$_{1...12}$ 1947.85 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.18	53.45	55.52	49.08	47.44	41.62	39.63	44.41	44.91	51.36	55.07	59.64	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.36	16.3	13.26	10.04	7.5	6.34	6.85	8.9	11.94	15.16	17.7	18.87	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.91	208.05	202.66	191.2	176.73	163.13	154.05	151.91	157.29	168.76	183.23	196.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	(71)

Water heating gains (Table 5)

(72)m=	82.22	79.54	74.63	68.17	63.76	57.8	53.26	59.69	62.37	69.04	76.48	80.16	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.5	364.9	351.56	330.42	309	288.28	275.16	281.51	292.62	313.97	338.42	356.86	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	4.31	x	11.28	x	0.55	x	0.7	=	12.97	(75)
Northeast 0.9x	0.77	x	4.31	x	22.97	x	0.55	x	0.7	=	26.41	(75)
Northeast 0.9x	0.77	x	4.31	x	41.38	x	0.55	x	0.7	=	47.58	(75)
Northeast 0.9x	0.77	x	4.31	x	67.96	x	0.55	x	0.7	=	78.14	(75)
Northeast 0.9x	0.77	x	4.31	x	91.35	x	0.55	x	0.7	=	105.04	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.31	x	97.38	x	0.55	x	0.7	=	111.99	(75)
Northeast 0.9x	0.77	x	4.31	x	91.1	x	0.55	x	0.7	=	104.76	(75)
Northeast 0.9x	0.77	x	4.31	x	72.63	x	0.55	x	0.7	=	83.52	(75)
Northeast 0.9x	0.77	x	4.31	x	50.42	x	0.55	x	0.7	=	57.98	(75)
Northeast 0.9x	0.77	x	4.31	x	28.07	x	0.55	x	0.7	=	32.28	(75)
Northeast 0.9x	0.77	x	4.31	x	14.2	x	0.55	x	0.7	=	16.33	(75)
Northeast 0.9x	0.77	x	4.31	x	9.21	x	0.55	x	0.7	=	10.6	(75)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	59.82	121.76	219.37	360.26	484.26	516.28	482.97	385.03	267.3	148.8	75.26	48.85	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	427.32	486.66	570.92	690.68	793.26	804.55	758.12	666.53	559.92	462.76	413.68	405.71	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.98	0.9	0.71	0.49	0.36	0.42	0.73	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.12	20.25	20.5	20.81	20.97	21	21	21	20.97	20.72	20.37	20.1	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.18	20.19	20.19	20.21	20.21	20.22	20.22	20.23	20.22	20.21	20.2	20.2	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.88	0.66	0.43	0.29	0.35	0.66	0.95	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19	19.2	19.55	20	20.18	20.22	20.22	20.23	20.2	19.89	19.38	18.99	(90)

fLA = Living area ÷ (4) = 0.24 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.27	19.45	19.78	20.19	20.37	20.41	20.41	20.41	20.39	20.09	19.62	19.26	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.12	19.3	19.63	20.04	20.22	20.26	20.26	20.26	20.24	19.94	19.47	19.11	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.87	0.66	0.43	0.3	0.35	0.66	0.94	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	425.83	482.68	554.37	602.54	520.29	346.96	224.92	236.21	369.83	437.09	410.35	404.67	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	961.59	930.75	845.19	702.45	534.82	347.77	224.98	236.37	380.21	586.19	782.9	951.35	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	398.6	301.1	216.37	71.94	10.81	0	0	0	0	110.93	268.24	406.73	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1784.72 (98)

Space heating requirement in kWh/m²/year 24.2 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	398.6	301.1	216.37	71.94	10.81	0	0	0	0	110.93	268.24	406.73	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	440.93	333.08	239.35	79.58	11.96	0	0	0	0	122.71	296.72	449.92	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1974.25 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84

Efficiency of water heater 80.3 (216)

(217)m= 86.8 | 86.45 | 85.54 | 83.2 | 80.9 | 80.3 | 80.3 | 80.3 | 80.3 | 84.06 | 86.09 | 86.9 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 226.34 | 198.5 | 208.74 | 190.33 | 189.53 | 168.16 | 161.11 | 179.6 | 181.59 | 197.52 | 205.88 | 220.76

Total = Sum(219a)$_{1...12}$ = 2328.06 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1974.25	
Water heating fuel used		2328.06	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	172.78		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		202.78	(231)
Electricity for lighting		324.19	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	426.44	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	502.86	(264)
Space and water heating	(261) + (262) + (263) + (264) =			929.3	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	105.24	(267)
Electricity for lighting	(232) x	0.519	=	168.26	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			741.79	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			10.06	(273)
EI rating (section 14)				92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 18

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	84.24	(1a) x	2.56	(2a) =	215.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	84.24	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		215.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	35.61	16.99	18.62	x	0.16	=	2.98			(29)
Walls Type2	20.82	2.42	18.4	x	0.14	=	2.6			(29)
Total area of elements, m²			56.43							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.49 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 629.29 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.56 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 36.06 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	23.48	23.18	22.88	21.37	21.07	19.55	19.55	19.25	20.16	21.07	21.67	22.27	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	59.54	59.24	58.94	57.43	57.12	55.61	55.61	55.31	56.22	57.12	57.73	58.33	

Average = Sum(39)$_{1...12}$ /12= 57.35 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.71	0.7	0.7	0.68	0.68	0.66	0.66	0.66	0.67	0.68	0.69	0.69

Average = Sum(40)$_{1...12}$ /12= 0.68 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.54 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 94.49 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	103.94	100.16	96.38	92.6	88.82	85.04	85.04	88.82	92.6	96.38	100.16	103.94

Total = Sum(44)$_{1...12}$ = 1133.85 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	154.13	134.81	139.11	121.28	116.37	100.42	93.05	106.78	108.05	125.93	137.46	149.27

Total = Sum(45)$_{1...12}$ = 1486.65 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.12	20.22	20.87	18.19	17.46	15.06	13.96	16.02	16.21	18.89	20.62	22.39

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.11	45.66	45.26	41.94	43.33	45.26	45.66	49.11	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	

Output from water heater (annual)$_{1...12}$ 2049.26 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	63.99	56.33	58.53	51.74	50.01	43.87	41.77	46.82	47.34	54.15	58.03	62.37	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	20.46	18.17	14.78	11.19	8.36	7.06	7.63	9.92	13.31	16.9	19.72	21.03	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	228.07	230.44	224.48	211.78	195.75	180.69	170.63	168.26	174.22	186.92	202.95	218.01	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	(71)

Water heating gains (Table 5)

(72)m=	86.01	83.82	78.67	71.86	67.21	60.93	56.15	62.93	65.76	72.78	80.6	83.83	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	398.62	396.51	382	358.91	335.41	312.76	298.48	305.18	317.36	340.68	367.35	386.95	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	449.76	500.62	569.57	666.95	749.48	754.21	711.44	634.4	545.92	467.91	431.7	428.72	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.98	0.9	0.69	0.47	0.34	0.4	0.7	0.96	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.34	20.45	20.64	20.89	20.99	21	21	21	20.99	20.82	20.55	20.33	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.33	20.34	20.34	20.36	20.36	20.38	20.38	20.38	20.37	20.36	20.35	20.35	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.88	0.65	0.43	0.3	0.35	0.64	0.95	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.44	19.6	19.88	20.23	20.35	20.38	20.38	20.38	20.36	20.16	19.76	19.43	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.63	19.78	20.05	20.37	20.49	20.51	20.51	20.51	20.5	20.3	19.93	19.63	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.48	19.63	19.9	20.22	20.34	20.36	20.36	20.36	20.35	20.15	19.78	19.48	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.87	0.65	0.42	0.29	0.35	0.64	0.94	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	448.6	497.44	555.55	583.37	486.8	320.18	209.16	219.2	347.42	440.94	428.72	427.91	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	903.98	872.74	789.61	650.22	493.35	320.37	209.17	219.23	351.28	545.62	731.8	891.13	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	338.8	252.2	174.14	48.14	4.87	0	0	0	0	77.88	218.21	344.64	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1458.88 (98)

Space heating requirement in kWh/m²/year 17.32 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	338.8	252.2	174.14	48.14	4.87	0	0	0	0	77.88	218.21	344.64	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	374.78	278.98	192.63	53.25	5.39	0	0	0	0	86.15	241.39	381.24	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1613.81 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23

Efficiency of water heater 80.3 (216)

(217)m=	86.31	85.89	84.86	82.36	80.56	80.3	80.3	80.3	80.3	83.16	85.44	86.41	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	237.63	210.54	221.81	202.7	200.62	177.28	169.85	189.34	191.43	210.48	218.59	231.73	

Total = Sum(219a)$_{1...12}$ = 2462.01 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1613.81

DER WorkSheet: New dwelling design stage

Water heating fuel used		2462.01	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	197.32		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	227.32	(231)
Electricity for lighting		361.31	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	348.58	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	531.79	(264)
Space and water heating	(261) + (262) + (263) + (264) =				880.38	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	117.98	(267)
Electricity for lighting	(232) x		0.519	=	187.52	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			724.87	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			8.6	(273)
EI rating (section 14)					92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 19

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.63	(1a) x	2.56	(2a) =	183.37	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.37	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	31.08	16.99	14.09	x	0.16	=	2.25			(29)
Walls Type2	25.62	2.42	23.2	x	0.14	=	3.28			(29)
Total area of elements, m²			56.69							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.45 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 633.84 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.39 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.84 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.97	19.71	19.45	18.17	17.91	16.63	16.63	16.37	17.14	17.91	18.43	18.94	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	55.81	55.55	55.29	54.01	53.75	52.46	52.46	52.21	52.98	53.75	54.26	54.78	

Average = Sum(39)$_{1...12}$ /12= 53.94 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.78	0.78	0.77	0.75	0.75	0.73	0.73	0.73	0.74	0.75	0.76	0.76	

Average = Sum(40)$_{1...12}$ /12= 0.75 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.47 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	97.32	93.78	90.24	86.7	83.16	79.62	79.62	83.16	86.7	90.24	93.78	97.32	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1061.64 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	144.32	126.22	130.25	113.55	108.96	94.02	87.13	99.98	101.17	117.91	128.7	139.76	

Total = Sum(45)$_{1...12}$ = 1391.97 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.65	18.93	19.54	17.03	16.34	14.1	13.07	15	15.18	17.69	19.31	20.96	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.59	43.16	45.98	42.76	42.38	39.27	40.57	42.38	42.76	45.98	46.25	49.59	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	

Output from water heater (annual)$_{1...12}$ 1922.64 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.38	52.76	54.8	48.45	46.82	41.08	39.11	43.84	44.33	50.7	54.36	58.87	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.93	15.92	12.95	9.8	7.33	6.19	6.68	8.69	11.66	14.81	17.28	18.42	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.07	203.16	197.9	186.71	172.58	159.3	150.42	148.34	153.6	164.79	178.92	192.2	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	(71)

Water heating gains (Table 5)

(72)m=	81.16	78.51	73.66	67.29	62.93	57.05	52.57	58.92	61.57	68.15	75.49	79.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.43	357.87	344.78	324.07	303.11	282.81	269.96	276.22	287.1	308.02	331.97	350.02	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	411.58	461.97	532.36	632.12	717.19	724.26	682.92	605.44	515.66	435.25	396.33	391.79	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.98	0.89	0.68	0.46	0.34	0.4	0.69	0.96	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.27	20.39	20.61	20.87	20.98	21	21	21	20.99	20.8	20.49	20.25	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.27	20.27	20.28	20.29	20.3	20.31	20.31	20.32	20.31	20.3	20.29	20.28	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.87	0.63	0.41	0.29	0.34	0.63	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.28	19.46	19.78	20.15	20.28	20.31	20.31	20.32	20.3	20.07	19.62	19.27	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.54	19.71	20	20.34	20.47	20.49	20.49	20.5	20.48	20.26	19.85	19.53	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.39	19.56	19.85	20.19	20.32	20.34	20.34	20.35	20.33	20.11	19.7	19.38	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.86	0.64	0.42	0.29	0.34	0.63	0.94	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	410.11	458.08	516.06	544.16	455.8	301.01	196.39	205.95	325.2	407.31	392.84	390.76	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	842.2	814.09	737.87	609.83	463.14	301.3	196.41	206	329.97	511.1	683.88	831.59	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	321.47	239.24	165.02	47.28	5.46	0	0	0	0	77.22	209.55	327.97	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1393.22 (98)

Space heating requirement in kWh/m²/year 19.45 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	321.47	239.24	165.02	47.28	5.46	0	0	0	0	77.22	209.55	327.97	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	355.61	264.64	182.55	52.3	6.04	0	0	0	0	85.42	231.8	362.8	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1541.17 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36

Efficiency of water heater 80.3 (216)

(217)m=	86.32	85.92	84.89	82.44	80.61	80.3	80.3	80.3	80.3	83.28	85.51	86.42	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	224.65	197.14	207.61	189.61	187.73	165.99	159.03	177.28	179.24	196.8	204.6	219.11	

Total = Sum(219a)$_{1...12}$ = 2308.79 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1541.17

DER WorkSheet: New dwelling design stage

Water heating fuel used		2308.79	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	167.79		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	197.79	(231)
Electricity for lighting		316.57	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	332.89	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	498.7	(264)
Space and water heating	(261) + (262) + (263) + (264) =				831.59	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	102.65	(267)
Electricity for lighting	(232) x		0.519	=	164.3	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			637.54	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			8.9	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 20

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	58.62	(1a) x	2.56	(2a) =	150.07	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	58.62	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		150.07	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration		0.25 - [0.2 x (14) ÷ 100] =		0 (15)
Infiltration rate		(8) + (10) + (11) + (12) + (13) + (15) =		0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor		(20) = 1 - [0.075 x (19)] =		0.85 (20)
Infiltration rate incorporating shelter factor		(21) = (18) x (20) =		0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			7.078	x	0.12	=	0.84936			(28)
Walls Type1	37.03	16.99	20.04	x	0.16	=	3.21			(29)
Walls Type2	26.11	2.42	23.69	x	0.14	=	3.35			(29)
Total area of elements, m²			70.22							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.32 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1274.24 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.77 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 39.09 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	16.34	16.13	15.92	14.87	14.66	13.61	13.61	13.4	14.03	14.66	15.08	15.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	55.43	55.22	55.01	53.96	53.75	52.7	52.7	52.49	53.12	53.75	54.17	54.59	

Average = Sum(39)$_{1...12}$ /12= 53.91 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.95	0.94	0.94	0.92	0.92	0.9	0.9	0.9	0.91	0.92	0.92	0.93

Average = Sum(40)$_{1...12}$ /12= 0.92 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.94 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 80.33 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	88.36	85.15	81.94	78.72	75.51	72.3	72.3	75.51	78.72	81.94	85.15	88.36

Total = Sum(44)$_{1...12}$ = 963.97 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	131.04	114.61	118.27	103.11	98.93	85.37	79.11	90.78	91.86	107.06	116.86	126.91

Total = Sum(45)$_{1...12}$ = 1263.92 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.66	17.19	17.74	15.47	14.84	12.81	11.87	13.62	13.78	16.06	17.53	19.04

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	45.03	39.19	41.75	38.82	38.48	35.65	36.84	38.48	38.82	41.75	41.99	45.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94	

Output from water heater (annual)$_{1...12}$ 1745.77 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	54.83	47.91	49.76	43.99	42.52	37.3	35.51	39.8	40.25	46.04	49.36	53.45	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	15.11	13.42	10.91	8.26	6.18	5.21	5.63	7.32	9.83	12.48	14.56	15.53	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	169.45	171.21	166.78	157.35	145.44	134.25	126.77	125.01	129.44	138.88	150.79	161.98	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	(71)

Water heating gains (Table 5)

(72)m=	73.69	71.29	66.88	61.1	57.14	51.81	47.74	53.5	55.9	61.88	68.55	71.85	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	313.39	311.05	299.71	281.84	263.9	246.4	235.28	240.97	250.31	268.37	289.03	304.49	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	364.54	415.16	487.28	589.89	677.97	687.85	648.24	570.19	478.87	395.6	353.39	346.25	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.9	0.7	0.49	0.36	0.42	0.72	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.06	20.21	20.47	20.79	20.96	21	21	21	20.97	20.7	20.33	20.05	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.13	20.13	20.13	20.15	20.15	20.17	20.17	20.17	20.16	20.15	20.15	20.14	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.87	0.65	0.43	0.29	0.35	0.65	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.88	19.08	19.46	19.92	20.12	20.17	20.17	20.17	20.14	19.81	19.28	18.86	(90)

fLA = Living area ÷ (4) = 0.3 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.23	19.42	19.76	20.18	20.37	20.42	20.42	20.42	20.39	20.08	19.59	19.22	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.08	19.27	19.61	20.03	20.22	20.27	20.27	20.27	20.24	19.93	19.44	19.07	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.87	0.65	0.43	0.3	0.36	0.66	0.94	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	362.82	410.83	470.77	510.51	443.26	297.59	193.24	202.91	315.39	371.08	349.74	345.02	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	819.52	793.71	721.35	600.74	458.06	298.59	193.32	203.13	326.01	501.37	668.62	811.57	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	339.78	257.3	186.43	64.97	11.01	0	0	0	0	96.94	229.59	347.11	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1533.14 (98)

Space heating requirement in kWh/m²/year 26.15 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	339.78	257.3	186.43	64.97	11.01	0	0	0	0	96.94	229.59	347.11	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	375.87	284.62	206.23	71.87	12.18	0	0	0	0	107.24	253.98	383.97	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1695.95 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94

Efficiency of water heater 80.3 (216)

(217)m=	86.68	86.34	85.44	83.22	80.97	80.3	80.3	80.3	80.3	84	85.98	86.78	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	203.13	178.14	187.3	170.55	169.71	150.72	144.4	160.97	162.75	177.16	184.76	198.12	

Total = Sum(219a)$_{1...12}$ = 2087.71 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1695.95

DER WorkSheet: New dwelling design stage

Water heating fuel used		2087.71	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	137.31		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	167.31	(231)
Electricity for lighting		266.79	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	366.32	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	450.94	(264)
Space and water heating	(261) + (262) + (263) + (264) =				817.27	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	86.83	(267)
Electricity for lighting	(232) x		0.519	=	138.47	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			581.56	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			9.92	(273)
EI rating (section 14)					92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 21

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.71	(1a) x	2.56	(2a) =	183.58	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.71	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.58	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	54.82	19.88	34.94	x	0.16	=	5.59			(29)
Walls Type2	34.97	2.42	32.55	x	0.14	=	4.6			(29)
Total area of elements, m²			89.79							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.94 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1147.31 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.4 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 46.34 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.99	19.73	19.48	18.19	17.93	16.64	16.64	16.39	17.16	17.93	18.45	18.96	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	66.33	66.07	65.82	64.53	64.27	62.98	62.98	62.73	63.5	64.27	64.79	65.3	

Average = Sum(39)$_{1...12}$ /12= 64.46 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.92	0.92	0.92	0.9	0.9	0.88	0.88	0.87	0.89	0.9	0.9	0.91

Average = Sum(40)$_{1...12}$ /12= 0.9 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.51 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	97.37	93.83	90.28	86.74	83.2	79.66	79.66	83.2	86.74	90.28	93.83	97.37

Total = Sum(44)$_{1...12}$ = 1062.17 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	144.39	126.28	130.31	113.61	109.01	94.07	87.17	100.03	101.22	117.97	128.77	139.83

Total = Sum(45)$_{1...12}$ = 1392.67 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.66	18.94	19.55	17.04	16.35	14.11	13.08	15	15.18	17.69	19.32	20.98

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.62	43.19	46.01	42.78	42.4	39.29	40.6	42.4	42.78	46.01	46.27	49.62	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45	

Output from water heater (annual)$_{1...12}$ 1923.61 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.41	52.79	54.83	48.47	46.85	41.1	39.13	43.86	44.35	50.73	54.38	58.9	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.94	15.94	12.96	9.81	7.33	6.19	6.69	8.7	11.67	14.82	17.3	18.44	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.25	203.34	198.08	186.88	172.73	159.44	150.56	148.47	153.74	164.94	179.08	192.37	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	(71)

Water heating gains (Table 5)

(72)m=	81.2	78.55	73.7	67.32	62.97	57.08	52.6	58.95	61.6	68.18	75.53	79.17	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.7	358.13	345.04	324.31	303.34	283.02	270.15	276.42	287.31	308.24	332.22	350.28	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01		(75)
Northeast	0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51		(75)
Northeast	0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53		(75)
Northeast	0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88		(75)
Northeast	0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19		(75)
Northeast	0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37		(75)
Northeast	0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08		(75)
Northeast	0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37		(75)
Northeast	0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59		(75)
Northeast	0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17		(75)
Northeast	0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05		(75)
Northeast	0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26		(75)
Northeast	0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3		(75)
Northeast	0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04		(75)
Northeast	0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19		(75)
Northeast	0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36		(75)
Northeast	0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35		(75)
Northeast	0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05		(75)
Northeast	0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72		(75)
Southeast	0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37		(77)
Southeast	0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33		(77)
Southeast	0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12		(77)
Southeast	0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93		(77)
Southeast	0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77		(77)
Southeast	0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1		(77)
Southeast	0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83		(77)
Southeast	0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49		(77)
Southeast	0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6		(77)
Southeast	0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41		(77)
Southeast	0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98		(77)
Southeast	0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28		(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	79.52	152.43	253.69	389.97	505.84	532.55	500.79	409.71	300.15	180.64	98.34	66.05	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	440.22	510.57	598.73	714.28	809.18	815.57	770.95	686.14	587.46	488.88	430.55	416.33	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.9	0.71	0.49	0.36	0.42	0.71	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.09	20.24	20.49	20.81	20.96	21	21	21	20.97	20.72	20.35	20.07	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.15	20.15	20.15	20.17	20.17	20.19	20.19	20.19	20.18	20.17	20.16	20.16	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.87	0.65	0.43	0.29	0.35	0.64	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.92	19.15	19.52	19.95	20.14	20.18	20.19	20.19	20.16	19.86	19.32	18.9	(90)

fLA = Living area ÷ (4) = 0.28 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.25	19.45	19.79	20.19	20.37	20.41	20.42	20.42	20.39	20.1	19.61	19.23	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.1	19.3	19.64	20.04	20.22	20.26	20.27	20.27	20.24	19.95	19.46	19.08	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.96	0.86	0.66	0.44	0.3	0.35	0.65	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	438.25	504.94	577.17	616.34	530.65	355.58	230.79	242.37	379.06	455.82	426.05	414.96	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	981.75	951.79	864.96	719.05	547.63	356.7	230.88	242.59	389.81	601.02	800.98	971.72	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	404.37	300.28	214.11	73.95	12.63	0	0	0	0	108.03	269.94	414.23	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1797.55 (98)

Space heating requirement in kWh/m²/year 25.07 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	404.37	300.28	214.11	73.95	12.63	0	0	0	0	108.03	269.94	414.23	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	447.31	332.17	236.85	81.8	13.97	0	0	0	0	119.5	298.61	458.22	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1988.44 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45

Efficiency of water heater 80.3 (216)

(217)m= 86.86 | 86.48 | 85.54 | 83.29 | 81 | 80.3 | 80.3 | 80.3 | 80.3 | 84.03 | 86.14 | 86.97 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 223.36 | 195.97 | 206.13 | 187.77 | 186.94 | 166.07 | 159.11 | 177.37 | 179.33 | 195.14 | 203.21 | 217.84

Total = Sum(219a)$_{1...12}$ = 2298.23 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1988.44	
Water heating fuel used		2298.23	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	184.77		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		214.77	(231)
Electricity for lighting		316.86	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	429.5	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	496.42	(264)
Space and water heating	(261) + (262) + (263) + (264) =			925.92	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	111.47	(267)
Electricity for lighting	(232) x	0.519	=	164.45	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			740.83	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			10.33	(273)
EI rating (section 14)				91	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 22

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.7	(1a) x	2.56	(2a) =	180.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.7	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	54.73	20.19	34.54	x	0.16	=	5.53			(29)
Walls Type2	22.23	2.42	19.81	x	0.14	=	2.8			(29)
Total area of elements, m²			76.96							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 38.48 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 923.92 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.8 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 45.28 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.71	19.46	19.2	17.93	17.68	16.41	16.41	16.16	16.92	17.68	18.19	18.69	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	64.99	64.74	64.48	63.21	62.96	61.69	61.69	61.44	62.2	62.96	63.47	63.97	

Average = Sum(39)$_{1...12}$ /12= 63.15 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.92	0.92	0.91	0.89	0.89	0.87	0.87	0.87	0.88	0.89	0.9	0.9

Average = Sum(40)$_{1...12}$ /12= 0.89 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.94 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.74	93.22	89.7	86.19	82.67	79.15	79.15	82.67	86.19	89.7	93.22	96.74

Total = Sum(44)$_{1...12}$ = 1055.33 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.46	125.47	129.48	112.88	108.31	93.46	86.61	99.38	100.57	117.21	127.94	138.93

Total = Sum(45)$_{1...12}$ = 1383.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.52	18.82	19.42	16.93	16.25	14.02	12.99	14.91	15.09	17.58	19.19	20.84

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.3	42.91	45.71	42.5	42.13	39.03	40.33	42.13	42.5	45.71	45.97	49.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	

Output from water heater (annual)$_{1...12}$ 1911.23 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.03	52.45	54.48	48.16	46.55	40.84	38.88	43.58	44.07	50.4	54.03	58.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.73	15.75	12.81	9.7	7.25	6.12	6.61	8.6	11.54	14.65	17.1	18.23	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.92	200.98	195.78	184.71	170.73	157.59	148.81	146.75	151.95	163.03	177	190.14	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	(71)

Water heating gains (Table 5)

(72)m=	80.68	78.05	73.22	66.89	62.56	56.72	52.26	58.57	61.2	67.74	75.05	78.66	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	357.27	354.72	341.76	321.24	300.48	280.37	267.63	273.86	284.64	305.36	329.09	346.97	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast 0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast 0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast 0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast 0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast 0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast 0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast 0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast 0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast 0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)
Southwest 0.9x	0.77	x	8.06	x	36.79		0.55	x	0.7	=	79.12	(79)
Southwest 0.9x	0.77	x	4.62	x	36.79		0.55	x	0.7	=	90.71	(79)
Southwest 0.9x	0.77	x	8.06	x	62.67		0.55	x	0.7	=	134.78	(79)
Southwest 0.9x	0.77	x	4.62	x	62.67		0.55	x	0.7	=	154.51	(79)
Southwest 0.9x	0.77	x	8.06	x	85.75		0.55	x	0.7	=	184.41	(79)
Southwest 0.9x	0.77	x	4.62	x	85.75		0.55	x	0.7	=	211.4	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	4.62	x	106.25		0.55	x	0.7	=	261.94	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	4.62	x	119.01		0.55	x	0.7	=	293.39	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	4.62	x	118.15		0.55	x	0.7	=	291.27	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	4.62	x	113.91		0.55	x	0.7	=	280.82	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	4.62	x	104.39		0.55	x	0.7	=	257.35	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	4.62	x	92.85		0.55	x	0.7	=	228.91	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	4.62	x	69.27		0.55	x	0.7	=	170.76	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	4.62	x	44.07		0.55	x	0.7	=	108.65	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	4.62	x	31.49		0.55	x	0.7	=	77.63	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	198.2	337.61	461.93	572.36	641.09	636.45	613.61	562.33	500.17	373.13	237.4	169.62	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	555.48	692.33	803.69	893.59	941.57	916.82	881.24	836.19	784.81	678.49	566.49	516.59	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.91	0.79	0.61	0.43	0.31	0.34	0.54	0.85	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.26	20.49	20.72	20.91	20.98	21	21	21	20.99	20.89	20.54	20.22	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.15	20.15	20.16	20.17	20.18	20.19	20.19	20.19	20.18	20.18	20.17	20.16	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.89	0.75	0.56	0.38	0.25	0.28	0.48	0.81	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.17	19.5	19.83	20.08	20.16	20.19	20.19	20.19	20.18	20.06	19.6	19.13	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.47	19.77	20.07	20.31	20.38	20.41	20.41	20.41	20.4	20.28	19.85	19.42	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.32	19.62	19.92	20.16	20.23	20.26	20.26	20.26	20.25	20.13	19.7	19.27	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.89	0.75	0.56	0.38	0.26	0.28	0.48	0.8	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	547.35	661.74	713.96	667.47	530	348.57	225.72	237.18	380.34	544.97	544.89	511.25	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	975.97	952.72	865.36	711.55	537.25	349.07	225.75	237.24	382.53	600.23	799.75	964.25	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	318.89	195.54	112.64	31.73	5.39	0	0	0	0	41.11	183.5	337.04	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1225.84 (98)

Space heating requirement in kWh/m²/year 17.34 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	318.89	195.54	112.64	31.73	5.39	0	0	0	0	41.11	183.5	337.04	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	352.76	216.3	124.6	35.1	5.97	0	0	0	0	45.48	202.99	372.83	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1356.02 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23

Efficiency of water heater 80.3 (216)

(217)m=	86.31	85.43	83.97	81.85	80.61	80.3	80.3	80.3	80.3	82.15	85.19	86.5

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	223.33	197.1	208.63	189.84	186.62	165	158.09	176.23	178.17	198.32	204.15	217.61

Total = Sum(219a)$_{1...12}$ = 2303.09 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1356.02	
Water heating fuel used		2303.09	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	165.6		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		195.6	(231)
Electricity for lighting		313.18	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	292.9	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	497.47	(264)
Space and water heating	(261) + (262) + (263) + (264) =			790.37	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	101.52	(267)
Electricity for lighting	(232) x	0.519	=	162.54	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			593.42	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			8.39	(273)
EI rating (section 14)				93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 23

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.46	(1a) x	2.56	(2a) =	129.18	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.46	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.18	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	24.7	10.95	13.75	x	0.16	=	2.2			(29)
Walls Type2	19.12	2.42	16.7	x	0.14	=	2.36			(29)
Total area of elements, m²			43.82							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 22.47 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 517.65 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.42 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 25.89 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.07	13.89	13.71	12.8	12.62	11.71	11.71	11.53	12.07	12.62	12.98	13.34	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	39.96	39.77	39.59	38.69	38.51	37.6	37.6	37.42	37.96	38.51	38.87	39.23	

Average = Sum(39)$_{1...12}$ /12= 38.64 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.79	0.79	0.78	0.77	0.76	0.75	0.75	0.74	0.75	0.76	0.77	0.78

Average = Sum(40)$_{1...12}$ /12= 0.77 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.66 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.13	79.14	76.15	73.17	70.18	67.2	67.2	70.18	73.17	76.15	79.14	82.13

Total = Sum(44)$_{1...12}$ = 895.94 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.79	106.52	109.92	95.83	91.95	79.35	73.53	84.37	85.38	99.5	108.62	117.95

Total = Sum(45)$_{1...12}$ = 1174.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.37	13.79	11.9	11.03	12.66	12.81	14.93	16.29	17.69

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.85	36.43	38.81	36.08	35.76	33.14	34.24	35.76	36.08	38.81	39.03	41.85	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	

Output from water heater (annual)$_{1...12}$ 1622.57 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.96	44.52	46.25	40.88	39.52	34.67	33.01	37	37.41	42.79	45.87	49.68	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.24	11.76	9.57	7.24	5.41	4.57	4.94	6.42	8.62	10.94	12.77	13.61	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.43	149.97	146.09	137.82	127.39	117.59	111.04	109.5	113.38	121.65	132.08	141.88	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	(71)

Water heating gains (Table 5)

(72)m=	68.49	66.26	62.16	56.78	53.11	48.15	44.37	49.72	51.96	57.51	63.71	66.78	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.72	279.54	269.37	253.41	237.47	221.87	211.9	217.2	225.51	241.65	260.11	273.82	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	85.75	0.55	x	0.7	=	66.12	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25	0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	2.89	x	106.25	0.55	x	0.7	=	81.93	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01	0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	2.89	x	119.01	0.55	x	0.7	=	91.77	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15	0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	2.89	x	118.15	0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91	0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91	0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39	0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39	0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85	0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85	0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27	0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27	0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07	0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07	0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49	0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49	0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	107.49	183.1	250.53	310.42	347.69	345.18	332.79	304.98	271.27	202.37	128.75	91.99	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	389.21	462.65	519.9	563.82	585.17	567.04	544.69	522.18	496.78	444.02	388.86	365.81	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.91	0.78	0.6	0.42	0.3	0.33	0.52	0.83	0.97	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.44	20.62	20.8	20.94	20.99	21	21	21	21	20.93	20.67	20.41	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.26	20.26	20.27	20.28	20.29	20.3	20.3	20.3	20.29	20.29	20.28	20.27	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.89	0.75	0.56	0.38	0.26	0.28	0.47	0.79	0.96	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.52	19.78	20.03	20.22	20.28	20.3	20.3	20.3	20.29	20.22	19.87	19.49	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.82	20.05	20.28	20.46	20.51	20.53	20.53	20.53	20.52	20.45	20.14	19.79	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.67	19.9	20.13	20.31	20.36	20.38	20.38	20.38	20.37	20.3	19.99	19.64	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.98	0.95	0.89	0.75	0.57	0.38	0.26	0.29	0.48	0.79	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	382.76	441.74	462.29	421.54	330.79	217.18	142.12	148.99	237.52	350.33	371.88	361.39	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	614.16	596.66	539.78	441.45	333.52	217.31	142.13	149.01	238.17	373.59	500.84	605.72	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	172.16	104.11	57.65	14.33	2.03	0	0	0	0	17.31	92.85	181.78	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 642.23 (98)

Space heating requirement in kWh/m²/year 12.73 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	172.16	104.11	57.65	14.33	2.03	0	0	0	0	17.31	92.85	181.78	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	190.45	115.16	63.77	15.85	2.25	0	0	0	0	19.14	102.71	201.09	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 710.43 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	

Efficiency of water heater 80.3 (216)

(217)m=	85.18	84.27	82.89	81.19	80.44	80.3	80.3	80.3	80.3	81.31	83.92	85.38	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	192.12	169.64	179.43	162.48	158.77	140.08	134.21	149.61	151.26	170.1	175.94	187.17	

Total = Sum(219a)$_{1...12}$ = 1970.82 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 710.43

DER WorkSheet: New dwelling design stage

Water heating fuel used		1970.82	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.2		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	148.2	(231)
Electricity for lighting		233.89	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	153.45	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	425.7	(264)
Space and water heating	(261) + (262) + (263) + (264) =				579.15	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	76.91	(267)
Electricity for lighting	(232) x		0.519	=	121.39	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			316.45	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			6.27	(273)
EI rating (section 14)					96	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 24

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	49.88	(1a) x	2.56	(2a) =	127.71	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	49.88	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		127.71	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	24.52	10.95	13.57	x	0.16	=	2.17			(29)
Walls Type2	18.94	2.42	16.52	x	0.14	=	2.34			(29)
Total area of elements, m²			43.46							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 22.41 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 511.5 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.41 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 25.82 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	13.91	13.73	13.55	12.65	12.47	11.58	11.58	11.4	11.94	12.47	12.83	13.19	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	39.73	39.55	39.37	38.48	38.3	37.4	37.4	37.22	37.76	38.3	38.66	39.01	

Average = Sum(39)$_{1...12}$ /12= 38.43 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.8	0.79	0.79	0.77	0.77	0.75	0.75	0.75	0.76	0.77	0.77	0.78	

Average = Sum(40)$_{1...12}$ /12= 0.77 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.69 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 74.26 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	81.69	78.72	75.74	72.77	69.8	66.83	66.83	69.8	72.77	75.74	78.72	81.69	

Total = Sum(44)$_{1...12}$ = 891.11 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	121.14	105.95	109.33	95.31	91.46	78.92	73.13	83.92	84.92	98.97	108.03	117.31	

Total = Sum(45)$_{1...12}$ = 1168.39 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	18.17	15.89	16.4	14.3	13.72	11.84	10.97	12.59	12.74	14.85	16.2	17.6	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.63	36.23	38.6	35.89	35.57	32.96	34.06	35.57	35.89	38.6	38.82	41.63	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	

Output from water heater (annual)$_{1...12}$ 1613.83 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.68	44.29	46	40.66	39.3	34.48	32.83	36.8	37.21	42.56	45.62	49.41	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.1	11.64	9.47	7.17	5.36	4.52	4.89	6.35	8.53	10.83	12.63	13.47	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	146.94	148.46	144.62	136.44	126.11	116.41	109.92	108.4	112.24	120.42	130.75	140.45	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	(71)

Water heating gains (Table 5)

(72)m=	68.12	65.9	61.83	56.48	52.83	47.89	44.13	49.46	51.68	57.2	63.37	66.42	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	279.47	277.3	267.21	251.38	235.6	220.12	210.24	215.51	223.75	239.75	258.05	271.64	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	85.75	0.55	x	0.7	=	66.12	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25	0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	2.89	x	106.25	0.55	x	0.7	=	81.93	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01	0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	2.89	x	119.01	0.55	x	0.7	=	91.77	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15	0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	2.89	x	118.15	0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91	0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91	0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39	0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39	0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85	0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85	0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27	0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27	0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07	0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07	0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49	0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49	0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	107.49	183.1	250.53	310.42	347.69	345.18	332.79	304.98	271.27	202.37	128.75	91.99	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	386.96	460.4	517.74	561.8	583.29	565.3	543.03	520.49	495.02	442.11	386.8	363.63	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.91	0.78	0.6	0.42	0.3	0.33	0.52	0.83	0.97	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.44	20.61	20.8	20.94	20.99	21	21	21	21	20.93	20.67	20.41	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.26	20.26	20.26	20.28	20.28	20.3	20.3	20.3	20.29	20.28	20.28	20.27	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.89	0.74	0.56	0.38	0.25	0.28	0.47	0.79	0.96	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.51	19.77	20.03	20.22	20.27	20.3	20.3	20.3	20.29	20.21	19.87	19.48	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.82	20.05	20.28	20.46	20.51	20.53	20.53	20.53	20.52	20.45	20.13	19.79	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.67	19.9	20.13	20.31	20.36	20.38	20.38	20.38	20.37	20.3	19.98	19.64	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.98	0.95	0.89	0.75	0.56	0.38	0.26	0.28	0.48	0.79	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	380.44	439.3	459.77	419.21	328.98	216.03	141.37	148.21	236.24	348.34	369.7	359.16	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	610.59	593.26	536.75	439.03	331.71	216.17	141.38	148.22	236.9	371.55	498.03	602.25	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	171.24	103.46	57.27	14.27	2.03	0	0	0	0	17.27	92.4	180.86	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 638.8 (98)

Space heating requirement in kWh/m²/year 12.81 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	171.24	103.46	57.27	14.27	2.03	0	0	0	0	17.27	92.4	180.86	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	189.42	114.45	63.35	15.79	2.25	0	0	0	0	19.1	102.21	200.07	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 706.64 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	

Efficiency of water heater 80.3 (216)

(217)m=	85.18	84.27	82.88	81.19	80.44	80.3	80.3	80.3	80.3	81.31	83.92	85.38	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	191.08	168.73	178.47	161.6	157.91	139.33	133.49	148.81	150.45	169.18	174.99	186.16	

Total = Sum(219a)$_{1...12}$ = 1960.19 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		706.64

DER WorkSheet: New dwelling design stage

Water heating fuel used		1960.19	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	116.85		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	146.85	(231)
Electricity for lighting		231.44	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	152.63	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	423.4	(264)
Space and water heating	(261) + (262) + (263) + (264) =				576.04	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	76.22	(267)
Electricity for lighting	(232) x		0.519	=	120.12	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			311.36	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			6.24	(273)
EI rating (section 14)					96	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 25

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.49	(1a) x	2.56	(2a) =	129.25	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.49	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.25	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			50.498	x	0.12	=	6.05976			(28)
Walls Type1	15.41	10.95	4.46	x	0.16	=	0.71			(29)
Walls Type2	48.46	2.42	46.04	x	0.14	=	6.51			(29)
Total area of elements, m²			114.36							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.19 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 4645.8 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 2.77 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 33.96 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.08	13.89	13.71	12.81	12.63	11.72	11.72	11.54	12.08	12.63	12.99	13.35	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	48.04	47.85	47.67	46.77	46.59	45.68	45.68	45.5	46.04	46.59	46.95	47.31	

Average = Sum(39)$_{1...12}$ /12= 46.72 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.95	0.95	0.94	0.93	0.92	0.9	0.9	0.9	0.91	0.92	0.93	0.94

Average = Sum(40)$_{1...12}$ /12= 0.93 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.68 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.15	79.16	76.18	73.19	70.2	67.21	67.21	70.2	73.19	76.18	79.16	82.15

Total = Sum(44)$_{1...12}$ = 896.19 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.83	106.55	109.95	95.86	91.98	79.37	73.55	84.4	85.41	99.53	108.65	117.98

Total = Sum(45)$_{1...12}$ = 1175.05 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.38	13.8	11.91	11.03	12.66	12.81	14.93	16.3	17.7

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.86	36.44	38.82	36.09	35.77	33.15	34.25	35.77	36.09	38.82	39.04	41.86	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85	

Output from water heater (annual)$_{1...12}$ 1623.02 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.97	44.54	46.26	40.9	39.53	34.68	33.02	37.01	37.42	42.8	45.88	49.7	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.25	11.77	9.57	7.25	5.42	4.57	4.94	6.42	8.62	10.95	12.78	13.62	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.51	150.05	146.16	137.9	127.46	117.65	111.1	109.56	113.44	121.71	132.15	141.95	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	(71)

Water heating gains (Table 5)

(72)m=	68.51	66.28	62.18	56.8	53.13	48.16	44.38	49.74	51.97	57.53	63.73	66.79	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.84	279.66	269.49	253.51	237.57	221.96	211.99	217.29	225.6	241.75	260.22	273.94	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast 0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast 0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast 0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast 0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast 0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast 0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast 0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast 0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast 0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)
Southwest 0.9x	0.77	x	8.06	x	36.79		0.55	x	0.7	=	79.12	(79)
Southwest 0.9x	0.77	x	8.06	x	62.67		0.55	x	0.7	=	134.78	(79)
Southwest 0.9x	0.77	x	8.06	x	85.75		0.55	x	0.7	=	184.41	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	107.49	183.1	250.53	310.42	347.69	345.18	332.79	304.98	271.27	202.37	128.75	91.99	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	389.33	462.76	520.01	563.93	585.26	567.13	544.78	522.27	496.87	444.12	388.97	365.93	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.86	0.7	0.51	0.37	0.4	0.62	0.89	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.2	20.39	20.62	20.84	20.96	21	21	21	20.98	20.83	20.47	20.17	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.13	20.13	20.15	20.15	20.16	20.16	20.17	20.16	20.15	20.14	20.14	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.83	0.65	0.45	0.3	0.33	0.55	0.86	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.07	19.34	19.66	19.97	20.11	20.16	20.16	20.17	20.15	19.97	19.48	19.03	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.44	19.68	19.97	20.26	20.39	20.43	20.44	20.44	20.42	20.25	19.81	19.4	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.29	19.53	19.82	20.11	20.24	20.28	20.29	20.29	20.27	20.1	19.66	19.25	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.82	0.66	0.46	0.31	0.34	0.56	0.86	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	384.4	448.21	481.36	464.64	384.45	258.44	168.32	176.78	279.97	380.14	377.31	362.49	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	719.85	700.25	635.2	524.15	397.82	259.62	168.41	176.93	284.12	442.52	589.47	712.08	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	249.57	169.37	114.46	42.84	9.95	0	0	0	0	46.41	152.75	260.09	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1045.45 (98)

Space heating requirement in kWh/m²/year 20.71 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	249.57	169.37	114.46	42.84	9.95	0	0	0	0	46.41	152.75	260.09	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	276.08	187.36	126.61	47.39	11	0	0	0	0	51.34	168.98	287.72	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1156.48 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85

Efficiency of water heater 80.3 (216)

(217)m=	86.11	85.48	84.4	82.56	80.95	80.3	80.3	80.3	80.3	82.62	85.14	86.27	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	190.09	167.28	176.27	159.82	157.81	140.12	134.25	149.65	151.31	167.46	173.47	185.29	

Total = Sum(219a)$_{1...12}$ = 1952.82 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1156.48

DER WorkSheet: New dwelling design stage

Water heating fuel used		1952.82	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.27		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	148.27	(231)
Electricity for lighting		234.02	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	249.8	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	421.81	(264)
Space and water heating	(261) + (262) + (263) + (264) =				671.61	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	76.95	(267)
Electricity for lighting	(232) x		0.519	=	121.46	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			409.01	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			8.1	(273)
EI rating (section 14)					94	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 26

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.04	(1a) x	2.56	(2a) =	186.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.04	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	36.47	17.3	19.17	x	0.16	=	3.07			(29)
Walls Type2	41.48	2.42	39.06	x	0.14	=	5.52			(29)
Total area of elements, m²			77.95							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 34.92 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 989.91 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.63 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 39.54 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.36	20.1	19.84	18.53	18.26	16.95	16.95	16.69	17.48	18.26	18.79	19.31	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	59.91	59.64	59.38	58.07	57.81	56.5	56.5	56.23	57.02	57.81	58.33	58.86	

Average = Sum(39)$_{1...12}$ /12= 58 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.82	0.82	0.81	0.8	0.79	0.77	0.77	0.77	0.78	0.79	0.8	0.81

Average = Sum(40)$_{1...12}$ /12= 0.79 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.24 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.17	94.6	91.03	87.46	83.89	80.32	80.32	83.89	87.46	91.03	94.6	98.17

Total = Sum(44)$_{1...12}$ = 1070.92 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.58	127.32	131.39	114.55	109.91	94.84	87.89	100.85	102.06	118.94	129.83	140.99

Total = Sum(45)$_{1...12}$ = 1404.14 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.84	19.1	19.71	17.18	16.49	14.23	13.18	15.13	15.31	17.84	19.47	21.15

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.03	43.54	46.39	43.13	42.75	39.61	40.93	42.75	43.13	46.39	46.65	50.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	

Output from water heater (annual)$_{1...12}$ 1939.46 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.91	53.22	55.28	48.87	47.23	41.44	39.45	44.22	44.72	51.14	54.83	59.38	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.21	16.18	13.16	9.96	7.44	6.29	6.79	8.83	11.85	15.04	17.56	18.72	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.29	206.41	201.06	189.69	175.34	161.84	152.83	150.71	156.05	167.42	181.78	195.27	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	(71)

Water heating gains (Table 5)

(72)m=	81.87	79.2	74.31	67.87	63.48	57.55	53.03	59.44	62.11	68.74	76.15	79.82	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	365.13	362.54	349.29	328.29	307.03	286.45	273.42	279.74	290.77	311.97	336.26	354.57	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	169.83	289.28	395.81	490.43	549.32	545.35	525.77	481.84	428.58	319.72	203.42	145.34	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	534.96	651.83	745.1	818.72	856.35	831.79	799.19	761.58	719.35	631.69	539.67	499.91	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.92	0.8	0.62	0.43	0.31	0.34	0.54	0.85	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.36	20.55	20.76	20.93	20.99	21	21	21	21	20.91	20.61	20.33	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.24	20.24	20.24	20.26	20.26	20.28	20.28	20.28	20.27	20.26	20.25	20.25	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.91	0.76	0.57	0.39	0.26	0.29	0.49	0.81	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.38	19.67	19.96	20.19	20.25	20.28	20.28	20.28	20.27	20.17	19.76	19.35	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.65	19.91	20.18	20.39	20.45	20.47	20.47	20.48	20.47	20.37	20	19.61	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.5	19.76	20.03	20.24	20.3	20.32	20.32	20.33	20.32	20.22	19.85	19.46	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.9	0.76	0.57	0.39	0.26	0.29	0.49	0.81	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	528.41	627.29	670.84	622.78	492.12	323.04	210.33	220.72	353.09	512.21	521.41	495.61	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	910.54	886.32	803.31	658.4	497.23	323.31	210.35	220.74	354.43	556.22	743.46	898.41	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	284.31	174.06	98.56	25.65	3.8	0	0	0	0	32.74	159.88	299.68	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1078.68 (98)

Space heating requirement in kWh/m²/year 14.77 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	284.31	174.06	98.56	25.65	3.8	0	0	0	0	32.74	159.88	299.68	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	314.5	192.55	109.02	28.37	4.2	0	0	0	0	36.22	176.86	331.51	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1193.23 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01

Efficiency of water heater 80.3 (216)

(217)m=	85.99	85.1	83.63	81.58	80.52	80.3	80.3	80.3	80.3	81.81	84.8	86.18	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	227.47	200.79	212.57	193.29	189.6	167.44	160.42	178.83	180.81	202.08	208.1	221.64	

Total = Sum(219a)$_{1...12}$ = 2343.03 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1193.23

DER WorkSheet: New dwelling design stage

Water heating fuel used		2343.03	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	171.09		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	201.09	(231)
Electricity for lighting		321.63	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	257.74	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	506.09	(264)
Space and water heating	(261) + (262) + (263) + (264) =				763.83	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	104.37	(267)
Electricity for lighting	(232) x		0.519	=	166.93	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			574.12	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			7.86	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 27

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.73	(1a) x	2.56	(2a) =	188.75	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.73	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.75	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	31.87	17.3	14.57	x	0.16	=	2.33			(29)
Walls Type2	39.15	2.42	36.73	x	0.14	=	5.2			(29)
Total area of elements, m²			71.02							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.85 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 872.08 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.64 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 38.49 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.55	20.29	20.03	18.7	18.44	17.11	17.11	16.85	17.64	18.44	18.97	19.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	59.05	58.78	58.52	57.19	56.93	55.6	55.6	55.34	56.13	56.93	57.46	57.99	

Average = Sum(39)$_{1...12}$ /12= 57.13 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.8	0.8	0.79	0.78	0.77	0.75	0.75	0.75	0.76	0.77	0.78	0.79

Average = Sum(40)$_{1...12}$ /12= 0.77 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.61 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.57	94.99	91.4	87.82	84.24	80.65	80.65	84.24	87.82	91.4	94.99	98.57

Total = Sum(44)$_{1...12}$ = 1075.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.18	127.85	131.93	115.02	110.37	95.24	88.25	101.27	102.48	119.43	130.37	141.57

Total = Sum(45)$_{1...12}$ = 1409.95 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.93	19.18	19.79	17.25	16.55	14.29	13.24	15.19	15.37	17.91	19.55	21.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.23	43.72	46.58	43.31	42.93	39.77	41.1	42.93	43.31	46.58	46.84	50.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8	

Output from water heater (annual)$_{1...12}$ 1947.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.16	53.44	55.51	49.07	47.43	41.61	39.62	44.4	44.9	51.35	55.06	59.63	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.35	16.3	13.26	10.04	7.5	6.33	6.84	8.89	11.94	15.16	17.69	18.86	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.84	207.98	202.59	191.13	176.67	163.07	153.99	151.86	157.24	168.7	183.16	196.76	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	(71)

Water heating gains (Table 5)

(72)m=	82.21	79.53	74.61	68.15	63.75	57.79	53.25	59.68	62.36	69.03	76.47	80.15	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.4	364.8	351.46	330.32	308.91	288.2	275.08	281.43	292.54	313.88	338.32	356.76	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	169.83	289.28	395.81	490.43	549.32	545.35	525.77	481.84	428.58	319.72	203.42	145.34	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	537.23	654.08	747.27	820.75	858.24	833.54	800.86	763.27	721.12	633.6	541.74	502.1	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.92	0.79	0.61	0.43	0.31	0.33	0.53	0.84	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.38	20.58	20.78	20.94	20.99	21	21	21	21	20.92	20.63	20.35	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.25	20.26	20.26	20.27	20.28	20.29	20.29	20.3	20.29	20.28	20.27	20.27	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.9	0.75	0.56	0.38	0.26	0.28	0.48	0.81	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.44	19.72	20	20.21	20.27	20.29	20.29	20.3	20.28	20.2	19.81	19.4	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.69	19.95	20.21	20.41	20.46	20.48	20.48	20.49	20.48	20.39	20.03	19.66	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.54	19.8	20.06	20.26	20.31	20.33	20.33	20.34	20.33	20.24	19.88	19.51	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.9	0.75	0.57	0.38	0.26	0.29	0.48	0.8	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	530.56	628.78	670.23	618.14	486.12	318.59	207.6	217.8	348.47	509.51	522.85	497.74	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	899.95	875.77	793.43	649.56	490.36	318.8	207.61	217.82	349.54	548.91	734.34	887.61	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	274.83	165.98	91.66	22.62	3.15	0	0	0	0	29.31	152.27	290.06	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1029.88 (98)

Space heating requirement in kWh/m²/year 13.97 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	274.83	165.98	91.66	22.62	3.15	0	0	0	0	29.31	152.27	290.06	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	304.01	183.6	101.39	25.02	3.49	0	0	0	0	32.43	168.44	320.87	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1139.25 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8

Efficiency of water heater 80.3 (216)

(217)m=	85.9	84.97	83.46	81.44	80.48	80.3	80.3	80.3	80.3	81.67	84.67	86.09	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	228.66	201.93	213.88	194.42	190.47	168.13	161.08	179.57	181.55	203.27	209.29	222.79	

Total = Sum(219a)$_{1...12}$ = 2355.04 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1139.25

DER WorkSheet: New dwelling design stage

Water heating fuel used		2355.04	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	172.7		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	202.7	(231)
Electricity for lighting		324.08	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	246.08	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	508.69	(264)
Space and water heating	(261) + (262) + (263) + (264) =				754.77	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	105.2	(267)
Electricity for lighting	(232) x		0.519	=	168.2	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			567.16	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			7.69	(273)
EI rating (section 14)					94	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 28

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	58.88	(1a) x	2.56	(2a) =	150.74	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	58.88	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		150.74	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			6.686	x	0.12	=	0.8023199			(28)
Walls Type1	31.19	15.57	15.62	x	0.16	=	2.5			(29)
Walls Type2	39.09	2.42	36.67	x	0.14	=	5.19			(29)
Total area of elements, m²			76.96							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 32.52 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1390.28 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.41 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 37.93 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	16.42	16.2	15.99	14.94	14.72	13.67	13.67	13.46	14.09	14.72	15.15	15.57	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	54.35	54.13	53.92	52.87	52.65	51.6	51.6	51.39	52.02	52.65	53.08	53.5	

Average = Sum(39)$_{1...12}$ /12= 52.81 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.92	0.92	0.92	0.9	0.89	0.88	0.88	0.87	0.88	0.89	0.9	0.91

Average = Sum(40)$_{1...12}$ /12= 0.9 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.95 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 80.51 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	88.56	85.34	82.12	78.9	75.68	72.46	72.46	75.68	78.9	82.12	85.34	88.56

Total = Sum(44)$_{1...12}$ = 966.12 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	131.33	114.86	118.53	103.34	99.15	85.56	79.29	90.98	92.07	107.3	117.12	127.19

Total = Sum(45)$_{1...12}$ = 1266.73 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.7	17.23	17.78	15.5	14.87	12.83	11.89	13.65	13.81	16.09	17.57	19.08

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	45.13	39.28	41.85	38.91	38.57	35.73	36.92	38.57	38.91	41.85	42.09	45.13	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32	

Output from water heater (annual)$_{1...12}$ 1749.66 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	54.95	48.01	49.87	44.09	42.61	37.38	35.59	39.89	40.34	46.14	49.47	53.57	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	15.17	13.47	10.96	8.29	6.2	5.23	5.66	7.35	9.87	12.53	14.62	15.59	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	170.12	171.89	167.44	157.97	146.01	134.78	127.27	125.51	129.95	139.42	151.38	162.62	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	(71)

Water heating gains (Table 5)

(72)m=	73.86	71.45	67.03	61.23	57.27	51.92	47.84	53.62	56.03	62.01	68.7	72.01	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	314.39	312.05	300.68	282.74	264.73	247.18	236.02	241.72	251.1	269.21	289.95	305.46	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast	0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)
Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast	0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast	0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast	0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast	0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast	0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast	0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast	0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast	0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast	0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)
Southeast	0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	152.85	260.36	356.23	441.39	494.39	490.81	473.2	433.65	385.72	287.75	183.08	130.81	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	467.24	572.41	656.9	724.13	759.12	737.99	709.21	675.38	636.82	556.96	473.03	436.26	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.92	0.8	0.63	0.45	0.32	0.35	0.56	0.85	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.26	20.47	20.71	20.9	20.98	21	21	21	20.99	20.88	20.54	20.22	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.15	20.15	20.15	20.17	20.17	20.19	20.19	20.19	20.18	20.17	20.17	20.16	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.9	0.76	0.58	0.39	0.26	0.29	0.49	0.81	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.17	19.48	19.8	20.07	20.16	20.19	20.19	20.19	20.18	20.05	19.59	19.13	(90)

fLA = Living area ÷ (4) = 0.34 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.54	19.82	20.11	20.35	20.43	20.46	20.46	20.46	20.45	20.33	19.91	19.5	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.39	19.67	19.96	20.2	20.28	20.31	20.31	20.31	20.3	20.18	19.76	19.35	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.9	0.77	0.59	0.4	0.27	0.3	0.5	0.81	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	460.29	548.48	589.41	554.53	444.34	294.08	191.47	201.04	320.32	453.69	455.33	431.59	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	820.12	799.42	725.69	597.26	451.95	294.64	191.51	201.1	322.62	504.36	671.92	810.5	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	267.71	168.63	101.4	30.77	5.66	0	0	0	0	37.7	155.95	281.91	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1049.73 (98)

Space heating requirement in kWh/m²/year 17.83 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	267.71	168.63	101.4	30.77	5.66	0	0	0	0	37.7	155.95	281.91	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	296.14	186.54	112.17	34.04	6.27	0	0	0	0	41.7	172.51	311.85	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1161.21 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32

Efficiency of water heater 80.3 (216)

(217)m= 86.1 | 85.28 | 83.93 | 81.93 | 80.66 | 80.3 | 80.3 | 80.3 | 80.3 | 82.15 | 85 | 86.28 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 204.96 | 180.76 | 191.08 | 173.62 | 170.75 | 151.05 | 144.72 | 161.33 | 163.11 | 181.55 | 187.31 | 199.71

Total = Sum(219a)$_{1...12}$ = 2109.95 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1161.21	
Water heating fuel used		2109.95	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	137.93		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		167.93	(231)
Electricity for lighting		267.84	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	250.82	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	455.75	(264)
Space and water heating	(261) + (262) + (263) + (264) =				706.57	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	87.15	(267)
Electricity for lighting	(232) x		0.519	=	139.01	(268)
Energy saving/generation technologies						
Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			471.73	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			8.01	(273)
EI rating (section 14)					94	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 29

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.42	(1a) x	2.56	(2a) =	187.95	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.42	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.95	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Windows Type 4			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	52.48	23.08	29.4	x	0.16	=	4.7			(29)
Walls Type2	22.71	2.42	20.29	x	0.14	=	2.87			(29)
Total area of elements, m²			75.19							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 41.56 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 844.75 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.24 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 48.81 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.47	20.2	19.94	18.62	18.36	17.04	17.04	16.78	17.57	18.36	18.89	19.41	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	69.27	69.01	68.75	67.43	67.16	65.85	65.85	65.58	66.37	67.16	67.69	68.22	

Average = Sum(39)$_{1...12}$ /12= 67.36 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.94	0.94	0.94	0.92	0.91	0.9	0.9	0.89	0.9	0.91	0.92	0.93

Average = Sum(40)$_{1...12}$ /12= 0.92 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.45 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.39	94.81	91.24	87.66	84.08	80.5	80.5	84.08	87.66	91.24	94.81	98.39

Total = Sum(44)$_{1...12}$ = 1073.36 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.91	127.61	131.69	114.81	110.16	95.06	88.09	101.08	102.29	119.21	130.12	141.31

Total = Sum(45)$_{1...12}$ = 1407.34 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.89	19.14	19.75	17.22	16.52	14.26	13.21	15.16	15.34	17.88	19.52	21.2

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.14	43.64	46.49	43.23	42.85	39.7	41.02	42.85	43.23	46.49	46.76	50.14	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	

Output from water heater (annual)$_{1...12}$ 1943.87 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.05	53.34	55.41	48.98	47.34	41.53	39.54	44.32	44.82	51.26	54.96	59.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.29	16.24	13.21	10	7.48	6.31	6.82	8.86	11.9	15.11	17.63	18.8	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.14	207.27	201.9	190.48	176.07	162.52	153.47	151.34	156.7	168.12	182.54	196.09	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	(71)

Water heating gains (Table 5)

(72)m=	82.06	79.38	74.47	68.03	63.63	57.68	53.15	59.57	62.25	68.9	76.33	80	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	366.38	363.78	350.48	329.41	308.07	287.41	274.33	280.67	291.74	313.02	337.39	355.78	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast	0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast	0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast	0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast	0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast	0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast	0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast	0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast	0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast	0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast	0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast	0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)
Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)
Southwest	0.9x	0.77	x	2.89	x	36.79		0.55	x	0.7	=	28.37	(79)
Southwest	0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	48.33	(79)
Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	66.12	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	81.93	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	91.77	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	44.07	0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49	0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	206.9	355.32	493.84	624.75	711.52	711.54	683.85	618.33	539.05	394.77	248.35	176.72	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	573.28	719.1	844.32	954.16	1019.59	998.95	958.18	899	830.79	707.79	585.74	532.5	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.92	0.78	0.6	0.42	0.3	0.34	0.54	0.85	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.22	20.45	20.7	20.91	20.98	21	21	21	20.99	20.87	20.51	20.18	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.13	20.13	20.14	20.15	20.15	20.17	20.17	20.17	20.16	20.15	20.15	20.14	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.9	0.74	0.55	0.37	0.25	0.28	0.48	0.81	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.1	19.44	19.79	20.06	20.14	20.17	20.17	20.17	20.16	20.03	19.53	19.05	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.38	19.69	20.01	20.27	20.35	20.38	20.38	20.38	20.37	20.24	19.78	19.33	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.23	19.54	19.86	20.12	20.2	20.23	20.23	20.23	20.22	20.09	19.63	19.18	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.89	0.74	0.55	0.37	0.25	0.28	0.49	0.81	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	565.31	688.56	751.06	708.61	563.37	369.97	238.83	251.1	403.44	573.02	564.64	527.29	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1034.23	1010.32	918.77	756.52	570.97	370.49	238.86	251.17	406.05	637.21	847.95	1022.15	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	348.87	216.22	124.78	34.49	5.66	0	0	0	0	47.76	203.98	368.18	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1349.95 (98)

Space heating requirement in kWh/m²/year 18.39 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

DER WorkSheet: New dwelling design stage

Fraction of space heat from main system(s)	(202) = 1 – (201) =	1 (202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1 (204)
Efficiency of main space heating system 1		90.4 (206)
Efficiency of secondary/supplementary heating system, %		0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	348.87	216.22	124.78	34.49	5.66	0	0	0	0	47.76	203.98	368.18	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)	385.92	239.18	138.03	38.16	6.26	0	0	0	0	52.83	225.64	407.28	(211)

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 1493.31 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Output from water heater (calculated above)	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45
(217)m=	86.49	85.64	84.17	81.94	80.62	80.3	80.3	80.3	80.3	82.36	85.41	86.67

Efficiency of water heater: 80.3 (216)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(219)m=	226.68	199.97	211.68	192.87	189.78	167.82	160.79	179.24	181.22	201.19	207.1	220.89

Total = Sum(219a)$_{1...12}$ = 2339.23 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1493.31
Water heating fuel used		2339.23
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	171.97	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		201.97 (231)
Electricity for lighting		322.98 (232)
Electricity generated by PVs		-888.26 (233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216 =	322.55 (261)
Space heating (secondary)	(215) x	0.519 =	0 (263)
Water heating	(219) x	0.216 =	505.27 (264)
Space and water heating	(261) + (262) + (263) + (264) =		827.83 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519 =	104.82 (267)

DER WorkSheet: New dwelling design stage

Electricity for lighting	(232) x	0.519	=	167.63	(268)
Energy saving/generation technologies Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			639.27	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			8.71	(273)
EI rating (section 14)				93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 30

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	72.68	(1a) x	2.56	(2a) =	186.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	72.68	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	55.67	20.19	35.48	x	0.16	=	5.68			(29)
Walls Type2	22.71	2.42	20.29	x	0.14	=	2.87			(29)
Total area of elements, m²			78.38							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 38.7 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 948.04 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.84 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 44.54 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.26	20	19.74	18.43	18.17	16.87	16.87	16.61	17.39	18.17	18.7	19.22	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	64.8	64.54	64.28	62.97	62.71	61.41	61.41	61.15	61.93	62.71	63.23	63.76	

Average = Sum(39)$_{1...12}$ /12= 62.91 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.89	0.89	0.88	0.87	0.86	0.84	0.84	0.84	0.85	0.86	0.87	0.88	

Average = Sum(40)$_{1...12}$ /12= 0.87 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.31 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.05 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	97.95	94.39	90.83	87.26	83.7	80.14	80.14	83.7	87.26	90.83	94.39	97.95	

Total = Sum(44)$_{1...12}$ = 1068.55 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	145.26	127.04	131.1	114.29	109.67	94.63	87.69	100.63	101.83	118.67	129.54	140.67	

Total = Sum(45)$_{1...12}$ = 1401.04 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.79	19.06	19.66	17.14	16.45	14.2	13.15	15.09	15.27	17.8	19.43	21.1	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.91	43.44	46.28	43.03	42.65	39.52	40.84	42.65	43.03	46.28	46.55	49.91	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59	

Output from water heater (annual)$_{1...12}$ 1935.17 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.78	53.1	55.16	48.76	47.13	41.35	39.37	44.12	44.62	51.03	54.71	59.25	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.14	16.11	13.1	9.92	7.41	6.26	6.76	8.79	11.8	14.98	17.49	18.64	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	203.46	205.57	200.25	188.92	174.63	161.19	152.21	150.1	155.42	166.75	181.05	194.48	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	(71)

Water heating gains (Table 5)

(72)m=	81.69	79.02	74.14	67.72	63.34	57.43	52.91	59.3	61.97	68.59	75.99	79.64	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	363.93	361.34	348.13	327.21	306.03	285.51	272.53	278.84	289.83	310.96	335.16	353.41	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)
Northwest 0.9x	0.77	x	8.06	x	11.28	x	0.55	x	0.7	=	24.26	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	8.06	x	22.97	x	0.55	x	0.7	=	49.39	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	8.06	x	41.38	x	0.55	x	0.7	=	88.98	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	8.06	x	67.96	x	0.55	x	0.7	=	146.14	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	8.06	x	91.35	x	0.55	x	0.7	=	196.43	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	8.06	x	97.38	x	0.55	x	0.7	=	209.42	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	8.06	x	91.1	x	0.55	x	0.7	=	195.91	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	8.06	x	72.63	x	0.55	x	0.7	=	156.18	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	8.06	x	50.42	x	0.55	x	0.7	=	108.43	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	8.06	x	28.07	x	0.55	x	0.7	=	60.36	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	8.06	x	14.2	x	0.55	x	0.7	=	30.53	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	8.06	x	9.21	x	0.55	x	0.7	=	19.81	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	80.45	154.33	257.11	395.59	513.39	540.6	508.33	415.72	304.32	182.96	99.51	66.81	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	444.38	515.68	605.25	722.8	819.42	826.12	780.86	694.56	594.15	493.92	434.67	420.22	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.89	0.69	0.47	0.35	0.4	0.69	0.95	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.13	20.29	20.54	20.83	20.97	21	21	21	20.98	20.75	20.39	20.11	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.17	20.18	20.18	20.2	20.2	20.21	20.21	20.22	20.21	20.2	20.19	20.19	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.86	0.64	0.42	0.28	0.34	0.62	0.93	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.01	19.23	19.6	20.01	20.17	20.21	20.21	20.22	20.19	19.92	19.4	18.99	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.29	19.5	19.83	20.22	20.38	20.41	20.41	20.41	20.39	20.13	19.65	19.28	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.14	19.35	19.68	20.07	20.23	20.26	20.26	20.26	20.24	19.98	19.5	19.13	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.96	0.85	0.64	0.42	0.29	0.34	0.63	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	442.37	509.79	581.99	615.67	521.83	346.91	224.87	236.18	372.27	457.93	429.96	418.83	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	961.94	932.56	847.41	703.4	534.64	347.65	224.92	236.33	380.32	588.15	784.2	951.57	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	386.56	284.1	197.47	63.17	9.54	0	0	0	0	96.88	255.06	396.37	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1689.14 (98)

Space heating requirement in kWh/m²/year 23.24 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	386.56	284.1	197.47	63.17	9.54	0	0	0	0	96.88	255.06	396.37	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	427.61	314.27	218.44	69.87	10.55	0	0	0	0	107.17	282.14	438.46	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1868.52 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59

Efficiency of water heater 80.3 (216)

(217)m=	86.74	86.33	85.32	82.96	80.83	80.3	80.3	80.3	80.3	83.76	85.98	86.85

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	225.01	197.49	207.9	189.66	188.44	167.07	160.07	178.43	180.41	196.94	204.8	219.44

Total = Sum(219a)$_{1...12}$ = 2315.64 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1868.52	
Water heating fuel used		2315.64	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	170.24		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		200.24	(231)
Electricity for lighting		320.33	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	403.6	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	500.18	(264)
Space and water heating	(261) + (262) + (263) + (264) =			903.78	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	103.92	(267)
Electricity for lighting	(232) x	0.519	=	166.25	(268)
Energy saving/generation technologies Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			712.95	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			9.81	(273)
EI rating (section 14)				92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 31

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	66.61	(1a) x	2.56	(2a) =	170.53	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	66.61	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		170.53	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x	1/[1/(1.4)+ 0.04]	=	10.69			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	31.65	14.38	17.27	x	0.16	=	2.76			(29)
Walls Type2	32.4	2.42	29.98	x	0.14	=	4.24			(29)
Total area of elements, m²			64.05							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 29.46 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 803.18 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.17 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 33.63 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	18.57	18.33	18.09	16.9	16.66	15.46	15.46	15.22	15.94	16.66	17.14	17.61	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	52.2	51.96	51.72	50.53	50.29	49.09	49.09	48.85	49.57	50.29	50.77	51.24	

Average = Sum(39)$_{1...12}$ /12= 50.47 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.78	0.78	0.78	0.76	0.75	0.74	0.74	0.73	0.74	0.75	0.76	0.77

Average = Sum(40)$_{1...12}$ /12= 0.76 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.16 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 85.53 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	94.08	90.66	87.24	83.82	80.4	76.98	76.98	80.4	83.82	87.24	90.66	94.08

Total = Sum(44)$_{1...12}$ = 1026.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	139.52	122.03	125.92	109.78	105.34	90.9	84.23	96.65	97.81	113.99	124.43	135.12

Total = Sum(45)$_{1...12}$ = 1345.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	20.93	18.3	18.89	16.47	15.8	13.63	12.63	14.5	14.67	17.1	18.66	20.27

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.94	41.73	44.46	41.34	40.97	37.96	39.23	40.97	41.34	44.46	44.71	47.94	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06	

Output from water heater (annual)$_{1...12}$ 1858.74 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	58.38	51.01	52.98	46.84	45.27	39.71	37.81	42.38	42.86	49.01	52.55	56.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.89	15	12.2	9.24	6.91	5.83	6.3	8.19	10.99	13.95	16.29	17.36	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	189.27	191.24	186.29	175.75	162.45	149.95	141.6	139.63	144.58	155.12	168.42	180.92	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	(71)

Water heating gains (Table 5)

(72)m=	78.46	75.9	71.21	65.05	60.84	55.16	50.82	56.96	59.52	65.88	72.98	76.5	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	343.05	340.56	328.12	308.46	288.62	269.35	257.14	263.2	273.51	293.37	316.11	333.2	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	8.06	x	11.28	x	0.55	x	0.7	=	24.26	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	8.06	x	22.97	x	0.55	x	0.7	=	49.39	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	8.06	x	41.38	x	0.55	x	0.7	=	88.98	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	8.06	x	67.96	x	0.55	x	0.7	=	146.14	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	8.06	x	91.35	x	0.55	x	0.7	=	196.43	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	8.06	x	97.38	x	0.55	x	0.7	=	209.42	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	8.06	x	91.1	x	0.55	x	0.7	=	195.91	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	8.06	x	72.63	x	0.55	x	0.7	=	156.18	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	8.06	x	50.42	x	0.55	x	0.7	=	108.43	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	8.06	x	28.07	x	0.55	x	0.7	=	60.36	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	8.06	x	14.2	x	0.55	x	0.7	=	30.53	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	8.06	x	9.21	x	0.55	x	0.7	=	19.81	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	43.29	88.12	158.76	260.72	350.46	373.63	349.52	278.64	193.45	107.68	54.47	35.35	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	386.33	428.67	486.88	569.18	639.08	642.99	606.66	541.85	466.96	401.06	370.58	368.55	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.98	0.91	0.71	0.49	0.36	0.41	0.71	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.27	20.38	20.59	20.85	20.98	21	21	21	20.98	20.79	20.49	20.25	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.27	20.27	20.27	20.29	20.29	20.31	20.31	20.31	20.3	20.29	20.29	20.28	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.88	0.66	0.44	0.3	0.35	0.65	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.28	19.45	19.75	20.13	20.27	20.31	20.31	20.31	20.29	20.05	19.62	19.27	(90)

fLA = Living area ÷ (4) = 0.37 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.64	19.79	20.06	20.39	20.53	20.56	20.56	20.56	20.55	20.32	19.94	19.63	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.49	19.64	19.91	20.24	20.38	20.41	20.41	20.41	20.4	20.17	19.79	19.48	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.88	0.67	0.44	0.31	0.36	0.66	0.94	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	384.95	425.27	473.73	500.65	427.01	284.86	187.13	196.03	306.2	377.53	367.39	367.56	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	792.9	765.85	693.46	573.13	436.58	285.29	187.15	196.1	312.04	481.38	644.07	783	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	303.51	228.87	163.48	52.18	7.11	0	0	0	0	77.27	199.21	309.09	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1340.72 (98)

Space heating requirement in kWh/m²/year 20.13 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	303.51	228.87	163.48	52.18	7.11	0	0	0	0	77.27	199.21	309.09	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	335.74	253.18	180.84	57.72	7.87	0	0	0	0	85.47	220.36	341.91	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1483.1 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06

Efficiency of water heater 80.3 (216)

(217)m=	86.26	85.89	84.95	82.67	80.72	80.3	80.3	80.3	80.3	83.35	85.46	86.36	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	217.33	190.65	200.57	182.79	181.26	160.47	153.74	171.39	173.28	190.09	197.9	211.98	

Total = Sum(219a)$_{1...12}$ = 2231.44 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1483.1

DER WorkSheet: New dwelling design stage

Water heating fuel used			2231.44	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		156.04		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		186.04	(231)
Electricity for lighting			298.32	(232)
Electricity generated by PVs			-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

		Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	320.35	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	481.99	(264)
Space and water heating	(261) + (262) + (263) + (264) =				802.34	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	96.55	(267)
Electricity for lighting	(232)	x	0.519	=	154.83	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =				592.72	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =				8.9	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 32

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.61	(1a) x	2.56	(2a) =	132.12	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.61	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		132.12	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	25.19	9.48	15.71	x	0.16	=	2.51			(29)
Walls Type2	25.13	2.42	22.71	x	0.14	=	3.21			(29)
Total area of elements, m²			50.32							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 21.68 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 653.12 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.36 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 25.04 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.39	14.2	14.02	13.09	12.91	11.98	11.98	11.79	12.35	12.91	13.28	13.65	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	39.43	39.24	39.05	38.13	37.94	37.02	37.02	36.83	37.39	37.94	38.31	38.68	

Average = Sum(39)$_{1...12}$ /12= 38.08 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.76	0.76	0.76	0.74	0.74	0.72	0.72	0.71	0.72	0.74	0.74	0.75

Average = Sum(40)$_{1...12}$ /12= 0.74 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.47 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	83.01	79.99	76.98	73.96	70.94	67.92	67.92	70.94	73.96	76.98	79.99	83.01

Total = Sum(44)$_{1...12}$ = 905.59 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	123.1	107.67	111.1	96.86	92.94	80.2	74.32	85.28	86.3	100.58	109.79	119.22

Total = Sum(45)$_{1...12}$ = 1187.37 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.47	16.15	16.67	14.53	13.94	12.03	11.15	12.79	12.95	15.09	16.47	17.88

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.3	36.82	39.23	36.47	36.15	33.49	34.61	36.15	36.47	39.23	39.45	42.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52	

Output from water heater (annual)$_{1...12}$ 1640.04 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.51	45	46.75	41.32	39.94	35.04	33.36	37.39	37.81	43.25	46.37	50.22	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.74	12.21	9.93	7.52	5.62	4.74	5.12	6.66	8.94	11.35	13.25	14.13	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.41	152.98	149.02	140.59	129.95	119.95	113.27	111.7	115.66	124.09	134.73	144.73	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	(71)

Water heating gains (Table 5)

(72)m=	69.23	66.97	62.83	57.4	53.68	48.67	44.84	50.26	52.52	58.13	64.4	67.5	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	286.45	284.22	273.84	257.57	241.32	225.43	215.3	220.68	229.18	245.63	264.44	278.41	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	9.51	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	19.36	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	34.89	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	57.29	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	77.01	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	82.11	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	76.81	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	61.23	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	42.51	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	23.66	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	11.97	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	7.77	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	28.54	58.09	104.66	171.88	231.04	246.32	230.42	183.7	127.53	70.99	35.91	23.31	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	314.98	342.31	378.5	429.45	472.36	471.74	445.73	404.38	356.71	316.62	300.35	301.72	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.91	0.72	0.5	0.37	0.42	0.7	0.95	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.33	20.43	20.62	20.86	20.98	21	21	21	20.99	20.82	20.54	20.32	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.28	20.29	20.29	20.31	20.31	20.33	20.33	20.33	20.32	20.31	20.3	20.3	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.88	0.68	0.45	0.31	0.36	0.64	0.93	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.38	19.53	19.8	20.15	20.29	20.32	20.33	20.33	20.31	20.1	19.7	19.37	(90)

fLA = Living area ÷ (4) = 0.47 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.83	19.96	20.19	20.49	20.62	20.64	20.65	20.65	20.63	20.44	20.1	19.82	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.68	19.81	20.04	20.34	20.47	20.49	20.5	20.5	20.48	20.29	19.95	19.67	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.89	0.69	0.46	0.32	0.37	0.66	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	313.49	339.08	367.84	380.31	324.54	217.81	144.17	150.83	234.36	295.85	297.01	300.61	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	606.26	584.92	528.78	436.01	332.58	218.19	144.19	150.89	238.54	367.69	492.33	598.42	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	217.82	165.2	119.74	40.1	5.99	0	0	0	0	53.45	140.63	221.56	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 964.49 (98)

Space heating requirement in kWh/m²/year 18.69 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	217.82	165.2	119.74	40.1	5.99	0	0	0	0	53.45	140.63	221.56	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	240.95	182.75	132.46	44.36	6.62	0	0	0	0	59.13	155.56	245.09	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1066.92 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52

Efficiency of water heater 80.3 (216)

(217)m=	85.75	85.39	84.48	82.43	80.7	80.3	80.3	80.3	80.3	82.86	84.9	85.85	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	192.91	169.21	177.94	161.76	159.97	141.59	135.65	151.22	152.89	168.72	175.77	188.15	

Total = Sum(219a)$_{1...12}$ = 1975.78 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1066.92

DER WorkSheet: New dwelling design stage

Water heating fuel used		1975.78	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	120.89		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	150.89	(231)
Electricity for lighting		242.71	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	230.45	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	426.77	(264)
Space and water heating	(261) + (262) + (263) + (264) =				657.22	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	78.31	(267)
Electricity for lighting	(232) x		0.519	=	125.97	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			400.49	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			7.76	(273)
EI rating (section 14)					94	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 33

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.63	(1a) x	2.56	(2a) =	129.62	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.62	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	24.86	9.48	15.38	x	0.16	=	2.46			(29)
Walls Type2	19.11	2.42	16.69	x	0.14	=	2.36			(29)
Total area of elements, m²			43.97							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 20.78 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 545.17 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.3 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 24.08 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.12	13.93	13.75	12.84	12.66	11.75	11.75	11.57	12.12	12.66	13.02	13.39	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	38.19	38.01	37.83	36.92	36.74	35.83	35.83	35.65	36.19	36.74	37.1	37.47	

Average = Sum(39)$_{1...12}$ /12= 36.88 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.75	0.75	0.75	0.73	0.73	0.71	0.71	0.7	0.71	0.73	0.73	0.74	

Average = Sum(40)$_{1...12}$ /12= 0.73 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.71 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.78 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	82.26	79.27	76.28	73.29	70.29	67.3	67.3	70.29	73.29	76.28	79.27	82.26	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 897.38 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	121.99	106.69	110.1	95.98	92.1	79.48	73.65	84.51	85.52	99.66	108.79	118.14	

Total = Sum(45)$_{1...12}$ = 1176.6 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	18.3	16	16.51	14.4	13.81	11.92	11.05	12.68	12.83	14.95	16.32	17.72	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.92	36.49	38.87	36.14	35.82	33.19	34.3	35.82	36.14	38.87	39.09	41.92	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06	

Output from water heater (annual)$_{1...12}$ 1625.17 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.04	44.6	46.32	40.95	39.58	34.72	33.06	37.05	37.47	42.86	45.95	49.76	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.48	11.97	9.73	7.37	5.51	4.65	5.02	6.53	8.77	11.13	12.99	13.85	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.87	150.42	146.52	138.24	127.78	117.94	111.37	109.83	113.72	122.01	132.47	142.3	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	(71)

Water heating gains (Table 5)

(72)m=	68.6	66.36	62.26	56.88	53.2	48.23	44.44	49.8	52.04	57.6	63.81	66.88	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	282.58	280.38	270.15	254.11	238.11	222.45	212.47	217.8	226.16	242.37	260.91	274.67	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	9.51	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	19.36	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	34.89	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	57.29	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	77.01	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	82.11	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	76.81	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	61.23	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	42.51	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	23.66	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	11.97	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	7.77	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	28.54	58.09	104.66	171.88	231.04	246.32	230.42	183.7	127.53	70.99	35.91	23.31	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	311.12	338.47	374.81	425.99	469.15	468.77	442.89	401.49	353.69	313.36	296.82	297.97	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.9	0.71	0.49	0.36	0.41	0.69	0.95	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.35	20.45	20.64	20.87	20.98	21	21	21	20.99	20.83	20.56	20.33	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.29	20.3	20.3	20.32	20.32	20.33	20.33	20.34	20.33	20.32	20.31	20.31	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.88	0.66	0.44	0.3	0.35	0.63	0.93	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.41	19.56	19.84	20.17	20.3	20.33	20.33	20.34	20.32	20.12	19.73	19.41	(90)

fLA = Living area ÷ (4) = 0.48 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.86	19.99	20.22	20.51	20.63	20.66	20.66	20.66	20.64	20.47	20.13	19.85	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.71	19.84	20.07	20.36	20.48	20.51	20.51	20.51	20.49	20.32	19.98	19.7	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.99	0.97	0.88	0.67	0.45	0.32	0.36	0.64	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	309.56	335.07	363.44	373.7	315.92	211.29	139.93	146.38	227.93	291.33	293.3	296.83	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	588.68	567.97	513.48	423.15	322.55	211.58	139.95	146.42	231.38	356.94	477.94	580.91	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	207.66	156.51	111.63	35.6	4.94	0	0	0	0	48.81	132.94	211.36	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 909.45 (98)

Space heating requirement in kWh/m²/year 17.96 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	207.66	156.51	111.63	35.6	4.94	0	0	0	0	48.81	132.94	211.36	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	229.71	173.13	123.48	39.38	5.46	0	0	0	0	54	147.06	233.8	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1006.03 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06

Efficiency of water heater 80.3 (216)

(217)m=	85.65	85.28	84.34	82.25	80.63	80.3	80.3	80.3	80.3	82.71	84.78	85.75	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	191.37	167.9	176.63	160.64	158.64	140.31	134.42	149.85	151.51	167.5	174.42	186.65	

Total = Sum(219a)$_{1...12}$ = 1959.84 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1006.03

DER WorkSheet: New dwelling design stage

Water heating fuel used		1959.84	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.6		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	148.6	(231)
Electricity for lighting		237.98	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	217.3	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	423.33	(264)
Space and water heating	(261) + (262) + (263) + (264) =				640.63	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	77.12	(267)
Electricity for lighting	(232) x		0.519	=	123.51	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			380.26	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			7.51	(273)
EI rating (section 14)					95	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 34

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.03	(1a) x	2.56	(2a) =	130.63	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.03	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.63	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Walls Type1	25.06	9.48	15.58	x	0.16	=	2.49			(29)
Walls Type2	19.31	2.42	16.89	x	0.14	=	2.39			(29)
Total area of elements, m²			44.37							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 20.84 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 551.97 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.34 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 24.18 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.23	14.04	13.86	12.94	12.76	11.84	11.84	11.66	12.21	12.76	13.13	13.49	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	38.4	38.22	38.04	37.12	36.94	36.02	36.02	35.84	36.39	36.94	37.3	37.67	

Average = Sum(39)$_{1...12}$ /12= 37.08 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.75	0.75	0.75	0.73	0.72	0.71	0.71	0.7	0.71	0.72	0.73	0.74

Average = Sum(40)$_{1...12}$ /12= 0.73 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.06 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.56	79.56	76.56	73.56	70.55	67.55	67.55	70.55	73.56	76.56	79.56	82.56

Total = Sum(44)$_{1...12}$ = 900.7 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.44	107.09	110.5	96.34	92.44	79.77	73.92	84.82	85.83	100.03	109.19	118.58

Total = Sum(45)$_{1...12}$ = 1180.95 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.37	16.06	16.58	14.45	13.87	11.97	11.09	12.72	12.88	15	16.38	17.79

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.07	36.62	39.01	36.27	35.95	33.31	34.42	35.95	36.27	39.01	39.24	42.07	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65	

Output from water heater (annual)$_{1...12}$ 1631.18 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.23	44.76	46.5	41.1	39.72	34.85	33.18	37.19	37.61	43.01	46.12	49.95	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.58	12.06	9.81	7.43	5.55	4.69	5.07	6.58	8.84	11.22	13.1	13.96	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.9	151.45	147.53	139.19	128.66	118.76	112.14	110.59	114.51	122.85	133.38	143.28	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	(71)

Water heating gains (Table 5)

(72)m=	68.86	66.61	62.49	57.09	53.39	48.4	44.6	49.99	52.23	57.81	64.05	67.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	284.14	281.93	271.65	255.51	239.41	223.65	213.61	218.96	227.38	243.69	262.33	276.18	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	9.51	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	19.36	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	34.89	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	57.29	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	77.01	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	82.11	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	76.81	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	61.23	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	42.51	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	23.66	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	11.97	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	7.77	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	28.54	58.09	104.66	171.88	231.04	246.32	230.42	183.7	127.53	70.99	35.91	23.31	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	312.68	340.02	376.3	427.39	470.45	469.97	444.04	402.66	354.91	314.68	298.24	299.49	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.9	0.71	0.49	0.36	0.41	0.69	0.95	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.35	20.45	20.64	20.87	20.98	21	21	21	20.99	20.83	20.56	20.34	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.29	20.3	20.3	20.32	20.32	20.34	20.34	20.34	20.33	20.32	20.31	20.31	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.88	0.66	0.44	0.3	0.35	0.63	0.93	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.41	19.57	19.84	20.17	20.3	20.33	20.34	20.34	20.32	20.13	19.74	19.41	(90)

fLA = Living area ÷ (4) = 0.48 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.86	19.99	20.22	20.51	20.63	20.65	20.65	20.66	20.64	20.46	20.13	19.85	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.71	19.84	20.07	20.36	20.48	20.5	20.5	20.51	20.49	20.31	19.98	19.7	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.88	0.67	0.45	0.32	0.37	0.65	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	311.13	336.65	365.02	375.39	317.51	212.36	140.62	147.1	229.08	292.72	294.75	298.35	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	591.85	571.01	516.2	425.36	324.23	212.65	140.64	147.14	232.56	358.8	480.48	584.02	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	208.86	157.49	112.48	35.98	5	0	0	0	0	49.16	133.72	212.54	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 915.24 (98)

Space heating requirement in kWh/m²/year 17.94 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	208.86	157.49	112.48	35.98	5	0	0	0	0	49.16	133.72	212.54	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	231.03	174.22	124.42	39.8	5.53	0	0	0	0	54.38	147.93	235.12	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1012.43 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65

Efficiency of water heater 80.3 (216)

(217)m=	85.65	85.28	84.35	82.26	80.64	80.3	80.3	80.3	80.3	82.71	84.79	85.76	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	192.07	168.51	177.27	161.21	159.22	140.82	134.92	150.41	152.07	168.1	175.05	187.33	

Total = Sum(219a)$_{1...12}$ = 1966.99 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1012.43

DER WorkSheet: New dwelling design stage

Water heating fuel used		1966.99	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	119.52		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	149.52	(231)
Electricity for lighting		239.88	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	218.68	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	424.87	(264)
Space and water heating	(261) + (262) + (263) + (264) =				643.55	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	77.6	(267)
Electricity for lighting	(232) x		0.519	=	124.5	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			384.65	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			7.54	(273)
EI rating (section 14)					95	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 35

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.86	(1a) x	2.56	(2a) =	183.97	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.86	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.97	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Walls Type1	36.57	12.64	23.93	x	0.16	=	3.83			(29)
Walls Type2	26	2.42	23.58	x	0.14	=	3.33			(29)
Total area of elements, m²			62.57							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 27.31 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 807.6 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.88 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 32.19 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.03	19.78	19.52	18.23	17.97	16.68	16.68	16.42	17.2	17.97	18.49	19	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	52.22	51.96	51.7	50.41	50.16	48.87	48.87	48.61	49.38	50.16	50.67	51.19	

Average = Sum(39)$_{1...12}$ /12= 50.35 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.73	0.72	0.72	0.7	0.7	0.68	0.68	0.68	0.69	0.7	0.71	0.71	
Average = Sum(40)$_{1...12}$ /12=													0.7 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.6 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	97.46	93.91	90.37	86.83	83.28	79.74	79.74	83.28	86.83	90.37	93.91	97.46	
Total = Sum(44)$_{1...12}$ =													1063.18 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	144.53	126.41	130.44	113.72	109.12	94.16	87.25	100.12	101.32	118.08	128.89	139.97	
Total = Sum(45)$_{1...12}$ =													1394 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.68	18.96	19.57	17.06	16.37	14.12	13.09	15.02	15.2	17.71	19.33	21	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.66	43.23	46.05	42.82	42.44	39.32	40.63	42.44	42.82	46.05	46.31	49.66	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63	

Output from water heater (annual)$_{1...12}$ 1925.45 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.47	52.84	54.88	48.52	46.89	41.14	39.17	43.9	44.39	50.77	54.43	58.96	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.43	16.37	13.31	10.08	7.53	6.36	6.87	8.93	11.99	15.22	17.77	18.94	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.6	203.7	198.42	187.2	173.03	159.72	150.82	148.73	154	165.23	179.39	192.71	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	(71)

Water heating gains (Table 5)

(72)m=	81.28	78.63	73.77	67.38	63.03	57.14	52.65	59.01	61.66	68.24	75.6	79.24	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	361.67	359.04	345.86	325.02	303.95	283.57	270.7	277.03	288.01	309.05	333.12	351.24	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	38.05	77.45	139.55	229.18	308.06	328.42	307.23	244.93	170.04	94.65	47.88	31.07	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	399.72	436.5	485.41	554.19	612.01	611.99	577.93	521.95	458.04	403.7	381	382.32	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.92	0.74	0.51	0.37	0.43	0.72	0.96	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.33	20.43	20.62	20.86	20.98	21	21	21	20.99	20.81	20.54	20.32	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.32	20.32	20.32	20.34	20.34	20.36	20.36	20.36	20.35	20.34	20.34	20.33	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.9	0.69	0.46	0.32	0.37	0.66	0.95	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.41	19.56	19.83	20.18	20.32	20.36	20.36	20.36	20.34	20.12	19.73	19.41	(90)

fLA = Living area ÷ (4) = 0.34 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.72	19.86	20.1	20.41	20.55	20.58	20.58	20.58	20.56	20.36	20	19.72	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.57	19.71	19.95	20.26	20.4	20.43	20.43	20.43	20.41	20.21	19.85	19.57	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.9	0.7	0.46	0.32	0.38	0.67	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	398.49	433.63	474.76	497.49	426.17	284.31	186.99	195.78	306.42	382.05	378.1	381.44	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	797.57	769.34	695.24	572.68	436.15	284.7	187.01	195.84	311.67	481.88	646.26	786.66	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	296.92	225.6	164.04	54.14	7.42	0	0	0	0	74.28	193.08	301.48	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1316.96 (98)

Space heating requirement in kWh/m²/year 18.33 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	296.92	225.6	164.04	54.14	7.42	0	0	0	0	74.28	193.08	301.48	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	328.45	249.55	181.46	59.89	8.21	0	0	0	0	82.16	213.59	333.5	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1456.81 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63

Efficiency of water heater 80.3 (216)

(217)m=	86.12	85.77	84.87	82.67	80.72	80.3	80.3	80.3	80.3	83.2	85.3	86.21	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	225.5	197.78	207.96	189.34	187.75	166.23	159.26	177.54	179.5	197.28	205.41	219.96	

Total = Sum(219a)$_{1...12}$ = 2313.51 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1456.81

DER WorkSheet: New dwelling design stage

Water heating fuel used		2313.51	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	168.33		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	198.33	(231)
Electricity for lighting		325.42	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	314.67	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	499.72	(264)
Space and water heating	(261) + (262) + (263) + (264) =				814.39	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	102.93	(267)
Electricity for lighting	(232) x		0.519	=	168.89	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			625.21	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			8.7	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 36

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.76	(1a) x	2.56	(2a) =	188.83	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.76	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.83	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 3			4.31	x	1/[1/(1.4)+ 0.04]	=	5.71			(27)
Walls Type1	56.59	19.87	36.72	x	0.16	=	5.87			(29)
Walls Type2	12.58	2.42	10.16	x	0.14	=	1.44			(29)
Roof	73.76	0	73.76	x	0.12	=	8.85			(30)
Total area of elements, m²			142.93							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 45.89 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1460.78 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 12.08 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 57.98 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.56	20.3	20.03	18.71	18.44	17.12	17.12	16.86	17.65	18.44	18.97	19.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	78.54	78.27	78.01	76.68	76.42	75.1	75.1	74.83	75.63	76.42	76.95	77.48	

Average = Sum(39)$_{1...12}$ /12= 76.62 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.06	1.06	1.06	1.04	1.04	1.02	1.02	1.01	1.03	1.04	1.04	1.05

Average = Sum(40)$_{1...12}$ /12= 1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.63 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.59	95.01	91.42	87.84	84.25	80.67	80.67	84.25	87.84	91.42	95.01	98.59

Total = Sum(44)$_{1...12}$ = 1075.55 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.21	127.88	131.96	115.04	110.39	95.25	88.27	101.29	102.5	119.45	130.39	141.6

Total = Sum(45)$_{1...12}$ = 1410.22 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.93	19.18	19.79	17.26	16.56	14.29	13.24	15.19	15.37	17.92	19.56	21.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.24	43.73	46.59	43.32	42.93	39.78	41.11	42.93	43.32	46.59	46.85	50.24	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84	

Output from water heater (annual)$_{1...12}$ 1947.85 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.18	53.45	55.52	49.08	47.44	41.62	39.63	44.41	44.91	51.36	55.07	59.64	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	116.69	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.36	16.3	13.26	10.04	7.5	6.34	6.85	8.9	11.94	15.16	17.7	18.87	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.91	208.05	202.66	191.2	176.73	163.13	154.05	151.91	157.29	168.76	183.23	196.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	-93.35	(71)

Water heating gains (Table 5)

(72)m=	82.22	79.54	74.63	68.17	63.76	57.8	53.26	59.69	62.37	69.04	76.48	80.16	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.5	364.9	351.56	330.42	309	288.28	275.16	281.51	292.62	313.97	338.42	356.86	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	4.31	x	11.28	x	0.55	x	0.7	=	12.97	(75)
Northeast 0.9x	0.77	x	4.31	x	22.97	x	0.55	x	0.7	=	26.41	(75)
Northeast 0.9x	0.77	x	4.31	x	41.38	x	0.55	x	0.7	=	47.58	(75)
Northeast 0.9x	0.77	x	4.31	x	67.96	x	0.55	x	0.7	=	78.14	(75)
Northeast 0.9x	0.77	x	4.31	x	91.35	x	0.55	x	0.7	=	105.04	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	4.31	x	97.38	x	0.55	x	0.7	=	111.99		(75)
Northeast	0.9x	0.77	x	4.31	x	91.1	x	0.55	x	0.7	=	104.76		(75)
Northeast	0.9x	0.77	x	4.31	x	72.63	x	0.55	x	0.7	=	83.52		(75)
Northeast	0.9x	0.77	x	4.31	x	50.42	x	0.55	x	0.7	=	57.98		(75)
Northeast	0.9x	0.77	x	4.31	x	28.07	x	0.55	x	0.7	=	32.28		(75)
Northeast	0.9x	0.77	x	4.31	x	14.2	x	0.55	x	0.7	=	16.33		(75)
Northeast	0.9x	0.77	x	4.31	x	9.21	x	0.55	x	0.7	=	10.6		(75)
Northwest	0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82		(81)
Northwest	0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03		(81)
Northwest	0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62		(81)
Northwest	0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73		(81)
Northwest	0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01		(81)
Northwest	0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77		(81)
Northwest	0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53		(81)
Northwest	0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59		(81)
Northwest	0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19		(81)
Northwest	0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03		(81)
Northwest	0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08		(81)
Northwest	0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21		(81)
Northwest	0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59		(81)
Northwest	0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62		(81)
Northwest	0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05		(81)
Northwest	0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46		(81)
Northwest	0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3		(81)
Northwest	0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02		(81)
Northwest	0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19		(81)
Northwest	0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33		(81)
Northwest	0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35		(81)
Northwest	0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94		(81)
Northwest	0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72		(81)
Northwest	0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54		(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	59.82	121.76	219.37	360.26	484.26	516.28	482.97	385.03	267.3	148.8	75.26	48.85	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	427.32	486.66	570.92	690.68	793.26	804.55	758.12	666.53	559.92	462.76	413.68	405.71	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.8	0.58	0.43	0.51	0.82	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.86	20	20.27	20.64	20.9	20.99	21	20.99	20.91	20.55	20.15	19.84	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.03	20.04	20.05	20.05	20.07	20.07	20.07	20.06	20.05	20.05	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.74	0.5	0.34	0.41	0.74	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.5	18.71	19.1	19.63	19.96	20.06	20.07	20.07	20	19.53	18.94	18.48	(90)

fLA = Living area ÷ (4) = 0.24 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.82	19.02	19.38	19.87	20.18	20.28	20.29	20.29	20.22	19.78	19.23	18.81	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.67	18.87	19.23	19.72	20.03	20.13	20.14	20.14	20.07	19.63	19.08	18.66	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.74	0.51	0.35	0.42	0.74	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	425.84	483.12	558.18	629.41	587.05	410.24	265.44	278.72	415.95	444.19	410.74	404.64	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1128.96	1093.21	992.95	830.08	636.87	415.44	265.96	280.02	451.25	689.82	921.66	1120.11	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	523.12	409.98	323.47	144.48	37.07	0	0	0	0	182.74	367.86	532.31	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2521.04 (98)

Space heating requirement in kWh/m²/year 34.18 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	523.12	409.98	323.47	144.48	37.07	0	0	0	0	182.74	367.86	532.31	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	578.67	453.52	357.82	159.82	41.01	0	0	0	0	202.15	406.93	588.84	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2788.76 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	196.45	171.61	178.54	158.36	153.32	135.04	129.37	144.22	145.81	166.04	177.24	191.84

Efficiency of water heater 80.3 (216)

(217)m= 87.4 | 87.17 | 86.53 | 84.82 | 82.09 | 80.3 | 80.3 | 80.3 | 80.3 | 85.29 | 86.85 | 87.48 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 224.78 | 196.87 | 206.34 | 186.7 | 186.78 | 168.16 | 161.11 | 179.6 | 181.59 | 194.67 | 204.08 | 219.28

Total = Sum(219a)$_{1...12}$ = 2309.97 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2788.76	
Water heating fuel used		2309.97	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	172.78		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		202.78	(231)
Electricity for lighting		324.19	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	602.37	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	498.95	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1101.33	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	105.24	(267)
Electricity for lighting	(232) x	0.519	=	168.26	(268)
Energy saving/generation technologies Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			913.82	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			12.39	(273)
EI rating (section 14)				90	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 37

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	84.24	(1a) x	2.56	(2a) =	215.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	84.24	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		215.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x	1/[1/(1.4)+ 0.04]	=	10.27			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Walls Type1	35.61	16.99	18.62	x	0.16	=	2.98			(29)
Walls Type2	20.82	2.42	18.4	x	0.14	=	2.6			(29)
Roof	84.25	0	84.25	x	0.12	=	10.11			(30)
Total area of elements, m²			140.67							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 41.6 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1387.5 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.82 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 51.42 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	23.48	23.18	22.88	21.37	21.07	19.55	19.55	19.25	20.16	21.07	21.67	22.27	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	74.91	74.6	74.3	72.79	72.49	70.97	70.97	70.67	71.58	72.49	73.09	73.7	

Average = Sum(39)$_{1...12}$ /12= 72.71 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.89	0.89	0.88	0.86	0.86	0.84	0.84	0.84	0.85	0.86	0.87	0.87

Average = Sum(40)$_{1...12}$ /12= 0.86 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.54 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 94.49 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	103.94	100.16	96.38	92.6	88.82	85.04	85.04	88.82	92.6	96.38	100.16	103.94

Total = Sum(44)$_{1...12}$ = 1133.85 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	154.13	134.81	139.11	121.28	116.37	100.42	93.05	106.78	108.05	125.93	137.46	149.27

Total = Sum(45)$_{1...12}$ = 1486.65 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.12	20.22	20.87	18.19	17.46	15.06	13.96	16.02	16.21	18.89	20.62	22.39

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	49.11	45.66	45.26	41.94	43.33	45.26	45.66	49.11	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23	

Output from water heater (annual)$_{1...12}$ 2049.26 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	63.99	56.33	58.53	51.74	50.01	43.87	41.77	46.82	47.34	54.15	58.03	62.37	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	126.92	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	20.46	18.17	14.78	11.19	8.36	7.06	7.63	9.92	13.31	16.9	19.72	21.03	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	228.07	230.44	224.48	211.78	195.75	180.69	170.63	168.26	174.22	186.92	202.95	218.01	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	35.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	-101.54	(71)

Water heating gains (Table 5)

(72)m=	86.01	83.82	78.67	71.86	67.21	60.93	56.15	62.93	65.76	72.78	80.6	83.83	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	398.62	396.51	382	358.91	335.41	312.76	298.48	305.18	317.36	340.68	367.35	386.95	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	449.76	500.62	569.57	666.95	749.48	754.21	711.44	634.4	545.92	467.91	431.7	428.72	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.81	0.59	0.44	0.51	0.82	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.06	20.18	20.4	20.71	20.93	20.99	21	21	20.94	20.65	20.31	20.05	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.18	20.18	20.18	20.2	20.2	20.22	20.22	20.22	20.21	20.2	20.2	20.19	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.94	0.77	0.52	0.36	0.42	0.75	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.91	19.08	19.4	19.86	20.13	20.21	20.22	20.22	20.17	19.79	19.29	18.9	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.16	19.32	19.62	20.04	20.3	20.38	20.39	20.39	20.33	19.97	19.51	19.15	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.01	19.17	19.47	19.89	20.15	20.23	20.24	20.24	20.18	19.82	19.36	19	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	1	0.98	0.93	0.76	0.53	0.36	0.43	0.75	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	448.74	498.19	560.66	619.68	572.76	396.57	257.83	270.59	410.34	452.39	429.51	427.98	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1101.72	1064.46	963.64	800.14	612.7	399.63	258.06	271.21	435.54	668.61	896.1	1090.62	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	485.82	380.53	299.82	129.93	29.72	0	0	0	0	160.87	335.95	493	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2315.63 (98)

Space heating requirement in kWh/m²/year 27.49 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	485.82	380.53	299.82	129.93	29.72	0	0	0	0	160.87	335.95	493	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	537.41	420.94	331.66	143.73	32.87	0	0	0	0	177.96	371.62	545.36	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2561.54 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	205.09	180.83	188.22	166.94	161.63	142.35	136.39	152.04	153.72	175.04	186.77	200.23

Efficiency of water heater 80.3 (216)

(217)m=	87.15	86.88	86.22	84.43	81.72	80.3	80.3	80.3	80.3	84.84	86.51	87.23	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	235.34	208.14	218.31	197.73	197.79	177.28	169.85	189.34	191.43	206.32	215.89	229.54	

Total = Sum(219a)$_{1...12}$ = 2436.96 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2561.54

DER WorkSheet: New dwelling design stage

Water heating fuel used		2436.96	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	197.32		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	227.32	(231)
Electricity for lighting		361.31	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	553.29	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	526.38	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1079.68	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	117.98	(267)
Electricity for lighting	(232) x		0.519	=	187.52	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			924.17	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			10.97	(273)
EI rating (section 14)					90	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 38

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.63	(1a) x	2.56	(2a) =	183.37	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.37	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	31.08	16.99	14.09	x	0.16	=	2.25			(29)
Walls Type2	25.62	2.42	23.2	x	0.14	=	3.28			(29)
Roof	71.63	0	71.63	x	0.12	=	8.6			(30)
Total area of elements, m²			128.33							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 40.04 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1278.53 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.93 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 48.98 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.97	19.71	19.45	18.17	17.91	16.63	16.63	16.37	17.14	17.91	18.43	18.94	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	68.95	68.69	68.43	67.15	66.89	65.6	65.6	65.35	66.12	66.89	67.4	67.92	

Average = Sum(39)$_{1...12}$ /12= 67.08 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.96	0.96	0.96	0.94	0.93	0.92	0.92	0.91	0.92	0.93	0.94	0.95	
Average = Sum(40)$_{1...12}$ /12=													0.94 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.47 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	97.32	93.78	90.24	86.7	83.16	79.62	79.62	83.16	86.7	90.24	93.78	97.32	
Total = Sum(44)$_{1...12}$ =													1061.64 (44)
Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)													
(45)m=	144.32	126.22	130.25	113.55	108.96	94.02	87.13	99.98	101.17	117.91	128.7	139.76	
Total = Sum(45)$_{1...12}$ =													1391.97 (45)
If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)													
(46)m=	21.65	18.93	19.54	17.03	16.34	14.1	13.07	15	15.18	17.69	19.31	20.96	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)
If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)
If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H													
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.59	43.16	45.98	42.76	42.38	39.27	40.57	42.38	42.76	45.98	46.25	49.59	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36	

Output from water heater (annual)$_{1...12}$ 1922.64 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.38	52.76	54.8	48.45	46.82	41.08	39.11	43.84	44.33	50.7	54.36	58.87	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	114.25	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.93	15.92	12.95	9.8	7.33	6.19	6.68	8.69	11.66	14.81	17.28	18.42	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.07	203.16	197.9	186.71	172.58	159.3	150.42	148.34	153.6	164.79	178.92	192.2	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	-91.4	(71)

Water heating gains (Table 5)

(72)m=	81.16	78.51	73.66	67.29	62.93	57.05	52.57	58.92	61.57	68.15	75.49	79.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.43	357.87	344.78	324.07	303.11	282.81	269.96	276.22	287.1	308.02	331.97	350.02	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	411.58	461.97	532.36	632.12	717.19	724.26	682.92	605.44	515.66	435.25	396.33	391.79	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.79	0.57	0.42	0.49	0.8	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.99	20.12	20.37	20.7	20.92	20.99	21	21	20.94	20.63	20.26	19.98	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.11	20.12	20.12	20.14	20.14	20.15	20.15	20.16	20.15	20.14	20.13	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.92	0.74	0.5	0.34	0.4	0.73	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.76	18.95	19.31	19.79	20.07	20.15	20.15	20.16	20.1	19.7	19.17	18.75	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.09	19.26	19.59	20.03	20.29	20.37	20.38	20.38	20.32	19.95	19.46	19.07	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.94	19.11	19.44	19.88	20.14	20.22	20.23	20.23	20.17	19.8	19.31	18.92	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.74	0.5	0.35	0.41	0.73	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	410.25	458.85	521.16	577.04	529.1	365.68	237.66	249.46	377.66	417.45	393.59	390.83	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1009.28	976.2	885.3	737.33	564.79	368.74	237.93	250.14	401.51	615.24	822.69	1000.07	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	445.68	347.66	270.92	115.41	26.55	0	0	0	0	147.16	308.96	453.28	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2115.61 (98)

Space heating requirement in kWh/m²/year 29.54 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	445.68	347.66	270.92	115.41	26.55	0	0	0	0	147.16	308.96	453.28	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	493.01	384.58	299.69	127.66	29.37	0	0	0	0	162.78	341.77	501.41	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2340.27 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	193.91	169.38	176.23	156.31	151.34	133.29	127.7	142.36	143.93	163.89	174.95	189.36

Efficiency of water heater 80.3 (216)

(217)m=	87.08	86.82	86.13	84.3	81.66	80.3	80.3	80.3	80.3	84.78	86.47	87.17	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	222.68	195.09	204.61	185.42	185.32	165.99	159.03	177.28	179.24	193.31	202.33	217.23	

Total = Sum(219a)$_{1...12}$ = 2287.53 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2340.27

DER WorkSheet: New dwelling design stage

Water heating fuel used		2287.53	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	167.79		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	197.79	(231)
Electricity for lighting		316.57	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	505.5	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	494.11	(264)
Space and water heating	(261) + (262) + (263) + (264) =				999.61	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	102.65	(267)
Electricity for lighting	(232) x		0.519	=	164.3	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			805.55	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.25	(273)
EI rating (section 14)					91	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 39

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	58.62	(1a) x	2.56	(2a) =	150.07	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	58.62	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		150.07	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	37.03	16.99	20.04	x	0.16	=	3.21			(29)
Walls Type2	26.11	2.42	23.69	x	0.14	=	3.35			(29)
Roof	58.62	0	58.62	x	0.12	=	7.03			(30)
Total area of elements, m²			121.76							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.5 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1271.01 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.89 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 47.4 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	16.34	16.13	15.92	14.87	14.66	13.61	13.61	13.4	14.03	14.66	15.08	15.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	63.74	63.53	63.32	62.27	62.06	61.01	61.01	60.8	61.43	62.06	62.48	62.9	

Average = Sum(39)$_{1...12}$ /12= 62.22 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.09	1.08	1.08	1.06	1.06	1.04	1.04	1.04	1.05	1.06	1.07	1.07

Average = Sum(40)$_{1...12}$ /12= 1.06 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.94 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 80.33 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	88.36	85.15	81.94	78.72	75.51	72.3	72.3	75.51	78.72	81.94	85.15	88.36

Total = Sum(44)$_{1...12}$ = 963.97 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	131.04	114.61	118.27	103.11	98.93	85.37	79.11	90.78	91.86	107.06	116.86	126.91

Total = Sum(45)$_{1...12}$ = 1263.92 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.66	17.19	17.74	15.47	14.84	12.81	11.87	13.62	13.78	16.06	17.53	19.04

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	45.03	39.19	41.75	38.82	38.48	35.65	36.84	38.48	38.82	41.75	41.99	45.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94	

Output from water heater (annual)$_{1...12}$ 1745.77 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	54.83	47.91	49.76	43.99	42.52	37.3	35.51	39.8	40.25	46.04	49.36	53.45	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	97.12	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	15.11	13.42	10.91	8.26	6.18	5.21	5.63	7.32	9.83	12.48	14.56	15.53	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	169.45	171.21	166.78	157.35	145.44	134.25	126.77	125.01	129.44	138.88	150.79	161.98	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	32.71	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	-77.69	(71)

Water heating gains (Table 5)

(72)m=	73.69	71.29	66.88	61.1	57.14	51.81	47.74	53.5	55.9	61.88	68.55	71.85	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	313.39	311.05	299.71	281.84	263.9	246.4	235.28	240.97	250.31	268.37	289.03	304.49	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	364.54	415.16	487.28	589.89	677.97	687.85	648.24	570.19	478.87	395.6	353.39	346.25	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.93	0.77	0.56	0.41	0.49	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.86	20.01	20.29	20.66	20.91	20.99	21	21	20.92	20.57	20.16	19.84	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.01	20.01	20.02	20.03	20.03	20.05	20.05	20.05	20.04	20.03	20.03	20.02	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.9	0.71	0.48	0.32	0.39	0.71	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.5	18.71	19.11	19.65	19.95	20.04	20.05	20.05	19.99	19.54	18.94	18.48	(90)

fLA = Living area ÷ (4) = 0.3 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.91	19.1	19.47	19.95	20.24	20.33	20.33	20.33	20.27	19.85	19.31	18.89	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.76	18.95	19.32	19.8	20.09	20.18	20.18	20.18	20.12	19.7	19.16	18.74	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.9	0.71	0.49	0.34	0.4	0.72	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	362.85	411.21	473.6	528.25	484.72	336.43	218.28	229.14	344.07	376.09	350.08	345.02	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	921.59	892.83	811.63	678.93	520.63	340.18	218.67	230.1	369.68	564.85	753.31	914.45	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	415.7	323.65	251.49	108.49	26.72	0	0	0	0	140.43	290.33	423.65	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1980.47 (98)

Space heating requirement in kWh/m²/year 33.78 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	415.7	323.65	251.49	108.49	26.72	0	0	0	0	140.43	290.33	423.65	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	459.85	358.02	278.2	120.01	29.56	0	0	0	0	155.35	321.16	468.64	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2190.78 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	176.07	153.8	160.02	141.93	137.41	121.03	115.95	129.26	130.69	148.81	158.86	171.94

Efficiency of water heater 80.3 (216)

(217)m=	87.14	86.88	86.18	84.38	81.79	80.3	80.3	80.3	80.3	84.91	86.55	87.23	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	202.06	177.03	185.67	168.2	168.01	150.72	144.4	160.97	162.75	175.27	183.54	197.1	

Total = Sum(219a)$_{1...12}$ = 2075.72 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2190.78

DER WorkSheet: New dwelling design stage

Water heating fuel used		2075.72	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	137.31		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	167.31	(231)
Electricity for lighting		266.79	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	473.21	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	448.36	(264)
Space and water heating	(261) + (262) + (263) + (264) =				921.57	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	86.83	(267)
Electricity for lighting	(232) x		0.519	=	138.47	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			685.86	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.7	(273)
EI rating (section 14)					91	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 40

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.71	(1a) x	2.56	(2a) =	183.58	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.71	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.58	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	54.82	19.88	34.94	x	0.16	=	5.59			(29)
Walls Type2	34.97	2.42	32.55	x	0.14	=	4.6			(29)
Roof	71.71	0	71.71	x	0.12	=	8.61			(30)
Total area of elements, m²			161.5							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 48.54 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1792.7 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.98 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 56.53 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.99	19.73	19.48	18.19	17.93	16.64	16.64	16.39	17.16	17.93	18.45	18.96	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	76.52	76.26	76	74.72	74.46	73.17	73.17	72.91	73.69	74.46	74.97	75.49	

Average = Sum(39)$_{1...12}$ /12= 74.65 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.07	1.06	1.06	1.04	1.04	1.02	1.02	1.02	1.03	1.04	1.05	1.05

Average = Sum(40)$_{1...12}$ /12= 1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.51 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	97.37	93.83	90.28	86.74	83.2	79.66	79.66	83.2	86.74	90.28	93.83	97.37

Total = Sum(44)$_{1...12}$ = 1062.17 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	144.39	126.28	130.31	113.61	109.01	94.07	87.17	100.03	101.22	117.97	128.77	139.83

Total = Sum(45)$_{1...12}$ = 1392.67 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.66	18.94	19.55	17.04	16.35	14.11	13.08	15	15.18	17.69	19.32	20.98

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.62	43.19	46.01	42.78	42.4	39.29	40.6	42.4	42.78	46.01	46.27	49.62	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45	

Output from water heater (annual)$_{1...12}$ 1923.61 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.41	52.79	54.83	48.47	46.85	41.1	39.13	43.86	44.35	50.73	54.38	58.9	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	114.35	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.94	15.94	12.96	9.81	7.33	6.19	6.69	8.7	11.67	14.82	17.3	18.44	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.25	203.34	198.08	186.88	172.73	159.44	150.56	148.47	153.74	164.94	179.08	192.37	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	34.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	-91.48	(71)

Water heating gains (Table 5)

(72)m=	81.2	78.55	73.7	67.32	62.97	57.08	52.6	58.95	61.6	68.18	75.53	79.17	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	360.7	358.13	345.04	324.31	303.34	283.02	270.15	276.42	287.31	308.24	332.22	350.28	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(75)
Northeast 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(75)
Northeast 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(75)
Northeast 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(75)
Northeast 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(75)
Northeast	0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(75)
Northeast	0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(75)
Northeast	0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(75)
Northeast	0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(75)
Northeast	0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(75)
Northeast	0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(75)
Northeast	0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(75)
Northeast	0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(75)
Northeast	0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(75)
Northeast	0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(75)
Northeast	0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(75)
Northeast	0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(75)
Northeast	0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(75)
Northeast	0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(75)
Northeast	0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(75)
Northeast	0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(75)
Northeast	0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(75)
Northeast	0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(75)
Southeast	0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast	0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast	0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast	0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast	0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)
Southeast	0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast	0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast	0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast	0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast	0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast	0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast	0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	79.52	152.43	253.69	389.97	505.84	532.55	500.79	409.71	300.15	180.64	98.34	66.05	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	440.22	510.57	598.73	714.28	809.18	815.57	770.95	686.14	587.46	488.88	430.55	416.33	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.93	0.77	0.56	0.42	0.48	0.78	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.88	20.04	20.32	20.68	20.91	20.99	21	21	20.93	20.6	20.18	19.86	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.03	20.03	20.05	20.05	20.07	20.07	20.07	20.06	20.05	20.05	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.9	0.72	0.49	0.33	0.39	0.7	0.95	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.54	18.77	19.17	19.68	19.97	20.06	20.07	20.07	20.01	19.59	18.98	18.52	(90)

fLA = Living area ÷ (4) = 0.28 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.92	19.13	19.49	19.96	20.24	20.32	20.33	20.33	20.27	19.87	19.32	18.9	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.77	18.98	19.34	19.81	20.09	20.17	20.18	20.18	20.12	19.72	19.17	18.75	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.89	0.72	0.49	0.34	0.4	0.71	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	438.28	505.52	581.16	639.15	581.74	403.2	261.44	274.55	416	463.03	426.52	414.95	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1107.14	1073.69	976.04	815.19	624.35	407.63	261.88	275.59	443.56	679.22	905.07	1098.09	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	497.63	381.81	293.79	126.75	31.7	0	0	0	0	160.85	344.56	508.25	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2345.35 (98)

Space heating requirement in kWh/m²/year 32.71 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	497.63	381.81	293.79	126.75	31.7	0	0	0	0	160.85	344.56	508.25	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	550.47	422.36	324.99	140.21	35.07	0	0	0	0	177.93	381.15	562.23	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2594.41 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	194.01	169.47	176.32	156.39	151.41	133.36	127.76	142.43	144	163.97	175.04	189.45

Efficiency of water heater: 80.3 (216)

(217)m= 87.32 | 87.03 | 86.33 | 84.53 | 81.88 | 80.3 | 80.3 | 80.3 | 80.3 | 85 | 86.73 | 87.41 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 222.18 | 194.72 | 204.25 | 185.02 | 184.91 | 166.07 | 159.11 | 177.37 | 179.33 | 192.9 | 201.83 | 216.73

Total = Sum(219a)$_{1...12}$ = 2284.41 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2594.41	
Water heating fuel used		2284.41	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	184.77		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		214.77	(231)
Electricity for lighting		316.86	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	560.39	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	493.43	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1053.83	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	111.47	(267)
Electricity for lighting	(232) x	0.519	=	164.45	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			868.74	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			12.11	(273)
EI rating (section 14)				90	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 41

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.7	(1a) x	2.56	(2a) =	180.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.7	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x	1/[1/(1.4)+ 0.04]	=	10.69			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Windows Type 3			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Walls Type1	54.73	20.19	34.54	x	0.16	=	5.53			(29)
Walls Type2	22.23	2.42	19.81	x	0.14	=	2.8			(29)
Roof	70.7	0	70.7	x	0.12	=	8.48			(30)
Total area of elements, m²			147.65							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 46.97 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1560.19 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.34 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 56.3 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.71	19.46	19.2	17.93	17.68	16.41	16.41	16.16	16.92	17.68	18.19	18.69	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	76.01	75.76	75.5	74.23	73.98	72.71	72.71	72.46	73.22	73.98	74.49	75	

Average = Sum(39)$_{1...12}$ /12= 74.17 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.08	1.07	1.07	1.05	1.05	1.03	1.03	1.02	1.04	1.05	1.05	1.06

Average = Sum(40)$_{1...12}$ /12= 1.05 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.94 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.74	93.22	89.7	86.19	82.67	79.15	79.15	82.67	86.19	89.7	93.22	96.74

Total = Sum(44)$_{1...12}$ = 1055.33 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.46	125.47	129.48	112.88	108.31	93.46	86.61	99.38	100.57	117.21	127.94	138.93

Total = Sum(45)$_{1...12}$ = 1383.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.52	18.82	19.42	16.93	16.25	14.02	12.99	14.91	15.09	17.58	19.19	20.84

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.3	42.91	45.71	42.5	42.13	39.03	40.33	42.13	42.5	45.71	45.97	49.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23	

Output from water heater (annual)$_{1...12}$ 1911.23 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.03	52.45	54.48	48.16	46.55	40.84	38.88	43.58	44.07	50.4	54.03	58.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	113.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.73	15.75	12.81	9.7	7.25	6.12	6.61	8.6	11.54	14.65	17.1	18.23	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.92	200.98	195.78	184.71	170.73	157.59	148.81	146.75	151.95	163.03	177	190.14	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	34.31	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	-90.52	(71)

Water heating gains (Table 5)

(72)m=	80.68	78.05	73.22	66.89	62.56	56.72	52.26	58.57	61.2	67.74	75.05	78.66	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	357.27	354.72	341.76	321.24	300.48	280.37	267.63	273.86	284.64	305.36	329.09	346.97	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast 0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast 0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast 0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast 0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast 0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast 0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast 0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast 0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast 0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)
Southwest 0.9x	0.77	x	8.06	x	36.79		0.55	x	0.7	=	79.12	(79)
Southwest 0.9x	0.77	x	4.62	x	36.79		0.55	x	0.7	=	90.71	(79)
Southwest 0.9x	0.77	x	8.06	x	62.67		0.55	x	0.7	=	134.78	(79)
Southwest 0.9x	0.77	x	4.62	x	62.67		0.55	x	0.7	=	154.51	(79)
Southwest 0.9x	0.77	x	8.06	x	85.75		0.55	x	0.7	=	184.41	(79)
Southwest 0.9x	0.77	x	4.62	x	85.75		0.55	x	0.7	=	211.4	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	4.62	x	106.25		0.55	x	0.7	=	261.94	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	4.62	x	119.01		0.55	x	0.7	=	293.39	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	4.62	x	118.15		0.55	x	0.7	=	291.27	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	4.62	x	113.91		0.55	x	0.7	=	280.82	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	4.62	x	104.39		0.55	x	0.7	=	257.35	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	4.62	x	92.85		0.55	x	0.7	=	228.91	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	4.62	x	69.27		0.55	x	0.7	=	170.76	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	4.62	x	44.07		0.55	x	0.7	=	108.65	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	4.62	x	31.49		0.55	x	0.7	=	77.63	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	198.2	337.61	461.93	572.36	641.09	636.45	613.61	562.33	500.17	373.13	237.4	169.62	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	555.48	692.33	803.69	893.59	941.57	916.82	881.24	836.19	784.81	678.49	566.49	516.59	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.85	0.69	0.5	0.36	0.4	0.62	0.89	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.03	20.27	20.54	20.81	20.95	20.99	21	21	20.98	20.78	20.35	19.99	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.02	20.02	20.03	20.04	20.04	20.06	20.06	20.06	20.05	20.04	20.04	20.03	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.92	0.81	0.63	0.43	0.29	0.32	0.55	0.86	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.75	19.09	19.48	19.84	20	20.06	20.06	20.06	20.04	19.81	19.22	18.7	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.1	19.41	19.76	20.1	20.26	20.31	20.31	20.32	20.29	20.07	19.53	19.05	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.95	19.26	19.61	19.95	20.11	20.16	20.16	20.17	20.14	19.92	19.38	18.9	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.92	0.81	0.64	0.44	0.29	0.33	0.55	0.85	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	548.43	668.2	735.9	719.94	597.92	401.66	258.87	272.42	433.77	577.51	549.42	511.84	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1113.3	1087.8	990.21	820.21	621.83	404.16	259.09	272.8	442.36	689.7	914.68	1102.37	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	420.26	281.97	189.21	72.2	17.79	0	0	0	0	83.47	262.99	439.35	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1767.23 (98)

Space heating requirement in kWh/m²/year 25 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	420.26	281.97	189.21	72.2	17.79	0	0	0	0	83.47	262.99	439.35	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	464.89	311.91	209.3	79.86	19.68	0	0	0	0	92.33	290.91	486.01	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1954.9 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	192.76	168.38	175.19	155.38	150.44	132.5	126.94	141.51	143.07	162.92	173.91	188.23

Efficiency of water heater 80.3 (216)

(217)m=	86.96	86.34	85.25	83.25	81.26	80.3	80.3	80.3	80.3	83.46	86.09	87.11

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	221.66	195.02	205.51	186.64	185.13	165	158.09	176.23	178.17	195.21	202.01	216.08

Total = Sum(219a)$_{1...12}$ = 2284.75 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1954.9	
Water heating fuel used		2284.75	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	165.6		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		195.6	(231)
Electricity for lighting		313.18	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	422.26	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	493.51	(264)
Space and water heating	(261) + (262) + (263) + (264) =			915.77	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	101.52	(267)
Electricity for lighting	(232) x	0.519	=	162.54	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			718.82	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			10.17	(273)
EI rating (section 14)				92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 42

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.46	(1a) x	2.56	(2a) =	129.18	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.46	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.18	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	24.7	10.95	13.75	x	0.16	=	2.2			(29)
Walls Type2	19.12	2.42	16.7	x	0.14	=	2.36			(29)
Roof	50.46	0	50.46	x	0.12	=	6.06			(30)
Total area of elements, m²			94.28							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 28.52 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 971.79 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.5 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 36.02 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.07	13.89	13.71	12.8	12.62	11.71	11.71	11.53	12.07	12.62	12.98	13.34	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	50.09	49.91	49.72	48.82	48.64	47.73	47.73	47.55	48.09	48.64	49	49.36	

Average = Sum(39)$_{1...12}$ /12= 48.77 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.99	0.99	0.99	0.97	0.96	0.95	0.95	0.94	0.95	0.96	0.97	0.98

Average = Sum(40)$_{1...12}$ /12= 0.97 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.66 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.13	79.14	76.15	73.17	70.18	67.2	67.2	70.18	73.17	76.15	79.14	82.13

Total = Sum(44)$_{1...12}$ = 895.94 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.79	106.52	109.92	95.83	91.95	79.35	73.53	84.37	85.38	99.5	108.62	117.95

Total = Sum(45)$_{1...12}$ = 1174.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.37	13.79	11.9	11.03	12.66	12.81	14.93	16.29	17.69

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.85	36.43	38.81	36.08	35.76	33.14	34.24	35.76	36.08	38.81	39.03	41.85	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8	

Output from water heater (annual)$_{1...12}$ 1622.57 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.96	44.52	46.25	40.88	39.52	34.67	33.01	37	37.41	42.79	45.87	49.68	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	85.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.24	11.76	9.57	7.24	5.41	4.57	4.94	6.42	8.62	10.94	12.77	13.61	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.43	149.97	146.09	137.82	127.39	117.59	111.04	109.5	113.38	121.65	132.08	141.88	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	-68.15	(71)

Water heating gains (Table 5)

(72)m=	68.49	66.26	62.16	56.78	53.11	48.15	44.37	49.72	51.96	57.51	63.71	66.78	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.72	279.54	269.37	253.41	237.47	221.87	211.9	217.2	225.51	241.65	260.11	273.82	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	66.12	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	81.93	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	91.77	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	107.49	183.1	250.53	310.42	347.69	345.18	332.79	304.98	271.27	202.37	128.75	91.99	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	389.21	462.65	519.9	563.82	585.17	567.04	544.69	522.18	496.78	444.02	388.86	365.81	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.73	0.53	0.38	0.42	0.65	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.14	20.33	20.57	20.81	20.95	20.99	21	21	20.98	20.8	20.42	20.11	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.09	20.1	20.11	20.11	20.13	20.13	20.13	20.12	20.11	20.11	20.1	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.67	0.46	0.31	0.34	0.57	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.95	19.23	19.57	19.9	20.07	20.12	20.13	20.13	20.11	19.9	19.38	18.92	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.34	19.59	19.89	20.2	20.35	20.41	20.41	20.42	20.39	20.19	19.72	19.31	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.19	19.44	19.74	20.05	20.2	20.26	20.26	20.27	20.24	20.04	19.57	19.16	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.84	0.68	0.47	0.32	0.35	0.58	0.87	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	384.48	448.97	484.08	472.02	395.73	268.29	174.71	183.54	289.56	384.96	377.93	362.49	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	745.81	725.65	658.49	544.28	413.61	270.09	174.86	183.79	295.43	459.25	611.18	738.2	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	268.83	185.93	129.76	52.03	13.3	0	0	0	0	55.27	167.94	279.53	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1152.6 (98)

Space heating requirement in kWh/m²/year 22.84 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	268.83	185.93	129.76	52.03	13.3	0	0	0	0	55.27	167.94	279.53	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	297.38	205.67	143.54	57.55	14.71	0	0	0	0	61.14	185.77	309.22	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1274.99 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.64	142.95	148.73	131.91	127.72	112.49	107.77	120.14	121.46	138.31	147.64	159.8

Efficiency of water heater 80.3 (216)

(217)m=	86.29	85.71	84.71	82.92	81.16	80.3	80.3	80.3	80.3	82.95	85.38	86.45	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.64	166.77	175.57	159.09	157.37	140.08	134.21	149.61	151.26	166.75	172.93	184.86	

Total = Sum(219a)$_{1...12}$ = 1948.15 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1274.99

DER WorkSheet: New dwelling design stage

Water heating fuel used		1948.15	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.2		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	148.2	(231)
Electricity for lighting		233.89	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	275.4	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	420.8	(264)
Space and water heating	(261) + (262) + (263) + (264) =				696.2	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	76.91	(267)
Electricity for lighting	(232) x		0.519	=	121.39	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			433.5	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			8.59	(273)
EI rating (section 14)					94	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 43

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	49.88	(1a) x	2.56	(2a) =	127.71	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	49.88	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		127.71	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	24.52	10.95	13.57	x	0.16	=	2.17			(29)
Walls Type2	18.94	2.42	16.52	x	0.14	=	2.34			(29)
Roof	49.88	0	49.88	x	0.12	=	5.99			(30)
Total area of elements, m²			93.34							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 28.4 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 960.46 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.48 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.88 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	13.91	13.73	13.55	12.65	12.47	11.58	11.58	11.4	11.94	12.47	12.83	13.19	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	49.78	49.6	49.42	48.53	48.35	47.45	47.45	47.28	47.81	48.35	48.71	49.07	

Average = Sum(39)$_{1...12}$ /12= 48.48 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1	0.99	0.99	0.97	0.97	0.95	0.95	0.95	0.96	0.97	0.98	0.98

Average = Sum(40)$_{1...12}$ /12= 0.97 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.69 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.26 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(44)m=	81.69	78.72	75.74	72.77	69.8	66.83	66.83	69.8	72.77	75.74	78.72	81.69

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 891.11 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.14	105.95	109.33	95.31	91.46	78.92	73.13	83.92	84.92	98.97	108.03	117.31

Total = Sum(45)$_{1...12}$ = 1168.39 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.17	15.89	16.4	14.3	13.72	11.84	10.97	12.59	12.74	14.85	16.2	17.6

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.63	36.23	38.6	35.89	35.57	32.96	34.06	35.57	35.89	38.6	38.82	41.63	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	

Output from water heater (annual)$_{1...12}$ 1613.83 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.68	44.29	46	40.66	39.3	34.48	32.83	36.8	37.21	42.56	45.62	49.41	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	84.34	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.1	11.64	9.47	7.17	5.36	4.52	4.89	6.35	8.53	10.83	12.63	13.47	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	146.94	148.46	144.62	136.44	126.11	116.41	109.92	108.4	112.24	120.42	130.75	140.45	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	31.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	-67.47	(71)

Water heating gains (Table 5)

(72)m=	68.12	65.9	61.83	56.48	52.83	47.89	44.13	49.46	51.68	57.2	63.37	66.42	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	279.47	277.3	267.21	251.38	235.6	220.12	210.24	215.51	223.75	239.75	258.05	271.64	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	85.75	0.55	x	0.7	=	66.12	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25	0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	2.89	x	106.25	0.55	x	0.7	=	81.93	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01	0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	2.89	x	119.01	0.55	x	0.7	=	91.77	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15	0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	2.89	x	118.15	0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91	0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91	0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39	0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39	0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85	0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85	0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27	0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27	0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07	0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07	0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49	0.55	x	0.7	=	67.71	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49	0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	107.49	183.1	250.53	310.42	347.69	345.18	332.79	304.98	271.27	202.37	128.75	91.99	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	386.96	460.4	517.74	561.8	583.29	565.3	543.03	520.49	495.02	442.11	386.8	363.63	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.72	0.53	0.38	0.42	0.64	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.13	20.33	20.56	20.81	20.95	20.99	21	21	20.98	20.8	20.42	20.1	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.09	20.09	20.11	20.11	20.12	20.12	20.13	20.12	20.11	20.1	20.1	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.67	0.46	0.31	0.34	0.57	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.94	19.22	19.56	19.9	20.06	20.12	20.12	20.13	20.1	19.89	19.37	18.91	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.34	19.59	19.89	20.2	20.35	20.41	20.41	20.42	20.39	20.19	19.72	19.3	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.19	19.44	19.74	20.05	20.2	20.26	20.26	20.27	20.24	20.04	19.57	19.15	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.84	0.67	0.47	0.32	0.35	0.58	0.87	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	382.16	446.55	481.55	469.42	393.42	266.73	173.71	182.48	287.85	382.76	375.75	360.26	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	741.15	721.21	654.52	541.07	411.18	268.53	173.86	182.73	293.71	456.54	607.47	733.64	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	267.09	184.57	128.69	51.59	13.21	0	0	0	0	54.89	166.84	277.79	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1144.67 (98)

Space heating requirement in kWh/m²/year 22.95 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	267.09	184.57	128.69	51.59	13.21	0	0	0	0	54.89	166.84	277.79	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	295.46	204.17	142.36	57.06	14.62	0	0	0	0	60.71	184.56	307.29	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1266.22 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	162.76	142.18	147.93	131.2	127.03	111.88	107.19	119.49	120.81	137.57	146.85	158.94	

Efficiency of water heater 80.3 (216)

(217)m=	86.29	85.71	84.7	82.91	81.15	80.3	80.3	80.3	80.3	82.94	85.37	86.44	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	188.62	165.88	174.64	158.24	156.53	139.33	133.49	148.81	150.45	165.86	172.01	183.87	

Total = Sum(219a)$_{1...12}$ = 1937.72 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1266.22

DER WorkSheet: New dwelling design stage

Water heating fuel used		1937.72	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	116.85		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	146.85	(231)
Electricity for lighting		231.44	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	273.5	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	418.55	(264)
Space and water heating	(261) + (262) + (263) + (264) =				692.05	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	76.22	(267)
Electricity for lighting	(232) x		0.519	=	120.12	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			427.38	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			8.57	(273)
EI rating (section 14)					94	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 44

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.49	(1a) x	2.56	(2a) =	129.25	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.49	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.25	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	15.41	10.95	4.46	x	0.16	=	0.71			(29)
Walls Type2	48.46	2.42	46.04	x	0.14	=	6.51			(29)
Roof	50.5	0	50.5	x	0.12	=	6.06			(30)
Total area of elements, m²			114.36							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.19 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1312.93 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 5.97 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 37.16 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.08	13.89	13.71	12.81	12.63	11.72	11.72	11.54	12.08	12.63	12.99	13.35	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	51.24	51.06	50.88	49.97	49.79	48.88	48.88	48.7	49.25	49.79	50.15	50.52	

Average = Sum(39)$_{1...12}$ /12= 49.93 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.01	1.01	1.01	0.99	0.99	0.97	0.97	0.96	0.98	0.99	0.99	1	
											Average = Sum(40)$_{1...12}$ /12=	0.99	(40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.68 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	82.15	79.16	76.18	73.19	70.2	67.21	67.21	70.2	73.19	76.18	79.16	82.15	
											Total = Sum(44)$_{1...12}$ =	896.19	(44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.83	106.55	109.95	95.86	91.98	79.37	73.55	84.4	85.41	99.53	108.65	117.98	
											Total = Sum(45)$_{1...12}$ =	1175.05	(45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.27	15.98	16.49	14.38	13.8	11.91	11.03	12.66	12.81	14.93	16.3	17.7	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.86	36.44	38.82	36.09	35.77	33.15	34.25	35.77	36.09	38.82	39.04	41.86	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85	

Output from water heater (annual)$_{1...12}$ 1623.02 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.97	44.54	46.26	40.9	39.53	34.68	33.02	37.01	37.42	42.8	45.88	49.7	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	85.23	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.25	11.77	9.57	7.25	5.42	4.57	4.94	6.42	8.62	10.95	12.78	13.62	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.51	150.05	146.16	137.9	127.46	117.65	111.1	109.56	113.44	121.71	132.15	141.95	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	31.52	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	-68.18	(71)

Water heating gains (Table 5)

(72)m=	68.51	66.28	62.18	56.8	53.13	48.16	44.38	49.74	51.97	57.53	63.73	66.79	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.84	279.66	269.49	253.51	237.57	221.96	211.99	217.29	225.6	241.75	260.22	273.94	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast 0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast 0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast 0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast 0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast 0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast 0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast 0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast 0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast 0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)
Southwest 0.9x	0.77	x	8.06	x	36.79		0.55	x	0.7	=	79.12	(79)
Southwest 0.9x	0.77	x	8.06	x	62.67		0.55	x	0.7	=	134.78	(79)
Southwest 0.9x	0.77	x	8.06	x	85.75		0.55	x	0.7	=	184.41	(79)
Southwest 0.9x	0.77	x	8.06	x	106.25		0.55	x	0.7	=	228.49	(79)
Southwest 0.9x	0.77	x	8.06	x	119.01		0.55	x	0.7	=	255.93	(79)
Southwest 0.9x	0.77	x	8.06	x	118.15		0.55	x	0.7	=	254.08	(79)
Southwest 0.9x	0.77	x	8.06	x	113.91		0.55	x	0.7	=	244.96	(79)
Southwest 0.9x	0.77	x	8.06	x	104.39		0.55	x	0.7	=	224.49	(79)
Southwest 0.9x	0.77	x	8.06	x	92.85		0.55	x	0.7	=	199.67	(79)
Southwest 0.9x	0.77	x	8.06	x	69.27		0.55	x	0.7	=	148.96	(79)
Southwest 0.9x	0.77	x	8.06	x	44.07		0.55	x	0.7	=	94.77	(79)
Southwest 0.9x	0.77	x	8.06	x	31.49		0.55	x	0.7	=	67.71	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	107.49	183.1	250.53	310.42	347.69	345.18	332.79	304.98	271.27	202.37	128.75	91.99	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	389.33	462.76	520.01	563.93	585.26	567.13	544.78	522.27	496.87	444.12	388.97	365.93	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.88	0.74	0.54	0.39	0.43	0.66	0.91	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.11	20.3	20.54	20.79	20.94	20.99	21	21	20.97	20.78	20.4	20.07	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.07	20.07	20.08	20.09	20.09	20.11	20.11	20.11	20.1	20.09	20.09	20.08	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.85	0.68	0.47	0.31	0.35	0.58	0.88	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.89	19.17	19.51	19.86	20.04	20.1	20.11	20.11	20.09	19.86	19.33	18.85	(90)

fLA = Living area ÷ (4) = 0.33 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.29	19.54	19.85	20.17	20.33	20.39	20.4	20.4	20.38	20.16	19.68	19.25	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.14	19.39	19.7	20.02	20.18	20.24	20.25	20.25	20.23	20.01	19.53	19.1	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.84	0.69	0.48	0.33	0.36	0.59	0.87	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	384.68	449.51	485.56	475.82	401.73	273.72	178.26	187.29	294.75	387.46	378.38	362.66	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	760.34	739.86	671.5	555.48	422.41	275.93	178.45	187.61	301.73	468.57	623.31	752.83	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	279.49	195.12	138.34	57.36	15.39	0	0	0	0	60.34	176.35	290.29	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1212.67 (98)

Space heating requirement in kWh/m²/year 24.02 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	279.49	195.12	138.34	57.36	15.39	0	0	0	0	60.34	176.35	290.29	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	309.17	215.84	153.03	63.45	17.02	0	0	0	0	66.75	195.08	321.12	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1341.45 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.69	142.99	148.77	131.95	127.75	112.52	107.8	120.17	121.5	138.35	147.69	159.85	

Efficiency of water heater 80.3 (216)

(217)m=	86.39	85.83	84.87	83.11	81.28	80.3	80.3	80.3	80.3	83.12	85.5	86.53	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.49	166.59	175.29	158.76	157.18	140.12	134.25	149.65	151.31	166.45	172.74	184.72	

Total = Sum(219a)$_{1...12}$ = 1946.54 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1341.45

DER WorkSheet: New dwelling design stage

Water heating fuel used		1946.54	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.27		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	148.27	(231)
Electricity for lighting		234.02	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	289.75	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	420.45	(264)
Space and water heating	(261) + (262) + (263) + (264) =				710.21	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	76.95	(267)
Electricity for lighting	(232) x		0.519	=	121.46	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			447.61	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			8.87	(273)
EI rating (section 14)					94	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 45

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.04	(1a) x	2.56	(2a) =	186.98	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.04	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.98	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	36.47	17.3	19.17	x	0.16	=	3.07			(29)
Walls Type2	41.48	2.42	39.06	x	0.14	=	5.52			(29)
Roof	73.04	0	73.04	x	0.12	=	8.76			(30)
Total area of elements, m²			150.99							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 43.68 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1647.24 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.78 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 51.46 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.36	20.1	19.84	18.53	18.26	16.95	16.95	16.69	17.48	18.26	18.79	19.31	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	71.82	71.56	71.3	69.99	69.72	68.41	68.41	68.15	68.94	69.72	70.25	70.77	

Average = Sum(39)$_{1...12}$ /12= 69.92 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.98	0.98	0.98	0.96	0.95	0.94	0.94	0.93	0.94	0.95	0.96	0.97

Average = Sum(40)$_{1...12}$ /12= 0.96 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.24 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.17	94.6	91.03	87.46	83.89	80.32	80.32	83.89	87.46	91.03	94.6	98.17

Total = Sum(44)$_{1...12}$ = 1070.92 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.58	127.32	131.39	114.55	109.91	94.84	87.89	100.85	102.06	118.94	129.83	140.99

Total = Sum(45)$_{1...12}$ = 1404.14 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.84	19.1	19.71	17.18	16.49	14.23	13.18	15.13	15.31	17.84	19.47	21.15

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.03	43.54	46.39	43.13	42.75	39.61	40.93	42.75	43.13	46.39	46.65	50.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01	

Output from water heater (annual)$_{1...12}$ 1939.46 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.91	53.22	55.28	48.87	47.23	41.44	39.45	44.22	44.72	51.14	54.83	59.38	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	115.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.21	16.18	13.16	9.96	7.44	6.29	6.79	8.83	11.85	15.04	17.56	18.72	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.29	206.41	201.06	189.69	175.34	161.84	152.83	150.71	156.05	167.42	181.78	195.27	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	34.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	-92.7	(71)

Water heating gains (Table 5)

(72)m=	81.87	79.2	74.31	67.87	63.48	57.55	53.03	59.44	62.11	68.74	76.15	79.82	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	365.13	362.54	349.29	328.29	307.03	286.45	273.42	279.74	290.77	311.97	336.26	354.57	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	169.83	289.28	395.81	490.43	549.32	545.35	525.77	481.84	428.58	319.72	203.42	145.34	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	534.96	651.83	745.1	818.72	856.35	831.79	799.19	761.58	719.35	631.69	539.67	499.91	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.71	0.52	0.38	0.41	0.64	0.91	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.11	20.32	20.57	20.82	20.95	20.99	21	21	20.98	20.8	20.41	20.08	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.1	20.1	20.1	20.12	20.12	20.14	20.14	20.14	20.13	20.12	20.12	20.11	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.66	0.45	0.3	0.33	0.57	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.93	19.23	19.58	19.92	20.08	20.13	20.14	20.14	20.12	19.9	19.36	18.89	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.25	19.52	19.85	20.16	20.32	20.37	20.37	20.37	20.35	20.15	19.65	19.21	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.1	19.37	19.7	20.01	20.17	20.22	20.22	20.22	20.2	20	19.5	19.06	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.66	0.46	0.31	0.34	0.57	0.87	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	529.63	633.99	693.88	680.29	567.72	382.16	247.56	260.25	413.1	549.01	526.46	496.32	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1062.89	1035.72	940.93	777.89	590.29	384.28	247.72	260.54	420.63	655.16	870.95	1051.73	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	396.74	269.97	183.81	70.27	16.79	0	0	0	0	78.97	248.03	413.23	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1677.81 (98)

Space heating requirement in kWh/m²/year 22.97 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	396.74	269.97	183.81	70.27	16.79	0	0	0	0	78.97	248.03	413.23	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	438.88	298.63	203.33	77.73	18.57	0	0	0	0	87.36	274.37	457.11	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1855.99 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	195.6	170.87	177.77	157.68	152.66	134.45	128.82	143.6	145.19	165.32	176.48	191.01

Efficiency of water heater 80.3 (216)

(217)m=	86.8	86.2	85.14	83.16	81.2	80.3	80.3	80.3	80.3	83.31	85.91	86.94	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	225.36	198.23	208.81	189.6	188.01	167.44	160.42	178.83	180.81	198.45	205.43	219.7	

Total = Sum(219a)$_{1...12}$ = 2321.08 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1855.99

DER WorkSheet: New dwelling design stage

Water heating fuel used		2321.08	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	171.09		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	201.09	(231)
Electricity for lighting		321.63	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	400.89	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	501.35	(264)
Space and water heating	(261) + (262) + (263) + (264) =				902.25	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	104.37	(267)
Electricity for lighting	(232) x		0.519	=	166.93	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			712.53	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			9.76	(273)
EI rating (section 14)					92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 46

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.73	(1a) x	2.56	(2a) =	188.75	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.73	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		188.75	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	31.87	17.3	14.57	x	0.16	=	2.33			(29)
Walls Type2	39.15	2.42	36.73	x	0.14	=	5.2			(29)
Roof	73.73	0	73.73	x	0.12	=	8.85			(30)
Total area of elements, m²			144.75							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 42.7 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1535.64 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.19 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 50.89 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.55	20.29	20.03	18.7	18.44	17.11	17.11	16.85	17.64	18.44	18.97	19.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	71.44	71.18	70.91	69.59	69.32	68	68	67.74	68.53	69.32	69.85	70.38	

Average = Sum(39)$_{1...12}$ /12= 69.52 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.97	0.97	0.96	0.94	0.94	0.92	0.92	0.92	0.93	0.94	0.95	0.95

Average = Sum(40)$_{1...12}$ /12= 0.94 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.61 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.57	94.99	91.4	87.82	84.24	80.65	80.65	84.24	87.82	91.4	94.99	98.57

Total = Sum(44)$_{1...12}$ = 1075.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.18	127.85	131.93	115.02	110.37	95.24	88.25	101.27	102.48	119.43	130.37	141.57

Total = Sum(45)$_{1...12}$ = 1409.95 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.93	19.18	19.79	17.25	16.55	14.29	13.24	15.19	15.37	17.91	19.55	21.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.23	43.72	46.58	43.31	42.93	39.77	41.1	42.93	43.31	46.58	46.84	50.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8	

Output from water heater (annual)$_{1...12}$ 1947.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.16	53.44	55.51	49.07	47.43	41.61	39.62	44.4	44.9	51.35	55.06	59.63	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	116.66	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.35	16.3	13.26	10.04	7.5	6.33	6.84	8.89	11.94	15.16	17.69	18.86	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.84	207.98	202.59	191.13	176.67	163.07	153.99	151.86	157.24	168.7	183.16	196.76	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	34.67	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	-93.33	(71)

Water heating gains (Table 5)

(72)m=	82.21	79.53	74.61	68.15	63.75	57.79	53.25	59.68	62.36	69.03	76.47	80.15	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	367.4	364.8	351.46	330.32	308.91	288.2	275.08	281.43	292.54	313.88	338.32	356.76	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	169.83	289.28	395.81	490.43	549.32	545.35	525.77	481.84	428.58	319.72	203.42	145.34	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	537.23	654.08	747.27	820.75	858.24	833.54	800.86	763.27	721.12	633.6	541.74	502.1	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.71	0.52	0.37	0.41	0.64	0.9	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.13	20.34	20.58	20.83	20.95	20.99	21	21	20.98	20.8	20.42	20.1	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.11	20.11	20.12	20.13	20.13	20.15	20.15	20.15	20.14	20.13	20.13	20.12	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.83	0.66	0.45	0.3	0.33	0.57	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.96	19.26	19.6	19.94	20.09	20.15	20.15	20.15	20.13	19.92	19.39	18.92	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.28	19.55	19.87	20.18	20.33	20.37	20.38	20.38	20.36	20.16	19.67	19.24	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.13	19.4	19.72	20.03	20.18	20.22	20.23	20.23	20.21	20.01	19.52	19.09	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.66	0.46	0.31	0.34	0.57	0.87	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	531.93	636.23	695.67	680.61	566.39	380.53	246.54	259.15	411.73	549.84	528.5	498.54	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1059.16	1031.93	937.33	774.52	587.57	382.44	246.69	259.41	418.68	652.45	867.63	1047.85	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	392.26	265.91	179.79	67.61	15.76	0	0	0	0	76.34	244.17	408.68	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1650.53 (98)

Space heating requirement in kWh/m²/year 22.39 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	392.26	265.91	179.79	67.61	15.76	0	0	0	0	76.34	244.17	408.68	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	433.91	294.15	198.89	74.79	17.43	0	0	0	0	84.45	270.1	452.08	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1825.81 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	196.41	171.57	178.51	158.33	153.29	135.01	129.35	144.19	145.79	166.01	177.21	191.8	

Efficiency of water heater 80.3 (216)

(217)m=	86.76	86.15	85.07	83.08	81.14	80.3	80.3	80.3	80.3	83.23	85.86	86.91	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	226.39	199.15	209.84	190.58	188.91	168.13	161.08	179.57	181.55	199.46	206.4	220.69	

Total = Sum(219a)$_{1...12}$ = 2331.76 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1825.81

DER WorkSheet: New dwelling design stage

Water heating fuel used		2331.76	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	172.7		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	202.7	(231)
Electricity for lighting		324.08	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	394.37	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	503.66	(264)
Space and water heating	(261) + (262) + (263) + (264) =				898.04	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	105.2	(267)
Electricity for lighting	(232) x		0.519	=	168.2	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			710.43	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			9.64	(273)
EI rating (section 14)					92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 47

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	58.88	(1a) x	2.56	(2a) =	150.74	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	58.88	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		150.74	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	31.19	15.57	15.62	x	0.16	=	2.5			(29)
Walls Type2	39.09	2.42	36.67	x	0.14	=	5.19			(29)
Roof	58.88	0	58.88	x	0.12	=	7.07			(30)
Total area of elements, m²			129.16							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 38.78 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1418.78 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.28 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 47.06 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	16.42	16.2	15.99	14.94	14.72	13.67	13.67	13.46	14.09	14.72	15.15	15.57	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	63.47	63.26	63.05	61.99	61.78	60.73	60.73	60.52	61.15	61.78	62.21	62.63	

Average = Sum(39)$_{1...12}$ /12= 61.94 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.08	1.07	1.07	1.05	1.05	1.03	1.03	1.03	1.04	1.05	1.06	1.06	
Average = Sum(40)$_{1...12}$ /12=													1.05 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.95 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 80.51 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	88.56	85.34	82.12	78.9	75.68	72.46	72.46	75.68	78.9	82.12	85.34	88.56	
Total = Sum(44)$_{1...12}$ =													966.12 (44)
Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)													
(45)m=	131.33	114.86	118.53	103.34	99.15	85.56	79.29	90.98	92.07	107.3	117.12	127.19	
Total = Sum(45)$_{1...12}$ =													1266.73 (45)
If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)													
(46)m=	19.7	17.23	17.78	15.5	14.87	12.83	11.89	13.65	13.81	16.09	17.57	19.08	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	45.13	39.28	41.85	38.91	38.57	35.73	36.92	38.57	38.91	41.85	42.09	45.13	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32	

Output from water heater (annual)$_{1...12}$ 1749.66 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	54.95	48.01	49.87	44.09	42.61	37.38	35.59	39.89	40.34	46.14	49.47	53.57	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	97.49	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	15.17	13.47	10.96	8.29	6.2	5.23	5.66	7.35	9.87	12.53	14.62	15.59	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	170.12	171.89	167.44	157.97	146.01	134.78	127.27	125.51	129.95	139.42	151.38	162.62	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	32.75	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	-78	(71)

Water heating gains (Table 5)

(72)m=	73.86	71.45	67.03	61.23	57.27	51.92	47.84	53.62	56.03	62.01	68.7	72.01	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	314.39	312.05	300.68	282.74	264.73	247.18	236.02	241.72	251.1	269.21	289.95	305.46	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast	0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)
Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast	0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast	0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast	0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast	0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast	0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast	0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast	0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast	0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast	0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)
Southeast	0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	152.85	260.36	356.23	441.39	494.39	490.81	473.2	433.65	385.72	287.75	183.08	130.81	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	467.24	572.41	656.9	724.13	759.12	737.99	709.21	675.38	636.82	556.96	473.03	436.26	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.86	0.71	0.52	0.38	0.41	0.64	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.04	20.26	20.52	20.79	20.94	20.99	21	21	20.97	20.77	20.35	20	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.02	20.02	20.02	20.04	20.04	20.06	20.06	20.06	20.05	20.04	20.04	20.03	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.82	0.65	0.45	0.3	0.33	0.56	0.86	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.75	19.07	19.45	19.81	19.99	20.05	20.06	20.06	20.03	19.8	19.22	18.71	(90)

fLA = Living area ÷ (4) = 0.34 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.19	19.47	19.81	20.14	20.31	20.37	20.37	20.38	20.35	20.13	19.6	19.14	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.04	19.32	19.66	19.99	20.16	20.22	20.22	20.23	20.2	19.98	19.45	18.99	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.92	0.82	0.66	0.46	0.31	0.34	0.57	0.86	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	461.24	553.47	605.81	594.63	498.93	338.53	219.87	231.12	364.43	479.05	459.04	432.13	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	935.35	912.53	829.94	687.77	522.7	341.21	220.12	231.54	373.05	579.24	768.38	926.4	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	352.74	241.29	166.75	67.07	17.69	0	0	0	0	74.54	222.72	367.74	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1510.54 (98)

Space heating requirement in kWh/m²/year 25.65 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	352.74	241.29	166.75	67.07	17.69	0	0	0	0	74.54	222.72	367.74	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	390.2	266.91	184.46	74.19	19.57	0	0	0	0	82.46	246.38	406.79	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1670.95 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	176.46	154.14	160.38	142.25	137.72	121.3	116.21	129.55	130.98	149.15	159.21	172.32

Efficiency of water heater 80.3 (216)

(217)m=	86.76	86.17	85.15	83.28	81.33	80.3	80.3	80.3	80.3	83.41	85.9	86.91

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	203.39	178.87	188.35	170.8	169.33	151.05	144.72	161.33	163.11	178.82	185.35	198.27

Total = Sum(219a)$_{1...12}$ = 2093.39 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1670.95	
Water heating fuel used		2093.39	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	137.93		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		167.93	(231)
Electricity for lighting		267.84	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	360.93	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	452.17	(264)
Space and water heating	(261) + (262) + (263) + (264) =			813.1	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	87.15	(267)
Electricity for lighting	(232) x	0.519	=	139.01	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			578.26	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			9.82	(273)
EI rating (section 14)				93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 48

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.42	(1a) x	2.56	(2a) =	187.95	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.42	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.95	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Windows Type 4			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	52.48	23.08	29.4	x	0.16	=	4.7			(29)
Walls Type2	22.71	2.42	20.29	x	0.14	=	2.87			(29)
Roof	73.42	0	73.42	x	0.12	=	8.81			(30)
Total area of elements, m²			148.61							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 50.37 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1505.51 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 10.78 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 61.15 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.47	20.2	19.94	18.62	18.36	17.04	17.04	16.78	17.57	18.36	18.89	19.41	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	81.62	81.35	81.09	79.77	79.51	78.19	78.19	77.93	78.72	79.51	80.04	80.56	

Average = Sum(39)$_{1...12}$ /12= 79.74 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.11	1.11	1.1	1.09	1.08	1.07	1.07	1.06	1.07	1.08	1.09	1.1	

Average = Sum(40)$_{1...12}$ /12= 1.09 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.33 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.45 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	98.39	94.81	91.24	87.66	84.08	80.5	80.5	84.08	87.66	91.24	94.81	98.39	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1073.36 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	145.91	127.61	131.69	114.81	110.16	95.06	88.09	101.08	102.29	119.21	130.12	141.31	

Total = Sum(45)$_{1...12}$ = 1407.34 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	21.89	19.14	19.75	17.22	16.52	14.26	13.21	15.16	15.34	17.88	19.52	21.2	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.14	43.64	46.49	43.23	42.85	39.7	41.02	42.85	43.23	46.49	46.76	50.14	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45	

Output from water heater (annual)$_{1...12}$ 1943.87 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.05	53.34	55.41	48.98	47.34	41.53	39.54	44.32	44.82	51.26	54.96	59.52	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	116.31	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.29	16.24	13.21	10	7.48	6.31	6.82	8.86	11.9	15.11	17.63	18.8	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	205.14	207.27	201.9	190.48	176.07	162.52	153.47	151.34	156.7	168.12	182.54	196.09	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	34.63	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	-93.05	(71)

Water heating gains (Table 5)

(72)m=	82.06	79.38	74.47	68.03	63.63	57.68	53.15	59.57	62.25	68.9	76.33	80	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	366.38	363.78	350.48	329.41	308.07	287.41	274.33	280.67	291.74	313.02	337.39	355.78	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast	0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast	0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast	0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast	0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast	0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast	0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast	0.9x	0.77	x	8.06	x	36.79	x	0.55	x	0.7	=	79.12	(77)
Southeast	0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast	0.9x	0.77	x	8.06	x	62.67	x	0.55	x	0.7	=	134.78	(77)
Southeast	0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast	0.9x	0.77	x	8.06	x	85.75	x	0.55	x	0.7	=	184.41	(77)
Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	8.06	x	106.25	x	0.55	x	0.7	=	228.49	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	8.06	x	119.01	x	0.55	x	0.7	=	255.93	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	8.06	x	118.15	x	0.55	x	0.7	=	254.08	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	8.06	x	113.91	x	0.55	x	0.7	=	244.96	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	8.06	x	104.39	x	0.55	x	0.7	=	224.49	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	8.06	x	92.85	x	0.55	x	0.7	=	199.67	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	8.06	x	69.27	x	0.55	x	0.7	=	148.96	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	8.06	x	44.07	x	0.55	x	0.7	=	94.77	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	8.06	x	31.49	x	0.55	x	0.7	=	67.71	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)
Southwest	0.9x	0.77	x	2.89	x	36.79		0.55	x	0.7	=	28.37	(79)
Southwest	0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	48.33	(79)
Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	66.12	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	81.93	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	91.77	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	44.07	0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49	0.55	x	0.7	=	24.28	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	206.9	355.32	493.84	624.75	711.52	711.54	683.85	618.33	539.05	394.77	248.35	176.72	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	573.28	719.1	844.32	954.16	1019.59	998.95	958.18	899	830.79	707.79	585.74	532.5	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.85	0.68	0.49	0.36	0.4	0.63	0.9	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.98	20.22	20.51	20.79	20.94	20.99	21	21	20.97	20.75	20.31	19.94	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.99	19.99	20	20.01	20.01	20.03	20.03	20.03	20.02	20.01	20.01	20	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.81	0.62	0.42	0.28	0.31	0.55	0.86	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.65	19	19.41	19.79	19.97	20.02	20.03	20.03	20.01	19.75	19.14	18.6	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.98	19.3	19.68	20.04	20.21	20.27	20.27	20.27	20.25	20	19.43	18.93	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.83	19.15	19.53	19.89	20.06	20.12	20.12	20.12	20.1	19.85	19.28	18.78	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	0.99	0.97	0.92	0.8	0.63	0.43	0.29	0.32	0.56	0.86	0.97	0.99	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	566.26	694.82	773.82	766.02	638.78	428.58	275.11	289.69	461.7	606.19	568.88	527.78	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	1185.9	1159.51	1056.76	876.95	664.79	431.35	275.36	290.15	472.08	735.74	974.74	1174.69	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	461.01	312.27	210.51	79.87	19.35	0	0	0	0	96.38	292.22	481.3	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1952.92 (98)

Space heating requirement in kWh/m²/year 26.6 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

DER WorkSheet: New dwelling design stage

Fraction of space heat from main system(s)	(202) = 1 – (201) =	1	(202)
Fraction of total heating from main system 1	(204) = (202) × [1 – (203)] =	1	(204)
Efficiency of main space heating system 1		90.4	(206)
Efficiency of secondary/supplementary heating system, %		0	(208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	461.01	312.27	210.51	79.87	19.35	0	0	0	0	96.38	292.22	481.3	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)	509.97	345.44	232.87	88.35	21.41	0	0	0	0	106.62	323.25	532.42	(211)

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 2160.31 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Output from water heater (calculated above)	196.05	171.25	178.18	158.04	153.01	134.76	129.11	143.93	145.52	165.7	176.88	191.45
Efficiency of water heater												80.3 (216)
(217)m=	87.13	86.54	85.47	83.43	81.32	80.3	80.3	80.3	80.3	83.74	86.31	87.28 (217)
Fuel for water heating, kWh/month (219)m = (64)m x 100 ÷ (217)m												
(219)m=	225.01	197.88	208.47	189.43	188.15	167.82	160.79	179.24	181.22	197.87	204.95	219.36

Total = Sum(219a)$_{1...12}$ = 2320.17 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2160.31	
Water heating fuel used		2320.17	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	171.97		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	201.97	(231)
Electricity for lighting		322.98	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	466.63		(261)
Space heating (secondary)	(215) x	0.519	=	0		(263)
Water heating	(219) x	0.216	=	501.16		(264)
Space and water heating	(261) + (262) + (263) + (264) =			967.78		(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	104.82		(267)

DER WorkSheet: New dwelling design stage

Electricity for lighting	(232) x	0.519	=	167.63	(268)
Energy saving/generation technologies Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			779.23	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			10.61	(273)
EI rating (section 14)				91	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 49

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	72.68	(1a) x	2.56	(2a) =	186.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	72.68	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x	1/[1/(1.4)+ 0.04]	=	10.69			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Windows Type 3			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Walls Type1	55.67	20.19	35.48	x	0.16	=	5.68			(29)
Walls Type2	22.71	2.42	20.29	x	0.14	=	2.87			(29)
Roof	72.68	0	72.68	x	0.12	=	8.72			(30)
Total area of elements, m²			151.05							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 47.42 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1602.12 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.02 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 56.44 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.26	20	19.74	18.43	18.17	16.87	16.87	16.61	17.39	18.17	18.7	19.22	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	76.71	76.44	76.18	74.88	74.62	73.31	73.31	73.05	73.83	74.62	75.14	75.66	

Average = Sum(39)$_{1...12}$ /12= 74.81 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.06	1.05	1.05	1.03	1.03	1.01	1.01	1.01	1.02	1.03	1.03	1.04

Average = Sum(40)$_{1...12}$ /12= 1.03 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.31 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.05 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	97.95	94.39	90.83	87.26	83.7	80.14	80.14	83.7	87.26	90.83	94.39	97.95

Total = Sum(44)$_{1...12}$ = 1068.55 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.26	127.04	131.1	114.29	109.67	94.63	87.69	100.63	101.83	118.67	129.54	140.67

Total = Sum(45)$_{1...12}$ = 1401.04 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.79	19.06	19.66	17.14	16.45	14.2	13.15	15.09	15.27	17.8	19.43	21.1

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.91	43.44	46.28	43.03	42.65	39.52	40.84	42.65	43.03	46.28	46.55	49.91	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59	

Output from water heater (annual)$_{1...12}$ 1935.17 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.78	53.1	55.16	48.76	47.13	41.35	39.37	44.12	44.62	51.03	54.71	59.25	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	115.46	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.14	16.11	13.1	9.92	7.41	6.26	6.76	8.79	11.8	14.98	17.49	18.64	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	203.46	205.57	200.25	188.92	174.63	161.19	152.21	150.1	155.42	166.75	181.05	194.48	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	34.55	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	-92.37	(71)

Water heating gains (Table 5)

(72)m=	81.69	79.02	74.14	67.72	63.34	57.43	52.91	59.3	61.97	68.59	75.99	79.64	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	363.93	361.34	348.13	327.21	306.03	285.51	272.53	278.84	289.83	310.96	335.16	353.41	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)
Northwest 0.9x	0.77	x	8.06	x	11.28	x	0.55	x	0.7	=	24.26	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	8.06	x	22.97	x	0.55	x	0.7	=	49.39	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	8.06	x	41.38	x	0.55	x	0.7	=	88.98	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	8.06	x	67.96	x	0.55	x	0.7	=	146.14	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	8.06	x	91.35	x	0.55	x	0.7	=	196.43	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	8.06	x	97.38	x	0.55	x	0.7	=	209.42	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	8.06	x	91.1	x	0.55	x	0.7	=	195.91	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	8.06	x	72.63	x	0.55	x	0.7	=	156.18	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	8.06	x	50.42	x	0.55	x	0.7	=	108.43	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	8.06	x	28.07	x	0.55	x	0.7	=	60.36	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	8.06	x	14.2	x	0.55	x	0.7	=	30.53	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	8.06	x	9.21	x	0.55	x	0.7	=	19.81	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	80.45	154.33	257.11	395.59	513.39	540.6	508.33	415.72	304.32	182.96	99.51	66.81	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	444.38	515.68	605.25	722.8	819.42	826.12	780.86	694.56	594.15	493.92	434.67	420.22	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.92	0.77	0.56	0.41	0.48	0.78	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.9	20.06	20.33	20.69	20.91	20.99	21	21	20.94	20.61	20.19	19.88	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.04	20.04	20.04	20.06	20.06	20.08	20.08	20.08	20.07	20.06	20.06	20.05	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.9	0.71	0.48	0.33	0.39	0.7	0.95	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.57	18.8	19.19	19.7	19.98	20.07	20.08	20.08	20.02	19.61	19.01	18.54	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.9	19.11	19.48	19.95	20.22	20.3	20.31	20.31	20.25	19.86	19.3	18.88	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.75	18.96	19.33	19.8	20.07	20.15	20.16	20.16	20.1	19.71	19.15	18.73	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.89	0.71	0.49	0.33	0.39	0.7	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	442.43	510.55	587.21	644.98	584.25	402.82	260.33	273.55	417.18	467.31	430.58	418.83	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1108.32	1074.91	977.19	815.93	624.3	406.8	260.71	274.46	442.99	679.48	905.72	1099.12	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	495.42	379.25	290.14	123.08	29.79	0	0	0	0	157.85	342.1	506.13	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2323.78 (98)

Space heating requirement in kWh/m²/year 31.97 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	495.42	379.25	290.14	123.08	29.79	0	0	0	0	157.85	342.1	506.13	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	548.03	419.52	320.96	136.16	32.96	0	0	0	0	174.62	378.43	559.88	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2570.55 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	195.17	170.49	177.38	157.33	152.32	134.16	128.53	143.28	144.87	164.96	176.09	190.59

Efficiency of water heater 80.3 (216)

(217)m= 87.3 | 87.01 | 86.28 | 84.44 | 81.8 | 80.3 | 80.3 | 80.3 | 80.3 | 84.94 | 86.69 | 87.39 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 223.57 | 195.95 | 205.58 | 186.32 | 186.22 | 167.07 | 160.07 | 178.43 | 180.41 | 194.2 | 203.12 | 218.08

Total = Sum(219a)$_{1...12}$ = 2299.02 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2570.55	
Water heating fuel used		2299.02	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	170.24		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		200.24	(231)
Electricity for lighting		320.33	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	555.24	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	496.59	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1051.83	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	103.92	(267)
Electricity for lighting	(232) x	0.519	=	166.25	(268)
Energy saving/generation technologies Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			861	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			11.85	(273)
EI rating (section 14)				90	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 50

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	66.61	(1a) x	2.56	(2a) =	170.53	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	66.61	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		170.53	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			8.06	x1/[1/(1.4)+ 0.04]		=	10.69			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Walls Type1	31.65	14.38	17.27	x	0.16	=	2.76			(29)
Walls Type2	32.4	2.42	29.98	x	0.14	=	4.24			(29)
Roof	66.61	0	66.61	x	0.12	=	7.99			(30)
Total area of elements, m²			130.66							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 37.45 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1402.72 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.26 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 45.71 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	18.57	18.33	18.09	16.9	16.66	15.46	15.46	15.22	15.94	16.66	17.14	17.61	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	64.28	64.04	63.8	62.6	62.36	61.17	61.17	60.93	61.65	62.36	62.84	63.32	

Average = Sum(39)$_{1...12}$ /12= 62.54 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.96	0.96	0.94	0.94	0.92	0.92	0.91	0.93	0.94	0.94	0.95

Average = Sum(40)$_{1...12}$ /12= 0.94 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.16 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 85.53 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	94.08	90.66	87.24	83.82	80.4	76.98	76.98	80.4	83.82	87.24	90.66	94.08

Total = Sum(44)$_{1...12}$ = 1026.35 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	139.52	122.03	125.92	109.78	105.34	90.9	84.23	96.65	97.81	113.99	124.43	135.12

Total = Sum(45)$_{1...12}$ = 1345.71 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	20.93	18.3	18.89	16.47	15.8	13.63	12.63	14.5	14.67	17.1	18.66	20.27

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.94	41.73	44.46	41.34	40.97	37.96	39.23	40.97	41.34	44.46	44.71	47.94	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06	

Output from water heater (annual)$_{1...12}$ 1858.74 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	58.38	51.01	52.98	46.84	45.27	39.71	37.81	42.38	42.86	49.01	52.55	56.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	108.06	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.89	15	12.2	9.24	6.91	5.83	6.3	8.19	10.99	13.95	16.29	17.36	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	189.27	191.24	186.29	175.75	162.45	149.95	141.6	139.63	144.58	155.12	168.42	180.92	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	33.81	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	-86.45	(71)

Water heating gains (Table 5)

(72)m=	78.46	75.9	71.21	65.05	60.84	55.16	50.82	56.96	59.52	65.88	72.98	76.5	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	343.05	340.56	328.12	308.46	288.62	269.35	257.14	263.2	273.51	293.37	316.11	333.2	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	8.06	x	11.28	x	0.55	x	0.7	=	24.26	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	8.06	x	22.97	x	0.55	x	0.7	=	49.39	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	8.06	x	41.38	x	0.55	x	0.7	=	88.98	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	8.06	x	67.96	x	0.55	x	0.7	=	146.14	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	8.06	x	91.35	x	0.55	x	0.7	=	196.43	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	8.06	x	97.38	x	0.55	x	0.7	=	209.42	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	8.06	x	91.1	x	0.55	x	0.7	=	195.91	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	8.06	x	72.63	x	0.55	x	0.7	=	156.18	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	8.06	x	50.42	x	0.55	x	0.7	=	108.43	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	8.06	x	28.07	x	0.55	x	0.7	=	60.36	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	8.06	x	14.2	x	0.55	x	0.7	=	30.53	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	8.06	x	9.21	x	0.55	x	0.7	=	19.81	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	43.29	88.12	158.76	260.72	350.46	373.63	349.52	278.64	193.45	107.68	54.47	35.35	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	386.33	428.67	486.88	569.18	639.08	642.99	606.66	541.85	466.96	401.06	370.58	368.55	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.81	0.6	0.44	0.51	0.81	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20	20.12	20.35	20.68	20.91	20.99	21	21	20.93	20.62	20.26	19.98	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.11	20.12	20.12	20.13	20.14	20.15	20.15	20.16	20.15	20.14	20.13	20.12	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.93	0.76	0.52	0.36	0.42	0.75	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.76	18.94	19.29	19.76	20.05	20.14	20.15	20.15	20.09	19.69	19.16	18.75	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.1	19.27	19.58	20.01	20.29	20.38	20.38	20.38	20.32	19.95	19.47	19.09	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.95	19.12	19.43	19.86	20.14	20.23	20.23	20.23	20.17	19.8	19.32	18.94	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.76	0.53	0.37	0.43	0.75	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	385.03	425.82	477.4	525.05	486.67	340.42	221.93	232.82	349.38	385.37	367.97	367.59	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	941.8	910.38	824.77	686.24	526.17	344.12	222.25	233.63	374.41	573.57	767.64	933.32	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	414.24	325.63	258.44	116.06	29.39	0	0	0	0	140.02	287.77	420.9	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1992.44 (98)

Space heating requirement in kWh/m²/year 29.91 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	414.24	325.63	258.44	116.06	29.39	0	0	0	0	140.02	287.77	420.9	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	458.23	360.21	285.89	128.38	32.51	0	0	0	0	154.89	318.33	465.6	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2204.03 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	187.46	163.75	170.38	151.12	146.31	128.86	123.46	137.62	139.14	158.44	169.14	183.06

Efficiency of water heater 80.3 (216)

(217)m=	86.99	86.75	86.1	84.4	81.83	80.3	80.3	80.3	80.3	84.74	86.38	87.08	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	215.5	188.77	197.89	179.06	178.79	160.47	153.74	171.39	173.28	186.97	195.81	210.22	

Total = Sum(219a)$_{1...12}$ = 2211.89 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2204.03

DER WorkSheet: New dwelling design stage

Water heating fuel used		2211.89	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	156.04		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	186.04	(231)
Electricity for lighting		298.32	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	476.07	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	477.77	(264)
Space and water heating	(261) + (262) + (263) + (264) =				953.84	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	96.55	(267)
Electricity for lighting	(232) x		0.519	=	154.83	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			744.22	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.17	(273)
EI rating (section 14)					91	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 51

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.61	(1a) x	2.56	(2a) =	132.12	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.61	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		132.12	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	25.19	9.48	15.71	x	0.16	=	2.51			(29)
Walls Type2	25.13	2.42	22.71	x	0.14	=	3.21			(29)
Roof	51.61	0	51.61	x	0.12	=	6.19			(30)
Total area of elements, m²			101.93							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 27.87 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1117.59 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.35 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.22 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.39	14.2	14.02	13.09	12.91	11.98	11.98	11.79	12.35	12.91	13.28	13.65	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	49.61	49.43	49.24	48.31	48.13	47.2	47.2	47.02	47.57	48.13	48.5	48.87	

Average = Sum(39)$_{1...12}$ /12= 48.27 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.96	0.95	0.94	0.93	0.91	0.91	0.91	0.92	0.93	0.94	0.95

Average = Sum(40)$_{1...12}$ /12= 0.94 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.47 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	83.01	79.99	76.98	73.96	70.94	67.92	67.92	70.94	73.96	76.98	79.99	83.01

Total = Sum(44)$_{1...12}$ = 905.59 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	123.1	107.67	111.1	96.86	92.94	80.2	74.32	85.28	86.3	100.58	109.79	119.22

Total = Sum(45)$_{1...12}$ = 1187.37 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.47	16.15	16.67	14.53	13.94	12.03	11.15	12.79	12.95	15.09	16.47	17.88

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.3	36.82	39.23	36.47	36.15	33.49	34.61	36.15	36.47	39.23	39.45	42.3	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52	

Output from water heater (annual)$_{1...12}$ 1640.04 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.51	45	46.75	41.32	39.94	35.04	33.36	37.39	37.81	43.25	46.37	50.22	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	86.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.74	12.21	9.93	7.52	5.62	4.74	5.12	6.66	8.94	11.35	13.25	14.13	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.41	152.98	149.02	140.59	129.95	119.95	113.27	111.7	115.66	124.09	134.73	144.73	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	31.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	-69.5	(71)

Water heating gains (Table 5)

(72)m=	69.23	66.97	62.83	57.4	53.68	48.67	44.84	50.26	52.52	58.13	64.4	67.5	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	286.45	284.22	273.84	257.57	241.32	225.43	215.3	220.68	229.18	245.63	264.44	278.41	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	9.51	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	19.36	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	34.89	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	57.29	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	77.01	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	82.11	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	76.81	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	61.23	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	42.51	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	23.66	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	11.97	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	7.77	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	28.54	58.09	104.66	171.88	231.04	246.32	230.42	183.7	127.53	70.99	35.91	23.31	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	314.98	342.31	378.5	429.45	472.36	471.74	445.73	404.38	356.71	316.62	300.35	301.72	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.83	0.62	0.46	0.53	0.82	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.03	20.14	20.36	20.67	20.9	20.99	21	21	20.93	20.64	20.29	20.02	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.12	20.12	20.14	20.14	20.16	20.16	20.16	20.15	20.14	20.13	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.94	0.78	0.55	0.38	0.44	0.75	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.82	18.98	19.3	19.75	20.04	20.15	20.15	20.16	20.09	19.71	19.21	18.81	(90)

fLA = Living area ÷ (4) = 0.35 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.25	19.39	19.67	20.07	20.34	20.44	20.45	20.45	20.39	20.04	19.59	19.23	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.1	19.24	19.52	19.92	20.19	20.29	20.3	20.3	20.24	19.89	19.44	19.08	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.79	0.56	0.39	0.45	0.76	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	313.67	339.76	371.22	399.61	372.18	264.82	174.41	182.69	271.06	303.65	297.81	300.72	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	734.06	708.86	641.26	532.49	408.8	268.71	174.77	183.52	292.13	447.08	598.55	727.43	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	312.77	248.04	200.91	95.67	27.24	0	0	0	0	106.71	216.53	317.47	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1525.34 (98)

Space heating requirement in kWh/m²/year 29.56 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	312.77	248.04	200.91	95.67	27.24	0	0	0	0	106.71	216.53	317.47	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	345.98	274.38	222.24	105.83	30.13	0	0	0	0	118.04	239.52	351.18	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1687.32 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.41	144.49	150.33	133.33	129.09	113.7	108.93	121.43	122.77	139.8	149.23	161.52

Efficiency of water heater 80.3 (216)

(217)m=	86.63	86.4	85.78	84.23	81.89	80.3	80.3	80.3	80.3	84.38	85.99	86.72	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	190.93	167.23	175.25	158.3	157.63	141.59	135.65	151.22	152.89	165.68	173.55	186.25	

Total = Sum(219a)$_{1...12}$ = 1956.18 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1687.32

DER WorkSheet: New dwelling design stage

Water heating fuel used		1956.18	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	120.89		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	150.89	(231)
Electricity for lighting		242.71	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	364.46	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	422.54	(264)
Space and water heating	(261) + (262) + (263) + (264) =				787	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	78.31	(267)
Electricity for lighting	(232) x		0.519	=	125.97	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			530.27	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			10.27	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 52

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.63	(1a) x	2.56	(2a) =	129.62	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.63	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.62	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	24.86	9.48	15.38	x	0.16	=	2.46			(29)
Walls Type2	19.11	2.42	16.69	x	0.14	=	2.36			(29)
Roof	50.63	0	50.63	x	0.12	=	6.08			(30)
Total area of elements, m²			94.6							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 26.85 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1000.85 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.67 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 34.53 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.12	13.93	13.75	12.84	12.66	11.75	11.75	11.57	12.12	12.66	13.02	13.39	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	48.64	48.46	48.28	47.37	47.19	46.28	46.28	46.1	46.64	47.19	47.55	47.91	

Average = Sum(39)$_{1...12}$ /12= 47.32 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.96	0.95	0.94	0.93	0.91	0.91	0.91	0.92	0.93	0.94	0.95

Average = Sum(40)$_{1...12}$ /12= 0.93 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.71 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.78 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.26	79.27	76.28	73.29	70.29	67.3	67.3	70.29	73.29	76.28	79.27	82.26

Total = Sum(44)$_{1...12}$ = 897.38 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.99	106.69	110.1	95.98	92.1	79.48	73.65	84.51	85.52	99.66	108.79	118.14

Total = Sum(45)$_{1...12}$ = 1176.6 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.3	16	16.51	14.4	13.81	11.92	11.05	12.68	12.83	14.95	16.32	17.72

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.92	36.49	38.87	36.14	35.82	33.19	34.3	35.82	36.14	38.87	39.09	41.92	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06	

Output from water heater (annual)$_{1...12}$ 1625.17 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.04	44.6	46.32	40.95	39.58	34.72	33.06	37.05	37.47	42.86	45.95	49.76	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	85.43	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.48	11.97	9.73	7.37	5.51	4.65	5.02	6.53	8.77	11.13	12.99	13.85	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.87	150.42	146.52	138.24	127.78	117.94	111.37	109.83	113.72	122.01	132.47	142.3	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	31.54	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	-68.35	(71)

Water heating gains (Table 5)

(72)m=	68.6	66.36	62.26	56.88	53.2	48.23	44.44	49.8	52.04	57.6	63.81	66.88	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	282.58	280.38	270.15	254.11	238.11	222.45	212.47	217.8	226.16	242.37	260.91	274.67	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	9.51	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	19.36	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	34.89	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	57.29	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	77.01	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	82.11	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	76.81	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	61.23	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	42.51	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	23.66	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	11.97	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	7.77	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	28.54	58.09	104.66	171.88	231.04	246.32	230.42	183.7	127.53	70.99	35.91	23.31	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	311.12	338.47	374.81	425.99	469.15	468.77	442.89	401.49	353.69	313.36	296.82	297.97	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.83	0.62	0.46	0.52	0.81	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.04	20.15	20.37	20.67	20.9	20.99	21	21	20.93	20.64	20.29	20.02	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.12	20.12	20.14	20.14	20.16	20.16	20.16	20.15	20.14	20.13	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.93	0.78	0.54	0.37	0.43	0.75	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.82	18.99	19.31	19.76	20.05	20.15	20.15	20.16	20.1	19.72	19.22	18.81	(90)

fLA = Living area ÷ (4) = 0.36 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.26	19.41	19.69	20.09	20.35	20.45	20.46	20.46	20.4	20.05	19.61	19.25	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.11	19.26	19.54	19.94	20.2	20.3	20.31	20.31	20.25	19.9	19.46	19.1	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.78	0.56	0.39	0.45	0.75	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	309.78	335.86	367.32	395.25	366.85	260.17	171.3	179.45	266.9	300.1	294.23	296.96	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	720.42	695.75	629.5	522.8	401.3	263.76	171.64	180.21	286.8	438.93	587.49	713.88	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	305.51	241.85	195.07	91.83	25.63	0	0	0	0	103.29	211.14	310.19	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1484.52 (98)

Space heating requirement in kWh/m²/year 29.32 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	305.51	241.85	195.07	91.83	25.63	0	0	0	0	103.29	211.14	310.19	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	337.96	267.53	215.78	101.59	28.35	0	0	0	0	114.26	233.57	343.13	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1642.17 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.91	143.18	148.97	132.13	127.92	112.67	107.94	120.33	121.66	138.53	147.88	160.06

Efficiency of water heater 80.3 (216)

(217)m=	86.6	86.36	85.73	84.16	81.83	80.3	80.3	80.3	80.3	84.32	85.95	86.69	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.28	165.79	173.76	157	156.33	140.31	134.42	149.85	151.51	164.29	172.06	184.64	

Total = Sum(219a)$_{1...12}$ = 1939.23 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1642.17

DER WorkSheet: New dwelling design stage

Water heating fuel used		1939.23	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	118.6		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	148.6	(231)
Electricity for lighting		237.98	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	354.71	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	418.87	(264)
Space and water heating	(261) + (262) + (263) + (264) =				773.58	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	77.12	(267)
Electricity for lighting	(232) x		0.519	=	123.51	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			513.21	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			10.14	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 53

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.03	(1a) x	2.56	(2a) =	130.63	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.03	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.63	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Windows Type 2			3.16	x1/[1/(1.4)+ 0.04]		=	4.19			(27)
Walls Type1	25.06	9.48	15.58	x	0.16	=	2.49			(29)
Walls Type2	19.31	2.42	16.89	x	0.14	=	2.39			(29)
Roof	50.03	0	50.03	x	0.12	=	6			(30)
Total area of elements, m²			94.4							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 26.84 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1002.21 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.7 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 34.54 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.23	14.04	13.86	12.94	12.76	11.84	11.84	11.66	12.21	12.76	13.13	13.49	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	48.76	48.58	48.4	47.48	47.3	46.38	46.38	46.2	46.75	47.3	47.66	48.03	

Average = Sum(39)$_{1...12}$ /12= 47.43 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.95	0.95	0.93	0.93	0.91	0.91	0.91	0.92	0.93	0.93	0.94

Average = Sum(40)$_{1...12}$ /12= 0.93 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.06 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.56	79.56	76.56	73.56	70.55	67.55	67.55	70.55	73.56	76.56	79.56	82.56

Total = Sum(44)$_{1...12}$ = 900.7 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.44	107.09	110.5	96.34	92.44	79.77	73.92	84.82	85.83	100.03	109.19	118.58

Total = Sum(45)$_{1...12}$ = 1180.95 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.37	16.06	16.58	14.45	13.87	11.97	11.09	12.72	12.88	15	16.38	17.79

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.07	36.62	39.01	36.27	35.95	33.31	34.42	35.95	36.27	39.01	39.24	42.07	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65	

Output from water heater (annual)$_{1...12}$ 1631.18 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.23	44.76	46.5	41.1	39.72	34.85	33.18	37.19	37.61	43.01	46.12	49.95	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	86.02	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.58	12.06	9.81	7.43	5.55	4.69	5.07	6.58	8.84	11.22	13.1	13.96	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.9	151.45	147.53	139.19	128.66	118.76	112.14	110.59	114.51	122.85	133.38	143.28	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	31.6	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	-68.81	(71)

Water heating gains (Table 5)

(72)m=	68.86	66.61	62.49	57.09	53.39	48.4	44.6	49.99	52.23	57.81	64.05	67.13	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	284.14	281.93	271.65	255.51	239.41	223.65	213.61	218.96	227.38	243.69	262.33	276.18	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	9.51	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	19.36	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	34.89	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	57.29	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	77.01	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	82.11	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	76.81	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	61.23	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	42.51	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	23.66	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	11.97	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	7.77	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	28.54	58.09	104.66	171.88	231.04	246.32	230.42	183.7	127.53	70.99	35.91	23.31	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	312.68	340.02	376.3	427.39	470.45	469.97	444.04	402.66	354.91	314.68	298.24	299.49	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.83	0.62	0.46	0.52	0.81	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.04	20.15	20.37	20.68	20.9	20.99	21	21	20.94	20.64	20.3	20.03	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.12	20.13	20.14	20.14	20.16	20.16	20.16	20.15	20.14	20.14	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.93	0.78	0.54	0.37	0.43	0.75	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.84	19	19.32	19.76	20.05	20.15	20.16	20.16	20.1	19.73	19.23	18.83	(90)

fLA = Living area ÷ (4) = 0.36 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.27	19.41	19.69	20.09	20.36	20.45	20.46	20.46	20.4	20.06	19.61	19.26	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.12	19.26	19.54	19.94	20.21	20.3	20.31	20.31	20.25	19.91	19.46	19.11	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.93	0.78	0.56	0.39	0.45	0.75	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	311.35	337.43	368.84	396.69	368.02	260.84	171.71	179.88	267.79	301.41	295.67	298.48	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	722.52	697.74	631.26	524.16	402.3	264.38	172.04	180.63	287.51	440.1	589.12	715.92	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	305.91	242.13	195.24	91.78	25.51	0	0	0	0	103.19	211.29	310.57	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1485.62 (98)

Space heating requirement in kWh/m²/year 29.11 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	305.91	242.13	195.24	91.78	25.51	0	0	0	0	103.19	211.29	310.57	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	338.39	267.85	215.97	101.53	28.21	0	0	0	0	114.15	233.73	343.55	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1643.38 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.51	143.71	149.52	132.61	128.39	113.08	108.34	120.78	122.11	139.05	148.43	160.65

Efficiency of water heater 80.3 (216)

(217)m=	86.59	86.35	85.72	84.15	81.81	80.3	80.3	80.3	80.3	84.31	85.94	86.68	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	189.99	166.41	174.42	157.6	156.93	140.82	134.92	150.41	152.07	164.92	172.71	185.33	

Total = Sum(219a)$_{1...12}$ = 1946.53 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1643.38

DER WorkSheet: New dwelling design stage

Water heating fuel used		1946.53	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	119.52		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	149.52	(231)
Electricity for lighting		239.88	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	354.97	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	420.45	(264)
Space and water heating	(261) + (262) + (263) + (264) =				775.42	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	77.6	(267)
Electricity for lighting	(232) x		0.519	=	124.5	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			516.52	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			10.12	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 54

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	71.86	(1a) x	2.56	(2a) =	183.97	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	71.86	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		183.97	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Windows Type 2			3.16	x	1/[1/(1.4)+ 0.04]	=	4.19			(27)
Walls Type1	36.57	12.64	23.93	x	0.16	=	3.83			(29)
Walls Type2	26	2.42	23.58	x	0.14	=	3.33			(29)
Roof	71.86	0	71.86	x	0.12	=	8.62			(30)
Total area of elements, m²			134.43							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 35.93 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1454.36 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.29 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 45.22 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.03	19.78	19.52	18.23	17.97	16.68	16.68	16.42	17.2	17.97	18.49	19	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	65.26	65	64.74	63.45	63.19	61.9	61.9	61.64	62.42	63.19	63.71	64.22	

Average = Sum(39)$_{1...12}$ /12= 63.39 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.91	0.9	0.9	0.88	0.88	0.86	0.86	0.86	0.87	0.88	0.89	0.89	

Average = Sum(40)$_{1...12}$ /12= 0.88 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.29 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 88.6 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	97.46	93.91	90.37	86.83	83.28	79.74	79.74	83.28	86.83	90.37	93.91	97.46	

Total = Sum(44)$_{1...12}$ = 1063.18 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	144.53	126.41	130.44	113.72	109.12	94.16	87.25	100.12	101.32	118.08	128.89	139.97	

Total = Sum(45)$_{1...12}$ = 1394 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.68	18.96	19.57	17.06	16.37	14.12	13.09	15.02	15.2	17.71	19.33	21	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.66	43.23	46.05	42.82	42.44	39.32	40.63	42.44	42.82	46.05	46.31	49.66	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63	

Output from water heater (annual)$_{1...12}$ 1925.45 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.47	52.84	54.88	48.52	46.89	41.14	39.17	43.9	44.39	50.77	54.43	58.96	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	114.52	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.43	16.37	13.31	10.08	7.53	6.36	6.87	8.93	11.99	15.22	17.77	18.94	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	201.6	203.7	198.42	187.2	173.03	159.72	150.82	148.73	154	165.23	179.39	192.71	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	34.45	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	-91.62	(71)

Water heating gains (Table 5)

(72)m=	81.28	78.63	73.77	67.38	63.03	57.14	52.65	59.01	61.66	68.24	75.6	79.24	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	361.67	359.04	345.86	325.02	303.95	283.57	270.7	277.03	288.01	309.05	333.12	351.24	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	11.28	x	0.55	x	0.7	=	19.03	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	22.97	x	0.55	x	0.7	=	38.73	(81)
Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	3.16	x	41.38	x	0.55	x	0.7	=	69.77	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	67.96	x	0.55	x	0.7	=	114.59	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	91.35	x	0.55	x	0.7	=	154.03	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	97.38	x	0.55	x	0.7	=	164.21	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	91.1	x	0.55	x	0.7	=	153.62	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	72.63	x	0.55	x	0.7	=	122.46	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	50.42	x	0.55	x	0.7	=	85.02	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	28.07	x	0.55	x	0.7	=	47.33	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	14.2	x	0.55	x	0.7	=	23.94	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)
Northwest 0.9x	0.77	x	3.16	x	9.21	x	0.55	x	0.7	=	15.54	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	38.05	77.45	139.55	229.18	308.06	328.42	307.23	244.93	170.04	94.65	47.88	31.07	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	399.72	436.5	485.41	554.19	612.01	611.99	577.93	521.95	458.04	403.7	381	382.32	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.84	0.63	0.47	0.54	0.84	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.06	20.16	20.37	20.68	20.9	20.99	21	21	20.93	20.64	20.31	20.04	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.16	20.16	20.17	20.18	20.19	20.2	20.2	20.2	20.19	20.19	20.18	20.17	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.95	0.8	0.56	0.39	0.45	0.77	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.89	19.05	19.35	19.8	20.09	20.19	20.2	20.2	20.14	19.76	19.27	18.88	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.18	19.33	19.61	20.02	20.3	20.39	20.4	20.4	20.34	19.98	19.53	19.18	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.03	19.18	19.46	19.87	20.15	20.24	20.25	20.25	20.19	19.83	19.38	19.03	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.99	0.94	0.8	0.56	0.39	0.45	0.77	0.97	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	398.61	434.2	478.16	520.51	487.77	345.11	225.75	236.71	353.54	390.39	378.76	381.5	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	961.47	928.22	839.26	696.03	533.76	349.38	226.1	237.56	380.24	583.3	782.36	952.15	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	418.77	331.98	268.66	126.38	34.22	0	0	0	0	143.53	290.59	424.56	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2038.68 (98)

Space heating requirement in kWh/m²/year 28.37 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	418.77	331.98	268.66	126.38	34.22	0	0	0	0	143.53	290.59	424.56	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	463.24	367.24	297.19	139.8	37.85	0	0	0	0	158.77	321.45	469.65	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2255.18 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	194.19	169.63	176.49	156.54	151.56	133.48	127.89	142.56	144.14	164.13	175.21	189.63

Efficiency of water heater 80.3 (216)

(217)m=	86.94	86.71	86.11	84.52	81.99	80.3	80.3	80.3	80.3	84.72	86.32	87.02	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	223.37	195.63	204.97	185.21	184.85	166.23	159.26	177.54	179.5	193.74	202.98	217.92	

Total = Sum(219a)$_{1...12}$ = 2291.2 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2255.18

DER WorkSheet: New dwelling design stage

Water heating fuel used		2291.2	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	168.33		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	198.33	(231)
Electricity for lighting		325.42	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	487.12	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	494.9	(264)
Space and water heating	(261) + (262) + (263) + (264) =				982.02	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	102.93	(267)
Electricity for lighting	(232) x		0.519	=	168.89	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			792.84	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.03	(273)
EI rating (section 14)					91	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 55

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	91.9	(1a) x	2.56	(2a) =	235.26	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	91.9	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		235.26	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²	U-value W/m2K	A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04] =	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04] =	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04] =	3.83			(27)
Floor			91.9	x 0.12 =	11.028			(28)
Walls	82.84	22.77	60.07	x 0.16 =	9.61			(29)
Total area of elements, m²			174.74					(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 50.83 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11130.17 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 18.92 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 69.75 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.62	25.29	24.96	23.31	22.98	21.33	21.33	21	21.99	22.98	23.64	24.3	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	95.37	95.04	94.71	93.06	92.73	91.08	91.08	90.75	91.74	92.73	93.39	94.05	

Average = Sum(39)$_{1...12}$ /12= 92.98 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.04	1.03	1.03	1.01	1.01	0.99	0.99	0.99	1	1.01	1.02	1.02	

Average = Sum(40)$_{1...12}$ /12= 1.01 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.65 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 97.16 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	106.87	102.99	99.1	95.21	91.33	87.44	87.44	91.33	95.21	99.1	102.99	106.87	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1165.89 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	158.49	138.62	143.04	124.71	119.66	103.26	95.68	109.8	111.11	129.48	141.34	153.49	

Total = Sum(45)$_{1...12}$ = 1528.67 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	23.77	20.79	21.46	18.71	17.95	15.49	14.35	16.47	16.67	19.42	21.2	23.02	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.5	46.96	46.54	43.12	44.56	46.54	46.96	50.5	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	209.45	184.64	193.54	171.66	166.2	146.38	140.24	156.34	158.06	179.99	190.66	204.45	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	209.45	184.64	193.54	171.66	166.2	146.38	140.24	156.34	158.06	179.99	190.66	204.45	

Output from water heater (annual)$_{1...12}$ 2101.6 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	65.44	57.6	60.19	53.2	51.42	45.11	42.95	48.14	48.68	55.68	59.33	63.77	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	132.54	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.62	19.2	15.62	11.82	8.84	7.46	8.06	10.48	14.07	17.86	20.85	22.22	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	242.53	245.05	238.7	225.2	208.16	192.14	181.44	178.92	185.27	198.77	215.81	231.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	36.25	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	-106.03	(71)

Water heating gains (Table 5)

(72)m=	87.95	85.71	80.89	73.89	69.11	62.66	57.73	64.71	67.61	74.84	82.4	85.72	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	417.87	415.72	400.98	376.68	351.88	328.02	313	319.87	332.71	357.23	384.82	405.53	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	17.4	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	35.42	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	63.81	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	104.8	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	140.87	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	150.18	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	140.49	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	112	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	77.76	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	43.28	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	21.89	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	14.21	(75)
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	184.19	319.52	452.53	586.44	680.34	685.76	656.84	585.2	498.65	357.27	221.67	156.94	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	602.06	735.24	853.51	963.12	1032.22	1013.78	969.84	905.08	831.36	714.5	606.48	562.48	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.97	0.91	0.76	0.56	0.41	0.46	0.71	0.94	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.96	20.16	20.43	20.73	20.92	20.99	21	21	20.96	20.7	20.27	19.93	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.05	20.05	20.06	20.07	20.08	20.09	20.09	20.09	20.08	20.08	20.07	20.06	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.96	0.88	0.71	0.49	0.33	0.37	0.64	0.92	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.67	18.96	19.35	19.78	20	20.08	20.09	20.09	20.06	19.74	19.13	18.64	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.96	19.23	19.59	19.99	20.21	20.28	20.29	20.29	20.25	19.95	19.38	18.92	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.81	19.08	19.44	19.84	20.06	20.13	20.14	20.14	20.1	19.8	19.23	18.77	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.95	0.87	0.71	0.49	0.33	0.37	0.64	0.91	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	598.42	722.89	814.21	838.12	729.06	499.08	322.03	338.77	531.31	651.91	597.58	560.05	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1383.54	1347.38	1225.29	1017.74	774.9	503.94	322.45	339.57	550.84	852.93	1133.07	1370.57	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	584.13	419.66	305.85	129.33	34.11	0	0	0	0	149.56	385.55	603.03	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2611.2 (98)

Space heating requirement in kWh/m²/year 28.41 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	584.13	419.66	305.85	129.33	34.11	0	0	0	0	149.56	385.55	603.03	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	646.16	464.22	338.33	143.06	37.73	0	0	0	0	165.44	426.49	667.07	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2888.5 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	209.45	184.64	193.54	171.66	166.2	146.38	140.24	156.34	158.06	179.99	190.66	204.45

Efficiency of water heater: 80.3 (216)

(217)m=

	87.5	87.05	86.2	84.35	81.86	80.3	80.3	80.3	80.3	84.59	86.79	87.61

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=

	239.38	212.1	224.53	203.51	203.03	182.29	174.65	194.69	196.84	212.78	219.68	233.36

Total = Sum(219a)$_{1...12}$ = 2496.84 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2888.5	
Water heating fuel used		2496.84	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	236.79		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		266.79	(231)
Electricity for lighting		381.85	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	623.92	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	539.32	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1163.23	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	138.47	(267)
Electricity for lighting	(232) x	0.519	=	198.18	(268)
Energy saving/generation technologies Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			1038.87	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			11.3	(273)
EI rating (section 14)				90	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 56

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	65.29	(1a) x	2.56	(2a) =	167.14	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	65.29	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		167.14	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			65.29	x	0.12	=	7.8348			(28)
Walls Type1	43.35	15.26	28.09	x	0.16	=	4.5			(29)
Walls Type2	25.26	2.42	22.84	x	0.16	=	3.65			(29)
Total area of elements, m²			133.9							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.6 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8047.73 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.75 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 48.35 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	18.2	17.97	17.73	16.56	16.33	15.15	15.15	14.92	15.62	16.33	16.8	17.26	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	66.55	66.32	66.08	64.91	64.68	63.5	63.5	63.27	63.97	64.68	65.14	65.61	

Average = Sum(39)$_{1...12}$ /12= 64.85 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.02	1.02	1.01	0.99	0.99	0.97	0.97	0.97	0.98	0.99	1	1

Average = Sum(40)$_{1...12}$ /12= 0.99 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.13 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 84.71 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	93.18	89.79	86.4	83.01	79.62	76.24	76.24	79.62	83.01	86.4	89.79	93.18	

Total = Sum(44)$_{1...12}$ = 1016.48 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	138.18	120.85	124.71	108.72	104.32	90.02	83.42	95.73	96.87	112.89	123.23	133.82	

Total = Sum(45)$_{1...12}$ = 1332.76 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	20.73	18.13	18.71	16.31	15.65	13.5	12.51	14.36	14.53	16.93	18.48	20.07	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.48	41.33	44.03	40.94	40.58	37.6	38.85	40.58	40.94	44.03	44.28	47.48	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	185.66	162.18	168.74	149.66	144.9	127.62	122.27	136.3	137.81	156.92	167.51	181.3	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	185.66	162.18	168.74	149.66	144.9	127.62	122.27	136.3	137.81	156.92	167.51	181.3	

Output from water heater (annual)$_{1...12}$ 1840.87 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	57.82	50.52	52.47	46.39	44.83	39.33	37.45	41.97	42.44	48.54	52.04	56.37	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	106.33	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.59	14.73	11.98	9.07	6.78	5.72	6.19	8.04	10.79	13.7	15.99	17.05	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	186.07	188	183.13	172.77	159.7	147.41	139.2	137.27	142.13	152.49	165.57	177.86	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	33.63	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	-85.06	(71)

Water heating gains (Table 5)

(72)m=	77.71	75.17	70.53	64.42	60.26	54.63	50.34	56.41	58.95	65.25	72.28	75.76	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	338.26	335.8	323.54	304.17	284.63	265.66	253.62	259.62	269.77	289.34	311.74	328.56	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast	0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast	0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast	0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast	0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast	0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast	0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast	0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast	0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast	0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast	0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast	0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast	0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast	0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast	0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast	0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast	0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast	0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast	0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast	0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast	0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast	0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	130.13	224.56	314.92	403.07	463.21	465.03	446.19	400.53	345.32	250.25	156.4	111.03	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	468.39	560.35	638.46	707.24	747.85	730.69	699.81	660.15	615.1	539.59	468.14	439.59	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.96	0.89	0.74	0.55	0.4	0.44	0.68	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.05	20.24	20.49	20.77	20.93	20.99	21	21	20.97	20.74	20.34	20.02	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.07	20.07	20.07	20.09	20.09	20.11	20.11	20.11	20.1	20.09	20.09	20.08	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.86	0.69	0.47	0.32	0.35	0.61	0.9	0.98	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.81	19.09	19.45	19.83	20.03	20.1	20.11	20.11	20.08	19.81	19.25	18.77	(90)

fLA = Living area ÷ (4) = 0.31 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.19	19.44	19.77	20.12	20.31	20.38	20.38	20.38	20.35	20.1	19.59	19.16	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.04	19.29	19.62	19.97	20.16	20.23	20.23	20.23	20.2	19.95	19.44	19.01	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.94	0.86	0.69	0.48	0.33	0.37	0.62	0.89	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	464.29	548	603.18	605.8	518.75	354.32	230.43	242.12	379.41	482.45	458.61	436.75	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	981.11	954.59	867.12	718.8	547.26	357.31	230.69	242.59	390.51	604.78	803.86	971.62	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	384.51	273.23	196.37	81.36	21.21	0	0	0	0	91.02	248.58	397.94	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1694.21 (98)

Space heating requirement in kWh/m²/year 25.95 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	384.51	273.23	196.37	81.36	21.21	0	0	0	0	91.02	248.58	397.94	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	425.34	302.25	217.22	90	23.46	0	0	0	0	100.69	274.98	440.2	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1874.13 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	185.66	162.18	168.74	149.66	144.9	127.62	122.27	136.3	137.81	156.92	167.51	181.3

Efficiency of water heater 80.3 (216)

(217)m=	86.84	86.35	85.43	83.59	81.46	80.3	80.3	80.3	80.3	83.73	86.04	86.98

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	213.79	187.81	197.51	179.05	177.87	158.93	152.26	169.74	171.61	187.4	194.68	208.45

Total = Sum(219a)$_{1...12}$ = 2199.1 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1874.13	
Water heating fuel used		2199.1	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	168.23		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		198.23	(231)
Electricity for lighting		292.95	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	404.81	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	475.01	(264)
Space and water heating	(261) + (262) + (263) + (264) =				879.82	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	102.88	(267)
Electricity for lighting	(232) x		0.519	=	152.04	(268)
Energy saving/generation technologies						
Item 1			0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =				673.73	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =				10.32	(273)
EI rating (section 14)					92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 57

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.41	(1a) x	2.56	(2a) =	129.05	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.41	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		129.05	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			50.41	x	0.12	=	6.0492			(28)
Walls Type1	24.71	12.37	12.34	x	0.16	=	1.97			(29)
Walls Type2	43.27	2.42	40.85	x	0.16	=	6.54			(29)
Total area of elements, m²			118.39							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 34.35 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6449.33 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.1 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 40.45 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.05	13.87	13.69	12.79	12.61	11.7	11.7	11.52	12.06	12.61	12.97	13.33	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	54.5	54.32	54.14	53.23	53.05	52.15	52.15	51.97	52.51	53.05	53.42	53.78	

Average = Sum(39)$_{1...12}$ /12= 53.19 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.08	1.08	1.07	1.06	1.05	1.03	1.03	1.03	1.04	1.05	1.06	1.07

Average = Sum(40)$_{1...12}$ /12= 1.06 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.7 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.63 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.09	79.1	76.12	73.13	70.15	67.16	67.16	70.15	73.13	76.12	79.1	82.09

Total = Sum(44)$_{1...12}$ = 895.52 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	121.74	106.47	109.87	95.79	91.91	79.31	73.49	84.33	85.34	99.46	108.57	117.89

Total = Sum(45)$_{1...12}$ = 1174.17 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.26	15.97	16.48	14.37	13.79	11.9	11.02	12.65	12.8	14.92	16.28	17.68

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.83	36.41	38.79	36.07	35.75	33.12	34.23	35.75	36.07	38.79	39.01	41.83	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	163.57	142.88	148.66	131.85	127.66	112.43	107.72	120.08	121.41	138.25	147.58	159.73	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	163.57	142.88	148.66	131.85	127.66	112.43	107.72	120.08	121.41	138.25	147.58	159.73	

Output from water heater (annual)$_{1...12}$ 1621.81 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.94	44.5	46.23	40.87	39.5	34.65	32.99	36.98	37.39	42.77	45.85	49.66	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	85.11	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.22	11.74	9.55	7.23	5.4	4.56	4.93	6.41	8.6	10.92	12.75	13.59	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	148.3	149.84	145.96	137.7	127.28	117.49	110.94	109.41	113.28	121.54	131.96	141.76	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	31.51	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	-68.09	(71)

Water heating gains (Table 5)

(72)m=	68.46	66.23	62.14	56.76	53.09	48.13	44.35	49.7	51.93	57.48	63.68	66.74	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	281.51	279.34	269.18	253.22	237.31	221.71	211.75	217.05	225.35	241.48	259.92	273.62	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	121.43	206.85	283.02	350.67	392.78	389.94	375.94	344.53	306.45	228.61	145.45	103.92	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	402.95	486.19	552.19	603.89	630.09	611.65	587.7	561.58	531.8	470.09	405.37	377.54	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.73	0.54	0.39	0.42	0.65	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.04	20.25	20.51	20.77	20.93	20.99	21	21	20.97	20.76	20.35	20	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.02	20.02	20.02	20.04	20.04	20.05	20.05	20.06	20.05	20.04	20.03	20.03	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.84	0.67	0.46	0.31	0.34	0.57	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.75	19.06	19.42	19.79	19.98	20.05	20.05	20.06	20.03	19.78	19.21	18.71	(90)

fLA = Living area ÷ (4) = 0.4 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.27	19.54	19.86	20.19	20.36	20.43	20.43	20.43	20.41	20.18	19.67	19.23	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.12	19.39	19.71	20.04	20.21	20.28	20.28	20.28	20.26	20.03	19.52	19.08	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.84	0.68	0.48	0.33	0.36	0.59	0.87	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	397.75	470.94	512.57	504.53	427.55	293.11	191.8	201.41	314.5	408.3	393.66	373.9	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	807.61	786.86	715.1	592.83	451.58	296.01	192.09	201.88	323.29	500.04	663.4	800.07	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	304.93	212.3	150.68	63.58	17.88	0	0	0	0	68.25	194.21	317.07	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1328.9 (98)

Space heating requirement in kWh/m²/year 26.36 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	304.93	212.3	150.68	63.58	17.88	0	0	0	0	68.25	194.21	317.07	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	337.31	234.84	166.68	70.33	19.78	0	0	0	0	75.5	214.83	350.75	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1470.03 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	163.57	142.88	148.66	131.85	127.66	112.43	107.72	120.08	121.41	138.25	147.58	159.73

Efficiency of water heater 80.3 (216)

(217)m=	86.6	86.05	85.09	83.33	81.42	80.3	80.3	80.3	80.3	83.38	85.74	86.74	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	188.88	166.05	174.72	158.23	156.79	140.02	134.15	149.54	151.19	165.81	172.11	184.13	

Total = Sum(219a)$_{1...12}$ = 1941.62 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1470.03

DER WorkSheet: New dwelling design stage

Water heating fuel used		1941.62	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	129.89		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	159.89	(231)
Electricity for lighting		233.49	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	317.53	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	419.39	(264)
Space and water heating	(261) + (262) + (263) + (264) =				736.92	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	82.98	(267)
Electricity for lighting	(232) x		0.519	=	121.18	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			480.07	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			9.52	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 58

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.54	(1a) x	2.56	(2a) =	131.94	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.54	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.94	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			51.54	x	0.12	=	6.1848			(28)
Walls Type1	24.71	12.37	12.34	x	0.16	=	1.97			(29)
Walls Type2	39.57	2.42	37.15	x	0.16	=	5.94			(29)
Total area of elements, m²			115.82							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.89 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6510.73 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.11 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 40 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.37	14.18	14	13.07	12.89	11.96	11.96	11.78	12.33	12.89	13.26	13.63	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	54.37	54.18	54	53.07	52.89	51.96	51.96	51.78	52.33	52.89	53.26	53.63	

Average = Sum(39)$_{1...12}$ /12= 53.02 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.05	1.05	1.05	1.03	1.03	1.01	1.01	1	1.02	1.03	1.03	1.04

Average = Sum(40)$_{1...12}$ /12= 1.03 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.96	79.94	76.93	73.91	70.89	67.88	67.88	70.89	73.91	76.93	79.94	82.96

Total = Sum(44)$_{1...12}$ = 905.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	123.03	107.6	111.03	96.8	92.88	80.15	74.27	85.23	86.25	100.51	109.72	119.15

Total = Sum(45)$_{1...12}$ = 1186.62 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.45	16.14	16.66	14.52	13.93	12.02	11.14	12.78	12.94	15.08	16.46	17.87

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.28	36.8	39.2	36.45	36.13	33.47	34.59	36.13	36.45	39.2	39.42	42.28	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	

Output from water heater (annual)$_{1...12}$ 1639.01 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.48	44.98	46.72	41.3	39.92	35.02	33.34	37.37	37.79	43.22	46.34	50.18	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.48	11.98	9.74	7.37	5.51	4.65	5.03	6.54	8.77	11.14	13	13.86	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.23	152.8	148.85	140.43	129.8	119.81	113.14	111.57	115.53	123.94	134.57	144.56	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	(71)

Water heating gains (Table 5)

(72)m=	69.19	66.93	62.79	57.36	53.65	48.64	44.82	50.23	52.48	58.09	64.36	67.45	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	285.93	283.74	273.41	257.19	240.99	225.14	215.02	220.37	228.81	245.21	263.96	277.9	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	121.43	206.85	283.02	350.67	392.78	389.94	375.94	344.53	306.45	228.61	145.45	103.92	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	407.37	490.58	556.43	607.86	633.77	615.07	590.96	564.89	535.26	473.81	409.41	381.82	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.72	0.53	0.39	0.42	0.65	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.07	20.27	20.53	20.79	20.94	20.99	21	21	20.97	20.77	20.37	20.03	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.04	20.04	20.04	20.06	20.06	20.08	20.08	20.08	20.07	20.06	20.06	20.05	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.83	0.67	0.46	0.31	0.34	0.57	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.81	19.11	19.47	19.83	20.01	20.07	20.08	20.08	20.05	19.82	19.26	18.77	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.12	19.4	19.73	20.07	20.24	20.3	20.31	20.31	20.28	20.06	19.54	19.08	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.97	19.25	19.58	19.92	20.09	20.15	20.16	20.16	20.13	19.91	19.39	18.93	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.67	0.47	0.31	0.34	0.58	0.86	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	401.97	474.72	515.09	504.02	422.99	286.2	184.62	194.28	308.59	408.47	397.1	378.04	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	797.77	777.55	706.45	584.7	443.66	288.43	184.81	194.61	315.69	492.22	654.54	790.1	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	294.48	203.5	142.37	58.09	15.37	0	0	0	0	62.31	185.36	306.58	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1268.06 (98)

Space heating requirement in kWh/m²/year 24.6 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	294.48	203.5	142.37	58.09	15.37	0	0	0	0	62.31	185.36	306.58	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	325.75	225.11	157.49	64.26	17.01	0	0	0	0	68.93	205.04	339.13	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1402.72 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42

Efficiency of water heater 80.3 (216)

(217)m=	86.49	85.91	84.92	83.12	81.27	80.3	80.3	80.3	80.3	83.17	85.6	86.64	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	191.13	168.07	176.92	160.31	158.75	141.5	135.57	151.13	152.8	167.99	174.23	186.31	

Total = Sum(219a)$_{1...12}$ = 1964.7 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1402.72

DER WorkSheet: New dwelling design stage

Water heating fuel used		1964.7	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	132.8		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	162.8	(231)
Electricity for lighting		238.1	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	302.99	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	424.38	(264)
Space and water heating	(261) + (262) + (263) + (264) =				727.36	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	84.49	(267)
Electricity for lighting	(232) x		0.519	=	123.58	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			474.43	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			9.21	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 59

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	89.93	(1a) x	2.56	(2a) =	230.23	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	89.93	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		230.23	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			89.933	x	0.12	=	10.79196			(28)
Walls Type1	66.42	22.77	43.65	x	0.16	=	6.98			(29)
Walls Type2	37.87	2.42	35.45	x	0.16	=	5.67			(29)
Roof	12.86	0	12.86	x	0.12	=	1.54			(30)
Total area of elements, m²			207.08							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 58.57 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 11353.1 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 15.02 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 73.59 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	25.07	24.75	24.43	22.81	22.49	20.87	20.87	20.55	21.52	22.49	23.13	23.78	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	98.66	98.33	98.01	96.4	96.07	94.46	94.46	94.14	95.11	96.07	96.72	97.37	

Average = Sum(39)$_{1...12}$ /12= 96.32 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.1	1.09	1.09	1.07	1.07	1.05	1.05	1.05	1.06	1.07	1.08	1.08

Average = Sum(40)$_{1...12}$ /12= 1.07 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.62 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 96.54 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	106.19	102.33	98.47	94.61	90.75	86.89	86.89	90.75	94.61	98.47	102.33	106.19

Total = Sum(44)$_{1...12}$ = 1158.47 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	157.48	137.73	142.13	123.91	118.9	102.6	95.07	109.1	110.4	128.66	140.44	152.51

Total = Sum(45)$_{1...12}$ = 1518.94 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	23.62	20.66	21.32	18.59	17.83	15.39	14.26	16.36	16.56	19.3	21.07	22.88

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	46.03	50.18	46.66	46.24	42.85	44.28	46.24	46.66	50.18	49.32	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	208.44	183.76	192.31	170.57	165.14	145.45	139.35	155.34	157.06	178.84	189.76	203.47	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	208.44	183.76	192.31	170.57	165.14	145.45	139.35	155.34	157.06	178.84	189.76	203.47	

Output from water heater (annual)$_{1...12}$ 2089.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	65.1	57.3	59.8	52.86	51.09	44.83	42.68	47.84	48.37	55.32	59.03	63.45	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	131.24	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	21.3	18.92	15.39	11.65	8.71	7.35	7.94	10.33	13.86	17.6	20.54	21.9	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	238.95	241.43	235.19	221.88	205.09	189.31	178.77	176.29	182.54	195.84	212.63	228.41	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	36.12	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	-104.99	(71)

Water heating gains (Table 5)

(72)m=	87.5	85.27	80.38	73.42	68.67	62.26	57.37	64.3	67.18	74.36	81.98	85.28	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	413.13	411	396.33	372.33	347.85	324.29	309.45	316.28	328.95	353.17	380.52	400.96	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)
Southwest	0.9x	0.77	x	2.89	x	36.79		0.55	x	0.7	=	56.74	(79)
Southwest	0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	96.65	(79)
Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	132.24	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	163.85	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	183.53	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	182.2	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	175.66	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	160.98	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	143.19	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	106.82	(79)
Southwest	0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	67.96	(79)
Southwest	0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	48.56	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	223.53	380.75	520.96	645.49	723.01	717.78	692.02	634.19	564.09	420.81	267.74	191.29	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	636.66	791.75	917.29	1017.82	1070.85	1042.07	1001.46	950.47	893.04	773.98	648.26	592.25	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.96	0.89	0.76	0.57	0.41	0.45	0.69	0.93	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.93	20.15	20.43	20.73	20.91	20.99	21	21	20.96	20.7	20.26	19.89	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20	20.01	20.01	20.02	20.03	20.04	20.04	20.04	20.04	20.03	20.02	20.02	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.95	0.86	0.7	0.49	0.32	0.36	0.61	0.9	0.98	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.59	18.91	19.31	19.72	19.95	20.03	20.04	20.04	20.01	19.7	19.07	18.54	(90)

fLA = Living area ÷ (4) = 0.23 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.89	19.19	19.56	19.95	20.17	20.25	20.26	20.26	20.22	19.93	19.34	18.85	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.74	19.04	19.41	19.8	20.02	20.1	20.11	20.11	20.07	19.78	19.19	18.7	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.98	0.94	0.85	0.7	0.49	0.33	0.37	0.61	0.89	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	631.37	773.32	863.45	870.03	748.48	513.16	330.64	348.08	548.7	690	635.3	588.72	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1424.67	1390.64	1265.52	1050.62	798.88	519.26	331.2	349.04	567.89	881.72	1169.29	1411.62	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	590.22	414.84	299.14	130.03	37.49	0	0	0	0	142.64	384.47	612.24	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2611.07 (98)

Space heating requirement in kWh/m²/year 29.03 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	590.22	414.84	299.14	130.03	37.49	0	0	0	0	142.64	384.47	612.24	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	652.89	458.89	330.91	143.84	41.48	0	0	0	0	157.79	425.3	677.26	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2888.35 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	208.44	183.76	192.31	170.57	165.14	145.45	139.35	155.34	157.06	178.84	189.76	203.47

Efficiency of water heater 80.3 (216)

(217)m= 87.53 | 87.04 | 86.16 | 84.38 | 82 | 80.3 | 80.3 | 80.3 | 80.3 | 84.49 | 86.79 | 87.65 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 238.14 | 211.12 | 223.2 | 202.15 | 201.4 | 181.13 | 173.53 | 193.45 | 195.59 | 211.67 | 218.63 | 232.14

Total = Sum(219a)$_{1...12}$ = 2482.17 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2888.35	
Water heating fuel used		2482.17	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	231.72		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		261.72	(231)
Electricity for lighting		376.22	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	623.88	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	536.15	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1160.03	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	135.84	(267)
Electricity for lighting	(232) x	0.519	=	195.26	(268)
Energy saving/generation technologies Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			1030.12	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			11.45	(273)
EI rating (section 14)				90	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 60

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.3	(1a) x	2.56	(2a) =	187.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.3	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			73.3	x	0.12	=	8.796			(28)
Walls Type1	52.59	19.88	32.71	x	0.16	=	5.23			(29)
Walls Type2	17.17	2.42	14.75	x	0.16	=	2.36			(29)
Total area of elements, m²			143.07							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 46.13 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8869.96 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 11.84 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 57.98 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.43	20.17	19.91	18.59	18.33	17.01	17.01	16.75	17.54	18.33	18.86	19.38	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	78.41	78.15	77.88	76.57	76.31	74.99	74.99	74.73	75.52	76.31	76.83	77.36	

Average = Sum(39)$_{1...12}$ /12= 76.5 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.07	1.07	1.06	1.04	1.04	1.02	1.02	1.02	1.03	1.04	1.05	1.06

Average = Sum(40)$_{1...12}$ /12= 1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.38 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.32	94.75	91.17	87.6	84.02	80.44	80.44	84.02	87.6	91.17	94.75	98.32

Total = Sum(44)$_{1...12}$ = 1072.6 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.81	127.52	131.59	114.73	110.08	94.99	88.03	101.01	102.22	119.12	130.03	141.21

Total = Sum(45)$_{1...12}$ = 1406.35 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.87	19.13	19.74	17.21	16.51	14.25	13.2	15.15	15.33	17.87	19.5	21.18

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.1	43.61	46.46	43.2	42.82	39.67	40.99	42.82	43.2	46.46	46.72	50.1	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31	

Output from water heater (annual)$_{1...12}$ 1942.5 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.01	53.3	55.37	48.95	47.31	41.5	39.52	44.29	44.79	51.22	54.92	59.48	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.26	16.22	13.19	9.99	7.47	6.3	6.81	8.85	11.88	15.09	17.61	18.77	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.87	207	201.64	190.24	175.84	162.31	153.27	151.14	156.5	167.91	182.3	195.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	(71)

Water heating gains (Table 5)

(72)m=	82	79.32	74.42	67.98	63.58	57.64	53.11	59.53	62.2	68.85	76.27	79.94	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	365.99	363.4	350.11	329.06	307.74	287.11	274.05	280.38	291.44	312.69	337.04	355.4	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	79.52	152.43	253.69	389.97	505.84	532.55	500.79	409.71	300.15	180.64	98.34	66.05	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	445.51	515.83	603.8	719.03	813.58	819.65	774.84	690.09	591.59	493.33	435.37	421.45	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.93	0.78	0.57	0.42	0.49	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.88	20.03	20.3	20.66	20.9	20.99	21	21	20.93	20.59	20.17	19.85	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.03	20.03	20.05	20.05	20.06	20.06	20.07	20.06	20.05	20.04	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.91	0.73	0.49	0.33	0.4	0.71	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.52	18.75	19.15	19.66	19.96	20.06	20.06	20.07	20	19.57	18.97	18.5	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.87	19.08	19.45	19.92	20.21	20.3	20.31	20.31	20.24	19.84	19.28	18.85	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.72	18.93	19.3	19.77	20.06	20.15	20.16	20.16	20.09	19.69	19.13	18.7	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.9	0.73	0.5	0.34	0.41	0.71	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	443.61	510.93	586.86	646.55	591.43	411.04	266.13	279.53	422.92	468.24	431.44	420.1	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1130.96	1096.65	996.67	832.35	637.56	415.93	266.61	280.68	452.52	693.25	924.32	1121.81	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	511.38	393.6	304.89	133.78	34.32	0	0	0	0	167.41	354.87	522.07	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2422.34 (98)

Space heating requirement in kWh/m²/year 33.05 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	511.38	393.6	304.89	133.78	34.32	0	0	0	0	167.41	354.87	522.07	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	565.69	435.4	337.27	147.99	37.97	0	0	0	0	185.19	392.56	577.51	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2679.58 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31

Efficiency of water heater 80.3 (216)

(217)m= 87.36 | 87.08 | 86.39 | 84.64 | 81.98 | 80.3 | 80.3 | 80.3 | 80.3 | 85.08 | 86.77 | 87.45 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 224.27 | 196.52 | 206.1 | 186.59 | 186.51 | 167.7 | 160.67 | 179.11 | 181.09 | 194.62 | 203.7 | 218.77

Total = Sum(219a)$_{1...12}$ = 2305.65 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2679.58	
Water heating fuel used		2305.65	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	188.87		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		218.87	(231)
Electricity for lighting		322.56	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	578.79	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	498.02	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1076.81	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	113.59	(267)
Electricity for lighting	(232) x		0.519	=	167.41	(268)
Energy saving/generation technologies						
Item 1			0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =				896.81	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =				12.23	(273)
EI rating (section 14)					90	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 61

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.47	(1a) x	2.56	(2a) =	180.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.47	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			70.475	x	0.12	=	8.457			(28)
Walls Type1	31.35	16.99	14.36	x	0.16	=	2.3			(29)
Walls Type2	17.17	2.42	14.75	x	0.16	=	2.36			(29)
Total area of elements, m²			119							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.03 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 8247.24 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.86 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 46.88 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.65	19.39	19.14	17.88	17.62	16.36	16.36	16.1	16.86	17.62	18.13	18.64	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	66.53	66.28	66.03	64.76	64.51	63.24	63.24	62.99	63.75	64.51	65.01	65.52	

Average = Sum(39)$_{1...12}$ /12= 64.7 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.94	0.94	0.94	0.92	0.92	0.9	0.9	0.89	0.9	0.92	0.92	0.93

Average = Sum(40)$_{1...12}$ /12= 0.92 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.82 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.6	93.09	89.57	86.06	82.55	79.04	79.04	82.55	86.06	89.57	93.09	96.6

Total = Sum(44)$_{1...12}$ = 1053.82 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.25	125.29	129.29	112.72	108.16	93.33	86.48	99.24	100.43	117.04	127.76	138.73

Total = Sum(45)$_{1...12}$ = 1381.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.49	18.79	19.39	16.91	16.22	14	12.97	14.89	15.06	17.56	19.16	20.81

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.23	42.85	45.65	42.44	42.07	38.98	40.28	42.07	42.44	45.65	45.91	49.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	

Output from water heater (annual)$_{1...12}$ 1908.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	59.94	52.37	54.4	48.09	46.48	40.78	38.82	43.51	44	50.33	53.96	58.44	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.69	15.71	12.78	9.67	7.23	6.1	6.6	8.57	11.51	14.61	17.05	18.18	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.4	200.46	195.27	184.23	170.29	157.18	148.43	146.37	151.56	162.6	176.55	189.65	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	(71)

Water heating gains (Table 5)

(72)m=	80.56	77.93	73.12	66.79	62.47	56.63	52.18	58.49	61.11	67.64	74.94	78.54	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	356.52	353.97	341.03	320.56	299.85	279.79	267.07	273.29	284.04	304.72	328.4	346.24	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	407.66	458.08	528.6	628.6	713.92	721.23	680.04	602.51	512.6	431.95	392.76	388	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.93	0.77	0.55	0.41	0.48	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.03	20.15	20.4	20.73	20.93	20.99	21	21	20.95	20.65	20.29	20.01	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.13	20.13	20.14	20.15	20.15	20.17	20.17	20.17	20.16	20.15	20.15	20.14	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.91	0.72	0.49	0.33	0.39	0.72	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.82	19.01	19.36	19.84	20.09	20.17	20.17	20.17	20.12	19.75	19.22	18.81	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.14	19.32	19.64	20.08	20.32	20.39	20.39	20.39	20.35	19.99	19.51	19.13	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.99	19.17	19.49	19.93	20.17	20.24	20.24	20.24	20.2	19.84	19.36	18.98	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.72	0.49	0.34	0.4	0.72	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	406.3	454.83	516.76	569.76	516.5	354.2	230.19	241.63	368.54	413.1	389.91	387.02	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	977.62	945.63	857.71	714.04	546.4	356.57	230.38	242.15	388.6	596.01	796.74	968.39	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	425.06	329.82	253.67	103.88	22.25	0	0	0	0	136.09	292.92	432.54	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1996.21 (98)

Space heating requirement in kWh/m²/year 28.33 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	425.06	329.82	253.67	103.88	22.25	0	0	0	0	136.09	292.92	432.54	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	470.2	364.84	280.6	114.91	24.61	0	0	0	0	150.54	324.02	478.47	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2208.2 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96

Efficiency of water heater 80.3 (216)

(217)m=	86.99	86.72	85.99	84.07	81.47	80.3	80.3	80.3	80.3	84.61	86.36	87.08	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	221.27	193.89	203.45	184.57	184.38	164.77	157.86	175.97	177.92	192.29	201.1	215.84	

Total = Sum(219a)$_{1...12}$ = 2273.3 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2208.2

DER WorkSheet: New dwelling design stage

Water heating fuel used		2273.3	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	181.59		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	211.59	(231)
Electricity for lighting		312.37	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	476.97	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	491.03	(264)
Space and water heating	(261) + (262) + (263) + (264) =				968	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	109.81	(267)
Electricity for lighting	(232) x		0.519	=	162.12	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			778.93	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.05	(273)
EI rating (section 14)					91	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 62

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.12	(1a) x	2.56	(2a) =	130.85	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.12	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.85	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			51.115	x	0.12	=	6.1338			(28)
Walls Type1	25.24	12.37	12.87	x	0.16	=	2.06			(29)
Walls Type2	33.85	2.42	31.43	x	0.16	=	5.03			(29)
Total area of elements, m²			110.2							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.01 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6375.7 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.16 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 39.17 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.25	14.07	13.88	12.97	12.78	11.86	11.86	11.68	12.23	12.78	13.15	13.52	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	53.42	53.24	53.05	52.14	51.95	51.03	51.03	50.85	51.4	51.95	52.32	52.69	

Average = Sum(39)$_{1...12}$ /12= 52.09 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.05	1.04	1.04	1.02	1.02	1	1	0.99	1.01	1.02	1.02	1.03

Average = Sum(40)$_{1...12}$ /12= 1.02 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.12 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.63	79.63	76.62	73.62	70.61	67.61	67.61	70.61	73.62	76.62	79.63	82.63

Total = Sum(44)$_{1...12}$ = 901.44 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.54	107.18	110.6	96.42	92.52	79.84	73.98	84.89	85.91	100.12	109.28	118.67

Total = Sum(45)$_{1...12}$ = 1181.94 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.38	16.08	16.59	14.46	13.88	11.98	11.1	12.73	12.89	15.02	16.39	17.8

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.11	36.65	39.05	36.3	35.98	33.34	34.45	35.98	36.3	39.05	39.27	42.11	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78	

Output from water heater (annual)$_{1...12}$ 1632.53 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.27	44.8	46.53	41.14	39.76	34.88	33.21	37.22	37.64	43.05	46.15	49.99	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.38	11.89	9.67	7.32	5.47	4.62	4.99	6.49	8.71	11.06	12.9	13.76	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	150.13	151.69	147.76	139.4	128.85	118.94	112.31	110.76	114.68	123.04	133.59	143.51	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	(71)

Water heating gains (Table 5)

(72)m=	68.91	66.66	62.55	57.13	53.44	48.45	44.64	50.03	52.28	57.86	64.1	67.19	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	284.27	282.08	271.82	255.7	239.61	223.85	213.79	219.12	227.51	243.8	262.44	276.29	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	13.91	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	28.31	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	51.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	83.77	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	112.6	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	120.04	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	112.29	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	89.52	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	62.15	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	34.6	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	17.5	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	11.36	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	37.24	75.8	136.57	224.28	301.48	321.41	300.67	239.7	166.41	92.63	46.85	30.41	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	321.51	357.88	408.39	479.98	541.08	545.25	514.46	458.81	393.92	336.44	309.3	306.7	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.94	0.8	0.59	0.43	0.5	0.8	0.97	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.93	20.06	20.31	20.66	20.9	20.99	21	21	20.93	20.6	20.21	19.91	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.05	20.05	20.05	20.07	20.07	20.08	20.08	20.09	20.08	20.07	20.06	20.06	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.74	0.51	0.35	0.41	0.73	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.62	18.81	19.18	19.67	19.98	20.08	20.08	20.09	20.02	19.6	19.04	18.6	(90)

fLA = Living area ÷ (4) = 0.37 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.1	19.27	19.6	20.04	20.32	20.41	20.42	20.42	20.36	19.97	19.48	19.09	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.95	19.12	19.45	19.89	20.17	20.26	20.27	20.27	20.21	19.82	19.33	18.94	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.75	0.52	0.36	0.43	0.74	0.95	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	320	354.67	398.36	437.39	404.93	285.19	187.06	196.02	290.91	320.84	306.38	305.57	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	782.86	757.29	686.92	572.95	440.07	289.04	187.46	196.97	313.91	479.1	639.64	776.49	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	344.37	270.56	214.69	97.61	26.14	0	0	0	0	117.74	239.94	350.37	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1661.42 (98)

Space heating requirement in kWh/m²/year 32.5 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	344.37	270.56	214.69	97.61	26.14	0	0	0	0	117.74	239.94	350.37	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	380.94	299.29	237.49	107.97	28.92	0	0	0	0	130.25	265.43	387.57	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1837.86 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78

Efficiency of water heater 80.3 (216)

(217)m=	86.87	86.62	85.96	84.29	81.85	80.3	80.3	80.3	80.3	84.63	86.25	86.96	(217)
Fuel for water heating, kWh/month (219)m = (64)m x 100 ÷ (217)m													
(219)m=	189.55	166.05	174.08	157.46	157	140.94	135.03	150.53	152.19	164.43	172.23	184.89	

Total = Sum(219a)$_{1...12}$ = 1944.39 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1837.86

DER WorkSheet: New dwelling design stage

Water heating fuel used		1944.39	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	131.7		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	161.7	(231)
Electricity for lighting		236.37	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	396.98	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	419.99	(264)
Space and water heating	(261) + (262) + (263) + (264) =				816.96	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	83.92	(267)
Electricity for lighting	(232) x		0.519	=	122.68	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			562.56	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.01	(273)
EI rating (section 14)					92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 63

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	77.53	(1a) x	2.56	(2a) =	198.47	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	77.53	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		198.47	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	54.38	19.88	34.5	x	0.16	=	5.52			(29)
Walls Type2	14.93	2.42	12.51	x	0.16	=	2			(29)
Total area of elements, m²			69.31							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 37.27 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 799.22 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.63 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 43.9 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	21.61	21.34	21.06	19.67	19.39	17.99	17.99	17.72	18.55	19.39	19.94	20.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	65.51	65.23	64.96	63.56	63.29	61.89	61.89	61.62	62.45	63.29	63.84	64.4	

Average = Sum(39)$_{1...12}$ /12= 63.49 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.85	0.84	0.84	0.82	0.82	0.8	0.8	0.79	0.81	0.82	0.82	0.83	
Average = Sum(40)$_{1...12}$ /12=													0.82 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.41 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 91.54 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	100.69	97.03	93.37	89.71	86.05	82.39	82.39	86.05	89.71	93.37	97.03	100.69	
Total = Sum(44)$_{1...12}$ =													1098.47 (44)
Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)													
(45)m=	149.33	130.6	134.77	117.49	112.74	97.28	90.15	103.45	104.68	122	133.17	144.61	
Total = Sum(45)$_{1...12}$ =													1440.27 (45)
If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)													
(46)m=	22.4	19.59	20.22	17.62	16.91	14.59	13.52	15.52	15.7	18.3	19.98	21.69	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)
If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)
If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H													
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	44.66	47.58	44.24	43.85	40.63	41.98	43.85	44.24	47.58	47.85	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	

Output from water heater (annual)$_{1...12}$ 1988.65 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	62.39	54.59	56.71	50.13	48.45	42.5	40.47	45.36	45.87	52.46	56.24	60.82	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	19.1	16.96	13.79	10.44	7.81	6.59	7.12	9.26	12.42	15.77	18.41	19.63	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	214.2	216.42	210.82	198.89	183.84	169.7	160.24	158.02	163.62	175.55	190.6	204.75	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	(71)

Water heating gains (Table 5)

(72)m=	83.86	81.24	76.22	69.62	65.12	59.03	54.4	60.97	63.7	70.51	78.11	81.75	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	379.36	376.83	363.04	341.17	318.98	297.53	283.97	290.46	301.96	324.04	349.34	368.34	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	175.49	301.81	420.62	534.04	609.91	610.67	586.6	529.2	459.78	335.63	210.72	149.84	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	554.85	678.64	783.67	875.21	928.89	908.2	870.57	819.66	761.74	659.68	560.06	518.18	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.93	0.81	0.62	0.44	0.31	0.35	0.56	0.87	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.3	20.5	20.73	20.92	20.99	21	21	21	20.99	20.89	20.57	20.27	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.21	20.22	20.22	20.24	20.24	20.25	20.25	20.26	20.25	20.24	20.23	20.23	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.92	0.77	0.58	0.39	0.26	0.29	0.5	0.83	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.29	19.58	19.89	20.15	20.23	20.25	20.25	20.26	20.24	20.13	19.68	19.25	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.51	19.78	20.08	20.32	20.39	20.42	20.42	20.42	20.41	20.29	19.87	19.48	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.36	19.63	19.93	20.17	20.24	20.27	20.27	20.27	20.26	20.14	19.72	19.33	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.91	0.77	0.58	0.39	0.26	0.29	0.5	0.83	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	548.94	656.22	712.12	672.47	534.44	350.39	226.96	238.39	382.69	546.34	543.7	514.32	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	986.68	960.98	872.11	716.25	540.64	350.72	226.97	238.42	384.59	603.87	806	974.06	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	325.68	204.8	119.03	31.53	4.62	0	0	0	0	42.8	188.86	342.05	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1259.35 (98)

Space heating requirement in kWh/m²/year 16.24 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	325.68	204.8	119.03	31.53	4.62	0	0	0	0	42.8	188.86	342.05	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	360.26	226.55	131.67	34.87	5.11	0	0	0	0	47.34	208.91	378.37	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1393.09 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57

Efficiency of water heater 80.3 (216)

(217)m=	86.27	85.44	84.01	81.79	80.56	80.3	80.3	80.3	80.3	82.15	85.16	86.44

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	232.16	205.12	217.06	197.74	194.38	171.75	164.55	183.43	185.46	206.43	212.57	226.24

Total = Sum(219a)$_{1...12}$ = 2396.88 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1393.09	
Water heating fuel used		2396.88	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	199.76		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		229.76	(231)
Electricity for lighting		337.24	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	300.91	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	517.73	(264)
Space and water heating	(261) + (262) + (263) + (264) =			818.63	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	119.25	(267)
Electricity for lighting	(232) x	0.519	=	175.03	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			651.9	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			8.41	(273)
EI rating (section 14)				93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 64

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.94	(1a) x	2.56	(2a) =	130.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.94	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	24.35	15.26	9.09	x	0.16	=	1.45			(29)
Walls Type2	39.32	2.42	36.9	x	0.16	=	5.9			(29)
Total area of elements, m²			63.67							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 30.98 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 781.75 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.49 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 34.47 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.2	14.02	13.84	12.92	12.74	11.82	11.82	11.64	12.19	12.74	13.11	13.47	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	48.67	48.49	48.31	47.39	47.21	46.3	46.3	46.11	46.66	47.21	47.58	47.94	

Average = Sum(39)$_{1...12}$ /12= 47.35 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.95	0.95	0.93	0.93	0.91	0.91	0.91	0.92	0.93	0.93	0.94

Average = Sum(40)$_{1...12}$ /12= 0.93 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.5	79.5	76.5	73.5	70.5	67.5	67.5	70.5	73.5	76.5	79.5	82.5

Total = Sum(44)$_{1...12}$ = 900.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.35	107.01	110.42	96.27	92.37	79.71	73.86	84.76	85.77	99.96	109.11	118.49

Total = Sum(45)$_{1...12}$ = 1180.06 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.35	16.05	16.56	14.44	13.86	11.96	11.08	12.71	12.87	14.99	16.37	17.77

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.04	36.59	38.98	36.25	35.93	33.29	34.4	35.93	36.25	38.98	39.21	42.04	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53	

Output from water heater (annual)$_{1...12}$ 1629.95 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.19	44.73	46.46	41.07	39.69	34.83	33.16	37.16	37.58	42.98	46.08	49.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.34	11.85	9.64	7.3	5.46	4.61	4.98	6.47	8.68	11.02	12.87	13.72	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.69	151.24	147.33	138.99	128.48	118.59	111.98	110.43	114.35	122.68	133.2	143.08	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	(71)

Water heating gains (Table 5)

(72)m=	68.8	66.56	62.45	57.04	53.35	48.37	44.57	49.95	52.19	57.77	64	67.08	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	283.61	281.42	271.18	255.1	239.05	223.33	213.3	218.62	226.99	243.24	261.83	275.65	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	130.13	224.56	314.92	403.07	463.21	465.03	446.19	400.53	345.32	250.25	156.4	111.03	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	413.74	505.98	586.1	658.17	702.27	688.36	659.49	619.15	572.32	493.49	418.23	386.67	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.92	0.79	0.61	0.43	0.31	0.34	0.55	0.85	0.97	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.23	20.45	20.69	20.9	20.98	21	21	21	20.99	20.87	20.51	20.19	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.12	20.13	20.14	20.14	20.16	20.16	20.16	20.15	20.14	20.14	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.9	0.75	0.56	0.37	0.25	0.28	0.49	0.82	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.11	19.42	19.76	20.04	20.13	20.16	20.16	20.16	20.15	20.01	19.53	19.06	(90)

fLA = Living area ÷ (4) = 0.28 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.42	19.71	20.02	20.28	20.37	20.39	20.4	20.4	20.38	20.25	19.81	19.38	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.27	19.56	19.87	20.13	20.22	20.24	20.25	20.25	20.23	20.1	19.66	19.23	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.98	0.96	0.89	0.75	0.56	0.38	0.26	0.29	0.5	0.81	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	407.07	483.97	523.25	495.15	395.9	260.85	168.73	177.35	284.08	401.22	401.87	382.12	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	728.79	710.78	645.88	532.17	402.09	261.3	168.76	177.41	286.25	448.48	597.4	720.6	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	239.36	152.42	91.23	26.65	4.61	0	0	0	0	35.16	140.79	251.83	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 942.05 (98)

Space heating requirement in kWh/m²/year 18.49 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	239.36	152.42	91.23	26.65	4.61	0	0	0	0	35.16	140.79	251.83	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	264.78	168.6	100.92	29.48	5.1	0	0	0	0	38.89	155.74	278.57	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1042.09 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53

Efficiency of water heater 80.3 (216)

(217)m= 86 | 85.2 | 83.85 | 81.83 | 80.61 | 80.3 | 80.3 | 80.3 | 80.3 | 82.15 | 84.92 | 86.18 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 191.16 | 168.54 | 178.18 | 161.94 | 159.15 | 140.72 | 134.82 | 150.29 | 151.95 | 169.12 | 174.65 | 186.27

Total = Sum(219a)$_{1...12}$ = 1966.79 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1042.09	
Water heating fuel used		1966.79	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	131.27		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		161.27	(231)
Electricity for lighting		235.67	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	225.09	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	424.83	(264)
Space and water heating	(261) + (262) + (263) + (264) =			649.92	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	83.7	(267)
Electricity for lighting	(232) x	0.519	=	122.31	(268)
Energy saving/generation technologies Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			394.93	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			7.75	(273)
EI rating (section 14)				94	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 65

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	56.64	(1a) x	2.56	(2a) =	145	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	56.64	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		145	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			56.64	x	0.12	=	6.7968			(28)
Walls Type1	48.55	15.26	33.29	x	0.16	=	5.33			(29)
Walls Type2	29.38	2.42	26.96	x	0.16	=	4.31			(29)
Total area of elements, m²			134.57							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 40.06 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 5272.23 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.32 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 46.38 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	15.79	15.59	15.38	14.37	14.16	13.15	13.15	12.94	13.55	14.16	14.57	14.98	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	62.17	61.97	61.76	60.75	60.54	59.53	59.53	59.32	59.93	60.54	60.95	61.36	

Average = Sum(39)$_{1...12}$ /12= 60.69 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.1	1.09	1.09	1.07	1.07	1.05	1.05	1.05	1.06	1.07	1.08	1.08

Average = Sum(40)$_{1...12}$ /12= 1.07 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.89 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 78.97 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(44)m=	86.87	83.71	80.55	77.39	74.24	71.08	71.08	74.24	77.39	80.55	83.71	86.87

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 947.69 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	128.83	112.67	116.27	101.37	97.26	83.93	77.77	89.25	90.31	105.25	114.89	124.76

Total = Sum(45)$_{1...12}$ = 1242.57 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.32	16.9	17.44	15.2	14.59	12.59	11.67	13.39	13.55	15.79	17.23	18.71

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	44.27	38.53	41.05	38.17	37.83	35.05	36.22	37.83	38.17	41.05	41.28	44.27	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	173.1	151.2	157.32	139.53	135.09	118.98	113.99	127.08	128.48	146.3	156.17	169.03	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	173.1	151.2	157.32	139.53	135.09	118.98	113.99	127.08	128.48	146.3	156.17	169.03	

Output from water heater (annual)$_{1...12}$ 1716.28 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	53.9	47.1	48.92	43.25	41.8	36.67	34.91	39.13	39.57	45.26	48.52	52.55	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	94.26	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	14.66	13.02	10.59	8.01	5.99	5.06	5.47	7.1	9.54	12.11	14.13	15.06	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	164.4	166.11	161.81	152.66	141.1	130.24	122.99	121.29	125.58	134.74	146.29	157.15	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	32.43	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	-75.41	(71)

Water heating gains (Table 5)

(72)m=	72.45	70.08	65.76	60.06	56.18	50.93	46.93	52.6	54.96	60.83	67.39	70.63	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	305.79	303.49	292.43	275.01	257.55	240.51	229.66	235.26	244.36	261.95	282.09	297.12	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	130.13	224.56	314.92	403.07	463.21	465.03	446.19	400.53	345.32	250.25	156.4	111.03	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	435.92	528.04	607.35	678.08	720.77	705.54	675.85	635.79	589.68	512.2	438.49	408.15	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.72	0.53	0.39	0.43	0.67	0.91	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.99	20.2	20.47	20.76	20.93	20.99	21	21	20.97	20.73	20.3	19.95	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20	20.01	20.01	20.02	20.03	20.04	20.04	20.04	20.04	20.03	20.02	20.01	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.66	0.46	0.3	0.34	0.59	0.88	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.67	18.98	19.36	19.76	19.96	20.03	20.04	20.04	20.01	19.74	19.14	18.63	(90)

fLA = Living area ÷ (4) = 0.3 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.06	19.34	19.69	20.06	20.25	20.32	20.33	20.33	20.3	20.03	19.49	19.02	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.91	19.19	19.54	19.91	20.1	20.17	20.18	20.18	20.15	19.88	19.34	18.87	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.84	0.67	0.47	0.31	0.35	0.6	0.88	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	430.95	513.19	566.36	566.76	482.44	328.51	212.58	223.57	351.65	449.88	427.28	404.68	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	908.4	885.48	805.53	668.79	508.68	331.5	212.86	224.08	362.32	561.92	745.76	900.17	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	355.23	250.18	177.95	73.46	19.52	0	0	0	0	83.36	229.3	368.64	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1557.64 (98)

Space heating requirement in kWh/m²/year 27.5 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	355.23	250.18	177.95	73.46	19.52	0	0	0	0	83.36	229.3	368.64	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	392.95	276.75	196.84	81.26	21.59	0	0	0	0	92.21	253.66	407.79	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1723.05 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	173.1	151.2	157.32	139.53	135.09	118.98	113.99	127.08	128.48	146.3	156.17	169.03

Efficiency of water heater 80.3 (216)

(217)m= 86.82 | 86.31 | 85.36 | 83.52 | 81.45 | 80.3 | 80.3 | 80.3 | 80.3 | 83.69 | 86.02 | 86.96 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 199.37 | 175.19 | 184.3 | 167.07 | 165.86 | 148.17 | 141.96 | 158.25 | 160 | 174.8 | 181.56 | 194.38

Total = Sum(219a)$_{1...12}$ = 2050.91 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1723.05	
Water heating fuel used		2050.91	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	145.94		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		175.94	(231)
Electricity for lighting		258.84	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	372.18	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	443	(264)
Space and water heating	(261) + (262) + (263) + (264) =			815.18	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	91.31	(267)
Electricity for lighting	(232) x	0.519	=	134.34	(268)
Energy saving/generation technologies Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			579.82	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			10.24	(273)
EI rating (section 14)				92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 66

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	64.03	(1a) x	2.56	(2a) =	163.91	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	64.03	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		163.91	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Floor			13.616	x	0.12	=	1.63392			(28)
Walls Type1	47.15	16.99	30.16	x	0.16	=	4.83			(29)
Walls Type2	31.49	2.42	29.07	x	0.16	=	4.65			(29)
Total area of elements, m²			92.25							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 37.02 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 2028.08 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.9 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 44.93 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	17.85	17.62	17.39	16.24	16.01	14.86	14.86	14.63	15.32	16.01	16.47	16.93	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	62.78	62.55	62.32	61.17	60.94	59.79	59.79	59.56	60.25	60.94	61.4	61.86	

Average = Sum(39)$_{1...12}$ /12= 61.11 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.98	0.98	0.97	0.96	0.95	0.93	0.93	0.93	0.94	0.95	0.96	0.97	

Average = Sum(40)$_{1...12}$ /12= 0.95 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.09 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 83.91 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	92.3	88.94	85.58	82.23	78.87	75.52	75.52	78.87	82.23	85.58	88.94	92.3	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1006.88 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	136.87	119.71	123.53	107.7	103.34	89.17	82.63	94.82	95.95	111.82	122.07	132.56	

Total = Sum(45)$_{1...12}$ = 1320.18 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	20.53	17.96	18.53	16.15	15.5	13.38	12.39	14.22	14.39	16.77	18.31	19.88	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.03	40.94	43.61	40.55	40.19	37.24	38.48	40.19	40.55	43.61	43.86	47.03	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	183.91	160.65	167.14	148.25	143.53	126.41	121.11	135.01	136.5	155.44	165.93	179.59	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	183.91	160.65	167.14	148.25	143.53	126.41	121.11	135.01	136.5	155.44	165.93	179.59	

Output from water heater (annual)$_{1...12}$ 1823.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	57.27	50.04	51.98	45.95	44.41	38.96	37.1	41.58	42.04	48.09	51.55	55.83	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	104.65	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.31	14.49	11.78	8.92	6.67	5.63	6.08	7.91	10.61	13.47	15.73	16.77	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	182.98	184.88	180.09	169.9	157.05	144.96	136.89	134.99	139.77	149.96	162.82	174.9	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	33.46	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	-83.72	(71)

Water heating gains (Table 5)

(72)m=	76.97	74.46	69.86	63.82	59.69	54.11	49.86	55.88	58.39	64.63	71.6	75.04	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	333.66	331.22	319.13	300.03	280.8	262.1	250.22	256.17	266.17	285.46	307.54	324.11	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	166.79	284.1	388.72	481.64	539.48	535.58	516.35	473.2	420.9	313.99	199.77	142.73	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	500.44	615.32	707.85	781.67	820.27	797.67	766.58	729.38	687.07	599.45	507.31	466.84	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.93	0.83	0.66	0.48	0.34	0.37	0.59	0.88	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.16	20.38	20.63	20.86	20.97	21	21	21	20.99	20.84	20.46	20.13	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.1	20.1	20.11	20.12	20.12	20.14	20.14	20.14	20.13	20.12	20.12	20.11	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.92	0.79	0.61	0.41	0.28	0.31	0.52	0.84	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19	19.32	19.66	19.97	20.1	20.14	20.14	20.14	20.12	19.95	19.44	18.95	(90)

fLA = Living area ÷ (4) = 0.24 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.28	19.58	19.9	20.19	20.31	20.35	20.35	20.35	20.34	20.17	19.69	19.24	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.13	19.43	19.75	20.04	20.16	20.2	20.2	20.2	20.19	20.02	19.54	19.09	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.91	0.79	0.61	0.42	0.28	0.31	0.53	0.84	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	493.71	592.46	643.5	617.11	502.34	333.53	215.12	226.27	362.41	500.61	490.58	462.3	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	931.25	908.66	825.78	681.41	515.44	334.63	215.2	226.41	366.61	573.95	763.61	921.13	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	325.53	212.48	135.62	46.29	9.75	0	0	0	0	54.57	196.58	341.37	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1322.18 (98)

Space heating requirement in kWh/m²/year 20.65 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	325.53	212.48	135.62	46.29	9.75	0	0	0	0	54.57	196.58	341.37	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	360.1	235.05	150.02	51.21	10.78	0	0	0	0	60.36	217.46	377.62	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1462.59 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	183.91	160.65	167.14	148.25	143.53	126.41	121.11	135.01	136.5	155.44	165.93	179.59

Efficiency of water heater 80.3 (216)

(217)m=	86.47	85.76	84.53	82.49	80.87	80.3	80.3	80.3	80.3	82.7	85.48	86.64	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	212.68	187.33	197.73	179.71	177.47	157.43	150.83	168.14	169.99	187.95	194.11	207.27	

Total = Sum(219a)$_{1...12}$ = 2190.65 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1462.59

DER WorkSheet: New dwelling design stage

Water heating fuel used		2190.65	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	164.97		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	194.97	(231)
Electricity for lighting		288.08	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	315.92	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	473.18	(264)
Space and water heating	(261) + (262) + (263) + (264) =				789.1	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	101.19	(267)
Electricity for lighting	(232) x		0.519	=	149.52	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			578.8	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			9.04	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 67

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.54	(1a) x	2.56	(2a) =	131.94	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.54	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.94	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	31.45	12.37	19.08	x	0.16	=	3.05			(29)
Walls Type2	32.9	2.42	30.48	x	0.16	=	4.88			(29)
Total area of elements, m²			64.34							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 27.72 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 842.43 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.19 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 31.91 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.37	14.18	14	13.07	12.89	11.96	11.96	11.78	12.33	12.89	13.26	13.63	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	46.27	46.09	45.9	44.98	44.79	43.87	43.87	43.68	44.24	44.79	45.16	45.53	

Average = Sum(39)$_{1...12}$ /12= 44.93 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	0.9	0.89	0.89	0.87	0.87	0.85	0.85	0.85	0.86	0.87	0.88	0.88	

Average = Sum(40)$_{1...12}$ /12= 0.87 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	82.96	79.94	76.93	73.91	70.89	67.88	67.88	70.89	73.91	76.93	79.94	82.96	

Total = Sum(44)$_{1...12}$ = 905.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	123.03	107.6	111.03	96.8	92.88	80.15	74.27	85.23	86.25	100.51	109.72	119.15	

Total = Sum(45)$_{1...12}$ = 1186.62 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	18.45	16.14	16.66	14.52	13.93	12.02	11.14	12.78	12.94	15.08	16.46	17.87	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.28	36.8	39.2	36.45	36.13	33.47	34.59	36.13	36.45	39.2	39.42	42.28	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	

Output from water heater (annual)$_{1...12}$ 1639.01 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.48	44.98	46.72	41.3	39.92	35.02	33.34	37.37	37.79	43.22	46.34	50.18	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.48	11.98	9.74	7.37	5.51	4.65	5.03	6.54	8.77	11.14	13	13.86	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.23	152.8	148.85	140.43	129.8	119.81	113.14	111.57	115.53	123.94	134.57	144.56	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	(71)

Water heating gains (Table 5)

(72)m=	69.19	66.93	62.79	57.36	53.65	48.64	44.82	50.23	52.48	58.09	64.36	67.45	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	285.93	283.74	273.41	257.19	240.99	225.14	215.02	220.37	228.81	245.21	263.96	277.9	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	121.43	206.85	283.02	350.67	392.78	389.94	375.94	344.53	306.45	228.61	145.45	103.92	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	407.37	490.58	556.43	607.86	633.77	615.07	590.96	564.89	535.26	473.81	409.41	381.82	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.93	0.81	0.64	0.45	0.33	0.36	0.56	0.86	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.29	20.49	20.71	20.9	20.98	21	21	21	20.99	20.88	20.56	20.26	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.17	20.17	20.18	20.19	20.19	20.21	20.21	20.21	20.2	20.19	20.19	20.18	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.91	0.77	0.59	0.4	0.27	0.29	0.5	0.82	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.24	19.53	19.83	20.09	20.18	20.21	20.21	20.21	20.2	20.08	19.64	19.2	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.5	19.77	20.05	20.29	20.38	20.41	20.41	20.41	20.4	20.28	19.87	19.47	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.35	19.62	19.9	20.14	20.23	20.26	20.26	20.26	20.25	20.13	19.72	19.32	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.98	0.96	0.9	0.77	0.59	0.4	0.27	0.3	0.5	0.81	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	401.01	470.26	500.98	469.6	375.66	247.68	160.4	168.53	270.16	385.92	393.56	377.46	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	696.64	678.37	615.18	505.61	381.98	248.11	160.42	168.58	271.94	426.78	569.98	688.34	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	219.95	139.85	84.96	25.92	4.7	0	0	0	0	30.4	127.02	231.29	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 864.1 (98)

Space heating requirement in kWh/m²/year 16.77 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	219.95	139.85	84.96	25.92	4.7	0	0	0	0	30.4	127.02	231.29	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	243.3	154.71	93.99	28.68	5.2	0	0	0	0	33.63	140.51	255.86	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 955.87 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42

Efficiency of water heater 80.3 (216)

(217)m=	85.77	84.97	83.68	81.79	80.62	80.3	80.3	80.3	80.3	81.94	84.65	85.96	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	192.73	169.94	179.54	162.92	160.03	141.5	135.57	151.13	152.8	170.52	176.19	187.79	

Total = Sum(219a)$_{1...12}$ = 1980.64 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 955.87

DER WorkSheet: New dwelling design stage

Water heating fuel used		1980.64	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	132.8		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	162.8	(231)
Electricity for lighting		238.1	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	206.47	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	427.82	(264)
Space and water heating	(261) + (262) + (263) + (264) =				634.29	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	84.49	(267)
Electricity for lighting	(232) x		0.519	=	123.58	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			381.35	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			7.4	(273)
EI rating (section 14)					95	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 68

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.98	(1a) x	2.56	(2a) =	189.38	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.98	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		189.38	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	57.81	22.77	35.04	x	0.16	=	5.61			(29)
Walls Type2	35.86	2.42	33.44	x	0.16	=	5.35			(29)
Total area of elements, m²			93.67							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 44.53 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1164.08 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.31 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 52.84 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.62	20.36	20.09	18.76	18.5	17.17	17.17	16.91	17.7	18.5	19.03	19.56	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	73.47	73.2	72.93	71.61	71.34	70.01	70.01	69.75	70.54	71.34	71.87	72.4	

Average = Sum(39)$_{1...12}$ /12= 71.54 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.99	0.99	0.99	0.97	0.96	0.95	0.95	0.94	0.95	0.96	0.97	0.98

Average = Sum(40)$_{1...12}$ /12= 0.97 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.34 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.74 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.72	95.13	91.54	87.95	84.36	80.77	80.77	84.36	87.95	91.54	95.13	98.72

Total = Sum(44)$_{1...12}$ = 1076.93 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.4	128.04	132.13	115.19	110.53	95.38	88.38	101.42	102.63	119.6	130.56	141.78

Total = Sum(45)$_{1...12}$ = 1412.03 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.96	19.21	19.82	17.28	16.58	14.31	13.26	15.21	15.39	17.94	19.58	21.27

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.31	43.79	46.65	43.37	42.99	39.83	41.16	42.99	43.37	46.65	46.91	50.31	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	

Output from water heater (annual)$_{1...12}$ 1950.34 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.25	53.52	55.59	49.14	47.5	41.67	39.68	44.47	44.97	51.43	55.14	59.72	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.4	16.34	13.29	10.06	7.52	6.35	6.86	8.92	11.97	15.2	17.74	18.91	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	206.4	208.54	203.14	191.65	177.15	163.52	154.41	152.27	157.67	169.16	183.66	197.29	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	(71)

Water heating gains (Table 5)

(72)m=	82.33	79.64	74.72	68.26	63.84	57.88	53.33	59.77	62.45	69.13	76.58	80.27	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	368.21	365.61	352.24	331.05	309.59	288.82	275.68	282.04	293.17	314.56	339.06	357.55	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)
Southwest	0.9x	0.77	x	2.89	x	36.79		0.55	x	0.7	=	56.74	(79)
Southwest	0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	96.65	(79)
Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	132.24	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	163.85	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	183.53	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	182.2	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	175.66	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	160.98	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	143.19	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	106.82	(79)
Southwest	0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	67.96	(79)
Southwest	0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	48.56	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(83)m=	223.53	380.75	520.96	645.49	723.01	717.78	692.02	634.19	564.09	420.81	267.74	191.29	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(84)m=	591.74	746.36	873.2	976.55	1032.6	1006.6	967.7	916.23	857.26	735.37	606.8	548.84	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.97	0.92	0.8	0.62	0.44	0.32	0.35	0.56	0.86	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(87)m=	20.16	20.41	20.67	20.88	20.97	21	21	21	20.99	20.85	20.47	20.12	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.09	20.1	20.11	20.11	20.13	20.13	20.13	20.12	20.11	20.11	20.1	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.96	0.9	0.76	0.57	0.38	0.26	0.28	0.49	0.82	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.99	19.34	19.7	19.99	20.09	20.13	20.13	20.13	20.12	19.96	19.44	18.94	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.28	19.6	19.94	20.21	20.31	20.34	20.34	20.34	20.33	20.18	19.69	19.23	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.13	19.45	19.79	20.06	20.16	20.19	20.19	20.19	20.18	20.03	19.54	19.08	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.89	0.76	0.57	0.39	0.26	0.29	0.5	0.81	0.96	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	583.05	713.68	778.17	737.86	592.06	390.51	251.46	264.55	425.19	597.53	584.32	543.13	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1089.34	1065.19	969.09	799.12	603.47	391.42	251.52	264.67	428.94	672.87	894.32	1077.23	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	376.68	236.21	142.04	44.1	8.49	0	0	0	0	56.05	223.2	397.37	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1484.16 (98)

Space heating requirement in kWh/m²/year 20.06 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	376.68	236.21	142.04	44.1	8.49	0	0	0	0	56.05	223.2	397.37	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	416.68	261.29	157.13	48.79	9.4	0	0	0	0	62.01	246.91	439.56	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1641.76 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08

Efficiency of water heater: 80.3 (216)

(217)m=	86.66	85.85	84.48	82.3	80.77	80.3	80.3	80.3	80.3	82.63	85.63	86.84

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	226.98	200.14	211.62	192.66	190.06	168.38	161.32	179.83	181.82	201.21	207.25	221.19

Total = Sum(219a)$_{1...12}$ = 2342.46 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1641.76	
Water heating fuel used		2342.46	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	190.61		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		220.61	(231)
Electricity for lighting		324.96	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	354.62	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	505.97	(264)
Space and water heating	(261) + (262) + (263) + (264) =			860.59	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	114.5	(267)
Electricity for lighting	(232) x	0.519	=	168.65	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			682.74	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			9.23	(273)
EI rating (section 14)				92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 69

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.3	(1a) x	2.56	(2a) =	187.65	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.3	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		187.65	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	56.92	19.88	37.04	x	0.16	=	5.93			(29)
Walls Type2	22.18	2.42	19.76	x	0.16	=	3.16			(29)
Total area of elements, m²			79.1							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 38.83 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 965.55 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.76 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 45.59 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.43	20.17	19.91	18.59	18.33	17.01	17.01	16.75	17.54	18.33	18.86	19.38	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	66.03	65.76	65.5	64.18	63.92	62.6	62.6	62.34	63.13	63.92	64.45	64.97	

Average = Sum(39)$_{1...12}$ /12= 64.12 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.9	0.9	0.89	0.88	0.87	0.85	0.85	0.85	0.86	0.87	0.88	0.89

Average = Sum(40)$_{1...12}$ /12= 0.87 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.32 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.38 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	98.32	94.75	91.17	87.6	84.02	80.44	80.44	84.02	87.6	91.17	94.75	98.32	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 1072.6 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.81	127.52	131.59	114.73	110.08	94.99	88.03	101.01	102.22	119.12	130.03	141.21

Total = Sum(45)$_{1...12}$ = 1406.35 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.87	19.13	19.74	17.21	16.51	14.25	13.2	15.15	15.33	17.87	19.5	21.18

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.1	43.61	46.46	43.2	42.82	39.67	40.99	42.82	43.2	46.46	46.72	50.1	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31	

Output from water heater (annual)$_{1...12}$ 1942.5 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.01	53.3	55.37	48.95	47.31	41.5	39.52	44.29	44.79	51.22	54.92	59.48	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	116.18	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.26	16.22	13.19	9.99	7.47	6.3	6.81	8.85	11.88	15.09	17.61	18.77	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	204.87	207	201.64	190.24	175.84	162.31	153.27	151.14	156.5	167.91	182.3	195.83	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	34.62	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	-92.94	(71)

Water heating gains (Table 5)

(72)m=	82	79.32	74.42	67.98	63.58	57.64	53.11	59.53	62.2	68.85	76.27	79.94	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	365.99	363.4	350.11	329.06	307.74	287.11	274.05	280.38	291.44	312.69	337.04	355.4	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	79.52	152.43	253.69	389.97	505.84	532.55	500.79	409.71	300.15	180.64	98.34	66.05	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	445.51	515.83	603.8	719.03	813.58	819.65	774.84	690.09	591.59	493.33	435.37	421.45	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.89	0.7	0.49	0.36	0.41	0.71	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.12	20.27	20.52	20.82	20.97	21	21	21	20.98	20.74	20.38	20.1	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.17	20.17	20.17	20.19	20.19	20.21	20.21	20.21	20.2	20.19	20.19	20.18	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.87	0.65	0.43	0.29	0.34	0.64	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.98	19.2	19.56	19.99	20.16	20.2	20.21	20.21	20.18	19.89	19.37	18.96	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.27	19.48	19.81	20.2	20.37	20.41	20.41	20.41	20.39	20.11	19.63	19.26	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	19.12	19.33	19.66	20.05	20.22	20.26	20.26	20.26	20.24	19.96	19.48	19.11	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.96	0.86	0.65	0.43	0.3	0.35	0.64	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	443.57	510.24	582.08	618.96	529.51	353.42	229.19	240.71	378.06	459.47	430.88	420.1	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	978.81	948.75	861.94	715.81	544.63	354.35	229.25	240.88	387.49	598.47	798.04	968.46	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	398.22	294.67	208.22	69.73	11.25	0	0	0	0	103.42	264.36	407.98	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1757.85 (98)

Space heating requirement in kWh/m²/year 23.98 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	398.22	294.67	208.22	69.73	11.25	0	0	0	0	103.42	264.36	407.98	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	440.51	325.97	230.33	77.14	12.44	0	0	0	0	114.4	292.43	451.3	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1944.52 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	195.91	171.13	178.05	157.92	152.9	134.66	129.02	143.83	145.41	165.58	176.76	191.31

Efficiency of water heater 80.3 (216)

(217)m= 86.8 | 86.41 | 85.45 | 83.15 | 80.92 | 80.3 | 80.3 | 80.3 | 80.3 | 83.9 | 86.06 | 86.91 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 225.7 | 198.06 | 208.38 | 189.94 | 188.95 | 167.7 | 160.67 | 179.11 | 181.09 | 197.35 | 205.38 | 220.12

Total = Sum(219a)$_{1...12}$ = 2322.46 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1944.52	
Water heating fuel used		2322.46	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	188.87		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		218.87	(231)
Electricity for lighting		322.56	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	420.02	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	501.65	(264)
Space and water heating	(261) + (262) + (263) + (264) =				921.67	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	113.59	(267)
Electricity for lighting	(232)	x	0.519	=	167.41	(268)
Energy saving/generation technologies						
Item 1			0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =				741.66	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =				10.12	(273)
EI rating (section 14)					92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 70

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.47	(1a) x	2.56	(2a) =	180.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.47	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	31.35	16.99	14.36	x	0.16	=	2.3			(29)
Walls Type2	17.17	2.42	14.75	x	0.16	=	2.36			(29)
Total area of elements, m²			48.53							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 30.57 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 494.99 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 4.61 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.18 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.65	19.39	19.14	17.88	17.62	16.36	16.36	16.1	16.86	17.62	18.13	18.64	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	54.83	54.58	54.32	53.06	52.81	51.54	51.54	51.29	52.05	52.81	53.31	53.82	

Average = Sum(39)$_{1...12}$ /12= 53 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.78	0.77	0.77	0.75	0.75	0.73	0.73	0.73	0.74	0.75	0.76	0.76

Average = Sum(40)$_{1...12}$ /12= 0.75 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.82 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.6	93.09	89.57	86.06	82.55	79.04	79.04	82.55	86.06	89.57	93.09	96.6

Total = Sum(44)$_{1...12}$ = 1053.82 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.25	125.29	129.29	112.72	108.16	93.33	86.48	99.24	100.43	117.04	127.76	138.73

Total = Sum(45)$_{1...12}$ = 1381.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.49	18.79	19.39	16.91	16.22	14	12.97	14.89	15.06	17.56	19.16	20.81

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.23	42.85	45.65	42.44	42.07	38.98	40.28	42.07	42.44	45.65	45.91	49.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	

Output from water heater (annual)$_{1...12}$ 1908.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	59.94	52.37	54.4	48.09	46.48	40.78	38.82	43.51	44	50.33	53.96	58.44	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.69	15.71	12.78	9.67	7.23	6.1	6.6	8.57	11.51	14.61	17.05	18.18	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.4	200.46	195.27	184.23	170.29	157.18	148.43	146.37	151.56	162.6	176.55	189.65	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	(71)

Water heating gains (Table 5)

(72)m=	80.56	77.93	73.12	66.79	62.47	56.63	52.18	58.49	61.11	67.64	74.94	78.54	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	356.52	353.97	341.03	320.56	299.85	279.79	267.07	273.29	284.04	304.72	328.4	346.24	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	407.66	458.08	528.6	628.6	713.92	721.23	680.04	602.51	512.6	431.95	392.76	388	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.89	0.67	0.46	0.33	0.39	0.68	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.27	20.39	20.61	20.88	20.98	21	21	21	20.99	20.8	20.5	20.26	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.27	20.28	20.28	20.29	20.3	20.31	20.31	20.32	20.31	20.3	20.29	20.28	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.86	0.63	0.41	0.28	0.33	0.62	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.29	19.47	19.79	20.16	20.28	20.31	20.31	20.32	20.3	20.07	19.63	19.28	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.55	19.72	20.01	20.35	20.47	20.5	20.5	20.5	20.48	20.27	19.87	19.54	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.4	19.57	19.86	20.2	20.32	20.35	20.35	20.35	20.33	20.12	19.72	19.39	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.97	0.86	0.63	0.41	0.28	0.34	0.62	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	406.16	454.05	511.68	537.89	448.61	295.98	193.17	202.56	320.06	403.16	389.16	386.95	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	828.19	800.62	725.75	599.71	455.31	296.23	193.18	202.61	324.44	502.7	672.55	817.72	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	313.99	232.9	159.27	44.51	4.98	0	0	0	0	74.06	204.04	320.49	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1354.25 (98)

Space heating requirement in kWh/m²/year 19.22 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	313.99	232.9	159.27	44.51	4.98	0	0	0	0	74.06	204.04	320.49	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	347.34	257.63	176.18	49.24	5.51	0	0	0	0	81.92	225.71	354.53	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1498.07 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96

Efficiency of water heater 80.3 (216)

(217)m=	86.28	85.87	84.82	82.35	80.59	80.3	80.3	80.3	80.3	83.21	85.46	86.38	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	223.1	195.8	206.25	188.41	186.4	164.77	157.86	175.97	177.92	195.51	203.21	217.59	

Total = Sum(219a)$_{1...12}$ = 2292.8 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1498.07

DER WorkSheet: New dwelling design stage

Water heating fuel used			2292.8	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		181.59		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		211.59	(231)
Electricity for lighting			312.37	(232)
Electricity generated by PVs			-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	323.58	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	495.25	(264)
Space and water heating	(261) + (262) + (263) + (264) =				818.83	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	109.81	(267)
Electricity for lighting	(232) x		0.519	=	162.12	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =				629.76	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =				8.94	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 71

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.12	(1a) x	2.56	(2a) =	130.85	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.12	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.85	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	25.24	12.37	12.87	x	0.16	=	2.06			(29)
Walls Type2	33.85	2.42	31.43	x	0.16	=	5.03			(29)
Total area of elements, m²			59.09							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 26.88 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 753.05 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 3.6 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 30.48 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.25	14.07	13.88	12.97	12.78	11.86	11.86	11.68	12.23	12.78	13.15	13.52	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	44.73	44.55	44.36	43.44	43.26	42.34	42.34	42.16	42.71	43.26	43.63	43.99	

Average = Sum(39)$_{1...12}$ /12= 43.4 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.88	0.87	0.87	0.85	0.85	0.83	0.83	0.82	0.84	0.85	0.85	0.86

Average = Sum(40)$_{1...12}$ /12= 0.85 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.12 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.63	79.63	76.62	73.62	70.61	67.61	67.61	70.61	73.62	76.62	79.63	82.63

Total = Sum(44)$_{1...12}$ = 901.44 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.54	107.18	110.6	96.42	92.52	79.84	73.98	84.89	85.91	100.12	109.28	118.67

Total = Sum(45)$_{1...12}$ = 1181.94 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.38	16.08	16.59	14.46	13.88	11.98	11.1	12.73	12.89	15.02	16.39	17.8

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.11	36.65	39.05	36.3	35.98	33.34	34.45	35.98	36.3	39.05	39.27	42.11	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78	

Output from water heater (annual)$_{1...12}$ 1632.53 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.27	44.8	46.53	41.14	39.76	34.88	33.21	37.22	37.64	43.05	46.15	49.99	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	86.15	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.38	11.89	9.67	7.32	5.47	4.62	4.99	6.49	8.71	11.06	12.9	13.76	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	150.13	151.69	147.76	139.4	128.85	118.94	112.31	110.76	114.68	123.04	133.59	143.51	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	31.61	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	-68.92	(71)

Water heating gains (Table 5)

(72)m=	68.91	66.66	62.55	57.13	53.44	48.45	44.64	50.03	52.28	57.86	64.1	67.19	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	284.27	282.08	271.82	255.7	239.61	223.85	213.79	219.12	227.51	243.8	262.44	276.29	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	13.91	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	28.31	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	51.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	83.77	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	112.6	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	120.04	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	112.29	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	89.52	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	62.15	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	34.6	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	17.5	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	11.36	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	37.24	75.8	136.57	224.28	301.48	321.41	300.67	239.7	166.41	92.63	46.85	30.41	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	321.51	357.88	408.39	479.98	541.08	545.25	514.46	458.81	393.92	336.44	309.3	306.7	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.9	0.71	0.49	0.36	0.42	0.72	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.18	20.3	20.53	20.82	20.97	21	21	21	20.98	20.75	20.42	20.16	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.19	20.19	20.19	20.21	20.21	20.23	20.23	20.23	20.22	20.21	20.21	20.2	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.88	0.66	0.44	0.3	0.35	0.65	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	19.08	19.27	19.6	20.01	20.18	20.23	20.23	20.23	20.2	19.93	19.45	19.07	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.36	19.53	19.83	20.21	20.38	20.42	20.42	20.42	20.4	20.13	19.69	19.34	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.21	19.38	19.68	20.06	20.23	20.27	20.27	20.27	20.25	19.98	19.54	19.19	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.99	0.97	0.87	0.66	0.44	0.3	0.36	0.65	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	319.81	353.96	394.72	417.62	358.54	239.47	155.42	163.19	256.09	313.78	305.66	305.46	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	666.72	644.8	584.7	484.87	369	240.07	155.46	163.31	262.55	405.97	542.91	659.59	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	258.11	195.45	141.34	48.42	7.78	0	0	0	0	68.59	170.82	263.48	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1153.99 (98)

Space heating requirement in kWh/m²/year 22.58 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	258.11	195.45	141.34	48.42	7.78	0	0	0	0	68.59	170.82	263.48	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	285.52	216.21	156.35	53.57	8.61	0	0	0	0	75.87	188.96	291.46	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1276.53 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.65	143.83	149.64	132.72	128.5	113.18	108.43	120.88	122.21	139.16	148.55	160.78

Efficiency of water heater 80.3 (216)

(217)m=	86.18	85.82	84.91	82.77	80.82	80.3	80.3	80.3	80.3	83.38	85.4	86.29	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	191.06	167.58	176.24	160.35	159.01	140.94	135.03	150.53	152.19	166.91	173.94	186.34	

Total = Sum(219a)$_{1...12}$ = 1960.12 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1276.53

DER WorkSheet: New dwelling design stage

Water heating fuel used		1960.12	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	131.7		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	161.7	(231)
Electricity for lighting		236.37	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	275.73	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	423.39	(264)
Space and water heating	(261) + (262) + (263) + (264) =				699.12	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	83.92	(267)
Electricity for lighting	(232) x		0.519	=	122.68	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			444.71	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			8.7	(273)
EI rating (section 14)					94	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 72

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	55.28	(1a) x	2.56	(2a) =	141.52	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	55.28	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		141.52	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Floor			55.286	x	0.12	=	6.63432			(28)
Walls Type1	47.86	9.24	38.62	x	0.16	=	6.18			(29)
Walls Type2	19.92	2.42	17.5	x	0.16	=	2.8			(29)
Total area of elements, m²			123.06							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 31.25 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 5100.42 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.88 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 39.13 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	15.41	15.21	15.01	14.02	13.82	12.83	12.83	12.63	13.23	13.82	14.22	14.62	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	54.54	54.34	54.14	53.15	52.95	51.96	51.96	51.76	52.36	52.95	53.35	53.75	

Average = Sum(39)$_{1...12}$ /12= 53.1 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.99	0.98	0.98	0.96	0.96	0.94	0.94	0.94	0.95	0.96	0.97	0.97

Average = Sum(40)$_{1...12}$ /12= 0.96 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.85 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 78.03 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	85.84	82.71	79.59	76.47	73.35	70.23	70.23	73.35	76.47	79.59	82.71	85.84

Total = Sum(44)$_{1...12}$ = 936.38 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	127.29	111.33	114.88	100.16	96.1	82.93	76.85	88.18	89.24	104	113.52	123.27

Total = Sum(45)$_{1...12}$ = 1227.75 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	19.09	16.7	17.23	15.02	14.42	12.44	11.53	13.23	13.39	15.6	17.03	18.49

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	43.74	38.07	40.56	37.71	37.38	34.63	35.79	37.38	37.71	40.56	40.79	43.74	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	171.03	149.4	155.44	137.87	133.48	117.56	112.63	125.56	126.95	144.56	154.31	167.02	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	171.03	149.4	155.44	137.87	133.48	117.56	112.63	125.56	126.95	144.56	154.31	167.02	

Output from water heater (annual)$_{1...12}$ 1695.81 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	53.26	46.53	48.34	42.73	41.3	36.23	34.5	38.67	39.1	44.72	47.94	51.92	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	92.28	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	14.84	13.18	10.72	8.12	6.07	5.12	5.53	7.19	9.66	12.26	14.31	15.25	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	160.91	162.58	158.37	149.41	138.1	127.48	120.38	118.71	122.92	131.87	143.18	153.81	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	32.23	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	-73.82	(71)

Water heating gains (Table 5)

(72)m=	71.59	69.25	64.97	59.35	55.51	50.32	46.37	51.97	54.3	60.11	66.59	69.79	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	301.02	298.69	287.74	270.56	253.36	236.6	225.96	231.55	240.56	257.92	277.76	292.53	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	27.82	56.62	102.01	167.53	225.19	240.08	224.59	179.05	124.3	69.19	35	22.72	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	328.83	355.31	389.75	438.09	478.56	476.68	450.55	410.6	364.86	327.11	312.76	315.25	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.96	0.87	0.67	0.5	0.57	0.85	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.98	20.09	20.3	20.61	20.86	20.98	21	20.99	20.91	20.59	20.24	19.97	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.1	20.1	20.12	20.12	20.13	20.13	20.14	20.13	20.12	20.11	20.11	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.99	0.95	0.82	0.59	0.41	0.47	0.79	0.97	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.73	18.89	19.2	19.65	19.98	20.12	20.13	20.13	20.05	19.64	19.13	18.72	(90)

fLA = Living area ÷ (4) = 0.23 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.02	19.16	19.45	19.87	20.19	20.32	20.33	20.33	20.25	19.86	19.38	19.01	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.87	19.01	19.3	19.72	20.04	20.17	20.18	20.18	20.1	19.71	19.23	18.86	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	

Utilisation factor for gains, hm:

(94)m=	1	0.99	0.98	0.94	0.82	0.59	0.41	0.47	0.78	0.96	0.99	1	(94)

Useful gains, hmGm , W = (94)m x (84)m

(95)m=	327.56	352.94	383.31	412.69	391.02	283.18	185.55	194.52	286.07	315.36	310.36	314.28	(95)

Monthly average external temperature from Table 8

(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)

Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]

(97)m=	794.46	766.97	693.2	575.28	441.44	289.26	186.13	195.78	314.23	482.33	647.37	787.73	(97)

Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m

(98)m=	347.37	278.23	230.56	117.06	37.51	0	0	0	0	124.23	242.65	352.24	

DER WorkSheet: New dwelling design stage

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ =	1729.85	(98)
Space heating requirement in kWh/m²/year	31.29	(99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system	0	(201)
Fraction of space heat from main system(s) (202) = 1 – (201) =	1	(202)
Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] =	1	(204)
Efficiency of main space heating system 1	90.4	(206)
Efficiency of secondary/supplementary heating system, %	0	(208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)	347.37	278.23	230.56	117.06	37.51	0	0	0	0	124.23	242.65	352.24	
(211)m = {[(98)m x (204)] } x 100 ÷ (206) (211)	384.26	307.77	255.04	129.49	41.5	0	0	0	0	137.42	268.42	389.65	

Total (kWh/year) =Sum(211)$_{1...5,10...12}$= 1913.55 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(215)m=	0	0	0	0	0	0	0	0	0	0	0	0

Total (kWh/year) =Sum(215)$_{1...5,10...12}$= 0 (215)

Water heating

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Output from water heater (calculated above)	171.03	149.4	155.44	137.87	133.48	117.56	112.63	125.56	126.95	144.56	154.31	167.02

Efficiency of water heater 80.3 (216)

(217)m=	86.8	86.59	86.04	84.64	82.32	80.3	80.3	80.3	80.3	84.67	86.19	86.89

(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	197.05	172.53	180.66	162.88	162.15	146.4	140.27	156.36	158.09	170.72	179.04	192.23

Total = Sum(219a)$_{1...12}$ = 2018.39 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1913.55
Water heating fuel used		2018.39
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	142.44	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		172.44 (231)
Electricity for lighting		262.09 (232)
Electricity generated by PVs		-888.26 (233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year

DER WorkSheet: New dwelling design stage

Space heating (main system 1)	(211) x	0.216	=	413.33	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	435.97	(264)
Space and water heating	(261) + (262) + (263) + (264) =			849.3	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	89.49	(267)
Electricity for lighting	(232) x	0.519	=	136.03	(268)
Energy saving/generation technologies Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			613.82	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			11.1	(273)
EI rating (section 14)				92	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 73

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	66.43	(1a) x	2.56	(2a) =	170.06	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	66.43	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		170.06	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			66.431	x	0.12	=	7.97172			(28)
Walls Type1	37.25	19.88	17.37	x	0.16	=	2.78			(29)
Walls Type2	32.9	2.42	30.48	x	0.16	=	4.88			(29)
Total area of elements, m²			136.57							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 45.37 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 5795.64 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.6 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 51.97 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	18.52	18.28	18.04	16.85	16.61	15.42	15.42	15.18	15.9	16.61	17.09	17.57	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	70.49	70.25	70.02	68.82	68.59	67.39	67.39	67.15	67.87	68.59	69.06	69.54	

Average = Sum(39)$_{1...12}$ /12= 68.76 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.06	1.06	1.05	1.04	1.03	1.01	1.01	1.01	1.02	1.03	1.04	1.05	
Average = Sum(40)$_{1...12}$ /12=													1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.16 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 85.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	93.96	90.54	87.12	83.71	80.29	76.87	76.87	80.29	83.71	87.12	90.54	93.96	
Total = Sum(44)$_{1...12}$ =													1024.98 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	139.34	121.86	125.75	109.63	105.2	90.78	84.12	96.53	97.68	113.84	124.26	134.94	
Total = Sum(45)$_{1...12}$ =													1343.92 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	20.9	18.28	18.86	16.45	15.78	13.62	12.62	14.48	14.65	17.08	18.64	20.24	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.88	41.67	44.4	41.28	40.92	37.91	39.17	40.92	41.28	44.4	44.65	47.88	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82	

Output from water heater (annual)$_{1...12}$ 1856.27 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	58.3	50.94	52.91	46.77	45.21	39.66	37.76	42.32	42.8	48.95	52.48	56.84	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.83	14.95	12.16	9.21	6.88	5.81	6.28	8.16	10.95	13.91	16.23	17.3	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	188.83	190.79	185.85	175.34	162.07	149.6	141.26	139.3	144.24	154.75	168.02	180.49	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	(71)

Water heating gains (Table 5)

(72)m=	78.36	75.8	71.12	64.96	60.76	55.08	50.76	56.89	59.44	65.79	72.89	76.39	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	342.37	339.88	327.47	307.85	288.06	268.84	256.64	262.7	272.98	292.8	315.49	332.54	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(79)

DER WorkSheet: New dwelling design stage

Southwest 0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	91.1	(79)
Southwest 0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	87.83	(79)
Southwest 0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	80.49	(79)
Southwest 0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	71.6	(79)
Southwest 0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	53.41	(79)
Southwest 0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	33.98	(79)
Southwest 0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	24.28	(79)
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	79.52	152.43	253.69	389.97	505.84	532.55	500.79	409.71	300.15	180.64	98.34	66.05	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	421.88	492.32	581.16	697.82	793.89	801.38	757.44	672.41	573.14	473.44	413.82	398.58	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.91	0.74	0.53	0.39	0.46	0.75	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.91	20.08	20.36	20.71	20.93	20.99	21	21	20.94	20.63	20.21	19.89	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.04	20.04	20.05	20.06	20.07	20.07	20.07	20.07	20.06	20.05	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.88	0.68	0.46	0.31	0.37	0.67	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.58	18.82	19.23	19.73	19.99	20.07	20.07	20.07	20.02	19.63	19.03	18.56	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.91	19.13	19.51	19.98	20.22	20.29	20.3	20.3	20.25	19.88	19.32	18.89	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.76	18.98	19.36	19.83	20.07	20.14	20.15	20.15	20.1	19.73	19.17	18.74	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.99	0.96	0.88	0.68	0.46	0.32	0.37	0.68	0.94	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	419.69	486.45	560.46	610.69	543.63	370.76	238.97	251.25	387.36	443.62	409.2	397.03	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1019.46	989.44	900.31	751.91	574.29	373.63	239.24	251.91	407.33	625.96	833.55	1010.91	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	446.22	338	252.85	101.68	22.81	0	0	0	0	135.66	305.53	456.73	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2059.49 (98)

Space heating requirement in kWh/m²/year 31 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	446.22	338	252.85	101.68	22.81	0	0	0	0	135.66	305.53	456.73	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	493.61	373.9	279.71	112.48	25.23	0	0	0	0	150.07	337.98	505.23	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2278.2 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82

Efficiency of water heater 80.3 (216)

(217)m= 87.16 | 86.84 | 86.05 | 84.08 | 81.53 | 80.3 | 80.3 | 80.3 | 80.3 | 84.67 | 86.53 | 87.26 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 214.79 | 188.32 | 197.74 | 179.49 | 179.21 | 160.26 | 153.54 | 171.16 | 173.05 | 186.89 | 195.21 | 209.5

Total = Sum(219a)$_{1...12}$ = 2209.17 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2278.2	
Water heating fuel used		2209.17	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	171.17		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		201.17	(231)
Electricity for lighting		297.29	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	492.09	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	477.18	(264)
Space and water heating	(261) + (262) + (263) + (264) =				969.27	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	104.41	(267)
Electricity for lighting	(232) x		0.519	=	154.3	(268)
Energy saving/generation technologies						
Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			766.97	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.55	(273)
EI rating (section 14)					91	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 74

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	77.64	(1a) x	2.56	(2a) =	198.76	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	77.64	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		198.76	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			74.146	x	0.12	=	8.89752			(28)
Walls Type1	54.34	19.88	34.46	x	0.16	=	5.51			(29)
Walls Type2	14.93	2.42	12.51	x	0.16	=	2			(29)
Total area of elements, m²			143.42							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 46.16 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 6359.46 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 10.42 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 56.57 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	21.64	21.37	21.09	19.69	19.41	18.02	18.02	17.74	18.58	19.41	19.97	20.53	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	78.22	77.94	77.66	76.27	75.99	74.59	74.59	74.31	75.15	75.99	76.54	77.1	

Average = Sum(39)$_{1...12}$ /12= 76.2 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.01	1	1	0.98	0.98	0.96	0.96	0.96	0.97	0.98	0.99	0.99

Average = Sum(40)$_{1...12}$ /12= 0.98 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.42 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 91.59 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	100.75	97.09	93.43	89.76	86.1	82.43	82.43	86.1	89.76	93.43	97.09	100.75

Total = Sum(44)$_{1...12}$ = 1099.12 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	149.41	130.68	134.85	117.56	112.8	97.34	90.2	103.51	104.74	122.07	133.25	144.7

Total = Sum(45)$_{1...12}$ = 1441.12 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	22.41	19.6	20.23	17.63	16.92	14.6	13.53	15.53	15.71	18.31	19.99	21.7

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	44.69	47.61	44.27	43.87	40.65	42.01	43.87	44.27	47.61	47.88	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	200.37	175.37	182.46	161.83	156.68	137.99	132.21	147.38	149.01	169.68	181.13	195.66	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	200.37	175.37	182.46	161.83	156.68	137.99	132.21	147.38	149.01	169.68	181.13	195.66	

Output from water heater (annual)$_{1...12}$ 1989.76 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	62.42	54.62	56.74	50.16	48.48	42.53	40.49	45.38	45.89	52.49	56.27	60.85	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	120.83	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	19.12	16.98	13.81	10.45	7.81	6.6	7.13	9.27	12.44	15.79	18.43	19.65	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	214.44	216.66	211.06	199.12	184.05	169.89	160.42	158.2	163.81	175.74	190.81	204.98	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	35.08	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	-96.66	(71)

Water heating gains (Table 5)

(72)m=	83.9	81.28	76.26	69.66	65.16	59.07	54.43	61	63.74	70.55	78.16	81.79	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	379.7	377.17	363.37	341.48	319.27	297.8	284.23	290.72	302.23	324.34	349.65	368.66	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	59.85	121.82	219.48	360.44	484.51	516.54	483.21	385.22	267.44	148.87	75.3	48.87	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	439.55	498.99	582.85	701.93	803.77	814.34	767.44	675.93	569.67	473.21	424.95	417.54	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.79	0.58	0.43	0.5	0.81	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.92	20.06	20.32	20.67	20.91	20.99	21	21	20.93	20.59	20.2	19.91	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.08	20.08	20.08	20.1	20.1	20.12	20.12	20.12	20.11	20.1	20.1	20.09	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.92	0.74	0.5	0.34	0.41	0.74	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.63	18.83	19.21	19.72	20.02	20.11	20.12	20.12	20.05	19.62	19.05	18.62	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.96	19.15	19.49	19.96	20.25	20.34	20.34	20.34	20.28	19.87	19.35	18.95	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.81	19	19.34	19.81	20.1	20.19	20.19	20.19	20.13	19.72	19.2	18.8	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.74	0.51	0.35	0.42	0.74	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	438.21	495.73	570.72	640.96	593.75	412.47	267.6	280.92	421.78	454.93	422.22	416.58	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1135.16	1098.67	997.28	832.34	638.23	416.63	267.99	281.92	453.06	692.88	925.96	1125.48	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	518.53	405.18	317.36	137.79	33.1	0	0	0	0	177.04	362.7	527.43	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2479.11 (98)

Space heating requirement in kWh/m²/year 31.93 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	518.53	405.18	317.36	137.79	33.1	0	0	0	0	177.04	362.7	527.43	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	573.59	448.21	351.06	152.43	36.61	0	0	0	0	195.84	401.21	583.44	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2742.38 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	200.37	175.37	182.46	161.83	156.68	137.99	132.21	147.38	149.01	169.68	181.13	195.66

Efficiency of water heater 80.3 (216)

(217)m= 87.34 | 87.09 | 86.43 | 84.65 | 81.9 | 80.3 | 80.3 | 80.3 | 80.3 | 85.16 | 86.77 | 87.42 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 229.42 | 201.36 | 211.1 | 191.18 | 191.32 | 171.85 | 164.64 | 183.54 | 185.57 | 199.25 | 208.76 | 223.8

Total = Sum(219a)$_{1...12}$ = 2361.78 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2742.38	
Water heating fuel used		2361.78	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	200.05		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		230.05	(231)
Electricity for lighting		337.62	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	592.35	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	510.14	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1102.5	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	119.4	(267)
Electricity for lighting	(232) x	0.519	=	175.22	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			936.11	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			12.06	(273)
EI rating (section 14)				90	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 75

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	77.53	(1a) x	2.56	(2a) =	198.47	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	77.53	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		198.47	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	54.38	19.88	34.5	x	0.16	=	5.52			(29)
Walls Type2	14.93	2.42	12.51	x	0.16	=	2			(29)
Roof	77.53	0	77.53	x	0.12	=	9.3			(30)
Total area of elements, m²			146.84							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 46.57 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1496.97 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.42 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 55.99 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	21.61	21.34	21.06	19.67	19.39	17.99	17.99	17.72	18.55	19.39	19.94	20.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	77.61	77.33	77.05	75.66	75.38	73.99	73.99	73.71	74.54	75.38	75.94	76.49	

Average = Sum(39)$_{1...12}$ /12= 75.59 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1	1	0.99	0.98	0.97	0.95	0.95	0.95	0.96	0.97	0.98	0.99

Average = Sum(40)$_{1...12}$ /12= 0.97 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.41 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 91.54 (43)
Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	100.69	97.03	93.37	89.71	86.05	82.39	82.39	86.05	89.71	93.37	97.03	100.69	

Total = Sum(44)$_{1...12}$ = 1098.47 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	149.33	130.6	134.77	117.49	112.74	97.28	90.15	103.45	104.68	122	133.17	144.61	

Total = Sum(45)$_{1...12}$ = 1440.27 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	22.4	19.59	20.22	17.62	16.91	14.59	13.52	15.52	15.7	18.3	19.98	21.69	(46)

Water storage loss:
Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:
a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)
Temperature factor from Table 2b 0 (49)
Energy lost from water storage, kWh/year (48) x (49) = 0 (50)
b) If manufacturer's declared cylinder loss factor is not known:
Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)
If community heating see section 4.3
Volume factor from Table 2a 0 (52)
Temperature factor from Table 2b 0 (53)
Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)
Enter (50) or (54) in (55) 0 (55)
Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)
Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	44.66	47.58	44.24	43.85	40.63	41.98	43.85	44.24	47.58	47.85	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	

Output from water heater (annual)$_{1...12}$ 1988.65 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	62.39	54.59	56.71	50.13	48.45	42.5	40.47	45.36	45.87	52.46	56.24	60.82	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	19.1	16.96	13.79	10.44	7.81	6.59	7.12	9.26	12.42	15.77	18.41	19.63	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	214.2	216.42	210.82	198.89	183.84	169.7	160.24	158.02	163.62	175.55	190.6	204.75	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	(71)

Water heating gains (Table 5)

(72)m=	83.86	81.24	76.22	69.62	65.12	59.03	54.4	60.97	63.7	70.51	78.11	81.75	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	379.36	376.83	363.04	341.17	318.98	297.53	283.97	290.46	301.96	324.04	349.34	368.34	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	175.49	301.81	420.62	534.04	609.91	610.67	586.6	529.2	459.78	335.63	210.72	149.84	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	554.85	678.64	783.67	875.21	928.89	908.2	870.57	819.66	761.74	659.68	560.06	518.18	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.98	0.96	0.87	0.71	0.52	0.37	0.41	0.65	0.91	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.07	20.28	20.54	20.81	20.95	20.99	21	21	20.98	20.77	20.37	20.04	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.08	20.09	20.09	20.1	20.11	20.12	20.12	20.12	20.12	20.11	20.1	20.09	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.84	0.66	0.45	0.3	0.33	0.58	0.88	0.98	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.85	19.16	19.53	19.89	20.06	20.12	20.12	20.12	20.1	19.86	19.3	18.81	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.12	19.4	19.75	20.09	20.26	20.31	20.31	20.31	20.29	20.06	19.53	19.08	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.97	19.25	19.6	19.94	20.11	20.16	20.16	20.16	20.14	19.91	19.38	18.93	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.66	0.45	0.3	0.34	0.58	0.88	0.98	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	549.82	661.54	732.25	727.51	609.59	409.08	263.42	277.17	441.4	578.66	547.6	514.8	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1138.48	1109.8	1009.12	835.48	633.63	411.27	263.59	277.49	450.31	701.9	932.81	1126.87	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	437.97	301.23	205.99	77.74	17.88	0	0	0	0	91.69	277.35	455.38	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1865.23 (98)

Space heating requirement in kWh/m²/year 24.06 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	437.97	301.23	205.99	77.74	17.88	0	0	0	0	91.69	277.35	455.38	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	484.48	333.21	227.87	86	19.78	0	0	0	0	101.42	306.8	503.74	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2063.3 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57

Efficiency of water heater 80.3 (216)

(217)m=	86.97	86.4	85.36	83.32	81.23	80.3	80.3	80.3	80.3	83.58	86.12	87.11

(217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m=	230.3	202.84	213.63	194.11	192.77	171.75	164.55	183.43	185.46	202.9	210.19	224.52

Total = Sum(219a)$_{1...12}$ = 2376.43 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2063.3	
Water heating fuel used		2376.43	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	199.76		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	229.76	(231)
Electricity for lighting		337.24	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	445.67	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	513.31	(264)
Space and water heating	(261) + (262) + (263) + (264) =			958.98	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	119.25	(267)
Electricity for lighting	(232) x	0.519	=	175.03	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			792.25	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			10.22	(273)
EI rating (section 14)				91	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 76

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.94	(1a) x	2.56	(2a) =	130.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.94	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	24.35	15.26	9.09	x	0.16	=	1.45			(29)
Walls Type2	39.32	2.42	36.9	x	0.16	=	5.9			(29)
Roof	50.94	0	50.94	x	0.12	=	6.11			(30)
Total area of elements, m²			114.61							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 37.09 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1240.25 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.81 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 43.9 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.2	14.02	13.84	12.92	12.74	11.82	11.82	11.64	12.19	12.74	13.11	13.47	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	58.1	57.92	57.73	56.82	56.64	55.72	55.72	55.54	56.09	56.64	57	57.37	

Average = Sum(39)$_{1...12}$ /12= 56.77 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.14	1.14	1.13	1.12	1.11	1.09	1.09	1.09	1.1	1.11	1.12	1.13

Average = Sum(40)$_{1...12}$ /12= 1.11 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.5	79.5	76.5	73.5	70.5	67.5	67.5	70.5	73.5	76.5	79.5	82.5

Total = Sum(44)$_{1...12}$ = 900.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.35	107.01	110.42	96.27	92.37	79.71	73.86	84.76	85.77	99.96	109.11	118.49

Total = Sum(45)$_{1...12}$ = 1180.06 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.35	16.05	16.56	14.44	13.86	11.96	11.08	12.71	12.87	14.99	16.37	17.77

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.04	36.59	38.98	36.25	35.93	33.29	34.4	35.93	36.25	38.98	39.21	42.04	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53	

Output from water heater (annual)$_{1...12}$ 1629.95 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.19	44.73	46.46	41.07	39.69	34.83	33.16	37.16	37.58	42.98	46.08	49.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	85.9	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.34	11.85	9.64	7.3	5.46	4.61	4.98	6.47	8.68	11.02	12.87	13.72	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.69	151.24	147.33	138.99	128.48	118.59	111.98	110.43	114.35	122.68	133.2	143.08	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	-68.72	(71)

Water heating gains (Table 5)

(72)m=	68.8	66.56	62.45	57.04	53.35	48.37	44.57	49.95	52.19	57.77	64	67.08	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	283.61	281.42	271.18	255.1	239.05	223.33	213.3	218.62	226.99	243.24	261.83	275.65	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	130.13	224.56	314.92	403.07	463.21	465.03	446.19	400.53	345.32	250.25	156.4	111.03	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	413.74	505.98	586.1	658.17	702.27	688.36	659.49	619.15	572.32	493.49	418.23	386.67	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.86	0.7	0.51	0.37	0.41	0.64	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.97	20.19	20.48	20.77	20.93	20.99	21	21	20.97	20.73	20.29	19.93	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.97	19.97	19.97	19.99	19.99	20.01	20.01	20.01	20	19.99	19.99	19.98	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.82	0.64	0.43	0.29	0.32	0.56	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.61	18.94	19.34	19.74	19.93	20	20.01	20.01	19.98	19.71	19.1	18.57	(90)

fLA = Living area ÷ (4) = 0.28 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.99	19.29	19.66	20.03	20.21	20.28	20.28	20.29	20.25	20	19.43	18.95	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.84	19.14	19.51	19.88	20.06	20.13	20.13	20.14	20.1	19.85	19.28	18.8	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.92	0.81	0.64	0.44	0.3	0.33	0.57	0.86	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	407.97	488.68	539.28	535.85	451.55	305.43	196.65	206.99	327.67	425.18	405.37	382.63	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	844.91	824.79	751.07	623.79	473.68	307.98	196.9	207.44	336.78	523.65	694.46	837.4	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	325.09	225.86	157.58	63.31	16.46	0	0	0	0	73.26	208.15	338.35	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1408.07 (98)

Space heating requirement in kWh/m²/year 27.64 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	325.09	225.86	157.58	63.31	16.46	0	0	0	0	73.26	208.15	338.35	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	359.61	249.85	174.31	70.04	18.21	0	0	0	0	81.05	230.25	374.28	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1557.6 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	164.39	143.6	149.4	132.51	128.3	113	108.26	120.68	122.02	138.94	148.32	160.53

Efficiency of water heater 80.3 (216)

(217)m= 86.74 | 86.19 | 85.19 | 83.31 | 81.33 | 80.3 | 80.3 | 80.3 | 80.3 | 83.52 | 85.9 | 86.88 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 189.53 | 166.61 | 175.39 | 159.06 | 157.74 | 140.72 | 134.82 | 150.29 | 151.95 | 166.35 | 172.65 | 184.76

Total = Sum(219a)$_{1...12}$ = 1949.88 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1557.6
Water heating fuel used		1949.88
Electricity for pumps, fans and electric keep-hot		
mechanical ventilation - balanced, extract or positive input from outside	131.27	(230a)
central heating pump:	30	(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		161.27 (231)
Electricity for lighting		235.67 (232)
Electricity generated by PVs		-888.26 (233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh	**Emissions** kg CO2/year
Space heating (main system 1)	(211) x	0.216 =	336.44 (261)
Space heating (secondary)	(215) x	0.519 =	0 (263)
Water heating	(219) x	0.216 =	421.17 (264)
Space and water heating	(261) + (262) + (263) + (264) =		757.62 (265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519 =	83.7 (267)
Electricity for lighting	(232) x	0.519 =	122.31 (268)
Energy saving/generation technologies Item 1		0.519 =	-461 (269)
Total CO2, kg/year	sum of (265)…(271) =		502.62 (272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =		9.87 (273)
EI rating (section 14)			93 (274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 77

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.4	(1a) x	2.56	(2a) =	131.58	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.4	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.58	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	24.33	15.26	9.07	x	0.16	=	1.45			(29)
Walls Type2	34.01	2.42	31.59	x	0.16	=	5.05			(29)
Roof	51.39	0	51.39	x	0.12	=	6.17			(30)
Total area of elements, m²			109.73							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 36.29 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1153.69 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.52 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 42.81 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.33	14.14	13.96	13.04	12.85	11.93	11.93	11.75	12.3	12.85	13.22	13.59	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	57.14	56.95	56.77	55.85	55.66	54.74	54.74	54.55	55.11	55.66	56.03	56.4	

Average = Sum(39)$_{1...12}$ /12= 55.8 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.11	1.11	1.1	1.09	1.08	1.06	1.06	1.06	1.07	1.08	1.09	1.1

Average = Sum(40)$_{1...12}$ /12= 1.09 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.73 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.32 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(44)m=	82.85	79.84	76.82	73.81	70.8	67.79	67.79	70.8	73.81	76.82	79.84	82.85

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 903.82 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.86	107.46	110.89	96.67	92.76	80.05	74.17	85.12	86.13	100.38	109.57	118.99

Total = Sum(45)$_{1...12}$ = 1185.06 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.43	16.12	16.63	14.5	13.91	12.01	11.13	12.77	12.92	15.06	16.44	17.85

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.22	36.75	39.15	36.4	36.08	33.43	34.54	36.08	36.4	39.15	39.37	42.22	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.08	144.21	150.04	133.07	128.84	113.48	108.72	121.19	122.53	139.53	148.94	161.21	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.08	144.21	150.04	133.07	128.84	113.48	108.72	121.19	122.53	139.53	148.94	161.21	

Output from water heater (annual)$_{1...12}$ 1636.84 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.41	44.92	46.66	41.24	39.86	34.97	33.3	37.32	37.74	43.16	46.28	50.12	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	86.57	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.45	11.95	9.72	7.35	5.5	4.64	5.02	6.52	8.75	11.11	12.97	13.82	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	150.86	152.43	148.48	140.09	129.48	119.52	112.86	111.3	115.24	123.64	134.24	144.21	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	31.66	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	-69.25	(71)

Water heating gains (Table 5)

(72)m=	69.1	66.84	62.71	57.28	53.58	48.57	44.76	50.16	52.42	58.02	64.27	67.36	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	285.38	283.19	272.88	256.69	240.53	224.7	214.61	219.95	228.38	244.74	263.45	277.36	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	130.13	224.56	314.92	403.07	463.21	465.03	446.19	400.53	345.32	250.25	156.4	111.03	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	415.51	507.74	587.8	659.76	703.75	689.73	660.79	620.48	573.7	494.99	419.85	388.39	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.85	0.69	0.5	0.36	0.4	0.64	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20	20.23	20.5	20.79	20.94	20.99	21	21	20.97	20.75	20.32	19.96	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.99	19.99	20	20.01	20.01	20.03	20.03	20.03	20.02	20.01	20.01	20	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.93	0.81	0.63	0.43	0.28	0.32	0.56	0.86	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.68	19.01	19.4	19.78	19.96	20.02	20.03	20.03	20	19.75	19.16	18.64	(90)

fLA = Living area ÷ (4) = 0.35 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.14	19.43	19.79	20.13	20.3	20.36	20.37	20.37	20.34	20.1	19.56	19.1	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.99	19.28	19.64	19.98	20.15	20.21	20.22	20.22	20.19	19.95	19.41	18.95	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.92	0.81	0.64	0.44	0.3	0.34	0.57	0.86	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	409.89	490.63	540.85	535.95	450.32	304.9	197.78	207.92	327.34	426.18	407.15	384.47	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	839.55	819.11	745.67	619.02	470.6	307.17	198	208.32	335.67	520.51	690.01	831.86	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	319.67	220.74	152.39	59.81	15.09	0	0	0	0	70.18	203.66	332.86	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1374.39 (98)

Space heating requirement in kWh/m²/year 26.74 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	319.67	220.74	152.39	59.81	15.09	0	0	0	0	70.18	203.66	332.86	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	353.61	244.18	168.57	66.16	16.7	0	0	0	0	77.63	225.29	368.2	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1520.35 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	165.08	144.21	150.04	133.07	128.84	113.48	108.72	121.19	122.53	139.53	148.94	161.21

Efficiency of water heater 80.3 (216)

(217)m= 86.69 | 86.12 | 85.09 | 83.18 | 81.25 | 80.3 | 80.3 | 80.3 | 80.3 | 83.42 | 85.84 | 86.84 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 190.44 | 167.45 | 176.33 | 159.98 | 158.57 | 141.31 | 135.39 | 150.93 | 152.59 | 167.26 | 173.51 | 185.65

Total = Sum(219a)$_{1...12}$ = 1959.41 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		1520.35	
Water heating fuel used		1959.41	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	132.43		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		162.43	(231)
Electricity for lighting		237.52	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	328.39	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	423.23	(264)
Space and water heating	(261) + (262) + (263) + (264) =			751.63	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	84.3	(267)
Electricity for lighting	(232) x	0.519	=	123.28	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			498.2	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			9.69	(273)
EI rating (section 14)				93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 78

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	49.58	(1a) x	2.56	(2a) =	126.92	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	49.58	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		126.92	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Windows Type 2			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Floor			38.452	x	0.12	=	4.61424			(28)
Walls Type1	17.48	7.51	9.97	x	0.16	=	1.59			(29)
Walls Type2	22.47	2.42	20.05	x	0.16	=	3.21			(29)
Roof	49.58	0	49.58	x	0.12	=	5.95			(30)
Total area of elements, m²			127.98							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 28.71 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 3840.42 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.48 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 35.19 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	13.82	13.64	13.47	12.58	12.4	11.51	11.51	11.33	11.86	12.4	12.75	13.11	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	49.01	48.83	48.65	47.76	47.59	46.7	46.7	46.52	47.05	47.59	47.94	48.3	

Average = Sum(39)$_{1...12}$ /12= 47.72 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.99	0.98	0.98	0.96	0.96	0.94	0.94	0.94	0.95	0.96	0.97	0.97

Average = Sum(40)$_{1...12}$ /12= 0.96 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.68 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 74.04 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	81.45	78.49	75.53	72.56	69.6	66.64	66.64	69.6	72.56	75.53	78.49	81.45

Total = Sum(44)$_{1...12}$ = 888.53 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	120.79	105.64	109.01	95.04	91.19	78.69	72.92	83.68	84.68	98.68	107.72	116.97

Total = Sum(45)$_{1...12}$ = 1165 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.12	15.85	16.35	14.26	13.68	11.8	10.94	12.55	12.7	14.8	16.16	17.55

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	41.51	36.13	38.49	35.78	35.47	32.86	33.96	35.47	35.78	38.49	38.71	41.51	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	162.29	141.77	147.5	130.82	126.66	111.56	106.88	119.14	120.46	137.17	146.42	158.48	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	162.29	141.77	147.5	130.82	126.66	111.56	106.88	119.14	120.46	137.17	146.42	158.48	

Output from water heater (annual)$_{1...12}$ 1609.15 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	50.54	44.16	45.87	40.55	39.19	34.38	32.74	36.69	37.1	42.43	45.49	49.27	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	83.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.74	12.21	9.93	7.52	5.62	4.74	5.12	6.66	8.94	11.35	13.25	14.13	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	146.14	147.65	143.83	135.7	125.43	115.77	109.33	107.81	111.63	119.77	130.04	139.69	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	31.39	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	-67.11	(71)

Water heating gains (Table 5)

(72)m=	67.93	65.71	61.65	56.31	52.67	47.75	44	49.31	51.53	57.03	63.18	66.22	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	278.97	276.73	266.57	250.69	234.88	219.43	209.62	214.95	223.27	239.32	257.64	271.2	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	54.05	94.96	137.61	183.37	217.13	220.73	210.65	184.68	153.33	107.02	65.27	45.92	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	333.02	371.7	404.18	434.06	452.01	440.16	420.27	399.63	376.6	346.34	322.91	317.12	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.94	0.84	0.66	0.49	0.53	0.78	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.05	20.19	20.4	20.67	20.88	20.98	21	21	20.94	20.68	20.32	20.03	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.1	20.1	20.11	20.12	20.13	20.13	20.14	20.13	20.12	20.11	20.1	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.93	0.8	0.58	0.39	0.43	0.71	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.83	19.03	19.33	19.73	20	20.12	20.13	20.13	20.08	19.75	19.24	18.81	(90)

fLA = Living area ÷ (4) = 0.36 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.27	19.44	19.72	20.07	20.32	20.43	20.44	20.44	20.39	20.09	19.63	19.25	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.12	19.29	19.57	19.92	20.17	20.28	20.29	20.29	20.24	19.94	19.48	19.1	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.99	0.97	0.92	0.8	0.59	0.41	0.45	0.72	0.94	0.99	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	330.87	367	392.58	400.06	361.77	259.79	171.97	180.26	272.11	324.44	318.49	315.52	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	726.32	702.94	635.83	526.39	403.02	265.22	172.49	181.17	289.03	444.35	593.5	719.67	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	294.21	225.76	180.97	90.96	30.69	0	0	0	0	89.21	198.01	300.69	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1410.5 (98)

Space heating requirement in kWh/m²/year 28.45 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	294.21	225.76	180.97	90.96	30.69	0	0	0	0	89.21	198.01	300.69	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	325.46	249.73	200.19	100.62	33.95	0	0	0	0	98.69	219.03	332.62	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1560.29 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	162.29	141.77	147.5	130.82	126.66	111.56	106.88	119.14	120.46	137.17	146.42	158.48

Efficiency of water heater 80.3 (216)

(217)m=	86.53	86.22	85.57	84.16	82.09	80.3	80.3	80.3	80.3	84	85.81	86.64	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	187.55	164.43	172.38	155.45	154.3	138.92	133.1	148.37	150.01	163.3	170.63	182.92	

Total = Sum(219a)$_{1...12}$ = 1921.37 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		1560.29

DER WorkSheet: New dwelling design stage

Water heating fuel used		1921.37	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	127.74		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	157.74	(231)
Electricity for lighting		242.72	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	337.02	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	415.02	(264)
Space and water heating	(261) + (262) + (263) + (264) =				752.04	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	81.87	(267)
Electricity for lighting	(232) x		0.519	=	125.97	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			498.87	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			10.06	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 79

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	50.98	(1a) x	2.56	(2a) =	130.51	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	50.98	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		130.51	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x	1/[1/(1.4)+ 0.04]	=	10.27			(27)
Windows Type 2			2.89	x	1/[1/(1.4)+ 0.04]	=	3.83			(27)
Walls Type1	26.3	10.64	15.66	x	0.16	=	2.51			(29)
Walls Type2	25.88	2.42	23.45	x	0.16	=	3.75			(29)
Roof	50.98	0	50.98	x	0.12	=	6.12			(30)
Total area of elements, m²			103.16							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 29.87 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1123.82 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 7.34 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 37.21 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.21	14.03	13.85	12.93	12.75	11.83	11.83	11.65	12.2	12.75	13.11	13.48	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	51.43	51.24	51.06	50.14	49.96	49.05	49.05	48.86	49.41	49.96	50.33	50.69	

Average = Sum(39)$_{1...12}$ /12= 50.1 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.01	1.01	1	0.98	0.98	0.96	0.96	0.96	0.97	0.98	0.99	0.99

Average = Sum(40)$_{1...12}$ /12= 0.98 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.72 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.03 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	82.53	79.53	76.53	73.52	70.52	67.52	67.52	70.52	73.52	76.53	79.53	82.53

Total = Sum(44)$_{1...12}$ = 900.3 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	122.39	107.04	110.46	96.3	92.4	79.73	73.89	84.78	85.8	99.99	109.14	118.52

Total = Sum(45)$_{1...12}$ = 1180.44 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	18.36	16.06	16.57	14.44	13.86	11.96	11.08	12.72	12.87	15	16.37	17.78

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.06	36.6	39	36.26	35.94	33.3	34.41	35.94	36.26	39	39.22	42.06	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	164.44	143.64	149.45	132.56	128.34	113.03	108.29	120.72	122.06	138.98	148.36	160.58	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	164.44	143.64	149.45	132.56	128.34	113.03	108.29	120.72	122.06	138.98	148.36	160.58	

Output from water heater (annual)$_{1...12}$ 1630.46 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.21	44.74	46.48	41.08	39.71	34.84	33.17	37.18	37.59	43	46.1	49.92	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	85.95	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.4	11.9	9.68	7.33	5.48	4.62	5	6.49	8.71	11.07	12.91	13.77	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	149.78	151.33	147.41	139.08	128.55	118.66	112.05	110.5	114.41	122.75	133.28	143.17	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	31.59	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	-68.76	(71)

Water heating gains (Table 5)

(72)m=	68.83	66.58	62.47	57.06	53.37	48.38	44.58	49.97	52.21	57.79	64.02	67.1	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	283.78	281.59	271.34	255.25	239.18	223.45	213.41	218.74	227.12	243.39	262	275.82	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	28.37	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	48.33	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	66.12	(77)
Southeast	0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast	0.9x	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	81.93	(77)
Southeast	0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast	0.9x	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	91.77	(77)
Southeast	0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast	0.9x	0.77	x	2.89	x	118.15	x	0.55	x	0.7	=	91.1	(77)
Southeast	0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast	0.9x	0.77	x	2.89	x	113.91	x	0.55	x	0.7	=	87.83	(77)
Southeast	0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast	0.9x	0.77	x	2.89	x	104.39	x	0.55	x	0.7	=	80.49	(77)
Southeast	0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast	0.9x	0.77	x	2.89	x	92.85	x	0.55	x	0.7	=	71.6	(77)
Southeast	0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast	0.9x	0.77	x	2.89	x	69.27	x	0.55	x	0.7	=	53.41	(77)
Southeast	0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast	0.9x	0.77	x	2.89	x	44.07	x	0.55	x	0.7	=	33.98	(77)
Southeast	0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast	0.9x	0.77	x	2.89	x	31.49	x	0.55	x	0.7	=	24.28	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	104.45	177.92	243.43	301.63	337.85	335.4	323.37	296.34	263.59	196.64	125.11	89.39	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	388.23	459.51	514.78	556.87	577.03	558.85	536.78	515.08	490.71	440.03	387.1	365.21	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.96	0.88	0.75	0.55	0.4	0.43	0.67	0.91	0.98	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.11	20.29	20.53	20.78	20.94	20.99	21	21	20.97	20.78	20.4	20.07	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.08	20.08	20.08	20.1	20.1	20.12	20.12	20.12	20.11	20.1	20.09	20.09	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.98	0.94	0.85	0.69	0.48	0.32	0.35	0.59	0.88	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.9	19.17	19.51	19.86	20.04	20.11	20.11	20.12	20.09	19.86	19.33	18.86	(90)

fLA = Living area ÷ (4) = 0.31 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.27	19.51	19.82	20.14	20.32	20.38	20.39	20.39	20.36	20.14	19.66	19.23	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	19.12	19.36	19.67	19.99	20.17	20.23	20.24	20.24	20.21	19.99	19.51	19.08	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.94	0.85	0.7	0.49	0.33	0.36	0.6	0.88	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	383.79	447.01	482.4	473.57	401.19	273.8	178.15	187.21	294.69	385.96	377	362.07	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	761.98	741.19	672.51	556.24	422.98	276.14	178.35	187.54	302	469.15	624.4	754.45	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	281.37	197.69	141.45	59.52	16.21	0	0	0	0	61.89	178.12	291.93	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1228.19 (98)

Space heating requirement in kWh/m²/year 24.09 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	281.37	197.69	141.45	59.52	16.21	0	0	0	0	61.89	178.12	291.93	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	311.25	218.69	156.47	65.84	17.93	0	0	0	0	68.46	197.04	322.93	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1358.61 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	164.44	143.64	149.45	132.56	128.34	113.03	108.29	120.72	122.06	138.98	148.36	160.58

Efficiency of water heater 80.3 (216)

(217)m=	86.39	85.86	84.91	83.18	81.32	80.3	80.3	80.3	80.3	83.16	85.51	86.54	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	190.34	167.31	176.01	159.36	157.82	140.76	134.86	150.34	152	167.12	173.5	185.56	

Total = Sum(219a)$_{1...12}$ = 1954.99 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1358.61

DER WorkSheet: New dwelling design stage

Water heating fuel used		1954.99	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	131.35		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	161.35	(231)
Electricity for lighting		236.56	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	293.46	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	422.28	(264)
Space and water heating	(261) + (262) + (263) + (264) =				715.74	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	83.74	(267)
Electricity for lighting	(232) x		0.519	=	122.78	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			461.25	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			9.05	(273)
EI rating (section 14)					94	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 80

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	51.54	(1a) x	2.56	(2a) =	131.94	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	51.54	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		131.94	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x	1/[1/(1.4)+ 0.04]	=	10.27			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Walls Type1	31.45	12.37	19.08	x	0.16	=	3.05			(29)
Walls Type2	32.9	2.42	30.48	x	0.16	=	4.88			(29)
Roof	51.54	0	51.54	x	0.12	=	6.18			(30)
Total area of elements, m²			115.89							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 33.9 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1306.3 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 6.83 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 40.74 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	14.37	14.18	14	13.07	12.89	11.96	11.96	11.78	12.33	12.89	13.26	13.63	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	55.1	54.92	54.73	53.81	53.62	52.7	52.7	52.51	53.07	53.62	53.99	54.36	

Average = Sum(39)$_{1...12}$ /12= 53.76 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(40)m=	1.07	1.07	1.06	1.04	1.04	1.02	1.02	1.02	1.03	1.04	1.05	1.05	

Average = Sum(40)$_{1...12}$ /12= 1.04 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 1.74 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 75.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(44)m=	82.96	79.94	76.93	73.91	70.89	67.88	67.88	70.89	73.91	76.93	79.94	82.96	

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

Total = Sum(44)$_{1...12}$ = 905.02 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(45)m=	123.03	107.6	111.03	96.8	92.88	80.15	74.27	85.23	86.25	100.51	109.72	119.15	

Total = Sum(45)$_{1...12}$ = 1186.62 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(46)m=	18.45	16.14	16.66	14.52	13.93	12.02	11.14	12.78	12.94	15.08	16.46	17.87	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	42.28	36.8	39.2	36.45	36.13	33.47	34.59	36.13	36.45	39.2	39.42	42.28	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42	

Output from water heater (annual)$_{1...12}$ 1639.01 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	51.48	44.98	46.72	41.3	39.92	35.02	33.34	37.37	37.79	43.22	46.34	50.18	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	86.77	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	13.48	11.98	9.74	7.37	5.51	4.65	5.03	6.54	8.77	11.14	13	13.86	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	151.23	152.8	148.85	140.43	129.8	119.81	113.14	111.57	115.53	123.94	134.57	144.56	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	31.68	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	-69.42	(71)

Water heating gains (Table 5)

(72)m=	69.19	66.93	62.79	57.36	53.65	48.64	44.82	50.23	52.48	58.09	64.36	67.45	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	285.93	283.74	273.41	257.19	240.99	225.14	215.02	220.37	228.81	245.21	263.96	277.9	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	45.35	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	77.25	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast 0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	105.7	(77)
Southeast 0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast 0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	130.97	(77)
Southeast 0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast 0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	146.7	(77)
Southeast 0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast 0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	145.64	(77)
Southeast 0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast 0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	140.41	(77)
Southeast 0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast 0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	128.68	(77)
Southeast 0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast 0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	114.45	(77)
Southeast 0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast 0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	85.38	(77)
Southeast 0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast 0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	54.32	(77)
Southeast 0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast 0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	38.81	(77)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	121.43	206.85	283.02	350.67	392.78	389.94	375.94	344.53	306.45	228.61	145.45	103.92	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	407.37	490.58	556.43	607.86	633.77	615.07	590.96	564.89	535.26	473.81	409.41	381.82	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.95	0.87	0.73	0.54	0.39	0.43	0.65	0.9	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20.05	20.25	20.51	20.78	20.93	20.99	21	21	20.97	20.76	20.35	20.01	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.03	20.03	20.03	20.05	20.05	20.06	20.06	20.07	20.06	20.05	20.04	20.04	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.94	0.84	0.67	0.46	0.31	0.34	0.58	0.87	0.98	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.77	19.07	19.44	19.8	19.99	20.06	20.06	20.07	20.04	19.79	19.23	18.73	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.09	19.37	19.7	20.05	20.23	20.29	20.3	20.3	20.27	20.04	19.51	19.05	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.94	19.22	19.55	19.9	20.08	20.14	20.15	20.15	20.12	19.89	19.36	18.9	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.97	0.93	0.83	0.67	0.47	0.32	0.35	0.58	0.87	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	402.01	474.98	515.95	506.32	426.65	289.5	186.75	196.53	311.73	409.93	397.3	378.07	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	806.75	786.35	714.51	591.66	449.11	292.02	186.97	196.9	319.56	497.97	662.04	799.14	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	301.13	209.24	147.73	61.45	16.71	0	0	0	0	65.5	190.61	313.28	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1305.65 (98)

Space heating requirement in kWh/m²/year 25.33 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	301.13	209.24	147.73	61.45	16.71	0	0	0	0	65.5	190.61	313.28	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	333.1	231.46	163.42	67.97	18.49	0	0	0	0	72.46	210.85	346.55	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 1444.3 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	165.3	144.4	150.23	133.25	129.01	113.62	108.86	121.35	122.7	139.71	149.14	161.42

Efficiency of water heater 80.3 (216)

(217)m=	86.54	85.98	85.01	83.23	81.34	80.3	80.3	80.3	80.3	83.27	85.67	86.69	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	191.01	167.93	176.73	160.09	158.6	141.5	135.57	151.13	152.8	167.78	174.09	186.2	

Total = Sum(219a)$_{1...12}$ = 1963.42 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 1444.3

DER WorkSheet: New dwelling design stage

Water heating fuel used		1963.42	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	132.8		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	162.8	(231)
Electricity for lighting		238.1	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	311.97	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	424.1	(264)
Space and water heating	(261) + (262) + (263) + (264) =				736.07	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	84.49	(267)
Electricity for lighting	(232) x		0.519	=	123.58	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			483.13	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			9.37	(273)
EI rating (section 14)					93	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 81

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.98	(1a) x	2.56	(2a) =	189.38	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.98	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		189.38	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	57.81	22.77	35.04	x	0.16	=	5.61			(29)
Walls Type2	35.86	2.42	33.44	x	0.16	=	5.35			(29)
Roof	73.98	0	73.98	x	0.12	=	8.88			(30)
Total area of elements, m²			167.64							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 53.41 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1829.88 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.52 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 61.93 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.62	20.36	20.09	18.76	18.5	17.17	17.17	16.91	17.7	18.5	19.03	19.56	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	82.56	82.29	82.02	80.7	80.43	79.1	79.1	78.84	79.63	80.43	80.96	81.49	

Average = Sum(39)$_{1...12}$ /12= 80.63 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.12	1.11	1.11	1.09	1.09	1.07	1.07	1.07	1.08	1.09	1.09	1.1

Average = Sum(40)$_{1...12}$ /12= 1.09 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.34 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.74 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.72	95.13	91.54	87.95	84.36	80.77	80.77	84.36	87.95	91.54	95.13	98.72

Total = Sum(44)$_{1...12}$ = 1076.93 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.4	128.04	132.13	115.19	110.53	95.38	88.38	101.42	102.63	119.6	130.56	141.78

Total = Sum(45)$_{1...12}$ = 1412.03 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.96	19.21	19.82	17.28	16.58	14.31	13.26	15.21	15.39	17.94	19.58	21.27

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.31	43.79	46.65	43.37	42.99	39.83	41.16	42.99	43.37	46.65	46.91	50.31	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	

Output from water heater (annual)$_{1...12}$ 1950.34 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.25	53.52	55.59	49.14	47.5	41.67	39.68	44.47	44.97	51.43	55.14	59.72	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.4	16.34	13.29	10.06	7.52	6.35	6.86	8.92	11.97	15.2	17.74	18.91	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	206.4	208.54	203.14	191.65	177.15	163.52	154.41	152.27	157.67	169.16	183.66	197.29	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	(71)

Water heating gains (Table 5)

(72)m=	82.33	79.64	74.72	68.26	63.84	57.88	53.33	59.77	62.45	69.13	76.58	80.27	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	368.21	365.61	352.24	331.05	309.59	288.82	275.68	282.04	293.17	314.56	339.06	357.55	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southeast 0.9x	0.77	x	7.75	x	36.79	x	0.55	x	0.7	=	76.08	(77)
Southeast 0.9x	0.77	x	4.62	x	36.79	x	0.55	x	0.7	=	90.71	(77)
Southeast 0.9x	0.77	x	7.75	x	62.67	x	0.55	x	0.7	=	129.59	(77)
Southeast 0.9x	0.77	x	4.62	x	62.67	x	0.55	x	0.7	=	154.51	(77)
Southeast 0.9x	0.77	x	7.75	x	85.75	x	0.55	x	0.7	=	177.31	(77)

DER WorkSheet: New dwelling design stage

Southeast	0.9x	0.77	x	4.62	x	85.75	x	0.55	x	0.7	=	211.4	(77)
Southeast	0.9x	0.77	x	7.75	x	106.25	x	0.55	x	0.7	=	219.7	(77)
Southeast	0.9x	0.77	x	4.62	x	106.25	x	0.55	x	0.7	=	261.94	(77)
Southeast	0.9x	0.77	x	7.75	x	119.01	x	0.55	x	0.7	=	246.08	(77)
Southeast	0.9x	0.77	x	4.62	x	119.01	x	0.55	x	0.7	=	293.39	(77)
Southeast	0.9x	0.77	x	7.75	x	118.15	x	0.55	x	0.7	=	244.3	(77)
Southeast	0.9x	0.77	x	4.62	x	118.15	x	0.55	x	0.7	=	291.27	(77)
Southeast	0.9x	0.77	x	7.75	x	113.91	x	0.55	x	0.7	=	235.53	(77)
Southeast	0.9x	0.77	x	4.62	x	113.91	x	0.55	x	0.7	=	280.82	(77)
Southeast	0.9x	0.77	x	7.75	x	104.39	x	0.55	x	0.7	=	215.85	(77)
Southeast	0.9x	0.77	x	4.62	x	104.39	x	0.55	x	0.7	=	257.35	(77)
Southeast	0.9x	0.77	x	7.75	x	92.85	x	0.55	x	0.7	=	191.99	(77)
Southeast	0.9x	0.77	x	4.62	x	92.85	x	0.55	x	0.7	=	228.91	(77)
Southeast	0.9x	0.77	x	7.75	x	69.27	x	0.55	x	0.7	=	143.23	(77)
Southeast	0.9x	0.77	x	4.62	x	69.27	x	0.55	x	0.7	=	170.76	(77)
Southeast	0.9x	0.77	x	7.75	x	44.07	x	0.55	x	0.7	=	91.13	(77)
Southeast	0.9x	0.77	x	4.62	x	44.07	x	0.55	x	0.7	=	108.65	(77)
Southeast	0.9x	0.77	x	7.75	x	31.49	x	0.55	x	0.7	=	65.11	(77)
Southeast	0.9x	0.77	x	4.62	x	31.49	x	0.55	x	0.7	=	77.63	(77)
Southwest	0.9x	0.77	x	2.89	x	36.79		0.55	x	0.7	=	56.74	(79)
Southwest	0.9x	0.77	x	2.89	x	62.67		0.55	x	0.7	=	96.65	(79)
Southwest	0.9x	0.77	x	2.89	x	85.75		0.55	x	0.7	=	132.24	(79)
Southwest	0.9x	0.77	x	2.89	x	106.25		0.55	x	0.7	=	163.85	(79)
Southwest	0.9x	0.77	x	2.89	x	119.01		0.55	x	0.7	=	183.53	(79)
Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	182.2	(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	175.66	(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	160.98	(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	143.19	(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	106.82	(79)
Southwest	0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	67.96	(79)
Southwest	0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	48.56	(79)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	223.53	380.75	520.96	645.49	723.01	717.78	692.02	634.19	564.09	420.81	267.74	191.29	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	591.74	746.36	873.2	976.55	1032.6	1006.6	967.7	916.23	857.26	735.37	606.8	548.84	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	0.99	0.98	0.94	0.84	0.68	0.5	0.36	0.39	0.62	0.89	0.98	0.99	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.99	20.24	20.53	20.8	20.94	20.99	21	21	20.97	20.77	20.32	19.95	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.99	19.99	19.99	20.01	20.01	20.03	20.03	20.03	20.02	20.01	20.01	20	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	0.99	0.97	0.92	0.8	0.62	0.42	0.28	0.31	0.54	0.85	0.97	0.99	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.66	19.02	19.42	19.8	19.96	20.02	20.03	20.03	20	19.77	19.15	18.61	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.99	19.32	19.7	20.04	20.2	20.26	20.27	20.27	20.24	20.01	19.44	18.94	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.84	19.17	19.55	19.89	20.05	20.11	20.12	20.12	20.09	19.86	19.29	18.79	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.96	0.91	0.8	0.63	0.43	0.29	0.32	0.55	0.85	0.97	0.99	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	583.77	718.44	794.75	778.23	645.65	432.97	277.79	292.57	467.44	621.83	587.51	543.5	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1200.18	1174.32	1070.02	887.04	671.95	435.84	278.05	293.02	477.16	744.95	986.99	1188.68	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	458.61	306.36	204.81	78.34	19.56	0	0	0	0	91.6	287.63	480.01	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 1926.92 (98)

Space heating requirement in kWh/m²/year 26.05 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	458.61	306.36	204.81	78.34	19.56	0	0	0	0	91.6	287.63	480.01	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	507.31	338.89	226.56	86.66	21.64	0	0	0	0	101.33	318.17	530.99	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2131.55 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08

Efficiency of water heater: 80.3 (216)

(217)m= 87.11 | 86.49 | 85.39 | 83.38 | 81.33 | 80.3 | 80.3 | 80.3 | 80.3 | 83.62 | 86.26 | 87.26 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 225.81 | 198.66 | 209.35 | 190.17 | 188.76 | 168.38 | 161.32 | 179.83 | 181.82 | 198.82 | 205.74 | 220.12

Total = Sum(219a)$_{1...12}$ = 2328.79 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2131.55	
Water heating fuel used		2328.79	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	190.61		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		220.61	(231)
Electricity for lighting		324.96	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	460.42	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	503.02	(264)
Space and water heating	(261) + (262) + (263) + (264) =			963.43	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	114.5	(267)
Electricity for lighting	(232) x	0.519	=	168.65	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			785.58	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			10.62	(273)
EI rating (section 14)				91	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 82

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	73.98	(1a) x	2.56	(2a) =	189.38	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	73.98	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		189.38	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	57.81	22.77	35.04	x	0.16	=	5.61			(29)
Walls Type2	35.86	2.42	33.44	x	0.16	=	5.35			(29)
Roof	73.3	0	73.3	x	0.12	=	8.8			(30)
Total area of elements, m²			166.97							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 53.33 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1823.78 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.43 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 62.75 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.62	20.36	20.09	18.76	18.5	17.17	17.17	16.91	17.7	18.5	19.03	19.56	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	83.38	83.11	82.85	81.52	81.25	79.92	79.92	79.66	80.46	81.25	81.78	82.31	

Average = Sum(39)$_{1...12}$ /12= 81.45 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.13	1.12	1.12	1.1	1.1	1.08	1.08	1.08	1.09	1.1	1.11	1.11

Average = Sum(40)$_{1...12}$ /12= 1.1 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.34 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.74 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.72	95.13	91.54	87.95	84.36	80.77	80.77	84.36	87.95	91.54	95.13	98.72

Total = Sum(44)$_{1...12}$ = 1076.93 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.4	128.04	132.13	115.19	110.53	95.38	88.38	101.42	102.63	119.6	130.56	141.78

Total = Sum(45)$_{1...12}$ = 1412.03 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.96	19.21	19.82	17.28	16.58	14.31	13.26	15.21	15.39	17.94	19.58	21.27

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.31	43.79	46.65	43.37	42.99	39.83	41.16	42.99	43.37	46.65	46.91	50.31	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08	

Output from water heater (annual)$_{1...12}$ 1950.34 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.25	53.52	55.59	49.14	47.5	41.67	39.68	44.47	44.97	51.43	55.14	59.72	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	116.94	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.4	16.34	13.29	10.06	7.52	6.35	6.86	8.92	11.97	15.2	17.74	18.91	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	206.4	208.54	203.14	191.65	177.15	163.52	154.41	152.27	157.67	169.16	183.66	197.29	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	34.69	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	-93.55	(71)

Water heating gains (Table 5)

(72)m=	82.33	79.64	74.72	68.26	63.84	57.88	53.33	59.77	62.45	69.13	76.58	80.27	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	368.21	365.61	352.24	331.05	309.59	288.82	275.68	282.04	293.17	314.56	339.06	357.55	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Southwest$_{0.9x}$	0.77	x	2.89	x	36.79	x	0.55	x	0.7	=	56.74	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	62.67	x	0.55	x	0.7	=	96.65	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	85.75	x	0.55	x	0.7	=	132.24	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	106.25	x	0.55	x	0.7	=	163.85	(79)
Southwest$_{0.9x}$	0.77	x	2.89	x	119.01	x	0.55	x	0.7	=	183.53	(79)

DER WorkSheet: New dwelling design stage

Southwest	0.9x	0.77	x	2.89	x	118.15		0.55	x	0.7	=	182.2		(79)
Southwest	0.9x	0.77	x	2.89	x	113.91		0.55	x	0.7	=	175.66		(79)
Southwest	0.9x	0.77	x	2.89	x	104.39		0.55	x	0.7	=	160.98		(79)
Southwest	0.9x	0.77	x	2.89	x	92.85		0.55	x	0.7	=	143.19		(79)
Southwest	0.9x	0.77	x	2.89	x	69.27		0.55	x	0.7	=	106.82		(79)
Southwest	0.9x	0.77	x	2.89	x	44.07		0.55	x	0.7	=	67.96		(79)
Southwest	0.9x	0.77	x	2.89	x	31.49		0.55	x	0.7	=	48.56		(79)
Northwest	0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33		(81)
Northwest	0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82		(81)
Northwest	0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49		(81)
Northwest	0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62		(81)
Northwest	0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56		(81)
Northwest	0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01		(81)
Northwest	0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51		(81)
Northwest	0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53		(81)
Northwest	0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88		(81)
Northwest	0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19		(81)
Northwest	0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37		(81)
Northwest	0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08		(81)
Northwest	0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37		(81)
Northwest	0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59		(81)
Northwest	0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17		(81)
Northwest	0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05		(81)
Northwest	0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26		(81)
Northwest	0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3		(81)
Northwest	0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04		(81)
Northwest	0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19		(81)
Northwest	0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36		(81)
Northwest	0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35		(81)
Northwest	0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05		(81)
Northwest	0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72		(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	107.89	200.76	319.81	471.9	597.6	623.65	588.63	490.2	371.75	234.05	132.32	90.33	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	476.1	566.37	672.05	802.95	907.19	912.47	864.31	772.24	664.92	548.61	471.38	447.88	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	0.99	0.98	0.91	0.75	0.55	0.4	0.47	0.76	0.96	0.99	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.83	20.01	20.3	20.67	20.91	20.99	21	21	20.93	20.59	20.14	19.8	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.98	19.98	19.98	20	20	20.02	20.02	20.02	20.01	20	20	19.99	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.97	0.88	0.7	0.47	0.32	0.37	0.68	0.94	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.42	18.69	19.11	19.63	19.92	20.01	20.02	20.02	19.96	19.54	18.9	18.39	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.77	19.01	19.41	19.89	20.16	20.25	20.26	20.26	20.2	19.8	19.2	18.74	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.62	18.86	19.26	19.74	20.01	20.1	20.11	20.11	20.05	19.65	19.05	18.59	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	0.99	0.99	0.96	0.88	0.7	0.48	0.32	0.38	0.68	0.93	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	473.47	558.91	646.52	703.45	631.35	434.66	279.85	294.28	451.39	512.51	465.77	446.03	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1193.93	1160.51	1056.85	883.65	675.45	439.5	280.34	295.41	478.72	735.17	977.53	1184.53	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	536.02	404.27	305.29	129.74	32.81	0	0	0	0	165.66	368.47	549.45	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2491.71 (98)

Space heating requirement in kWh/m²/year 33.68 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	536.02	404.27	305.29	129.74	32.81	0	0	0	0	165.66	368.47	549.45	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	592.94	447.2	337.71	143.52	36.3	0	0	0	0	183.25	407.6	607.79	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2756.32 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	196.7	171.83	178.77	158.56	153.52	135.21	129.54	144.41	146	166.25	177.47	192.08

Efficiency of water heater: 80.3 (216)

(217)m= 87.45 | 87.13 | 86.39 | 84.55 | 81.91 | 80.3 | 80.3 | 80.3 | 80.3 | 85.04 | 86.85 | 87.55 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 224.94 | 197.2 | 206.94 | 187.53 | 187.42 | 168.38 | 161.32 | 179.83 | 181.82 | 195.49 | 204.34 | 219.4

Total = Sum(219a)$_{1...12}$ = 2314.63 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2756.32	
Water heating fuel used		2314.63	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	190.61		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		220.61	(231)
Electricity for lighting		324.96	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year	**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x	0.216	=	595.36	(261)
Space heating (secondary)	(215) x	0.519	=	0	(263)
Water heating	(219) x	0.216	=	499.96	(264)
Space and water heating	(261) + (262) + (263) + (264) =			1095.33	(265)
Electricity for pumps, fans and electric keep-hot	(231) x	0.519	=	114.5	(267)
Electricity for lighting	(232) x	0.519	=	168.65	(268)
Energy saving/generation technologies					
Item 1		0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =			917.47	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =			12.4	(273)
EI rating (section 14)				90	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 83

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	70.47	(1a) x	2.56	(2a) =	180.42	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	70.47	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		180.42	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x	1/[1/(1.4)+ 0.04]	=	10.27			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Walls Type1	31.35	16.99	14.36	x	0.16	=	2.3			(29)
Walls Type2	17.17	2.42	14.75	x	0.16	=	2.36			(29)
Roof	70.47	0	70.47	x	0.12	=	8.46			(30)
Total area of elements, m²			119							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 39.03 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1129.26 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.88 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 47.9 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	19.65	19.39	19.14	17.88	17.62	16.36	16.36	16.1	16.86	17.62	18.13	18.64	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	67.55	67.3	67.05	65.78	65.53	64.26	64.26	64.01	64.77	65.53	66.03	66.54	

Average = Sum(39)$_{1...12}$ /12= 65.72 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	0.96	0.95	0.95	0.93	0.93	0.91	0.91	0.91	0.92	0.93	0.94	0.94

Average = Sum(40)$_{1...12}$ /12= 0.93 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.26 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 87.82 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	96.6	93.09	89.57	86.06	82.55	79.04	79.04	82.55	86.06	89.57	93.09	96.6

Total = Sum(44)$_{1...12}$ = 1053.82 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	143.25	125.29	129.29	112.72	108.16	93.33	86.48	99.24	100.43	117.04	127.76	138.73

Total = Sum(45)$_{1...12}$ = 1381.72 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.49	18.79	19.39	16.91	16.22	14	12.97	14.89	15.06	17.56	19.16	20.81

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.23	42.85	45.65	42.44	42.07	38.98	40.28	42.07	42.44	45.65	45.91	49.23	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96	

Output from water heater (annual)$_{1...12}$ 1908.48 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	59.94	52.37	54.4	48.09	46.48	40.78	38.82	43.51	44	50.33	53.96	58.44	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	112.88	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	17.69	15.71	12.78	9.67	7.23	6.1	6.6	8.57	11.51	14.61	17.05	18.18	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	198.4	200.46	195.27	184.23	170.29	157.18	148.43	146.37	151.56	162.6	176.55	189.65	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	34.29	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	-90.3	(71)

Water heating gains (Table 5)

(72)m=	80.56	77.93	73.12	66.79	62.47	56.63	52.18	58.49	61.11	67.64	74.94	78.54	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	356.52	353.97	341.03	320.56	299.85	279.79	267.07	273.29	284.04	304.72	328.4	346.24	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	407.66	458.08	528.6	628.6	713.92	721.23	680.04	602.51	512.6	431.95	392.76	388	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.78	0.56	0.41	0.49	0.79	0.97	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	20	20.13	20.38	20.71	20.93	20.99	21	21	20.94	20.64	20.27	19.99	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.12	20.12	20.12	20.14	20.14	20.16	20.16	20.16	20.15	20.14	20.14	20.13	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.73	0.49	0.34	0.4	0.72	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.78	18.97	19.33	19.81	20.08	20.15	20.16	20.16	20.11	19.72	19.18	18.77	(90)

fLA = Living area ÷ (4) = 0.27 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	19.11	19.28	19.61	20.05	20.31	20.38	20.38	20.39	20.33	19.97	19.47	19.1	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.96	19.13	19.46	19.9	20.16	20.23	20.23	20.24	20.18	19.82	19.32	18.95	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.73	0.5	0.34	0.41	0.73	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	406.3	454.86	517	571.49	521.21	358.95	233.28	244.87	371.9	413.59	389.94	387.02	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	990.28	957.91	868.86	723.63	554.07	361.69	233.51	245.48	393.97	603.85	807.24	981.16	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	434.48	338.05	261.78	109.54	24.44	0	0	0	0	141.55	300.46	442.04	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2052.33 (98)

Space heating requirement in kWh/m²/year 29.12 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	434.48	338.05	261.78	109.54	24.44	0	0	0	0	141.55	300.46	442.04	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	480.62	373.95	289.58	121.17	27.04	0	0	0	0	156.59	332.36	488.98	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2270.28 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	192.48	168.14	174.94	155.16	150.22	132.31	126.76	141.31	142.87	162.68	173.66	187.96

Efficiency of water heater 80.3 (216)

(217)m=	87.04	86.77	86.06	84.19	81.58	80.3	80.3	80.3	80.3	84.7	86.42	87.13	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	221.14	193.76	203.26	184.29	184.15	164.77	157.86	175.97	177.92	192.06	200.95	215.72	

Total = Sum(219a)$_{1...12}$ = 2271.87 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2270.28

DER WorkSheet: New dwelling design stage

Water heating fuel used			2271.87	
Electricity for pumps, fans and electric keep-hot				
mechanical ventilation - balanced, extract or positive input from outside		181.59		(230a)
central heating pump:		30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =		211.59	(231)
Electricity for lighting			312.37	(232)
Electricity generated by PVs			-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

		Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	490.38	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	490.72	(264)
Space and water heating	(261) + (262) + (263) + (264) =				981.1	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	109.81	(267)
Electricity for lighting	(232)	x	0.519	=	162.12	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =				792.04	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =				11.24	(273)
EI rating (section 14)					91	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 84

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	74.52	(1a) x	2.56	(2a) =	190.77	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	74.52	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		190.77	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Floor			24.906	x	0.12	=	2.98872			(28)
Walls Type1	44.28	19.88	24.4	x	0.16	=	3.9			(29)
Walls Type2	57.23	2.42	54.81	x	0.16	=	8.77			(29)
Roof	74.52	0	74.52	x	0.12	=	8.94			(30)
Total area of elements, m²			200.93							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 54.35 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 3885.11 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 11.62 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 65.97 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.77	20.51	20.24	18.9	18.63	17.3	17.3	17.03	17.83	18.63	19.17	19.7	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	86.75	86.48	86.21	84.87	84.61	83.27	83.27	83	83.8	84.61	85.14	85.68	

Average = Sum(39)$_{1...12}$ /12= 84.84 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.16	1.16	1.16	1.14	1.14	1.12	1.12	1.11	1.12	1.14	1.14	1.15	
											Average = Sum(40)$_{1...12}$ /12=	1.14	(40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.35 (42)
if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)
if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 90.03 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	99.03	95.43	91.83	88.23	84.63	81.02	81.02	84.63	88.23	91.83	95.43	99.03	
											Total = Sum(44)$_{1...12}$ =	1080.33	(44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	146.86	128.44	132.54	115.55	110.88	95.68	88.66	101.74	102.95	119.98	130.97	142.23	
											Total = Sum(45)$_{1...12}$ =	1416.49	(45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	22.03	19.27	19.88	17.33	16.63	14.35	13.3	15.26	15.44	18	19.65	21.33	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)
Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)
Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m
(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.46	43.92	46.79	43.51	43.12	39.96	41.29	43.12	43.51	46.79	47.06	50.46	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	197.32	172.37	179.34	159.06	154	135.64	129.95	144.86	146.46	166.78	178.03	192.69	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	197.32	172.37	179.34	159.06	154	135.64	129.95	144.86	146.46	166.78	178.03	192.69	

Output from water heater (annual)$_{1...12}$ 1956.5 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	61.45	53.69	55.77	49.3	47.65	41.8	39.8	44.61	45.11	51.59	55.31	59.91	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	117.53	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.51	16.44	13.37	10.12	7.57	6.39	6.9	8.97	12.04	15.29	17.84	19.02	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	207.6	209.76	204.33	192.77	178.18	164.47	155.31	153.16	158.59	170.14	184.73	198.44	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	34.75	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	-94.03	(71)

Water heating gains (Table 5)

(72)m=	82.59	79.89	74.96	68.47	64.04	58.06	53.5	59.96	62.65	69.35	76.82	80.52	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	369.96	367.35	353.92	332.62	311.05	290.18	276.97	283.35	294.54	316.04	340.66	359.25	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)
Northwest 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	59.85	121.82	219.48	360.44	484.51	516.54	483.21	385.22	267.44	148.87	75.3	48.87	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	429.81	489.17	573.39	693.07	795.56	806.71	760.18	668.57	561.97	464.91	415.96	408.12	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.83	0.63	0.48	0.56	0.85	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.72	19.86	20.14	20.54	20.84	20.97	20.99	20.99	20.87	20.46	20.03	19.7	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	19.95	19.95	19.95	19.97	19.97	19.99	19.99	19.99	19.98	19.97	19.97	19.96	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.93	0.78	0.54	0.37	0.44	0.78	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.24	18.45	18.86	19.43	19.82	19.97	19.98	19.98	19.88	19.34	18.71	18.22	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.61	18.8	19.18	19.7	20.08	20.22	20.24	20.24	20.13	19.62	19.04	18.59	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.46	18.65	19.03	19.55	19.93	20.07	20.09	20.09	19.98	19.47	18.89	18.44	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.78	0.55	0.38	0.45	0.78	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	428.3	485.73	561.8	640.52	616.59	444.57	289.08	302.94	436.47	448.47	413.1	407.01	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1228.22	1189.37	1080.05	904.3	696.02	455.36	290.36	305.91	492.38	750.57	1003.59	1220.01	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	595.14	472.84	385.58	189.92	59.09	0	0	0	0	224.76	425.15	604.87	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2957.35 (98)

Space heating requirement in kWh/m²/year 39.69 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	595.14	472.84	385.58	189.92	59.09	0	0	0	0	224.76	425.15	604.87	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	658.34	523.06	426.52	210.09	65.37	0	0	0	0	248.63	470.3	669.1	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 3271.4 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	197.32	172.37	179.34	159.06	154	135.64	129.95	144.86	146.46	166.78	178.03	192.69

Efficiency of water heater 80.3 (216)

(217)m= 87.65 | 87.46 | 86.93 | 85.5 | 82.87 | 80.3 | 80.3 | 80.3 | 80.3 | 85.8 | 87.16 | 87.73 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 225.12 | 197.08 | 206.3 | 186.04 | 185.84 | 168.91 | 161.83 | 180.4 | 182.39 | 194.37 | 204.25 | 219.63

Total = Sum(219a)$_{1...12}$ = 2312.17 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		3271.4	
Water heating fuel used		2312.17	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	192.01		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		222.01	(231)
Electricity for lighting		326.86	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211)	x	0.216	=	706.62	(261)
Space heating (secondary)	(215)	x	0.519	=	0	(263)
Water heating	(219)	x	0.216	=	499.43	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1206.05	(265)
Electricity for pumps, fans and electric keep-hot	(231)	x	0.519	=	115.22	(267)
Electricity for lighting	(232)	x	0.519	=	169.64	(268)
Energy saving/generation technologies						
Item 1			0.519	=	-461	(269)
Total CO2, kg/year	sum of (265)…(271) =				1029.91	(272)
Dwelling CO2 Emission Rate	(272) ÷ (4) =				13.82	(273)
EI rating (section 14)					88	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 85

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	72.83	(1a) x	2.56	(2a) =	186.43	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	72.83	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		186.43	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x	1/[1/(1.4)+ 0.04]	=	10.27			(27)
Windows Type 2			4.62	x	1/[1/(1.4)+ 0.04]	=	6.12			(27)
Floor			16.55	x	0.12	=	1.986			(28)
Walls Type1	31.76	16.99	14.77	x	0.16	=	2.36			(29)
Walls Type2	34.04	2.42	31.62	x	0.16	=	5.06			(29)
Roof	72.83	0	72.83	x	0.12	=	8.74			(30)
Total area of elements, m²			155.17							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 44.06 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 2685.21 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.29 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 52.35 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	20.3	20.04	19.78	18.47	18.21	16.9	16.9	16.64	17.43	18.21	18.73	19.26	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	72.65	72.39	72.13	70.82	70.56	69.25	69.25	68.99	69.78	70.56	71.08	71.61	

Average = Sum(39)$_{1...12}$ /12= 70.76 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1	0.99	0.99	0.97	0.97	0.95	0.95	0.95	0.96	0.97	0.98	0.98

Average = Sum(40)$_{1...12}$ /12= 0.97 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.31 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 89.13 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	98.04	94.48	90.91	87.34	83.78	80.21	80.21	83.78	87.34	90.91	94.48	98.04

Total = Sum(44)$_{1...12}$ = 1069.53 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	145.39	127.16	131.22	114.4	109.77	94.72	87.77	100.72	101.92	118.78	129.66	140.8

Total = Sum(45)$_{1...12}$ = 1402.32 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	21.81	19.07	19.68	17.16	16.47	14.21	13.17	15.11	15.29	17.82	19.45	21.12

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	49.96	43.48	46.33	43.07	42.69	39.56	40.88	42.69	43.07	46.33	46.59	49.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	195.35	170.64	177.54	157.47	152.46	134.28	128.65	143.41	145	165.11	176.25	190.76	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	195.35	170.64	177.54	157.47	152.46	134.28	128.65	143.41	145	165.11	176.25	190.76	

Output from water heater (annual)$_{1...12}$ 1936.94 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	60.83	53.15	55.21	48.81	47.17	41.38	39.4	44.16	44.66	51.08	54.76	59.31	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	115.64	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	18.17	16.14	13.12	9.94	7.43	6.27	6.78	8.81	11.82	15.01	17.52	18.67	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	203.8	205.92	200.59	189.24	174.92	161.46	152.47	150.35	155.68	167.03	181.35	194.81	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	34.56	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	-92.51	(71)

Water heating gains (Table 5)

(72)m=	81.76	79.09	74.21	67.79	63.4	57.48	52.96	59.36	62.03	68.65	76.06	79.71	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	364.42	361.84	348.61	327.65	306.44	285.9	272.9	279.21	290.22	311.38	335.61	353.89	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	415.57	465.95	536.18	635.7	720.51	727.34	685.86	608.43	518.78	438.61	399.97	395.66	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.95	0.81	0.6	0.44	0.52	0.82	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.94	20.07	20.32	20.66	20.9	20.99	21	21	20.93	20.59	20.22	19.93	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.09	20.09	20.09	20.11	20.11	20.12	20.12	20.13	20.12	20.11	20.1	20.1	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.93	0.76	0.52	0.36	0.42	0.75	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.66	18.85	19.21	19.71	20.02	20.12	20.12	20.13	20.06	19.63	19.08	18.65	(90)

fLA = Living area ÷ (4) = 0.26 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.99	19.16	19.49	19.95	20.24	20.34	20.35	20.35	20.28	19.88	19.37	18.98	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.84	19.01	19.34	19.8	20.09	20.19	20.2	20.2	20.13	19.73	19.22	18.83	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.92	0.76	0.53	0.36	0.43	0.75	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	414.26	462.95	525.77	585.6	546.11	382.52	248.71	260.99	389.96	422.18	397.34	394.7	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1056.37	1021.72	926.43	772.15	592.33	387.05	249.13	262.04	420.77	643.9	861.4	1047.31	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	477.73	375.5	298.09	134.32	34.39	0	0	0	0	164.96	334.12	485.54	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2304.65 (98)

Space heating requirement in kWh/m²/year 31.65 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	477.73	375.5	298.09	134.32	34.39	0	0	0	0	164.96	334.12	485.54	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	528.46	415.37	329.75	148.59	38.05	0	0	0	0	182.48	369.61	537.1	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2549.39 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	195.35	170.64	177.54	157.47	152.46	134.28	128.65	143.41	145	165.11	176.25	190.76

Efficiency of water heater 80.3 (216)

(217)m=	87.22	86.98	86.35	84.65	81.99	80.3	80.3	80.3	80.3	85.05	86.64	87.3	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	223.98	196.18	205.62	186.02	185.96	167.22	160.21	178.6	180.57	194.13	203.44	218.51	

Total = Sum(219a)$_{1...12}$ = 2300.45 (219)

Annual totals **kWh/year** **kWh/year**

Space heating fuel used, main system 1 2549.39

DER WorkSheet: New dwelling design stage

Water heating fuel used		2300.45	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	187.65		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	217.65	(231)
Electricity for lighting		320.87	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	550.67	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	496.9	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1047.57	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	112.96	(267)
Electricity for lighting	(232) x		0.519	=	166.53	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			866.05	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.89	(273)
EI rating (section 14)					90	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 86

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	66.43	(1a) x	2.56	(2a) =	170.06	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	66.43	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		170.06	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7

Wind Factor (22a)m = (22)m ÷ 4

(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Walls Type1	37.25	16.99	20.26	x	0.16	=	3.24			(29)
Walls Type2	32.9	2.42	30.48	x	0.16	=	4.88			(29)
Roof	66.43	0	66.43	x	0.12	=	7.97			(30)
Total area of elements, m²			136.57							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 42 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1460.32 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 8.37 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 50.37 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	18.52	18.28	18.04	16.85	16.61	15.42	15.42	15.18	15.9	16.61	17.09	17.57	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	68.89	68.65	68.42	67.22	66.99	65.79	65.79	65.55	66.27	66.99	67.46	67.94	

Average = Sum(39)$_{1...12}$ /12= 67.16 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1.04	1.03	1.03	1.01	1.01	0.99	0.99	0.99	1	1.01	1.02	1.02

Average = Sum(40)$_{1...12}$ /12= 1.01 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31

(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.16 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 85.42 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec

Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)

(44)m=	93.96	90.54	87.12	83.71	80.29	76.87	76.87	80.29	83.71	87.12	90.54	93.96

Total = Sum(44)$_{1...12}$ = 1024.98 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	139.34	121.86	125.75	109.63	105.2	90.78	84.12	96.53	97.68	113.84	124.26	134.94

Total = Sum(45)$_{1...12}$ = 1343.92 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	20.9	18.28	18.86	16.45	15.78	13.62	12.62	14.48	14.65	17.08	18.64	20.24

(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0

(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0

(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0

(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	47.88	41.67	44.4	41.28	40.92	37.91	39.17	40.92	41.28	44.4	44.65	47.88	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82	

Output from water heater (annual)$_{1...12}$ 1856.27 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	58.3	50.94	52.91	46.77	45.21	39.66	37.76	42.32	42.8	48.95	52.48	56.84	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	107.82	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	16.83	14.95	12.16	9.21	6.88	5.81	6.28	8.16	10.95	13.91	16.23	17.3	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	188.83	190.79	185.85	175.34	162.07	149.6	141.26	139.3	144.24	154.75	168.02	180.49	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	33.78	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	-86.26	(71)

Water heating gains (Table 5)

(72)m=	78.36	75.8	71.12	64.96	60.76	55.08	50.76	56.89	59.44	65.79	72.89	76.39	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	342.37	339.88	327.47	307.85	288.06	268.84	256.64	262.7	272.98	292.8	315.49	332.54	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)

DER WorkSheet: New dwelling design stage

Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	51.15	104.11	187.57	308.04	414.07	441.45	412.96	329.22	228.56	127.23	64.35	41.77	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	393.51	443.99	515.04	615.9	702.13	710.28	669.61	591.92	501.54	420.03	379.84	374.3	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.79	0.58	0.43	0.5	0.81	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.91	20.04	20.3	20.66	20.9	20.99	21	21	20.92	20.58	20.19	19.89	(87)

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.05	20.06	20.06	20.07	20.08	20.09	20.09	20.09	20.09	20.08	20.07	20.06	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	0.99	0.98	0.92	0.74	0.5	0.34	0.41	0.74	0.96	0.99	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.59	18.79	19.17	19.68	19.99	20.08	20.09	20.09	20.03	19.59	19.01	18.57	(90)

fLA = Living area ÷ (4) = 0.25 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.91	19.1	19.45	19.92	20.21	20.31	20.31	20.32	20.25	19.83	19.31	18.9	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

DER WorkSheet: New dwelling design stage

(93)m=	18.76	18.95	19.3	19.77	20.06	20.16	20.16	20.17	20.1	19.68	19.16	18.75	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.74	0.51	0.35	0.42	0.74	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	392.02	440.56	503.17	560.64	518.88	361.42	234.14	245.85	369.23	402.09	376.88	373.22	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	996.45	964.48	875.45	730.81	560.28	365.56	234.53	246.84	397.46	608.48	813.26	988.32	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	449.7	352.07	276.97	122.52	30.8	0	0	0	0	153.55	314.19	457.64	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2157.45 (98)

Space heating requirement in kWh/m²/year 32.48 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	449.7	352.07	276.97	122.52	30.8	0	0	0	0	153.55	314.19	457.64	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	497.45	389.46	306.39	135.53	34.07	0	0	0	0	169.86	347.56	506.23	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2386.56 (211)

Space heating fuel (secondary), kWh/month
= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

Water heating

Output from water heater (calculated above)

	187.21	163.54	170.15	150.91	146.11	128.69	123.29	137.44	138.96	158.23	168.91	182.82

Efficiency of water heater 80.3 (216)

(217)m=	87.18	86.93	86.27	84.53	81.89	80.3	80.3	80.3	80.3	84.98	86.59	87.27	(217)

Fuel for water heating, kWh/month
(219)m = (64)m x 100 ÷ (217)m

(219)m=	214.75	188.12	197.23	178.53	178.42	160.26	153.54	171.16	173.05	186.21	195.06	209.49	

Total = Sum(219a)$_{1...12}$ = 2205.82 (219)

Annual totals	**kWh/year**	**kWh/year**
Space heating fuel used, main system 1		2386.56

DER WorkSheet: New dwelling design stage

Water heating fuel used		2205.82	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	171.17		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year	sum of (230a)…(230g) =	201.17	(231)
Electricity for lighting		297.29	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		Emission factor kg CO2/kWh		Emissions kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	515.5	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	476.46	(264)
Space and water heating	(261) + (262) + (263) + (264) =				991.95	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	104.41	(267)
Electricity for lighting	(232) x		0.519	=	154.3	(268)
Energy saving/generation technologies Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			789.65	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.89	(273)
EI rating (section 14)					91	(274)

DER WorkSheet: New dwelling design stage

User Details:

Assessor Name:	Chris Hocknell	**Stroma Number:**	STRO016363
Software Name:	Stroma FSAP 2012	**Software Version:**	Version: 1.0.4.16

Property Address: Flat 87

Address :

1. Overall dwelling dimensions:

	Area(m²)		Av. Height(m)		Volume(m³)	
Ground floor	77.53	(1a) x	2.56	(2a) =	198.47	(3a)
Total floor area TFA = (1a)+(1b)+(1c)+(1d)+(1e)+.....(1n)	77.53	(4)				
Dwelling volume			(3a)+(3b)+(3c)+(3d)+(3e)+.....(3n) =		198.47	(5)

2. Ventilation rate:

	main heating		secondary heating		other		total		m³ per hour	
Number of chimneys	0	+	0	+	0	=	0	x 40 =	0	(6a)
Number of open flues	0	+	0	+	0	=	0	x 20 =	0	(6b)
Number of intermittent fans							0	x 10 =	0	(7a)
Number of passive vents							0	x 10 =	0	(7b)
Number of flueless gas fires							0	x 40 =	0	(7c)

			Air changes per hour	
Infiltration due to chimneys, flues and fans =	(6a)+(6b)+(7a)+(7b)+(7c) =	0	÷ (5) =	0 (8)
If a pressurisation test has been carried out or is intended, proceed to (17), otherwise continue from (9) to (16)				
Number of storeys in the dwelling (ns)				0 (9)
Additional infiltration			[(9)-1]x0.1 =	0 (10)
Structural infiltration: 0.25 for steel or timber frame or 0.35 for masonry construction				0 (11)
if both types of wall are present, use the value corresponding to the greater wall area (after deducting areas of openings); if equal user 0.35				
If suspended wooden floor, enter 0.2 (unsealed) or 0.1 (sealed), else enter 0				0 (12)
If no draught lobby, enter 0.05, else enter 0				0 (13)
Percentage of windows and doors draught stripped				0 (14)
Window infiltration	0.25 - [0.2 x (14) ÷ 100] =			0 (15)
Infiltration rate	(8) + (10) + (11) + (12) + (13) + (15) =			0 (16)
Air permeability value, q50, expressed in cubic metres per hour per square metre of envelope area				4 (17)
If based on air permeability value, then	(18) = [(17) ÷ 20]+(8), otherwise (18) = (16)			0.2 (18)
Air permeability value applies if a pressurisation test has been done or a degree air permeability is being used				
Number of sides sheltered				2 (19)
Shelter factor	(20) = 1 - [0.075 x (19)] =			0.85 (20)
Infiltration rate incorporating shelter factor	(21) = (18) x (20) =			0.17 (21)

Infiltration rate modified for monthly wind speed

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
Monthly average wind speed from Table 7												
(22)m=	5.1	5	4.9	4.4	4.3	3.8	3.8	3.7	4	4.3	4.5	4.7
Wind Factor (22a)m = (22)m ÷ 4												
(22a)m=	1.27	1.25	1.23	1.1	1.08	0.95	0.95	0.92	1	1.08	1.12	1.18

DER WorkSheet: New dwelling design stage

Adjusted infiltration rate (allowing for shelter and wind speed) = (21a) x (22a)m

0.22	0.21	0.21	0.19	0.18	0.16	0.16	0.16	0.17	0.18	0.19	0.2

Calculate effective air change rate for the applicable case

If mechanical ventilation: 0.5 (23a)

If exhaust air heat pump using Appendix N, (23b) = (23a) × Fmv (equation (N5)) , otherwise (23b) = (23a) 0.5 (23b)

If balanced with heat recovery: efficiency in % allowing for in-use factor (from Table 4h) = 77.35 (23c)

a) If balanced mechanical ventilation with heat recovery (MVHR) (24a)m = (22b)m + (23b) × [1 – (23c) ÷ 100]

(24a)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(24a)

b) If balanced mechanical ventilation without heat recovery (MV) (24b)m = (22b)m + (23b)

(24b)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24b)

c) If whole house extract ventilation or positive input ventilation from outside
if (22b)m < 0.5 × (23b), then (24c) = (23b); otherwise (24c) = (22b) m + 0.5 × (23b)

(24c)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24c)

d) If natural ventilation or whole house positive input ventilation from loft
if (22b)m = 1, then (24d)m = (22b)m otherwise (24d)m = 0.5 + [(22b)m² x 0.5]

(24d)m=	0	0	0	0	0	0	0	0	0	0	0	0	(24d)

Effective air change rate - enter (24a) or (24b) or (24c) or (24d) in box (25)

(25)m=	0.33	0.33	0.32	0.3	0.3	0.27	0.27	0.27	0.28	0.3	0.3	0.31	(25)

3. Heat losses and heat loss parameter:

ELEMENT	Gross area (m²)	Openings m²	Net Area A ,m²		U-value W/m2K		A X U (W/K)	k-value kJ/m²·K	A X k kJ/K	
Doors			2.42	x	1.4	=	3.388			(26)
Windows Type 1			7.75	x1/[1/(1.4)+ 0.04]		=	10.27			(27)
Windows Type 2			4.62	x1/[1/(1.4)+ 0.04]		=	6.12			(27)
Windows Type 3			2.89	x1/[1/(1.4)+ 0.04]		=	3.83			(27)
Walls Type1	54.38	19.88	34.5	x	0.16	=	5.52			(29)
Walls Type2	14.93	2.42	12.51	x	0.16	=	2			(29)
Roof	77.64	0	77.64	x	0.12	=	9.32			(30)
Total area of elements, m²			146.95							(31)

** for windows and roof windows, use effective window U-value calculated using formula 1/[(1/U-value)+0.04] as given in paragraph 3.2*

*** include the areas on both sides of internal walls and partitions*

Fabric heat loss, W/K = S (A x U) (26)…(30) + (32) = 46.58 (33)

Heat capacity Cm = S(A x k) ((28)…(30) + (32) + (32a)…(32e) = 1497.98 (34)

Thermal mass parameter (TMP = Cm ÷ TFA) in kJ/m²K Indicative Value: Medium 250 (35)

For design assessments where the details of the construction are not known precisely the indicative values of TMP in Table 1f can be used instead of a detailed calculation.

Thermal bridges : S (L x Y) calculated using Appendix K 9.42 (36)

if details of thermal bridging are not known (36) = 0.15 x (31)

Total fabric heat loss (33) + (36) = 56.01 (37)

Ventilation heat loss calculated monthly (38)m = 0.33 × (25)m x (5)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(38)m=	21.61	21.34	21.06	19.67	19.39	17.99	17.99	17.72	18.55	19.39	19.94	20.5	(38)

Heat transfer coefficient, W/K (39)m = (37) + (38)m

(39)m=	77.62	77.34	77.06	75.67	75.39	74	74	73.72	74.56	75.39	75.95	76.51	

Average = Sum(39)$_{1...12}$ /12= 75.6 (39)

DER WorkSheet: New dwelling design stage

Heat loss parameter (HLP), W/m²K (40)m = (39)m ÷ (4)

(40)m=	1	1	0.99	0.98	0.97	0.95	0.95	0.95	0.96	0.97	0.98	0.99

Average = Sum(40)$_{1...12}$ /12= 0.98 (40)

Number of days in month (Table 1a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(41)m=	31	28	31	30	31	30	31	31	30	31	30	31	(41)

4. Water heating energy requirement: kWh/year:

Assumed occupancy, N 2.41 (42)

if TFA > 13.9, N = 1 + 1.76 x [1 - exp(-0.000349 x (TFA -13.9)2)] + 0.0013 x (TFA -13.9)

if TFA £ 13.9, N = 1

Annual average hot water usage in litres per day Vd,average = (25 x N) + 36 91.54 (43)

Reduce the annual average hot water usage by 5% if the dwelling is designed to achieve a water use target of not more that 125 litres per person per day (all water use, hot and cold)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Hot water usage in litres per day for each month Vd,m = factor from Table 1c x (43)													
(44)m=	100.69	97.03	93.37	89.71	86.05	82.39	82.39	86.05	89.71	93.37	97.03	100.69	

Total = Sum(44)$_{1...12}$ = 1098.47 (44)

Energy content of hot water used - calculated monthly = 4.190 x Vd,m x nm x DTm / 3600 kWh/month (see Tables 1b, 1c, 1d)

(45)m=	149.33	130.6	134.77	117.49	112.74	97.28	90.15	103.45	104.68	122	133.17	144.61	

Total = Sum(45)$_{1...12}$ = 1440.27 (45)

If instantaneous water heating at point of use (no hot water storage), enter 0 in boxes (46) to (61)

(46)m=	22.4	19.59	20.22	17.62	16.91	14.59	13.52	15.52	15.7	18.3	19.98	21.69	(46)

Water storage loss:

Storage volume (litres) including any solar or WWHRS storage within same vessel 0 (47)

If community heating and no tank in dwelling, enter 110 litres in (47)

Otherwise if no stored hot water (this includes instantaneous combi boilers) enter '0' in (47)

Water storage loss:

a) If manufacturer's declared loss factor is known (kWh/day): 0 (48)

Temperature factor from Table 2b 0 (49)

Energy lost from water storage, kWh/year (48) x (49) = 0 (50)

b) If manufacturer's declared cylinder loss factor is not known:

Hot water storage loss factor from Table 2 (kWh/litre/day) 0 (51)

If community heating see section 4.3

Volume factor from Table 2a 0 (52)

Temperature factor from Table 2b 0 (53)

Energy lost from water storage, kWh/year (47) x (51) x (52) x (53) = 0 (54)

Enter (50) or (54) in (55) 0 (55)

Water storage loss calculated for each month ((56)m = (55) × (41)m

(56)m=	0	0	0	0	0	0	0	0	0	0	0	0	(56)

If cylinder contains dedicated solar storage, (57)m = (56)m x [(50) – (H11)] ÷ (50), else (57)m = (56)m where (H11) is from Appendix H

(57)m=	0	0	0	0	0	0	0	0	0	0	0	0	(57)

Primary circuit loss (annual) from Table 3 0 (58)

Primary circuit loss calculated for each month (59)m = (58) ÷ 365 × (41)m

(modified by factor from Table H5 if there is solar water heating and a cylinder thermostat)

(59)m=	0	0	0	0	0	0	0	0	0	0	0	0	(59)

DER WorkSheet: New dwelling design stage

Combi loss calculated for each month (61)m = (60) ÷ 365 × (41)m

(61)m=	50.96	44.66	47.58	44.24	43.85	40.63	41.98	43.85	44.24	47.58	47.85	50.96	(61)

Total heat required for water heating calculated for each month (62)m = 0.85 × (45)m + (46)m + (57)m + (59)m + (61)m

(62)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	(62)

Solar DHW input calculated using Appendix G or Appendix H (negative quantity) (enter '0' if no solar contribution to water heating)

(add additional lines if FGHRS and/or WWHRS applies, see Appendix G)

(63)m=	0	0	0	0	0	0	0	0	0	0	0	0	(63)

Output from water heater

(64)m=	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57	

Output from water heater (annual)$_{1...12}$ 1988.65 (64)

Heat gains from water heating, kWh/month 0.25 ´ [0.85 × (45)m + (61)m] + 0.8 x [(46)m + (57)m + (59)m]

(65)m=	62.39	54.59	56.71	50.13	48.45	42.5	40.47	45.36	45.87	52.46	56.24	60.82	(65)

include (57)m in calculation of (65)m only if cylinder is in the dwelling or hot water is from community heating

5. Internal gains (see Table 5 and 5a):

Metabolic gains (Table 5), Watts

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(66)m=	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	120.71	(66)

Lighting gains (calculated in Appendix L, equation L9 or L9a), also see Table 5

(67)m=	19.1	16.96	13.79	10.44	7.81	6.59	7.12	9.26	12.42	15.77	18.41	19.63	(67)

Appliances gains (calculated in Appendix L, equation L13 or L13a), also see Table 5

(68)m=	214.2	216.42	210.82	198.89	183.84	169.7	160.24	158.02	163.62	175.55	190.6	204.75	(68)

Cooking gains (calculated in Appendix L, equation L15 or L15a), also see Table 5

(69)m=	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	35.07	(69)

Pumps and fans gains (Table 5a)

(70)m=	3	3	3	3	3	3	3	3	3	3	3	3	(70)

Losses e.g. evaporation (negative values) (Table 5)

(71)m=	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	-96.57	(71)

Water heating gains (Table 5)

(72)m=	83.86	81.24	76.22	69.62	65.12	59.03	54.4	60.97	63.7	70.51	78.11	81.75	(72)

Total internal gains = (66)m + (67)m + (68)m + (69)m + (70)m + (71)m + (72)m

(73)m=	379.36	376.83	363.04	341.17	318.98	297.53	283.97	290.46	301.96	324.04	349.34	368.34	(73)

6. Solar gains:

Solar gains are calculated using solar flux from Table 6a and associated equations to convert to the applicable orientation.

Orientation:	Access Factor Table 6d		Area m²		Flux Table 6a		g_ Table 6b		FF Table 6c		Gains (W)	
Northeast 0.9x	0.77	x	2.89	x	11.28	x	0.55	x	0.7	=	8.7	(75)
Northeast 0.9x	0.77	x	2.89	x	22.97	x	0.55	x	0.7	=	17.71	(75)
Northeast 0.9x	0.77	x	2.89	x	41.38	x	0.55	x	0.7	=	31.91	(75)
Northeast 0.9x	0.77	x	2.89	x	67.96	x	0.55	x	0.7	=	52.4	(75)
Northeast 0.9x	0.77	x	2.89	x	91.35	x	0.55	x	0.7	=	70.43	(75)

DER WorkSheet: New dwelling design stage

Northeast 0.9x	0.77	x	2.89	x	97.38	x	0.55	x	0.7	=	75.09	(75)
Northeast 0.9x	0.77	x	2.89	x	91.1	x	0.55	x	0.7	=	70.25	(75)
Northeast 0.9x	0.77	x	2.89	x	72.63	x	0.55	x	0.7	=	56	(75)
Northeast 0.9x	0.77	x	2.89	x	50.42	x	0.55	x	0.7	=	38.88	(75)
Northeast 0.9x	0.77	x	2.89	x	28.07	x	0.55	x	0.7	=	21.64	(75)
Northeast 0.9x	0.77	x	2.89	x	14.2	x	0.55	x	0.7	=	10.95	(75)
Northeast 0.9x	0.77	x	2.89	x	9.21	x	0.55	x	0.7	=	7.1	(75)
Northwest 0.9x	0.77	x	7.75	x	11.28	x	0.55	x	0.7	=	23.33	(81)
Northwest 0.9x	0.77	x	4.62	x	11.28	x	0.55	x	0.7	=	27.82	(81)
Northwest 0.9x	0.77	x	7.75	x	22.97	x	0.55	x	0.7	=	47.49	(81)
Northwest 0.9x	0.77	x	4.62	x	22.97	x	0.55	x	0.7	=	56.62	(81)
Northwest 0.9x	0.77	x	7.75	x	41.38	x	0.55	x	0.7	=	85.56	(81)
Northwest 0.9x	0.77	x	4.62	x	41.38	x	0.55	x	0.7	=	102.01	(81)
Northwest 0.9x	0.77	x	7.75	x	67.96	x	0.55	x	0.7	=	140.51	(81)
Northwest 0.9x	0.77	x	4.62	x	67.96	x	0.55	x	0.7	=	167.53	(81)
Northwest 0.9x	0.77	x	7.75	x	91.35	x	0.55	x	0.7	=	188.88	(81)
Northwest 0.9x	0.77	x	4.62	x	91.35	x	0.55	x	0.7	=	225.19	(81)
Northwest 0.9x	0.77	x	7.75	x	97.38	x	0.55	x	0.7	=	201.37	(81)
Northwest 0.9x	0.77	x	4.62	x	97.38	x	0.55	x	0.7	=	240.08	(81)
Northwest 0.9x	0.77	x	7.75	x	91.1	x	0.55	x	0.7	=	188.37	(81)
Northwest 0.9x	0.77	x	4.62	x	91.1	x	0.55	x	0.7	=	224.59	(81)
Northwest 0.9x	0.77	x	7.75	x	72.63	x	0.55	x	0.7	=	150.17	(81)
Northwest 0.9x	0.77	x	4.62	x	72.63	x	0.55	x	0.7	=	179.05	(81)
Northwest 0.9x	0.77	x	7.75	x	50.42	x	0.55	x	0.7	=	104.26	(81)
Northwest 0.9x	0.77	x	4.62	x	50.42	x	0.55	x	0.7	=	124.3	(81)
Northwest 0.9x	0.77	x	7.75	x	28.07	x	0.55	x	0.7	=	58.04	(81)
Northwest 0.9x	0.77	x	4.62	x	28.07	x	0.55	x	0.7	=	69.19	(81)
Northwest 0.9x	0.77	x	7.75	x	14.2	x	0.55	x	0.7	=	29.36	(81)
Northwest 0.9x	0.77	x	4.62	x	14.2	x	0.55	x	0.7	=	35	(81)
Northwest 0.9x	0.77	x	7.75	x	9.21	x	0.55	x	0.7	=	19.05	(81)
Northwest 0.9x	0.77	x	4.62	x	9.21	x	0.55	x	0.7	=	22.72	(81)

Solar gains in watts, calculated for each month (83)m = Sum(74)m …(82)m

(83)m=	59.85	121.82	219.48	360.44	484.51	516.54	483.21	385.22	267.44	148.87	75.3	48.87	(83)

Total gains – internal and solar (84)m = (73)m + (83)m , watts

(84)m=	439.21	498.65	582.52	701.61	803.49	814.07	767.18	675.68	569.4	472.92	424.64	417.21	(84)

7. Mean internal temperature (heating season)

Temperature during heating periods in the living area from Table 9, Th1 (°C) 21 (85)

Utilisation factor for gains for living area, h1,m (see Table 9a)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
(86)m=	1	1	0.99	0.94	0.79	0.57	0.42	0.5	0.81	0.98	1	1	(86)

Mean internal temperature in living area T1 (follow steps 3 to 7 in Table 9c)

(87)m=	19.93	20.07	20.32	20.68	20.92	20.99	21	21	20.93	20.6	20.21	19.92	(87)

DER WorkSheet: New dwelling design stage

Temperature during heating periods in rest of dwelling from Table 9, Th2 (°C)

(88)m=	20.08	20.09	20.09	20.1	20.11	20.12	20.12	20.12	20.12	20.11	20.1	20.09	(88)

Utilisation factor for gains for rest of dwelling, h2,m (see Table 9a)

(89)m=	1	1	0.98	0.92	0.74	0.5	0.34	0.41	0.74	0.97	1	1	(89)

Mean internal temperature in the rest of dwelling T2 (follow steps 3 to 7 in Table 9c)

(90)m=	18.65	18.85	19.22	19.73	20.03	20.11	20.12	20.12	20.06	19.63	19.07	18.63	(90)

fLA = Living area ÷ (4) = 0.22 (91)

Mean internal temperature (for the whole dwelling) = fLA × T1 + (1 – fLA) × T2

(92)m=	18.93	19.11	19.46	19.94	20.22	20.31	20.31	20.31	20.25	19.84	19.32	18.91	(92)

Apply adjustment to the mean internal temperature from Table 4e, where appropriate

(93)m=	18.78	18.96	19.31	19.79	20.07	20.16	20.16	20.16	20.1	19.69	19.17	18.76	(93)

8. Space heating requirement

Set Ti to the mean internal temperature obtained at step 11 of Table 9b, so that Ti,m=(76)m and re-calculate the utilisation factor for gains using Table 9a

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	
Utilisation factor for gains, hm:													
(94)m=	1	0.99	0.98	0.91	0.73	0.5	0.34	0.41	0.73	0.96	0.99	1	(94)
Useful gains, hmGm , W = (94)m x (84)m													
(95)m=	437.85	495.31	570.08	639.06	589.27	407.33	263.27	276.56	418.15	454.1	421.84	416.24	(95)
Monthly average external temperature from Table 8													
(96)m=	4.3	4.9	6.5	8.9	11.7	14.6	16.6	16.4	14.1	10.6	7.1	4.2	(96)
Heat loss rate for mean internal temperature, Lm , W =[(39)m x [(93)m– (96)m]													
(97)m=	1123.76	1087.72	987.38	823.94	631.15	411.11	263.6	277.44	447.4	685.43	916.38	1114.11	(97)
Space heating requirement for each month, kWh/month = 0.024 x [(97)m – (95)m] x (41)m													
(98)m=	510.32	398.1	310.47	133.11	31.16	0	0	0	0	172.11	356.07	519.22	

Total per year (kWh/year) = Sum(98)$_{1...5,9...12}$ = 2430.55 (98)

Space heating requirement in kWh/m²/year 31.35 (99)

9a. Energy requirements – Individual heating systems including micro-CHP)

Space heating:

Fraction of space heat from secondary/supplementary system 0 (201)

Fraction of space heat from main system(s) (202) = 1 – (201) = 1 (202)

Fraction of total heating from main system 1 (204) = (202) × [1 – (203)] = 1 (204)

Efficiency of main space heating system 1 90.4 (206)

Efficiency of secondary/supplementary heating system, % 0 (208)

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	kWh/year
Space heating requirement (calculated above)													
	510.32	398.1	310.47	133.11	31.16	0	0	0	0	172.11	356.07	519.22	
(211)m = {[(98)m x (204)] } x 100 ÷ (206)													(211)
	564.51	440.37	343.44	147.24	34.47	0	0	0	0	190.39	393.88	574.35	

Total (kWh/year) =Sum(211)$_{1...5,10....12}$= 2688.66 (211)

Space heating fuel (secondary), kWh/month

= {[(98)m x (201)] } x 100 ÷ (208)

(215)m=	0	0	0	0	0	0	0	0	0	0	0	0	

Total (kWh/year) =Sum(215)$_{1...5,10....12}$= 0 (215)

DER WorkSheet: New dwelling design stage

Water heating

Output from water heater (calculated above)

	200.28	175.26	182.35	161.73	156.59	137.91	132.13	147.3	148.92	169.58	181.02	195.57

Efficiency of water heater 80.3 (216)

(217)m= 87.3 | 87.05 | 86.38 | 84.57 | 81.82 | 80.3 | 80.3 | 80.3 | 80.3 | 85.09 | 86.72 | 87.39 (217)

Fuel for water heating, kWh/month

(219)m = (64)m x 100 ÷ (217)m

(219)m= 229.41 | 201.33 | 211.1 | 191.25 | 191.39 | 171.75 | 164.55 | 183.43 | 185.46 | 199.3 | 208.73 | 223.79

Total = Sum(219a)$_{1...12}$ = 2361.47 (219)

Annual totals	**kWh/year**	**kWh/year**	
Space heating fuel used, main system 1		2688.66	
Water heating fuel used		2361.47	
Electricity for pumps, fans and electric keep-hot			
mechanical ventilation - balanced, extract or positive input from outside	199.76		(230a)
central heating pump:	30		(230c)
Total electricity for the above, kWh/year sum of (230a)…(230g) =		229.76	(231)
Electricity for lighting		337.24	(232)
Electricity generated by PVs		-888.26	(233)

12a. CO2 emissions – Individual heating systems including micro-CHP

	Energy kWh/year		**Emission factor** kg CO2/kWh		**Emissions** kg CO2/year	
Space heating (main system 1)	(211) x		0.216	=	580.75	(261)
Space heating (secondary)	(215) x		0.519	=	0	(263)
Water heating	(219) x		0.216	=	510.08	(264)
Space and water heating	(261) + (262) + (263) + (264) =				1090.83	(265)
Electricity for pumps, fans and electric keep-hot	(231) x		0.519	=	119.25	(267)
Electricity for lighting	(232) x		0.519	=	175.03	(268)
Energy saving/generation technologies						
Item 1			0.519	=	-461	(269)
Total CO2, kg/year		sum of (265)…(271) =			924.1	(272)
Dwelling CO2 Emission Rate		(272) ÷ (4) =			11.92	(273)
EI rating (section 14)					90	(274)