

Daylight and Sunlight Assessment (Proposed Scheme)

Mead House, Mead House Lane, Hayes End, Hayes, UB4 8EW

For Reliant Care Ltd

November 2024

ecolytik

This page has been left intentionally blank

Contents

1 Executive Summary	4
2 Introduction	5
2.1 Site	5
2.2 Planning policies	5
2.3 Application of BRE's guidance	5
3 Technical model	6
3.1 Sources of information and assumptions	6
3.2 Scope of Assessment	6
3.3 Trees	6
4 Assessment results	7
4.1 Daylight	7
4.2 Sunlight	7
5 Conclusions	10
Appendix A – Detailed results	A
Appendix B – Planning Policies	B
Appendix C – BRE Guidance	C

Project number	997
Report status	Final
Revision number	1
Prepared by	Sherleen Pang
Checked by	Kostas Mastronikolaou

1 Executive Summary

Daylight and Sunlight analysis was carried out for the proposed development at Mead House in Hayes, located within the London Borough of Hillingdon. The Class MA prior approval application is for the conversion of the ground and first floor of the existing building to create 14no. studio flats. This report outlines the results of the analysis for the planning application, evaluating daylight and sunlight access within the development.

The methodology set out in this report is in accordance with BRE's "Site Layout Planning for Daylight and Sunlight, A Guide to Good Practice" by PJ Littlefair (2022) which is accepted as good practice by Planning Authorities. The numerical criteria suggested within the BRE guidelines has been applied to the assessment and it is important to note that these guidelines are not a rigid set of rules but are advisory and often need to be applied flexibly according to the specific context of a site.

A 3D computer model was prepared of the proposed scheme and the key surrounding buildings from design team drawings. Using this model and specialist technical software, daylight and sunlight levels were calculated. All habitable rooms of the development were evaluated in detail.

The results indicated that all habitable spaces exceed BRE recommendations for daylight, using the illuminance method and climate-based modelling. All assessed spaces with windows within 90 degrees due south exceeded BRE's recommendations for sunlight.

The proposed development complies with BRE's guidelines for daylight and sunlight access to the proposed dwellings within the conversion. It can therefore be concluded that the scheme meets relevant policies and will provide good quality of accommodation to the future residents from a daylight and sunlight perspective.

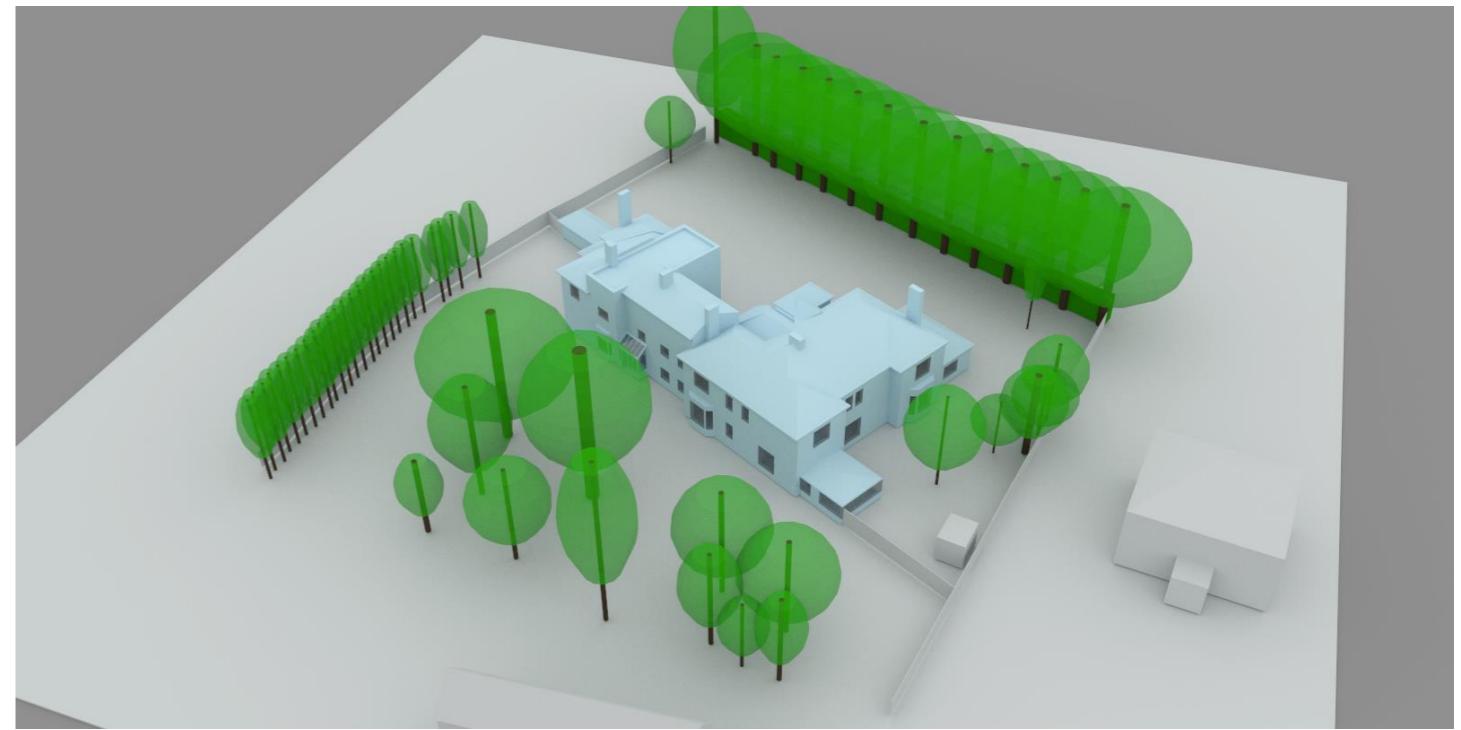


Figure 1: Technical 3D model of Mead House and surrounding context.

2 Introduction

2.1 Site

The proposed development at Mead House is located to the north of the junction between Mead House Lane and Hayes End Road, in Hayes, within the London Borough of Hillingdon.

The site currently comprises a 3-storey building which has had multiple uses, most recent was a day centre (run by the council) and prior to that it was a GP surgery (NHS).

The proposed works include conversion of the ground and first floor spaces from Class E to Class C3 Residential Studios under a Class MA prior approval application.

The site location is presented to the right.

2.2 Planning policies

Local, regional and national planning policies relating to daylight and sunlight has been considered as part of this assessment. In general terms, planning policy advises that new development should be making the best use of land and be designed in a way that enables appropriate levels of daylight and sunlight amenity. Provision of daylight and sunlight should be balanced against potential overheating risks. Policy requires new development to be assessed against BRE's guidelines. BRE's latest "Site layout planning for daylight and sunlight" document published in 2022 provides a set of recommendations for daylight and sunlight in new developments. It builds on British Standard EN 17037 (2018) and sets out criteria to evaluate both the quantity and quality of daylight and sunlight within new developments.

A full summary of the relevant policy landscape is presented in Appendix B.

2.3 Application of BRE's guidance

The BRE guidelines advise that the quality, quantity and distribution of daylight and sunlight within a habitable space would be notably affected if building obstructions are large in relation to their distance away. When assessing a proposed residential development, only those windows and rooms that have a reasonable expectation of daylight and sunlight need to be considered. The main habitable rooms have been tested, with non-habitable spaces such as staircases, hallways, bathrooms, toilets, stores etc omitted.

Sunlight specifically is mainly sought in living rooms and external amenity spaces, although the BRE guide recognises that for housing specifically, at least one room of the dwelling should meet the minimum sunlight recommendation. It is therefore considered that any dwellings that have at least one habitable room receiving adequate sunlight to be performing satisfactorily.

In addition, it is worth highlighting the following excerpts from the guidance:

"The guide is intended for building designers and their clients, consultants, and planning officials. The advice given here is not mandatory and the guide should not be seen as an instrument of planning policy; its aim is to help rather than constrain the designer. Although it gives numerical guidelines, these should be interpreted flexibly since natural lighting is only one of many factors in site layout design."

It is therefore important to apply the BRE guidance flexibly, with careful consideration of the specific site context. Its numerical targets theoretically apply to any built environment, from city centres to rural villages. However, in more tightly constrained environments, achieving the default BRE targets can be very challenging and conflict with other beneficial factors of site layout design. With the above in mind, rigid adherence to the BRE in certain situations could result in an inappropriate form of development. The specific criteria and recommendations of the BRE guidance are presented in Appendix C of this report.



Figure 2. Approximate site location of Mead House (source: Google Maps).

3 Technical model

3.1 Sources of information and assumptions

Architectural drawings from Buckmaster Batchup Architects, topographic survey data from Topo M Surveys, and publicly available satellite images were used to create a 3D computer model of the proposed development. The full list of sources of information used in this assessment is as follows:

The full list of sources of information used in this assessment is as follows:

- BBA 951.PA.09 Proposed Block plan
- BBA 951.PA.16 Proposed ground floor plan
- BBA 951.PA.17 Proposed first floor plan
- BBA 951.PA.18 Proposed ne sw elevations
- BBA 951.PA.19 Proposed se nw elevations
- 10600.01 - Topographical Survey.pdf

3.2 Scope of Assessment

The image to the right shows the technical 3D model developed for the analysis. All habitable spaces were modelled using specialist simulation software.

The model includes the following inputs with regards to surface reflectance which can influence the calculations:

- External walls 0.2
- Internal walls 0.8
- Floors 0.4
- Ceiling 0.9

The design team will adopt white finishes for the walls and ceilings as well as adopt light floor finishes to achieve the above reflectance values.

A maintenance factor for dirt of 92% has been applied to all glazing, which is modelled as double-glazed units, with a light transmission of 68%. These parameters were taken from the BRE guidelines.

All studios have open plan kitchen/living/dining (KLD) and bedroom areas, with the kitchens most often located to the rear of the rooms and away from the façade, therefore would be task lit. The kitchens have been included in the working plane but the target of 150 lux for living rooms has been applied in the assessments as it would be more appropriate.

The working plane of each habitable room was set in line with BRE's guidance. Where there is an entrance corridor of less than 1.5m wide to reach the main occupied zone of the room, this was excluded from the assessed working plane.

3.3 Trees

A number of large trees are present to the east of the building which would have an impact on daylight levels to the proposed dwellings with windows on the eastern facade. These trees have been included in the technical model.

Tree heights and spreads are based on the site topographic survey information. All trees were assumed to be deciduous in nature, aside from the hedge along the northern site boundary which was assumed to be evergreen.

As the deciduous tree species are not known, tree crown transparency of 20% under full leaf condition (applicable for English Oak, Sycamore, Horse Chestnut, European Birch and Beech, see Table G1 of the BRE guide) was applied as a conservative approach. A 20% summer reflectance for deciduous trees was applied in line with Table G2 of the BRE Guide.

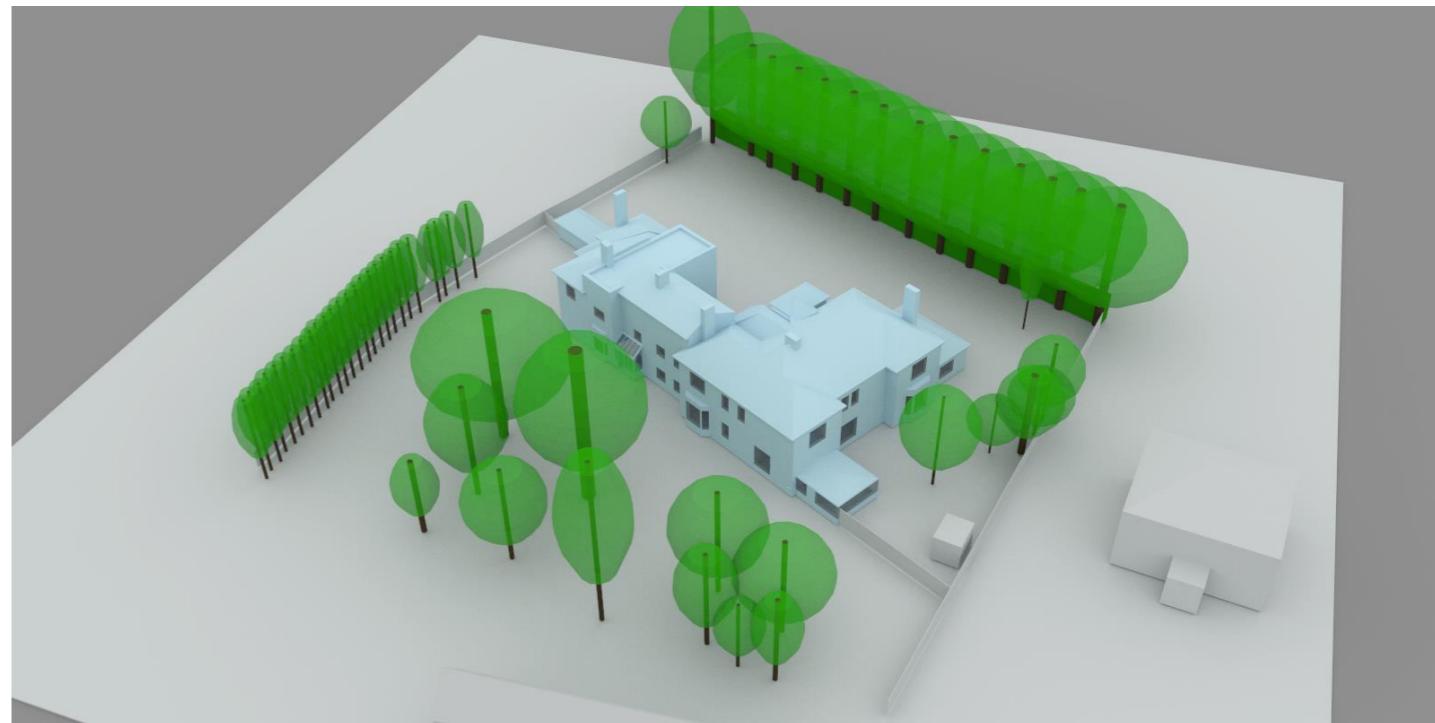


Figure 3: 3D technical model of the proposed development and context. View from southeast

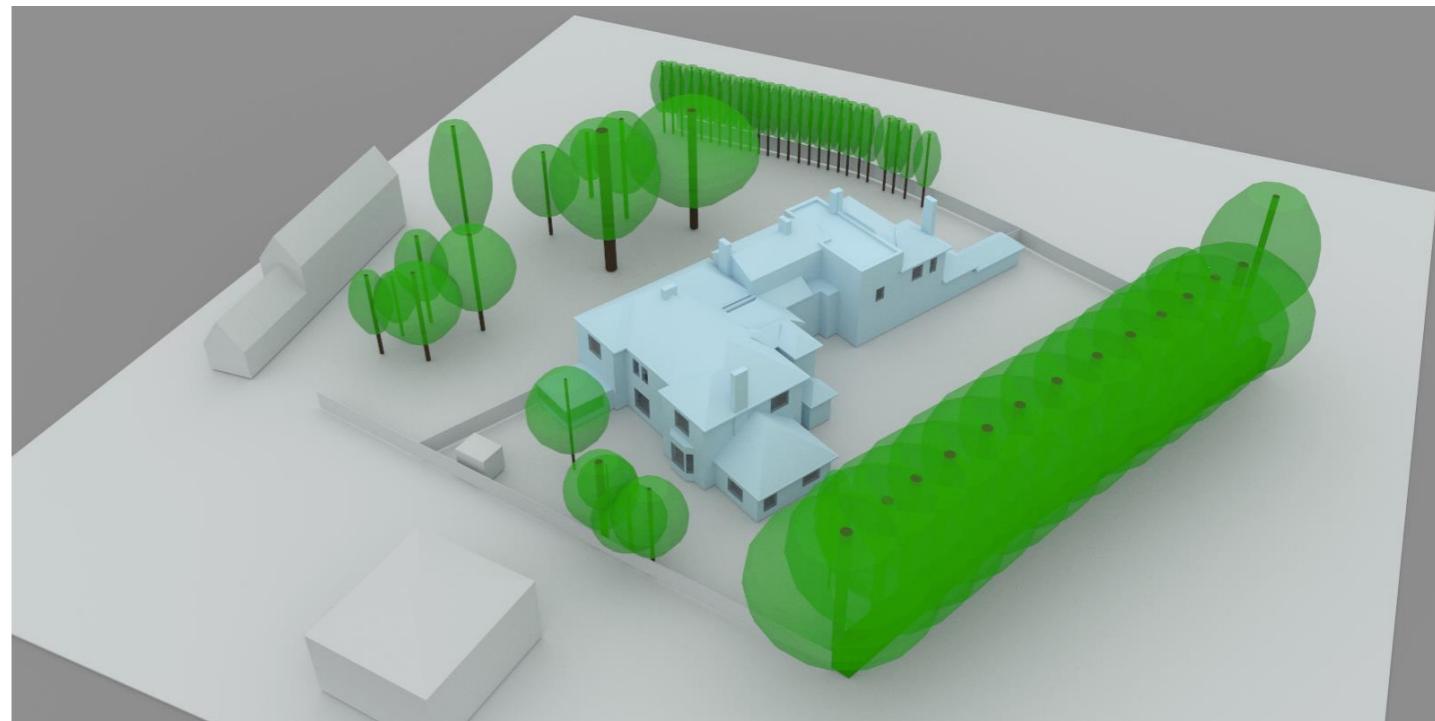


Figure 4: 3D technical model of the proposed development and context. View from northeast.

4 Assessment results

4.1 Daylight

Figure 5 and Figure 6 on the following pages illustrate the results of the climate-based daylight analysis.

All assessed habitable spaces achieve the required daylight illuminance for over 50% of the working plane area, for over 50% of the year. It can therefore be concluded that all habitable rooms within the proposed conversion development will achieve the recommendations of the BRE guide.

The detailed numerical results are presented in Appendix A of this report.

4.2 Sunlight

The assessment results shows that all studios with a window within 90 degrees due south will meet BRE's target for sunlight exposure. It can therefore be concluded that the scheme is compliant with BRE's guide in terms of sunlight access to dwellings.

The detailed results are presented in Appendix A of the report.



Figure 5. Spatial Daylight Autonomy (SDA) results for habitable rooms on ground floor (with window and room references).



Figure 6: Spatial Daylight Autonomy (SDA) results for habitable rooms on first floor (with window and room references).

5 Conclusions

Based on the findings, it can be concluded that the proposed conversion scheme will provide satisfactory levels of daylight and sunlight to future residents and their homes in line with BRE guidance.

Appendix A – Detailed results

Daylight

Floor Ref	Room Ref	Room Use	Room Area m2	Effective Area	Median Lux	Area Meeting Req Lux	% of Area Meeting Req Lux	Req Lux	Req % of Effective Area	Req % of Daylight Hours	Daylight Hours	Meets Criteria
Ground	R1	Living Room	36.53	27.72	1088	27.72	100%	150	50%	50%	4380	Yes
	R2	Living Room	32.29	24.82	479	24.82	100%	150	50%	50%	4380	Yes
	R3	Living Room	32.19	24.83	208	19.98	80%	150	50%	50%	4380	Yes
	R4	Living Room	33.58	25.99	238	25.07	96%	150	50%	50%	4380	Yes
	R5	Living Room	38.24	30.36	385	30.36	100%	150	50%	50%	4380	Yes
	R6	Living Room	34.06	27.19	309	27.19	100%	150	50%	50%	4380	Yes
	R7	Living Room	32.29	24.06	292	21.25	88%	150	50%	50%	4380	Yes
First	R1	Living Room	35.08	24.44	551	20.62	84%	150	50%	50%	4380	Yes
	R2	Living Room	28.95	22.70	223	16.42	72%	150	50%	50%	4380	Yes
	R3	Living Room	36.61	29.08	371	29.08	100%	150	50%	50%	4380	Yes
	R4	Living Room	30.96	23.41	253	20.72	89%	150	50%	50%	4380	Yes
	R5	Living Room	35.55	27.45	214	24.02	88%	150	50%	50%	4380	Yes
	R6	Living Room	27.96	21.06	382	21.06	100%	150	50%	50%	4380	Yes
	R7	Living Room	40.94	31.21	243	27.42	88%	150	50%	50%	4380	Yes

Sunlight

Floor Ref	Room Ref	Room Use	Window Ref	Window Orientation	Proposed Sunlight Exposure (Hours)	Meet Criteria?
Ground	R1	Studio	W1	207°	5.8	
			W2	207°	3.9	
			W3	207°	4.7	
			W25	27°N	1	
			W26	117°	5.3	
Ground	R2	Studio			8.3	Yes
			W4	207°	3	
			W5	163°	4.5	
			W6	207°	3.7	
			W7	252°	1.4	
Ground	R3	Studio			5.5	Yes
			W8	207°	1.6	
			W9	207°	2.5	
			W10	207°	1.1	
					3.4	Yes
Ground	R4	Studio	W11	162°	2.3	
			W12	207°	3.1	
			W13	253°	1.7	
			W14	297°N	0.1	
					3.3	Yes
Ground	R5	Studio	W15	297°N	0	
			W16	297°N	0	
			W17	297°N	0	
			W18	27°N	0	
			W19	27°N	0	
Ground	R6	Studio	W20	117°	2.3	
					2.3	Yes
			W21	73°N	0.1	
			W22	117°	1.7	
			W23	162°	2.8	
Ground	R7	Studio			3.3	Yes
			W24	117°	3.1	
					3.1	Yes
			W1	117°	5.3	
			W2	207°	3.7	
First	R1	Studio	W3	207°	3.3	
					7	Yes
			W4	207°	3.7	
					3.7	Yes
			W13	27°N	0	
First	R3	Studio				

Daylight and Sunlight Assessment (Proposed Scheme)
ecolytik

Floor Ref	Room Ref	Room Use	Window Ref	Window Orientation	Proposed Sunlight Exposure (Hours)	Meet Criteria?
First	R4	Studio	W14	117°	4.8	
			W15	117°	4.8	Yes
First	R5	Studio	W16	117°	3.1	
			W5	207°	2.8	
			W6	207°	3.5	Yes
First	R6	Studio	W7	207°	4.4	
			W8	207°	5.5	
			W9	207°	5.6	Yes
			W10	27°N	6.8	
First	R7	Studio	W11	27°N	7.1	Yes
			W12	27°N	0	
					0	North facing

Appendix B – Planning Policies


National Planning Policy Framework (2023)

This document provides a framework within which locally prepared plans for housing and other development can be produced.

For example, it sets out how the planning system could achieve sustainable development, effective use of land, well-designed places, protecting the green belt, meeting the challenge of climate change, among several other aspects which precipitate with more specificity into local planning policies.

London Plan (March 2021)

The London Plan is part of the statutory development plan for London and sets out a framework for how the city will develop sustainably over the next 20-25 years. Policies which are directly or indirectly linked to daylight/sunlight/amenity are summarised below.

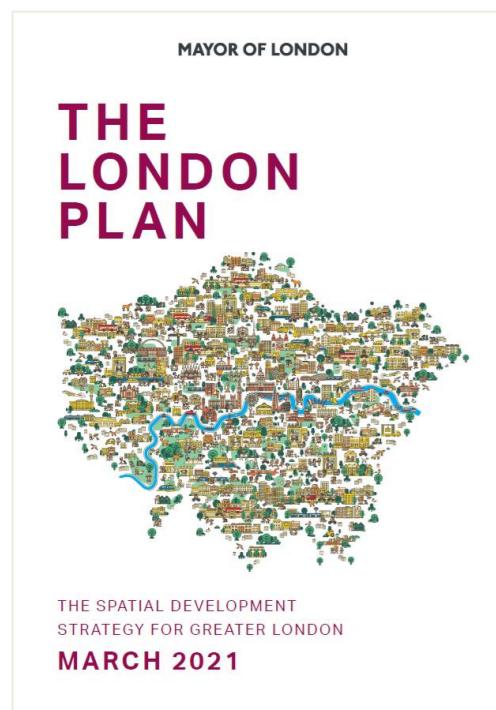

Policy GG2 Making the best use of land

- enable the development of brownfield land, particularly in Opportunity Areas, on surplus public sector land, and sites within and on the edge of town centres, as well as utilising small sites.
- proactively explore the potential to intensify the use of land, promoting higher density development.

Housing SPG (March 2016)

The need to protect the amenity of neighbours is echoed within publications from the Mayor of London and the Secretary of State for Housing, Communities and Local Government. Although, these documents also stress that current guidance needs to be used flexibly where developments are in urban areas and intend to achieve higher densities. Specifically, these documents suggest that the nationally applicable criteria given within the BRE guidance needs to be applied carefully and in consideration of the development's context.

- Policy 7.6Bd requires new development to avoid causing 'unacceptable harm' to the amenity of surrounding land and buildings, particularly in relation to privacy and overshadowing and where tall buildings are proposed. An appropriate degree of flexibility needs to be applied when using BRE guidelines to assess the daylight and sunlight impacts of new development on surrounding properties.

Appendix C – BRE Guidance

Daylight

The illuminance method is one of the approaches that could be adopted to determine whether a development meets daylight recommendations set out within the BRE guide (2022) and BS EN 17037 (2022).

It entails the use of climatic data for the location of the site and the evaluation of the illuminance levels, measured in lux, over the working plane or assessment grid. The following should be achieved for at least 50% of the assessment grid:

- Bedrooms 100 lux
- Living rooms 150 lux
- Kitchens 200 lux

Where a room has a shared use, the higher target should apply although local authorities could use discretion. The target for living room could be used for a kitchen / living / dining area for example to avoid having small separate kitchens in a design. Conversely, a higher illuminance target may be set for a room in homes for the elderly.

Sunlight to windows

The BRE guide stipulates that in general, a dwelling or non-residential building that has a particular requirement for sunlight, will appear reasonably sunlit provided that:


- At least one window wall faces 90 degrees south.
- A habitable room, preferably a living room, can receive a total of 1.5 hours of sunlight on 21st of March. This analysis is carried out at the centre of the window(s) and sunlight received by different windows can be added provided they occur at different times and sunlight hours are not double counted.

Where groups of dwellings are planned, the design should aim to maximise the number of dwellings

that have a main living room window that meets the above recommendations.

Sunlight to open spaces

For an open space to be adequately sunlit, the BRE guide recommends that at least half of the amenity area receives at least 2 hours of sunlight during the 21st of March.

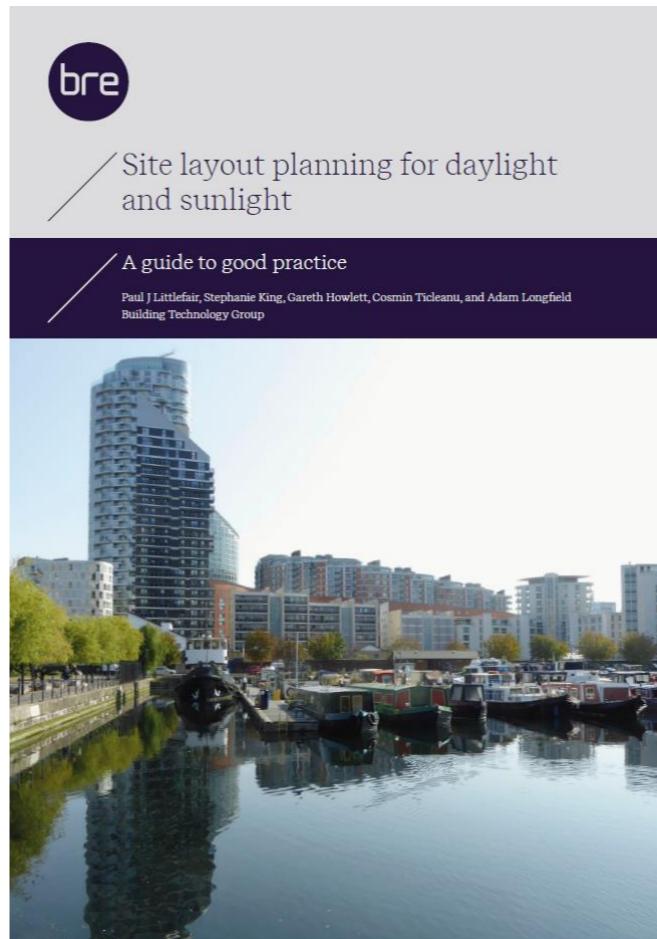

BS EN 17037:2018



BSI Standards Publication

Daylight in buildings

bsi.

ecolytik

86-90 Paul Street
London
EC2A 4NE

+44 (0) 0203 835 4114
mail@ecolytik.com
ecolytik.com