



Notes:

- 100mm deep concrete plinth cast over the ATS & holding tank to prevent uplift.
- Excavated material from ATS & holding tank pits to be re-used in upfill to ramp. Type 1 Hardcore used to supplement infill to ramps, & compacted in 150mm layers.
- Ramps constructed using 150mm thick concrete 21N/mm² c/w A393 fabric reinforcement. Allow for expansion movement joints.
- External pch 1000mm wide constructed using well compacted hardcore & 6mm whin dust. Allow for finishing in battered edges.

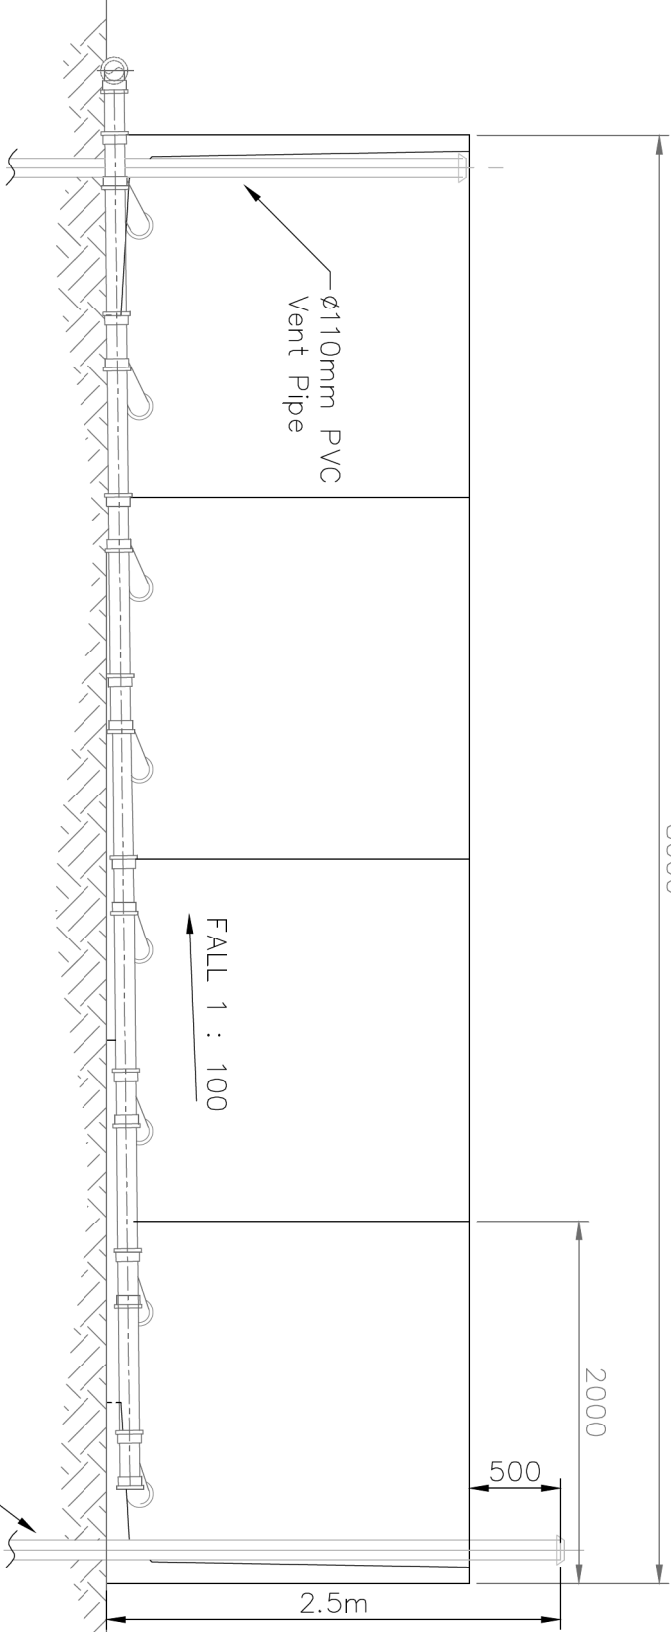

Section On X-X

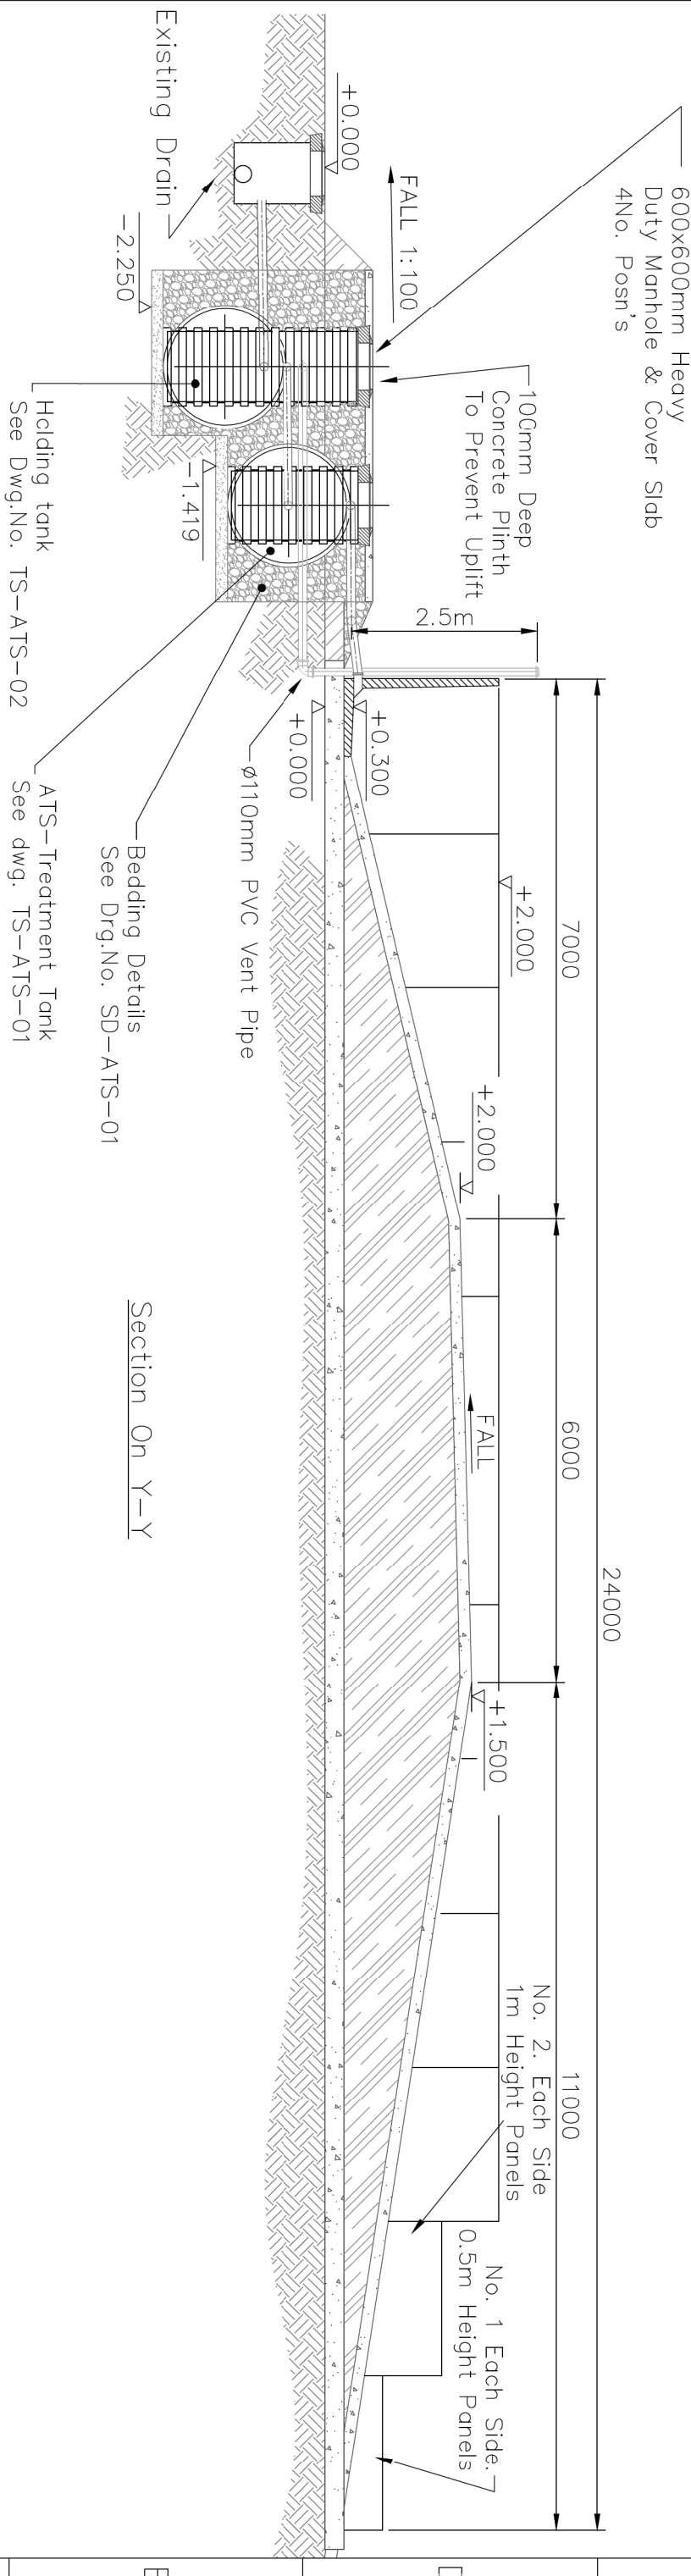

Section On Y-Y

		APSU ENVIRONMENTAL LTD. 4 MELVILLE CRESCENT, EDINBURGH, EH3 7JA TEL: +44(0) 131 510 0515 www.apsu-environmental.com		APSU ENVIRONMENTAL LTD OWN THE COPYRIGHT OF THIS DOCUMENT WHICH IS SUPPLIED IN CONFIDENCE AND WHICH MUST NOT BE USED FOR ANY PURPOSE OTHER THAN THAT FOR WHICH IT IS SUPPLIED. IT IS NOT TO BE REPRODUCED WITHOUT PERMISSION IN WRITING FROM THE COMPANY.		DRAWN CHECKED APPROVED FILENAME SCALE DATE		D.C. TS-GA-02.DWG See dimensions 01/11/10		TITLE Proposed Gully Waste Plant Sections DRAWING No TS-GA-02 REV	
1	2										