

JOHN DAVIES ASSOCIATES
Consulting Engineers

**212 SWAKELEY ROAD
UXBRIDGE
UB10 8AY**

**Flood Risk Assessment &
Drainage Strategy
(Rev C)**

14th JANUARY 2025

Issue Sheet.

Prepared	Date		Checked	Date
MJM	12-10-23		MJM	12-10-23

Revisions	Comment	Date
A	Initial Issue	12-10-23
B	Layout Updated	04-07-24
C	Layout Updated	14-01-25

The report is based on the information that has been acquired and / or made available to John Davies Associates Limited via the various searches and consultations undertaken as part of the Flood Risk Assessment. In some cases, anecdotal information has been relied upon, where documented evidence has been lacking.

The conclusions drawn in the following report are considered correct although any subsequent additional information may allow refinement of the conclusions.

All work carried out in preparing this report has utilised and is based upon John Davies Associates current professional knowledge and understanding of current UK standards and codes, technology and legislation. Changes in this legislation and guidance may occur at any time in the future and cause any conclusions to become inappropriate or incorrect.

This report has been prepared using information contained in maps and documents prepared by others. John Davies Associates can accept no responsibility for the accuracy of such information.

EXECUTIVE SUMMARY

Site Description

Site Area	3188m ² (0.32ha)
Existing Use	Existing dwelling and outbuildings
Proposed Use	Single Dwelling

Flood Risk

Flood Zone	1 (one)
Surface Water	Very Low
Reservoirs	None
Sewers	None known.
Ground Water	Low Risk

Drainage Strategy

Existing Impermeable Area	0.145ha
Proposed Impermeable Area	0.05ha
Proposed Discharge Rate	1.4 l/s
Proposed Outfall	Public Sewer
1 in 100 Year + CC Storage	41m ³ in sub-base of permeable paving

Table of Contents

Table of Contents.....	4
1 Introduction	5
2 Site Description	5
3 Site Levels	5
4 Site Location.....	6
5 Aerial Photograph.....	7
6 Existing Flood Risk.	8
7 Existing Geology / Hydrogeology	8
8 Environment Agency Consultation	8
9 Sewerage Undertaker Consultation.	8
10 Flood Risk Assessment.....	9
11 Sequential Test.....	10
12 Exception Test	11
13 Sources of Potential Flooding.....	12
14 Flood Mitigation	14
15 Drainage Strategy.....	15
16 SUDS Operations and Maintenance Plan	19
17 Flood Exceedance Event.....	23
18 Conclusion	24
Appendix A Site Layout Plan	25
Appendix B BGS Website Data.....	26
Appendix C EA Data	28
Appendix D Greenfield Runoff Calc	29
Appendix E Drainage Layout Plan	30
Appendix F Drainage Calc.....	31
Appendix G Hillingdon SUDS Proforma	32
Appendix H Flood Exceedance Plan	33

1 Introduction

- 1.1 John Davies Associates has been commissioned by J79 Studio Architects Limited, to undertake a Flood Risk Assessment (FRA) and Drainage Strategy in connection with the proposed development 212 Swakeley Road. The proposal is for the demolition of the existing dwelling and outbuildings and then the construction of a new 2 storey building with car parking to the front. (See Appendix A for layout).
- 1.2 This FRA has been produced to demonstrate how risk from all sources of flooding to the site itself and risk to others will be managed, in order to satisfy the requirements, set out in the NPPF – National Planning Policy Framework.


2 Site Description

- 2.1 The site is located off Swakeley Road and the over site area is 3188m² (0.32ha) and can be found at co-ordinates 506618E, 186185N and the nearest postcode is UB10 8AY.
- 2.2 The site is located within a predominantly residential area, to the north and east of the site are open fields, to the south of the site is Swakeley Road, beyond which is more housing and to the west of the site is 214 Swakeley Road.

3 Site Levels

- 3.1 At the time of writing this report no topographical survey was available, however from mapping we can see the land falls towards the north.

4 Site Location

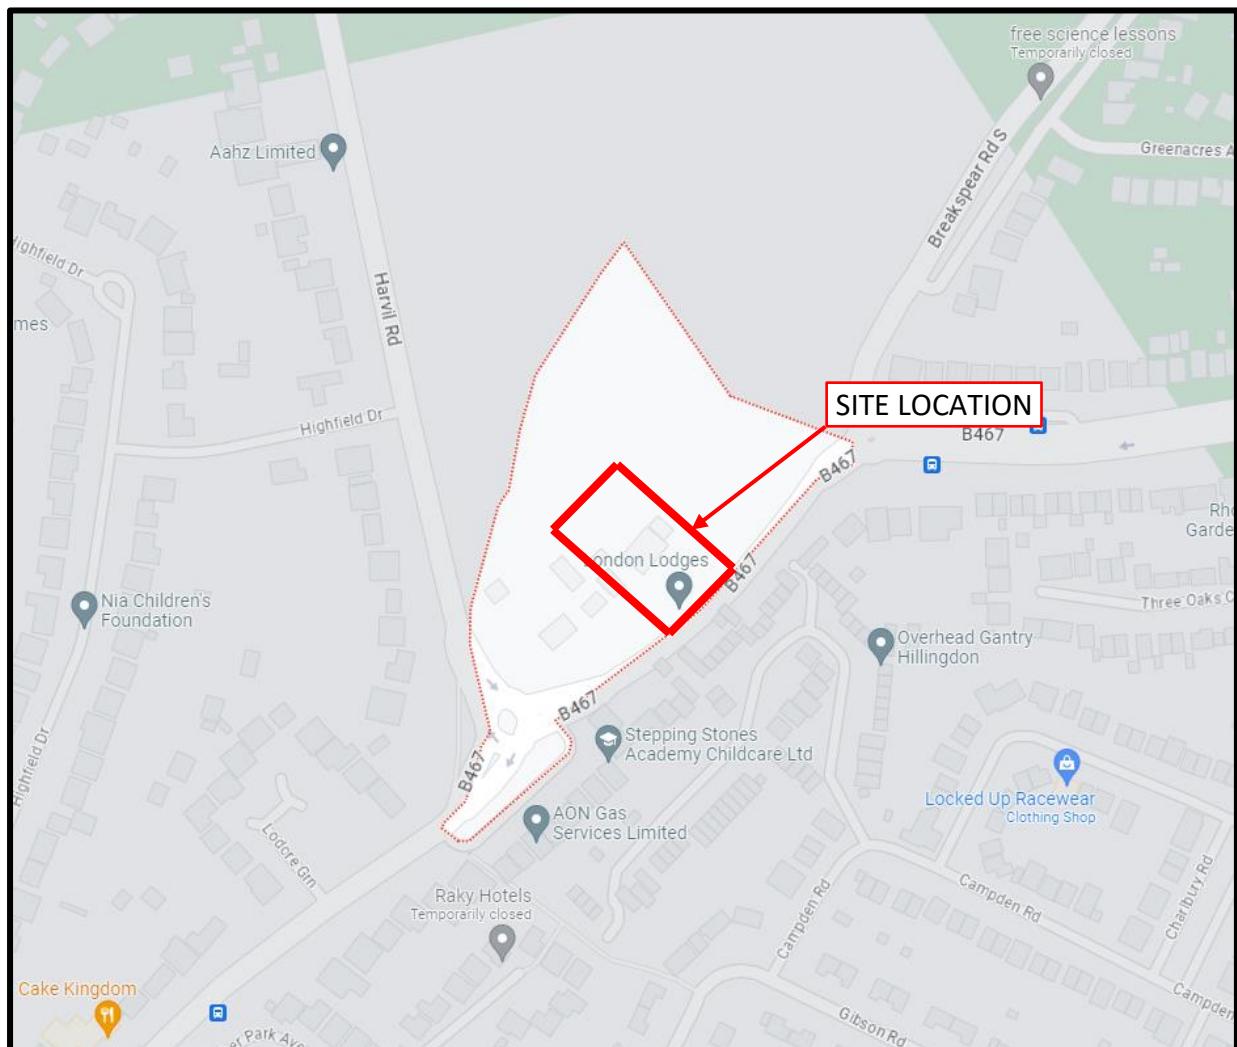

5 Aerial Photograph



6 Existing Flood Risk.

6.1 National Planning Policy Framework (NPPF) Paragraphs 155-165 refers to the risk based Sequential Test aiming to steer new development to areas at the lowest probability of flooding (Zone 1).

6.2 Paragraph's 158 & 159 of the NPPF states that

"158. The aim of the sequential test is to steer new development to areas with the lowest risk of flooding. Development should not be allocated or permitted if there are reasonably available sites appropriate for the proposed development in areas with a lower risk of flooding. The strategic flood risk assessment will provide the basis for applying this test. The sequential approach should be used in areas known to be at risk now or in the future from any form of flooding."

"159. If it is not possible for development to be located in zones with a lower risk of flooding (taking into account wider sustainable development objectives), the exception test may have to be applied. The need for the exception test will depend on the potential vulnerability of the site and of the development proposed, in line with the Flood Risk Vulnerability Classification set out in national planning guidance."

7 Existing Geology / Hydrogeology

7.1 At the point of writing this report no Ground Investigatory works had been undertaken, we have therefore consulted with the BGS website and as expected in this area the site is underlain with London Clays. (See Appendix B for BGS data.)

8 Environment Agency Consultation

8.1 Consultation has been had with the Environment Agency (EA) and they have confirmed that the site is located in Flood Zone 1 and they have no records of any historic flooding in this area. (See Appendix C for EA Correspondence).

9 Sewerage Undertaker Consultation.


9.1 Thames Water is the sewerage undertaker in this location, no correspondence had been received at the time of writing.

10 Flood Risk Assessment

10.1 The National Planning Policy Framework (NPPF) aims to avoid inappropriate development in areas at risk of flooding, directing development away from high-risk areas and avoiding increasing or reducing the risk of flooding elsewhere.

10.2 The flood risk assessment will use a sequential approach to assess the site to avoid development in flood risk areas and to manage the residual risks and take into account the effect of climate change. The 'Sequential Test' will start with consideration of the Flood Zones in the vicinity of the site. Where development is proposed within a flood zone an 'Exception Test' may also be necessary in accordance with the National Planning Policy Framework guidance.

10.3 As per the (EA) flood map below, the existing site is in **Flood Zone 1**.

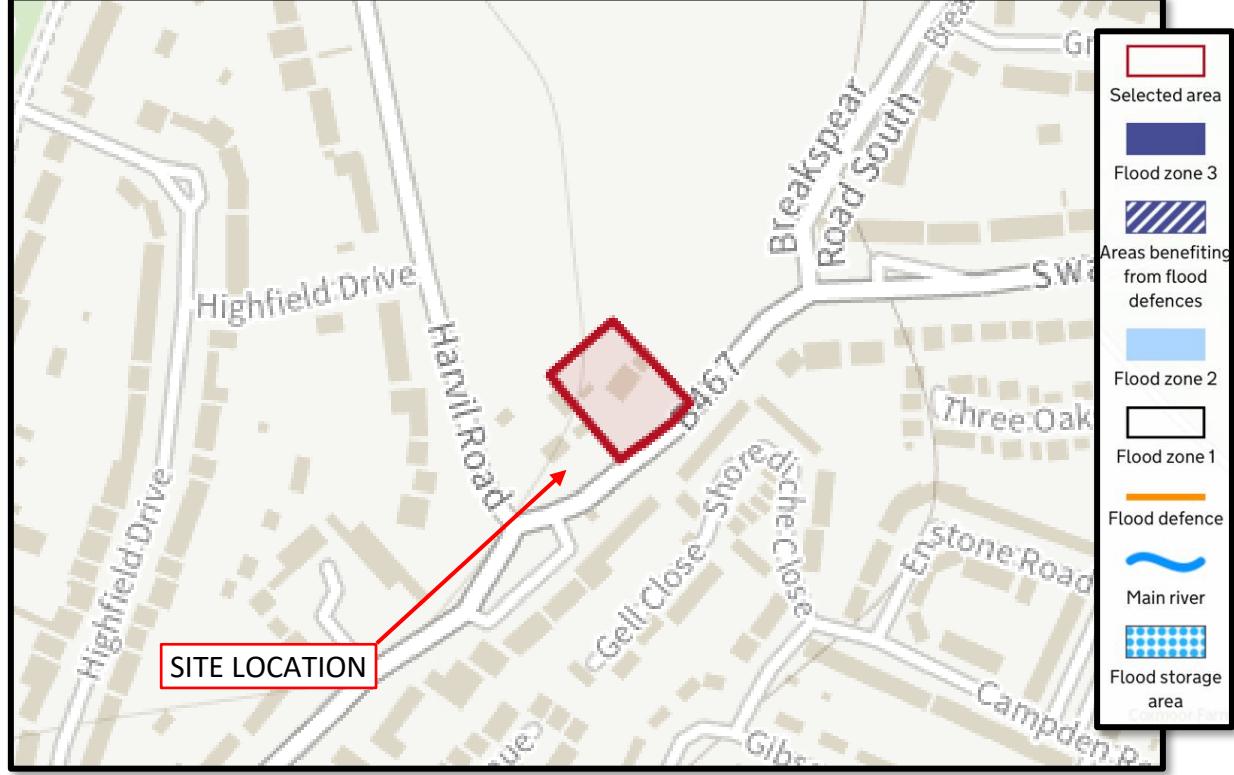

10.4 These flood zones refer to the probability of river and sea flooding, ignoring the presence of defences. They are shown on the Environment Agency's Flood map for planning (River and Seas) available on the Environment Agency's website.

11 Sequential Test

11.1 This risk-based test has the aim of steering new development to area at the lowest probability of flooding, it is broken down into 3 tables, the first of which identifies the risk based on Flood zone as per below, of which this site is within **FLOOD ZONE 1**.

Flood Zone	Definition
Zone 1 Low Probability	Land having a less than 1 in 1,000 annual probability of river or sea flooding. (Shown as 'clear' on the Flood Map – all land outside Zones 2 and 3)
Zone 2 Medium Probability	Land having between a 1 in 100 and 1 in 1,000 annual probability of river flooding; or land having between a 1 in 200 and 1 in 1,000 annual probability of sea flooding. (Land shown in light blue on the Flood Map)
Zone 3a High Probability	Land having a 1 in 100 or greater annual probability of river flooding; or Land having a 1 in 200 or greater annual probability of sea flooding. (Land shown in dark blue on the Flood Map)
Zone 3b	This zone comprises land where water has to flow or be stored in times of flood. Local The planning authorities should identify in their Strategic Flood Risk Assessments areas of Functional floodplain and its boundaries accordingly, in agreement with the Environment Floodplain Agency. (Not separately distinguished from Zone 3a on the Flood Map)

11.2 The second table then identifies the vulnerability class of the site dependant on the sites proposed used, and within this table this site falls into the **MORE VULNERABLE** classification as shown below:

More vulnerable
<ul style="list-style-type: none"> • Hospitals • Residential institutions such as residential care homes, children's homes, social services homes, prisons and hostels. • Buildings used for dwelling houses, student halls of residence, drinking establishments, nightclubs and hotels. • Non-residential uses for health services, nurseries and educational establishments. • Landfill* and sites used for waste management facilities for hazardous waste. • Sites used for holiday or short-let caravans and camping, subject to a specific warning and evacuation plan.

11.3 Finally, Table 3 determines the need for the Exception test based upon the results from tables 1 and 2 previously identified, in this instance the development is **appropriate** and therefore the exception test is required.

Flood Zones	Flood Risk Vulnerability Classification				
	Essential infrastructure	Highly vulnerable	More vulnerable	Less vulnerable	Water compatible
Zone 1	✓	✓	✓	✓	✓
Zone 2	✓	Exception Test required	✓	✓	✓
Zone 3a †	Exception Test required †	✗	Exception Test required	✓	✓
Zone 3b *	Exception Test required *	✗	✗	✗	✓*

Key:

- ✓ Development is appropriate
- ✗ Development should not be permitted.


12 Exception Test

12.1 The site has passed the Sequential test and therefore the exception test is not required.


13 Sources of Potential Flooding

SOURCE OF FLOODING	POTENTIAL RISK				DESCRIPTION
	HIGH	MEDIUM	LOW	NONE	
Fluvial			X		See paragraph 13.1
Pluvial			X		See paragraph 13.2
Reservoirs				X	See paragraph 13.3
Sewers				X	No known sewer flooding
Groundwater			X		Low ground water expected
Proposed Development			X		See paragraph 13.4


13.1 The (EA) flood mapping service on their website identifies that part of the site has a **Very Low** risk of fluvial flooding as identified on the map below.

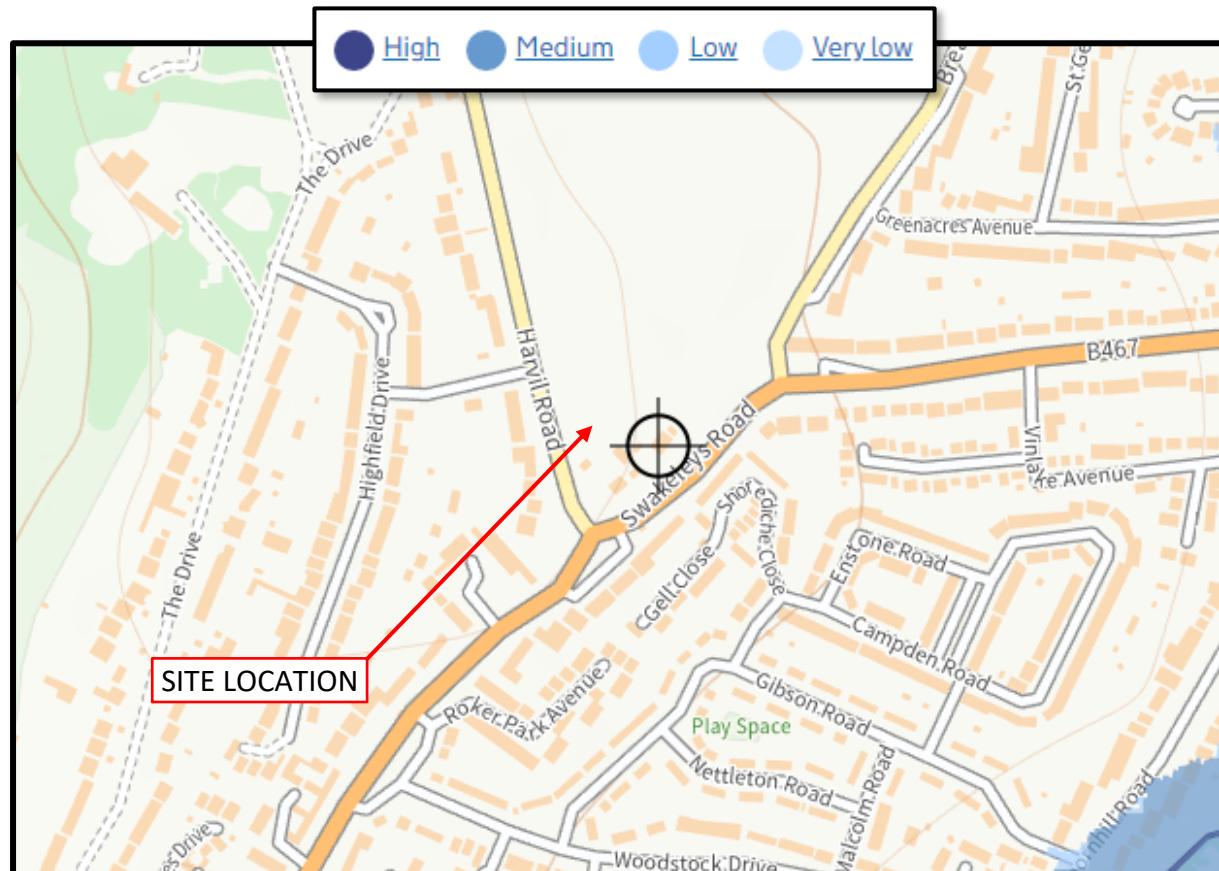

13.2 The (EA) flood mapping service on their website identifies the areas at risk from surface water flooding, it can be seen from the below map that a small part of the site to the rear is at a **Very Low** risk of surface water flooding which is generated by rainfall.

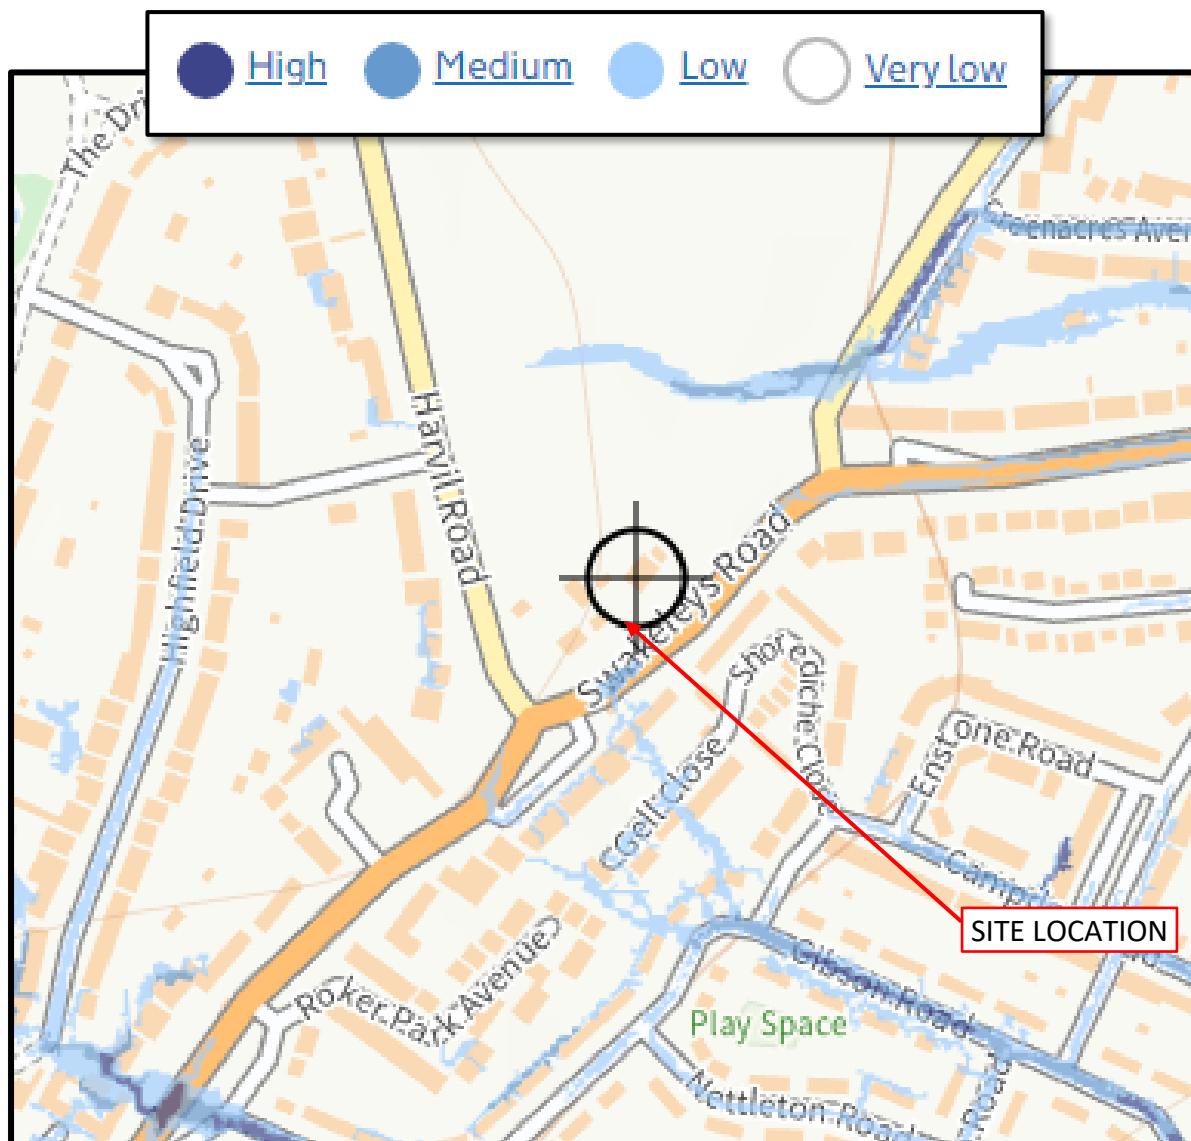

13.3 The (EA) flood mapping service on their website identifies the areas at risk from reservoirs flooding through failure to the reservoir or over topping but only in conjunction with river flooding, as per the map below then the site is **not** at risk of flooding should the reservoir fail.

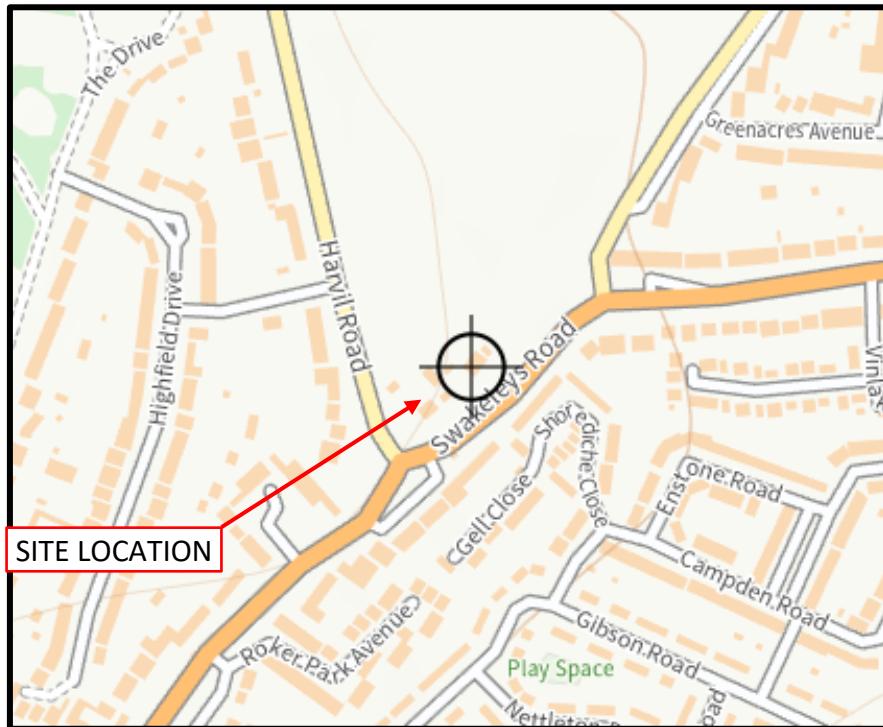

13.4 The proposed development needs to be considered when looking at the risks of flooding both on site and the surrounding areas and downstream of the proposed outfall to ensure that the development does not create flooding elsewhere. Therefore, any risk of increase of flooding would be mitigated though a SUDS surface water drainage scheme.


14 Flood Mitigation

14.1 The site is not at risk of flooding and therefore there are no mitigation measures being proposed.

15 Drainage Strategy

Surface Water

15.1 In accordance with the SUDS hierarchy when considering surface water drainage then consideration to each of the below discharge options should be considered in sequence:

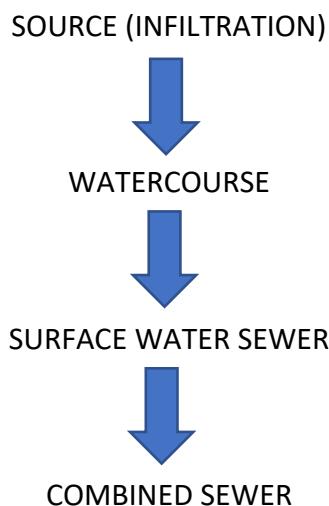

15.2 In accordance with the BGS website and the expected ground conditions then we are expecting soakaways not to be viable, we are therefore discounting the use of soakaways.

15.3 Next in the SUDS hierarchy would be to discharge to a water course, as the nearest watercourse appears to be 0.5 miles to the south of the site then discharge to a watercourse has been discounted.

15.4 Therefore it is proposed to discharge the surface water to the public sewer located in Swakeley Road via the existing connections on site that served the previous property.

15.5 The site currently has a large dwelling on there as well as various outbuilding meaning the site is Brownfield and as such would discharge as follows:

$$2.78 \times 0.145 \times 50 = 20 \text{ l/s}$$

15.6 However wherever possible the sites should be returned back to the equivalent greenfield runoff rates, which for this site are as follows: (see appendix D for greenfield calc):

$$\begin{aligned} Q_{\bar{B}} &= 1.4 \text{ l/s} \\ 1 \text{ in 1Year} &= 1.19 \text{ l/s} \\ 1 \text{ in 30 Year} &= 3.22 \text{ l/s} \\ 1 \text{ in 100 Year} &= 4.47 \text{ l/s} \end{aligned}$$

15.7 Normally small orifices would be at risk of blockages, but if they are run through a SUDS feature such as permeable paving then this is greatly reduced, therefore it is proposed to restrict the flow to the equivalent $Q_{\bar{B}}$ rate of **1.4l/s**.

15.8 The site is therefore proposed to discharge to the public sewer at a rate of 1.4 l/s with attenuation provided on site in the sub-base of the permeable paving, sized to accommodate the 1 in 100 year + 40% climate change rainfall event. (See Appendix E for the drainage layout and Appendix F for drainage calcs).


15.9 In addition to the above Hillingdon council produce a Sustainable Drainage proforma that needs to be completed and accompany any SUDS drainage scheme, a copy of this can be found in Appendix G.

Foul Sewer

15.7 It is proposed that the foul drainage will discharge to the public sewer via existing connections on site.

SUDS

15.8 All new surface water should be designed in accordance with 'The SUDS Manual' which identifies 4 pillars of a sustainable drainage solution, these four elements are shown as:

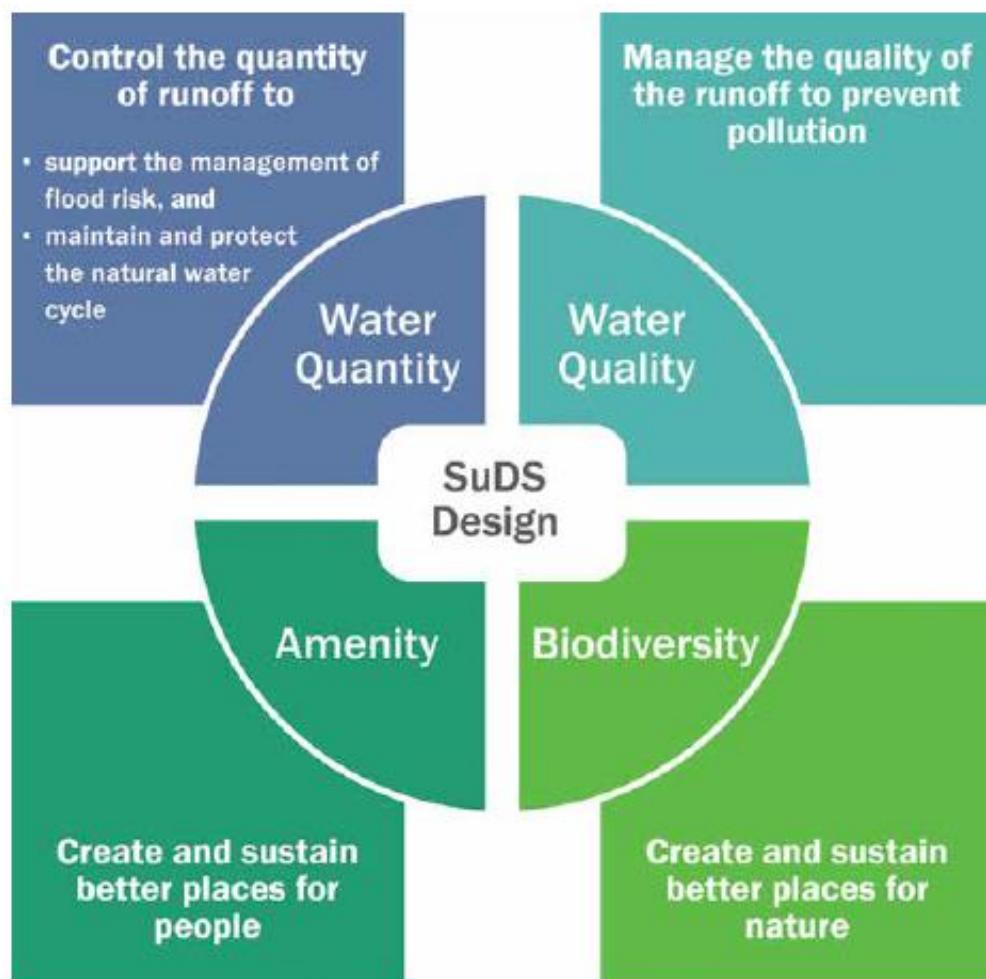

15.9 **WATER QUANTITY:** The surface water from the site is being restricted to the equivalent greenfield runoff rates of 1.4 l/s which attenuation on site in the sub-base of the permeable paving, which is an 83% reduction on the existing runoff from site.

15.10 **WATER QUALITY:** All the new roof and hard paved areas are being discharged via permeable paving which offers 2 levels of treatment, also to the rear of the property is a proposed green roof.

15.11 **AMENITY AND BIODIVERSITY:** New Garden areas are being provided to the new dwelling with new trees and landscaping.

15.12 In producing the SUDS drainage strategy we have considered each of the following elements as outlined below:

COMPONENT	SUITABILITY	REASON
Green Roof	✓	Green Roof is proposed to the rear of the property
Infiltration Systems	X	Ground conditions make infiltration unsuitable
Proprietary Treatment Systems	✓	A flow control device is being used
Filter Strips	X	Ground conditions make infiltration unsuitable
Filter Drains	X	Ground conditions make infiltration unsuitable
Swales	X	Ground conditions make infiltration unsuitable
Bioretention Systems	X	Insufficient land available.
Trees	X	Insufficient land available.
Rain Garden	✓	Rain gardens in planting areas.
Pervious Pavements	✓	Driveway is permeable paving with sub-base sized for attenuation.
Attenuation Storage Tanks	X	Attenuation is provided in Permeable paving which is a preferred solution
Detention Basins	X	Insufficient land available.
Ponds and Wetlands	X	Insufficient land available.

16 SUDS Operations and Maintenance Plan

16.1 The proposed drainage strategy consists of several SUDS elements which can have different responsibilities on the operation and maintenance and each one will require routine checks and repairs, these different SUDS elements and their required maintenance are as outlined in the table below.

ELEMENT	RESPONSIBILITY		
	PUBLIC	PRIVATE	MAINTENANCE COMPANY
PERMEABLE PAVING		✓	
FLOW CONTROL		✓	
GREEN ROOF		✓	
RAIN GARDEN		✓	

16.2 PERMEABLE PAVING MAINTENANCE

Operation and maintenance requirements for pervious pavements		
Maintenance schedule	Required action	Typical frequency
Regular maintenance	Brushing and vacuuming (standard cosmetic sweep over whole surface)	Once a year, after autumn leaf fall, or reduced frequency as required, based on site-specific observations of clogging or manufacturer's recommendations – pay particular attention to areas where water runs onto pervious surface from adjacent impermeable areas as this area is most likely to collect the most sediment
Occasional maintenance	Stabilise and mow contributing and adjacent areas	As required
	Removal of weeds or management using glyphosate applied directly into the weeds by an applicator rather than spraying	As required – once per year on less frequently used pavements
Remedial Actions	Remediate any landscaping which, through vegetation maintenance or soil slip, has been raised to within 50 mm of the level of the paving	As required
	Remedial work to any depressions, rutting and cracked or broken blocks considered detrimental to the structural performance or a hazard to users, and replace lost jointing material	As required
	Rehabilitation of surface and upper substructure by remedial sweeping	Every 10 to 15 years or as required (if infiltration performance is reduced due to significant clogging)
Monitoring	Initial inspection	Monthly for three months after installation
	Inspect for evidence of poor operation and/or weed growth – if required, take remedial action	Three-monthly, 48 h after large storms in first six months
	Inspect silt accumulation rates and establish appropriate brushing frequencies	Annually
	Monitor inspection chambers	Annually

16.3 FLOW CONTROL DEVICE MAINTENANCE

Maintenance schedule	Required action	Typical frequency
Routine maintenance	Remove litter and debris and inspect for sediment, oil and grease accumulation	Six monthly
	Change the filter media	As recommended by manufacturer
	Remove sediment, oil, grease and floatables	As necessary – indicated by system inspections or immediately following significant spill
Remedial actions	Replace malfunctioning parts or structures	As required
Monitoring	Inspect for evidence of poor operation	Six monthly
	Inspect filter media and establish appropriate replacement frequencies	Six monthly
	Inspect sediment accumulation rates and establish appropriate removal frequencies	Monthly during first half year of operation, then every six months

16.4 GREEN ROOF MAINTENANCE

Operation and maintenance requirements for green roofs		
Maintenance schedule	Required action	Typical frequency
Regular inspections	Inspect all components including soil substrate, vegetation, drains, irrigation systems (if applicable), membranes and roof structure for proper operation, integrity of waterproofing and structural stability	Annually and after severe storms
	Inspect soil substrate for evidence of erosion channels and identify any sediment sources	Annually and after severe storms
	Inspect drain inlets to ensure unrestricted runoff from the drainage layer to the conveyance or roof drain system	Annually and after severe storms
	Inspect underside of roof for evidence of leakage	Annually and after severe storms
Regular maintenance	Remove debris and litter to prevent clogging of inlet drains and interference with plant growth	Six monthly and annually or as required
	During establishment (ie year one), replace dead plants as required	Monthly (but usually responsibility of manufacturer)
	Post establishment, replace dead plants as required (where > 5% of coverage)	Annually (in autumn)
	Remove fallen leaves and debris from deciduous plant foliage	Six monthly or as required
	Remove nuisance and invasive vegetation, including weeds	Six monthly or as required
	Mow grasses, prune shrubs and manage other planting (if appropriate) as required – clippings should be removed and not allowed to accumulate	Six monthly or as required
Remedial actions	If erosion channels are evident, these should be stabilised with extra soil substrate similar to the original material, and sources of erosion damage should be identified and controlled	As required
	If drain inlet has settled, cracked or moved, investigate and repair as appropriate	As required

16.5 RAIN GARDEN MAINTENANCE

Operation and maintenance requirements for bioretention systems		
Maintenance schedule	Required action	Typical frequency
Regular inspections	Inspect infiltration surfaces for silting and ponding, record de-watering time of the facility and assess standing water levels in underdrain (if appropriate) to determine if maintenance is necessary	Quarterly
	Check operation of underdrains by inspection of flows after rain	Annually
	Assess plants for disease infection, poor growth, invasive species etc and replace as necessary	Quarterly
	Inspect inlets and outlets for blockage	Quarterly
Regular maintenance	Remove litter and surface debris and weeds	Quarterly (or more frequently for tidiness or aesthetic reasons)
	Replace any plants, to maintain planting density	As required
	Remove sediment, litter and debris build-up from around inlets or from forebays	Quarterly to biannually
Occasional maintenance	Infill any holes or scour in the filter medium, improve erosion protection if required	As required
	Repair minor accumulations of silt by raking away surface mulch, scarifying surface of medium and replacing mulch	As required
Remedial actions	Remove and replace filter medium and vegetation above	As required but likely to be > 20 years


17 Flood Exceedance Event

17.1 Although the drainage has been designed to accommodate the 1 in 100 year + 40%cc rainfall event consideration has to be given to the exceedance event to the drainage, this is the event where the surface water system is pushed to such a point that it is forced to flood so that the resultant flow paths can be identified on a plan. (See Appendix H for plan).

18 Conclusion

- 18.1 John Davies Associates has been commissioned by J79 Studio Architects Limited, to undertake a Flood Risk Assessment (FRA) and Drainage Strategy in relation to the proposed scheme at 212 Swakeley Road, Uxbridge. The proposal consists of the demolition of the existing dwelling and associated outbuilding and then the erection of a single dwelling.
- 18.2 The proposed development site falls into Flood Zone 1 and has a low risk of flooding from rivers and watercourses.
- 18.3 The proposed development is at a very low risk of flooding from Surface water.
- 18.4 The proposed development is not at risk from groundwater or reservoirs.
- 18.5 The sequential test was undertaken, and it was deemed that the exception test was not required for the site.
- 18.6 The surface water drainage is proposed to connect into the public sewers via existing connections on site at a controlled rate of 1.4 l/s, all the surface water will drain through the permeable paving to treat the water with attenuation provided in the subbase of the permeable paving.
- 18.7 The foul drainage is proposed to connect into the public sewer via existing connections located on site.
- 18.8 This Flood Risk Assessment has confirmed that subject to the findings in the report being employed then the proposal for the site is deemed acceptable in the terms as set out in NPPF.

Appendix A
Site Layout Plan

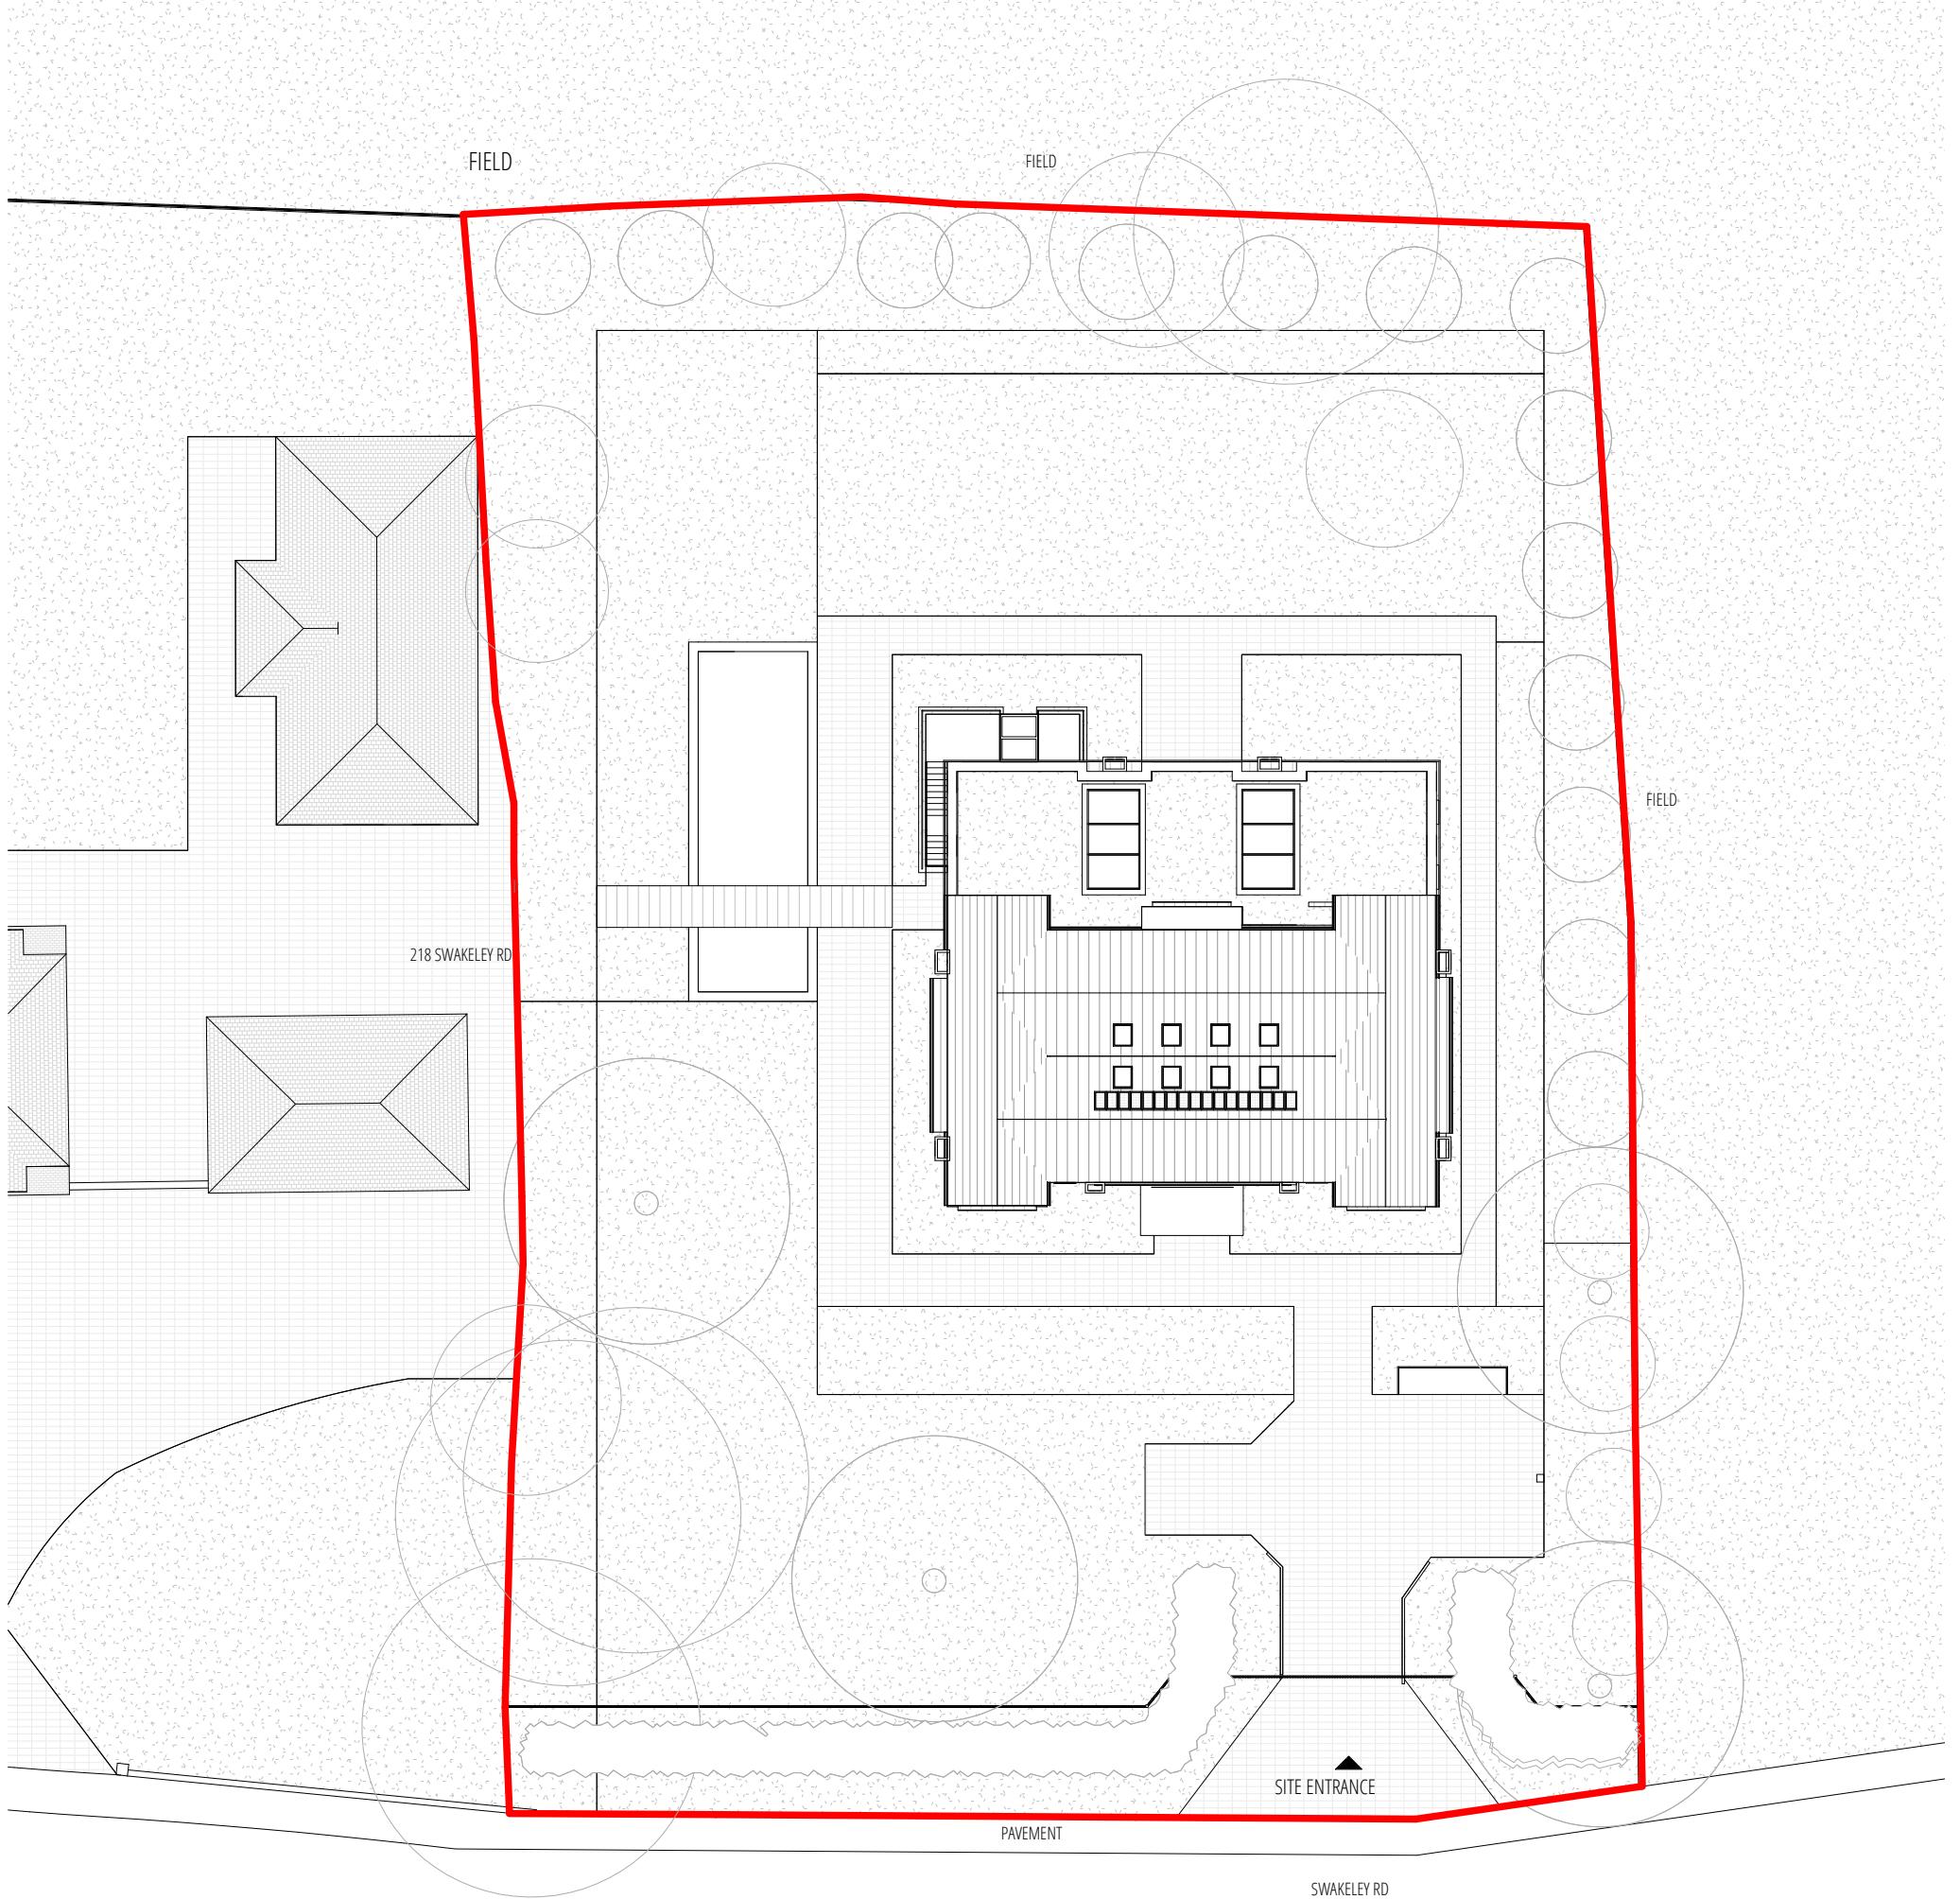

01 PROPOSED SITE PLAN
1:300 @ A3



DRAWN BY ARCHITECT		ACCEPT / A REJECT / R	Rev	Date	Note
CHECK BY CLIENT SIGN / DATE		P1	06-12-24	PLANNING ISSUE	
CHECK BY CONTRACTOR SIGN / DATE					
CHECK BY APPROVED INSPECTOR SIGN / DATE					
ALL DIMENSIONS TO BE CHECKED ON SITE BY CONTRACTOR AND FABRICATOR OBTAINED BUILDING CONTROL + PLANNING APPROVAL PRIOR SITE WORK COMMENCE					
PROJECT 212 Swakeleys Road, Ickenham UB10 8AY					
DRAWING TITLE PROPOSED BLOCK PLAN					

PLANNING 01

J79 STUDIO

This drawing is the property of Architect. Copyright is reserved & this drawing is issued on the condition that it is not copied, reproduced, retained or disclosed to any unauthorised person, either wholly or in part, without our consent. Do not scale from this drawing, check all dimensions on site. Any errors please notify architect in the first instance.

SCALE
1:200 @ A3


DATE
DEC 2024

PROJECT NO.
1942

REVISION
P1

DRAWING NO.
A200

0 1:200 @ A3 5 10M

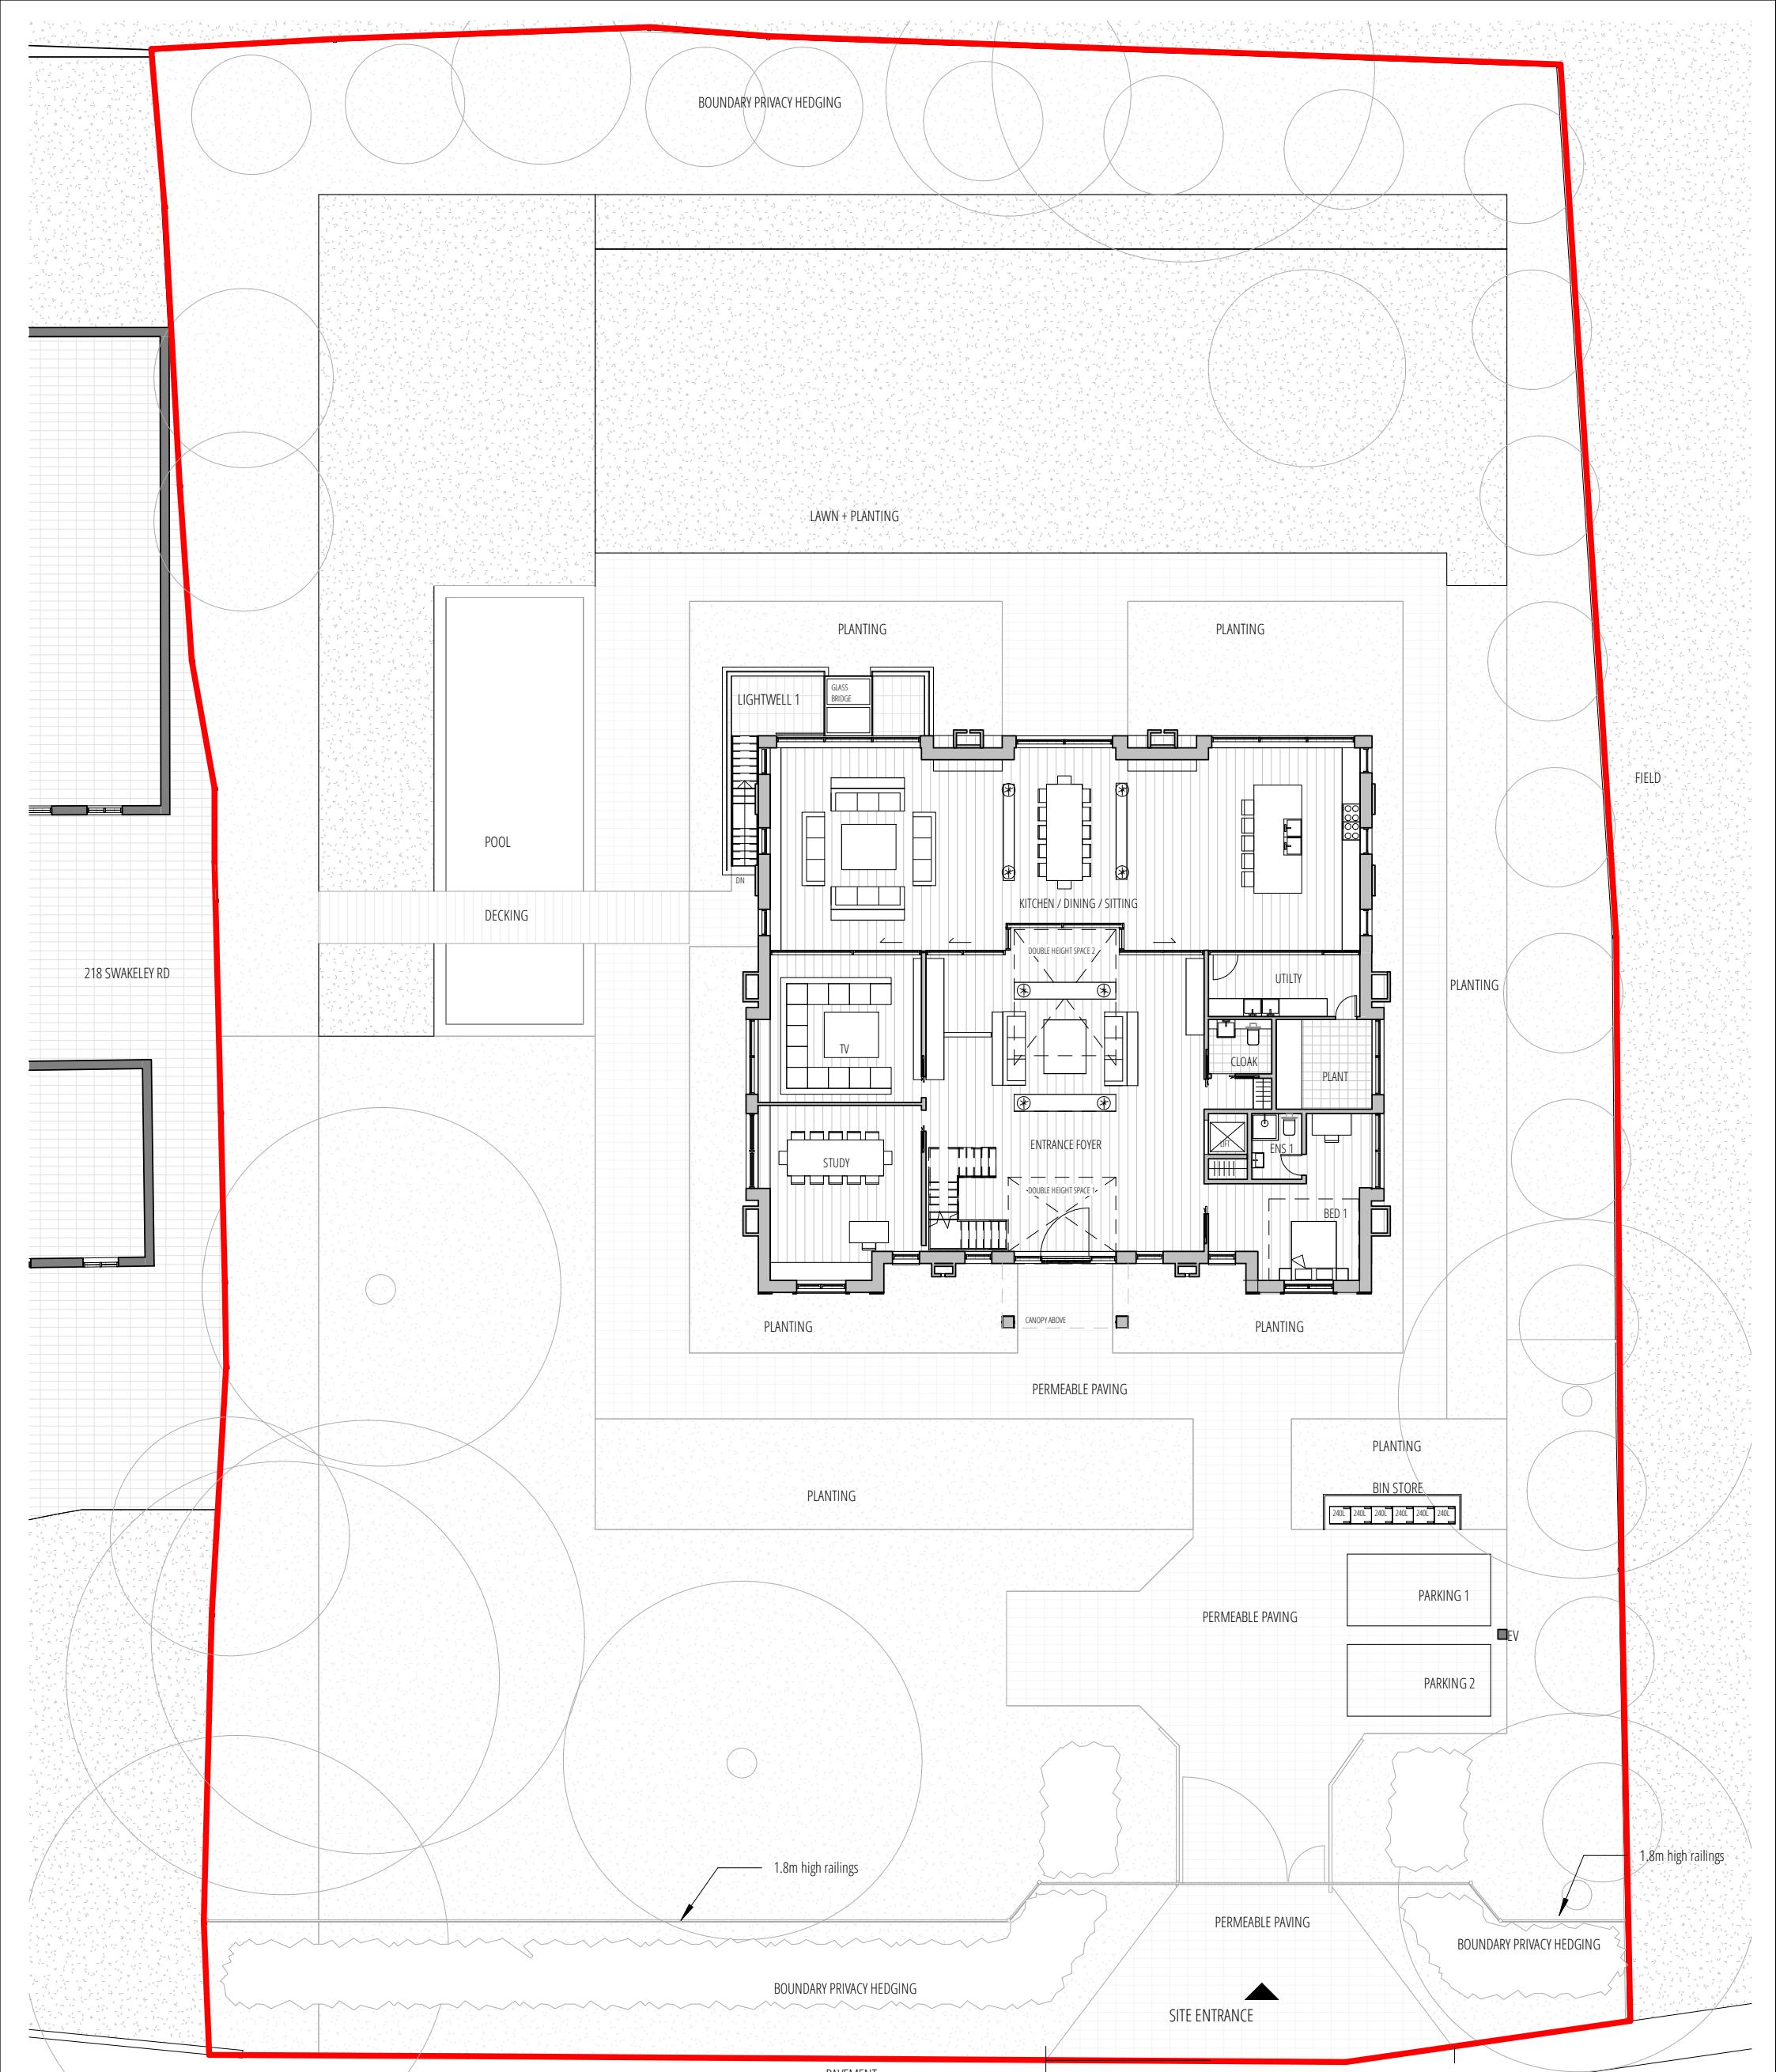

KEY:

	SITE BOUNDARY		APPROVED SCHEME
	EXISTING STRUCTURE	REF NO:13583/APP/2024/2318	
	PROPOSED STRUCTURE		
	ENTRANCE		PV SOLAR PANEL
M1	BUFF BRICKWORK WITH PATTERN		
M2	SANDSTONE / SMOOTH		
M3	SANDSTONE / ROUGH		
M4	HARDWOOD WINDOW AND DOORS / OG OPAQUE		
M5	SAFETY GLAZING GUARDING		
M6	SANDSTONE CLADDING WITH PATTERN		
M7	METAL FLAT LOCK ROOFING / DORMER CLADDING		
M8	TREATED POPLAR TIMBER CLADDING		


01 PROPOSED GF PLAN

1:200 @ A3

SWAKELEY RD

DRAWN BY ARCHITECT		ACCEPT / A REJECT / R	Rev	Date	Note
CHECK BY CLIENT SIGN / DATE		P1	06-12-24		PLANNING ISSUE
CHECK BY CONTRACTOR SIGN / DATE					
CHECK BY APPROVED INSPECTOR SIGN / DATE					
PROJECT					
212 Swakeleys Road, Ickenham UB10 8AY					
DRAWING TITLE	PROPOSED GF PLAN				
SCALE	1:200@A3	DATE	DEC 2024	PROJECT NO.	1942
REVISION	P1	DRAWING NO.	A201		


PLANNING 01



This drawing is the property of the architect. Copyright is reserved & this drawing is issued on the condition that it is not copied, reproduced, retained or disclosed to any unauthorised person, either wholly or in part, without our consent. Do not scale from this drawing, check all dimensions on site. Any errors please notify architect in the first instance.

SCALE: 1:200@A3 DATE: DEC 2024 PROJECT NO: 1942

REVISION: P1 DRAWING NO. A201

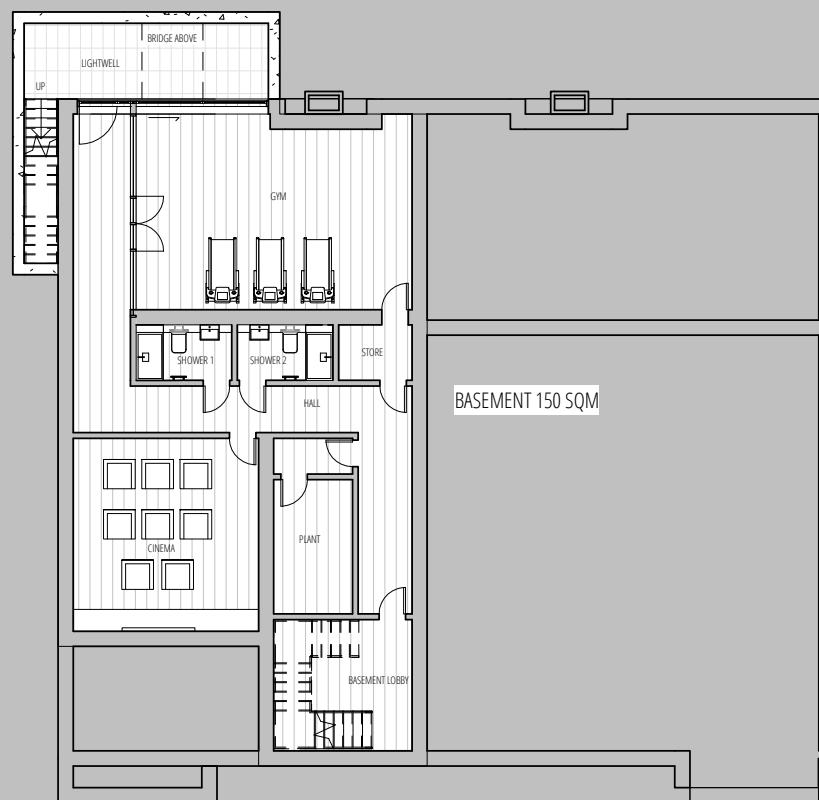

01 PROPOSED LG PLAN
1:200 @ A3



0	1:200 @ A3	5	10M
PLANNING 01			
J79 STUDIO			
This drawing is the property of Architect. Copyright is reserved & this drawing is issued on the condition that it is not copied, reproduced, retained or disclosed to any unauthorised person, either wholly or in part, without our consent. Do not scale from this drawing, check all dimensions on site. Any errors please notify architect in the first instance.			
SCALE	DATE	PROJECT NO.	
1:200@A3	DEC 2024	1942	
REVISION	P1	DRAWING NO.	
			A199

DRAWN BY ARCHITECT
ACCEPT / A
REJECT / R
CHECK BY CLIENT
SIGN / DATE
CHECK BY CONTRACTOR
SIGN / DATE
CHECK BY APPROVED INSPECTOR
SIGN / DATE

ALL DIMENSIONS TO BE CHECKED ON SITE BY
CONTRACTOR AND FABRICATOR
OBTAINED BUILDING CONTROL + PLANNING
APPROVAL PRIOR SITE WORK COMMENCE


Rev Date Note

P1 06-12-24 PLANNING ISSUE

PROJECT
212 Swakeleys Road, Ickenham UB10 8AY

DRAWING TITLE
PROPOSED BASEMENT

**Appendix B
BGS Website Data**

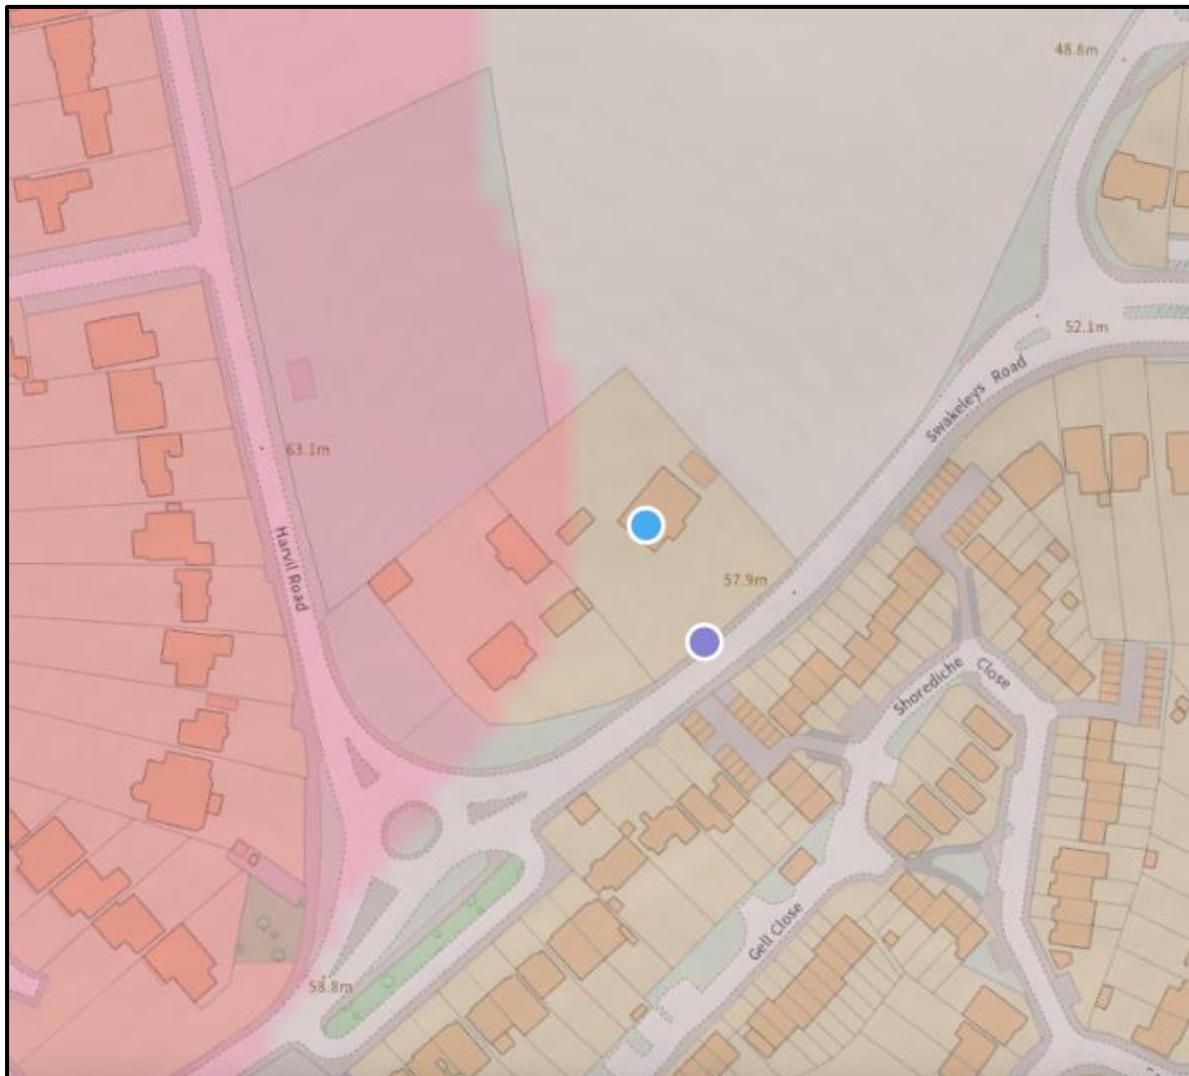

Geology ×

Bedrock geology

London Clay Formation - Clay, silt and sand. Sedimentary bedrock formed between 56 and 47.8 million years ago during the Palaeogene period.

[More Information](#)

**Appendix C
EA Data**

NET Enquiries <HNLenquiries@environment-agency.gov.uk>

Fri 06/10/2023 10:05

To:Michael Micklethwaite <michaelm@jda-ce.co.uk>

Dear Michael

Enquiry regarding: UB10 8AY

Thank you for your enquiry which was received on 25 September 2023.

We respond to requests under the Freedom of Information Act 2000 and Environmental Information Regulations 2004.

Please note that this information is already freely available online at the links below.

The information on Flood Zones in the area relating to UB10 8AY is as follows:

The property is in an area located within Flood Zone 1 shown on our Flood Map for Planning (Rivers and Sea).

Note - This information relates to the area that the above named site is in and is not specific to the property/proposed development itself.

Because this site does not fall within an area at risk of flooding from rivers or the sea, we do not hold any detailed flood modelling data that would impact your site. As such we are unable to provide a flood risk product.

We do not hold records of historic flood events from rivers and/or the sea affecting the area local to this site. However, please be aware that this does not necessarily mean that flooding has not occurred here in the past, as our records are not comprehensive.

This address is within 15m of an area at Medium of surface water flooding.

Following the Flood and Water Management Act 2010, Lead Local Flood Authorities are responsible for the management of groundwater and surface water flooding. They also maintain a register of property flooding incidents. You may want to seek further advice from the Lead Local Flood Authority London Borough of Hillingdon who may have further information.

If you have requested this information to help inform a development proposal, then you should note the information on GOV.UK on the use of Environment Agency Information for Flood Risk Assessments.

<https://www.gov.uk/planning-applications-assessing-flood-risk>

<https://www.gov.uk/government/publications/pre-planning-application-enquiry-form-preliminary-opinion>

You can view groundwater flooding issues here: <https://www.gov.uk/government/collections/groundwater-current-status-and-flood-risk>

<https://www.gov.uk/planning-applications-assessing-flood-risk>

<https://www.gov.uk/government/publications/pre-planning-application-enquiry-form-preliminary-opinion>

You can also view and print surface water flood maps online at: <http://watermaps.environment-agency.gov.uk/wiyby/wiyby.aspx?topic=ufmfsw#x=357683&y=355134&scale=2>

This information is provided subject to the [Open Government Licence](#), which you should read.

Data Available Online

Many of our flood datasets are available online:

- Flood Map For Planning ([Flood Zone 2](#), [Flood Zone 3](#), [Flood Storage Areas](#), [Flood Defences](#))
- [Risk of Flooding from Rivers and Sea](#)
- [Historic Flood Map](#)
- [Assets and Defences](#)
- [Current Flood Warnings](#)
- [Open data](#)

Please get in touch if you have any further queries or contact us within two months if you'd like us to review the information we have sent.

Kind regards

Becca Field

Customers and Engagement Officer

Environment Agency, Hertfordshire and North London

Alchemy, Bessemer Road, Welwyn Garden City, Hertfordshire, AL7 1HE

Direct dial 0203 025 9210

Direct email HNLenquiries@environment-agency.gov.uk

From: Michael Micklethwaite <michaelm@jda-ce.co.uk>

Sent: Monday, September 25, 2023 11:52 AM

To: NET Enquiries <HNLenquiries@environment-agency.gov.uk>

Subject: Product 4 Data - 212 Swakeley Road, Uxbridge

To whom it may concern,

My client has a development at an existing dwelling which is to be demolished and a new dwelling erected in its place, the site is located off Swakeley Road, the nearest postcode is UB10 8AY and the co-ordinates are 506618, 186185.

I have attached a site plan and would appreciate a copy of any data you may have for this area.

Regards,

Michael Micklethwaite
Director

Mob: 07725 686154

michaelm@jda-ce.co.uk

Information in this message may be confidential and may be legally privileged. If you have received this message by mistake, please notify the sender immediately, delete it and do not copy it to anyone else. We have checked this email and its attachments for viruses. But you should still check any attachment before opening it. We may have to make this message and any reply to it public if asked to under the Freedom of Information Act, Data Protection Act or for litigation. Email messages and attachments sent to or from any Environment Agency address may also be accessed by someone other than the sender or recipient, for business purposes.

Appendix D
Greenfield Runoff Calc

Calculated by:	Michael Micklithwaite
Site name:	Swakeley Road
Site location:	Uxbridge

This is an estimation of the greenfield runoff rates that are used to meet normal best practice criteria in line with Environment Agency guidance "Rainfall runoff management for developments", SC030219 (2013), the SuDS Manual C753 (Ciria, 2016) and the non-statutory standards for SuDS (Defra, 2015). This information on greenfield runoff rates may be the basis for setting consents for the drainage of surface water runoff from sites.

Site Details

Latitude:	51.56448° N
Longitude:	0.46326° W
Reference:	1542428898
Date:	Oct 12 2023 18:02

Runoff estimation approach

IH124

Site characteristics

Total site area (ha): 0.32

Notes

 (1) Is $Q_{BAR} < 2.0 \text{ l/s/ha}$?

When Q_{BAR} is $< 2.0 \text{ l/s/ha}$ then limiting discharge rates are set at 2.0 l/s/ha .

Methodology

 Q_{BAR} estimation method: Calculate from SPR and SAAR

SPR estimation method: Calculate from SOIL type

Soil characteristics

	Default	Edited
SOIL type:	4	4
HOST class:	N/A	N/A
SPR/SPRHOST:	0.47	0.47

 (2) Are flow rates $< 5.0 \text{ l/s}$?

Where flow rates are less than 5.0 l/s consent for discharge is usually set at 5.0 l/s if blockage from vegetation and other materials is possible. Lower consent flow rates may be set where the blockage risk is addressed by using appropriate drainage elements.

Hydrological characteristics

	Default	Edited
SAAR (mm):	644	644
Hydrological region:	6	6
Growth curve factor 1 year:	0.85	0.85
Growth curve factor 30 years:	2.3	2.3
Growth curve factor 100 years:	3.19	3.19
Growth curve factor 200 years:	3.74	3.74

 (3) Is $SPR/SPRHOST \leq 0.3$?

Where groundwater levels are low enough the use of soakaways to avoid discharge offsite would normally be preferred for disposal of surface water runoff.

Greenfield runoff rates

	Default	Edited
Q _{BAR} (l/s):	1.4	1.4
1 in 1 year (l/s):	1.19	1.19
1 in 30 years (l/s):	3.22	3.22
1 in 100 year (l/s):	4.47	4.47
1 in 200 years (l/s):	5.24	5.24

This report was produced using the greenfield runoff tool developed by HR Wallingford and available at www.ukuds.com. The use of this tool is subject to the UK SuDS terms and conditions and licence agreement, which can both be found at www.ukuds.com/terms-and-conditions.htm. The outputs from this tool are estimates of greenfield runoff rates. The use of these results is the responsibility of the users of this tool. No liability will be accepted by HR Wallingford, the Environment Agency, CEH, Hydrosolutions or any other organisation for the use of this data in the design or operational characteristics of any drainage scheme.

Appendix E
Drainage Layout Plan


EXISTING SEWERS TO BE INVESTIGATED ON SITE FOR BOTH SURFACE AND FOUL WITH THE INTENTION OF UTILISING AN EXISTING CONNECTION

**COVER AND INVERTS OF EXISTING
SEWERS SHOULD BE CHECKED ON
SITE PRIOR TO CONSTRUCTION**

**ALL RWP AND SVP'S TO BE
CHECKED AGAINST ARCHITECTS
LAYOUT PLANS**

Notes

1. This drawing is produced for use in this project only and may not be used for any other purpose. The consulting Engineers accept no liability for the use of this drawing other than the purpose for which it was intended in connection with this project as recorded on the title block fields 'Purpose for Issue' and 'File Status Code'.
2. This drawing may not be reproduced in any form without prior written agreement.
3. Do not scale from the drawing, use written dimensions only.
4. All dimensions are in millimetres unless otherwise specified.
5. Discrepancies must be reported back to the engineer prior to construction.

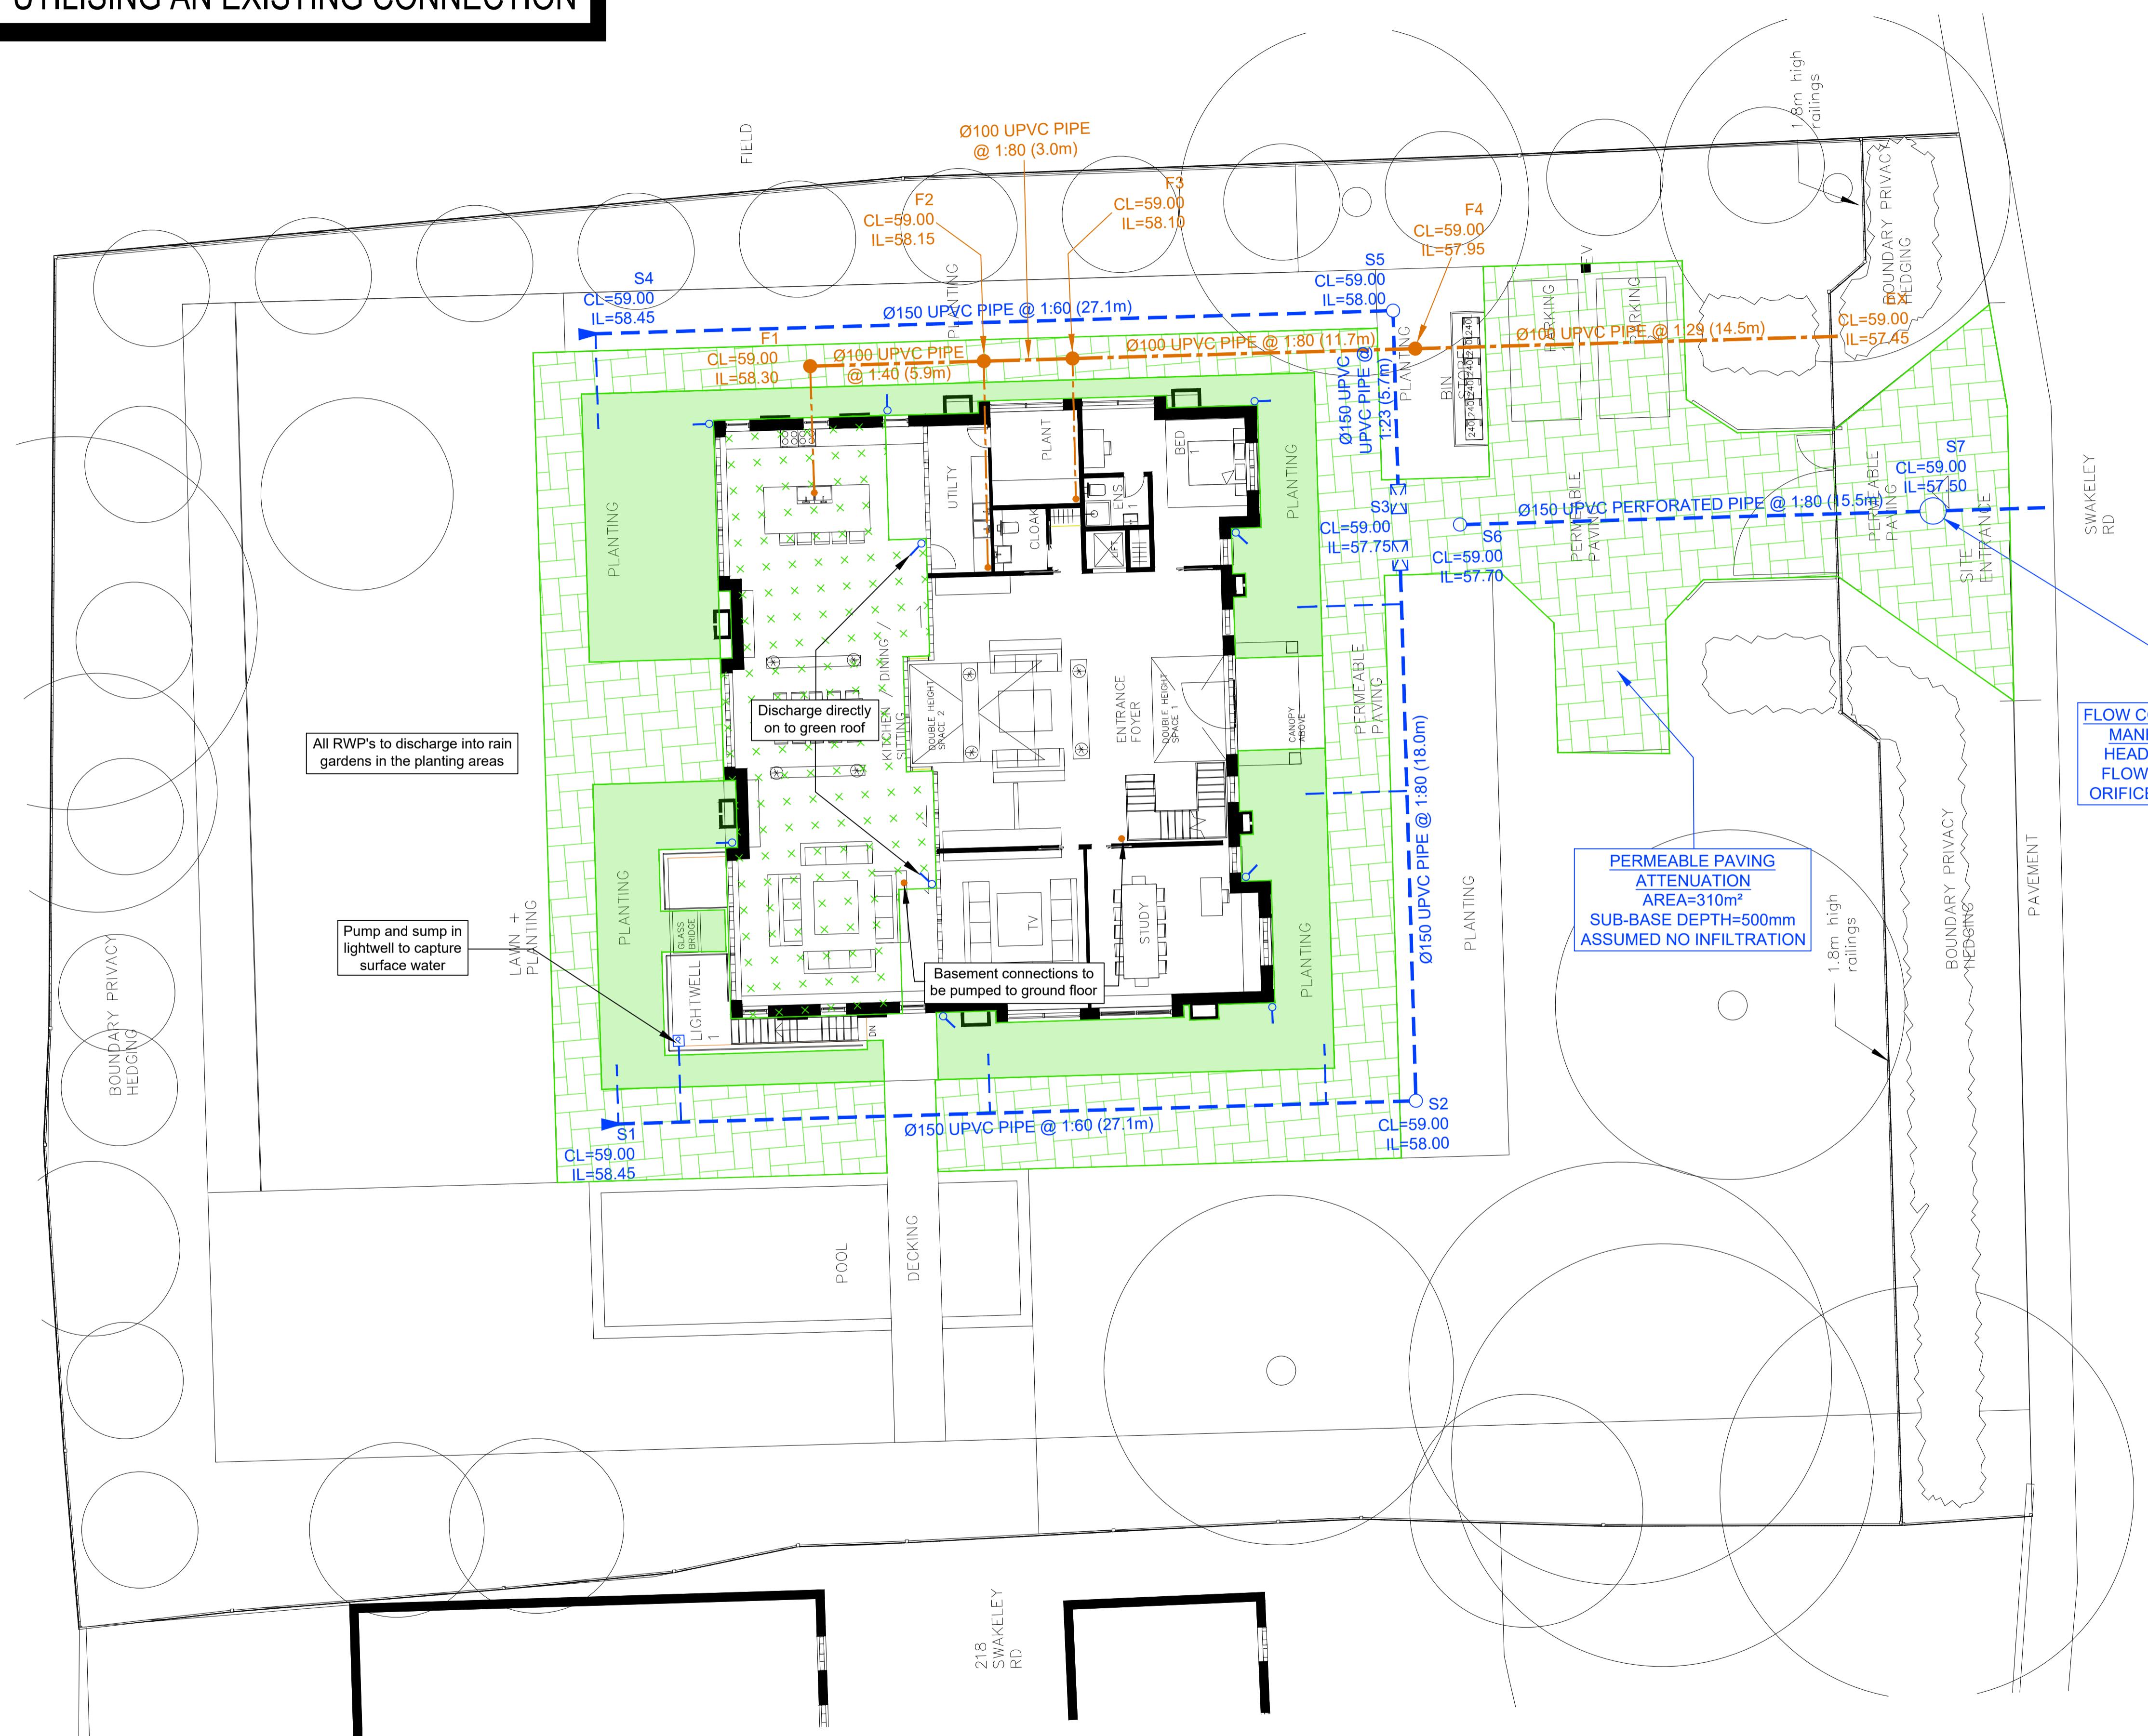

DRAINAGE STRATEGY

SURFACE WATER

In accordance with the SuDS Hierarchy then infiltration should be considered in the first instance, based on BGS records it is assumed that soakaway would not be viable.

If soakaways do not work then the surface water should discharge to a water course wherever possible, as there are no watercourses

We are therefore proposing to discharge to the public sewer via existing connections on site, at a controlled rate of 1.4 l/s with attenuation on site to store the 1 in 100 Year + 40% climate change rainfall event. (Refer to JDA Drainage Strategy Report)

FOUL DRAINAGE

It is proposed to discharge the foul drainage to the existing public sewerage system, via the proposed drainage outlet.

REV	DESCRIPTION	REV	CHG	DATE
C	UPDATED TO LATEST LAYOUT	MJM	JD	14.01.2023
B	UPDATED TO LATEST LAYOUT	MJM	JD	04.07.2022
A	INITIAL ISSUE	MJM	JD	19.09.2021

THIS DRAWING IS CONFIDENTIAL AND MUST NOT
REPRODUCED WITHOUT THE CONSENT OF
JOHN DAVIES ASSOCIATES.

CLIENT

J79 STUDIO ARCHITECTS

PROJECT
212 SWAKELEY ROAD
UXBRIDGE
UB10 2AY

TITLE

PROPOSED DRAINAGE LAYOUT PLAN

DWN	DATE	CHK	DATE	APP.	DATE	SCALE
MM	OCT '27					1:125

John Davies Associates
1 St John's Rd.
Queen's Park
Chester. CH4 7AL
Tel/Fax: 01244 677991

JOHN DAVIES
ASSOCIATES
Consulting Engineers

Drawing Number

JDA/490/3/1

A1

Appendix F
Drainage Calc

Design Settings

Rainfall Methodology	FSR	Maximum Time of Concentration (mins)	30.00
Return Period (years)	1	Maximum Rainfall (mm/hr)	50.0
Additional Flow (%)	0	Minimum Velocity (m/s)	1.00
FSR Region	England and Wales	Connection Type	Level Soffits
M5-60 (mm)	20.000	Minimum Backdrop Height (m)	0.200
Ratio-R	0.400	Preferred Cover Depth (m)	1.200
CV	0.750	Include Intermediate Ground	✓
Time of Entry (mins)	5.00	Enforce best practice design rules	✓

Adoptable Manhole Type

Max Width (mm)	Diameter (mm)	Max Width (mm)	Diameter (mm)
374	1200	749	1500
499	1350	900	1800

>900 Link+900 mm

Max Depth (m)	Diameter (mm)	Max Depth (m)	Diameter (mm)
1.500	1050	99.999	1200

Circular Link Type

Shape	Circular	Auto Increment (mm)	75
Barrels	1	Follow Ground	x

Available Diameters (mm)

100 | 150

Nodes

Name	Area (ha)	T of E (mins)	Cover Level (m)	Diameter (mm)	Easting (m)	Northing (m)	Depth (m)
S1	0.014	5.00	59.000	450	506595.029	186185.460	0.550
S2	0.008	5.00	59.000	450	506613.604	186164.581	1.000
S3			59.000	450	506628.365	186177.628	1.250
S4	0.014	5.00	59.000	450	506615.294	186203.489	0.550
S5			59.000	450	506633.869	186182.610	1.000
S6	0.014	5.00	59.000	450	506629.717	186176.132	1.300
S7			59.000	450	506640.510	186164.002	1.500
EX			59.000	1200	506643.058	186161.137	1.550

Links

Name	US Node	DS Node	Length (m)	ks (mm) / n	US IL (m)	DS IL (m)	Fall (m)	Slope (1:X)	Dia (mm)	T of C (mins)	Rain (mm/hr)
1.000	S1	S2	27.946	0.600	58.450	58.000	0.450	62.1	150	5.36	50.0
1.001	S2	S3	19.701	0.600	58.000	57.750	0.250	78.8	150	5.65	50.0
2.000	S4	S5	27.946	0.600	58.450	58.000	0.450	62.1	150	5.36	50.0
2.001	S5	S3	7.424	0.600	58.000	57.750	0.250	29.7	150	5.43	50.0
1.002	S3	S6	2.016	0.600	57.750	57.700	0.050	40.3	150	5.68	50.0
1.003	S6	S7	16.237	0.600	57.700	57.500	0.200	81.2	150	5.92	50.0
1.004	S7	EX	3.834	0.600	57.500	57.450	0.050	76.7	150	5.97	49.7

Name	Vel (m/s)	Cap (l/s)	Flow (l/s)	US Depth (m)	DS Depth (m)	Σ Area (ha)	Σ Add Inflow (l/s)	Pro Depth (mm)	Pro Velocity (m/s)
1.000	1.278	22.6	1.9	0.400	0.850	0.014	0.0	30	0.782
1.001	1.133	20.0	3.0	0.850	1.100	0.022	0.0	39	0.814
2.000	1.278	22.6	1.9	0.400	0.850	0.014	0.0	30	0.782
2.001	1.854	32.8	1.9	0.850	1.100	0.014	0.0	24	1.008
1.002	1.589	28.1	4.9	1.100	1.150	0.036	0.0	42	1.200
1.003	1.116	19.7	6.8	1.150	1.350	0.050	0.0	61	1.014
1.004	1.149	20.3	6.7	1.350	1.400	0.050	0.0	59	1.034

Pipeline Schedule

Link	Length (m)	Slope (1:X)	Dia (mm)	Link Type	US CL (m)	US IL (m)	US Depth (m)	DS CL (m)	DS IL (m)	DS Depth (m)
1.000	27.946	62.1	150	Circular	59.000	58.450	0.400	59.000	58.000	0.850
1.001	19.701	78.8	150	Circular	59.000	58.000	0.850	59.000	57.750	1.100
2.000	27.946	62.1	150	Circular	59.000	58.450	0.400	59.000	58.000	0.850
2.001	7.424	29.7	150	Circular	59.000	58.000	0.850	59.000	57.750	1.100
1.002	2.016	40.3	150	Circular	59.000	57.750	1.100	59.000	57.700	1.150
1.003	16.237	81.2	150	Circular	59.000	57.700	1.150	59.000	57.500	1.350
1.004	3.834	76.7	150	Circular	59.000	57.500	1.350	59.000	57.450	1.400

Link	US Node	Dia (mm)	Node Type	MH Type	DS Node	Dia (mm)	Node Type	MH Type
1.000	S1	450	Manhole	Adoptable	S2	450	Manhole	Adoptable
1.001	S2	450	Manhole	Adoptable	S3	450	Manhole	Adoptable
2.000	S4	450	Manhole	Adoptable	S5	450	Manhole	Adoptable
2.001	S5	450	Manhole	Adoptable	S3	450	Manhole	Adoptable
1.002	S3	450	Manhole	Adoptable	S6	450	Manhole	Adoptable
1.003	S6	450	Manhole	Adoptable	S7	450	Manhole	Adoptable
1.004	S7	450	Manhole	Adoptable	EX	1200	Manhole	Adoptable

Manhole Schedule

Node	Easting (m)	Northing (m)	CL (m)	Depth (m)	Dia (mm)	Connections	Link	IL (m)	Dia (mm)
S1	506595.029	186185.460	59.000	0.550	450				
S2	506613.604	186164.581	59.000	1.000	450	0 1 0	1.000 1.001 1.001	58.450 58.000 58.000	150 150 150

Manhole Schedule

Node	Easting (m)	Northing (m)	CL (m)	Depth (m)	Dia (mm)	Connections	Link	IL (m)	Dia (mm)	
S3	506628.365	186177.628	59.000	1.250	450		1 2 0	2.001 1.001 1.002	57.750 57.750 57.750	150 150 150
S4	506615.294	186203.489	59.000	0.550	450		0	2.000	58.450	150
S5	506633.869	186182.610	59.000	1.000	450		1 0	2.000 2.001	58.000 58.000	150 150
S6	506629.717	186176.132	59.000	1.300	450		1 0	1.002 1.003	57.700 57.700	150 150
S7	506640.510	186164.002	59.000	1.500	450		1 0	1.003 1.004	57.500 57.500	150 150
EX	506643.058	186161.137	59.000	1.550	1200		1	1.004	57.450	150

Simulation Settings

Rainfall Methodology	FSR	Analysis Speed	Detailed
Rainfall Events	Singular	Skip Steady State	x
FSR Region	England and Wales	Drain Down Time (mins)	240
M5-60 (mm)	20.000	Additional Storage (m³/ha)	0.0
Ratio-R	0.400	Starting Level (m)	
Summer CV	0.750	Check Discharge Rate(s)	x
Winter CV	0.840	Check Discharge Volume	x

Storm Durations

15 | 30 | 60 | 120 | 180 | 240 | 360 | 480 | 600 | 720 | 960 | 1440

Return Period (years)	Climate Change (CC %)	Additional Area (A %)	Additional Flow (Q %)
1	0	0	0
30	0	0	0
100	0	0	0
100	40	0	0

Node S7 Online Orifice Control

Flap Valve	x	Design Depth (m)	1.200	Discharge Coefficient	0.600
Replaces Downstream Link	✓	Design Flow (l/s)	1.4		
Invert Level (m)	57.500	Diameter (m)	0.024		

Node S3 Depth/Area Storage Structure

Base Inf Coefficient (m/hr)	0.00000	Safety Factor	2.0	Invert Level (m)	57.750
Side Inf Coefficient (m/hr)	0.00000	Porosity	0.33	Time to half empty (mins)	

Depth (m)	Area (m ²)	Inf Area (m ²)	Depth (m)	Area (m ²)	Inf Area (m ²)	Depth (m)	Area (m ²)	Inf Area (m ²)
0.000	137.0	0.0	0.300	137.0	0.0	0.301	0.0	0.0

Other (defaults)

Entry Loss (manhole)	0.250	Entry Loss (junction)	0.000	Apply Recommended Losses	x
Exit Loss (manhole)	0.250	Exit Loss (junction)	0.000	Flood Risk (m)	0.300

Rainfall

Event	Peak Intensity (mm/hr)	Average Intensity (mm/hr)	Event	Peak Intensity (mm/hr)	Average Intensity (mm/hr)
1 year 15 minute summer	109.521	30.991	30 year 480 minute summer	24.324	6.428
1 year 15 minute winter	76.857	30.991	30 year 480 minute winter	16.160	6.428
1 year 30 minute summer	71.439	20.215	30 year 600 minute summer	19.756	5.404
1 year 30 minute winter	50.133	20.215	30 year 600 minute winter	13.498	5.404
1 year 60 minute summer	48.435	12.800	30 year 720 minute summer	17.490	4.687
1 year 60 minute winter	32.179	12.800	30 year 720 minute winter	11.754	4.687
1 year 120 minute summer	30.053	7.942	30 year 960 minute summer	14.215	3.743
1 year 120 minute winter	19.966	7.942	30 year 960 minute winter	9.416	3.743
1 year 180 minute summer	23.233	5.979	30 year 1440 minute summer	10.161	2.723
1 year 180 minute winter	15.102	5.979	30 year 1440 minute winter	6.829	2.723
1 year 240 minute summer	18.475	4.882	100 year 15 minute summer	348.738	98.681
1 year 240 minute winter	12.274	4.882	100 year 15 minute winter	244.728	98.681
1 year 360 minute summer	14.169	3.646	100 year 30 minute summer	228.965	64.789
1 year 360 minute winter	9.210	3.646	100 year 30 minute winter	160.677	64.789
1 year 480 minute summer	11.185	2.956	100 year 60 minute summer	153.288	40.510
1 year 480 minute winter	7.431	2.956	100 year 60 minute winter	101.841	40.510
1 year 600 minute summer	9.182	2.511	100 year 120 minute summer	92.562	24.461
1 year 600 minute winter	6.274	2.511	100 year 120 minute winter	61.496	24.461
1 year 720 minute summer	8.203	2.199	100 year 180 minute summer	69.806	17.964
1 year 720 minute winter	5.513	2.199	100 year 180 minute winter	45.376	17.964
1 year 960 minute summer	6.768	1.782	100 year 240 minute summer	54.269	14.342
1 year 960 minute winter	4.483	1.782	100 year 240 minute winter	36.055	14.342
1 year 1440 minute summer	4.949	1.326	100 year 360 minute summer	40.484	10.418
1 year 1440 minute winter	3.326	1.326	100 year 360 minute winter	26.315	10.418
30 year 15 minute summer	268.706	76.035	100 year 480 minute summer	31.414	8.302
30 year 15 minute winter	188.566	76.035	100 year 480 minute winter	20.871	8.302
30 year 30 minute summer	174.929	49.499	100 year 600 minute summer	25.431	6.956
30 year 30 minute winter	122.757	49.499	100 year 600 minute winter	17.376	6.956
30 year 60 minute summer	116.589	30.811	100 year 720 minute summer	22.452	6.017
30 year 60 minute winter	77.459	30.811	100 year 720 minute winter	15.089	6.017
30 year 120 minute summer	70.438	18.615	100 year 960 minute summer	18.166	4.784
30 year 120 minute winter	46.797	18.615	100 year 960 minute winter	12.033	4.784
30 year 180 minute summer	53.298	13.715	100 year 1440 minute summer	12.896	3.456
30 year 180 minute winter	34.645	13.715	100 year 1440 minute winter	8.667	3.456
30 year 240 minute summer	41.604	10.995	100 year +40% CC 15 minute summer	488.233	138.153
30 year 240 minute winter	27.641	10.995	100 year +40% CC 15 minute winter	342.620	138.153
30 year 360 minute summer	31.221	8.034	100 year +40% CC 30 minute summer	320.551	90.705
30 year 360 minute winter	20.295	8.034	100 year +40% CC 30 minute winter	224.948	90.705

Rainfall

Event	Peak Intensity (mm/hr)	Average Intensity (mm/hr)	Event	Peak Intensity (mm/hr)	Average Intensity (mm/hr)
100 year +40% CC 60 minute summer	214.603	56.713	100 year +40% CC 480 minute summer	43.979	11.622
100 year +40% CC 60 minute winter	142.577	56.713	100 year +40% CC 480 minute winter	29.219	11.622
100 year +40% CC 120 minute summer	129.587	34.246	100 year +40% CC 600 minute summer	35.604	9.738
100 year +40% CC 120 minute winter	86.094	34.246	100 year +40% CC 600 minute winter	24.327	9.738
100 year +40% CC 180 minute summer	97.729	25.149	100 year +40% CC 720 minute summer	31.433	8.424
100 year +40% CC 180 minute winter	63.526	25.149	100 year +40% CC 720 minute winter	21.125	8.424
100 year +40% CC 240 minute summer	75.977	20.078	100 year +40% CC 960 minute summer	25.432	6.697
100 year +40% CC 240 minute winter	50.477	20.078	100 year +40% CC 960 minute winter	16.847	6.697
100 year +40% CC 360 minute summer	56.677	14.585	100 year +40% CC 1440 minute summer	18.055	4.839
100 year +40% CC 360 minute winter	36.841	14.585	100 year +40% CC 1440 minute winter	12.134	4.839

**Results for 1 year Critical Storm Duration. Lowest mass balance: 97.22%**

Node Event	US	Peak	Level	Depth	Inflow	Node	Flood	Status
	Node	(mins)	(m)	(m)	(l/s)	Vol (m³)	(m³)	
15 minute winter	S1	10	58.480	0.030	2.0	0.0048	0.0000	OK
15 minute winter	S2	10	58.046	0.046	3.1	0.0072	0.0000	OK
60 minute winter	S3	58	57.814	0.064	3.1	2.8915	0.0000	OK
15 minute winter	S4	10	58.481	0.031	2.0	0.0049	0.0000	OK
15 minute winter	S5	10	58.028	0.028	2.0	0.0044	0.0000	OK
120 minute winter	S6	98	57.818	0.118	4.5	0.0188	0.0000	OK
180 minute summer	S7	128	57.821	0.321	2.2	0.0510	0.0000	SURCHARGED
15 minute summer	EX	1	57.450	0.000	0.7	0.0000	0.0000	OK

Link Event (Upstream Depth)	US	Link	DS	Outflow	Velocity	Flow/Cap	Link	Discharge Vol (m³)
	Node	Node		(l/s)	(m/s)		Vol (m³)	
15 minute winter	S1	1.000	S2	2.0	0.568	0.087	0.0978	
15 minute winter	S2	1.001	S3	3.1	1.180	0.157	0.0589	
60 minute winter	S3	1.002	S6	3.8	0.461	0.137	0.0219	
15 minute winter	S4	2.000	S5	2.0	0.825	0.087	0.0671	
15 minute winter	S5	2.001	S3	2.0	1.296	0.061	0.0175	
120 minute winter	S6	1.003	S7	1.9	0.349	0.099	0.2640	
180 minute summer	S7	Orifice	EX	0.7				6.8

**Results for 30 year Critical Storm Duration. Lowest mass balance: 97.22%**

Node Event	US	Peak	Level	Depth	Inflow	Node	Flood	Status
	Node	(mins)	(m)	(m)	(l/s)	Vol (m³)	(m³)	
15 minute winter	S1	10	58.497	0.047	4.8	0.0074	0.0000	OK
15 minute winter	S2	10	58.068	0.068	7.5	0.0109	0.0000	OK
120 minute winter	S3	114	57.972	0.222	4.5	10.0813	0.0000	SURCHARGED
15 minute winter	S4	10	58.499	0.049	4.8	0.0078	0.0000	OK
15 minute summer	S5	9	58.039	0.039	4.5	0.0063	0.0000	OK
120 minute winter	S6	114	57.972	0.272	3.6	0.0433	0.0000	SURCHARGED
120 minute winter	S7	114	57.972	0.472	1.6	0.0750	0.0000	SURCHARGED
15 minute summer	EX	1	57.450	0.000	0.7	0.0000	0.0000	OK

Link Event (Upstream Depth)	US	Link	DS	Outflow	Velocity	Flow/Cap	Link	Discharge
	Node	Node		(l/s)	(m/s)		Vol (m³)	Vol (m³)
15 minute winter	S1	1.000	S2	4.7	0.784	0.210	0.1741	
15 minute winter	S2	1.001	S3	7.6	1.334	0.380	0.1875	
120 minute winter	S3	1.002	S6	3.6	0.475	0.130	0.0355	
15 minute winter	S4	2.000	S5	4.7	1.102	0.209	0.1204	
15 minute summer	S5	2.001	S3	4.6	1.429	0.141	0.0572	
120 minute winter	S6	1.003	S7	1.6	0.349	0.080	0.2858	
120 minute winter	S7	Orifice	EX	0.8				14.5

**Results for 100 year Critical Storm Duration. Lowest mass balance: 97.22%**

Node Event	US	Peak	Level	Depth	Inflow	Node	Flood	Status
	Node	(mins)	(m)	(m)	(l/s)	Vol (m³)	(m³)	
15 minute winter	S1	10	58.504	0.054	6.3	0.0085	0.0000	OK
15 minute winter	S2	10	58.077	0.077	9.8	0.0123	0.0000	OK
120 minute winter	S3	118	58.065	0.315	6.1	13.6357	0.0000	SURCHARGED
15 minute winter	S4	10	58.507	0.057	6.3	0.0090	0.0000	OK
120 minute winter	S5	118	58.065	0.065	2.0	0.0103	0.0000	OK
120 minute winter	S6	118	58.065	0.365	2.1	0.0581	0.0000	SURCHARGED
120 minute winter	S7	118	58.065	0.565	1.6	0.0898	0.0000	SURCHARGED
15 minute summer	EX	1	57.450	0.000	0.8	0.0000	0.0000	OK

Link Event (Upstream Depth)	US	Link	DS	Outflow	Velocity	Flow/Cap	Link	Discharge
	Node	Node		(l/s)	(m/s)		Vol (m³)	Vol (m³)
15 minute winter	S1	1.000	S2	6.2	0.845	0.275	0.2071	
15 minute winter	S2	1.001	S3	9.8	1.370	0.489	0.2346	
120 minute winter	S3	1.002	S6	1.4	0.485	0.051	0.0355	
15 minute winter	S4	2.000	S5	6.2	1.193	0.274	0.1453	
120 minute winter	S5	2.001	S3	2.0	0.894	0.061	0.0925	
120 minute winter	S6	1.003	S7	1.6	0.398	0.083	0.2858	
120 minute winter	S7	Orifice	EX	0.9				16.0

**Results for 100 year +40% CC Critical Storm Duration. Lowest mass balance: 97.22%**

Node Event	US	Peak	Level	Depth	Inflow	Node	Flood	Status
	Node	(mins)	(m)	(m)	(l/s)	Vol (m³)	(m³)	
120 minute winter	S1	116	58.913	0.463	2.8	0.0736	0.0000	FLOOD RISK
120 minute winter	S2	116	58.913	0.913	4.4	0.1451	0.0000	FLOOD RISK
120 minute winter	S3	116	58.913	1.163	8.8	13.7705	0.0000	FLOOD RISK
120 minute winter	S4	116	58.913	0.463	2.8	0.0736	0.0000	FLOOD RISK
120 minute winter	S5	116	58.913	0.913	2.8	0.1451	0.0000	FLOOD RISK
120 minute winter	S6	116	58.912	1.212	3.3	0.1928	0.0000	FLOOD RISK
120 minute winter	S7	116	58.911	1.411	2.2	0.2244	0.0000	FLOOD RISK
15 minute summer	EX	1	57.450	0.000	0.8	0.0000	0.0000	OK

Link Event	US	Link	DS	Outflow	Velocity	Flow/Cap	Link	Discharge
(Upstream Depth)	Node		Node	(l/s)	(m/s)		Vol (m³)	Vol (m³)
120 minute winter	S1	1.000	S2	2.8	0.702	0.124	0.4920	
120 minute winter	S2	1.001	S3	4.4	0.844	0.220	0.3468	
120 minute winter	S3	1.002	S6	1.7	0.483	0.061	0.0355	
120 minute winter	S4	2.000	S5	2.8	0.956	0.124	0.4920	
120 minute winter	S5	2.001	S3	2.8	0.952	0.085	0.1307	
120 minute winter	S6	1.003	S7	2.2	0.398	0.109	0.2858	
120 minute winter	S7	Orifice	EX	1.4				20.1

Appendix G
Hillingdon SUDS Proforma

1. Project & Site Details	
Project / Site Name (including sub-catchment / stage / phase where appropriate)	212 Swakeley Road
Address & post code	212 Swakeley Road, Uxbridge, UB10 8AY
OS Grid ref. (Easting, Northing)	E 506618 N 186185
LPA reference (if applicable)	
Brief description of proposed work	Demolition of existing dwelling and outbuilding and erection of new single dwelling
Total site Area	3188 m ²
Total existing impervious area	1454 m ²
Total proposed impervious area	507 m ²
Is the site in a surface water flood risk catchment (ref. local Surface Water Management Plan)?	No
Existing drainage connection type and location	Existing drainage connections to public sewer
Designer Name	Michael Micklethwaite
Designer Position	Director
Designer Company	John Davies Associates

2. Proposed Discharge Arrangements		
	Feasible (Y/N)	Proposed (Y/N)
1 store rainwater for later use	Y	Y
2 use infiltration techniques, such as porous surfaces in non-clay areas	N	Y
3 attenuate rainwater in ponds or open water features for gradual release	N	N
4 attenuate rainwater by storing in tanks or sealed water features for gradual release	N	N
5 discharge rainwater direct to a watercourse	N	N
6 discharge rainwater to a surface water sewer/drain	Y	Y
7 discharge rainwater to the combined sewer.	N	N
2c. Proposed Discharge Details		
Proposed discharge location	Existing drainage connections on site	
Has the owner/regulator of the discharge location been consulted?	Not Yet	

3a. Discharge Rates & Required Storage				
	Greenfield (GF) runoff rate (l/s)	Existing discharge rate (l/s)	Required storage for GF rate (m ³)	Proposed discharge rate (l/s)
Qbar	1.4	XX	XX	XX
1 in 1	1.19	20	10	1.4
1 in 30	3.22	47	28	1.4
1 in 100	4.47	60	38	1.4
1 in 100 + CC	XX	XX	52	1.4
Climate change allowance used	40%			
3b. Principal Method of Flow Control	Orifice Plate in flow control manhole			
3c. Proposed SuDS Measures				
	Catchment area (m ²)	Plan area (m ³)	Storage vol. (m ³)	
Rainwater harvesting	0	XX	0	
Infiltration systems	0	XX	0	
Green roofs	173	173	0	
Blue roofs	0	0	0	
Filter strips	0	0	0	
Filter drains	0	0	0	
Bioretention / tree pits	0	0	0	
Pervious pavements	310	400	52	
Swales	0	0	0	
Basins/ponds	0	0	0	
Attenuation tanks	0	XX	0	
Total	483	573	52	

4. Supporting Information	4a. Discharge & Drainage Strategy	Page/section of drainage report
	Infiltration feasibility (2a) – geotechnical factual and interpretive reports, including infiltration results	-
	Drainage hierarchy (2b)	Public Sewer
	Proposed discharge details (2c) – utility plans, correspondence / approval from owner/regulator of discharge location	-
	Discharge rates & storage (3a) – detailed hydrologic and hydraulic calculations	1.4 l/s [23028 - SW Model (A)]
	Proposed SuDS measures & specifications (3b)	Roof, Rain Gardens and Permeable P
4b. Other Supporting Details	Page/section of drainage report	
Detailed Development Layout	A201 (P1) _ Proposed GF Plan	
Detailed drainage design drawings, including exceedance flow routes	sed Drainage Layout / JDA-490-4-1 (A)	
Detailed landscaping plans		
Maintenance strategy	JDA Drainage Strategy Report	
Demonstration of how the proposed SuDS measures improve:		
a) water quality of the runoff?	Drainage Strategy Report	
b) biodiversity?	Drainage Strategy Report	
c) amenity?	Drainage Strategy Report	

Appendix H
Flood Exceedance Plan

EXISTING SEWERS TO BE INVESTIGATED ON SITE FOR BOTH SURFACE AND FOUL WITH THE INTENTION OF UTILISING AN EXISTING CONNECTION


**COVER AND INVERTS OF EXISTING
SEWERS SHOULD BE CHECKED ON
SITE PRIOR TO CONSTRUCTION**

ALL RWP AND SVP'S TO BE
CHECKED AGAINST ARCHITECTS
LAYOUT PLANS

Notes

1. This drawing is produced for use in this project only and may not be used for any other purpose. The consulting Engineers accept no liability for the use of this drawing other than the purpose for which it was intended in connection with this project as recorded on the title block fields 'Purpose for Issue' and 'File Status Code'.
2. This drawing may not be reproduced in any form without prior written agreement.
3. Do not scale from the drawing, use written dimensions only.
4. All dimensions are in millimetres unless otherwise specified.
5. Discrepancies must be reported back to the engineer prior to construction.

Key

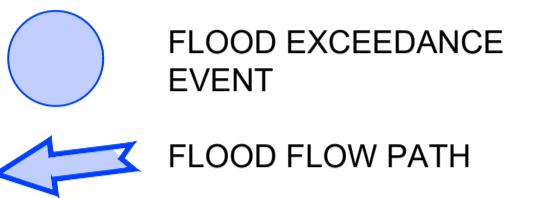

This architectural site plan illustrates the stormwater management system for a residential property. The plan shows the house, surrounding landscaping, and various piping and drainage details.

Key Features and Labels:

- House:** The main building includes a Kitchen, Dining, Living, TV, Study, and Utility areas. It features a glass bridge connecting the kitchen to a lightwell, a double-height space, and a canopy above the entrance.
- Landscaping:** The property includes a lawn, planting areas, and a pool. A boundary hedge runs along the property line.
- Drainage and Piping:**
 - Upvc Pipe:** Ø150 UPVC PIPE @ 1:60 (27.1m) connects the house to the street.
 - Upvc Pipe:** Ø100 UPVC PIPE @ 1:80 (3.0m) connects the house to the field.
 - Upvc Pipe:** Ø100 UPVC PIPE @ 1:80 (11.7m) connects the house to the parking area.
 - Upvc Pipe:** Ø150 UPVC PIPE @ 1:23 (5.7m) connects the house to the permeable paving area.
 - Upvc Pipe:** Ø150 UPVC PIPE @ 1:80 (18.0m) connects the house to the permeable paving area.
 - Upvc Pipe:** Ø150 UPVC PIPE @ 1:80 (14.5m) connects the parking area to the street.
 - Upvc Pipe:** Ø150 UPVC PERFORATED PIPE @ 1:80 (15.5m) connects the permeable paving area to the street.
 - Manholes:** Various manholes are marked with labels like S1, S2, S3, S4, S5, S6, S7, F1, F2, F3, F4, and F5.
 - Flow Control:** A flow control box is located on the permeable paving area.
- Annotations:**
 - All RWP's to discharge into rain gardens in the planting areas.
 - Pump and sump in lightwell to capture surface water.
 - Basement connections to be pumped to ground floor.
 - Discharge directly on to green roof.
 - 1.8m high railings.
 - Boundary privacy hedging.
 - Permeable paving attenuation area = 137m², sub-base depth = 300mm, assumed no infiltration.
 - Flow control parameters: MANHOLE HEAD=1, FLOW=1, ORIFICE=2.
- Address:** 218 SWAKELEY RD

DATE	CHK	DWN	DESCRIPTION	REMARKS
14.01.25	JD	MJM	UPDATED TO LATEST LAYOUT	
04.07.24	JD	MJM	UPDATED TO LATEST LAYOUT	
19.09.23	JD	MJM	INITIAL ISSUE	

THIS DRAWING IS CONFIDENTIAL AND MUST NOT BE
REPRODUCED WITHOUT THE CONSENT OF
JOHN DAVIES ASSOCIATES.

179 STUDIO

PROJECT
212 SWAKELEY ROAD
UXBRIDGE
UB10 2AY

FLOOD EXCEEDANCE LAYOUT PLAN

N	DATE	CHK	DATE	APP.	DATE	SCALE
IM	OCT '23					1:125

John Davies Associates
1 St John's Rd.
Queen's Park
Chester. CH4 7AL
Tel/Fax: 01244 677991

**JOHN DAVIES
ASSOCIATES**
Consulting Engineers

Drawing Number

JDA/490/4/1

A1
REV