



**AF Acoustics Ltd**  
13 Bernard Ave  
West Ealing  
London  
W13 9TG


Tel: +44 (0)20 3372 4430  
Email: [info@af-acoustics.com](mailto:info@af-acoustics.com)  
[www.af-acoustics.com](http://www.af-acoustics.com)

**AMERESCO**  
**HILLINGDON CIVIC**  
**CENTRE**  
**PLANT NOISE**  
**ASSESSMENT**  
**25 AUGUST 2023**

**1951-AF-00001-01**

**AMERESCO  
HILLINGDON CIVIC CENTRE  
PLANT NOISE ASSESSMENT**

**DOCUMENT REFERENCE: 1951-AF-00001-01**

<b>REVIEW AND AUTHORISATION</b>			
<b>Authored and approved by</b> Adrian Finn	<b>Position</b> Director	<b>Signature</b> 	<b>Date</b> 25/08/2023
<b>Reviewed by</b> Daniel Flood	<b>Position</b> Senior Consultant	<b>Signature</b> 	<b>Date</b> 25/08/2023

<b>AMENDMENT HISTORY</b>			
<b>Issue</b>	<b>Status</b>	<b>Description</b>	<b>Date</b>
01	Issue	Report issued	25/08/2023

CONTENTS	PAGE NO.
<b>1. INTRODUCTION</b>	<b>1</b>
1.2 Brief and Scope	1
<b>2. SITE DESCRIPTION</b>	<b>1</b>
2.1 Location	1
<b>3. GUIDANCE</b>	<b>3</b>
3.1 British Standard 4142:2014	3
3.2 Local authority Guidance – Hillingdon	4
<b>4. NOISE SURVEY AND MEASUREMENTS</b>	<b>5</b>
4.1 Unattended Noise Survey	5
4.2 Measurement Weather Conditions	6
4.3 Results	6
<b>5. PLANT NOISE ASSESSMENT</b>	<b>7</b>
5.1 Noise Rating Limit	7
5.2 Plant Noise Levels	7
5.3 Calculated Noise Levels	7
<b>6. CONCLUSION</b>	<b>9</b>

## APPENDIX A – FIGURES

Figure A1 : Noise Measurement Results at Hillingdon Civic Centre

## APPENDIX B – TABLES

Table B1 : Plant Calculations

## APPENDIX C – TERMINOLOGY RELATING TO NOISE

## APPENDIX D – LIMITATIONS TO THE REPORT

## 1. INTRODUCTION

1.1.1 Ameresco has commissioned AF Acoustics Ltd. to undertake a plant noise assessment for the proposed installation of a number of air to water heat pumps to be installed at the Hillingdon Civic Centre.

### 1.2 Brief and Scope

1.2.1 The brief is to undertake a plant noise assessment for the proposed plant to be installed at Hillingdon Civic Centre and to calculate the level of noise impact at the nearest residential receptor. If the proposed plant creates an adverse impact, or the noise levels at the nearest residential receptor do not meet the local authority guidance then recommendations will be given to reduce the noise from the plant, so that the plant produces a low impact in accordance with BS 4142:2014 and meets local authority guidance.

## 2. SITE DESCRIPTION

### 2.1 Location


2.1.1 The proposed plant is to be located at the Hillingdon Civic Centre. The proposed plant is to be located in the following areas:

- Ground level goods-in
- Lower roof
- Upper roof
- Middlesex suite Phase 2A

2.1.2 The proposed locations are shown in Figure 2.1.

2.1.3 Hillingdon Civic Centre is located in a mainly commercial area of Uxbridge Town Centre. There is a residential premises to the north of the site at Lovell House.

2.1.4 The noise profile at the measurement location at Hillingdon Civic Centre consisted mainly of noise from local road traffic.

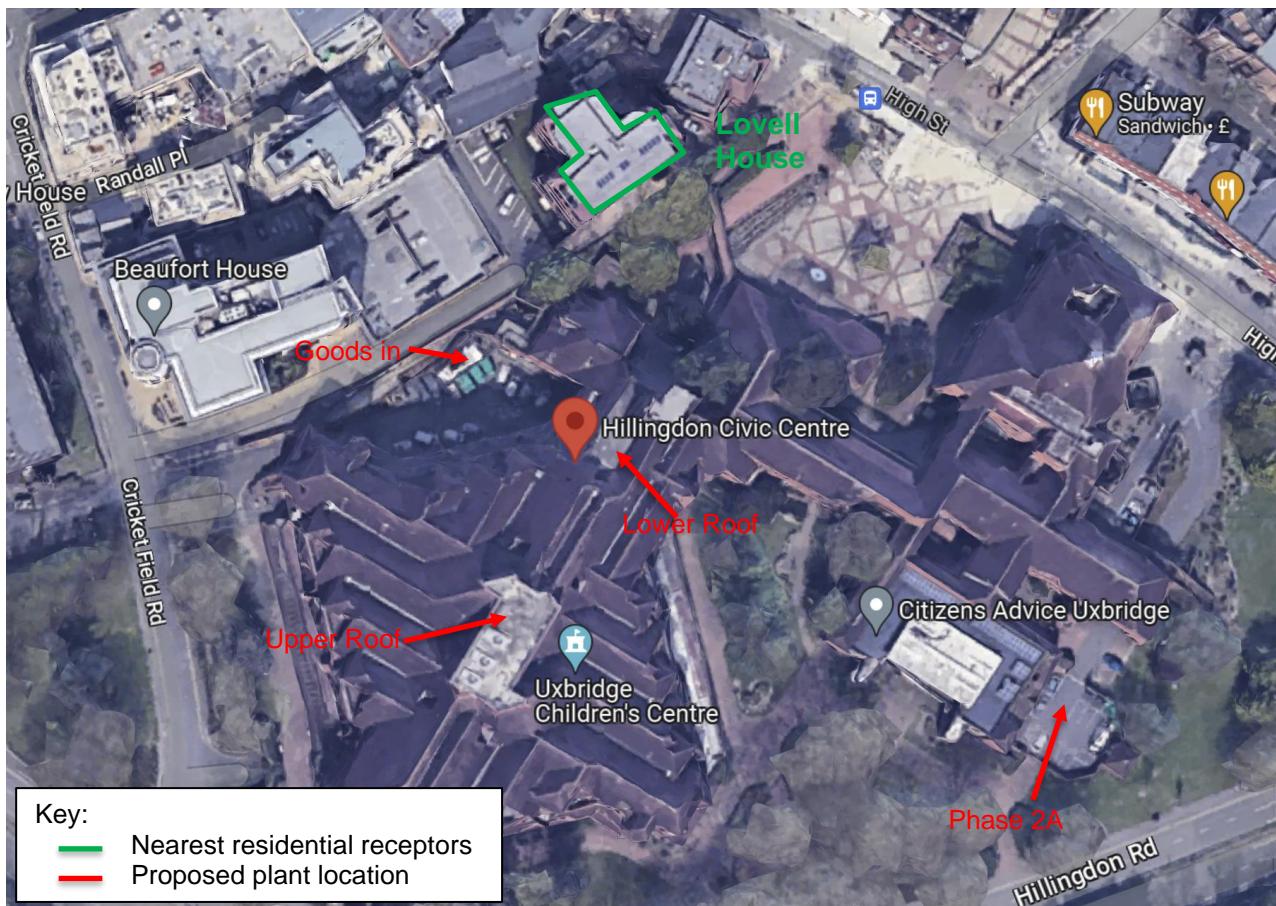

**FIGURE 2.1: LOCATION MAP**

### 3. GUIDANCE

#### 3.1 British Standard 4142:2014

3.1.1 BS 4142:2014 'Methods for rating and assessing industrial and commercial sound' describes methods for rating and assessing sound from "fixed installations which comprise mechanical and electrical plant and equipment", amongst other sources of noise.

3.1.2 The methodology contained within BS 4142:2014 uses outdoor sound levels to assess the likely effects of sound on people who might be inside or outside a dwelling or premises used for residential purposes upon which sound is incident.

3.1.3 A summary of the approach set out within BS 4142:2014 is set out below:

- establish the specific sound level of the source(s);
- measure the representative background sound level, typically by measurement close to the receptor location;
- rate the specific sound level to account for any distinguishing characteristics;
- estimate the impact by subtracting the background sound level from the rating level; and
- consider the initial estimate of impact, in the context of the noise and its environment.

3.1.4 An initial estimate of the impact of the specific sound is obtained by subtracting the background sound level from the rating level. Using this approach, BS 4142 states:

"Typically, the greater this difference, the greater the magnitude of impact  
*A difference of around +10 dB or more is likely to be an indication of a significant adverse impact, depending on the context*  
 A difference of around +5 dB is likely to be an indication of an adverse impact, depending on the context.  
 The lower the rating level is relative to the measured background sound level, the less likely it is that the specific sound source will have an adverse impact or a significant adverse impact. Where the rating level does not exceed the background sound level, this is an indication of the specific sound source having a low impact, depending on the context."

3.1.5 Certain acoustic features can increase the significance of the impact over that expected from a basic comparison between specific sound level and the background sound level. These features include tonality and impulsivity, as well as additional characteristics and intermittency of the sound.

3.1.6 If appropriate, a subjective assessment of the plant features can be adopted. Where the plant noise contains tonal elements, the following corrections can be made depending on how perceptible the tone is at the noise receptor.

3.1.7 The specific sound level is rated to account for distinguishing characteristics by using the penalties below:

- 0 dB where the tone is not perceptible
- 2 dB where the tone is just perceptible
- 4 dB where the tone is clearly perceptible
- 6 dB where the tone is highly perceptible

3.1.8 Where the plant noise is impulsive, the following corrections can be made depending on how perceptible the impulsivity is at the noise receptor.

- 0 dB where the impulse is not perceptible
- 3 dB where the impulse is just perceptible
- 6 dB where the impulse is clearly perceptible
- 9 dB where the impulse is highly perceptible

3.1.9 For noise which is equally both impulsive and tonal, then both features can be taken into account by linearly summing the corrections for both characteristics.

3.1.10 If the plant has other distinctive characteristics, such as intermittency, then a 3 dB correction can be made.

3.1.11 If a subjective assessment is not appropriate then an objective assessment can be made. A noise source is deemed to be tonal if the time averaged sound pressure level in a one-third octave band exceeds the level in adjacent one-third octave bands by the level differences given below:

- 15 dB in the low frequency one-third octave bands (25 Hz to 125 Hz)
- 8 dB in the mid frequency one-third octave bands (160 Hz to 400 Hz)
- 5 dB in the high frequency one-third octave bands (500 Hz to 10000 Hz)

3.1.12 If an objective assessment identifies the plant noise to be tonal then a 6 dB correction must be made.

### **3.2 Local authority Guidance – Hillingdon**


3.2.1 The London Borough of Hillingdon's guidance on plant noise states, 'The rating level of noise emitted from the plant and/or machinery hereby approved shall be at least 5dB below the existing background noise level. The noise levels shall be determined at the nearest residential property. The measurements and assessment shall be made in accordance with British Standard 4142.'

## 4. NOISE SURVEY AND MEASUREMENTS

### 4.1 Unattended Noise Survey

4.1.1 An unattended noise survey was undertaken by Adrian Finn of AF Acoustics with the sound level meter located on the 4<sup>th</sup> floor roof level of the civic centre overlooking the nearest residential receptor of Lovell House. The measurement position is considered representative of the noise levels affecting the nearest noise sensitive receptor. The measurement position was chosen as it was the closest position on the civic centre to the nearest residential receptor where it was safe to put the measurement equipment and was not influenced by plant from the civic centre.

4.1.2 The duration of the survey was between 09:30 on 8 August and 10:30 on 9 August 2023. This measurement location is labelled in Figure 4.1. The measured noise levels are considered free field noise levels. The microphone was protected with a windshield during the noise survey. Measurements were carried out in accordance with the requirements of BS 7445-2:1991 and ISO 1996-2:1987.

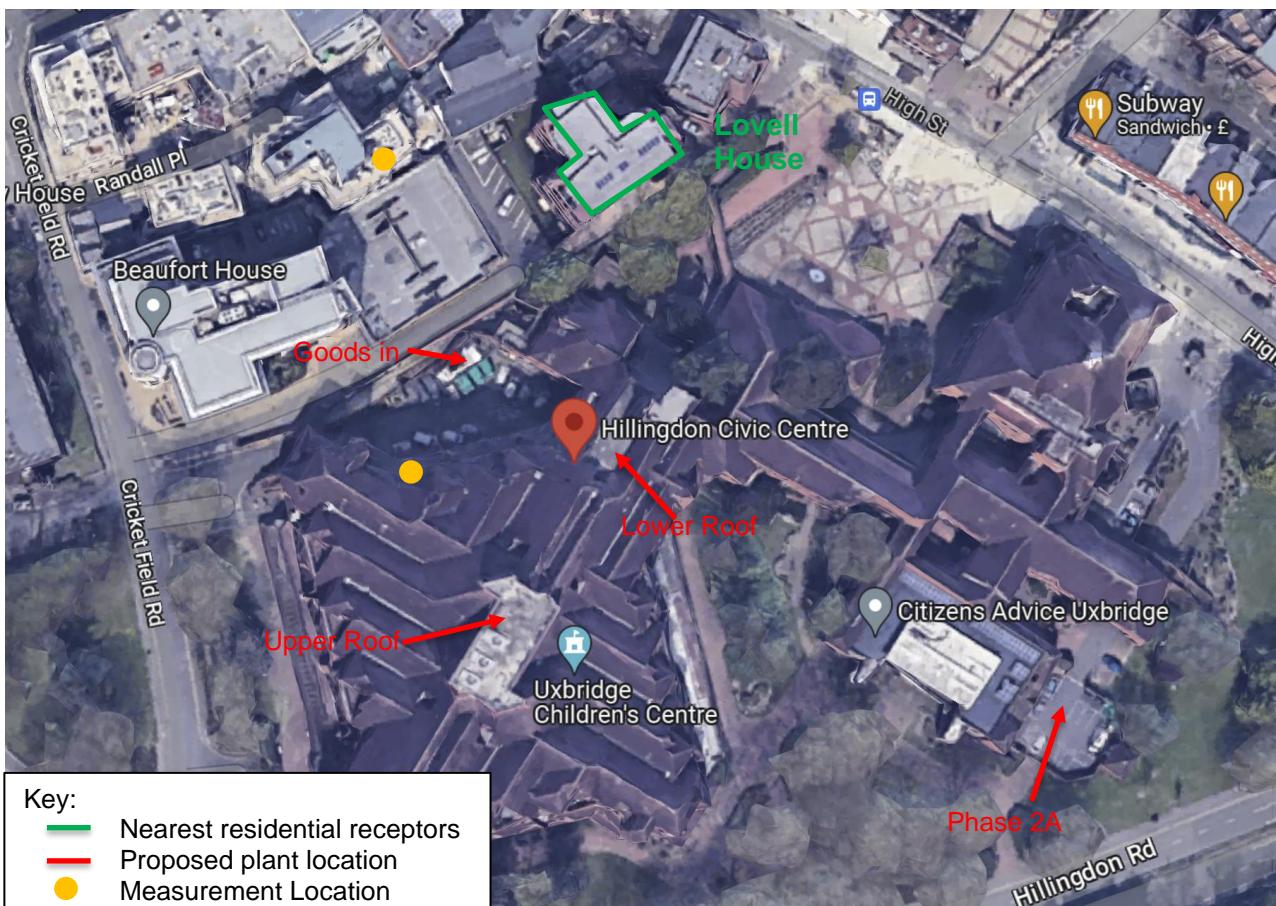

**FIGURE 4.1: MEASUREMENT LOCATION**

4.1.3 The sound level meter had calibration checks before and after the measurement surveys to generate a calibration level of 114 dB at 1 kHz. The equipment calibration was verified before and after the survey and no calibration drift was observed. The microphone was fitted with a windshield.

4.1.4 The noise profile at the measurement location at Hillingdon Sports & Leisure Complex consisted mainly of noise from the centre plant room.

4.1.5 The equipment used is shown in Table 4.1.

Name	Serial Number	Last Calibrated
<b>NTI Audio XL2-TA Class 1 Sound Level Meter</b>	A2A-18530-E0	January 2023
<b>NTI Audio MA220 Pre-amplifier</b>	9566	January 2023
<b>NTI Audio MC230A Microphone</b>	A19842	January 2023
<b>Norsonic 1251 Calibrator</b>	30900	July 2023

TABLE 4.1: MEASUREMENT EQUIPMENT

#### 4.2 Measurement Weather Conditions

4.2.1 The weather during the measurements was mainly dry and clear, with some light rain at the beginning of the survey. This short spell of precipitation has been removed from the subsequent analysis.

4.2.2 The temperature ranged from 12 to 24°C. Average wind speeds remained below 3 ms<sup>-1</sup>.

#### 4.3 Results

4.3.1 The results of the continuous noise monitoring survey are presented in graphical form in Figure A1 of Appendix A and summarised in Table 4.2.

4.3.2 The L<sub>A90</sub> background noise level has been derived considering the most commonly occurring 1 hour period during the day and 15 minute period at night, whilst the L<sub>Amax,F</sub> maximum noise level is the 90<sup>th</sup> percentile of the measured maximum noise levels.

Time period	Measured Noise Levels (dB re 2.0 x 10 <sup>-5</sup> Pa)		
	L <sub>Amax,F</sub>	L <sub>Aeq,T</sub>	Typical L <sub>A90,T</sub>
<b>Daytime (07:00 – 23:00)</b>	70	53	50
<b>Night time (23:00 – 07:00)</b>	63	52	49

TABLE 4.2: SUMMARY OF UNATTENDED NOISE MEASUREMENTS, LT1

## 5. PLANT NOISE ASSESSMENT

### 5.1 Noise Rating Limit

5.1.1 The table below presents the maximum noise rating level which must not be exceeded at the noise sensitive receptor.

Measurement Period	Assessed Background Noise Level dB L <sub>A90</sub>	Noise Rating Level Design Criteria	Plant Noise Rating Level dB L <sub>Ar,Tr</sub>
24 hour	49	5dB below the background noise level	44

TABLE 5.1: TARGET BACKGROUND NOISE LEVEL

### 5.2 Plant Noise Levels

5.2.1 It is proposed to install the following plant at the civic centre:

- Ground level Goods-in - 2x 440 ThermoNovas and 2x 330 ThermoNovas
- Lower Roof - 1x 440 ThermoNovas
- Upper Roof – 1x 440 ThermoNovas and 1 x 220 ThermoNova
- Middlesex suite Phase 2A - 2x 220 ThermoNovas

5.2.2 The above plant has the following manufacturer measured noise levels, at 5m.

Plant	Manufacturer Noise Level at 5m, dB(A)
440 ThermoNova	47
330 ThermoNova	46
220 ThermoNova	45

TABLE 5.2: PLANT NOISE LEVELS

### 5.3 Calculated Noise Levels

5.3.1 Table 5.3 provides a summary of the calculated plant noise at the nearest receptor, Lovell House. The calculation sheets are presented in Appendix B.

Property	Assessment Period	Target Plant Noise Rating Level dB $L_{Ar,Tr}$	Plant Specific Sound Level dB $L_{Aeq,Tr}$	Actual Noise Rating Level dB $L_{Ar,Tr}$
Lovell House	24 hour	44	32	32

**TABLE 5.3: PREDICTED NOISE AT NEAREST RESIDENTIAL RECEPTORS**

5.3.2 No correction factors have been added in accordance with BS4142:2014. There are no tones or other acoustic characteristics present from the proposed plant.

5.3.3 As per the semantics of BS4142:2014, the assessment indicates little likelihood of adverse impact. The proposed plant meets the London Borough of Hillingdon's requirement that the plant is 5dB below the background noise level at the nearest residential receptor.

## 6. CONCLUSION

- 6.1.1 Ameresco has commissioned AF Acoustics Ltd. to undertake a plant noise assessment for the proposed installation of a number of air to water heat pumps at the Hillingdon Civic Centre.
- 6.1.2 A noise survey was undertaken at the civic centre in a representative position to the nearest residential receptor. The representative noise levels measured at this location was used to establish the prevailing environmental noise climate.
- 6.1.3 Plant noise emission criteria have been set at the nearest receptor based on the results of the noise survey and in conjunction with the national guidance.
- 6.1.4 Noise calculations based on the plant data have been undertaken to the nearest noise sensitive receptor.
- 6.1.5 The results of the assessment have been used to assess the impact of noise from the proposed plant to the nearest noise sensitive receptor.
- 6.1.6 As per the semantics of BS4142:2014, the assessment indicates little likelihood of adverse impact. The proposed plant meets the London Borough of Hillingdon's requirement that the plant is 5dB below the background noise level at the nearest residential receptor.

**AF Acoustics**

## APPENDIX A: FIGURES

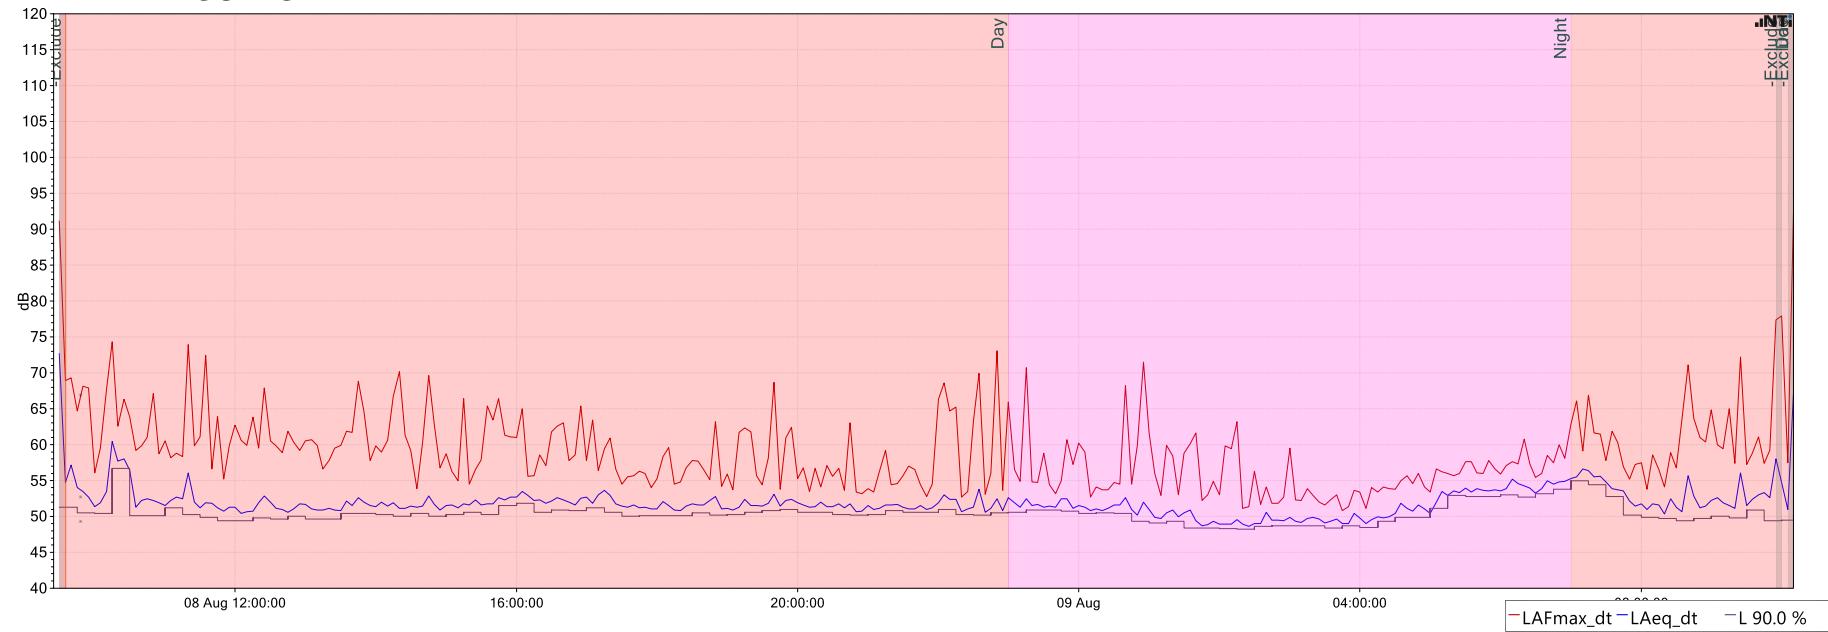


FIGURE A1: NOISE MEASUREMENT RESULTS AT HILLINGDON CIVIC CENTRE

## APPENDIX B: TABLES



Job No.	Job Title		
1951	Hillingdon Civic Centre		
Date Created	By	Date Revised	Rev
22 Aug 2023	AF	25 Aug 2023	16
Date Reviewed	By	Review Type	Review Status
25-Aug-23	AF	Self Check	No Comments

### Plant Calculations - Hillingdon Civic Centre

Item / Description	Rating/Broadband/Input	Octave Band Centre Frequency, Hz							31.5	63	125	250	500	1k	2k	4k	8k
		Rating	dB	dB(A)	31.5	63	125	250	500	1k	2k	4k	8k				
<b>Ground level Goods in</b>																	
‡ 440 ThermoNovas	SPL at 5m												47.0				
‡ 440 ThermoNovas	SPL at 5m												47.0				
‡ 330 ThermoNovas	SPL at 5m												46.0				
‡ 330 ThermoNovas	SPL at 5m												46.0				
= <b>Logarithmic Sum</b>													<b>52.5</b>				
No line of sight to nearest receptor													-10.0				
Ratio of Distances - Point Source		5.0 m		32.0 m									-16.1				
<b>Noise from plant at nearest residential receptor</b>													<b>26.4</b>				
<b>Lower Roof</b>																	
440 ThermoNovas	SPL at 5m												47.0				
Ratio of Distances - Point Source		5.0 m		44.0 m									-18.9				
<b>Noise from plant at nearest residential receptor</b>													<b>28.1</b>				
<b>Upper Roof</b>																	
440 ThermoNovas	SPL at 5m												47.0				
220 ThermoNova	SPL at 5m												45.0				
= <b>Logarithmic Sum</b>													<b>49.1</b>				
‡ Ratio of Distances - Point Source		5.0 m		90.0 m									-25.1				
<b>‡ Noise from plant at nearest residential receptor</b>													<b>24.0</b>				
<b>Middlesex suite Phase 2A roof</b>																	
220 ThermoNova	SPL at 5m												45.0				
220 ThermoNova	SPL at 5m												45.0				
<b>Logarithmic Sum</b>													<b>48.0</b>				
Ratio of Distances - Point Source		5.0 m		90.0 m									-25.1				
<b>Noise from plant at nearest residential receptor</b>													<b>22.9</b>				
= <b>Total Noise level at nearest residential receptor</b>													<b>32</b>				

**TABLE B1: PLANT CALCULATIONS**

## APPENDIX C: TERMINOLOGY RELATING TO NOISE

<b>Sound Pressure</b>	Sound, or sound pressure, is a fluctuation in air pressure over the static ambient pressure.
<b>Sound Pressure Level</b>	The sound level is the sound pressure relative to a standard reference pressure of $20\mu\text{Pa}$ ( $20 \times 10^{-6}$ Pascals) on a decibel scale.
<b>Sound Power Level (Lw)</b>	is the total amount of sound energy inherent in a particular sound source, independent of its environment. It is a logarithmic measure of the sound power in comparison to a specified reference level (usually $10^{-12}$ W).
<b>Decibel (dB)</b>	A scale for comparing the ratios of two quantities, including sound pressure and sound power. The difference in level between two sounds $s_1$ and $s_2$ is given by $20 \log_{10} (s_1 / s_2)$ . The decibel can also be used to measure absolute quantities by specifying a reference value that fixes one point on the scale. For sound pressure, the reference value is $20\mu\text{Pa}$ .
<b>A-weighting, dB(A)</b>	The unit of sound level, weighted according to the A-scale, which takes into account the increased sensitivity of the human ear at some frequencies.
$L_{\text{Aeq},T}$	Equivalent continuous A-weighted sound pressure level. The value of the A-weighted sound pressure level of a continuous steady sound that, within a measurement time interval T, has the same A-weighted sound energy as the actual time-varying sound
$L_{90,T}$	$L_{90}$ is the noise level exceeded for 90% of the period T (i.e. the quietest 10% of the measurement) and is often used to describe the background noise level.
$L_{\text{max},T}$	A noise level index defined as the maximum noise level during the period T. $L_{\text{max}}$ is sometimes used for the assessment of occasional loud noises, which may have little effect on the overall $L_{\text{eq}}$ noise level but will still affect the noise environment. Unless described otherwise, it is measured using the 'fast' sound level meter response.
<b>Specific Noise</b>	The noise source under investigation for assessing the likelihood of complaints.
<b>Rating Level</b>	The specific noise level plus any adjustment for the characteristic features of the noise.
<b>Free field</b>	Far from the presence of sound reflecting objects (except the ground), usually taken to mean at least 3.5m.
<b>Façade</b>	At a distance of 1m in front of a large sound reflecting object such as a building façade.

## APPENDIX D: LIMITATIONS TO THE REPORT

This report has been prepared for the titled project or named part thereof and should not be used in whole or part and relied upon for any other project without the written authorisation of AF Acoustics Ltd. AF Acoustics Ltd accepts no responsibility or liability for the consequences of this document if it is used for a purpose other than that for which it was commissioned. Persons wishing to use or rely upon this report for other purposes must seek written authority to do so from the owner of this report and/or AF Acoustics Ltd and agree to indemnify AF Acoustics Ltd for any and all loss or damage resulting therefrom. AF Acoustics Ltd accepts no responsibility or liability for this document to any other party other than the person by whom it was commissioned.

The findings and opinions expressed are relevant to the dates of the site works and should not be relied upon to represent conditions at substantially later dates. Opinions included therein are based on information gathered during the study and from our experience. If additional information becomes available which may affect our comments, conclusions or recommendations AF Acoustics Ltd reserves the right to review the information, reassess any new potential concerns and modify our opinions accordingly.