


NOTES:
All dimensions must be checked on site and not scaled from this drawing.

Contractor to expose existing foundations prior to commencement to confirm adequacy to the satisfaction of the Local Authority.


Contractor to expose existing lintels over 1st floor rear windows to confirm adequacy, if found to be inadequate then provide 152 x 89 x 16kg/UB to inner leaf.

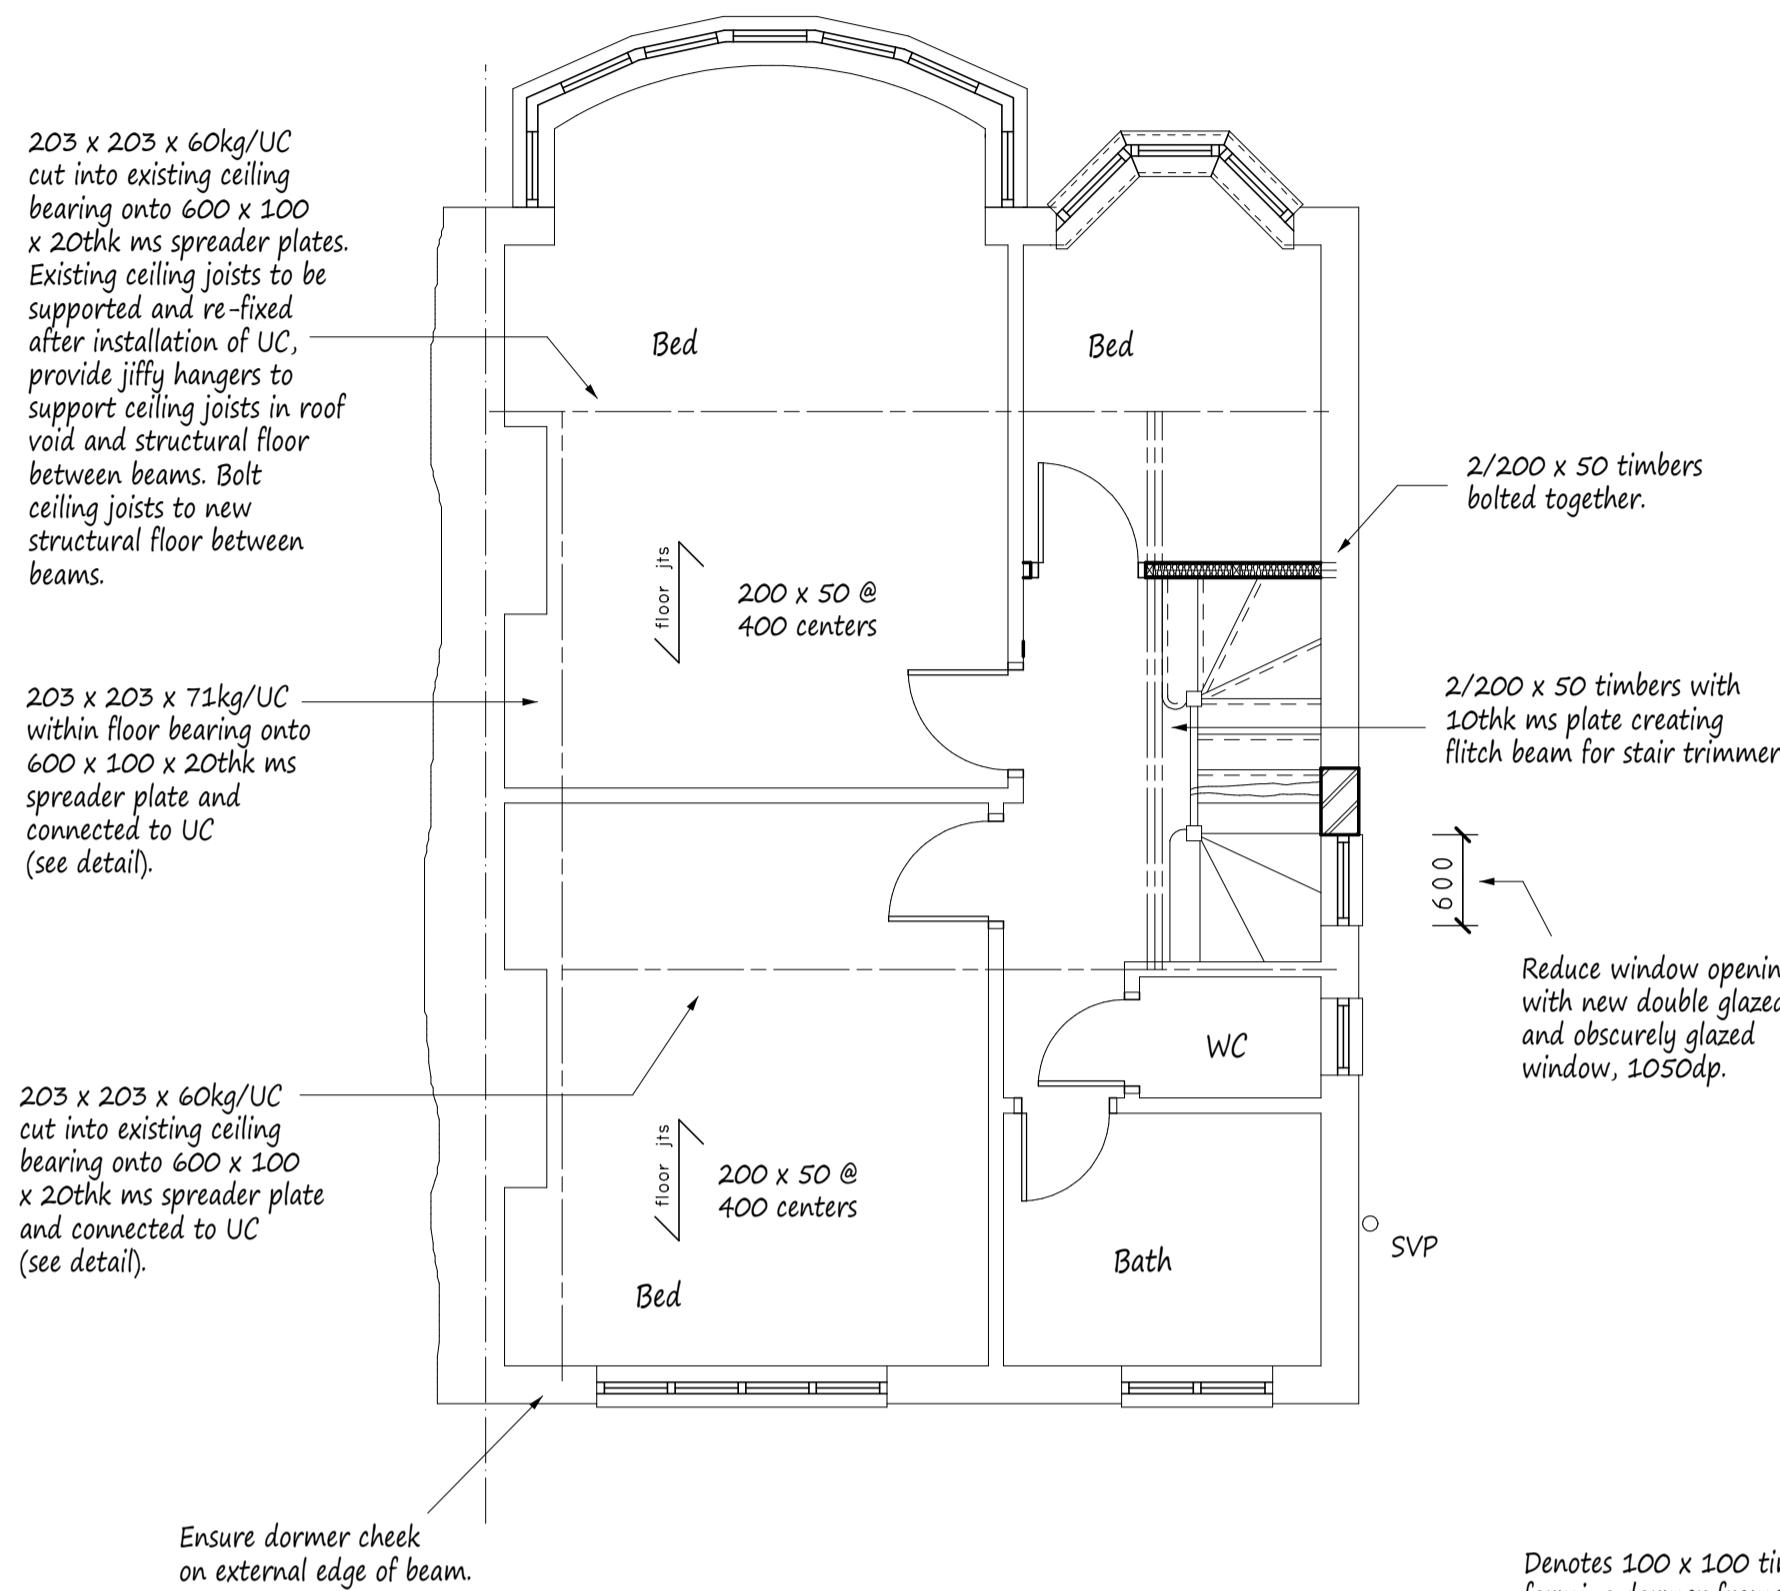

Proposed First Floor Plan

This drawing to be read in conjunction with Drg No 4397/03


Proposed Elevations - All Materials to Match Existing

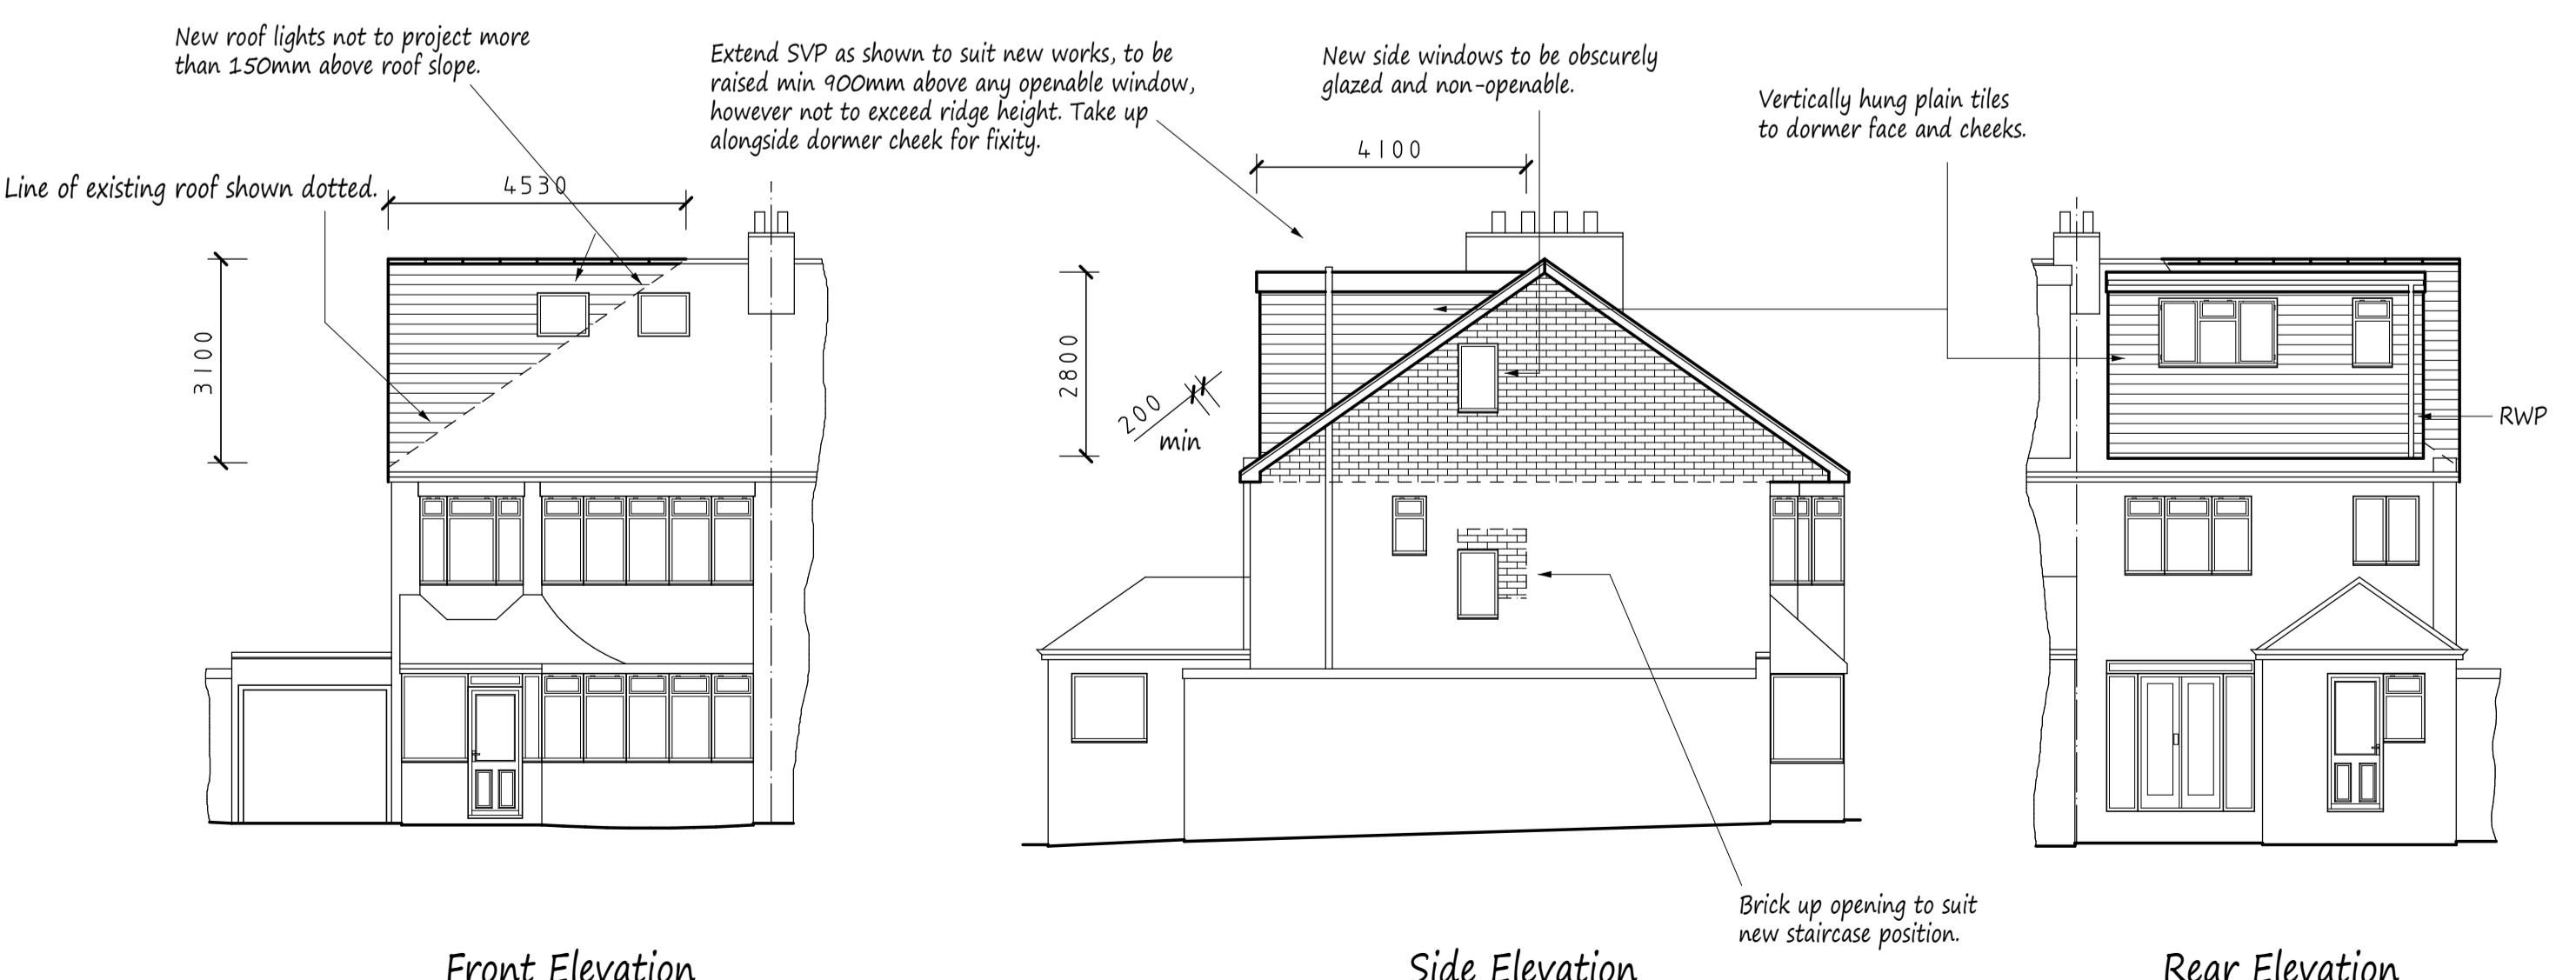


Front Elevation

Side Elevation

Rear Elevation

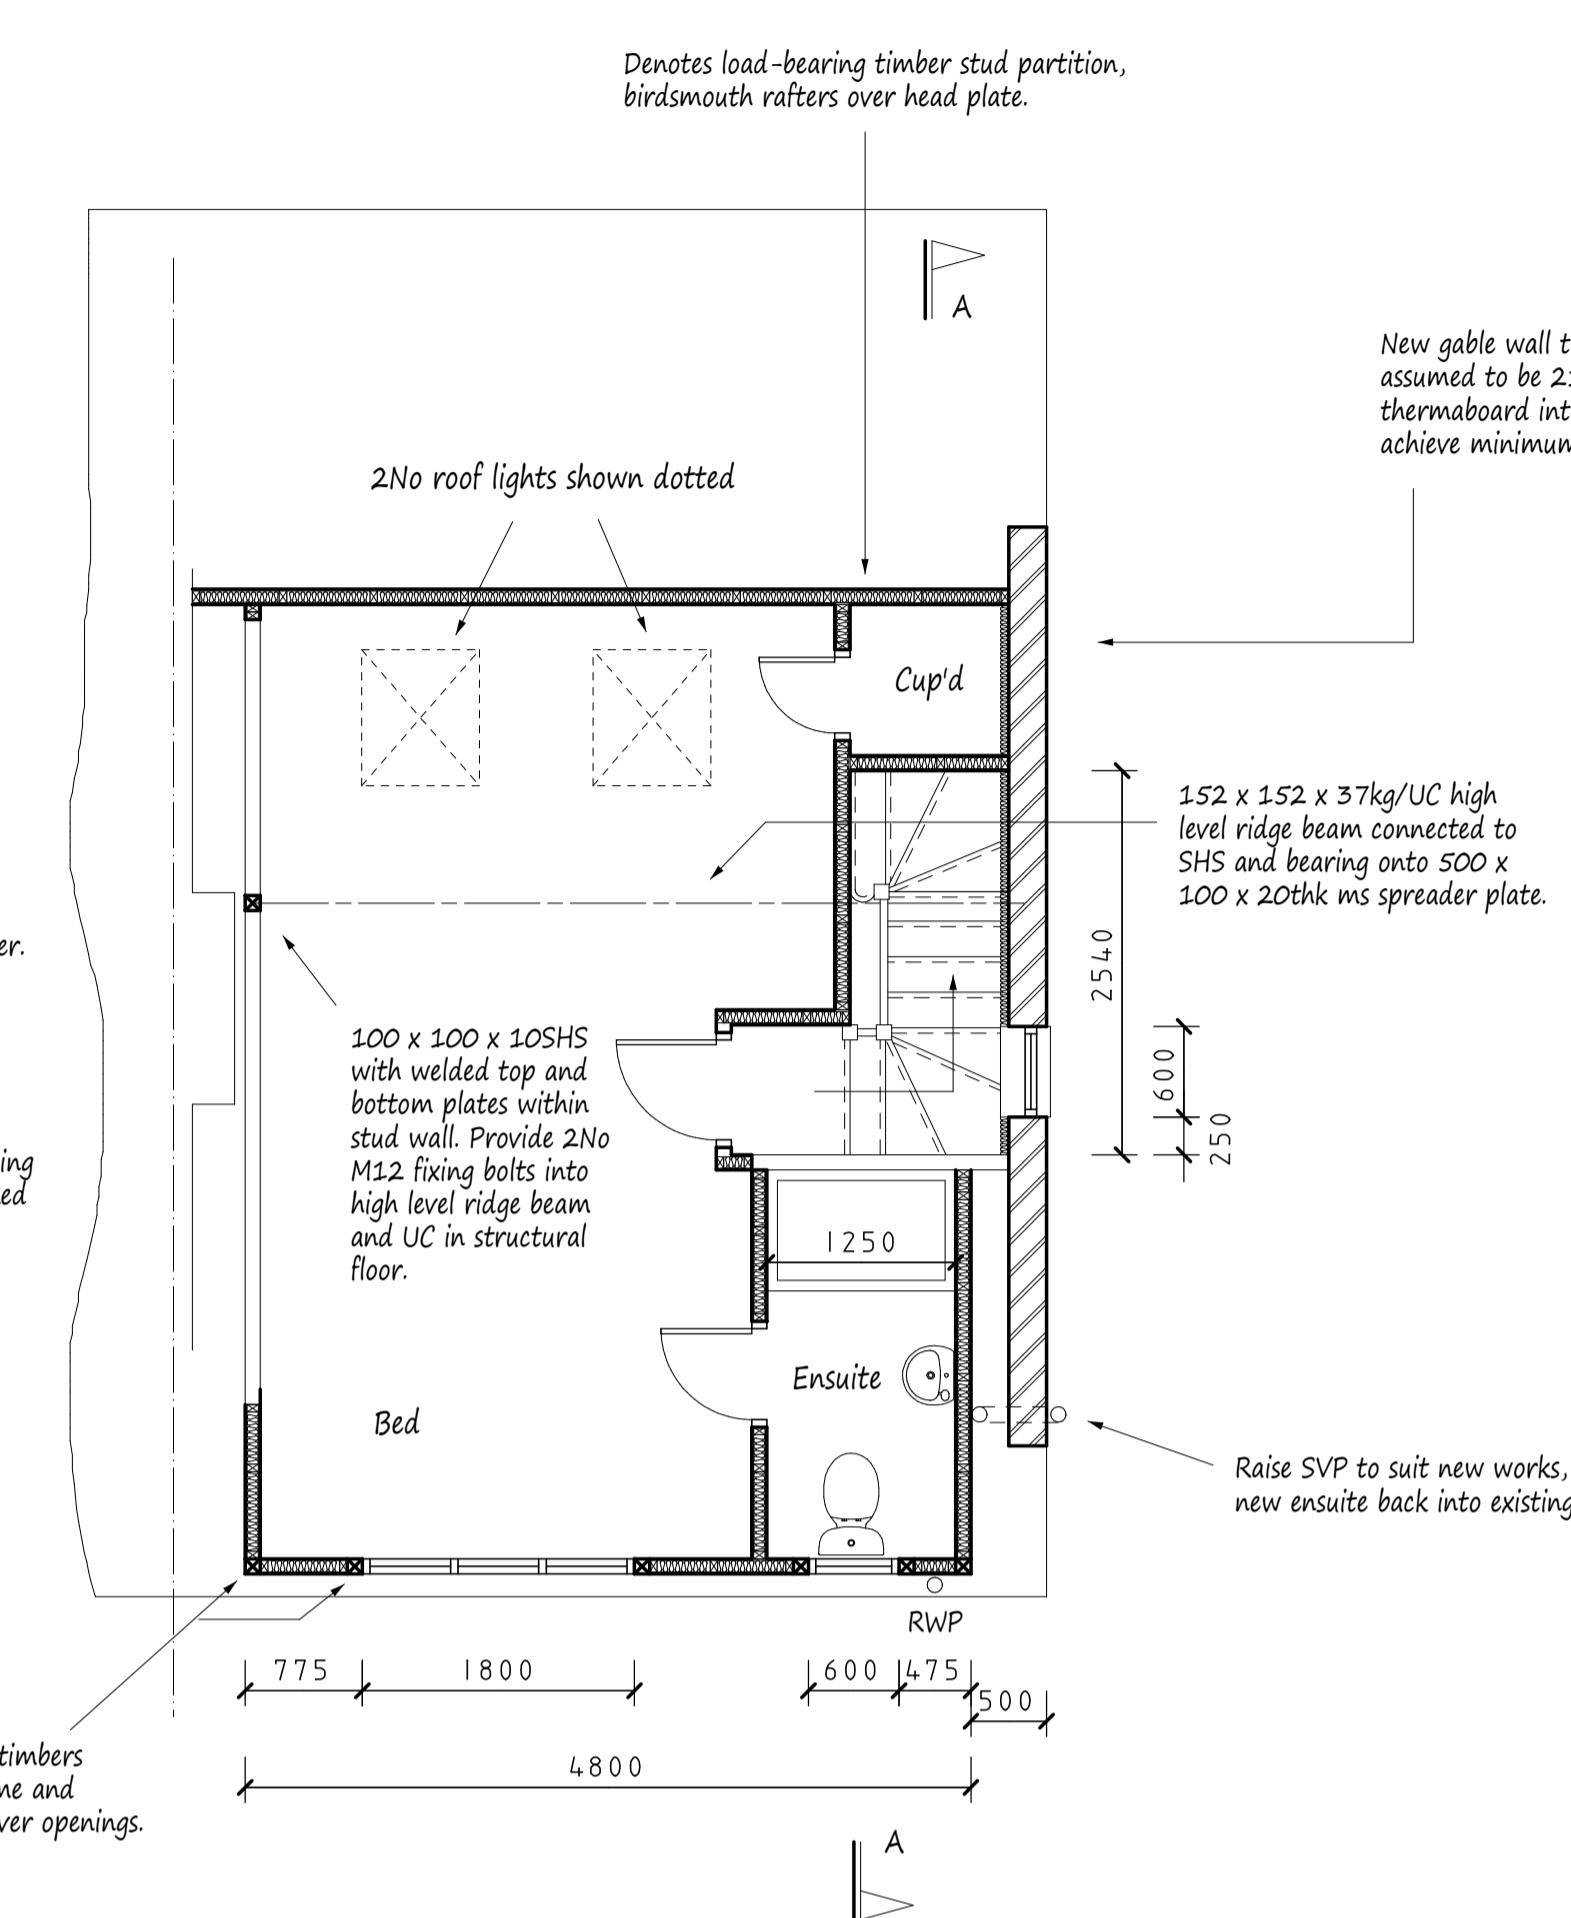

Proposed Second Floor Plan

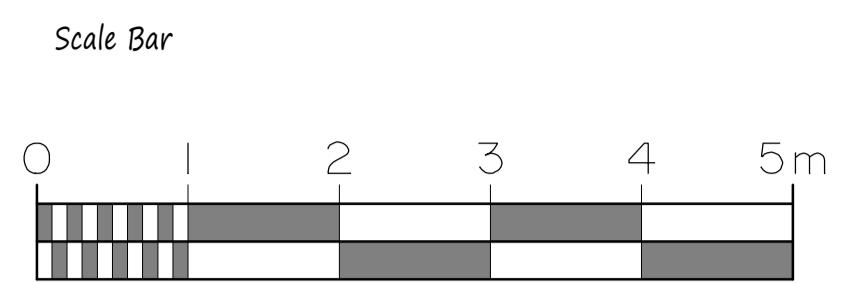

Scale Bar

New gable wall to be constructed as existing wall below, assumed to be 235kN brickwork, provide 65mm thermaboard internally on dabs and skim to finish to achieve minimum U-Value requirements.

Provide mains operated inter-connected smoke alarms to circulating areas at ground, 1st and 2nd floor ceiling levels, all with battery back up. Provide heat detector to kitchen linked with smoke alarms.

Steel beams to be encased in 2/12mm sheets of plasterboard and skim or use fire resistant paint to achieve necessary fire protection.


New roof lights to be A-A fire rated and installed to manufacturers requirements. Double up and bolt together rafters each side of roof light with M12 bolts @ 500 centers.

New ensuite to have mechanical ventilation to open air, min 30l/s.

All doors off staircase enclosure at ground, 1st and 2nd floors to be half hour fire resistant onto 25 x 35 glued and screwed stops. All walls enclosing staircase to be half hour fire resistant and all doors to have 3No fire hinges. Underlying areas of staircase to be half hour fire protected.

Surface water to be taken back to existing outlets.

Raise SVP to suit new works, taking waste from new ensuite back into existing system.

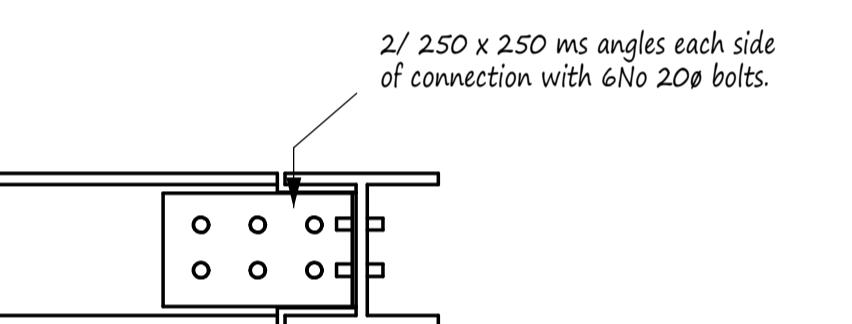


Connection Detail (typical)

Dormer checks
100 x 50 timbers @ 400 centers, 10mm external quality ply with 9mm supalux boarding internally and externally, 1 layer felt, 38 x 19 sw battens and vertical hung plain tiles to finish. 100 celotex insulation, 47mm thermaboard internally and skim. Dormer checks to be constructed off 3No rafters bolted together with M12 bolts @ 500 centers.

Provide 3No high level vent tiles as close to ridge as realistically possible.

'Warm Deck' roof construction - see enclosed specification sheet. 175mm x 75mm flat roof joists with solid noggins mid span due to span of timbers, 12mm plasterboard and skim.

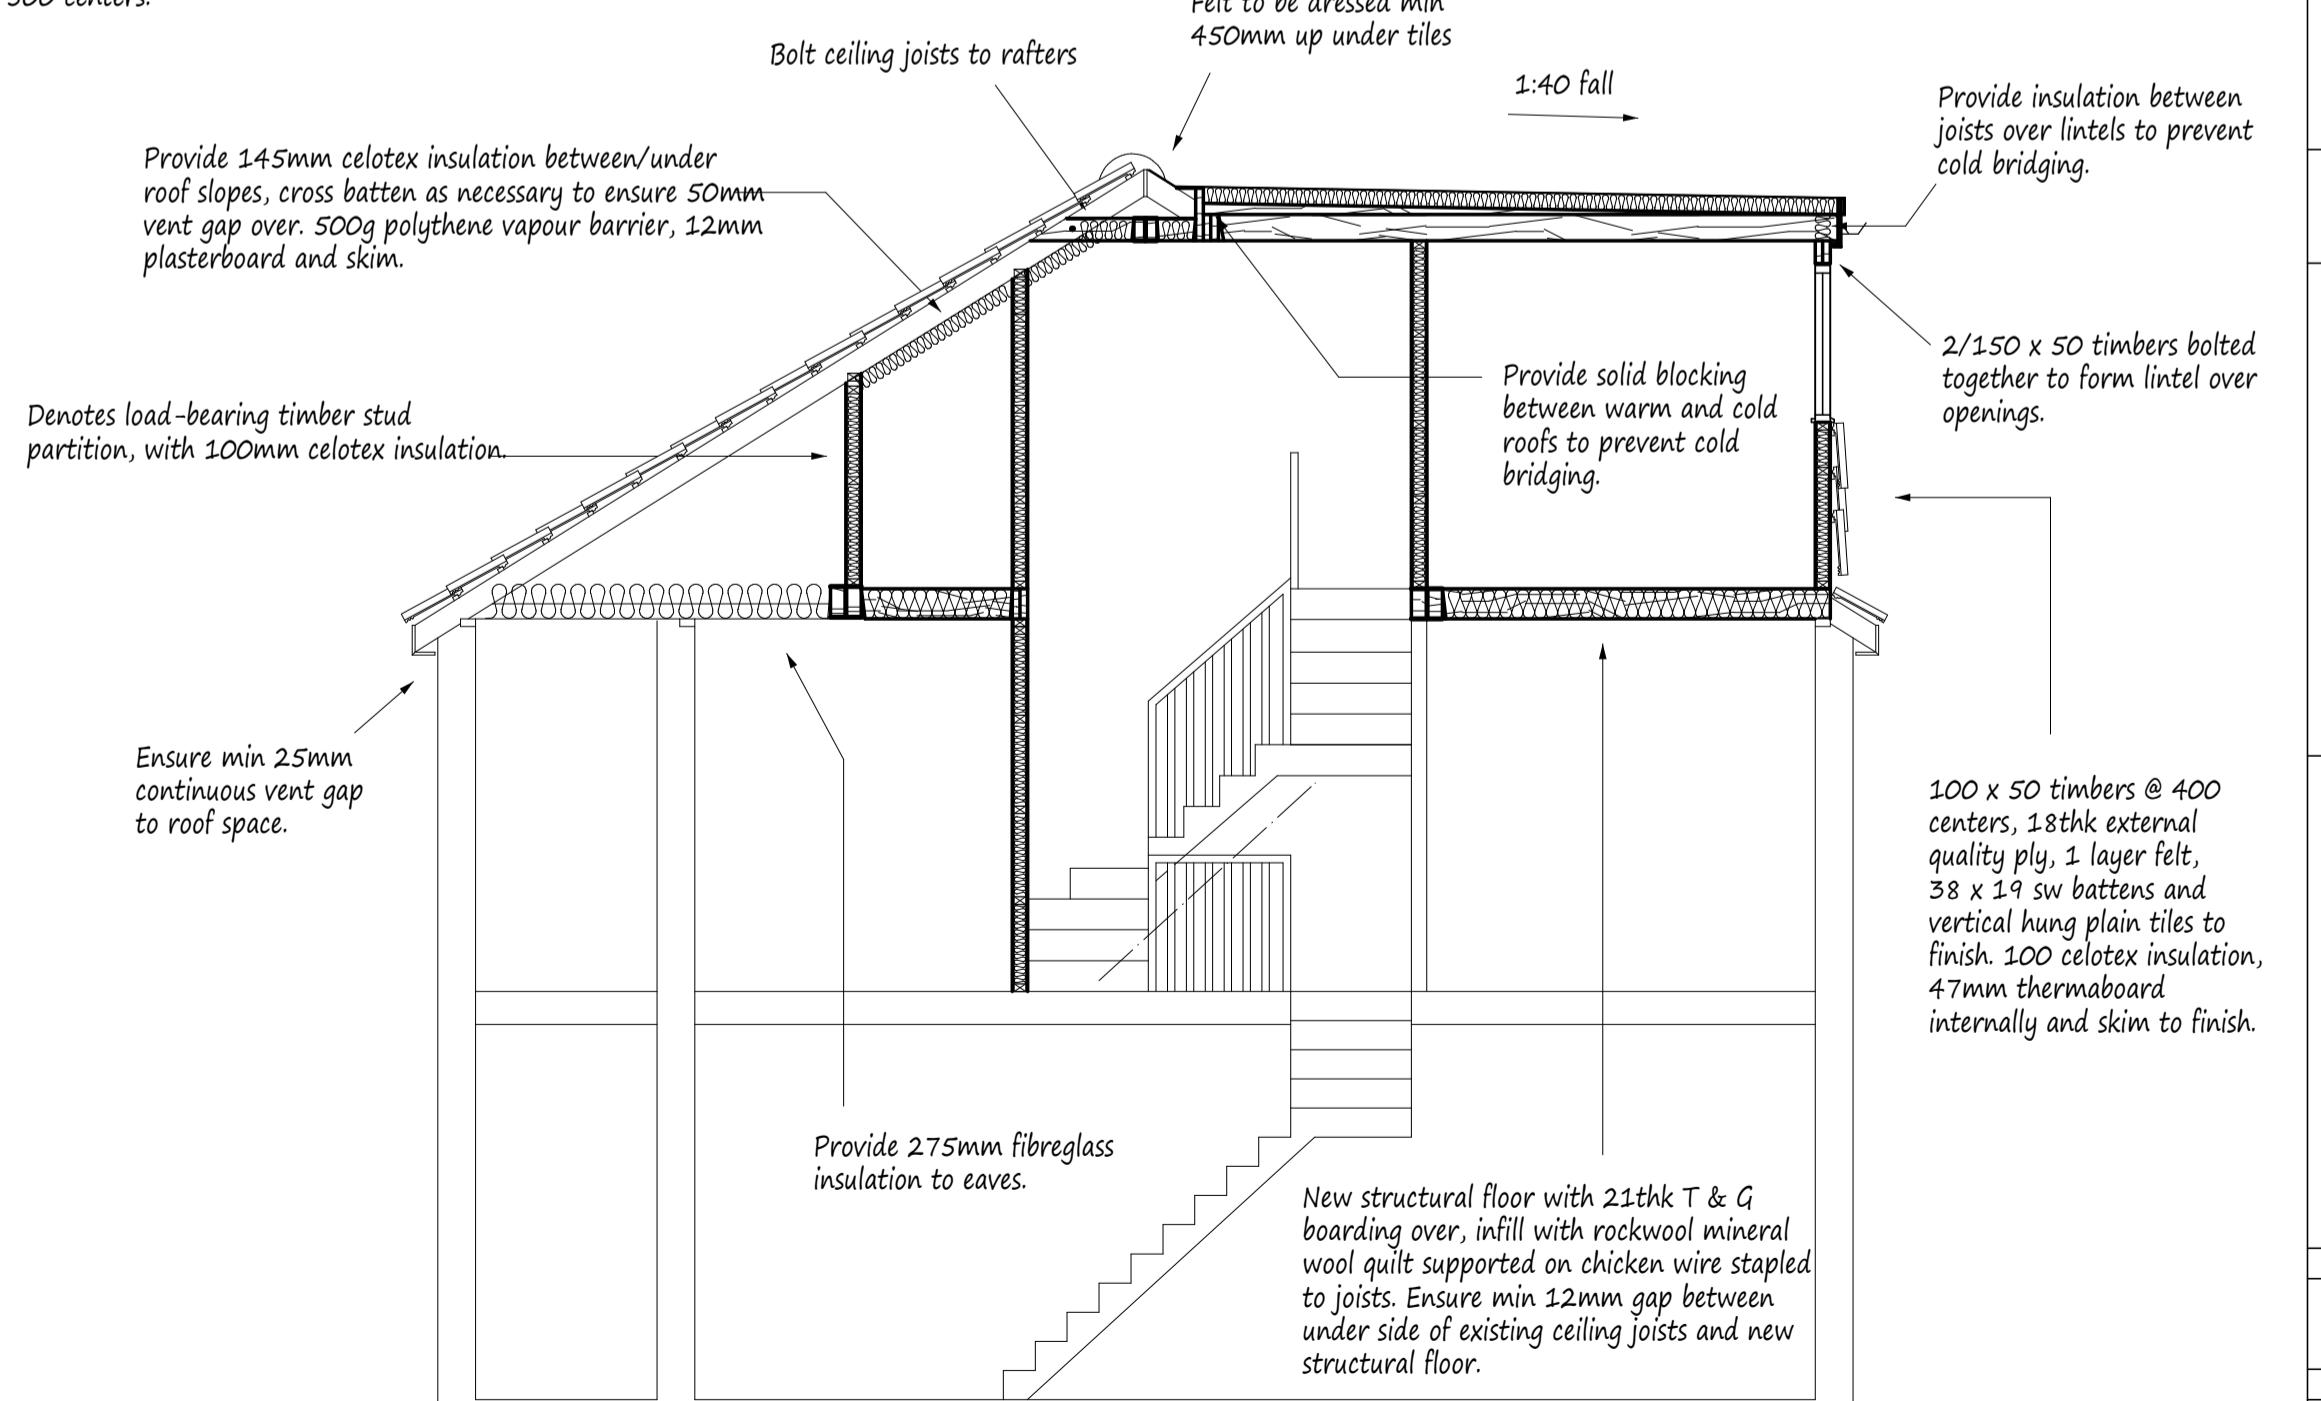

Section A-A

Proposed gable = 21.5 cubic meters
Proposed dormer = 2.76 cubic meters
Total Development = 49.1 cubic meters

A Date Revisions

Copyright
Pottle & Co Ltd.
Building Design &
Management Services

Suite A
128 Manor Way
Ruislip
Middlesex
HA4 8HR

Tel: 01895 622800
www.pottle.uk.com

Client
Mr & Mrs O'Toole

Job Title
38 Eversley Crescent
Ruislip
Middlesex

Drawing Title
Proposed Loft Conversion.

Scale
1:50. 100

Date
June 2020
Drawn by
MPP

Drg No.
4397/04

- All dimensions are in millimetres.
- Vertical dimensions are 1/20 floor levels (mm).
- Lintels have a minimum of 150mm end bearings.
- New habitable rooms to have background ventilation of at least 800mm² i.e. trickle vent or air brick.
- New stud partitions to be constructed of 100 x 50 timbers, infill with rockwool mineral wool quilt, 2 x 12mm sheets of plasterboard and skim. Partitions to be constructed off doubled up floor joists bolted together with M12 bolts at 500 centres.
- New windows to be double glazed and achieve a 'U' value of 1.6W/m² i.e. 16mm spacer with low E glass to inner pane.
- Staircase: 13 No of Equal Risers @ 207mm Max 42 degree pitch, min 200mm clear headroom height. Min 900mm finished floor level to handrail/stair nosing. Max 100mm centres balustrading. Min 50mm tread to winder box. Staircase manufacturer to visit site to confirm the above.
- Provide code 4 lead flashing and soakers to dormer at junction of main roof.
- Plumbing: Waste pipe sizes. Sink - 38mm diameter. Bath - 38mm diameter. Wash basin - 32mm diameter. All waste deep seal traps. All plumbing to be to BS 5572:1978.
- 75% light fittings to be capable of taking a lamp having a luminous efficiency greater than 40 lumens/circuit watt.
- All electrical work to be designed and installed, inspected and tested in accordance with the requirements of BS 7671, the IEE 17th edition wiring guidance and Building Regulation Part P (electrical safety) by a competent person with a self-certification scheme authorised by the secretary of state (BRE, BSI, ELECSA, NAPIT, or NICEIC).
- Thermostatic rad valves to be provided to the extension of existing heating, extend existing hot and cold water supplies to new works with thermostatic mixing valves.