

SITE PLAN - EXCERPT FROM  
21\_079-SGP-XX-ZZ-DR-A-201101-C09

21 No STUD CAGES TO BE INSTALLED AT CENTRES SHOWN.  
ENSURE ALL BOLTS ARE IN LINE PARALLEL TO EDGE OF CONCRETE

Existing Cycle Shelter

Proposed substation

INSIDE


REDUCED POST CENTRES AT ENDS OF RUN  
BAY 1 & BAY 2 AT EITHER END



SEE DETAIL SHEET 3

1168 1168 2410 14 @ 2410 = 33740 2360 1168 1168  
43398 OVERALL FENCE LENGTH  
43830 concrete

POSTS GENERALLY INSTALLED AT 2.41m MAXIMUM CENTRES  
ANY ADJUSTMENTS TO LENGTH TO BE MADE IN BAY 3

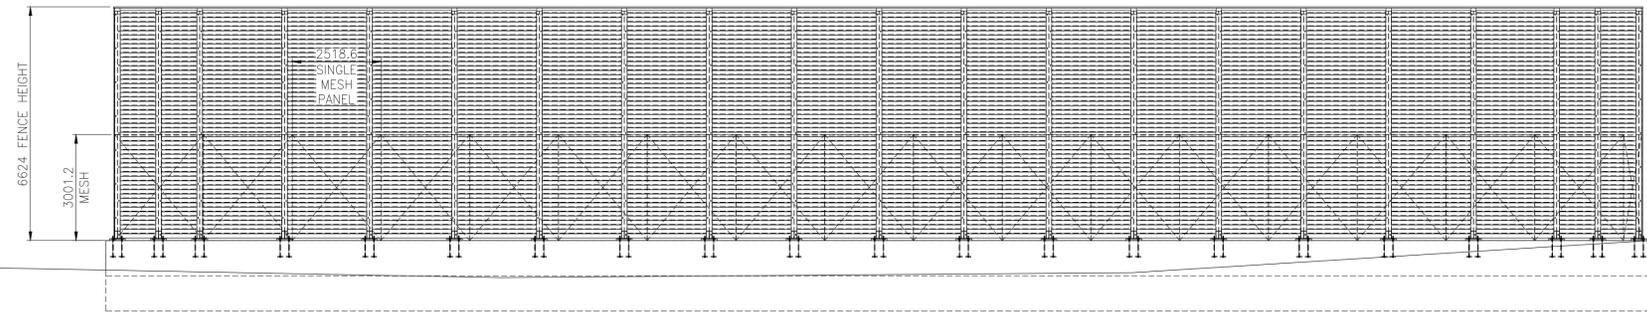

VIEWED FROM OUTSIDE