





Schedule										
Symbol	Label	Image	Quantity	Manufacturer	Catalog Number	Description	Number Lamps	Lumens Per Lamp	Light Loss Factor	Wattage
	EX1		15	HOLOPHANE EUROPE LIMITED	DWL.1.LA014.NR.W007	Denver ID Wall c/w 3 Hour Emergency Building Mounted @ 4m FGL (FGL - Finished Ground Level, to be measured from FGL to underside of luminaire)	1	913	0.9	6.5
	EX2		4	HOLOPHANE EUROPE LIMITED	DSX0.1.LA064.SY	D-Series 0 Area luminaire Lighting Column Mounted EX2-1, EX2-2 & EX2-3 @ 6m FGL EX2-4 @ 8m FGL	1	6109	0.9	45
	EX3		4	HOLOPHANE EUROPE LIMITED	DSX0.1.LA084.FW.BLS	D-Series 0 Area luminaire Lighting Column Mounted @ 6m FGL	1	6265	0.9	64
	EX4		6	HOLOPHANE EUROPE LIMITED	DSX1.2.LA114.AY.BLS	D-Series 1 Luminaire with Back Light Shield Building Mounted @ 8m FGL	1	9898	0.9	105
	EX5		8	HOLOPHANE EUROPE LIMITED	DSX2.2.LA304.FW	D-Series 2 Luminaire Building Mounted @ 8m FGL	1	33388	0.9	282
	EX6		4	HOLOPHANE EUROPE LIMITED	DSX1.2.LA114.FW.BLS	D-Series 1 Luminaire with Back Light Shield Lighting Column Mounted @ 8m FGL	1	9818	0.9	105
	EX7		5	HOLOPHANE EUROPE LIMITED	DWL.1.LA034.FW.W018	Denver ID Wall Building Mounted at @ 4m FGL	1	2489	1	18

Statistics					
Description	Symbol	Avg	Max	Min	Min/Avg
Access Rd [20/0.40]		20 lux	35 lux	8 lux	0.40
Car Park [10/0.40]		14 lux	28 lux	6 lux	0.43
DDA [20/0.40]		20 lux	28 lux	12 lux	0.60
Loading 50/0.40]		56 lux	83 lux	39 lux	0.70
Perimeter [5/0.25]		10 lux	32 lux	3 lux	0.30
Service Yard [30/0.40]		36 lux	83 lux	15 lux	0.42
SPILL		2 lux	80 lux	0 lux	0.00
Calc Zone #6		11 lux	14 lux	8 lux	0.73

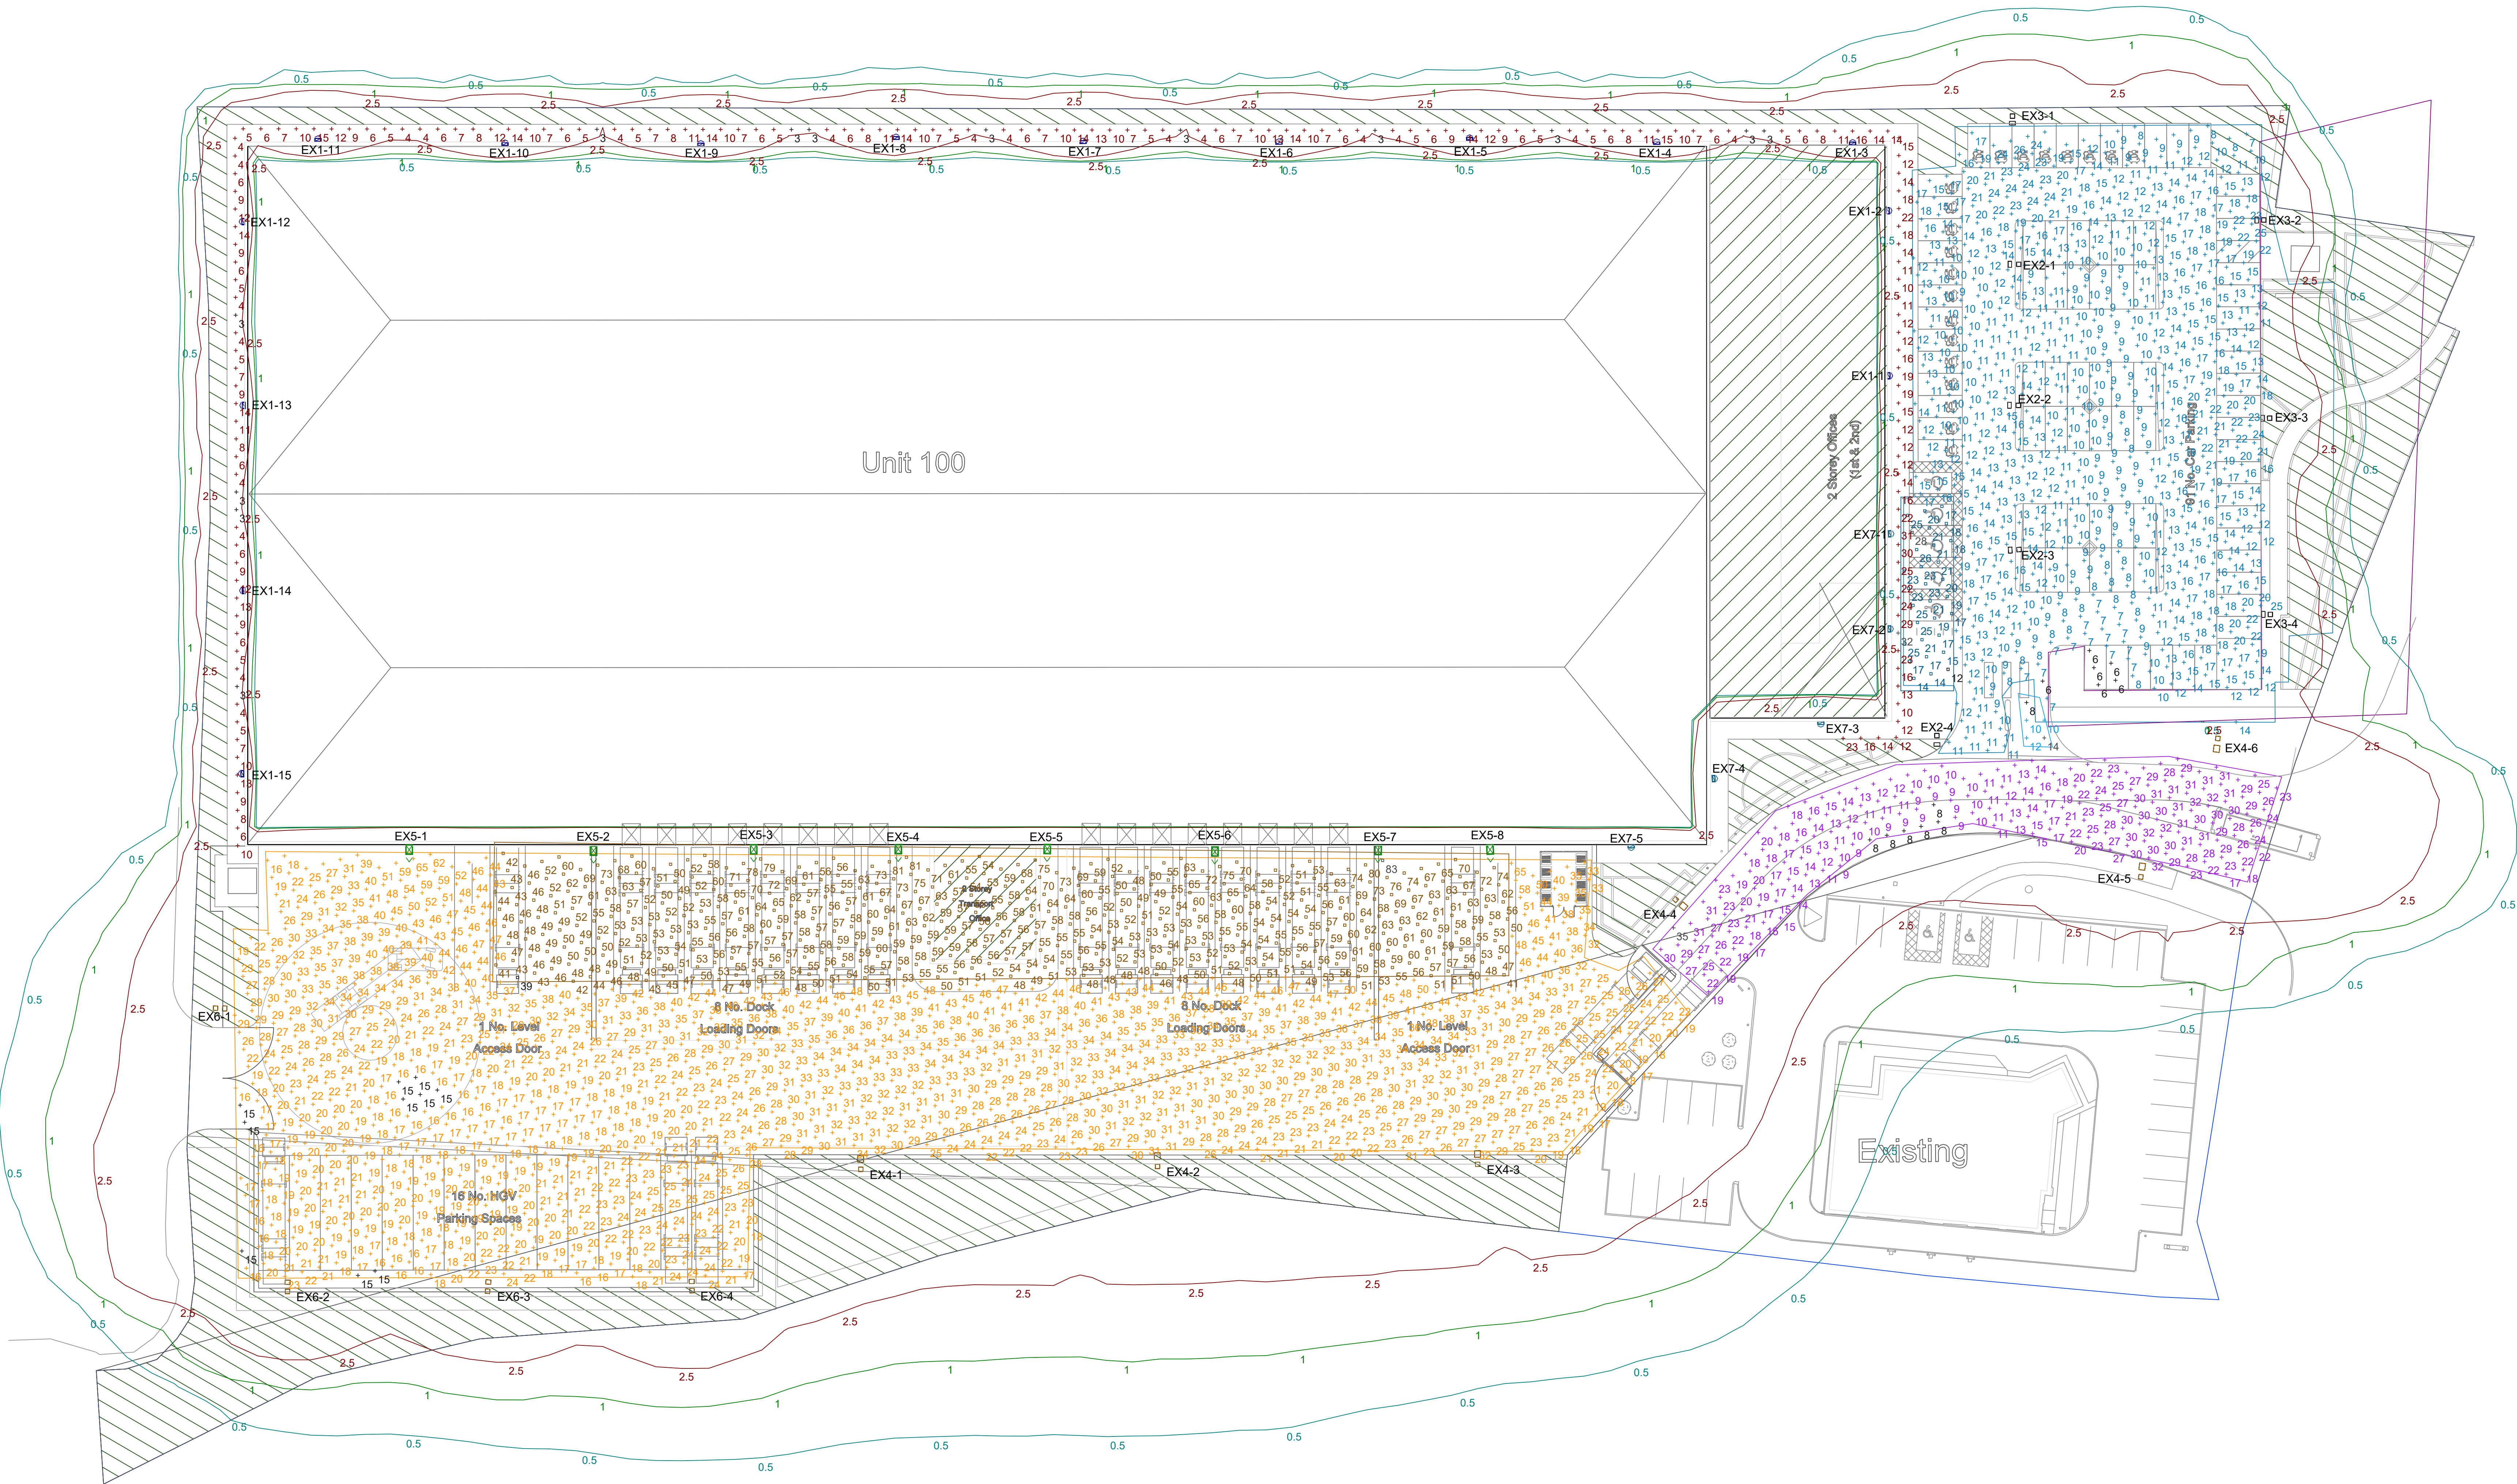

REV	DATE	DRAWN	REVISION NOTES	CHK
0	28.09.23	ZK	PLANNING ISSUE	AW
1				

PLEASE NOTE:

- THIS DRAWING IS COPYRIGHT AND MAY NOT BE ALTERED WITHOUT WRITTEN PERMISSION.
- THIS DRAWING HAS BEEN PREPARED IN ACCORDANCE WITH THE SCOPE OF BRIAR'S APPOINTMENT WITH THEIR CLIENT AND IS SUBJECT TO THE TERMS AND CONDITIONS OF THAT APPOINTMENT. BRIAR ACCEPTS NO LIABILITY FOR ANY USE OF THIS DOCUMENT OTHER THAN BY THEIR CLIENT AND ONLY FOR THE PURPOSES FOR WHICH IT WAS PREPARED AND PROVIDED.
- IF RECEIVED ELECTRONICALLY IT IS THE RECIPIENT'S RESPONSIBILITY TO PRINT TO CORRECT SCALE. ONLY WRITTEN DIMENSIONS SHOULD BE USED.
- ALL DIMENSIONS ARE IN MILLIMETERS UNLESS NOTED AND/OR SPECIFIED OTHERWISE. DO NOT SCALE FROM THIS DRAWING. ALL DIMENSIONS ARE TO BE CONFIRMED ON SITE DURING CONSTRUCTION.
- THIS DRAWING SHOULD BE READ IN CONJUNCTION WITH ALL OTHER DRAWINGS AND SPECIFICATIONS ASSOCIATED WITH THIS PROJECT.
- CONTACT ADDRESS: CAPTAIN HOUSE THE WATERFRONT, BRIERLEY HILL, WEST MIDLANDS, DY5 1XL.

briar
part of the **zenergi** family
Captain House, The Waterfront, Briarley Hill, West Midlands, DY5 1XL.
Tel: 0184 397777
Email: info@briarzenergi.co.uk
Web: www.briarzenergi.co.uk

CLIENT:

BRIDGEWATER RETAIL PARK, HAYES

DRAWING:

PROPOSED EXTERNAL LIGHTING ISOLUX SPILL LAYOUT

JOB:

BD1497

STATUS:

P

SCALE:

1:300

REVISION:

0

PAPER SIZE:

A0

DWG REF:

E001