



## Specification & EMAQ Report

---

**Project Name** Sui generis

106 Cowley Rd, Uxbridge UB8 2LX

**Prepared for:** Masih Taher

**Prepared by:** Nathan Collins

**Date:** 15/11/24

**Contact details:**

Nathan Collins

01708 755 414

[nathan.collins@purifiedair.com](mailto:nathan.collins@purifiedair.com)

**AIR FILTRATION  
EXPERTS**



**MARKET LEADERS  
S I N C E  
1984**

# CONTENTS

---

CONTENTS .....	2
INTRODUCTION .....	3
TECHNICAL SPECIFICATIONS (per unit) .....	<b>Error! Bookmark not defined.</b>
TECHNICAL DRAWINGS.....	9

# INTRODUCTION

---

## Interpretation of Requirements

Following our conversation today I am pleased to provide an equipment selection for an odour control solution.

As with any project we get involved in we always recommend to our clients that they should closely follow the EMAQ guide for guidance on odour control equipment selection.

This ensures that what they propose will be in line with local authority's requirements and if the system is maintained correctly they will not exhaust nuisance odours leading to complaints from nearby residents.

With this in mind I carried out a risk assessment as detailed in Appendix 3 of the EMAQ Guide.

Taking into consideration the level of discharge, proximity of receptors, size of kitchen and cooking type your project requires a high level of odour control to comply. The equipment has been specified under the assumption of the airflow being 1.12m<sup>3</sup>/s.

We have scored as below and as taken from Appendix 3: Risk Assessment for Odour;

Risk	Score
Dispersions	10
Proximity Of Receptors	10
Size Of Kitchen	01
Cooking Type	04
Total Score	25

The type of odour abatement system that complies is as below, taken directly from the EMAQ Guide and must be to a high level of control;

## Odour arrestment plant performance

High level odour control may include:

1. Fine filtration or ESP followed by carbon filtration (carbon filters rated with a 0.2 – 0.4 second residence time).
2. Fine filtration or ESP followed by UV ozone system to achieve the same level of control as point 1.

## PRODUCT OVERVIEWS

---

Criteria	Score	Score	Details
Dispersion	Very Poor	20	Low level discharge, discharge into courtyard or restriction on stack.
	Poor	15	Not low level but below eaves, or discharge below 10 m/s
	Moderate	10	Discharging 1m above eaves at 10-15 m/s
	Good	5	Discharging 1m above ridge at 15 m/s
Proximity of Receptor	Close	10	Closest sensitive receptor between 20m from kitchen discharge.
	Medium	5	Closest sensitive receptor between 20 and 100m from kitchen discharge.
	Far	1	Closest sensitive receptor more than 100m from kitchen discharge.
Size of Kitchen	Large	5	More than 100 covers or large sized take away.
	Medium	3	Between 30 and 100 covers or medium sized take away.
	Small	1	Less than 30 covers or small take away.
Cooking type (odour and grease loading)	Very High	10	Pub (high level of fried food), fried chicken, burgers or fish & chips. <i>Turkish, Middle Eastern or any other premises cooking with solid fuel</i>
	High	7	Vietnamese, Thai, Indian, <i>Japanese, Chinese, steakhouse.</i>
	Medium	4	<i>Cantonese, Italian, French, Pizza (gas fired)</i>
	Low	1	Most pubs ( <i>no fried food, mainly reheating and sandwiches etc.</i> ), <i>Tea rooms.</i>

## PRODUCT OVERVIEWS

---

### The System

The first stage of control should be our **Electrostatic Precipitator ESP3000** unit.



#### Key Features

Eliminates up to 98% of oil, grease and smoke particles

Filters particles down to sub-micron levels

Produces Ozone to help reduce malodours

Designed with an integral sump

As our ESP's have been specifically designed for kitchen extract and not modified from industrial use, they have integral sumps to collect the oil, grease and smoke particles filtered out of the exhaust; this not only simplifies servicing but eradicates potentially dangerous spillage from the bottom of the units and greatly cuts down on flammable build-ups within the duct run.

The ionisation voltage has been designed to run at a negative potential which enhances the ionisation of particles and also produces more Ozone which is helpful in reducing odours in kitchen applications.

Our ESP units fit in-line with the kitchen ducting and can be configured modularly to cope with all extract volume requirements.

The Electrostatic Precipitator is a very efficient means for separating the particulate phase; operating efficiency when clean can be as high as 98% at particle sizes down to 0.01 micron.

The Electrostatic Precipitator does not present a high-pressure loss (175PA approx. dependant on air flow). This gives a specific advantage in that most standard Kitchen extractor fans will have the capability of overcoming this small differential.

This is particularly advantageous when it is considered that if the pressure loss were high larger noisier fans would probably be necessary resulting in potential noise pollution.

# PRODUCT OVERVIEWS

---

## The second stage of control should be our MFU 1200 E2 (Carbon Filters only)



### Key Features

- Modular in design
- Endless combinations of passive filtration
- Multiple configurations
- Built for stock / No lead times

Our MFUs are designed explicitly for kitchen extract systems; they collect the oil, grease and smoke particles filtered out of the exhaust through a combination of passive air filters, including panel, bag, HEPA and carbon. The high-quality unit can house multiple filter combinations and is effortlessly serviced, replaced or even re-configured to provide continually effective and affordable kitchen extract particulate control. Additionally, the units help reduce grease build-up within the ducting and reduce odours.

Its modular design means units can be configured in various ways to handle any required flow rate, providing effective and efficient kitchen extract filtration.

## PRODUCT OVERVIEWS

---

### Carbon Filters

We manufacture Site Safe carbon filters, these innovative carbon units measure 594x196x597mm, three combining to 594x594x597mm, directly replacing our original carbon blocks whilst providing exactly the same filter performance as an existing full size cell.

Their advantage is that they only weigh 18kg each against the 68kg of our original blocks. This takes the strain out of fitting and servicing, allowing only one engineer to complete the task where two had been previously required.

Our Site Safe carbon filters use panels of activated carbon to remove the malodorous gases within the commercial kitchen extract duct through the process of chemical adsorption. By installing our ESP units before our Site Safe filters, the carbon life span is greatly increased, allowing it to nullify malodours at optimum efficiency for much longer.

**As you can see the system that has been specified is in line with EMAQ guidance.**

# TECHNICAL SPECIFICATIONS (per unit)

---


No. ESP 3000E Unit.	
Air Volume Max	1.4 m <sup>3</sup> /s
Electrical Supply	220/240V, 50/60Hz, 1ph
Power Consumption	30 W
Weight each	85 kg
Min/Max Working Temperature	4/56°C
Max Relative Humidity	75%

No. MFU 1200 (Casing Only)	
Width	1245 mm
Height	630 mm
Depth	925 mm
Weight	78 kg




# TECHNICAL DRAWINGS

## ESP 3000

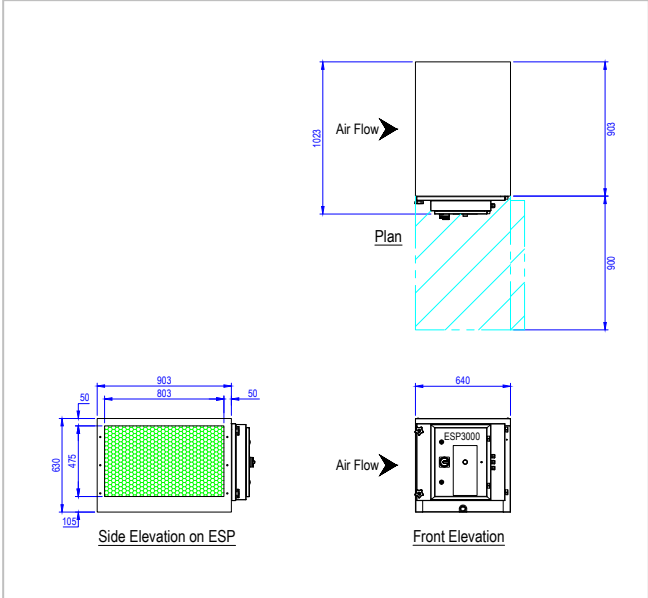

## MFU 1200

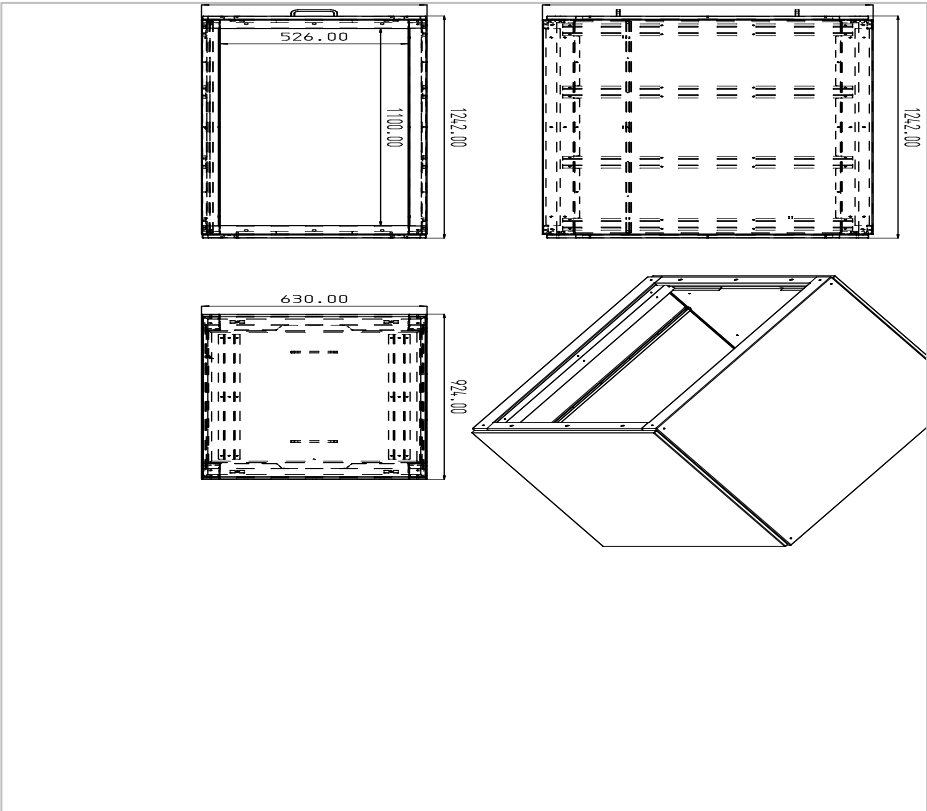



ACCREDITED AND CERTIFIED BY



Thank you for the opportunity to provide the specification and EMAQ report. Should you have any questions or queries please get in touch.

**Nathan Collins**  
Business Development Manager  
T 01708 755 414  
nathan.collins@purifiedair.com

**purifiedair.com**

Lyon House, Lyon Rd, Romford, Essex RM1 2BG

---