

Note:

Kitchen extract system to include Fine filtration or ESP
Followed by a UV Ozone system with a 0.2 to 0.4
second residence time


This drawing is to be read in conjunction with:
Drawings TPS02, SPS04 and TPS05
NRG Consulting Noise Assessment April 2020
Kitchen Odour Risk Assessment Project No 9617.S April 2020

Kitchen extraction flue


Rendered board enclosure:

20mm render on 12mm cementitious board
on metal stud frame with 100mm
rockwool infill. Access panel to be formed using an
external grade timber fire door cut down to size
(See item 6.1.1 in Noise Assessment Report)

Window is shown in rear distance, and is
not built over.

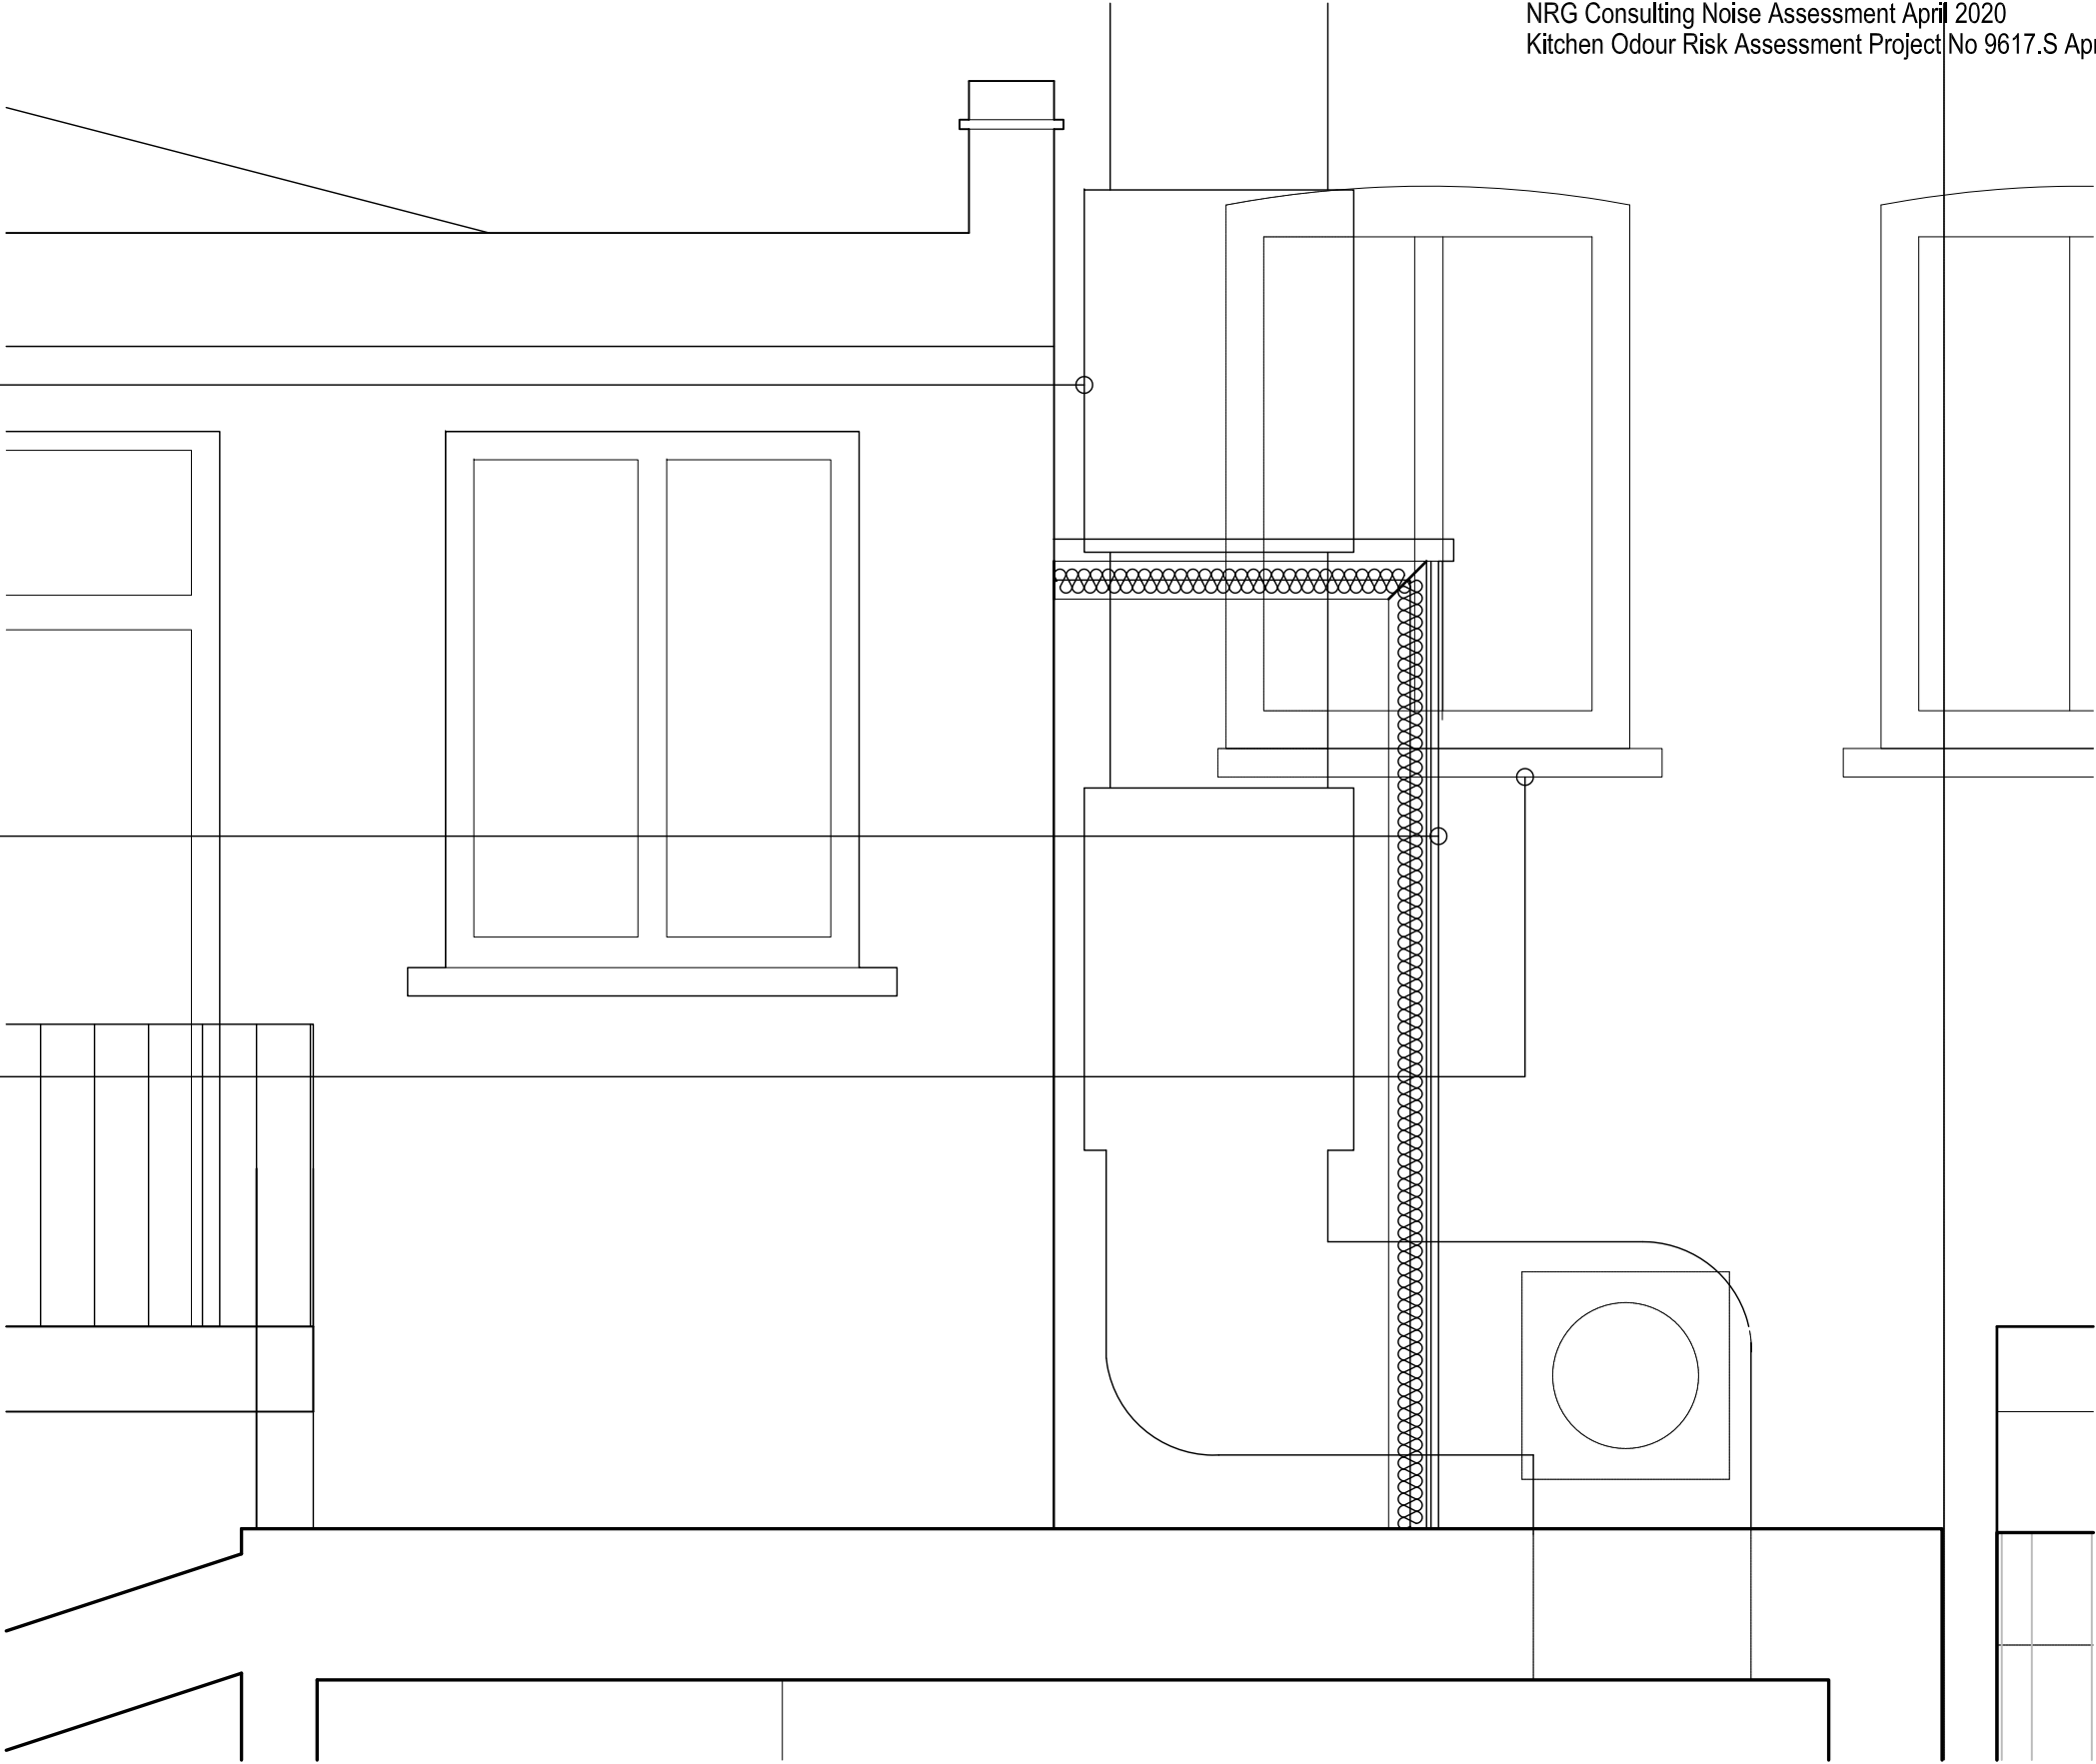

PROPOSED ENLARGED SECTION
THROUGH ENCLOSURE



PROPOSED CROSS SECTION

Project Address: 105 Field End Road, Eastcote

Project Name: Eastcote Karahi
SHEET NAME: Enlarged section showing
extract fan enclosure

Rev	Description	Date
P1	Planning issue	12.10.20

A3 @	Date.	Job No.	Drg. No.
1 :20	01.07.20	A3626	TPS05/P1
www.argent-architects.co.uk		tel 01834 845440	
info@argent-architects.co.uk		fax 01834 845440	
ARGENT ARCHITECTS			