


\*Attenuator specifications

Table 4 Attenuator Specification for Ducted Plant Items							
Plant Item	Dynamic insertion loss, dB (minimum)						
	63 Hz	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz	4000 Hz
Ruck MPC 560 EC 40 exhaust	7	23	29	39	37	34	27
Helios MUB 355 exhaust	5	14	22	28	34	32	23
Systemair AW 500 exhaust	-	-	3	10	13	15	16

Note The attenuator supplier should confirm solutions that will achieve or exceed the above minimum specifications.

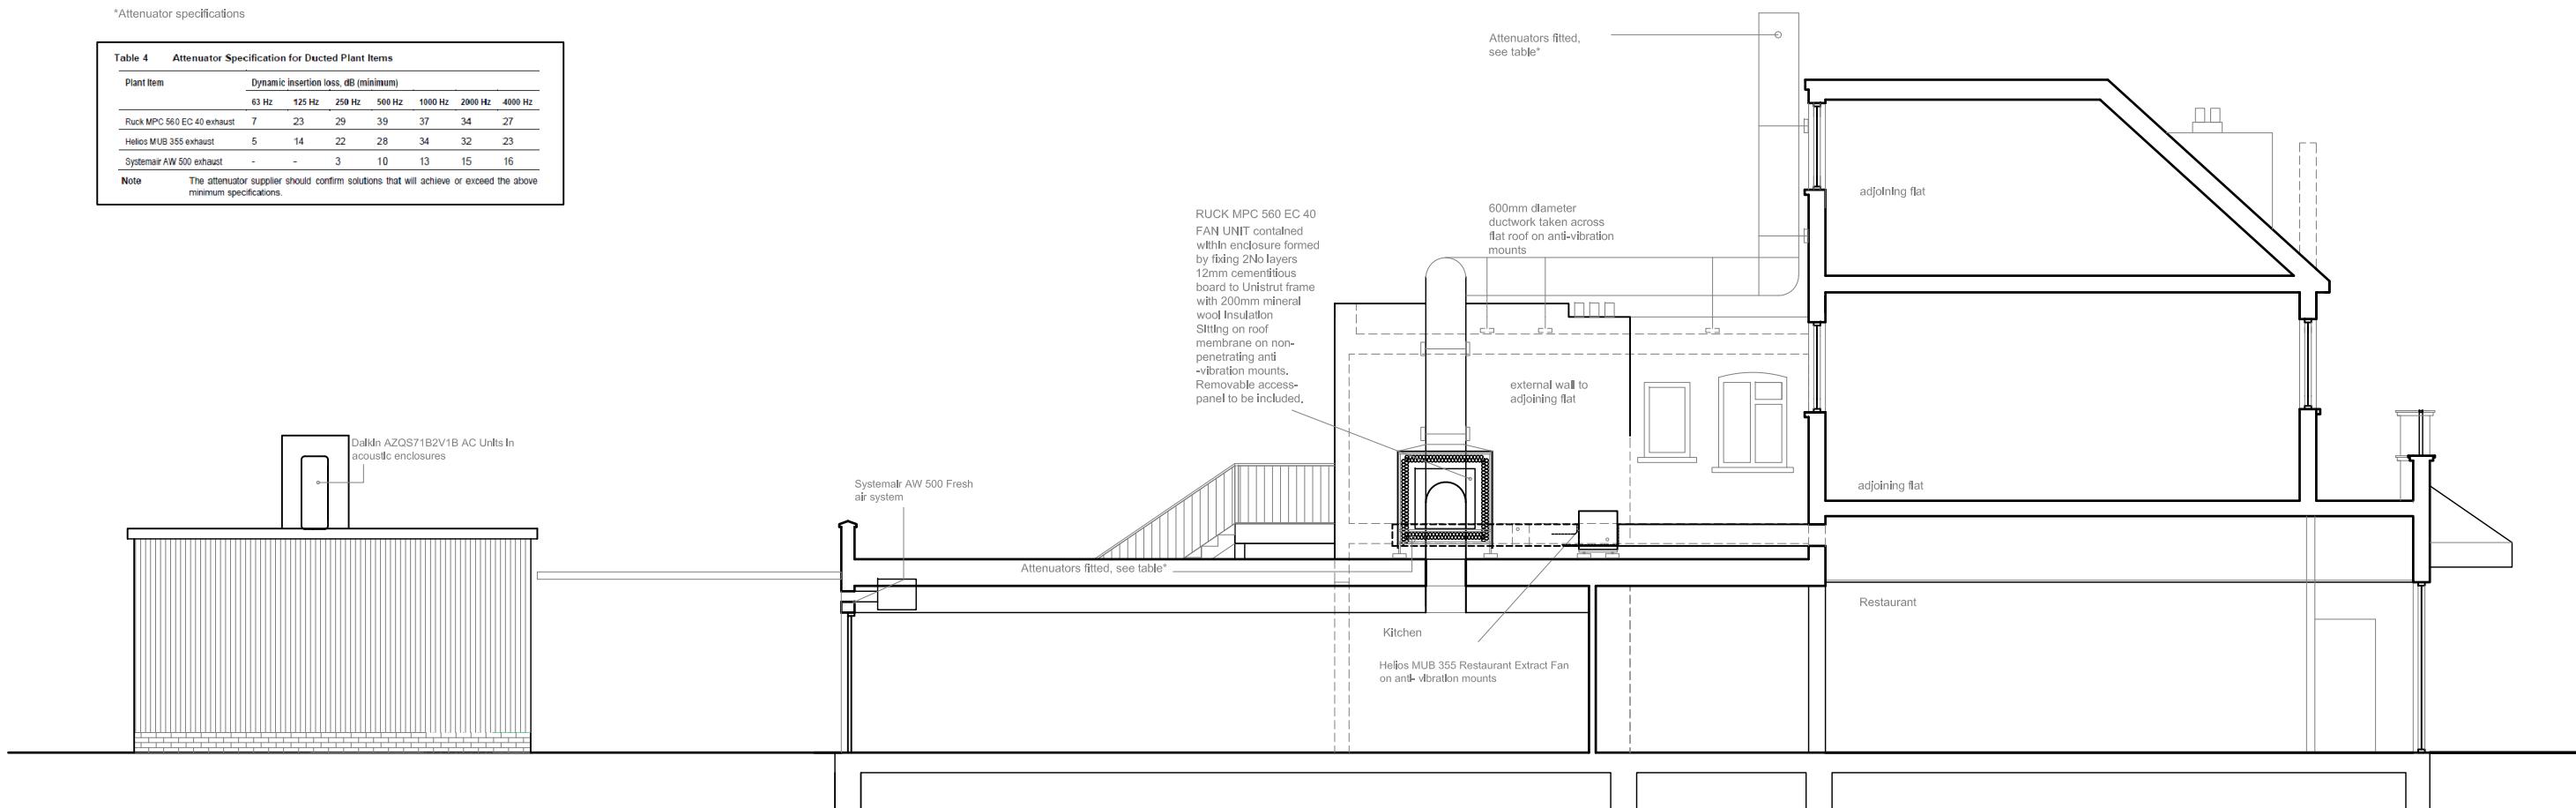

Project Address: 105 Field End Road, Eastcote  
 Project Name: Lahore Eastcote  
 SHEET NAME: Proposed Rear Elevation & section

Rev	Description	Date
P8	AC units position adjusted	26/05/22
P9	Adjustment to shape of shed roof	27/05/22
P10	Acoustic enclosures added to AC units	27/05/22
P11	Flue termination set to 1m above ridge	19/08/22

