


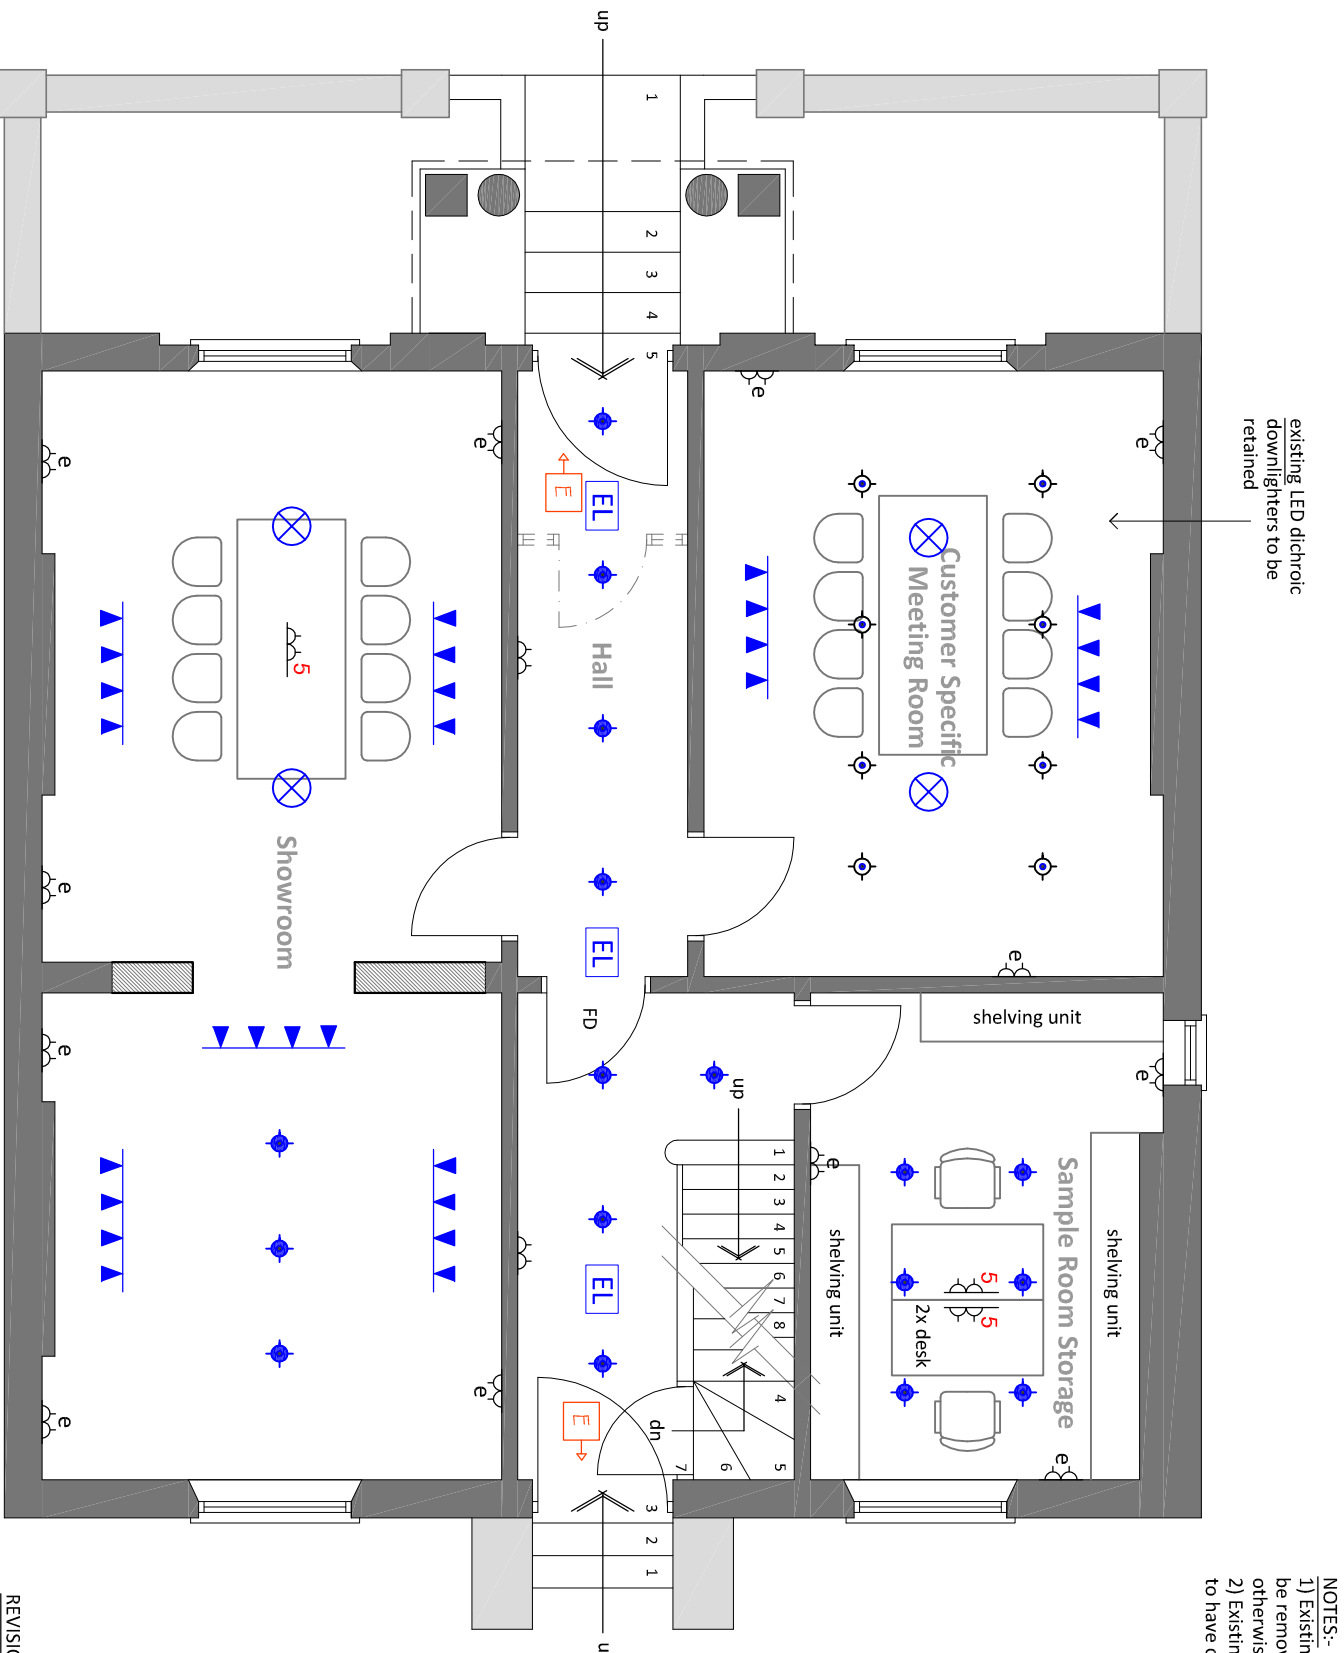

existing LED dichroic
downlighters to be
retained

- NOTES:-
- 1) Existing light fittings to be removed unless otherwise stated
 - 2) Existing socket outlets to have covers replaced.

- new LED dichroic downlighters
 - existing LED dichroic downlighters retained
 - LED pendant light fittings
 - LED angled track spotlights
 - 1500W twin tube fluoro light fitting with diffuser
 - ceiling mounted light fitting
 - wall mounted flat TV screen
 - LED emergency light fitting
 - fire exit route
 - new twin socket outlet
 - existing twin socket outlet
 - new twin socket outlet with Cat 5
 - hand dryer
- scale bar

PROPOSED GROUND FLOOR - 2 of 2

Elmsdale House,
31 The Green,
Money Lane,
West Drayton
UB7 7PN

REVISION A - Mar 3 2022
Various amendments
following site meeting
with Conservation Officer
on 1st March 2022

pgs design
mobile: 07827 930918
pgsdesign2014@gmail.com

Electrical & Furniture Layout