


GENERAL SPECIFICATION
(unless noted otherwise on drawings or engineer's design)

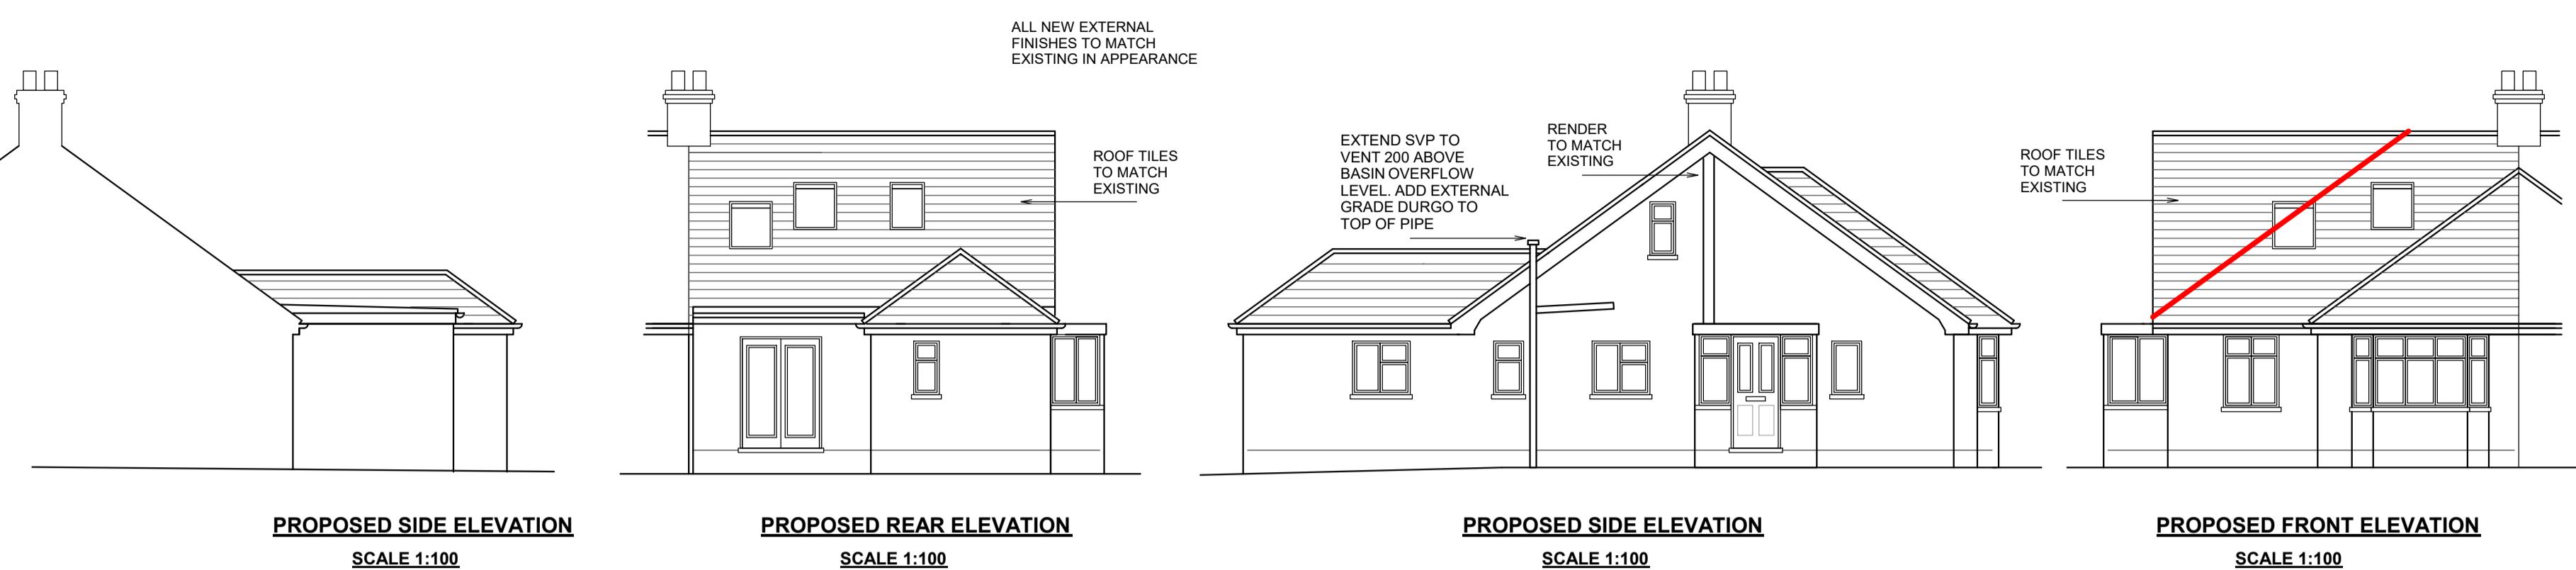


PROPOSED SIDE ELEVATION
SCALE 1:100

PROPOSED REAR ELEVATION
SCALE 1:100

PROPOSED SIDE ELEVATION
SCALE 1:100

PROPOSED FRONT ELEVATION
SCALE 1:100

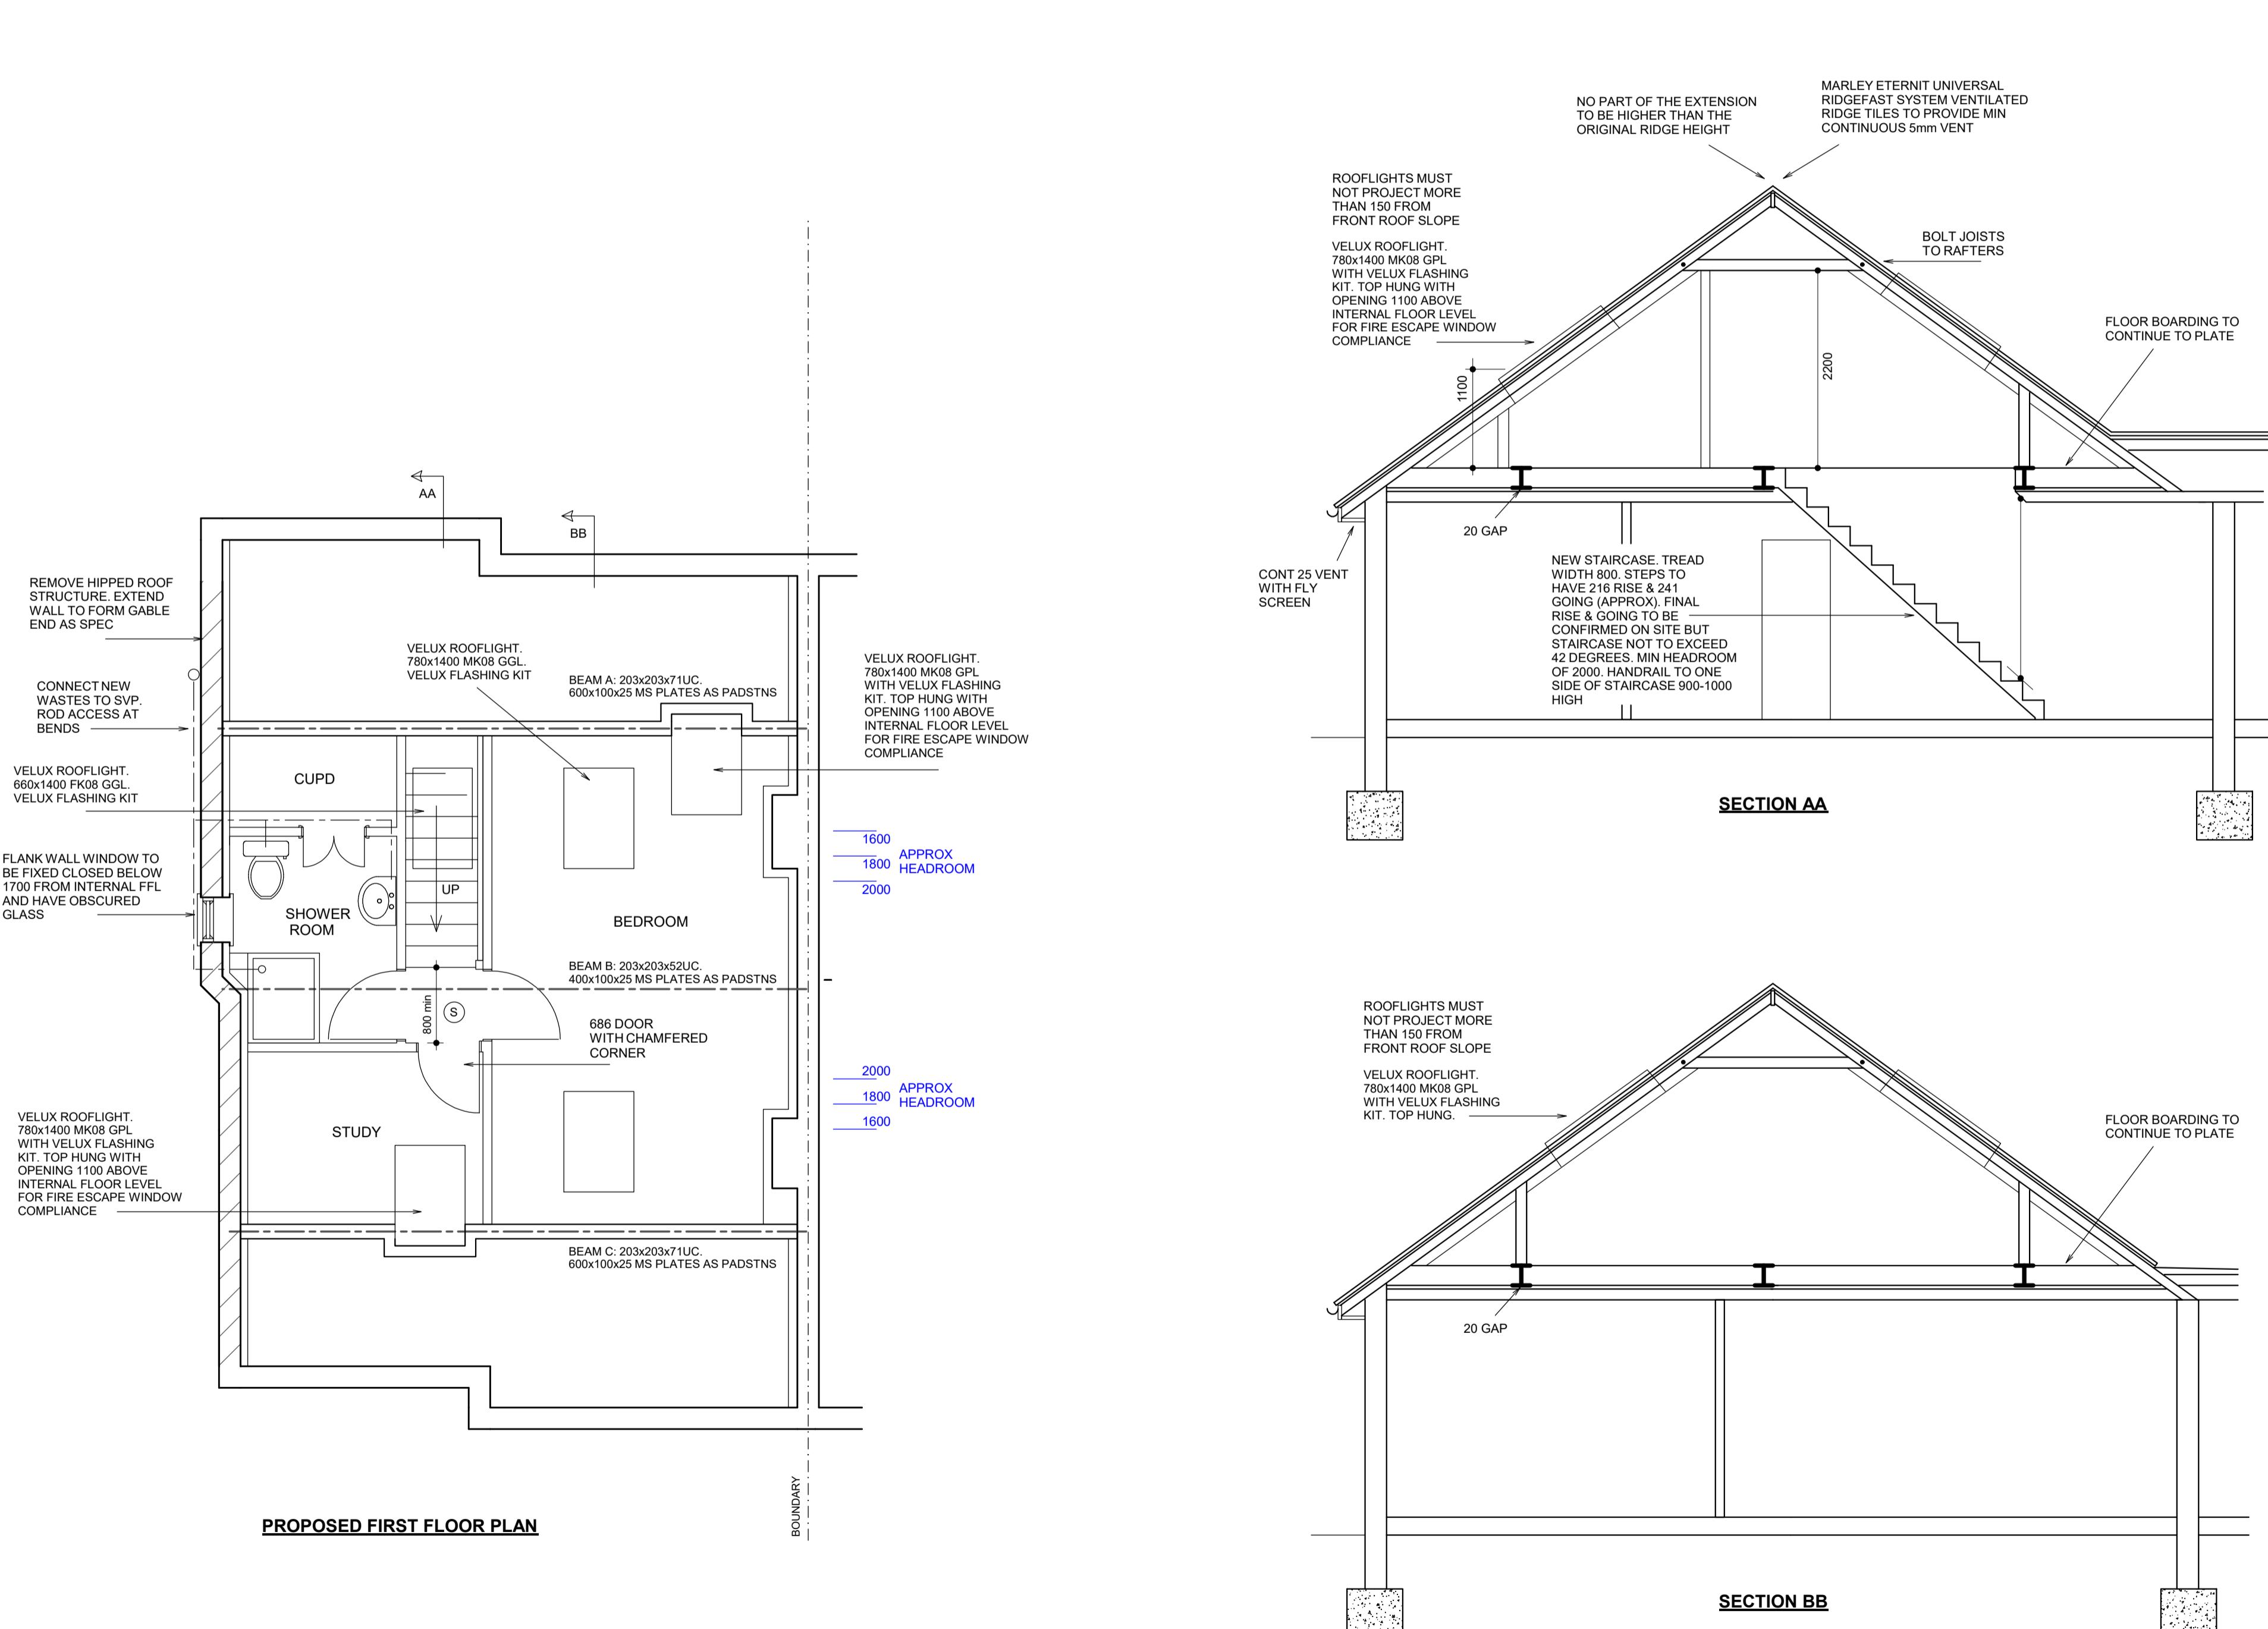

PROPOSED FIRST FLOOR PLAN

BOUNDARY

EXTERNAL WALLS (GABLE WALL)

It is assumed that existing house has solid walls. To confirm on site. Solid wall of 215 Celcon Standard lightweight block. Dryline internally with 72.5 Celotex PL4000 insulation backed plasterboard dot & dabbed to wall with 3 skim. Mortar mix 1:1:6. Exterior render blockwork to match existing 2 x 10 coat 1:1:6 mix + waterproof additive BS5262. Opening to have insulated Catnic CN71A steel lintel over with min 150 bearing unless stated otherwise on drawing.

UPGRADING OF EXISTING PARTY WALL

Dry line wall with 72.5 thick Celotex PL4000 insulation backed plasterboard fixed to 47x47 battens. Additional 40 Celotex TB4000 between battens. 3 skim. Wall to achieve U-value of 0.18W/m2K.

STEELWORK

Beams to be clad with 12.5 fireline plasterboard + skim to provide 30 min fire rating. Alternatively steelwork to be painted with intumescent paint by suitably trained person to approval of building inspector on site.

LOFT FLOOR STRUCTURE

200x50 C16 joists at 400 cts (unless noted otherwise on engineers design). 22mm moisture resistant T&G particle board (18 WBP ply to bathrooms). 100 acoustic quilt located between joists fixed with chicken wire. 5x30 steel restraint straps at 2000 cts over 2 joists & located in brick or blockwork. 200x38 straight strutting between joists.

STAIRCASE

32 engineered pine strings. 22 MDF treads. 9 ply risers. 90x90 newels. Tread & riser provisionally as plan but to be confirmed on site. Pitch not to exceed 42 degrees. 50 min tread length at turns. Open banisters to have spindles spaced to prevent 100 dia sphere from passing at any point. Handrails 900-1000 high. 2000 min headroom over stairs.

INTERNAL PARTITIONS

75x50 stud. Double up joists under partition bolting together with M12 bolts @ 600cts if on timber floor. All partitions to contain 75 acoustic quilt. Clad stairwell partitions with 12.5 fireline or 2x12.5 plasterboard. Clad bath/shower room partitions with 12.5 soundblock. Clad other partitions with 12.5 plasterboard. Skim all plasterboard.

EXISTING MAIN ROOF RAFTERS (PITCHED WITH SLOPING SOFFIT) - UNVENTILATED

Existing rafters 100x50 at 400 cts. Double up/replace with 150x50 C16 @ 400cts. 130mm Celotex XR4000 insulation between rafters & 50mm Celotex GA4000 insulation slab beneath rafters to achieve U-value of 0.15W/m2K. Tyvek breathable membrane. 19x38 battens. Roof tiles to match existing. New ridge tiles to be bedded on mortar in addition to a mechanical fixing.

Bolt 120x50 C16 ceiling joists to rafters with M12 8.8 bolts. 300 fibreglass quilt laid between joists & over joists.

ROOFLIGHTS - PITCHED ROOFS

Install with manufacturers upstand/flashing kit and all to manufacturers instructions. Doubled up rafters and trimmers around opening to be bolted together with M12 bolts @ 600cts.

VENTILATION

Windows to match existing & provide vent of min 1/20 floor area & built in adjustable 800mm² min vent. Internal power vent to bath/shower room to achieve 15 litres/sec and be connected to light switch with 15 min overrun. Vent to be ducted to ceiling level to outside air.

SURFACE WATER

112 dia PVC gutters. 68 dia PVC downpipes. Surface water downpipes connected into existing surface water drain. If not possible construct soakaway minimum 5 metres from any building. Volume of 1 cubic metre per 16.5 square metres of roof area served. Fill with hardcore.

WINDOWS

Double glazed with 16 air gap and soft low E coating. Built in 8000mm² adjustable vent. to achieve U value of 1.4 w/m2K. All glass below 800mm to be toughened safety glass.

ABOVE GROUND DRAINAGE AND PLUMBING

Bath/shower to have 40 dia waste. Basin with 32 dia waste. All with 75 D/S traps & rodding access at bends. WC with 110 dia waste. Plumbing to comply with British Standards. Wholesome water (ie water provided by statutory water supplier via a compliant water supply installation) to be provided to all taps. Baths & shower taps to be thermostatically controlled to ensure water does not exceed 48 deg C

ELECTRICAL WORK

All electrical work required to meet the requirements of Part P (Electrical Safety). Must be designed, installed, inspected & tested by a person competent to do so. Prior to completion the council should be satisfied the Part P has been complied with. This may require an appropriate BS7671 electrical installation certificate to be issued for the work by a person competent to do so. New light fittings to have LED bulbs. Electrical switches and sockets to be installed between 450mm and 1200mm from floor level where practical.

HEATING

New radiators to be fitted with thermostatic valves. Work to gas pipework, boilers & appliances to be carried out, tested and certified by Gas Safe registered person.