

TRIMMER T1 :2No.50x200
TRIMMER T2 :3No.50x200
BEAM R1 :152x152x37UC ON 100x450x215 PAD
BEAM F1,F2 :203x203x46 UC ON 100x500x20 PLATES
BEAM F3 :2No.50x200 OVER REAR WALL TO BRIDGE
EXISTING WINDOW LINTELS

BOLT TOGETHER DOUBLE JOISTS / RAFTERS WITH M10 BOLTS
WITH 50 DIA TOOTH PLATE CONNECTORS AND WASHERS AT 900 C/C

STEEL BEAMS TO BE PAINTED WITH INTUMESCENT PAINT -
TO MANUFACTURERS INSTRUCTIONS

ALL NEW WINDOWS TO BE DOUBLE GLAZED WITH TOUGHENED GLASS
TO BS 6206, IF WITHIN 800MM OF FLOOR

ALL INTERNAL STUD WALLS BETWEEN THE W.C./BEDROOM AND
STAIRS TO BE FILLED WITH 100MM MINERAL WOOL
DENSITY 15KG/M3

STUD WALLS TO STAIRS ENCLOSURE TO BE HALF HOUR FIRE
RESISTING 50x100 STUDS AT 400C/C VERTICALLY AND
HORIZONTALLY LINE BOTH SIDES WITH 12.5MM PLASTER BOARD
AND SKIM, FILL VOIDS WITH 100MM MINERAL WOOL DENSITY 15KG/M3

SOFFIT OF NEW STAIRS TO BE LINED WITH 12.5MM PLASTER
BOARD AND SKIM

PROVIDE CODE 4 LEAD FLASHING BETWEEN THE DORMER CHEEKS
AND THE ROOF

BASIN AND SHOWER WASTE TO BE 38MM WITH 75MM UPVC DEEP
SEAL TRAP, W.C. TO HAVE TURNED P TRAP MULTIKWIK
CONNECTOR-DISCHARGE INTO THE EXISTING SOIL AND VENT PIPE,
IN ACCORDANCE WITH BS5572

PROVIDE ROODING ACCESS IN WASTE PIPES AT CHANGE IN DIRECTION

PROVIDE ELECTRIC FAN TO W.C./SHOWER ROOM TO GIVE
15 LITRES PER SECOND AIR EXTRACT RATE WITH 15 MINUTE
TIMER

PROVIDE AT EACH LANDING SELF CONTAINED SMOKE
DETECTORS PERMANENTLY WIRED TO A SEPARATELY
FUSED CIRCUIT AT THE DISTRIBUTION BOARD WITH
BATTERY BACK UP,
SMOKE ALARMS TO BE LINKED AND DENOTED THUS:- Ø
SMOKE ALARMS TO COMPLY WITH BS 5446;PART 1

ANCHOR EXISTING GABLE WALL TO ROOF AND FLOOR
JOISTS WITH 30x5x1200 LONG GALVANISED MILD
STEEL STAPLS AT 1200 C/C

STEEL BEAMS TO AVOID BEARING ON TO BRICK WORK THAT
PREVIOUSLY FORMED PART OF THE CHIMNEY BREAST

RAISE GABLE WALL IN 215MM THERMALITE TURBO BLOCKS, BUILT
OFF THE EXISTING WALL, DRY LINE INTERNALLY WITH 47.5MM
KOOLTHERM K18 DRY-LINING BOARD MECHANICALLY FIXED TO
TIMBER BATTENS
EXTERNALLY - 20MM RENDER WITH WATER PROOF ADDITIVE

PROVIDE CATNIC LINTEL CN71A OVER
WINDOW OPENING IN GABLE WALL

FLUSHING DEVICES TO W.C. TO BE PROVIDED WITH PROVISION
OF WHOLESOME WATER FROM THE MAINS

BASIN/SHOWER TO BE PROVIDED WITH HEATED WHOLESOME
WATER OR SOFTENED WATER

ALL ELEMENTS OF HOT WATER SYSTEM TO BE DESIGNED,
CONSTRUCTED AND INSTALLED TO RESIST EFFECTS OF
TEMPERATURE DURING NORMAL USE AND IN THE EVENT OF A
MALFUNCTION. SYSTEM TO BE ADEQUATELY SUPPORTED AND
COMPLY WITH APPROVED DOCUMENT G (G3)

HOT WATER STORAGE VESSEL REQUIRES PRECAUTIONS TO
PREVENT WATER EXCEEDING 100 DEGREES C. SAFETY
DEVICES TO DISCHARGE TO A SUITABLE PLACE OF SAFETY
TO PREVENT INJURY TO PEOPLE

DOUBLE UP RAFTERS AROUND ROOF LIGHTS

DOOR FRAMES RECEIVING FD30 DOORS ARE TO HAVE 25x25MM
DOOR STOPS AND FD30 DOORS ARE TO BE HUNG ON 3NO.
HEAVY DUTY STEEL HINGES


LEAD FLASHING TO HAVE 150MM UPSTAND

DORMER TILES TO BE PLAIN CONCRETE

WINDOW AREA TO BE 1/10TH OF THE FLOOR
AREA AND OPENABLE AREA EQUAL TO 1/20TH
OF THE FLOOR AREA

PROVIDE 8000MM2 BACKGROUND VENTILATION
TO NEW LOFT ROOMS, VIA TRICKLE VENTS
IN WINDOWS

BEAM F1/F2 AND
THEIR BEARING
NOT TO TAKE
SUPPORT ONTO
MASONARY
FORMING PART
OF THE CHIMNEY
BREAST

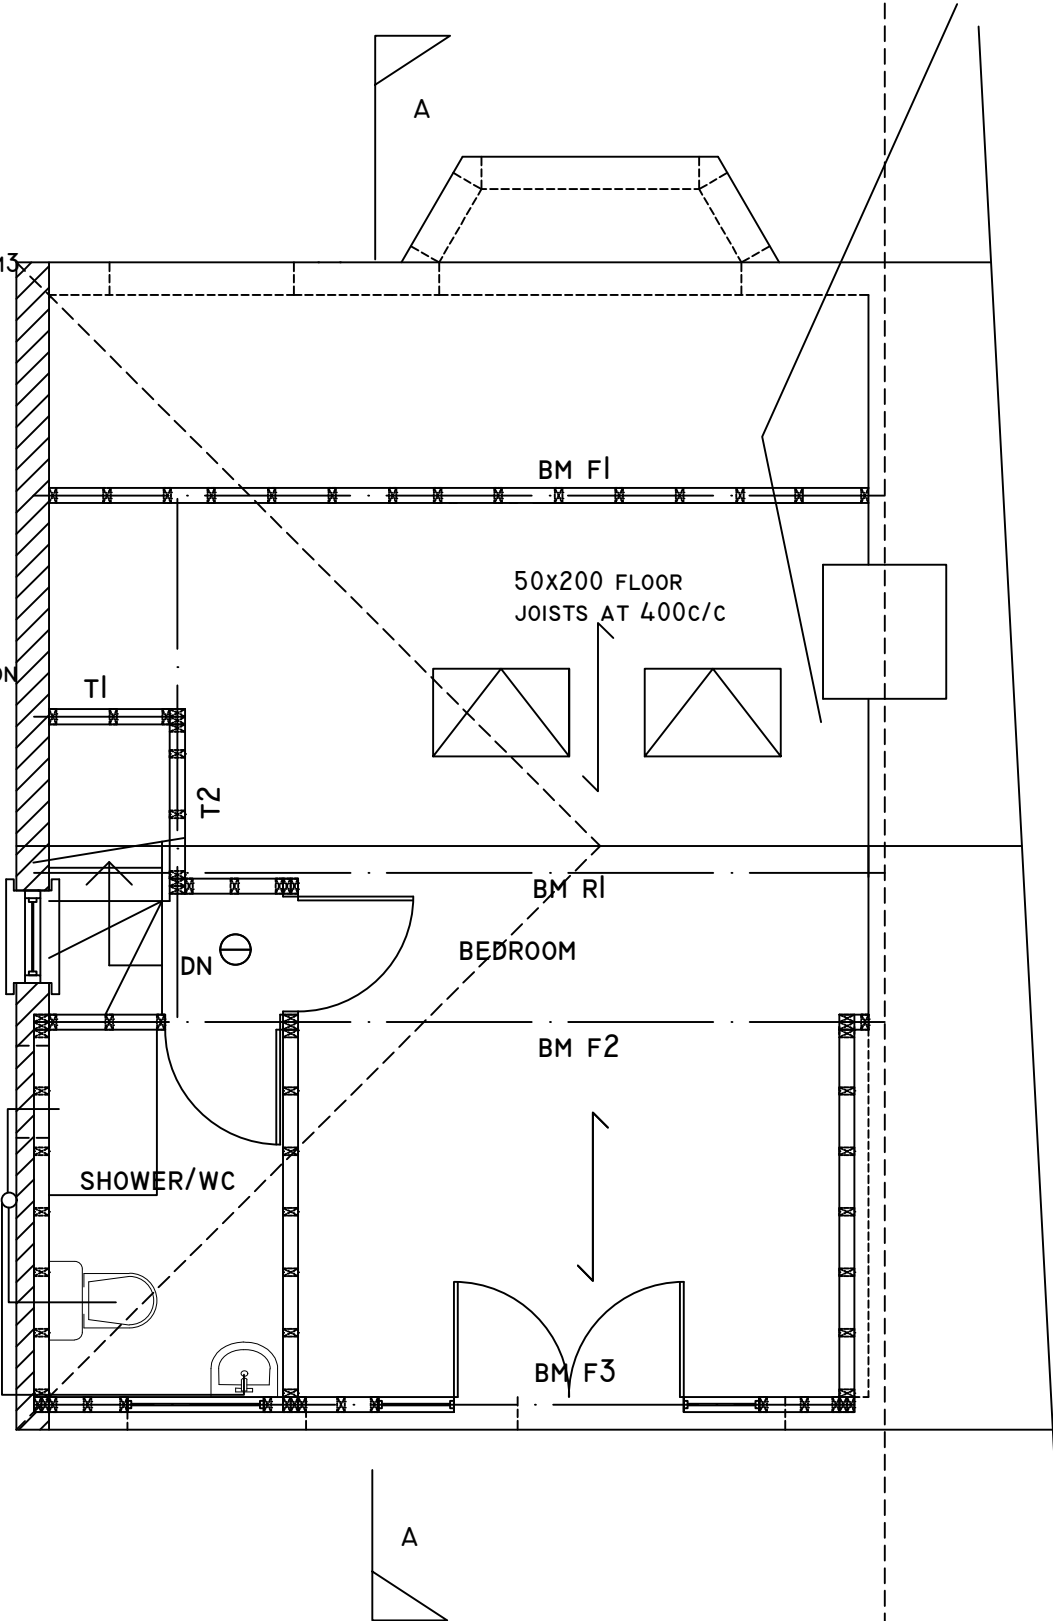

LOFT PLAN

PROVIDE 10MM GAP TO WC DOOR FOR AIR INTAKE

DOUBLE UP FLOOR JOISTS UNDER STUD PARTITIONS
AND BOLT TOGETHER WITH 10MM BOLTS AT 600C/C

PROVIDE ACCESS FOR RODDING AT BASE OF ALL STACKS

0 10M

CHECKED:	DATE: SEPT 2020
DRAWN:	SCALE: 1:50
DRAWING NUMBER:	L3

DRAWING TITLE:
LOFT PLAN

PROJECT:
1 PERRY CLOSE
UXBRIDGE
UB8 3HR