



ENVIRONMENTAL NOISE SURVEY_GF

105 Hayes End Rd, Hayes
UB4 8EL

24/08/2026

105 Eade road London N4 1TJ
Email info@stone-brick.co.uk

REPORT No: 105HER220826UB48EL

Survey Date: 22-23 August 2026

CLIENT PROJECT REFERENCE

105 Hayes End Rd, Hayes, UB4 8EL

ENVIRONMENTAL NOISE SURVEY_GF

PREPARED FOR:

105 Hayes End Rd, Hayes, UB4 8EL

PREPARED BY:

Mr Salih K. Hassan

Senior Acoustic Consultant

BSc, BEng (Hons), MSc, MIOA, MIEE, LDip, MSLL, MTCEA, MCIBSE, CEng.

IOA Registration No. 30878

IEE Registration No. 16695640

MCIBSE No 5628

Engineering Council No. 510932

CHECKED BY

Dr Haydar Aygun (PhD, MSc, BSc, FIOA, MASA)

Associate Professor of Acoustics and Ventilation

Fellow Member of the Institute of Acoustics

Member of the Acoustical Society of America

Signed: *Salih K Hassan*

Date: 24/08/2026

Contents

1.	Summary	3
2.	Introduction	4
2.1.	Proposal.....	4
2.2.	Reason for Assessment.....	4
2.3.	Assessment Standards & Justification.....	4
2.3.1	The National Planning Policy Framework (2024).....	4
2.3.2	Noise Policy Statement for England (2010).....	4
2.3.3	WHO Guidelines for Community Noise (1999)	5
2.3.4	BS4142:2014 + A1:2019.....	5
2.3.5	Guidance on Sound Insulation and Noise Reduction for Buildings BS8233 (2014)	6
2.4.	Measurements.....	6
2.5.	Sound Insulation and Noise Impact Assessment.....	6
2.6.	Site & Measurement Location.....	7
3.	Environmental Noise Survey.....	7
3.1.	Source under Investigation	7
3.2.	Weather Conditions.....	7
3.3.	Measurement Equipment.....	7
3.4.	Measurement Results	7
3.5.	Observation	9
3.6.	Uncertainty	10
4.	Noise Impact Assessment.....	10
4.2	Day noise impact assessment	10
4.3	Night noise impact assessment.....	10
4.4	Distance attenuation	10
4.5	Barrier attenuation.....	10
4.6	BS4142:2014 + A1:2019 Assessment for nearest noise sensitive receptors	10
4.6.1	103-Hayes End Road windows.....	10
4.6.2	107-Hayes End Road windows.....	11
4.6.3	External amenity (107 Hayes End Road)	11
5.	BS8233:2014 Noise Assessment.....	12
5.1.	Criteria.....	12
5.2.	External Noise Analysis	12
5.3.	Internal Noise Levels.....	12
5.4.	Daytime Internal Noise Levels.....	12
5.5.	Night-time Internal Noise Levels	12
6.	Vibration.....	13
7.	Sound Insulation Scheme	13
7.1.	Sound Insulation Assessment for floors and party walls.....	13
8.	Conclusion.....	15
9.	References	16
10.	Appendixes	17
10.1.	Appendix A: Equipment details	17
10.2.	Appendix B: Measurement Location and Calibration Details.....	17
10.3.	Appendix C: Ground Floor.....	18
10.4.	Appendix D: First Floor Room 4.....	21
10.5.	Appendix E: Second Floor Room 8.....	24
10.6.	Appendix F: Building Regulations Approved Document E	27
10.7.	Appendix G: Acoustics terminology	27
10.8.	Appendix H: Plans for proposed rooms.....	29

1. Summary

An environmental noise impact assessment was carried out at the premises at 105 Hayes End Rd, Hayes, UB4 8EL, UK started on Saturday 22nd August 2026 and finished on Sunday 23rd August 2026 in order to determine internal noise levels of the *proposed ensuite rooms*. A BS4142 and BS8233 noise assessment was carried out at the site. All worst-case situations were considered for this assessment.

A rigorous calculation method that is given in BS8233 and based on measured environmental noise levels, was used to determine interior noise levels in the *proposed ensuite rooms*. In accordance with BS8233:2014 guidance, the results shown in table below shows that;

- The day internal noise levels in living rooms are within the desirable category of 35dB(A) $L_{Aeq,16hr}$.
- The night internal noise levels in bedrooms are in the desirable category of 30dBA $L_{Aeq,8hr}$.
- The maximum individual noise events in bedrooms do not exceed 45dB(A) L_{AFmax} of the desirable category.

A summary of internal noise levels of the *proposed ensuite rooms* is given in table below.

Ground Floor Rooms				
Internal Space	Noise Parameter	Internal Noise Level	BS8233 Limit	Within Desirable Limit (BS8233)
L/D/K (35m ²)	Daytime $L_{Aeq,16hr}$	27	35	Yes
Bedroom-3 (10.37m ²)	Night-time $L_{Aeq,8hr}$	23	30	Yes
Bedroom-3 (10.37m ²)	Night-time L_{AFmax}	42	45	Yes
First Floor Rooms				
Internal Space	Noise Parameter	Internal Noise Level	BS8233 Limit	Within Desirable Limit (BS8233)
Living Room-4 (12.50m ²)	Daytime $L_{Aeq,16hr}$	22	35	Yes
Bedroom-4 (12.50m ²)	Night-time $L_{Aeq,8hr}$	22	30	Yes
Bedroom-4 (12.50m ²)	Night-time L_{AFmax}	42	45	Yes
Second Floor Rooms				
Internal Space	Noise Parameter	Internal Noise Level	BS8233 Limit	Within Desirable Limit (BS8233)
Living Room 8 (18.5m ²)	Daytime $L_{Aeq,16hr}$	23	35	Yes
Bedroom-8 (18.5m ²)	Night-time $L_{Aeq,8hr}$	23	30	Yes
Bedroom 8 (18.5m ²)	Night-time L_{AFmax}	43	45	Yes
L/D/K means living/ dining/ kitchen area				

The results given in Table above demonstrate that the predicted indoor ambient noise levels, $L_{Aeq,16hr}$ for day, $L_{Aeq,8hr}$ for night and L_{AFmax} for night in the proposed ensuite rooms do not exceed the guideline values that are set in Table 4 of BS8233:2014.

The summary of the difference between the Rating Level and Background Noise Level of noise sensitive receptors is given in Table below.

Noise sensitive receptor	Difference between The Rating Level and Background Level	
	Day Ground Floor Window	Night First Floor Window
103 Hayes End Road	- 6dB(A)	- 4dB(A)
107 Hayes End Road	- 4dB(A)	- 2dB(A)

In accordance with BS4142:2014+A1:2019 guidance, the day Rating Levels at nearest noise sensitive receptors do not exceed the background sound level as shown in Table above. Therefore, the operation of the *site as multiple occupancy* indicates the specific sound source having a low adverse impact during daytime.

BS8233:2014 provides a desirable guideline of 50dB $L_{Aeq,16hr}$ for external amenity spaces and an acceptable guideline of 55dB $L_{Aeq,16hr}$ for noisier environments. The nearest external amenity space is rear garden of 107 Hayes End Road. The Rating Level $L_{Aeq,Tr}$ at the external amenity space is 49 dB and it does not exceed the guideline values of 50dB L_{Aeq} .

We can confirm that the internal ambient noise levels are within the standards set out in BS8233:2014 guidance and the Rating Level $L_{Aeq,Tr}$ of the site operating as multiple occupancy is expected to comply with BS4142:2014+A1:2019 guidance. Also, we can confirm that there were not any structural borne noise and vibration from the noise sources nearby the site.

2 Introduction

2.1. Proposal

An environmental noise survey was carried out to assess noise levels at 105 Hayes End Rd, Hayes, UB4 8EL, UK started on Saturday 22nd August 2026 and finished on Sunday 23rd August 2026. This noise survey was prepared to support an outline application for *converting existing site to 8 ensuite rooms* with access secured and all other matters reserved. The site has three floors including loft floor. The site is located on Hayes End Road.

2.2. Reason for Assessment

A noise assessment is required to specify mitigation measures to ensure environmental noise levels do not exceed guideline internal/external noise levels, as listed in BS8233:2014.

2.3. Assessment Standards & Justification

2.3.1 The National Planning Policy Framework (2024)

The revised National Planning Policy Framework (NPPF) sets out the Government's planning policies for England, superseding all previous planning policy statements and guidance. In respect of noise, the NPPF states that the planning system should contribute to and enhance the natural and local environment by preventing both new and existing developments from contributing to being put at unacceptable risk from or being adversely affected by unacceptable levels of noise pollution.

Hence, Paragraph 198 states that planning policies and decisions should also ensure new development is appropriate for its location taking into account the likely effects (including cumulative effects) of pollution on health, living conditions and the natural environments, as well as the potential sensitivity of the site or the wider area to impacts that could arise from the development. In doing so they should:

- a) *mitigate and reduce to a minimum potential adverse impact resulting from noise from new development- and avoid noise giving rise to significant adverse impacts on health and the quality of life.*
- b) *Identify and protect tranquil areas which have remained relatively undisturbed by noise and are prized for their recreational and amenity value for this reason.*

In regard to the term adverse impact, reference is made to the Noise Policy for England:

2.3.2 Noise Policy Statement for England (2010)

The Noise Policy Statement for England (NPSE) sets out the long-term vision of Government noise policy: to promote good health and a good quality of life through the effective management of noise within the context of Government policy on sustainable development. This vision is supported by the following aims:

- avoid significant adverse impacts on health and quality of life;
- mitigate and minimise adverse impacts on health and quality of life; and
- where possible, contribute to the improvement of health and quality of life.

The term “significant adverse” and “adverse” are related to the following concepts:

- No Observed Effect Level (NOEL) - the level below which no effect on health and quality of life can be detected.
- Lowest Observed Adverse Effect Level (LOAEL) – the level above which adverse effects on health and quality of life can be detected.

- Significant Observed Adverse Effect Level (SOAEL) – the level above which significant adverse effects on health and quality of life occur.

The guidance acknowledges that it is not possible to have a single objective noise-based measure that defines SOAEL that is applicable to all sources of noise in all situations, but will be different for different noise sources, receptors and times.

In order to enable assessment of impacts in line with these requirements, reference should be made to other currently available guidance.

2.3.3 WHO Guidelines for Community Noise (1999)

The guidance in this document details suitable noise levels for various activities within residential and commercial buildings. WHO guidance states that the sound pressure levels should not exceed 35dB $L_{Aeq,T}$ to maintain speech intelligibility and avoid moderate annoyance in living rooms during day and evening time, and should not exceed 30dB $L_{Aeq,T}$ to prevent sleep disturbance in bedrooms nighttime. It also states that for a good sleep, it is believed that indoor sound pressure levels should not exceed approximately 45dB L_{Amax} more than 10-15 times a night. For sleep disturbance, i.e. in bedrooms at night, the NOEL can, therefore, be taken as anything below 30dB(A), whilst the onset of the LOAEL occurs at 30dB(A) and above. The SOEL cannot be inferred for this information.

2.3.4 BS4142:2014 + A1:2019

BS4142:2014+A1:2019 provides guidance on the assessment of the likelihood of complaints relating to noise from industrial sources. The key aspects of the BS4142:2014+A1:2019 are summarised below. The standard presents a method of assessing potential noise impact by comparing the noise level due to industrial sources (the Rating Level) with that of the existing background noise level at the nearest noise sensitive receiver in the absence of the source (the Background Sound Level). The Specific Noise Level - the noise level produced by the source in question at the assessment location - is determined and a correction applied for certain undesirable acoustic features such as tonality, impulsivity or intermittency. The corrected *Specific Noise Level* is referred to as the *Rating Level*. The significance of sound of an industrial and/or commercial nature depends upon both the margin by which the rating level of the specific sound source exceeds the background sound level and the context in which the sound occurs.

- A difference of around +10 dB or more is likely to be an indication of a significant adverse impact, depending on the context.
- A difference of around +5 dB is likely to be an indication of an adverse impact, depending on the context.
- The lower the rating level is relative to the measured background sound level, the less likely it is that the specific sound source will have an adverse impact or a significant adverse impact.
- Where the rating level does not exceed the background sound level, this is an indication of the specific sound source having a low impact, depending on the context.

BS4142:2014+A1:2019 criteria are given below.

Difference between the rating level and the background level	Assessment (All dependant on the context)
Around 10 dBA or more	<i>Indicates a significant adverse impact</i>
Around 5 dBA	<i>Indicates an adverse impact</i>
Below 5 dBA	<i>Lower the adverse impact</i>

2.3.5 Guidance on Sound Insulation and Noise Reduction for Buildings BS8233 (2014)

BS8233:2014 contains useful advice relevant to the planning and design of new development, including new noise-sensitive development such as housing. BS8233 advocates a systematic approach to acoustic design as follows: i) assess the site, identify significant existing and potential noise sources, measure or estimate noise levels, and evaluate layout options. ii) Determine design noise levels for spaces in and around the building(s); iii) Determine sound insulation of the building envelope, including the ventilation strategy; iv) Identify internal sound insulation requirements; v) Identify and design appropriate noise control measures; and vi) Establish quality control and ensure good quality workmanship. Section 5 of BS8233:2014 contains guidance on the sequence of stages to be followed in the planning and early acoustic design of a new development. Section 5.4 of BS8233:2014 outlines a general approach to determining appropriate noise control measures including the following suggested steps (which may be iterative): i. Check the feasibility of reducing noise levels and/or relocating noise sources. ii. Consider options for planning the site or building layout. iii. Consider the orientation of proposed building(s). iv. Select construction types and methods for meeting building performance requirements. v. Examine the effects of noise control measures on the requirements for ventilation, fire regulation, health and safety, cost, construction, design and management etc. vi. Assess the viability of alternative solutions. The designer should then decide which of the following options could be applied to reduce noise levels: i. Quietening or removing the source of noise. ii. Attenuating the sound on its path to the receiver. iii. Obstructing the sound path between source and receiver. iv. Improving the sound insulation of the building envelope. v. Using agreements to manage noise.

2.4. Measurements

Environmental noise survey was undertaken at the site in order to assess environmental noise emissions. The sound level meter was mounted onto a tripod at 1.3 metre above the ground at the front of the site. It was positioned at minimum 1 metre away from nearby walls/fences.

2.5. Sound Insulation and Noise Impact Assessment

2.5.1 Sound Insulation Assessment for proposed residential rooms

The Building Regulations Approved Document E require a minimum sound insulation value of 43 dB ($D_{nT,w} + C_{tr}$ dB) for floors, stairs, and walls, and 64 dB ($L_{nT,w}$ dB) for floor, and stairs of dwelling-houses and flats formed by material change of use (See Appendix F). The outcome summarised in Table 1 was achieved by using assumed standard construction details as specified in Appendix C, Appendix D, and Appendix E for the building façade.

Table 1: Noise Assessment Outcome

Ground Floor Rooms				
Internal Space	Noise Parameter	Internal Noise Level	BS8233 Limit	Within Desirable Limit (BS8233)
L/D/K (35m ²)	Daytime $L_{Aeq,16hr}$	27	35	Yes
Bedroom-3 (10.37m ²)	Night-time $L_{Aeq,8hr}$	23	30	Yes
Bedroom-3 (10.37m ²)	Night-time L_{AFmax}	42	45	Yes
First Floor Rooms				
Internal Space	Noise Parameter	Internal Noise Level	BS8233 Limit	Within Desirable Limit (BS8233)
Living Room-4	Daytime $L_{Aeq,16hr}$	22	35	Yes

(12.50m ²)				
Bedroom-4 (12.50m ²)	Night-time $L_{Aeq,8hr}$	22	30	Yes
Bedroom-4 (12.50m ²)	Night-time L_{AFmax}	42	45	Yes
Second Floor Rooms				
Internal Space	Noise Parameter	Internal Noise Level	BS8233 Limit	Within Desirable Limit (BS8233)
Living Room 8 (18.5m ²)	Daytime $L_{Aeq,16hr}$	23	35	Yes
Bedroom-8 (18.5m ²)	Night-time $L_{Aeq,8hr}$	23	30	Yes
Bedroom 8 (18.5m ²)	Night-time L_{AFmax}	43	45	Yes
L/D/K means living/ dining/ kitchen area				

2.6. Site & Measurement Location

The site is located in a residential area on Hayes End Road. Noise levels were measured 1 metre away from the ground floor façades of the site.

3. Environmental Noise Survey

3.1. Source under Investigation

The noise source identified on-site was road traffic noise, pedestrians' noise, and airplane noise.

3.2. Weather Conditions

Weather conditions were noted to be 11 degrees Celsius with a clear sunny sky at the beginning of the measurements with a light wind, which was less than 3m/s, and 10 degrees Celsius at the end of the measurements with a mostly clear sunny sky and a wind, which was less than 2m/s. These weather conditions were checked against and confirmed using the Meteorology Office mobile application available on smart phone technology.

3.3. Measurement Equipment

Measurement equipment that was used for the survey complies with accuracy requirements for common environmental noise measurement standards. The noise monitoring equipment was calibrated before and after the measurements. No significant drift was recorded. A detailed equipment list is given in **Appendix A** with calibration information in **Appendix B**.

3.4. Measurement Results

Daytime noise level: The results from the measurements taken at the site, 16-hour noise level (dB $L_{Aeq,16hr}$) are summarised in the Table 2 and graphically in Figure 1. The measured spectral data (dB $L_{eq,16hr}$) for the daytime is used to give a broadband noise level that is equal to dB $L_{Aeq,16hr}$.

Table 2a: Daytime 16-hour Noise Level (dB $L_{Aeq,16hr}$) at the site

#	Starting Time	Finishing Time	$L_{Aeq,1hr}$ (dB)	$L_{Amax, 1hr}$ (dB)	$L_{A10,1hr}$ (dB)	$L_{A90,1hr}$ (dB)
1	07:00	08:00	50	64	53	45
2	08:00	09:00	55	70	58	47
3	09:00	10:00	59	73	63	50
4	10:00	11:00	56	74	58	48
5	11:00	12:00	54	71	56	46
6	12:00	13:00	57	72	60	47
7	13:00	14:00	56	75	58	47
8	14:00	15:00	56	74	59	48

9	15:00	16:00	59	73	64	50
10	16:00	17:00	61	77	66	53
11	17:00	18:00	61	73	66	52
12	18:00	19:00	59	76	63	51
13	19:00	20:00	54	71	56	48
14	20:05	21:05	52	70	54	47
15	21:05	22:05	53	68	54	46
16	22:05	23:05	51	64	53	46
Average Levels			57	73	61	49

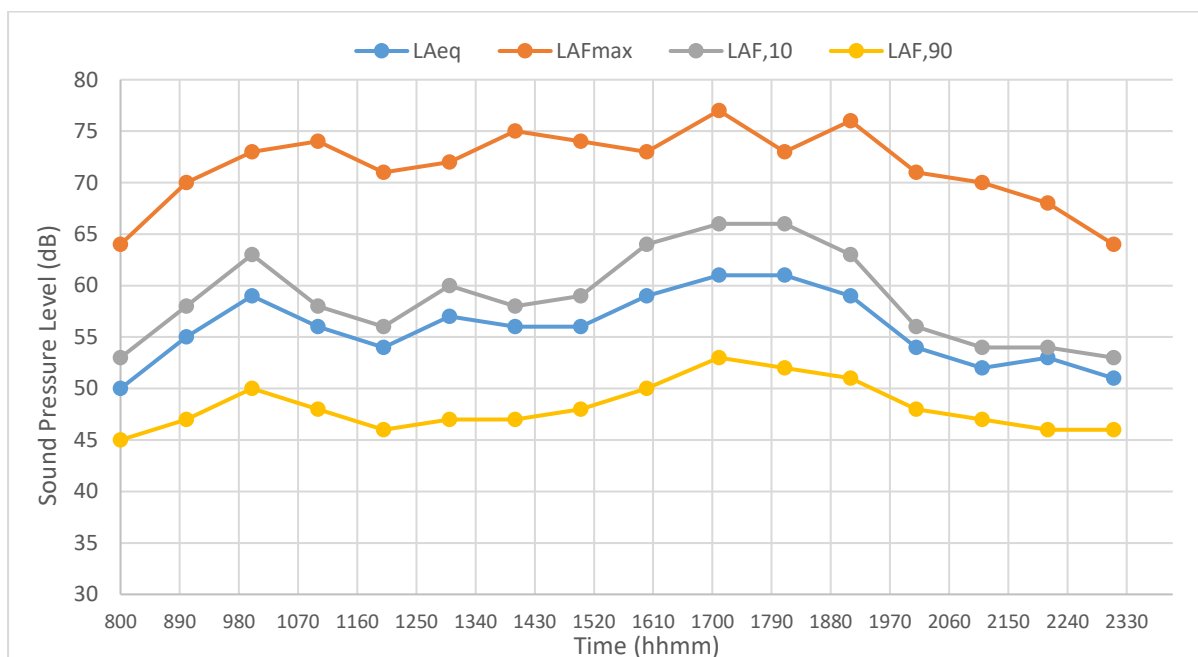


Figure 1: A graphical comparison of the noise indices at the site for the daytime 16-hours on.

Octave band noise spectra $dB L_{eq}$ that were measured at the site are given in Table 2b.

Table 2b: Day time 16 hours octave band spectra, $dB L_{eq}$.

#	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz
1-16	51	51	47	50	43
Highest levels	59	58	53	54	45

Octave band maximum noise spectra $dB L_{Max}$ that were measured at the site are given in Table 2c.

Table 2c: Day time 16 hours octave band maximum noise spectra, $dB L_{Max}$.

#	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz
1-16	71	70	64	66	58
Highest levels	80	78	72	69	62

Night-time noise level: The results from the measurements taken at the site, 8-hour noise level ($dB L_{Aeq}$) are summarised in the Table 3. The measured spectral data for the night-time is used to give a broadband noise level that is equal to $dB L_{Aeq}$. But night-time noise levels are not

higher than day-time noise levels. Therefore, for worst-case scenario, daytime noise levels are used to predict internal noise levels in bedrooms.

Table 3a: Night-time Noise Level (dB L_{Aeq}) at the site.

#	Starting Time	Finishing Time	$L_{Aeq,1hr}(dB)$	$L_{Amax,1hr}(dB)$	$L_{A10,1hr}(dB)$	$L_{A90,1hr}(dB)$
1	23:05	00:05	49	57	52	45
2	00:05	01:05	47	64	49	44
3	01:05	02:05	46	55	49	46
4	02:05	03:05	46	69	48	44
5	03:05	04:05	47	55	50	46
6	04:05	05:05	49	60	51	46
7	05:05	06:05	49	59	51	47
8	06:05	07:05	53	74	55	44
Average Levels			49	67	51	45

Octave band noise spectra $dB L_{eq}$ that were measured *at the site* are given in Table 3b.

Table 3b: Night-time 8 hours octave band spectra, $dB L_{eq}$.

#	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz
1-8	46	43	40	42	34
Highest level	49	46	41	44	37

Octave band maximum noise spectra $dB L_{Max}$ that were measured at the site are given in Table 3c.

Table 3c: Night-time 8 hours octave band maximum noise spectra, $dB L_{Max}$.

#	125 Hz	250 Hz	500 Hz	1000 Hz	2000 Hz
1-8	57	55	53	54	48
Highest level	63	65	60	65	55

3.5. Observation

Noise level measurements were carried out at the site as shown in Tables 2-3. Observations and detailed notes were made of the significant noise sources, which contribute to each of the measured levels.

Road Traffic Noise: Road traffic noise from Hayes End Road was audible at the monitoring location, and it was subjectively loud during the measurement. It was dominant noise source.

Site Sound Sources: There were not mechanical sound sources in operation at noise survey locations during the measurements and no other audible noise at the site.

People Noise: Noise from pedestrian using Hayes Ed Road and from the people nearby were audible at measurement location. But it was not subjectively loud during the measurement.

Neighbourhood Sound Source: No mechanical noise from nearby shops was audible at survey location.

Airplane noise: Noise from airplanes was audible at the survey locations and it was subjectively loud during measurement.

Bird sound: Noise from birds was audible at the survey locations but it was not subjectively loud during the measurement.

3.6. Uncertainty

The conclusion of this environmental noise survey is based on the noise monitoring undertaken at the site. The levels of uncertainty in the data and calculations are low given the robust measurements undertaken in noise monitoring and the confidence in the data statistical analysis.

4. Noise Impact Assessment

4.2 Day noise impact assessment

Normal Conversation at 1m has a sound pressure level between 40-6-dB(A). So, as a worst-case scenario, 60dB(A) was used in the report. So day rating level $L_{Aeq\ Tr,1h}$ at the front of the site is 60dB(A).

Day Rating Level $L_{Aeq\ Tr,1h} = 60\text{dB(A)}$.

4.3 Night noise impact assessment

Normal Conversation at 1m has a sound pressure level between 40-6-dB(A). So, as a worst-case scenario, 60dB(A) was used in the report. So day rating level $L_{Aeq\ Tr,1h}$ at the front of the site is 60dB(A).

Night Rating Level $L_{Aeq\ Tr,1h} = 60\text{dB(A)}$.

4.4 Distance attenuation

The noise sensitive receptors to noise sources were noted to be windows of ground and first floors of 103 and 107 Hayes End Road. The noise levels at window of the noise sensitive receptors can be predicted using outdoor sound propagation equation.

- Distance attenuation at 4 metres (107 Hayes End Road, ground floor, window) from discharge of noise sources is 12dB(A) using a 1m measurement distance from the noise source.
- Distance attenuation at 5 metres (107 Hayes End Road, first floor, window) from discharge of noise sources is 14dB(A) using a 1m measurement distance from the noise source.
- Distance attenuation at 5 metres (103 Hayes End Road, ground floor, window) from discharge of noise sources is 14dB(A) using a 1m measurement distance from the noise source.
- Distance attenuation at 6.5 metres (103 Hayes End Road, first floor, window) from discharge of noise sources is 16dB(A) using a 1m measurement distance from the noise source.

4.5 Barrier attenuation

Screening of the noise units to prevent line of sight to the sound source would reduce noise levels at the receivers. *Theory of outdoor sound propagation suggest that if the line-of-sight is significantly cut by a barrier/wall then a 10dB(A) reduction can be expected. If the line-of-sight is just cut by a barrier/wall, then a 5dB(A) reduction might be expected.*

The line-of-sight of windows is not cut by any barrier, then no reduction might be expected.

4.6 BS4142:2014 + A1:2019 Assessment for nearest noise sensitive receptors

4.6.1 103-Hayes End Road windows

The predicted Rating Levels $L_{Aeq\ Tr}$ at the receptor is 6dB(A) and 4dB(A) below background noise level at the ground-floor window level of noise sensitive receptor for day and at the first-floor window level of noise sensitive receptor for night respectively as calculated in table below. In accordance with BS 4142:2014+A1:2019 guidance and criteria, *the rating level does*

not exceed the background sound level. This is an indication of the specific sound source having a low adverse impact (low adverse impact likely).

BS4142:2014+A1:2019 Assessment	Day dB(A) G/F Window	Night dB(A) F/F Window
Specific Sound Level	60	60
Characteristic penalty	0	0
Façade correction	-3	-3
Distance attenuation at 5m and at 6.5m	-14	-16
Line-of-site cut (barrier attenuation)	0	0
Rating Level at receptor point	43	41
Background Level, L_{A90}	49	45
Difference between rating and background level	-6	-4

4.6.2 107-Hayes End Road windows

The predicted Rating Levels $L_{Aeq,Tr}$ at the receptor is 4dB(A) and 2dB(A) below background noise level at the ground-floor window level of noise sensitive receptor for day and at the first-floor window level of noise sensitive receptor for night respectively as calculated in table below. In accordance with BS 4142:2014+A1:2019 guidance and criteria, *the rating level does not exceed the background sound level. This is an indication of the specific sound source having a low adverse impact (low adverse impact likely).*

BS4142:2014+A1:2019 Assessment	Day dB(A) G/F Window	Night dB(A) F/F Window
Specific Sound Level	60	60
Characteristic penalty	0	0
Façade correction	-3	-3
Distance attenuation at 4m and at 5m	-12	-14
Line-of-site cut (barrier attenuation)	0	0
Rating Level at receptor point	45	43
Background Level, L_{A90}	49	45
Difference between rating and background level	-4	-2

4.6.3 External amenity (107 Hayes End Road)

BS8233:2014 provides a desirable guideline of 50dB $L_{Aeq,16hr}$ for external amenity spaces and an acceptable guideline of 55dB $L_{Aeq,16hr}$ for noisier environments.

Nearest external amenity space is the rear garden of 107 Hayes End Road, which is approximately 2m from the members of the site using the rear garden. The predicted daytime Rating Level $L_{Aeq Tr,1h}$, at the external amenity space is 49dB(A). The Rating Level $L_{Aeq Tr,1h}$, at the external amenity space is in the desirable category of BS8233:2014.

BS4142:2014+A1:2019 Assessment	Day dB(A)
Specific Sound Level	60
Characteristic penalty	0
Façade correction	0
Distance attenuation at 2m	-6
Line-of-site cut by fences	-5

5. BS8233:2014 Noise Assessment

5.1. Criteria

For desirable internal and external noise levels to be maintained, the assessment criteria are given in BS8233:2014 as:

- 35dB $L_{Aeq,16hr}$ within living rooms (07:00 – 23:00).
- 30dB $L_{Aeq,8hr}$ within bedrooms (23:00 – 07:00).
- 45dB L_{Amax} should not be regularly exceeded within bedrooms (23:00 – 07:00).
- <55dB $L_{Aeq,16hr}$ within external amenity spaces.

5.2. External Noise Analysis

Measured noise levels are shown in Tables 2-3, and they are characterised by environmental noise climate, which is dominated by road traffic noise, airplane noise, and by noise from public using Hayes End Road.

5.3. Internal Noise Levels

Internal noise levels were calculated in order to demonstrate that the proposed conversion of existing site to 8 *ensuite rooms* can achieve suitable internal noise levels inside rooms, when the suggested appropriate glazing, ventilation systems, walls and ceiling/roof systems are used.

In order to describe the likely internal exposure to environmental noise at the site, it is suggested using data from BS8233:2014 on standard construction materials. This will include all elements of the exposed living room and bedroom façades closest to the noise sources. A summary of assumed standard construction details is provided within Appendix C, Appendix D, and Appendix E.

5.4. Daytime Internal Noise Levels

The desirable limit of BS8233:2014 suggests a guideline of 35dB $L_{Aeq,16hr}$ for resting conditions, and up to 40dB considered acceptable for necessary developments.

Considering the insulation with 12.8SC/16/16.8SC Double Glazing unit, hit and miss trickle ventilation, wall, and roof/ceiling, daytime environmental noise internally would be reduced from 63dB $L_{Aeq,16hr}$ to interior levels of 27dB $L_{Aeq,16hr}$ (Ground Floor L/D/K, 35m²), 22dB $L_{Aeq,16hr}$ (First Floor Room-4, 12.50m²), and 23dB $L_{Aeq,16hr}$ (Second Floor Room-8, 18.5m²).

The assumed standard of construction would place the internal levels in dining / living/ kitchen areas as below 35dB. Therefore, daytime internal levels in dining/living areas are within the desirable category.

5.5. Night-time Internal Noise Levels

BS8233:2014 suggests a desirable guideline of 30dB $L_{Aeq,8hr}$ for sleeping conditions, with an acceptable limit of 35dB $L_{Aeq,8hr}$. Individual noise events (Measured with fast time-weighted Maximum) should not normally exceed 45dB L_{AFmax} (as in BS8233:2014).

Considering the insulation with 12.8SC/16/16.8SC Double Glazing unit, *hit and miss trickle ventilation*, wall, and roof/ceiling, night-time environmental noise in bedrooms would be reduced from 63dB $L_{Aeq,8hr}$ to interior levels of 23dB $L_{Aeq,8hr}$ (Ground Floor Room-3, 10.37m²), 22dB $L_{Aeq,8hr}$ (First Floor Room-4, 12.50m²), and 23dB $L_{Aeq,8hr}$ (Second Floor Room-8, 18.50m²).

Maximum individual noise events would be reduced from 83dB L_{AFmax} to internal levels of 43dB L_{AFmax} (Ground Floor Room-3, 10.37m²), 42dB L_{AFmax} (First Floor Room-4, 12.50m²), and 43dB L_{AFmax} (Second Floor Room-8, 18.50m²).

The assumed standard of construction would place the internal continuous levels in bedrooms as below 30dB $L_{Aeq,8hr}$ and maximum noise level as below 45dB L_{AFmax} . Therefore, night-time internal noise levels in bedrooms are in the desirable category.

6. Vibration

In addition to the control of airborne noise transfer, it is essential to consider the transfer of noise as vibration to the proposed dwellings. It is also important to consider the transmission of vibration from the roads to the building façade. A subjective analysis of the ground borne vibration was carried out at the site. Hard ground/surfaces and the existing walls around the building were checked. Based on subjective assessment, no vibration from the noise sources and vibration sources was observed at the site. There were not any structural borne noise and vibration from the noise sources at the site.

7. Sound Insulation Scheme

The recommended minimum requirements in terms of glazing and ventilation are given in Table 4. This is to ensure desirable internal noise levels are achieved. Detailed specifications could be found in Appendix C, Appendix D, and Appendix E.

Table 4: Façade Specifications

Internal Space	Glazing		Ventilation	
	Minimum Performance R_w+C_{tr}	Suggested Specification	Minimum Performance, $D_{nT,w}+C_{tr}$ (open)	Suggested Specification
Living Rooms	51	12.8SC/16/16.8SC Double Glazing	32	Hit & Miss Trickle, Ventilators
Bedrooms	51	12.8SC/16/16.8SC Double Glazing	32	Hit & Miss Trickle, Ventilators

7.1. Sound Insulation Assessment for floors and party walls

Sound insulation performance of the proposed flats is given in Appendix C, Appendix D, and Appendix E.

The internal floors of ground floor rooms and upper floor roomss: Approved Document E condition states that “**The scheme shall achieve a minimum airborne sound insulation value of 43 dB ($D_{nTw} + C_{tr}$ dB) for all floors, stairs, and walls, and an impact sound insulation value of 64 dB ($L_{nT,w}$ dB) for all floors and stairs.** BS 8233:2014 states that “Airborne sound insulation is mainly considered for intermediate floors between spaces containing either noise sources or noise-sensitive occupants. For a ground floor where there is neither an appreciable noise source nor a noise-sensitive occupant below the floor, the floor is only of interest if it could contribute to flanking transmission. A higher standard of sound insulation may be required between spaces used for normal domestic purposes and communal or non-domestic purposes”.

To control the transfer of noise from the ground floor shops to the first-floor flat, a sound insulation scheme given in Figure 2 is suggested. 100mm mineral wool quilt with minimum density 12kg/m³ should be used to fill the cavity between existing joists and finished with 15mm FIRELINE plasterboard to achieve 60min fire rating. In addition to existing floor, additional insulation (**Similar to Approved Document E, page 61 section 4.31/4.32/4.33/4.34 for details**) should be used. A minimum of 18mm chipboard, 19mm acoustic plasterboard on

Danskin or similar RELEX battens @400mm centres with 12mm acoustic insulation fitted between battens on existing floor joists. Proposed new ceiling scheme in Figure 2 will reduce noise level significantly and satisfy the required minimum sound insulation value of 43dB that is set by Approved Document E.

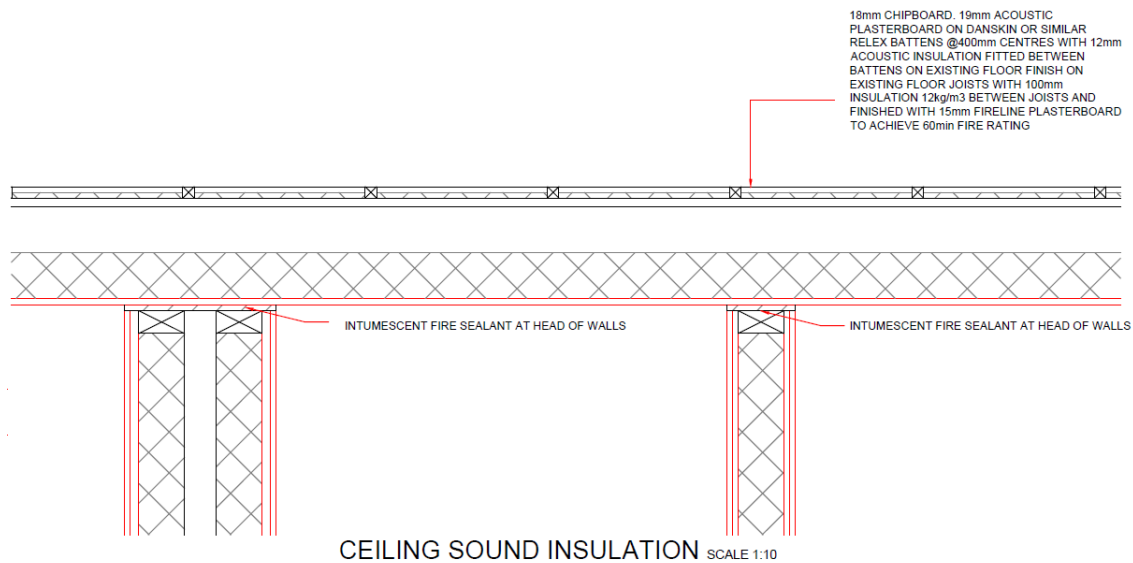


Figure 2: Suggested ceiling scheme for additional sound insulation for the floor between ground floor rooms and upper floor rooms.

The party walls: Approved Document E condition states that “The scheme shall achieve a minimum airborne sound insulation value of 43dB ($D_{nT,w} + C_{tr}$ dB) for all floors, stairs, and walls, and an impact sound insulation value of 64dB ($L_{nT,w}$ dB) for all floors and stairs”.

To control the transfer of noise between party walls, a sound insulation scheme given in Figure 3 is suggested to achieve a minimum airborne sound insulation value of 43dB ($D_{nT,w} + C_{tr}$ dB).

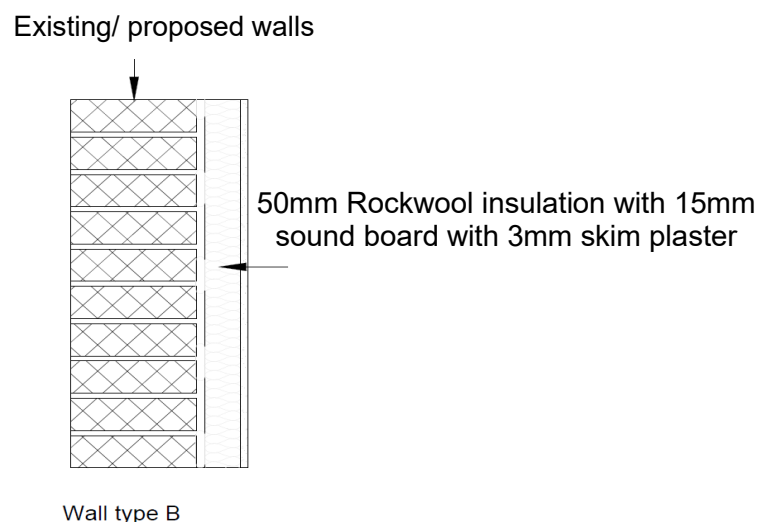


Figure 3: Upgrade of insulation to the party wall of the rooms.

The external walls: Approved Document E condition states that “The scheme shall achieve a minimum airborne sound insulation value of 43dB ($D_{nT,w} + C_{tr}$ dB) for all floors, stairs, and walls, and an impact sound insulation value of 64dB ($L_{nT,w}$ dB) for all floors and stairs”.

To control the transfer of noise through external walls from outside to the proposed rooms, a sound insulation scheme given in Figure 4 is suggested to achieve an airborne sound insulation value higher than 43dB ($D_{nTw} + C_{tr}$ dB). Proposed external wall scheme in Figure 4 will reduce noise level significantly and satisfy the required minimum sound insulation value of 43dB that is set by Approved Document E.

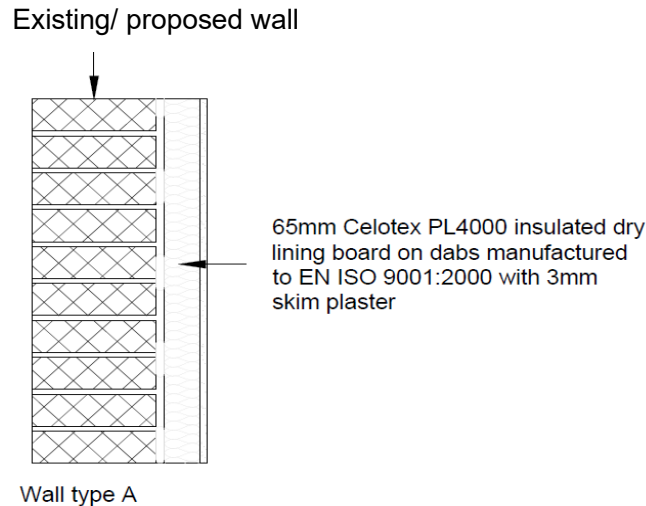


Figure 4: Upgrade of insulation to external walls of the rooms.

Following approval and implementation of the scheme, a test shall be undertaken to demonstrate that the attenuation measures carried out as part of the approved scheme are effective and achieve the specified criteria. All works, which form part of the approved scheme, shall be completed before the use commences.

8 Conclusion

An environmental noise survey was undertaken at the site in order to determine internal noise levels of *proposed residential ensuite rooms*. A BS4142:2014+A1:2019 and BS8233 noise assessment was carried out at the site. All worst-case situations were considered for this assessment. A rigorous calculation method that is given in BS8233 and based on measured environmental noise levels was used to determine interior noise levels in the *proposed ensuite rooms*.

In accordance with BS8233:2014 guidance:

- The daytime internal noise levels in living room are within the desirable category of 35dB(A) $L_{Aeq,16hr}$.
- The night-time internal noise levels in bedrooms are in the desirable category of 30dBA $L_{Aeq,8hr}$.
- The maximum individual noise events in bedrooms do not exceed 45dB(A) L_{AFmax} of the desirable category.

The results given in Table 1 demonstrate that the predicted indoor ambient noise levels, $L_{Aeq,16hr}$ for day, $L_{Aeq,8hr}$ for night and L_{AFmax} for night in the proposed residential rooms do not exceed the guideline values that are set in Table 4 of BS8233:2014.

We can confirm that the predicted internal ambient noise levels are within the standards set out in BS8233:2014 guidance.

The summary of the difference between the Rating Level and Background Noise Level of noise sensitive receptors is given in Table below.

Noise sensitive receptor	Difference between The Rating Level and Background Level	
	Day Ground Floor Window	Night First Floor Window
103 Hayes End Road	– 6dB(A)	– 4dB(A)
107 Hayes End Road	– 4dB(A)	– 2dB(A)

In accordance with BS4142:2014+A1:2019 guidance, the day Rating Levels at nearest noise sensitive receptors do not exceed the background sound level as shown in Table above. Therefore, the operation of the *site as multiple occupancy* indicates the specific sound source having a low adverse impact during daytime.

BS8233:2014 provides a desirable guideline of 50dB $L_{Aeq,16hr}$ for external amenity spaces and an acceptable guideline of 55dB $L_{Aeq,16hr}$ for noisier environments. The nearest external amenity space is rear garden of 107 Hayes End Road. The Rating Level $L_{Aeq,Tr}$ at the external amenity space is 49 dB and it does not exceed the guideline values of 50dB L_{Aeq} .

It can be confirmed that the Rating Level $L_{Aeq,Tr}$ of the site operating as multiple occupancy is expected to comply with BS4142:2014+A1:2019 guidance.

Also, we can confirm that there were not any structural borne noise and vibration from the noise sources nearby the site.

9. References

- BS 8233:2014 “Guidance on sound insulation and noise reduction for buildings”.
- Approved Document E, the building regulation 2010. HM Government.
- The National Planning Policy Framework (NPPF)-2024. Ministry of Housing, Communities, and Local Government.
- The Noise Policy Statement for England (NPSE) -2010. Department for Environment, Food and Rural Affairs.
- World Health Organisation Guidelines for Community Noise (1999).
- BS4142:2014+A1:2019, “Methods for rating and assessing industrial and commercial sound”. BSI standards publication.

10. Appendixes

10.1. Appendix A: Equipment details

Description of the Equipment used for measurements

Equipment	Description	Quantity	Serial No
Norsonic SLM	Type 1 sound level meter, NOR140	1	1402815
Norsonic	½ inch microphone	1	1225
Norsonic	Preamplifier	1	1209
B&K Calibrator	Type 4230, Class 1 (94 dB)	1	1410722

10.2. Appendix B: Measurement Location and Calibration Details



Google map showing the site


● Red circle shows the location of noise measurements at the front of the site, and Red rectangle shows the site.

Calibration Details				
Calibrator Ref Level (dB)	Level Before (dB)	Deviation Before (dB)	Level After (dB)	Deviation After (dB)
94	93.90	-0.10	93.80	-0.20

10.3. Appendix C: Ground Floor

BS8233:2014 Specification Calculations / Construction Details, DAY – Living/ Dining/ Kitchen Area (35m²), Ground Floor (89.52m²)

Room Properties		Sound Insulation Properties					
Room Width (m)	2.8	Frequency, Hz	125	250	500	1k	2k
Room Depth (m)	12.5	Wall, $R_{w,Ctr}$ (dB)	40	44	45	51	56
Room Height (m)	2.794	Ceiling, $R_{w,Ctr}$ (dB)	28	34	40	45	49
Glazed Area (m ²)	4	Glazing, $R_{w,Ctr}$ (dB)	27	32	43	46	48
Is dwelling on top floor?	No	Vents, $D_{new,Ctr}$ (dB)	37	36	35	36	34

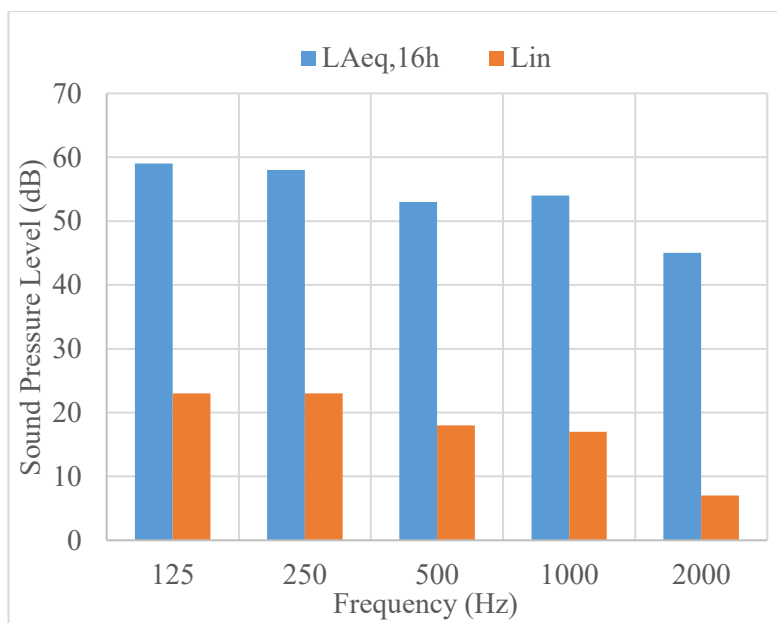


External Level **63 dB**
 L_{Aeq}
 Internal Level **27dB**
 L_{Aeq}
 Insertion Loss **36dB**
 L_{Aeq}

Sound Insulation Requirement			
Minimum Sound Insulation Requirement			Suitable Systems
Glazing	51	dB R_{w+Ctr}	12.8SC/16/16.8SC Double Glazing
Ventilation	32	dB $D_{new+Ctr}$	Hit & miss trickle vent Titan Trimvent XS13 4400EA

Transmission coefficients					
Frequency, Hz	125	250	500	1k	2k
Vents	5.21637E-06	6.56702E-06	8.26739E-06	6.56702E-06	1.0408E-05
Glazing	0.000208655	6.59825E-05	5.24117E-06	2.62681E-06	1.6574E-06
Wall	8.95425E-05	3.56475E-05	2.83158E-05	7.11261E-06	2.24921E-06
Ceiling	0.001450229	0.000364281	9.15033E-05	2.89359E-05	1.15196E-05
External, L_{eq} (dB)A	59	58	53	54	45
Internal L_{Aeq} (dB)A	23	23	18	17	7
Calculations are conducted in accordance with BS8233: 2014 rigorous calculation method: $L_{eq,2}=L_{eq,ff} + 10\log\left(\frac{A_0}{S} 10^{\frac{-D}{10}} + \frac{S_{wi}}{S} 10^{\frac{-R_{wi}}{10}} + \frac{S_{ew}}{S} 10^{\frac{-R_{ew}}{10}} + \frac{S_{rr}}{S} 10^{\frac{-R_{rr}}{10}}\right) + 10\log\left(\frac{S}{A}\right) + 3$					

BS8233: 2014 Specification Calculation Summary
Night –Bedroom, Ground Floor Room-3 (10.37m²)

Room Properties		Sound Insulation Properties					
Room Width (m)	2.2	Frequency, Hz	125	250	500	1k	2k
Room Depth (m)	4.71	Wall, $R_{w,Ctr}$ (dB)	40	44	45	51	56
Room Height (m)	2.794	Ceiling, $R_{w,Ctr}$ (dB)	28	34	40	45	49
Glazed Area (m ²)	1	Glazing, $R_{w,Ctr}$ (dB)	27	32	43	46	48
Is dwelling on top floor?	No	Vents, $D_{new,Ctr}$ (dB)	37	36	35	36	34

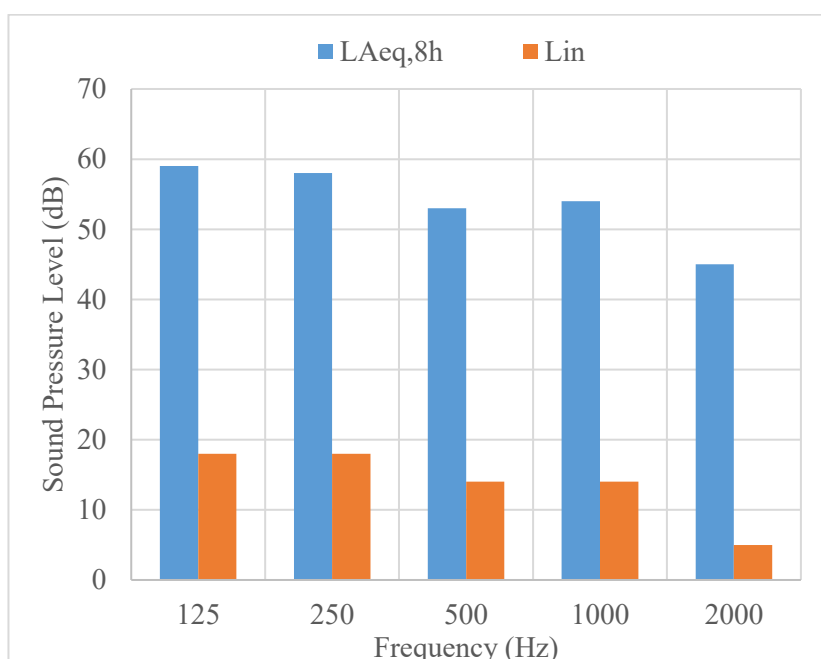


External Level **63dB**
 L_{Aeq}
 Internal Level **23B**
 L_{Aeq}
 Insertion Loss **40dB**
 L_{Aeq}

Sound Insulation Requirement			
Minimum Sound Insulation Requirement			Suitable Systems
Glazing	51	dB R_{w+Ctr}	12.8SC/16/16.8SC Double Glazing
Ventilation	32	dB $D_{new+Ctr}$	Hit & miss trickle vent Titan Trimvent XS13 4400EA

Transmission coefficients					
Frequency, Hz	125	250	500	1k	2k
Vents	1.155E-05	1.45406E-05	1.83055E-05	1.45406E-05	2.30453E-05
Glazing	0.0001155	3.65243E-05	2.90123E-06	1.45406E-06	9.17449E-07
Wall	9.42113E-05	3.75062E-05	2.97922E-05	7.48347E-06	2.36648E-06
Ceiling/Floor	0.000950661	0.000238795	5.99826E-05	1.89682E-05	7.55137E-06
External Level (dB)A	59	58	53	54	45
Internal Level (dB)A	18	18	14	14	5
Calculations are conducted in accordance with BS8233: 2014 rigorous calculation method: $L_{eq,2}=L_{eq,ff} + 10\log\left(\frac{A_0}{S} 10^{\frac{-D}{10}} + \frac{S_{wi}}{S} 10^{\frac{-R_{wi}}{10}} + \frac{S_{ew}}{S} 10^{\frac{-R_{ew}}{10}} + \frac{S_{rr}}{S} 10^{\frac{-R_{rr}}{10}}\right) + 10\log\left(\frac{S}{A}\right) + 3$					

BS8233: 2014 Specification Calculation Summary
Maximum Levels, Bedroom, Ground Floor Room-3 (10.37m²)

Room Properties		Sound Insulation Properties					
Room Width (m)	2.2	Frequency, Hz	125	250	500	1k	2k
Room Depth (m)	4.71	Wall, $R_{w,Ctr}$ (dB)	40	44	45	51	56
Room Height (m)	2.794	Ceiling, $R_{w,Ctr}$ (dB)	28	34	40	45	49
Glazed Area (m ²)	1	Glazing, $R_{w,Ctr}$ (dB)	27	32	43	46	48
Is dwelling on top floor?	No	Vents, $D_{new,Ctr}$ (dB)	37	36	35	36	34

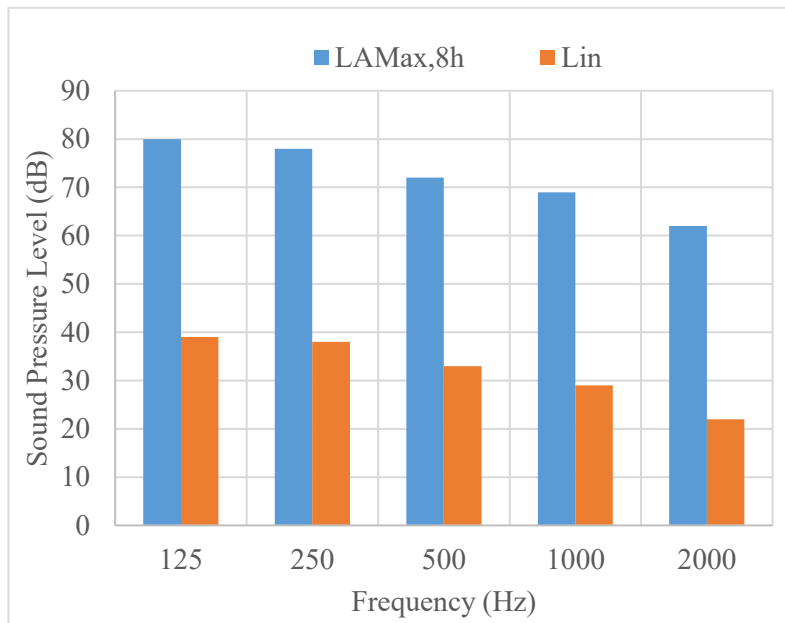

External Level **83dB**
 L_{Amax}

Internal Level **42dB**
 L_{Amax}

Insertion Loss **41dB**
 L_{Amax}

Sound Insulation Requirement			
Minimum Sound Insulation Requirement			Suitable Systems
Glazing	51	dB $R_{w+C_{tr}}$	12.8SC/16/16.8SC Double Glazing
Ventilation	32	dB $D_{new+C_{tr}}$	Hit & miss trickle vent Titan Trimvent XS13 4400EA

Frequency, Hz	Transmission coefficients				
	125	250	500	1k	2k
Vents	1.155E-05	1.45406E-05	1.83055E-05	1.45406E-05	2.30453E-05
Glazing	0.0001155	3.65243E-05	2.90123E-06	1.45406E-06	9.17449E-07
Wall	9.42113E-05	3.75062E-05	2.97922E-05	7.48347E-06	2.36648E-06
Ceiling	0.000950661	0.000238795	5.99826E-05	1.89682E-05	7.55137E-06
External Level (dB)A	80	78	72	69	62
Internal Level (dB)A	39	38	33	29	22


Calculations are conducted in accordance with BS8233: 2014 rigorous calculation method:

$$L_{eq,2}=L_{eq,ff} + 10\log\left(\frac{A_0}{S} 10^{\frac{-D}{10}} + \frac{S_{wi}}{S} 10^{\frac{-R_{wi}}{10}} + \frac{S_{ew}}{S} 10^{\frac{-R_{ew}}{10}} + \frac{S_{rr}}{S} 10^{\frac{-R_{rr}}{10}}\right) + 10\log\left(\frac{S}{A}\right) + 3$$

10.4. Appendix D: First Floor Room 4

BS8233:2014 Specification Calculations / Construction Details, Day- Living Area, First Floor Room-4 (12.50m²)

Room Properties		Sound Insulation Properties					
Room Width (m)	2.8	Frequency, Hz	125	250	500	1k	2k
Room Depth (m)	4.46	Wall, R _w , C _{tr} (dB)	40	44	45	51	56
Room Height (m)	2.66	Ceiling, R _w , C _{tr} (dB)	28	34	40	45	49
Glazed Area (m ²)	1	Glazing, R _w , C _{tr} (dB)	27	32	43	46	48
Is dwelling on top floor?	No	Vents, D _{new} , C _{tr} (dB)	37	36	35	36	34

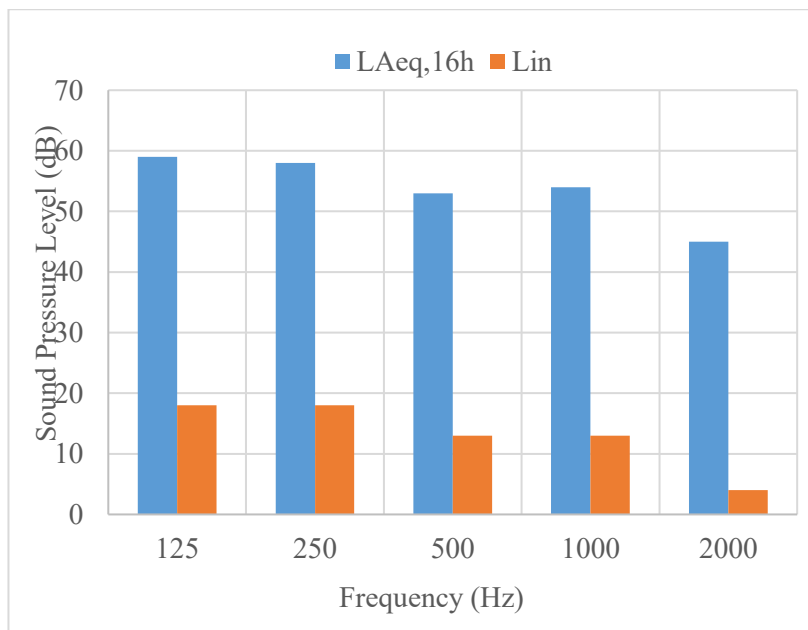

External Level **63dB**
 L_{Aeq}
 Internal Level **22dB**
 L_{Aeq}
 Insertion Loss **41dB**
 L_{Aeq}

Sound Insulation Requirement			
Minimum Sound Insulation Requirement			Suitable Systems
Glazing	51	dB R _w +C _{tr}	12.8SC/16/16.8SC Double Glazing
Ventilation	32	dB D _{new} +C _{tr}	Hit & miss trickle vent Titan Trimvent XS13 4400EA


Frequency, Hz	Transmission coefficients				
	125	250	500	1k	2k
Vents	1.08962E-05	1.301E-05	1.638E-05	1.301E-05	2.061E-05
Glazing	0.000103319	3.267E-05	2.595E-06	1.301E-06	8.207E-07
Wall	9.48218E-05	3.775E-05	2.999E-05	7.532E-06	2.382E-06
Ceiling	0.001024884	0.0002574	6.467E-05	2.045E-05	8.141E-06
External L_{eAeq} (dB)A	59	58	53	54	45
Internal L_{Aeq} (dB)A	18	18	13	13	4

Calculations are conducted in accordance with BS8233: 2014 rigorous calculation method:

$$L_{eq,2} = L_{eq,ff} + 10 \log \left(\frac{A_0}{S} 10^{\frac{-D}{10}} + \frac{S_{wi}}{S} 10^{\frac{-R_{wi}}{10}} + \frac{S_{ew}}{S} 10^{\frac{-R_{ew}}{10}} + \frac{S_{rr}}{S} 10^{\frac{-R_{rr}}{10}} \right) + 10 \log \left(\frac{S}{A} \right) + 3$$

BS8233: 2014 Specification Calculation Summary
Night – Bedroom, First Floor Room-4 (12.50m²)

Room Properties		Sound Insulation Properties					
Room Width (m)	2.8	Frequency, Hz	125	250	500	1k	2k
Room Depth (m)	4.46	Wall, Rw,Ctr (dB)	40	44	45	51	56
Room Height (m)	2.66	Ceiling, Rw,Ctr (dB)	28	34	40	45	49
Glazed Area (m ²)	1	Glazing, Rw,Ctr (dB)	27	32	43	46	48
Is dwelling on top floor?	No	Vents, Dnew,Ctr (dB)	37	36	35	36	34

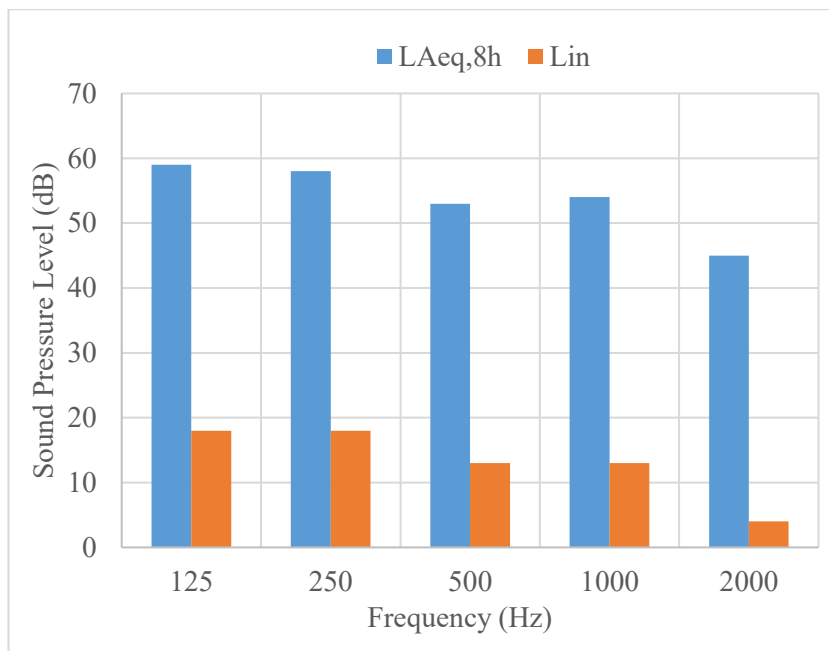

External Level **63dB**
 L_{Aeq}
 Internal Level **22dB**
 L_{Aeq}
 Insertion Loss **41dB**
 L_{Aeq}

Sound Insulation Requirement			
Minimum Sound Insulation Requirement			Suitable Systems
Glazing	51	dB $R_{w+C_{tr}}$	12.8SC/16/16.8SC Double Glazing
Ventilation	32	dB $D_{new+C_{tr}}$	Hit & miss trickle vent Titan Trimvent XS13 4400EA


Transmission coefficients					
Frequency, Hz	125	250	500	1k	2k
Vents	1.08962E-05	1.30071E-05	1.6375E-05	1.30071E-05	2.06149E-05
Glazing	0.000103319	3.26725E-05	2.59527E-06	1.30071E-06	8.20695E-07
Wall	9.48218E-05	3.77492E-05	2.99853E-05	7.53196E-06	2.38182E-06
Roof	0.001024884	0.000257439	6.46658E-05	2.04491E-05	8.14094E-06
External Level (dB)A	59	58	53	54	45
Internal Level (dB)A	18	18	13	13	4

Calculations are conducted in accordance with BS8233: 2014 rigorous calculation method:

$$L_{eq,2} = L_{eq,ff} + 10 \log \left(\frac{A_0}{S} 10^{\frac{-D}{10}} + \frac{S_{wi}}{S} 10^{\frac{-R_{wi}}{10}} + \frac{S_{ew}}{S} 10^{\frac{-R_{ew}}{10}} + \frac{S_{rr}}{S} 10^{\frac{-R_{rr}}{10}} \right) + 10 \log \left(\frac{S}{A} \right) + 3$$

BS8233: 2014 Specification Calculation Summary
Maximum Levels, Bedroom, First Floor Room-4 (12.50m²)

Room Properties		Sound Insulation Properties					
Room Width (m)	2.8	Frequency, Hz	125	250	500	1k	2k
Room Depth (m)	4.46	Wall, R _w ,C _{tr} (dB)	40	44	45	51	56
Room Height (m)	2.66	Ceiling, R _w ,C _{tr} (dB)	28	34	40	45	49
Glazed Area (m ²)	1	Glazing, R _w ,C _{tr} (dB)	27	32	43	46	48
Is dwelling on top floor?	No	Vents, D _{new} ,C _{tr} (dB)	37	36	35	36	34

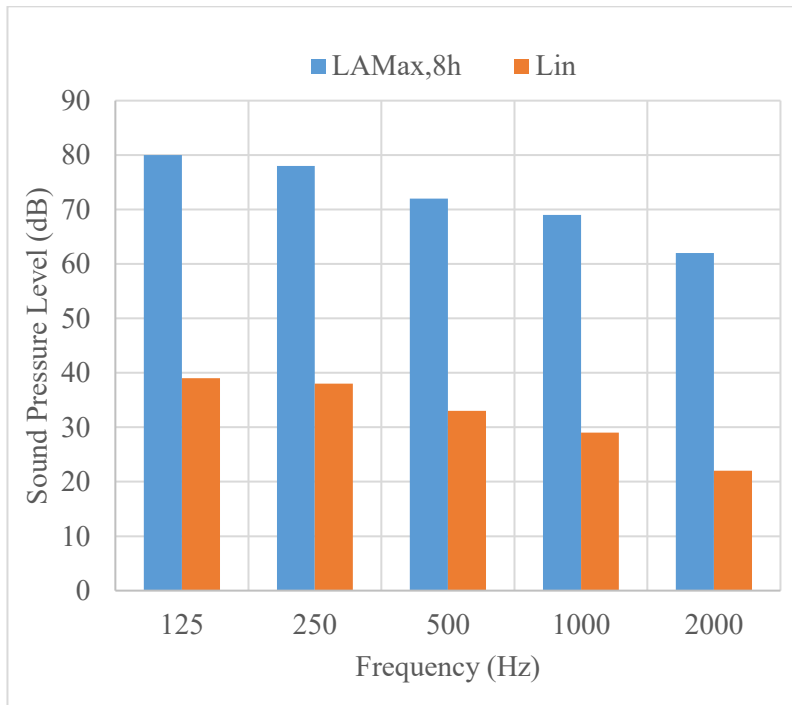

External Level **83dB**
L_{Amax}

Internal Level **42dB**
L_{Amax}

Insertion Loss **41dB**
L_{Amax}

Sound Insulation Requirement			
Minimum Sound Insulation Requirement			Suitable Systems
Glazing	51	dB R _w +C _{tr}	12.8SC/16/16.8SC Double Glazing
Ventilation	32	dB D _{new} +C _{tr}	Hit & miss trickle vent Titan Trimvent XS13 4400EA

Transmission coefficients					
Frequency, Hz	125	250	500	1k	2k
Vents	1.03319E-05	1.30071E-05	1.6375E-05	1.30071E-05	2.06149E-05
Glazing	0.000103319	3.26725E-05	2.59527E-06	1.30071E-06	8.20695E-07
Wall	9.48218E-05	3.77492E-05	2.99853E-05	7.53196E-06	2.38182E-06
Ceiling	0.001024884	0.000257439	6.46658E-05	2.04491E-05	8.14094E-06
External Level (dB)A	80	78	72	69	62
Internal Level (dB)A	39	38	32	28	21


Calculations are conducted in accordance with BS8233: 2014 rigorous calculation method:

$$L_{eq,2} = L_{eq,ff} + 10 \log \left(\frac{A_0}{S} 10^{\frac{-D}{10}} + \frac{S_{wi}}{S} 10^{\frac{-R_{wi}}{10}} + \frac{S_{ew}}{S} 10^{\frac{-R_{ew}}{10}} + \frac{S_{rr}}{S} 10^{\frac{-R_{rr}}{10}} \right) + 10 \log \left(\frac{S}{A} \right) + 3$$

10.5. Appendix E: Second Floor Room 8

BS8233:2014 Specification Calculations / Construction Details, Day - Living Area, Second Floor Room-8 (18.5m²)

Room Properties		Sound Insulation Properties					
Room Width (m)	4.2	Frequency, Hz	125	250	500	1k	2k
Room Depth (m)	4.4	Wall, R _w , C _{tr} (dB)	40	44	45	51	56
Room Height (m)	2.4	Ceiling, R _w , C _{tr} (dB)	28	34	40	45	49
Glazed Area (m ²)	3.5	Glazing, R _w , C _{tr} (dB)	27	32	43	46	48
Is dwelling on top floor?	Yes	Vents, D _{new} , C _{tr} (dB)	37	36	35	36	34

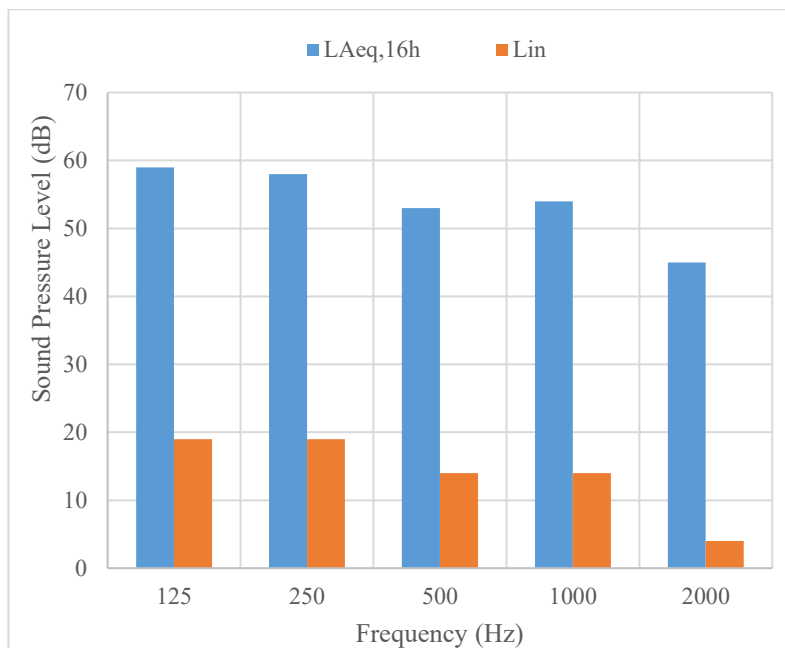

External Level **63dB**
L_{Aeq}

Internal Level **23dB**
L_{Aeq}

Insertion Loss **40dB**
L_{Aeq}

Sound Insulation Requirement			
Minimum Sound Insulation Requirement			Suitable Systems
Glazing	51	dB R _w +C _{tr}	12.8SC/16/16.8SC Double Glazing
Ventilation	32	dB D _{new} +C _{tr}	Hit & miss trickle vent Titan Trimvent XS13 4400EA


Frequency, Hz	Transmission coefficients				
	125	250	500	1k	2k
Vents	6.98621E-06	8.795E-06	1.107E-05	8.795E-06	1.394E-05
Glazing	0.000244517	7.732E-05	6.142E-06	3.078E-06	1.942E-06
Wall	8.77451E-05	3.493E-05	2.775E-05	6.97E-06	2.204E-06
Ceiling	0.001584893	0.0003981	0.0001	3.162E-05	1.259E-05
External <i>L_{eAeq}</i> (dB)A	59	58	53	54	45
Internal <i>L_{Aeq}</i> (dB)A	19	19	14	14	4

Calculations are conducted in accordance with BS8233: 2014 rigorous calculation method:

$$L_{eq,2} = L_{eq,ff} + 10 \log \left(\frac{A_0}{S} 10^{\frac{-D}{10}} + \frac{S_{wi}}{S} 10^{\frac{-R_{wi}}{10}} + \frac{S_{ew}}{S} 10^{\frac{-R_{ew}}{10}} + \frac{S_{rr}}{S} 10^{\frac{-R_{rr}}{10}} \right) + 10 \log \left(\frac{S}{A} \right) + 3$$

BS8233: 2014 Specification Calculation Summary
Night – Bedroom, Second Floor Room-8 (18.5m²)

Room Properties		Sound Insulation Properties					
Room Width (m)	4.2	Frequency, Hz	125	250	500	1k	2k
Room Depth (m)	4.4	Wall, R _w , C _{tr} (dB)	40	44	45	51	56
Room Height (m)	2.4	Ceiling, R _w , C _{tr} (dB)	28	34	40	45	49
Glazed Area (m ²)	3.5	Glazing, R _w , C _{tr} (dB)	27	32	43	46	48
Is dwelling on top floor?	Yes	Vents, D _{new} , C _{tr} (dB)	37	36	35	36	34

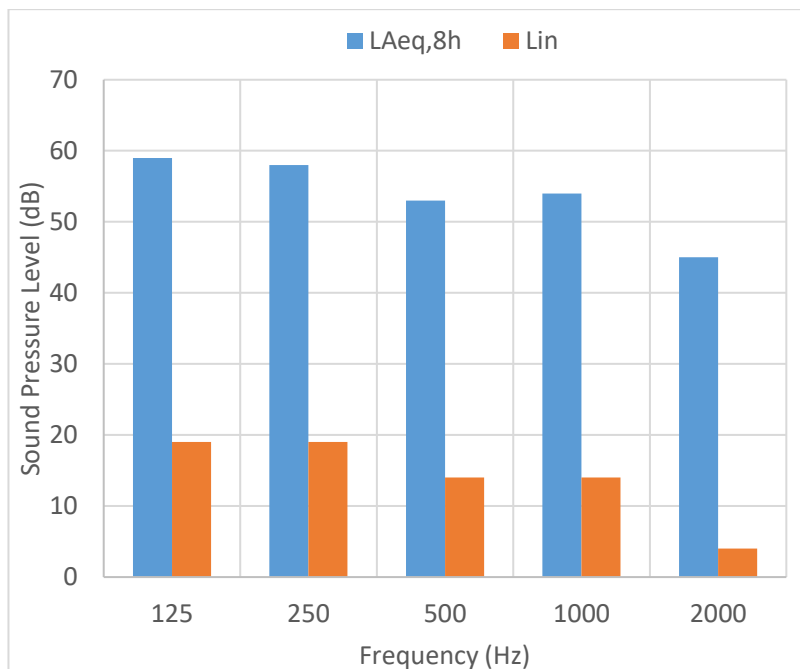

External Level **63dB**
 L_{Aeq}

Internal Level **23dB**
 L_{Aeq}

Insertion Loss **40dB**
 L_{Aeq}

Sound Insulation Requirement			
Minimum Sound Insulation Requirement		Suitable Systems	
Glazing	51	dB R _w +C _{tr}	12.8SC/16/16.8SC Double Glazing
Ventilation	32	dB D _{new} +C _{tr}	Hit & miss trickle vent Titan Trimvent XS13 4400EA


Frequency, Hz	Transmission coefficients				
	125	250	500	1k	2k
Vents	6.98621E-06	8.795E-06	1.107E-05	8.795E-06	1.394E-05
Glazing	0.000244517	7.732E-05	6.142E-06	3.078E-06	1.942E-06
Wall	8.77451E-05	3.493E-05	2.775E-05	6.97E-06	2.204E-06
Roof	0.001584893	0.0003981	0.0001	3.162E-05	1.259E-05
External Level (dB)A	59	58	53	54	45
Internal Level (dB)A	19	19	14	14	4

Calculations are conducted in accordance with BS8233: 2014 rigorous calculation method:

$$L_{eq,2}=L_{eq,ff} + 10\log\left(\frac{A_0}{S} 10^{\frac{-D}{10}} + \frac{S_{wi}}{S} 10^{\frac{-R_{wi}}{10}} + \frac{S_{ew}}{S} 10^{\frac{-R_{ew}}{10}} + \frac{S_{rr}}{S} 10^{\frac{-R_{rr}}{10}}\right) + 10\log\left(\frac{S}{A}\right) + 3$$

BS8233: 2014 Specification Calculation Summary
Maximum Levels, Second Floor Room-8 (18.5m²)

Room Properties		Sound Insulation Properties					
Room Width (m)	4.2	Frequency, Hz	125	250	500	1k	2k
Room Depth (m)	4.4	Wall, Rw,Ctr (dB)	40	44	45	51	56
Room Height (m)	2.4	Ceiling, Rw,Ctr (dB)	28	34	40	45	49
Glazed Area (m ²)	3.5	Glazing, Rw,Ctr (dB)	27	32	43	46	48
Is dwelling on top floor?	Yes	Vents, Dnew,Ctr (dB)	37	36	35	36	34

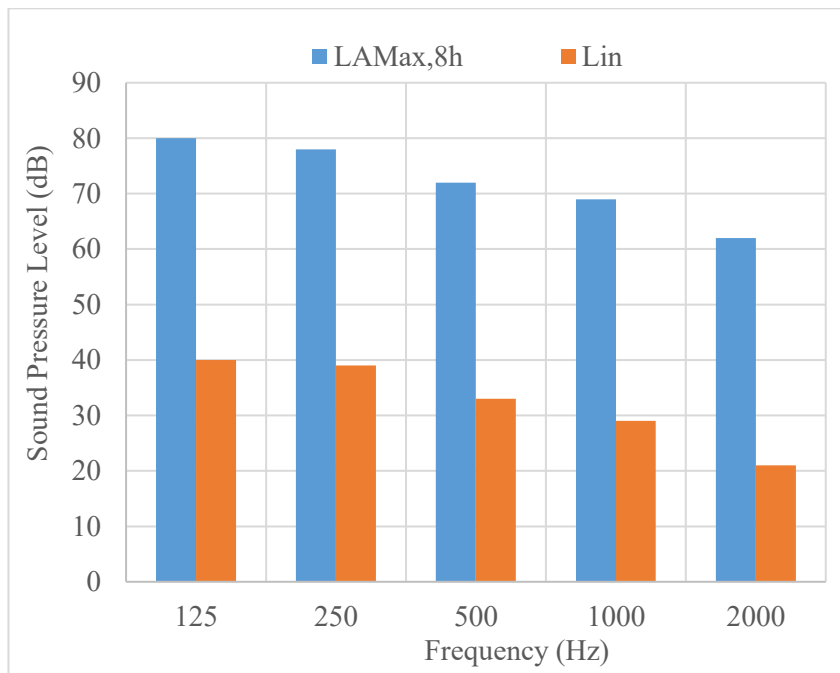

External Level **83dB**
 L_{Amax}

Internal Level **43dB**
 L_{Amax}

Insertion Loss **40dB**
 L_{Amax}

Sound Insulation Requirement			
Minimum Sound Insulation Requirement			Suitable Systems
Glazing	51	dB R_w+C_{tr}	12.8SC/16/16.8SC Double Glazing
Ventilation	32	dB $D_{new}+C_{tr}$	Hit & miss trickle vent Titan Trimvent XS13 4400EA

Frequency, Hz	Transmission coefficients				
	125	250	500	1k	2k
Vents	6.98621E-06	8.795E-06	1.107E-05	8.795E-06	1.394E-05
Glazing	0.000244517	7.732E-05	6.142E-06	3.078E-06	1.942E-06
Wall	8.77451E-05	3.493E-05	2.775E-05	6.97E-06	2.204E-06
Ceiling	0.001584893	0.0003981	0.0001	3.162E-05	1.259E-05
External Level (dB)A	80	78	72	69	62
Internal Level (dB)A	40	39	33	29	21

Calculations are conducted in accordance with BS8233: 2014 rigorous calculation method:

$$L_{eq,2}=L_{eq,ff} + 10\log\left(\frac{A_0}{S} 10^{\frac{-D}{10}} + \frac{S_{wi}}{S} 10^{\frac{-R_{wi}}{10}} + \frac{S_{ew}}{S} 10^{\frac{-R_{ew}}{10}} + \frac{S_{rr}}{S} 10^{\frac{-R_{rr}}{10}}\right) + 10\log\left(\frac{S}{A}\right) + 3$$

10.6. Appendix F: Building Regulations Approved Document E

Table 1: Building regulation Table 1a, E1.		
Dwelling-houses and flats – performance standards for separating walls, separating floors, and stairs that have a separating function		
	Airborne Sound Insulation $D_{nT,w}+C_{tr}$ dB (min. value)	Impact Sound Insulation $L_{nT,w}$ dB (max. value)
Purpose build dwelling-houses and flats		
Walls	45	-
Floors and stairs	45	62
Dwelling – houses and flats formed by material change of use		
Walls	43	-
Floors and stairs	43	64

Building Regulations Table 1b, E1

Table 2: Building Regulation Table 1b, E1		
Rooms for residential purposes – performance standards for separating walls, floors, and stairs that have a separating function.		
	Airborne Sound Insulation $D_{nT,w}+C_{tr}$ dB (min. value)	Impact Sound Insulation $L_{nT,w}$ dB (max. value)
Purpose build dwelling-houses and flats		
Walls	43	-
Floor and stairs	45	62
Dwellings – houses and flats formed by material change of use		
Walls	43	-
Floors and stairs	43	64

10.7. Appendix G: Acoustics terminology

Parameter	Description
Decibel (dB)	A logarithmic scale representing the sound pressure or power level relative to the threshold of hearing (20×10^{-6} Pascals).
Ambient noise level	The totally encompassing sound in a given $L_{Aeq,T}$ situation at a given time, usually composed of sound from many sources near and far.
Background noise level	The A-weighted sound pressure level of the $L_{A90,T}$ residual noise at the assessment position exceeded for 90% of a given time interval T, measured using the fast response and reported to the nearest whole dB.
Rating level $L_{Ar,T}$	The specific noise level plus any adjustment for the characteristic features of the noise.

Residual noise level	The ambient noise level at the assessment $L_{Aeq,T}$ position in the absence of the noise source under investigation.
Specific noise level	The equivalent continuous A-weighted noise $L_{Aeq,T}$ level produced by the source over a given reference time interval.
$L_{Aeq,T}$	The A-weighted equivalent continuous noise level over the time period T (typically T= 16 hours for daytime periods, T = 8 hours for night-time periods). This is the sound level that is equivalent to the average energy of noise recorded over a given period.
$L_{n,T}$	The noise level exceeded for n% of the time over a given period T. e.g., L90, the noise level exceeded for 90% of the time (background noise) level.
L_{Max}	The maximum noise level measured.
$L_{eq,ff}$	The equivalent continuous sound pressure level outside the room elements under consideration
A_0	A reference absorption area of 10 m ² and is independent of frequency;
S_f	The total facade area in square metres (m ²) of the room in question;
S_{wi}	The area in square metres (m ²) of the windows of the room;
S_{ew}	The area in square metres (m ²) of the external wall of the room;
S_{rr}	The area in square metres (m ²) of the ceiling of the room
S	The total area in square metres (m ²) of elements through which sound enters the room, i.e. $S_f + S_{rr}$;
$D_{n,e}$	The insulation of the trickle ventilator measured according to BS EN ISO 10140;
R_{wi}	The sound reduction index (octave band value) of the window (see Annex C BS EN ISO 10140)
R_{ew}	The sound reduction index (octave band value) of the external wall (see Annex C BS EN ISO 10140);
R_{rr}	The sound reduction index (octave band values) of the roof/ceiling (see Annex C BS EN ISO 10140);
A	The equivalent absorption area of the receiving room being considered (see Annex C BS EN ISO 10140);
3	A correction factor

10.8. Appendix H: Plans for proposed rooms

