
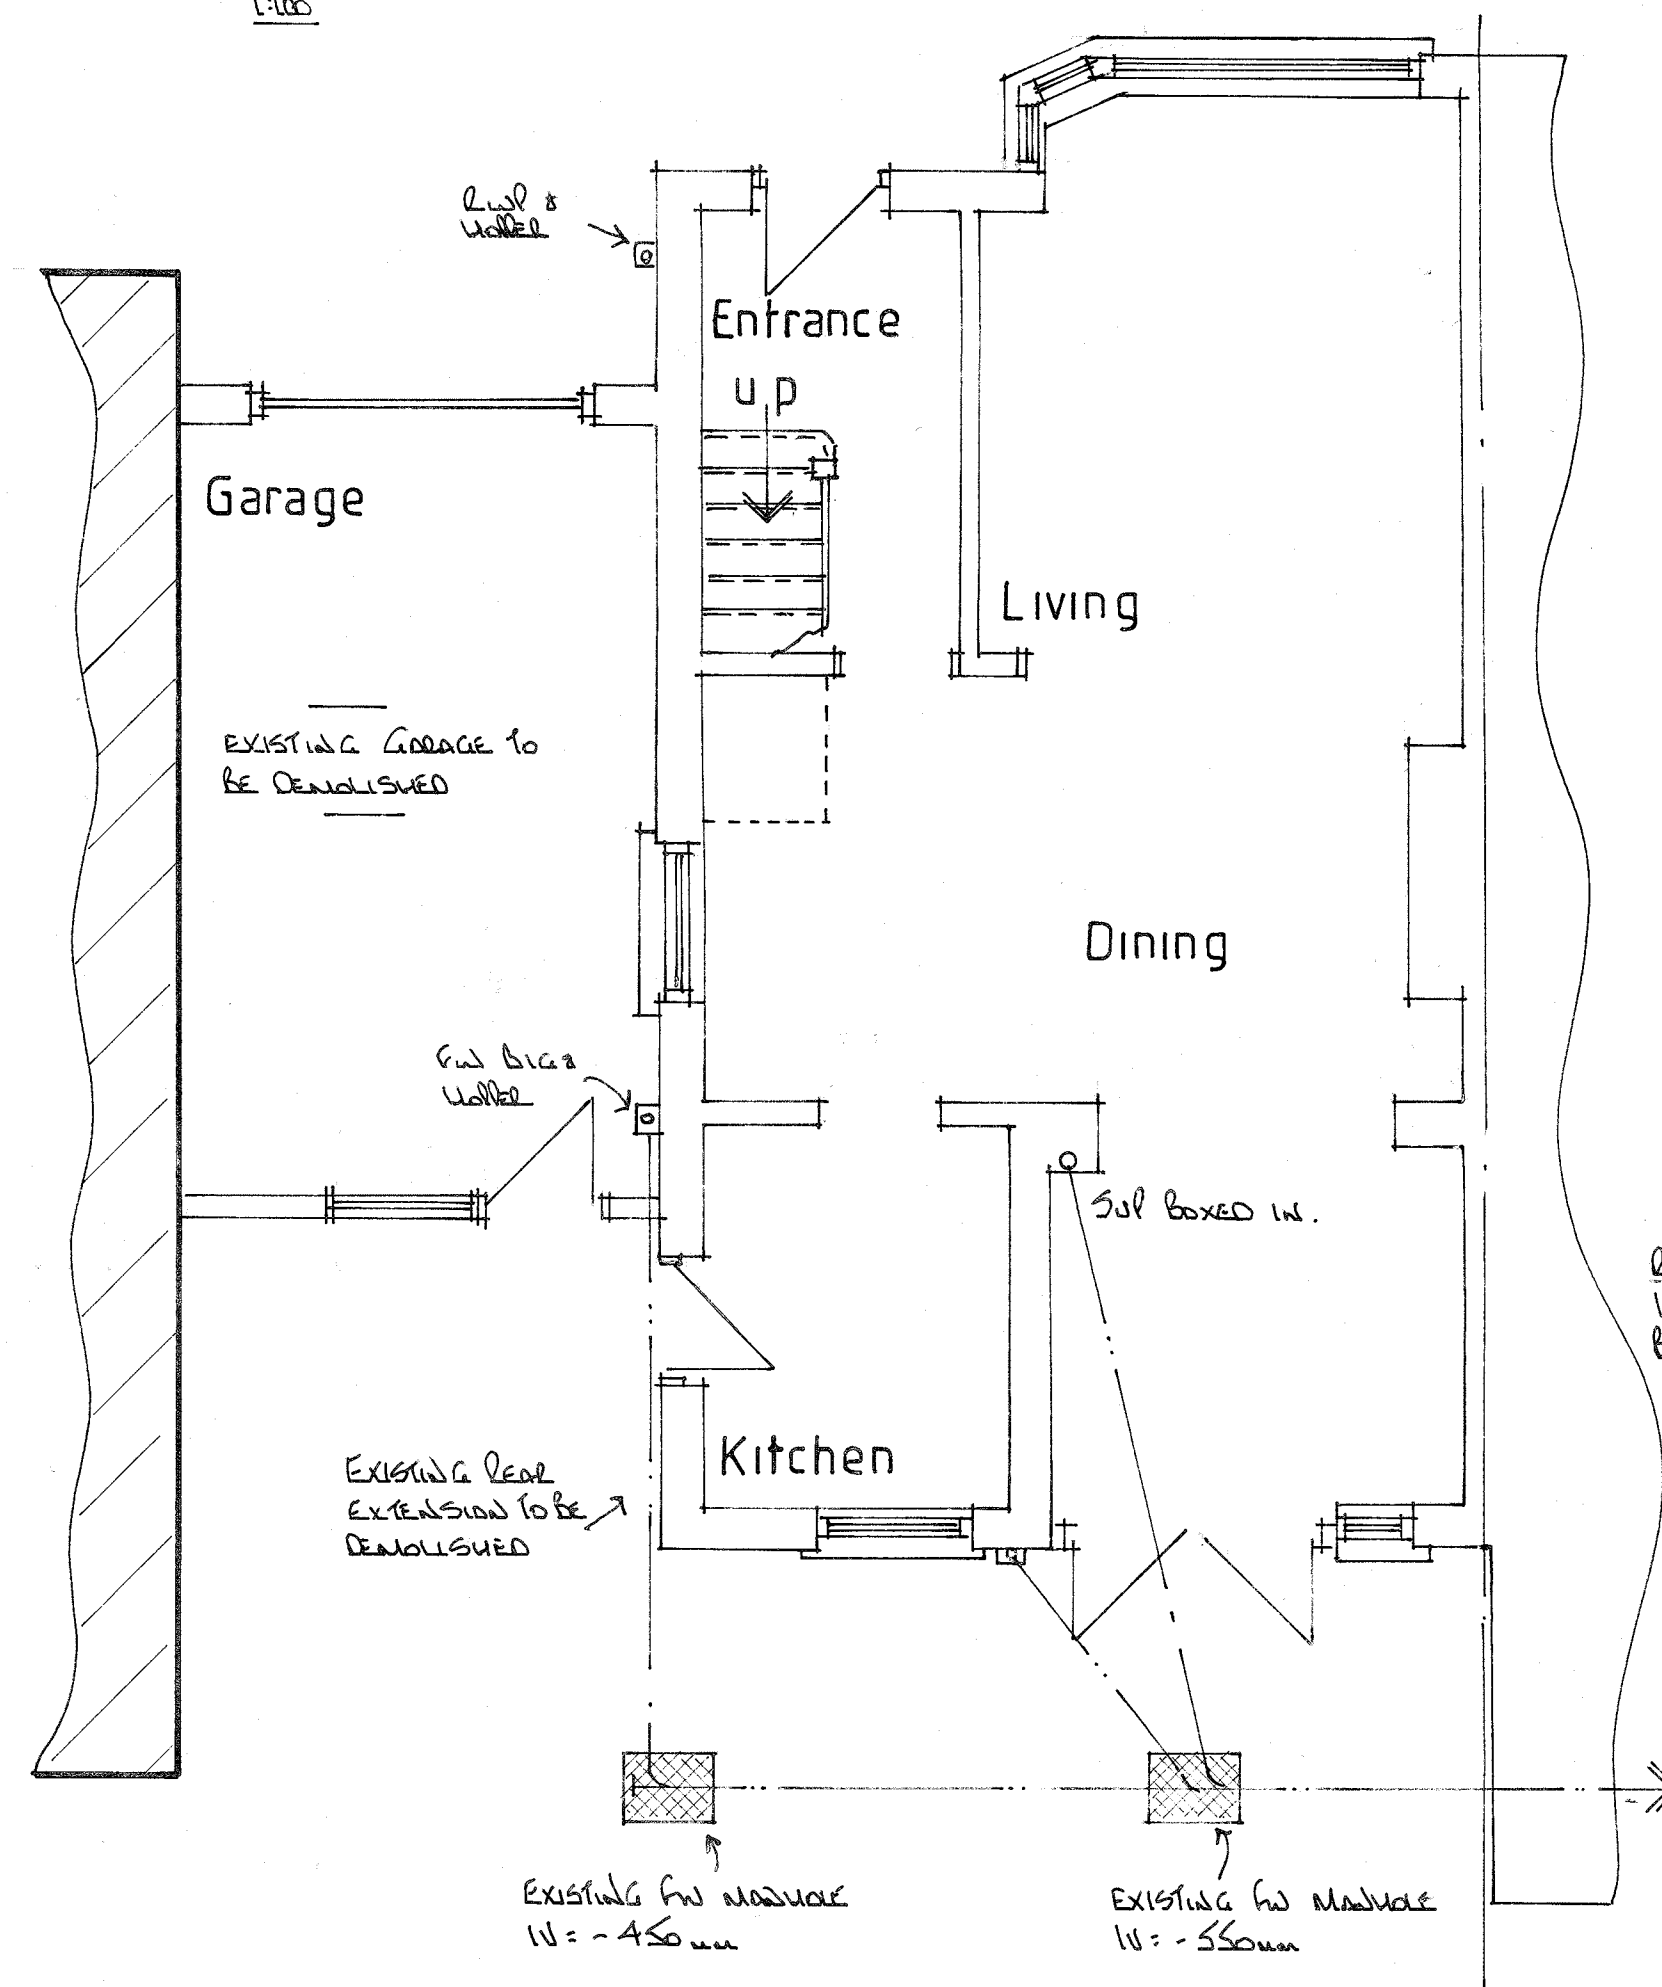


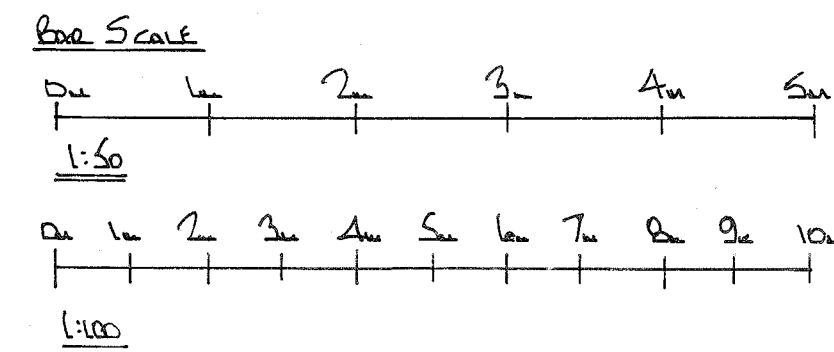

EXISTING GROUND FLOOR PLAN

CREATE NEW STRUCTURAL CEILING WITH PC LINTELS OVER & MAKE GOOD.


FOUNDATION TO BE EXCAVATED & RAISED IN SEQUENCE & 1.0m INCREMENTS SO AS NOT TO UNDERMINE NEIGHBOURS PROPERTY.

RESTED SUP TO TAKE WASTE FROM EXISTING BATHROOM AT 1st FLOOR LVL


KITCHEN TO HAVE MECH VENT TO OPEN AIR MAIN HOUS OR IF INTERLOCKED WITHIN A COOKER HOOD THEN SOILS.

NEW FW MANHOLE W = 400mm OFFSET - TO SUIT EXISTING DRAIN RUN

PROVIDE MAINS DELETED WATER CONNECTED SMOKE ALARMS AT GROUND 1st FLOOR CIRCULATING AREAS - ALL WITH BATTERY BACK UP. PROVIDE HEAT DETECTOR TO KITCHEN LINKED TO SMOKE ALARMS.

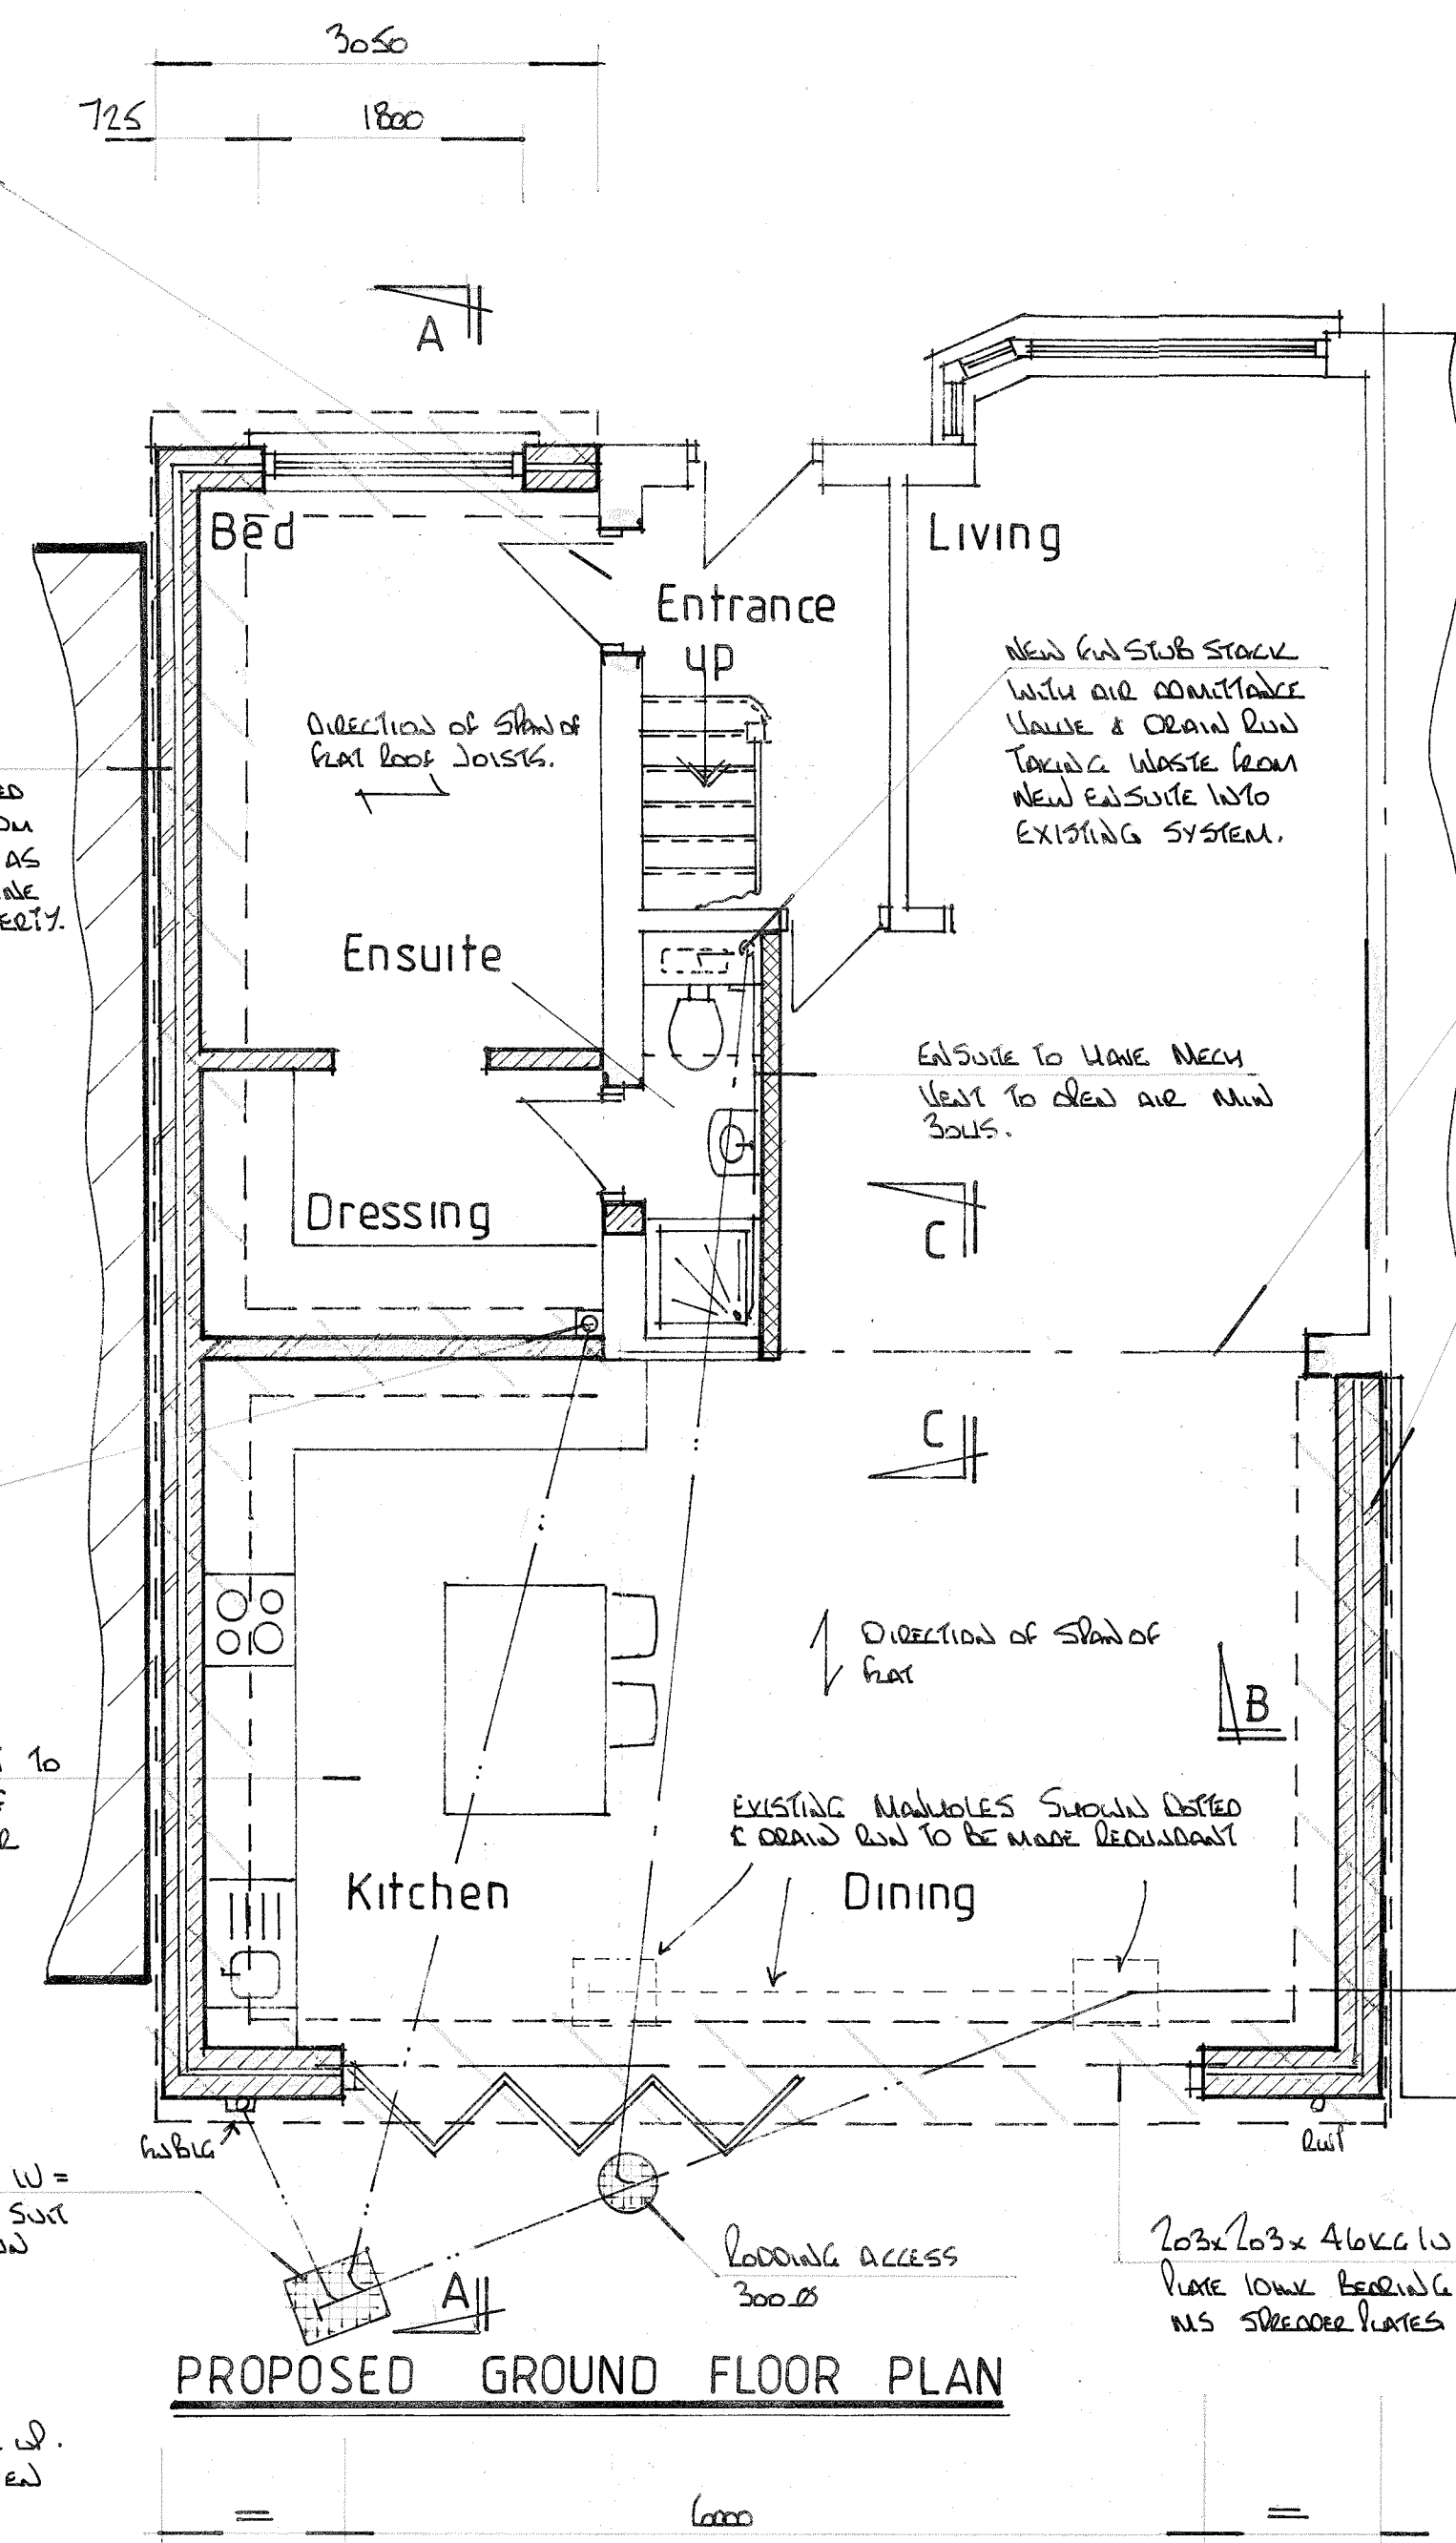


PROPOSED GROUND FLOOR PLAN

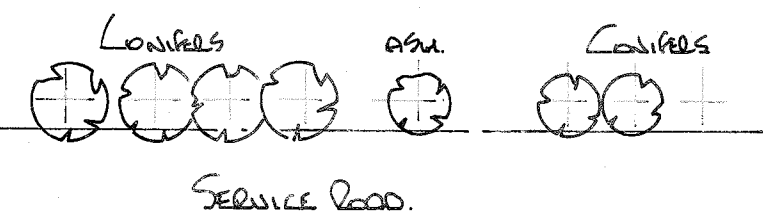

203x203x52x6102 BEARING ONTO 300x300x215x3000 CONCRETE BEAMS.

FOUNDATION TO BE EXCAVATED & RAISED IN SEQUENCE & 1.0m INCREMENTS SO AS NOT TO UNDERMINE NEIGHBOURS PROPERTY.

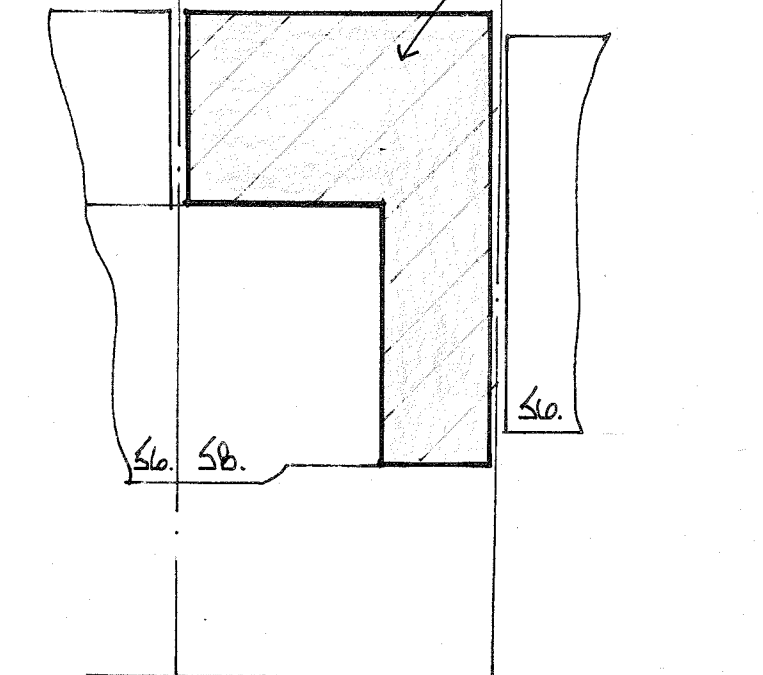





EXMOUTH ROAD

SITE PLAN scale 1:200

SURFACE WATER FROM NEW ROOF TO BE TAKEN TO SOAKAWAY WITH 1.0m³ PER EVERY 110.0m² ROOF TO BE DRAINAGE A 5.0m FROM ANY BUILDING.

THIS DRAWING TO BE READ IN CONJUNCTION WITH DRG No 4327 /02

ALL MATERIALS TO MATCH EXISTING

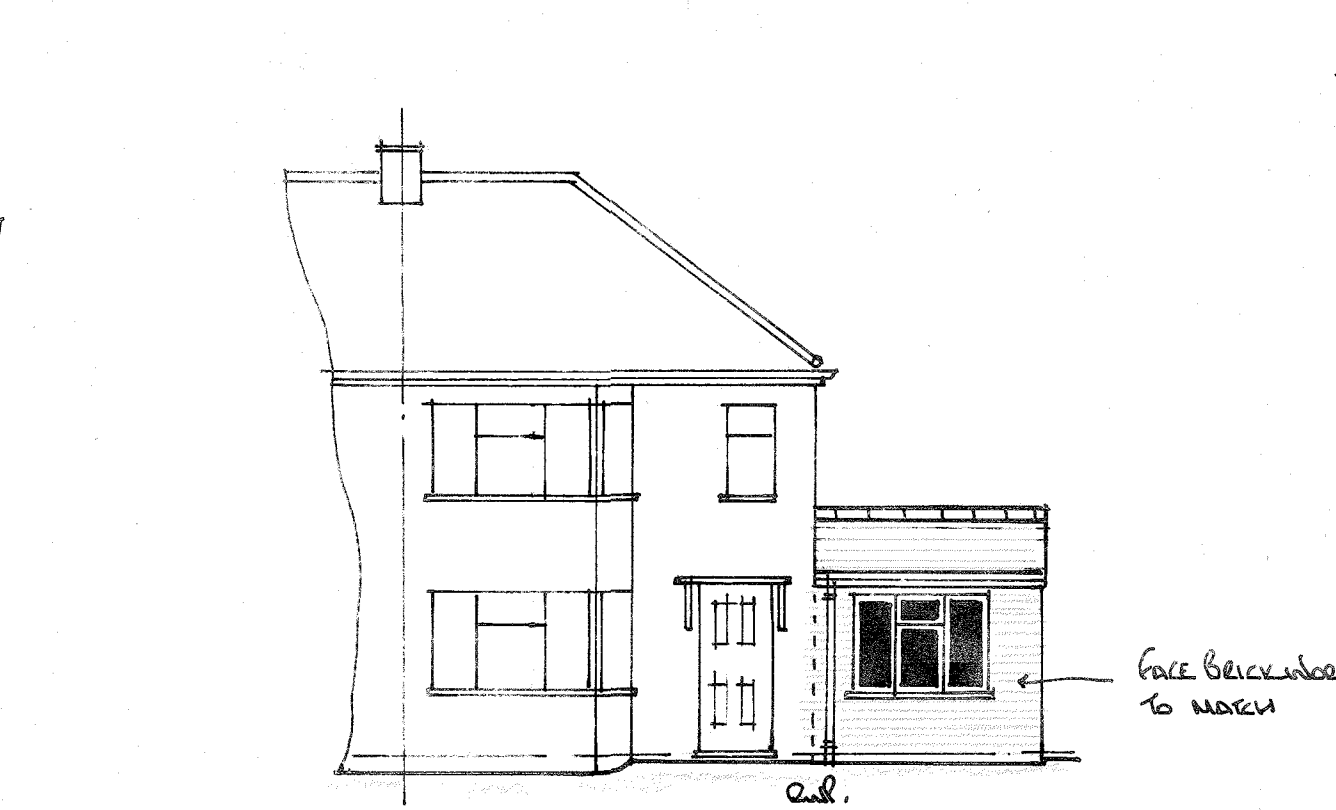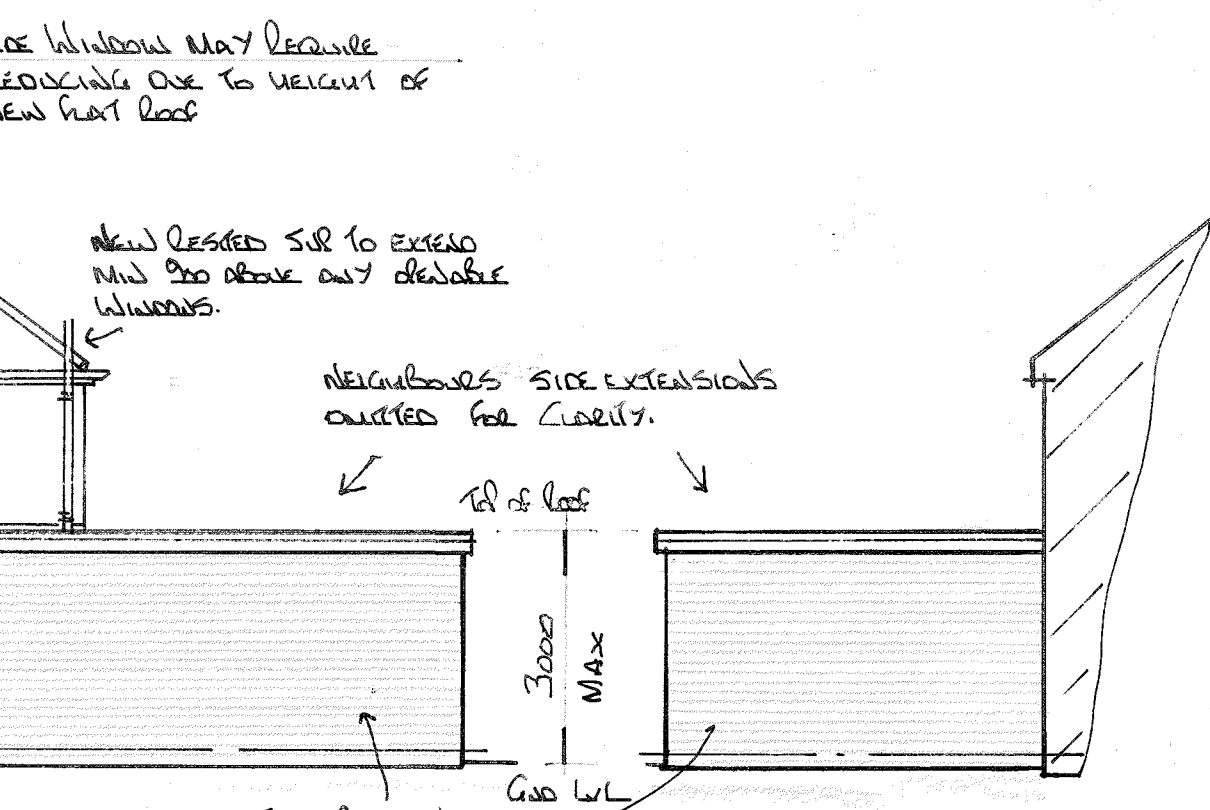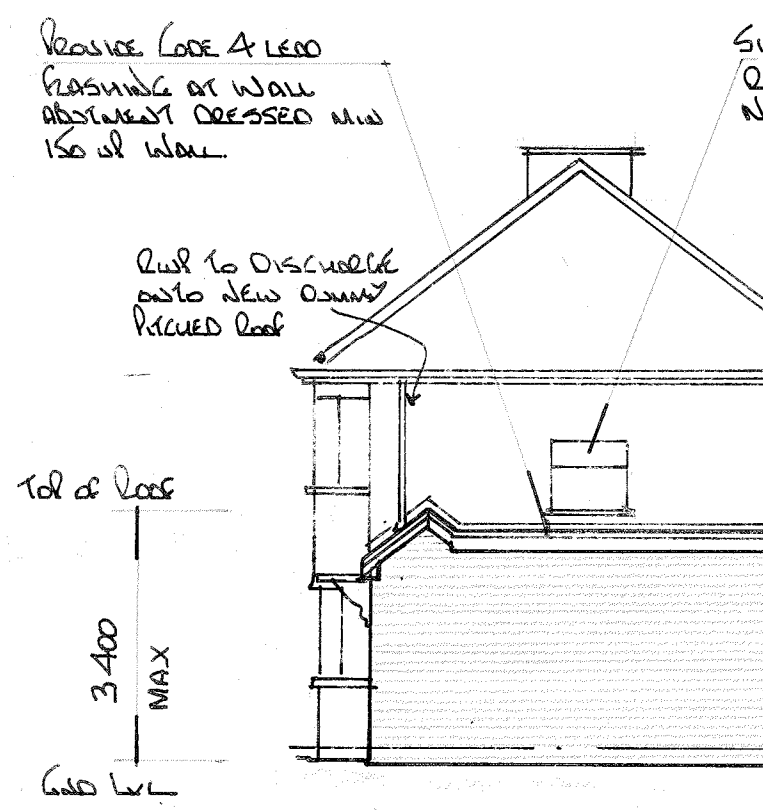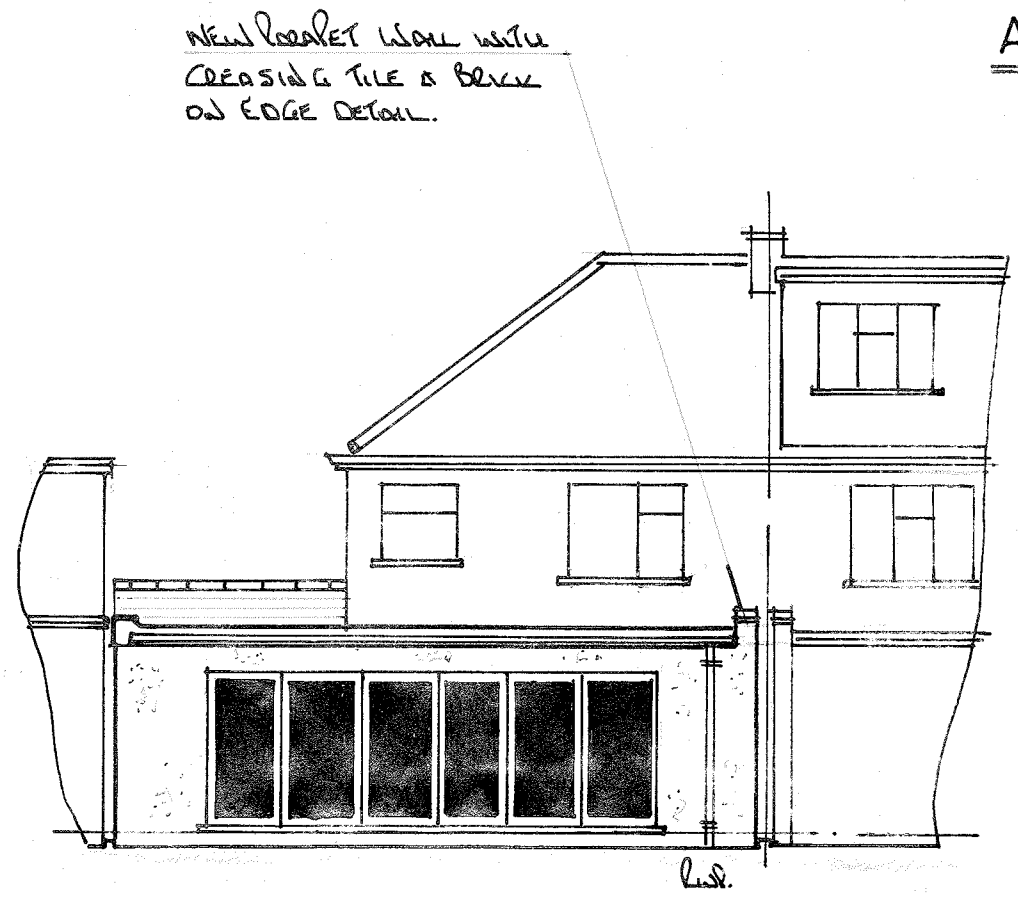

- NOTES:**
- All dimensions must be checked on site and not scaled from this drawing.
- All dimensions are in millimetres.
 - Ventilation to be 1/20 of room area (min)
 - Lintels to have min of 150 end bearings.
 - Walls: 103 face brickwork / 100 concrete blockwork externally and pebbledash / rendered to finish. 100 cavity filled with drytherm 34 insulation. Min 100 celcon solar blockwork or similar approved plastered to finish. External render to be applied in 2 coats with a suitable waterproof additive.
 - Cavity walls to have stainless steel ties @ 450 centres and staggered 900 horizontally.
 - DPC's to be provided up sides and over heads of new external windows and doors, also where the cavity is closed. Provide insulated cavity closers at reveals.
 - If proposed extension covers air bricks then air brick to be removed and 100 diameter pvc piping provided from existing to new air brick in external wall.
 - New habitable rooms to have background ventilation of at least 8000mm² i.e. trickle vent or air brick.
 - New steel beams to be encased in 2, 12mm sheets of plasterboard and skim to achieve necessary fire protection.
 - New stud partitions to be constructed of 100 x 50 timbers @ 400 centres with horizontal nogging. Infill with rockwool mineral wool quilt, 2 x 12mm sheets of plasterboard and skim. Partitions to be constructed off doubled up floor joists bolted together with M12 bolts @ 500 centres.
 - New structural timber to be SC3 grade and tanalised.
 - New windows and doors to be double glazed and achieve a U value of 1.6w/m²k i.e. 16mm spacer with low E glass to inner pane. Glazing to doors and sidelights to be toughened.
 - Drainage: 100 diameter pvc piping (flexible) totally encased in 100mm peashingle (10mm). Provide pre-cast concrete lintels where drains pass through walls. New manholes to be constructed in 215 thick class B semi engineering brickwork on 150 thick concrete slab and medium duty cover.
 - Plumbing: Waste pipe sizes: sink - 38 diameter, bath - 38 diameter, shower - 38 diameter, wash hand basin - 32 diameter. All with 75 deep seal traps. All plumbing to be BS 5572:1978.
 - 75% Light fittings to be capable of taking a lamp having a luminous efficiency greater than 40 lumens/cdm² watt.
 - All electrical works to be designed and installed, inspected and tested in accordance with the requirements of BS 7671, the IEE 17th edition wiring guidance and building regulation part P (electrical safety) by a competent person with a self-certification scheme authorised by the secretary of state. (OR BS 7671:2017 or NICEIC)
 - If proposed works involves the installation of a new boiler, then the boiler is to be a condensing type with a SEDBUK rating not less than 86%. Boiler to be installed by an approved contractor and certificated radiators to have thermostatic valves.

Date	Revisions

©copyright

Pottle & Co Ltd
Planning & Building Consultants

Suite A, 128 Manor Way
Ruislip, Middlesex, HA4 8HR

Tel: 01895 622800
www.pottle.uk.com

Client
MR MRS SIM

Job Title
58 EXMOUTH ROAD
RUISLIP
MIDD

Drawing Title
PROPOSED SINGLE
STOREY SIDE/REAR
EXTENSION

Scale: 1:50, 1:100, 1:200

Date: November 2019 Drawn by: GEL

Drg No. 4327/01 Rev.