



Plan
Ground Floor

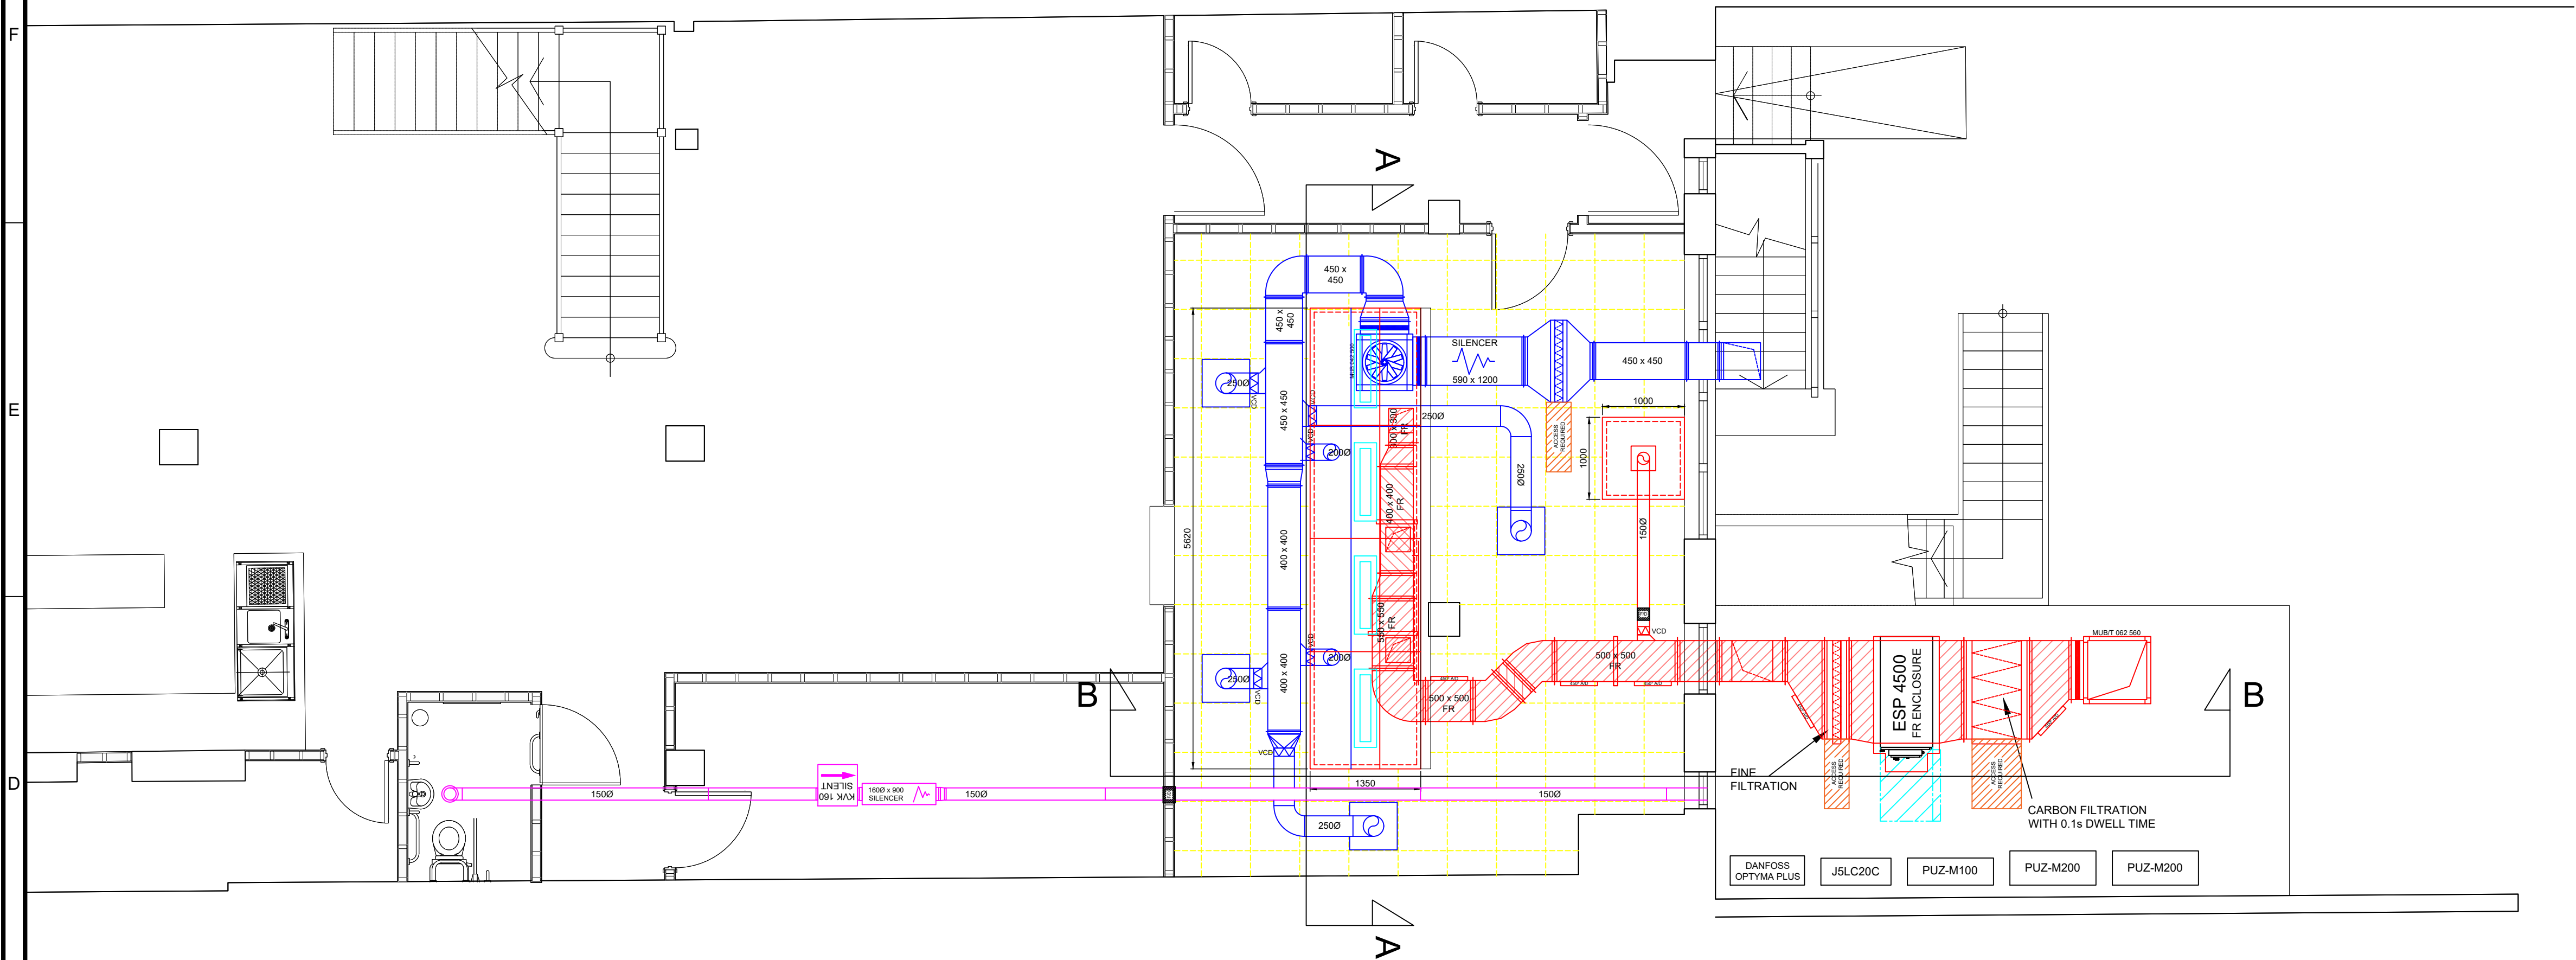

Plan
First Floor

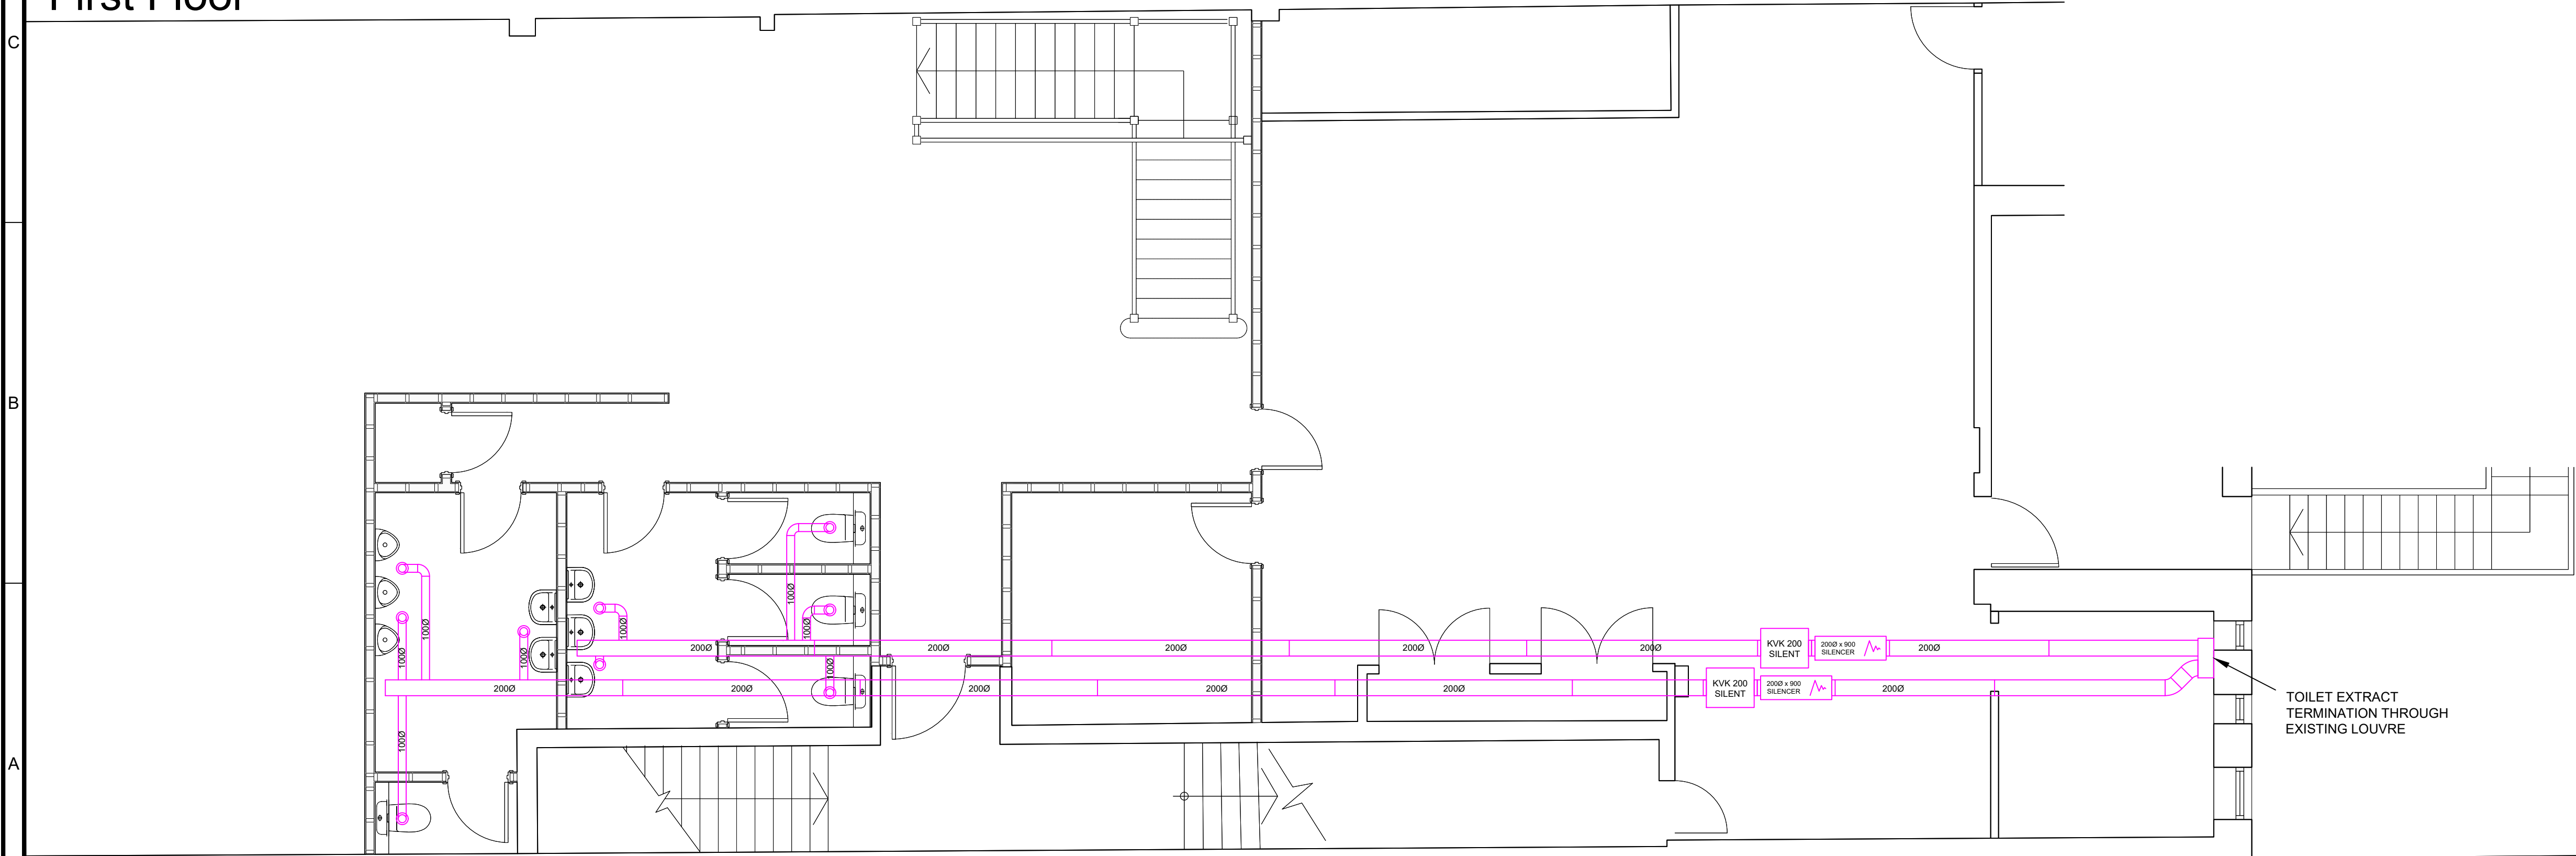

FOR APPROVAL

DO NOT SCALE FROM THIS DRAWING!
ALL MEASUREMENTS IN MILLIMETERS
GENERAL TOLERANCE +/- 1mm.
ALL POWER & SERVICES INSTALLATION BY
CLIENT AND/OR M&E CONTRACTOR.



FAN INFORMATION
Extract fan: MUB/T 062 560
Start current: 80.64A 3PH
Sound level: 52 dB @ 3m (20m² Sabine)
38 dB @ 3m (free field)

Supply fan: MUB 042 500
Start current: 54.18A 3PH
Sound level: 48 dB @ 3m (20m² Sabine)
34 dB @ 3m (free field)

Approximate canopy weight: 300kg

Drawing to be used in conjunction with
Architect: Richard Pedlar LNG4535.10/11
Kitchen: Tailor Made Ruislip Rev2

REVISIONS:		
REV	DATE	NOTES
A	14/01/2022	Supply air silencer changed to correct length
B	04/05/2022	ESP added. Cookline changed for all electric. Extract filters moved to external compound area.
C	04/05/2022	A/C units changed

Client:
Loungers

Project:
Ruislip Lounge
GRANERO
81-83 High Street
HA4 7AB

Scale:	1:50 @ A1
Date:	04/05/2021
Drawn by:	CH
Drawing number:	L202-01
Revision:	C

Partridge Ventilation
"a breath of fresh air"
Cardrew Industrial Estate, Redruth, Cornwall TR15 1SH
01209 204700
enquiries@partridge-ventilation.co.uk

I hereby confirm my acceptance of all information on this drawing and understand that any subsequent changes to this plan may be subject to additional charges
Customers Signature: .
Date: .