


STATISTICS						
Description	Symbol	Avg	Max	Min	Min/Max	Min/Avg
Car Park	+	18 lux	80 lux	5 lux	0.06	0.28
Cycle Store	+	38 lux	46 lux	30 lux	0.65	0.79
Loading Bays	+	62 lux	79 lux	46 lux	0.58	0.74
Lorry Yard	+	32 lux	67 lux	14 lux	0.21	0.44
Main Entrance	+	79 lux	119 lux	37 lux	0.31	0.47

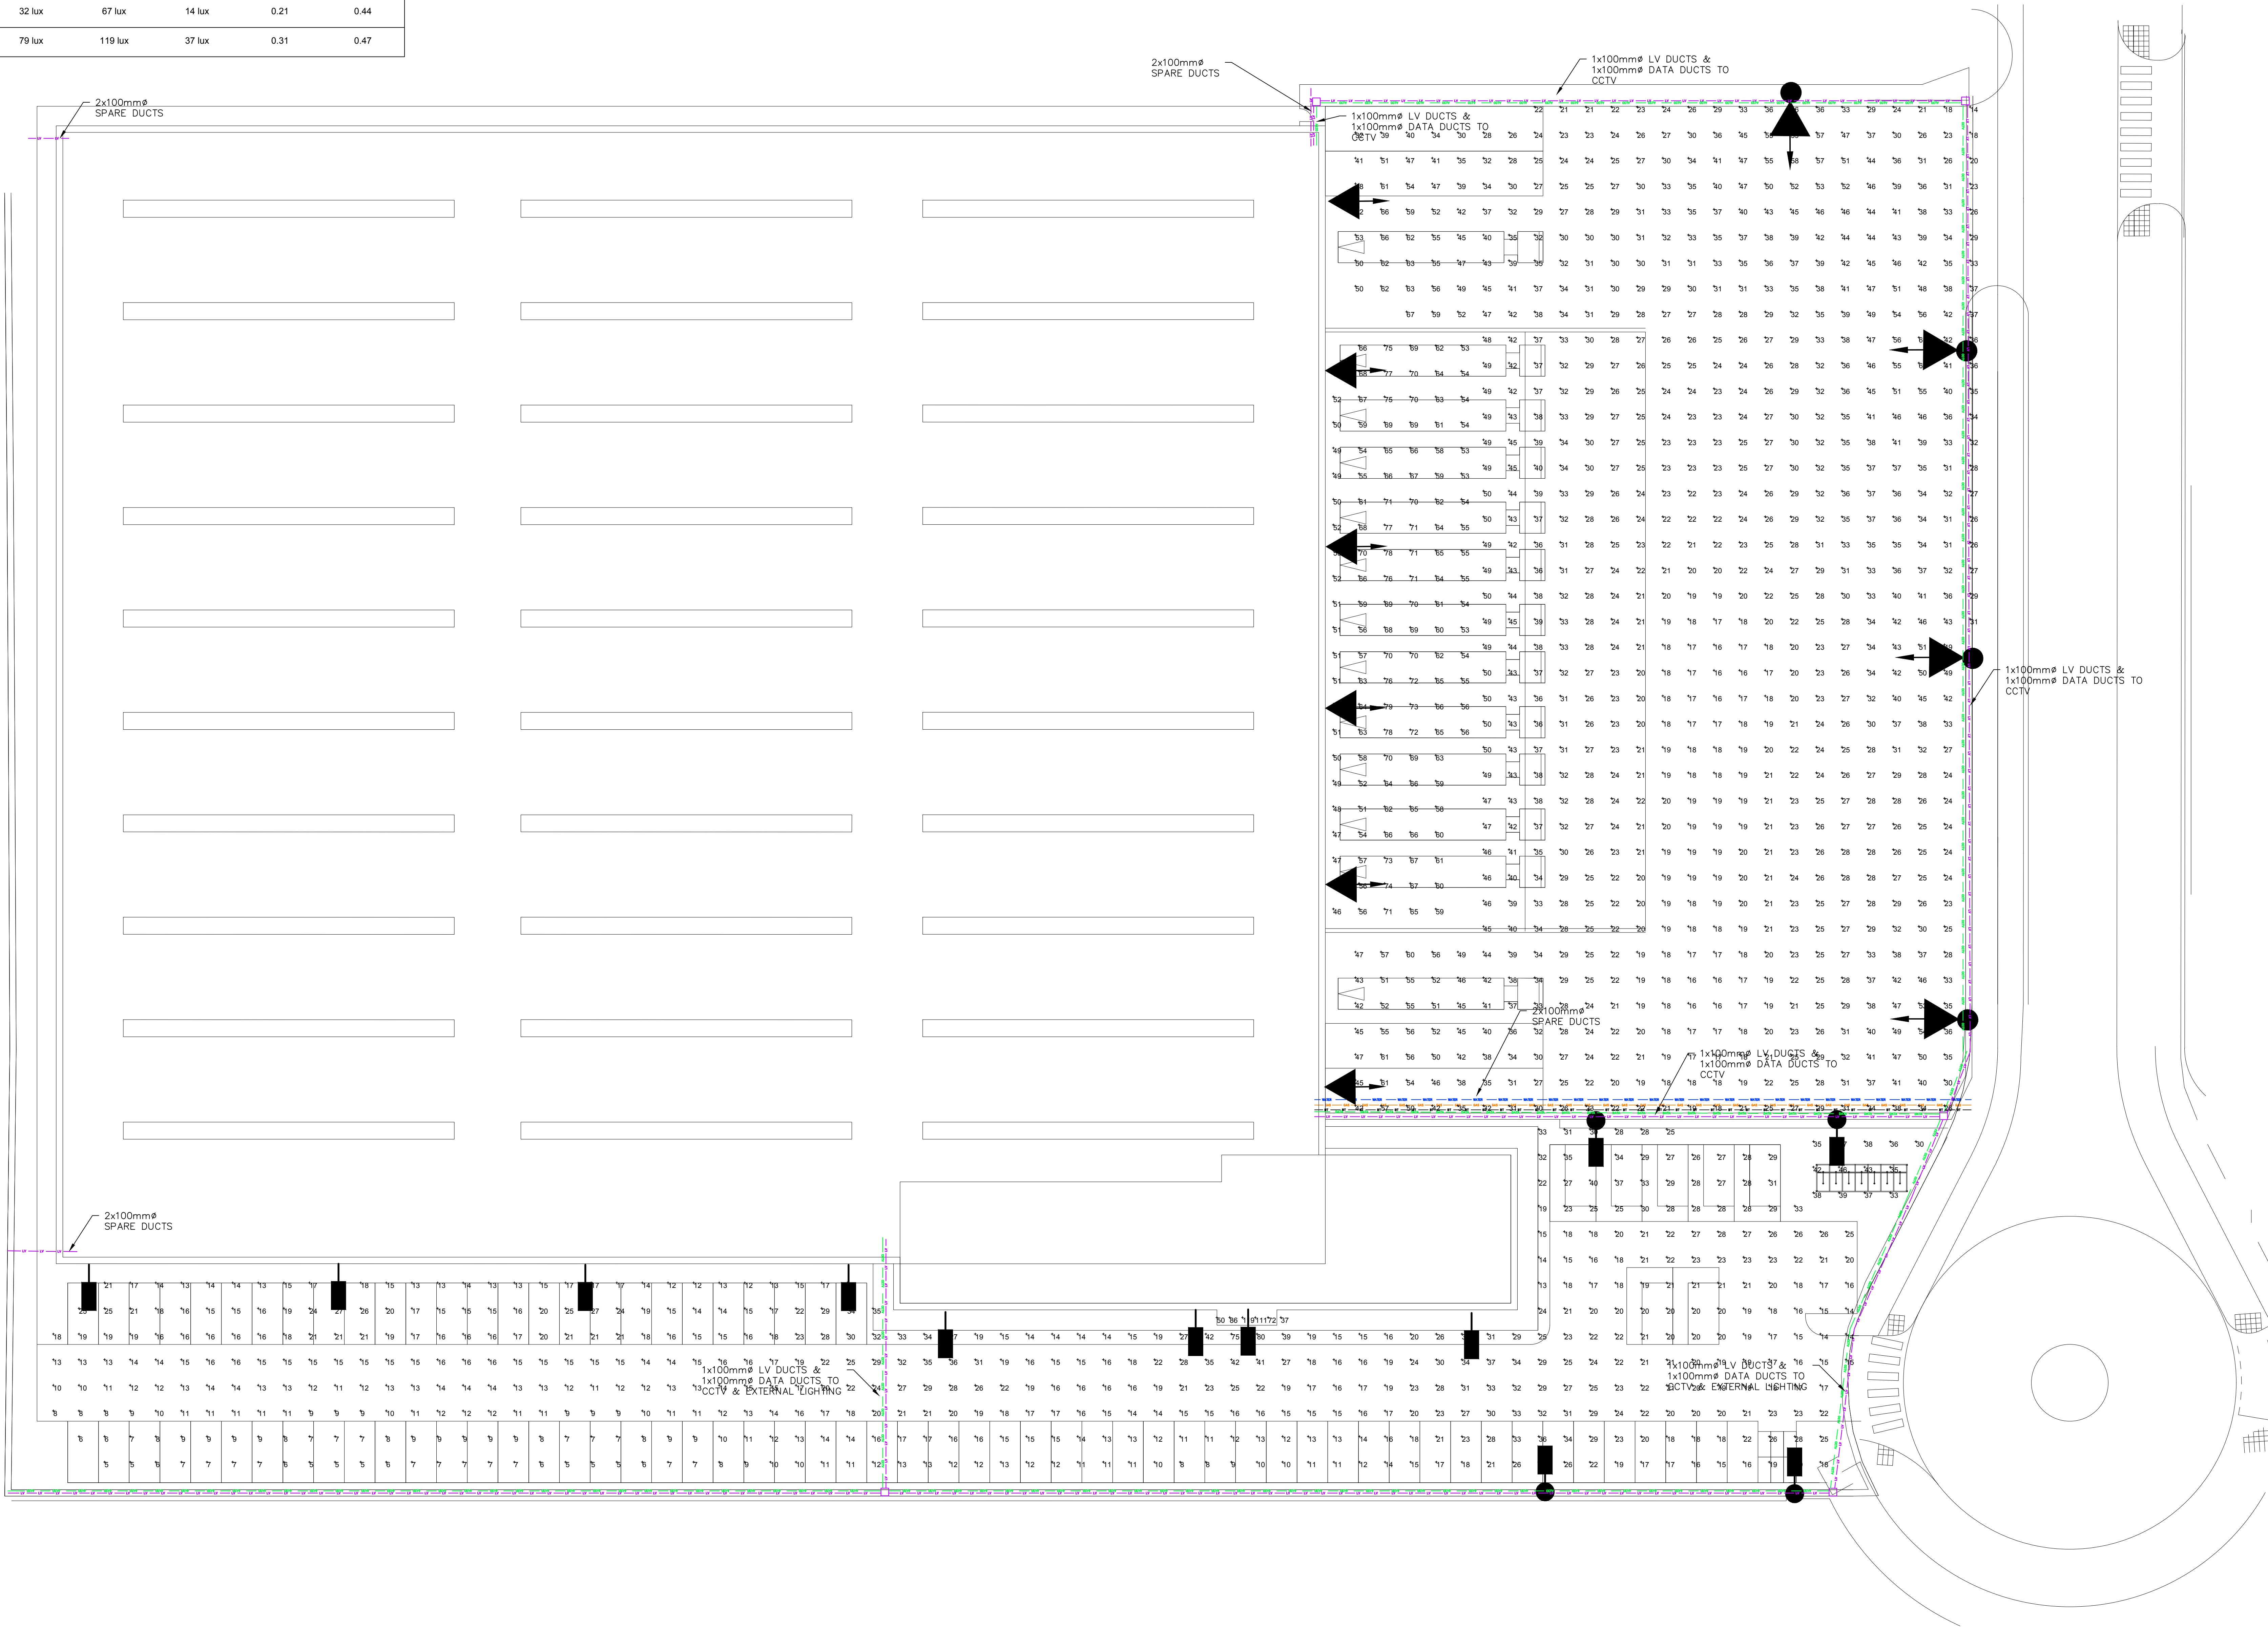

LEGEND

DISTRIBUTION BOARD

LV DUCT ROUTE, SIZES AND QUANTITIES AS PER DETAILED ON DRAWING

DATA DUCT ROUTE, SIZES AND QUANTITIES AS PER DETAILED ON DRAWING

WATER DUCT ROUTE, SIZES AND QUANTITIES AS PER DETAILED ON DRAWING

GAS ROUTE, SIZES AND QUANTITIES AS PER DETAILED ON DRAWING

BT DUCT, 1x90ø RIGIDUCTS

INSPECTION PIT, 600mm x 600mm UNLESS SPECIFIED ON DRAWING

LIGHTING COLUMN LOCATION

LIGHTING COLUMN WITH SINGLE LANTERN

WALL MOUNTED LANTERN

WALL MOUNTED FLOODLIGHT

- NOTES:
- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE SPECIFICATION AND ALL OTHER INSTALLATION DRAWINGS.
 - LOCATIONS OF ALL SERVICES AND DUCTS SHALL BE FULLY COORDINATED WITH THE BUILDING STRUCTURE AND ALL OTHER SERVICES LAYOUTS AND INSTALLATIONS.
 - THE INFORMATION SHOWN UPON THIS DRAWING IS INDICATIVE ONLY AND THE LAYOUTS AND DIMENSIONS SHOWN MUST BE CONFIRMED BY SITE SURVEY.
 - INCOMING DUCT POSITIONS, WHERE SHOWN ARE INDICATIVE ONLY AND LOCATIONS AND SETTING OUT DIMENSIONS MUST BE CONFIRMED AND AGREED ON SITE, PRIOR TO THE COMMENCEMENT OF CONSTRUCTION.
 - ALL DUCTS SHALL ENTER BUILDINGS AND EQUIPMENT WITH SLOW RADIUS BENDS
 - ALL DUCTS SHALL BE PROVIDED WITH ADEQUATE DRAW CORDS
 - ALL DUCTS SHALL BE CONTINUOUS AND FREE OF OBSTRUCTIONS TO PERMIT SAFE PASSAGE FOR THE FUTURE INSTALLATION OF SITE CABLES
 - ROUTES SHOWN FOR THE INCOMING GAS MAIN, WATER PIPE, HV, AND BT CABLES ARE INDICATIVE ONLY. THE ROUTES, NUMBERS OF DUCTS, LAYOUTS AND LOCATIONS OF DRAW-PIPS MUST BE CONFIRMED BY THE MAIN CONTRACTOR AND WITH THE APPROPRIATE SERVICE PROVIDER BEFORE WORKS COMMENCE.

P2	19.09.18	LUX PLOTS ADDED	HVS
P1	18.06.18	SITE LAYOUT CORRECTED	HVS
P0	29.05.18	PRELIMINARY ISSUE	HVS
REV	DATE	DESCRIPTION	BY

WM BUILDING SERVICES

657 Melton Road
Thurston
Leicester
LE14 8BB
Tel: (0115) 313 2477
Fax: (0115) 260 9537
Email: office@wmbuildingservices.com
Web: www.wmbuildingservices.com

Project:
Prologis Park
West London
Unit 4

Client:

Title:
External Lighting &
External Services Duct
Layout

Scale at A0:	Date:	Designed:	Drawn:	Design Check:
1:200	05/18	HVS	HVS	RWF

Drawing No:	Rev:
E-500	P2

PRELIMINARY