

auricI

acoustic consulting

Hillingdon Hospital

Plant Noise Assessment Report

23 April 2025

For:

Tejpal Golh
Hillingdon Hospital

London

UB8 3NN

Contents

SUMMARY.....	2
1.0 INTRODUCTION.....	3
2.0 DESCRIPTION OF SITE.....	3
3.0 LONDON BOROUGH OF HILLINGDON REQUIREMENTS.....	4
4.0 NOISE SURVEY.....	4
4.1 Methodology	4
4.2 Noise Survey Equipment.....	5
4.3 Survey Results & Observations.....	6
5.0 BUILDING SERVICES PLANT NOISE EMISSIONS.....	6
5.1 Plant Noise Limits	6
5.2 Proposed Plant.....	6
5.3 Noise Predictions	7
APPENDIX A – ACOUSTIC TERMINOLOGY	10
APPENDIX B – TIME HISTORY GRAPH	10

SUMMARY

New items of building services plant are proposed at Hillingdon Hospital in Hillingdon, noise emissions from which will be subject to London Borough of Hillingdon's requirements.

auricl has been instructed to carry out an environmental noise survey at the site to determine background noise levels at the nearest noise sensitive properties and to undertake an acoustic assessment of the proposed plant in relation to London Borough of Hillingdon's noise requirements.

The assessment shows that the predicted plant noise levels at the nearest noise sensitive properties achieve the London Borough of Hillingdon's requirements.

Project Number	14894	Issue Date	15 May 2025
Document Reference	R/PNA/1/250515	Version	01
Report Produced by	Nicholas Jones BEng(Hons) CEng MIOA	T: 07739 715411 E: njones@auricl.com	
auricl Limited www.auricl.com hello@auricl.com	107 Cheapside London EC2V 6DN	9 Greyfriars Road Reading RG1 1NU	
		Registered Company 09824075	

Copyright © auricl Limited 2025. All rights reserved. This report is confidential to the party to whom it is addressed and their professional advisers for the specific purpose to which it refers. No responsibility is accepted to third parties, and neither the whole nor any part of this report nor reference thereto may be published or disclosed without the written consent of auricl Limited.

1.0 Introduction

New items of building services plant are proposed at Hillingdon Hospital in Hillingdon, noise emissions from which will be subject to London Borough of Hillingdon's requirements.

auricl has been appointed to undertake an environmental noise survey to determine background noise levels at the nearest noise sensitive properties and to undertake an acoustic assessment of the proposed plant in relation to London Borough of Hillingdon's noise requirements.

This report presents the methodology and results of the noise survey and our acoustic assessment of the proposed plant.

2.0 Description of Site


The site is occupied by a clinical building within the Hillingdon Hospital site, in a predominantly residential area.

New items of plant are proposed in the courtyard/lightwell area towards the south-west of the main clinical building.

The nearest noise sensitive properties to the proposed plant are noted to be located to the north east, on the north-eastern side of Pield Heath Road.

Figure 2.1 shows the approximate existing site extent in **red**, the approximate plant location in **blue** and the nearest noise sensitive properties indicated in **orange**.

Figure 2.1 Existing Site Extent and Surroundings

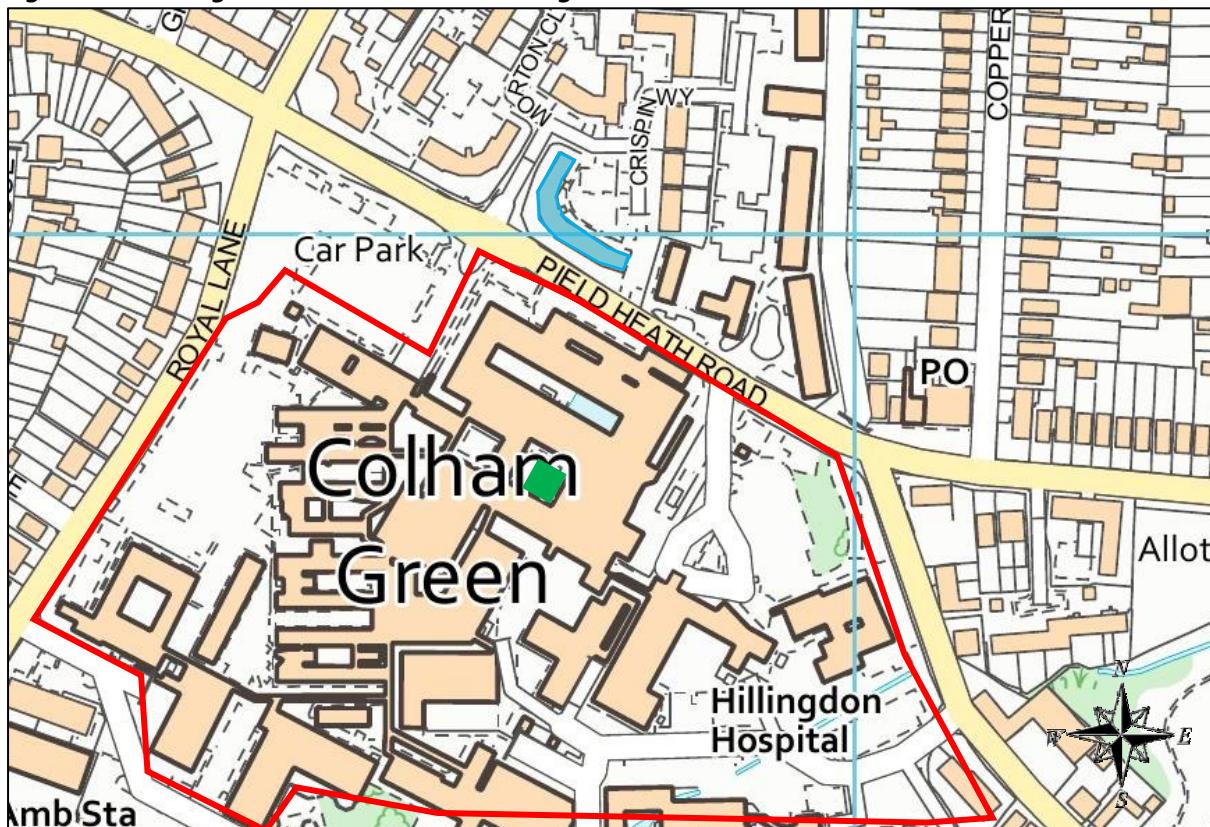

3.0 London Borough of Hillingdon Requirements

London Borough of Hillingdon's Supplementary Planning Document "*Development Control for Noise Generating and Noise Sensitive Development*" (July 2014) states it would normally be acceptable for the Rating Level ($L_{Ar,Tr}$) due to sounds of an industrial and/or commercial nature to be at least 5 dB(A) below the Background Level L_{A90} , based on the terms specified in BS 4142.

British Standard (BS) 4142: 2014+A1: 2019 "*Methods for rating and assessing industrial and commercial*" provides a procedure for the measurement and rating of noise levels from industrial and commercial noise sources. BS 4142: 2014 is the current industry standard for predicting the likelihood of adverse impact due to these sources.

The rating level ($L_{Ar,Tr}$) is defined in BS 4142: 2014+A1: 2019 and is used to rate the source (known as the specific noise source) at the assessment location. This level is obtained by adding a correction for tonal and/or impulsive noise sources. Additionally, corrections can be made for other sound characteristics and intermittency of the noise source.

The method for predicting the likelihood of complaints is based on differences between the rating level and the background $L_{A90,T}$ noise level. The standard states that:

- a) *"Typically, the greater this difference, the greater the magnitude of the impact.*
- b) *A difference of around +10dB or more is likely to be an indication of a significant adverse impact, depending on the context.*
- c) *A difference of around +5 dB is likely to be an indication of an adverse impact, depending on context.*

The lower the rating level is relative to the measured background sound level, the less likely it is that the specific sound source will have an adverse impact or significant adverse impact. Where the rating level does not exceed the background sound level, this is an indication of the specific sound source having a low impact depending on the context."

4.0 Noise Survey


4.1 Methodology

An unmanned environmental noise survey was undertaken between Friday 4 April 2025 and Tuesday 8 April 2025.

The noise survey period was selected to determine background noise levels during periods when the plant items are proposed to be operational i.e. daytime and night-time, weekdays and weekends.

The measurement position was located on the north eastern most point of the roof of the main building facing Pield Heath Road, as indicated in **purple** on Figure 4.1.

Figure 4.1 Noise Measurement Position in Relation to Site Extent and Surroundings

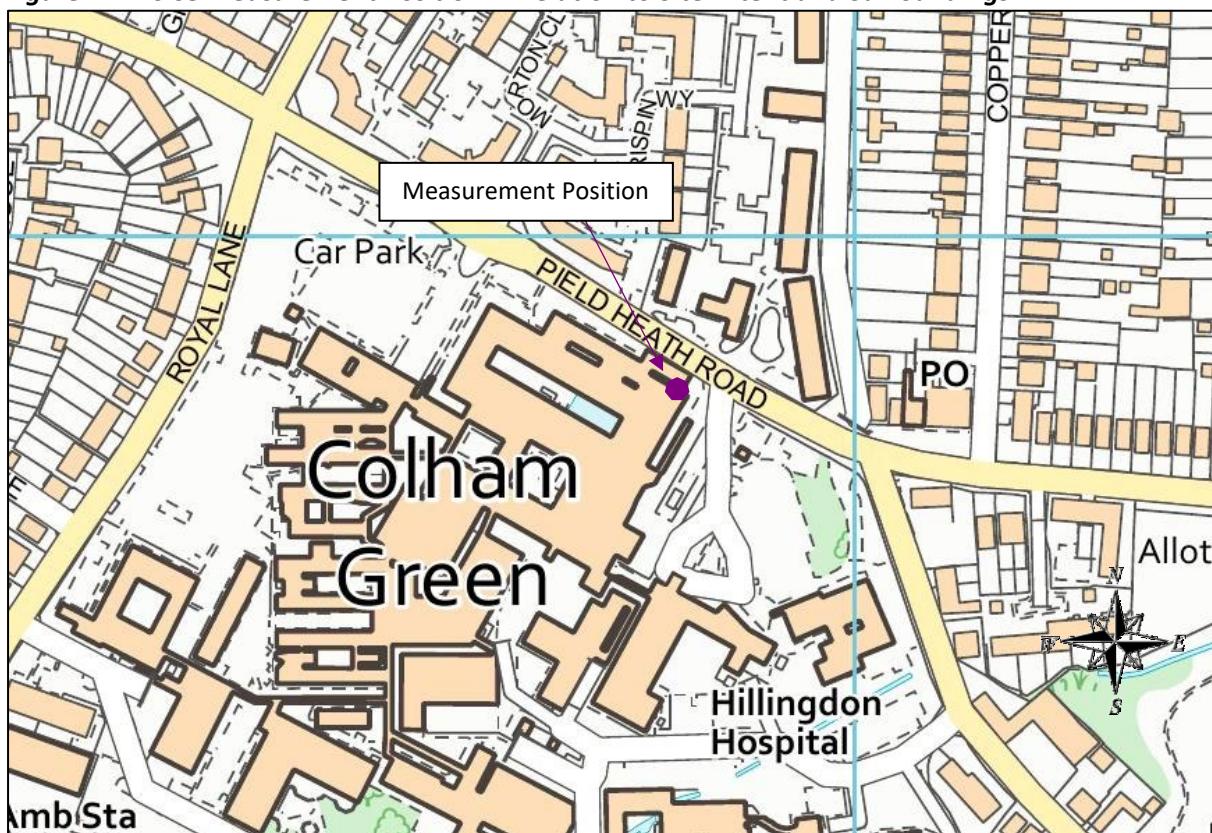

The measurement position was selected as being representative of background noise levels at the nearest noise sensitive properties to the proposed plant.

Due to the nature of the noise survey, i.e. unmanned, we are unable to comment on the exact weather conditions throughout the entire noise survey period, however at the beginning and end of the survey period, weather conditions were dry with partial cloud coverage and only light wind. Conditions throughout the survey period were considered to be appropriate for undertaking environmental noise measurements.

4.2 Noise Survey Equipment

The equipment used for the noise survey is summarised in Table 4.1.

Table 4.1 Description of Equipment used for Noise Survey

Item	Make & Model	Serial Number
Type 1 automated logging sound level meter	01dB FUSION	15996
Type 1 ½" microphone	GRAS 40CD	627559
Calibrator	CIRRUS CR515	105381

L_{Aeq} and L_{A90} sound pressure levels were measured throughout the noise survey over contiguous 1-second intervals.

The noise monitoring equipment was calibrated before and after the noise survey period. No significant change was found. Laboratory equipment calibration certificates can be provided upon request.

4.3 Survey Results & Observations

Appendix B presents a time history graph showing the L_{Aeq} and L_{A90} sound pressure levels measured throughout the noise survey (shown as 15-minute periods).

The typical (modal) measured (L_{A90}) background noise levels during daytime and night-time periods are summarised in Table 4.2.

Table 4.2 Typical Measured Background Noise Levels

Typical Measured $L_{A90,T}$ Background Noise Level (dB)	
Daytime (07:00 – 23:00 hours, T = 1 hour)	Night-time (23:00 – 07:00 hours, T = 15 mins)
55	50

We would consider the measured levels to be reasonable, taking into account the location of the measurement position and the dominant nearby noise sources.

Due to the nature of the unmanned noise survey, we are unable to comment on the exact noise climate throughout the entire survey period, however at the beginning and end of the survey period, the typical daytime noise climate at the measurement position was noted to be affected by distant road traffic. We would expect the same to be apparent during night-time periods.

5.0 Building Services Plant Noise Emissions

5.1 Plant Noise Limits

Based on London Borough of Hillingdon's requirements and the results of the noise survey, Table 5.1 presents the overall development plant noise limits to be achieved at the nearest noise sensitive properties during daytime and night-time periods.

Table 5.1 External Noise Limits

External L_{Aeq} Plant Noise Limit during Plant Operating Period (dB)	
Daytime (07:00 – 23:00 hours)	Night-time (23:00 – 07:00 hours)
50	45

The noise limits are to be achieved at a distance of 1m external to the nearest noise sensitive property and apply to the total cumulative noise level with all relevant plant operating simultaneously.

5.2 Proposed Plant

One air source heat pump, four condenser units and an air handling unit are proposed in the courtyard/lightwell area towards the south-west of the main clinical building, in the approximate location indicated on Figure 2.1.

The proposed air source heat pump and condenser units, and the manufacturer's published noise data, are as follows:

ASHP	Swegon ZETA Sky Hi R7 HP SLN	83 dB L _{WA} sound power level
CU1	Mitsubishi PURY-P200YNW-A2	76 dB L _{WA} sound power level
CU2	Carrier 38VT018173HQEE	88 dB L _{WA} sound power level
CU3	Carrier 38VT018173HQEE	88 dB L _{WA} sound power level
CU4	Mitsubishi PUZ-ZM100YKA2	69 dB L _{WA} sound power level

The manufacturer's sound levels for the air handling unit are shown in Table 5.2.

Table 5.2 Air Handling Unit Noise Data

Source	Sound Pressure Level (dB) at Octave Band Centre Frequency (Hz)							
	63	125	250	500	1k	2k	4k	8k
Supply Intake	80	80	80	71	72	70	73	64
Extract Exhaust	75	75	75	75	75	73	73	66

These types of plant items are not usually tonal or impulsive and are not expected to operate intermittently.

5.3 Noise Predictions

Our plant noise calculations are presented in Tables 5.3 and 5.4 for the air handling unit (supply and extract respectively) and in Table 5.5 for the proposed air source heat pumps and condenser units, with the total cumulative levels presented in Table 5.6.

Table 5.3 Air Handling Unit Noise Calculations – Supply Intake

Element	Level (dB) at Octave Band Centre Frequency (Hz)							
	63	125	250	500	1k	2k	4k	8k
In-Duct Sound Power Level	80	80	80	71	72	70	73	64
Grille End Reflection	-4	-1	0	0	0	0	0	0
Distance Attenuation	-47	-47	-47	-47	-47	-47	-47	-47
Directivity	+4.5	+5	+5.5	+6	+6	+6	+6	+6
Screening Attenuation	-5	-5	-5	-5	-5	-5	-5	-5
Predicted Sound Pressure Level at Receptor	29	32	34	25	26	24	27	18
	33 dB L _{pA}							

Table 5.4 Air Handling Unit Noise Calculations – Extract Exhaust

Element	Level (dB) at Octave Band Centre Frequency (Hz)							
	63	125	250	500	1k	2k	4k	8k
In-Duct Sound Power Level	75	75	75	75	75	73	73	66
Grille End Reflection	-4	-1	0	0	0	0	0	0
Distance Attenuation	-47	-47	-47	-47	-47	-47	-47	-47
Directivity	+4.5	+5	+5.5	+6	+6	+6	+6	+6
Screening Attenuation	-5	-5	-5	-5	-5	-5	-5	-5
Predicted Sound Pressure Level at Receptor	24	27	29	29	29	27	27	20
	34 dB L _{pA}							

Table 5.5 ASHP and Condenser Unit Noise Calculations

Element	Level (dB)				
	ASHP	CU1	CU2	CU3	CU4
Unit Sound Power Level L_{wA}	83	76	88	88	69
Acoustic Reflections	+5	+5	+5	+5	+5
Screening Attenuation	-15	-15	-15	-15	-15
Distance Attenuation	-48	-48	-48	-48	-48
Predicted Sound Pressure Level (L_p) at Nearest Residential Property	25	18	30	30	11

Table 5.6 Total Noise Calculations

Element	Predicted Sound Pressure Level (L_p) at Receptor (dB)
Supply Intake	23
Extract Exhaust	24
ASHP	25
CU1	18
CU2	30
CU3	30
CU4	11
TOTAL Predicted Sound Pressure Level (L_p) at Receptor	35
Noise Limit	50 Daytime
	45 Night-time

It can be seen that the total predicted building services plant noise level at the nearest noise sensitive properties does not exceed the proposed plant noise limit during daytime and night-time periods and should therefore be considered acceptable in relation to London Borough of Hillingdon's noise requirements.

Appendix A – Acoustic Terminology

Parameter	Description
Decibel (dB)	A logarithmic scale representing the sound pressure or power level relative to the threshold of hearing (20×10^{-6} Pascals).
Sound Pressure Level (L_p)	The sound pressure level is the sound pressure fluctuation caused by vibrating objects relative to the threshold of hearing.
A-weighting (L_A or dBA)	The sound level in dB with a filter applied to increase certain frequencies and decrease others to correspond with the average human response to sound.
$L_{Aeq,T}$	The A-weighted equivalent continuous noise level over the time period T (typically T= 16 hours for daytime periods, T = 8 hours for night-time periods). This is the sound level that is equivalent to the average energy of noise recorded over a given period.
R_w	The weighted (w) sound reduction index (R), a single figure rating of the laboratory airborne sound insulation performance of a construction, usually measured across the frequency range 100-3150Hz. The higher the value, the greater the sound insulation, and the more onerous the requirement.

Appendix B – Time History Graph

