

NOTES:

EXTERNAL WALLS (AD A):

302mm Cavity walls comprising 100mm 7.0N/mm² Blockwork sub-structure blockwork up to underside of PC floor, and thereafter 100mm Plaster Agile 'Ultimate' 4.2N/mm² or similar approved inner leaf Blockwork tied to Weiberberger Sineed Deane external facing brick with 225mm long Stainless Steel ties Type 4 (strength) to BS EN 845-1 @ 720mm c/c horizontally and 450mm c/c vertically with additional ties @225mm c/c vertically within 300mm of all openings. 100mm Cavity formed as work proceeds to be fully filled with 100mm Knauf 'Earthwool Dnthem 34' from DPC level full height up to wall plate level.

SUSPENDED CONCRETE FLOOR (AD C):

50mm 1:3 Cement:Sand Screed or pumped Flow Screed on 500g polythene separating layer on Celotex XR4000 100mm horizontal insulation on 1200g DPM with Celotex FR5000 20mm vertical insulation to perimeters of floors on 150mm concrete Beam and Block floor.

Sub-floor void to be tanked where required as shown and cross ventilated with Timloc injection moulded polypropylene telescopic vents built in as work proceeds at maximum 2 metre centres or at the rate of 500mm²/m² of floor area and not more than 450mm from the ends of any wall

WASTE PLUMBING & WATER SUPPLIES (AD G & AD H):

SVPs to be 110mm PVC-U solvent-welded pipes Waste Pipes to be solvent welded MuPVC of sizes as below:
Bath: 42mm, WHB: 32mm, Shower: 50mm, Basins: 42mm
Kitchen Sink waste: 42mm

Waste plumbing pipework to be fitted with access caps where possible including rodding access points at 1100mm W.C. connections and at bases of stacks so as to be roddable between soil pipes and manhole chambers.

NOTE: Hot water supplies to Baths are to be limited to a maximum temperature of 48 Deg. Centigrade via an in-line blending valve

Wholesome Water to be supplied to Kitchen sinks in accordance with the Water Supply (Water Quality) Regulations 2000 (SI 2000/3184)

EXTERNAL DOORS & WINDOWS (AD L1A & AD Q):

All habitable rooms are to have escape windows (see elevations and Floor Plans). Emergency Egress windows should have an un-obstructed openable area that is at least 0.33m² and at least 450mm high and 450mm wide (the route through the window may be at an angle rather than straight through) - a minimum clear opening size of 450mm x 750mm is to be provided.

The bottom of the openable area should be not more than 1100mm above the finished floor level and if lower than 800mm fixed guarding should be installed in addition). Windows should be designed such that they will remain in the open position without needing to be held by a person making their escape. Locks (with or without removable keys) and stays may be fitted to egress windows, subject to the stay being fitted with a release catch, which may be child resistant.

New windows and external door D11 to be of PVCu with minimum 24mm Argon filled sealed double glazed units. All windows are to be fitted with trickle vents and to achieve a minimum U value of 1.40 W/m²K

Fiat Entrance Doors to be of Composite construction and to be fitted with Locks to BS3621.

All flat Entrance Doors are to be fitted with door chain or Limiter, viewer and letterplate incorporating an internal flap and with a maximum aperture of 260mm x 40mm

ELECTRICAL INSTALLATION (AD P):

Layout and positions of lighting and power points are to be as determined by the Client.

All electrical works are to comply with I.E.E. Wiring regulations and require an appropriate BS7671:2008 incorporating Amendment No 1:2011.

An Electrical Installation Certificate shall be issued, in order to satisfy Approved Document P (Electrical Safety) certifying that the work has been designed, installed, inspected and tested by a person competent to do so.

Electrical sockets and lighting switches are to be positioned in a zone 450mm above FFL and 1200mm above FFL respectively.

Final electrical details are subject to client approval prior to installation on site - Contractor is responsible for providing these layouts for approval.

Consumer units are to be mounted so that the switches are between 1350mm and 1450mm above floor level.

Consideration to be given to ensure compliance with all other statutory requirements relating to consumer unit position such as British and European standards.

INTERNAL WALLS (AD E):
Internal walls dimensions as 89mm are to be timber Stud Partitions with all voids fully filled with 90mm Rockwool Flexi Acoustic Insulation and lined with 12.5mm Plasterboard & Skim.

Stud partitions are to be built off 15mm OSB or Chipboard decking, (whichever is used), and where partitions run parallel with Posi Joists, sole plate fixings are to be in accordance with MITek Standard Detail SDPU 03.01


Junctions of skirtings and floors are to be sealed with continuous flexible acoustic sealant

STAIRCASE (AD K):


Staircase to be of timber construction comprising 244 x 38mm String, 22mm Treads and 12mm Ply risers to provide 250mm clear Going + 20mm Nosing and 163.47mm Rise as shown on Drawing No 7100/D05.

Staircase to have single 44mm stained Oak handrail fixed to outer wall at maximum 900mm above pitch line.


1 : 50 @ AO

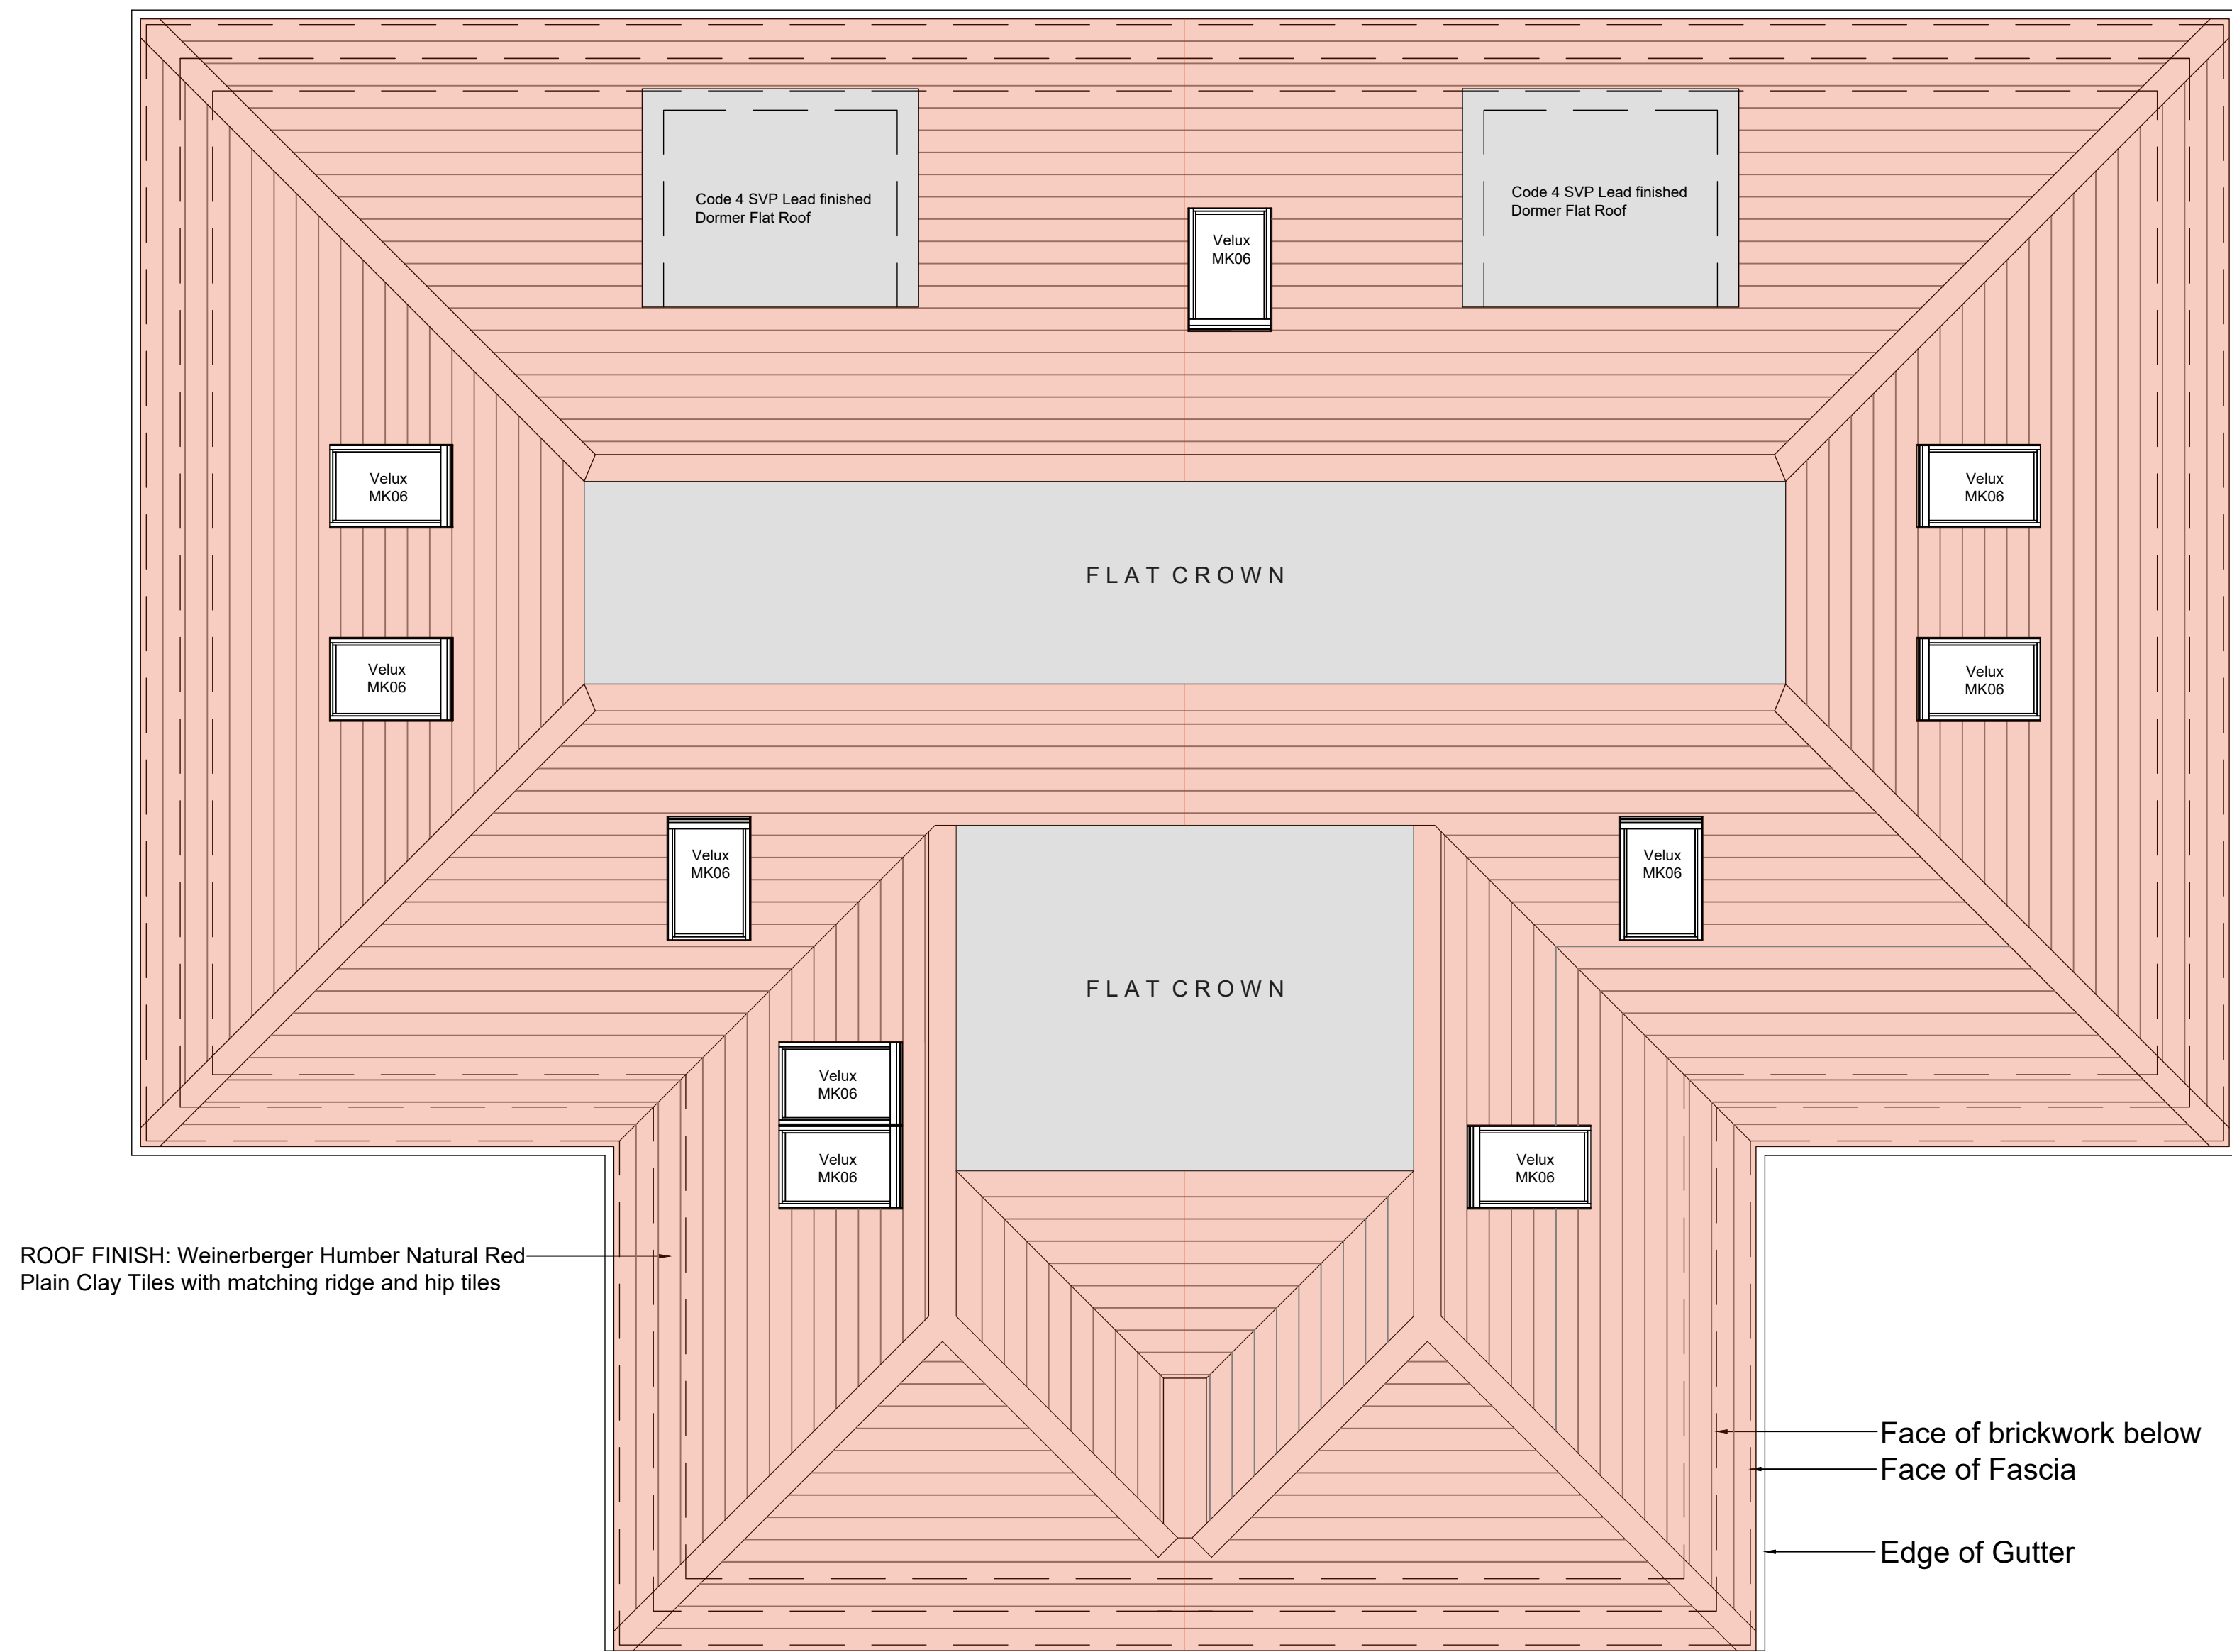


ROOF PLAN

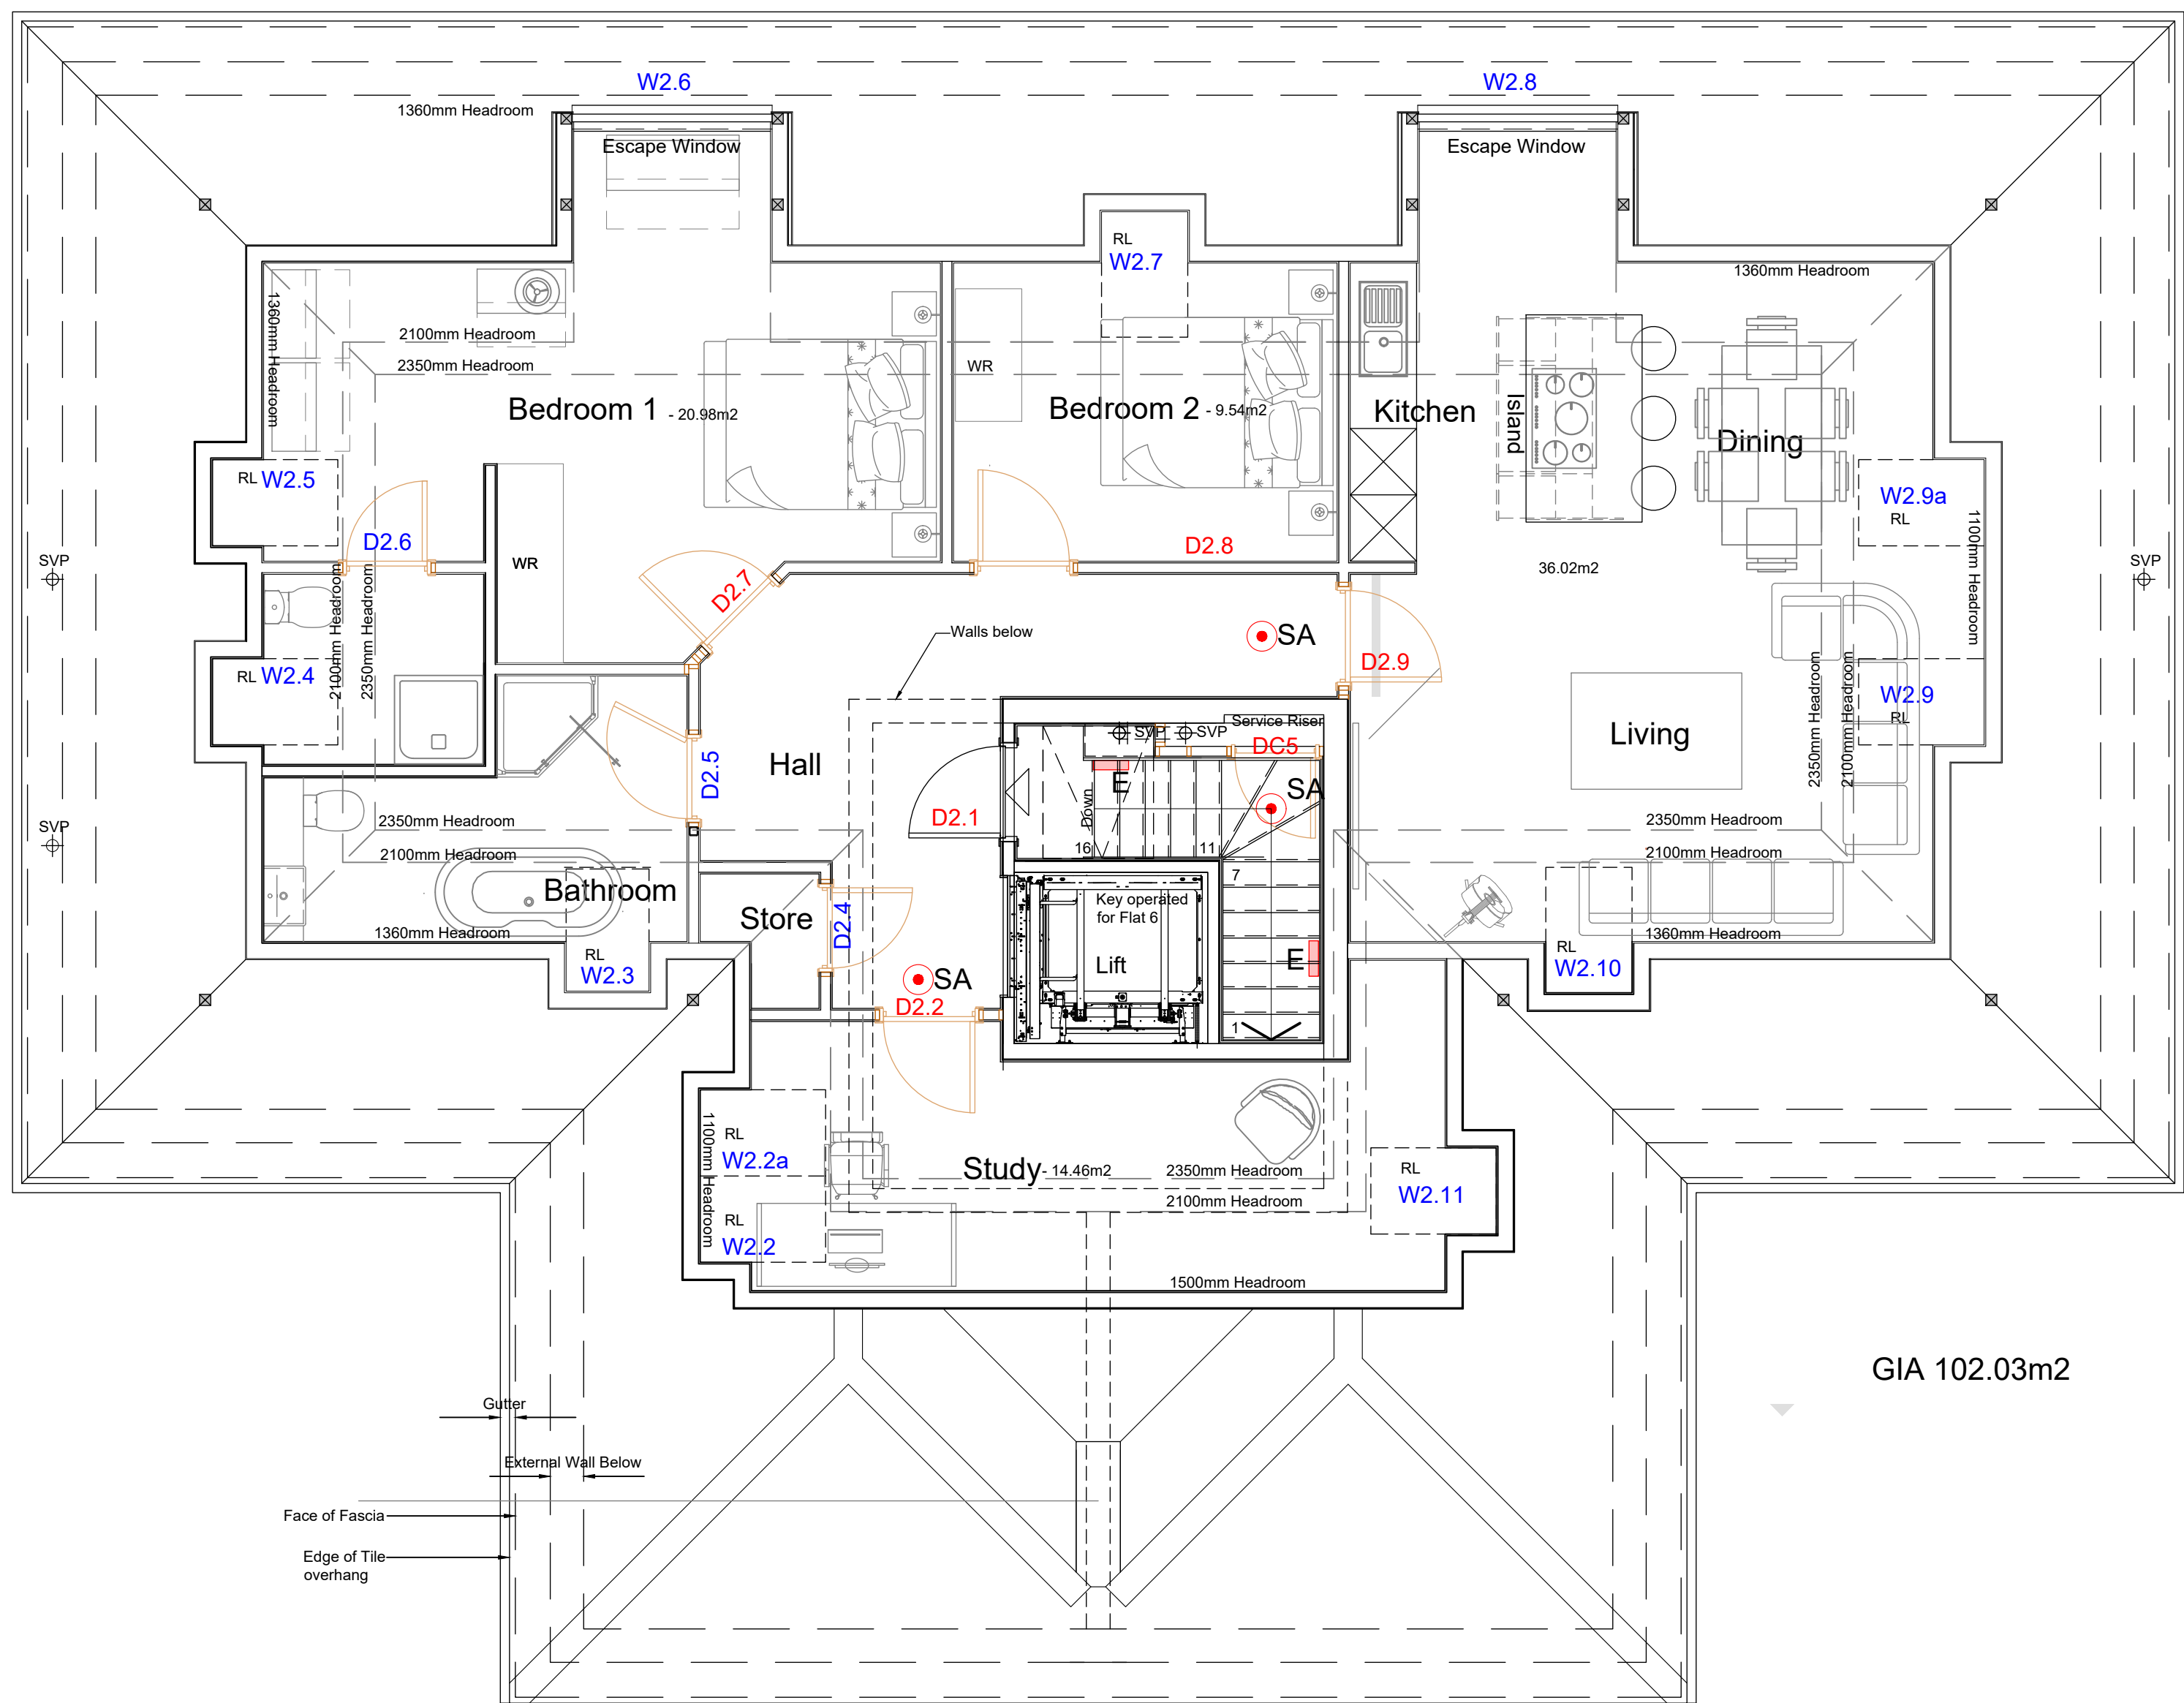

SECOND FLOOR

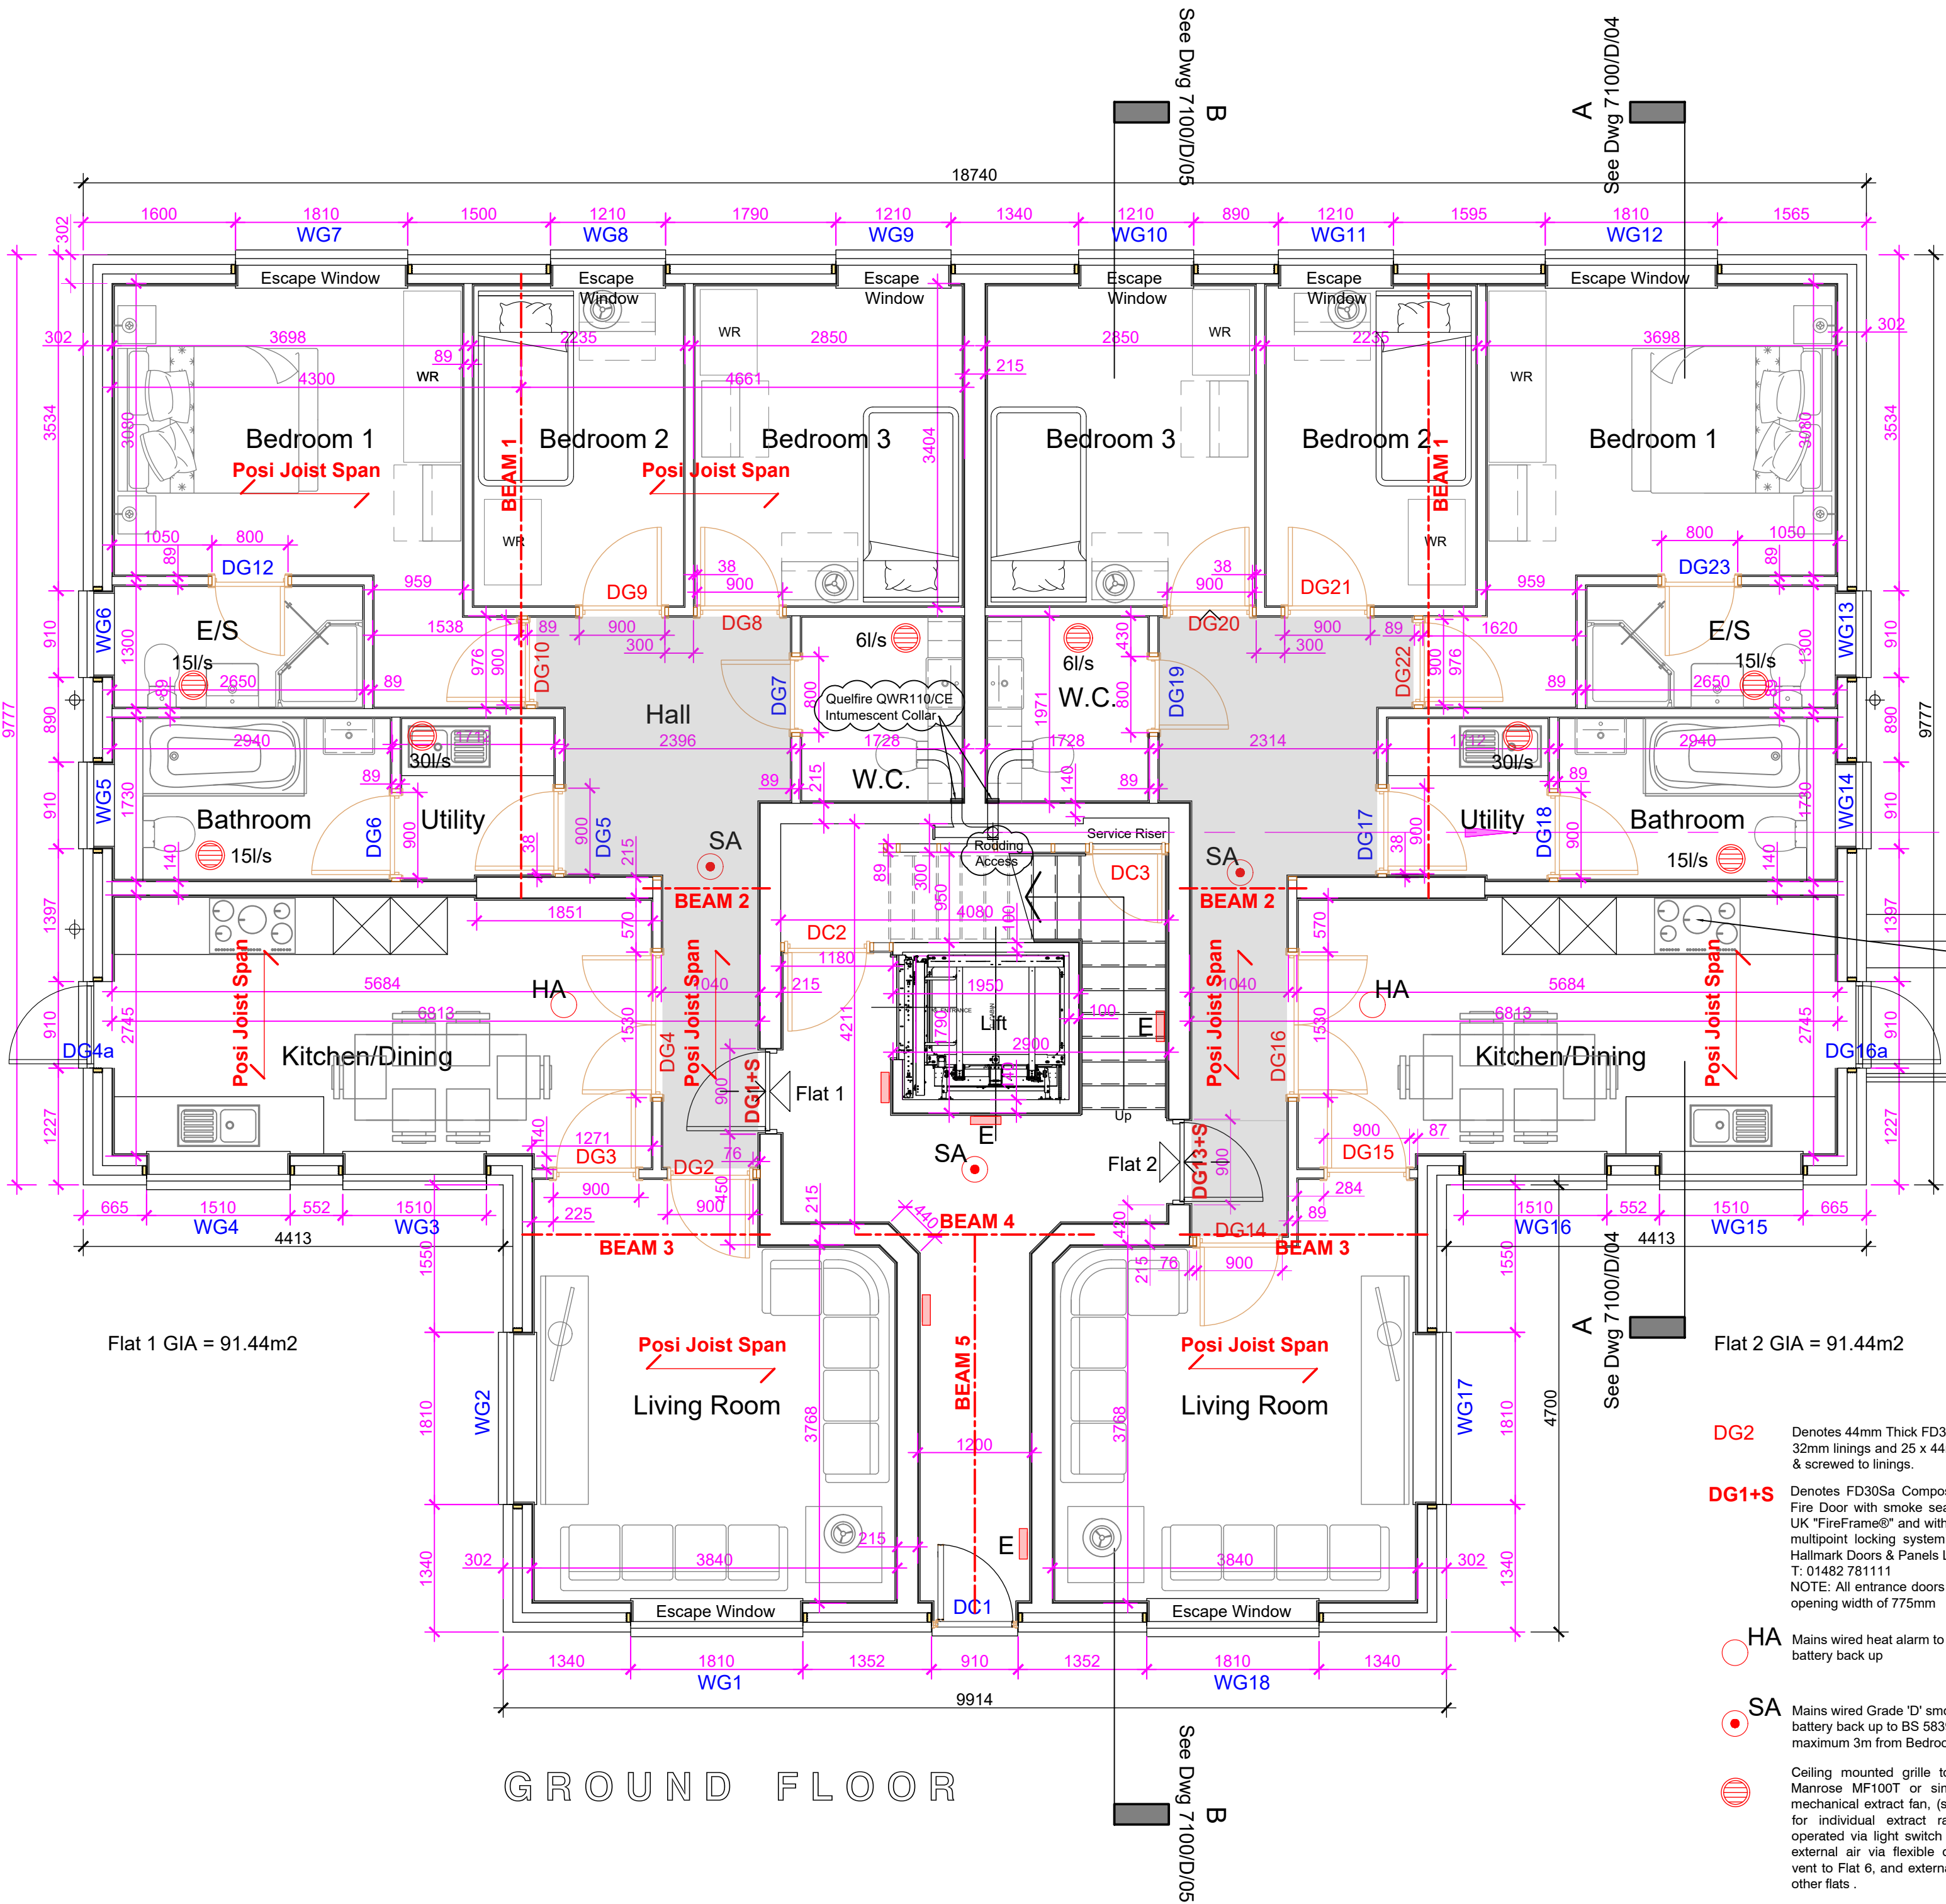

GROUND FLOOR

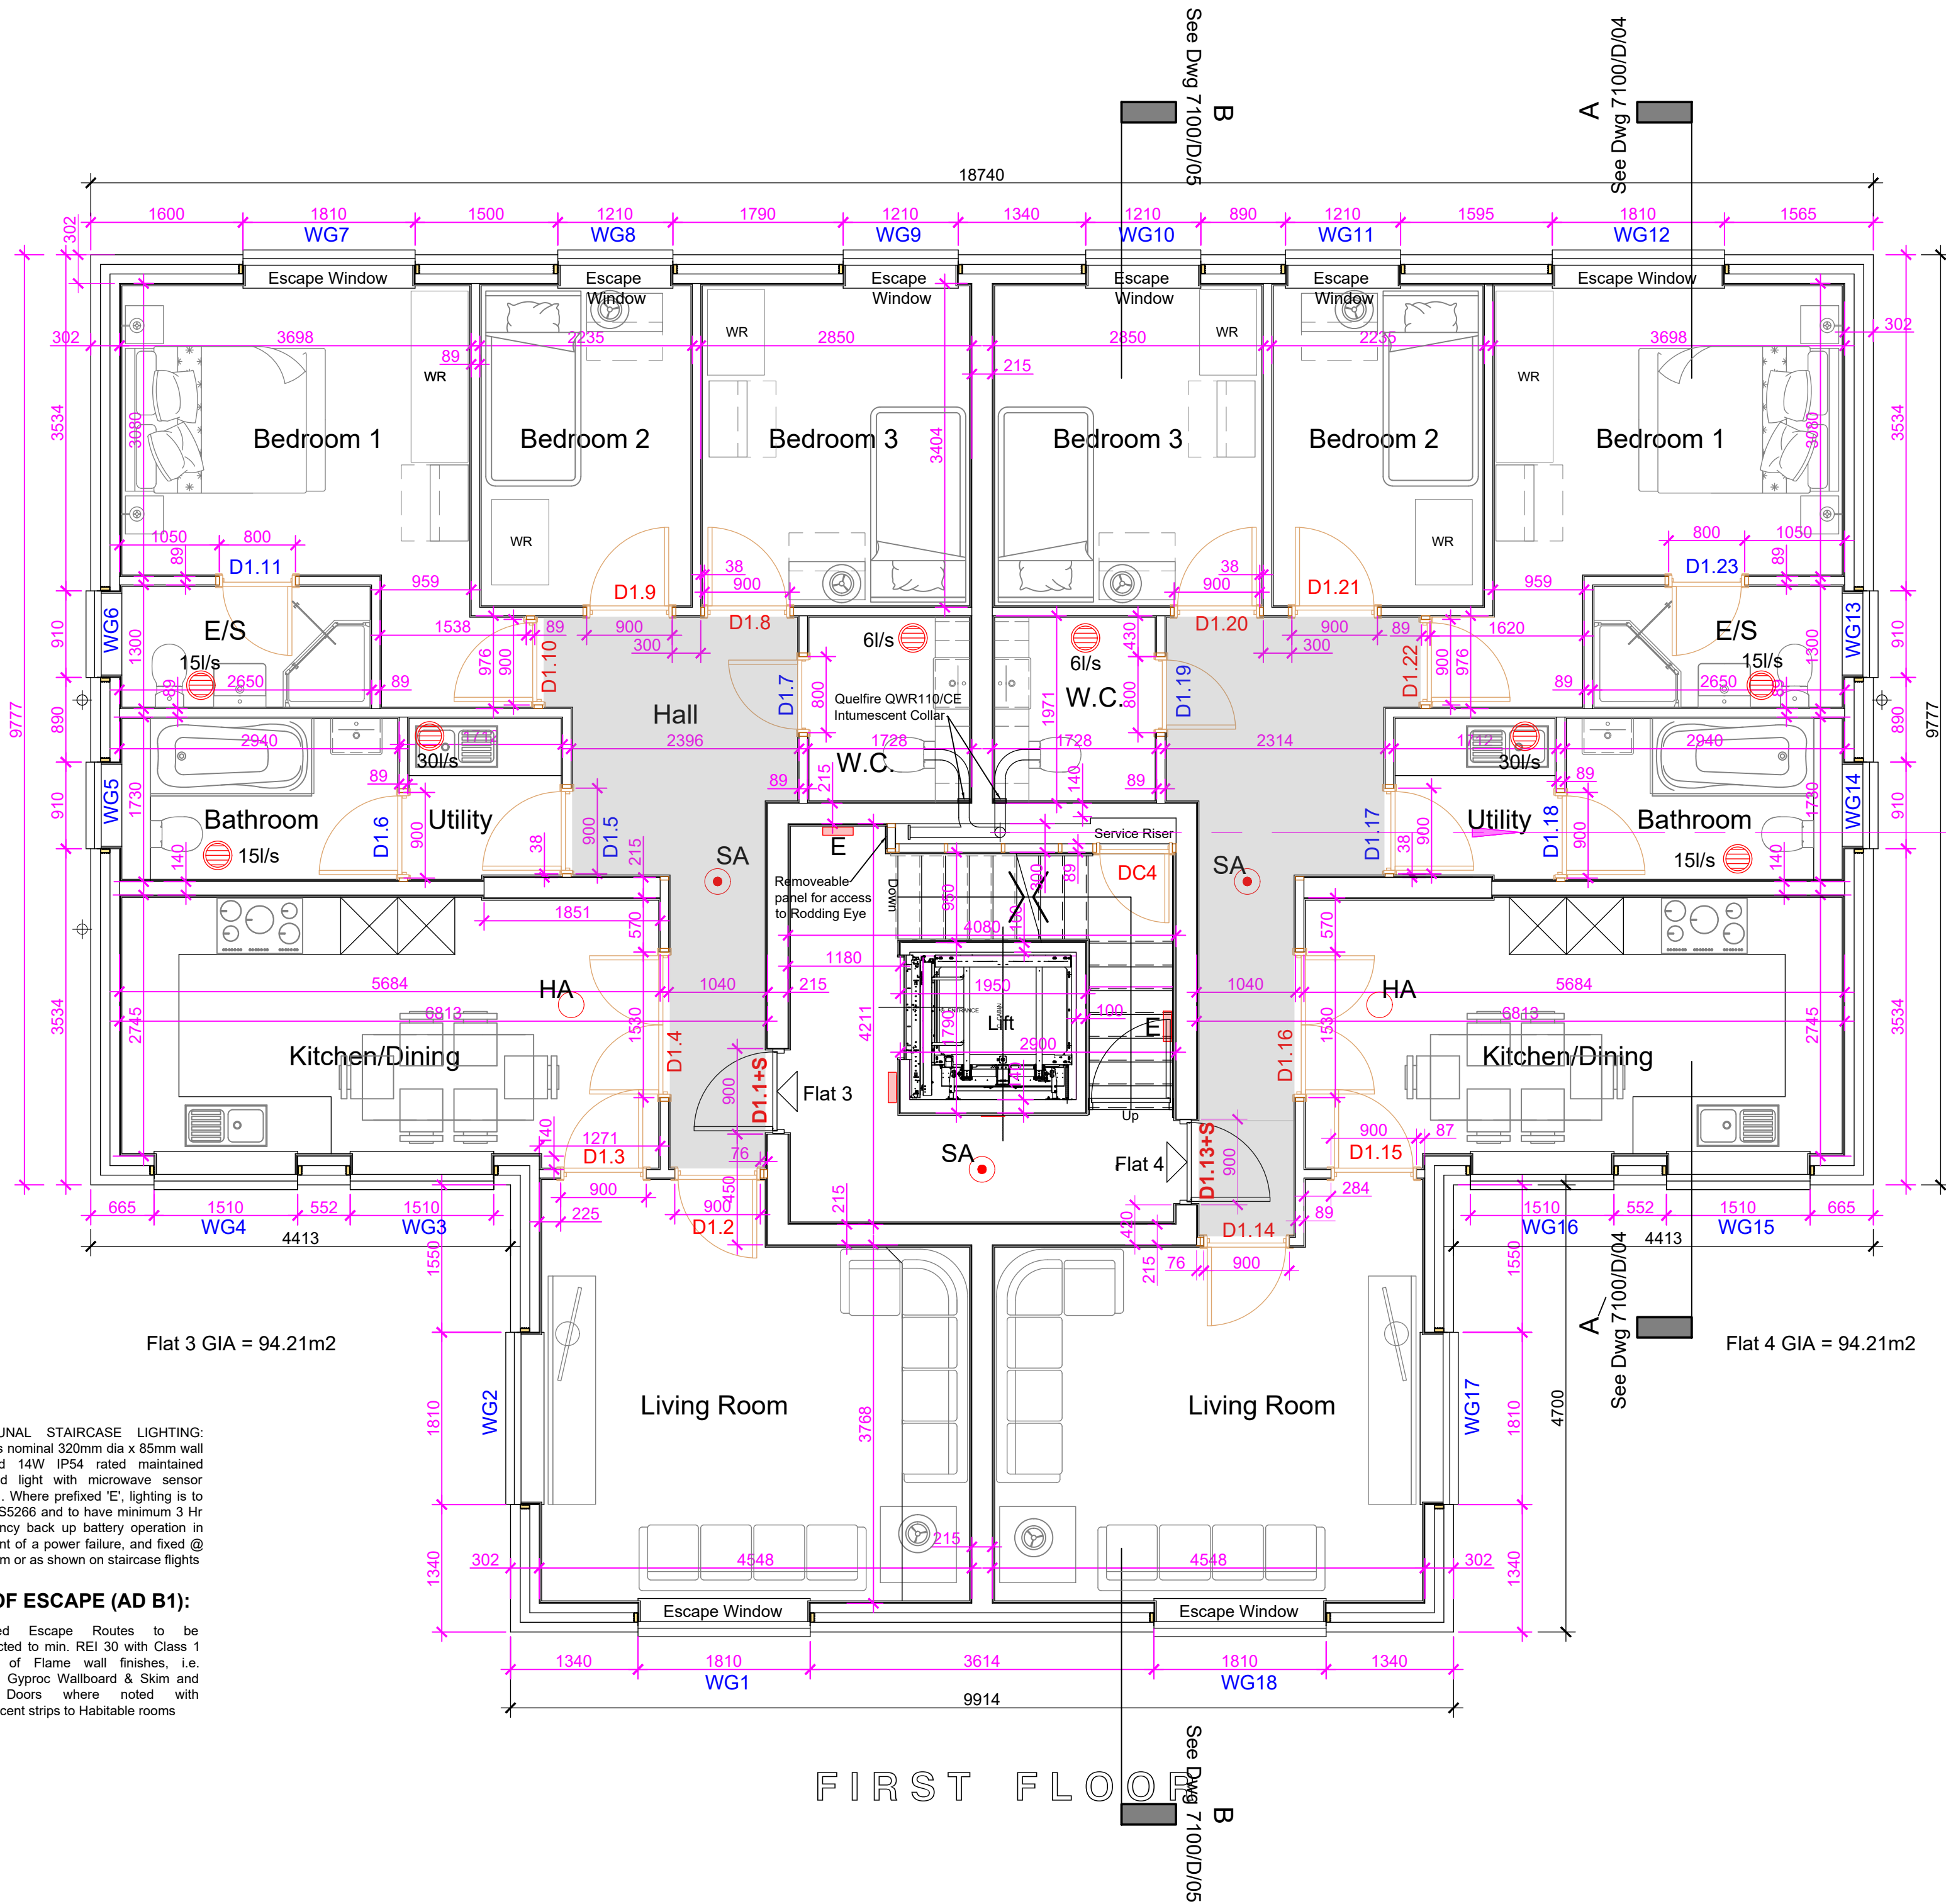

FIRST FLOOR

J	20.08.2021	Flat layout revised and GIA reduced, roof over front revised to include 20kg skips in lieu of Cables following Pre-App meeting with LPA 11/08/2021 and further correspondence with LPA 20/07/2021
H	19.02.2021	Automatic Smoke Vent added & Section drawing 06 referenced, rodding access noted to SVP and Intumescent collars shown
G	18.02.2021	1st Floor layout revised and shown as 2 x 3 Bed flats as Ground Floor to comply with Approved Document B1 2019 Diagram 3.9 - Note 3
F	05.02.2021	Emergency lighting, head alarms, escape windows and fire door locations and specifications added. Protected escape routes to flats shown shaded & maximum travel distances added
E	27.01.2021	Stairwell re-aligned to match Ground & 1st Floors & Roof finish amended
D	15.01.2021	Wall between Kitchen & Utility increased to 215mm
C	28.12.2020	Window & Door Nos. added, Lift configuration handed and additional notes added for Building Control
B	16.12.2020	Roof Plan updated to show Dormer roofs and Velux roof windows
A	14.12.2020	Overall width of building reduced to 18.740m as Planning Permission 40711/APR/2018/4033
Rev.	Date	Description

ISSUE STATUS	Information Only	Client Approval	Cost Estimate
Planning	☒	☒	☒
Building Control	☒	☒	☒

PROJECT
Residential Development at:
**27 Ducks Hill Road,
Northwood, Middlesex**

The Welton Group
Architecture & Construction
Nevis Architecture
Welton House, Blunstone Heath Rd., Welton Le Marsh Lincs. PE23 5BG
Tel: 01534 890490 e: info@weltongroup.co.uk

DRAWING Floor Plans	DATE 10.12.20
CLIENT Bramley Building Services	SCALE 1:50 @ AO
DRAWING NO. 7100/D/02	DRAWN J.P.T.
	REV. J