

+00-Ground Floor Plan - Existing


1:20

All Dims in millimeters unless otherwise stated. Do not scale except for planning purposes. If in doubt - Ask	Scale 1:25	0 1 2m
This drawing is confidential and is the property of Keenan Project Designs Ltd.	Scale 1:50	0 1 4m
© Copyright	Scale 1:100	0 2 5m

KEENAN  
PROJECT  
DESIGNS

KEENAN PROJECT DESIGNS  
0800 233 5787  
INFO@KEENANPROJECTDESIGNS.COM  
WWW.KEENANPROJECTDESIGNS.COM

CLIENT: Mihai Lancu	DATE: 09/10/2023	DRAWN BY: Diyana Yordanova	PROJECT LEAD: Awwal Kazeem
ADDRESS: 13 Cheviot Cl, Harlington, Hayes UB3 5LR	DRAWING NUMBER: 2204 D - 01	REVISION: D	12/03/2025 Diyana Yordanova

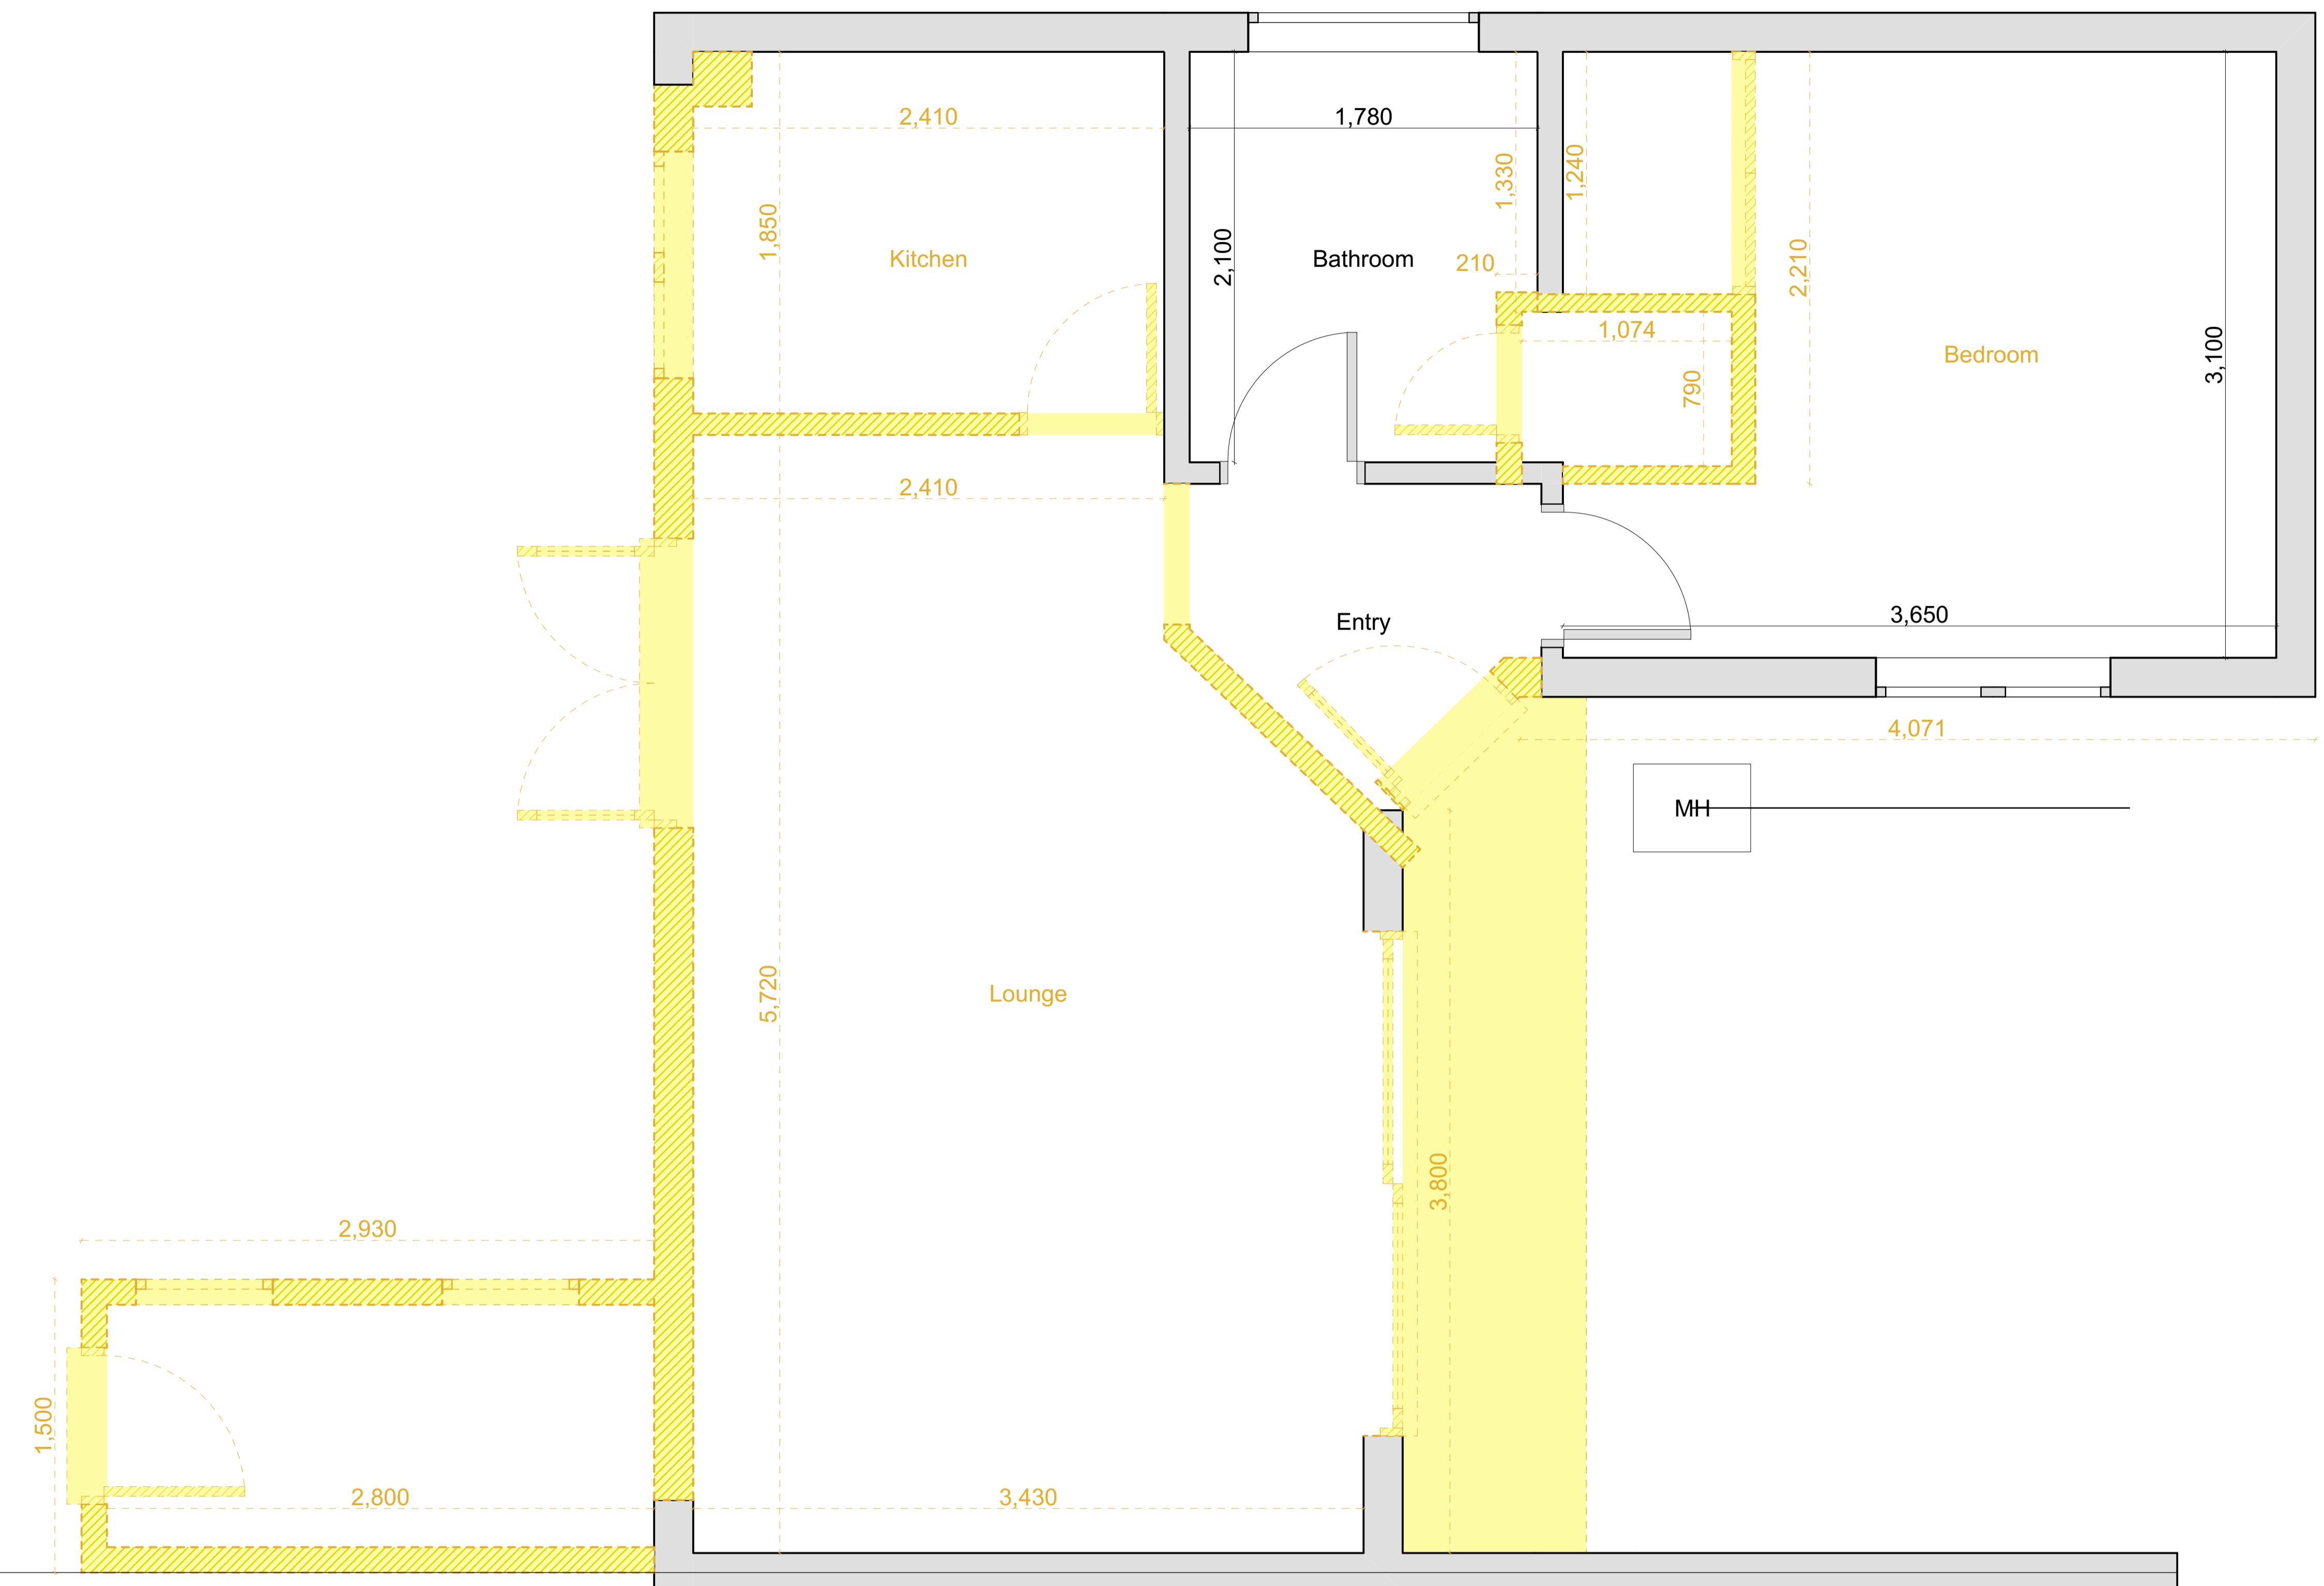

+00-Ground Floor Plan - Demolished


1:20

All Dims in millimeters unless otherwise stated. Do not scale except for planning purposes. If in doubt - Ask	Scale 1:25	0 1 2m
This drawing is confidential and is the property of Keenan Project Designs Ltd.	Scale 1:50	0 1 4m
© Copyright	Scale 1:100	0 2 5m

KEENAN  
PROJECT  
DESIGNS

KEENAN PROJECT DESIGNS  
0800 233 5787  
INFO@KEENANPROJECTDESIGNS.COM  
WWW.KEENANPROJECTDESIGNS.COM

CLIENT: Mihai Lancu	DATE: 09/10/2023	DRAWN BY: Diyana Yordanova	PROJECT LEAD: Awwal Kazeem
ADDRESS: 13 Cheviot Cl, Harlington, Hayes UB3 5LR	DRAWING NUMBER: 2204 D - 02	REVISION: D	12/03/2025 Diyana Yordanova

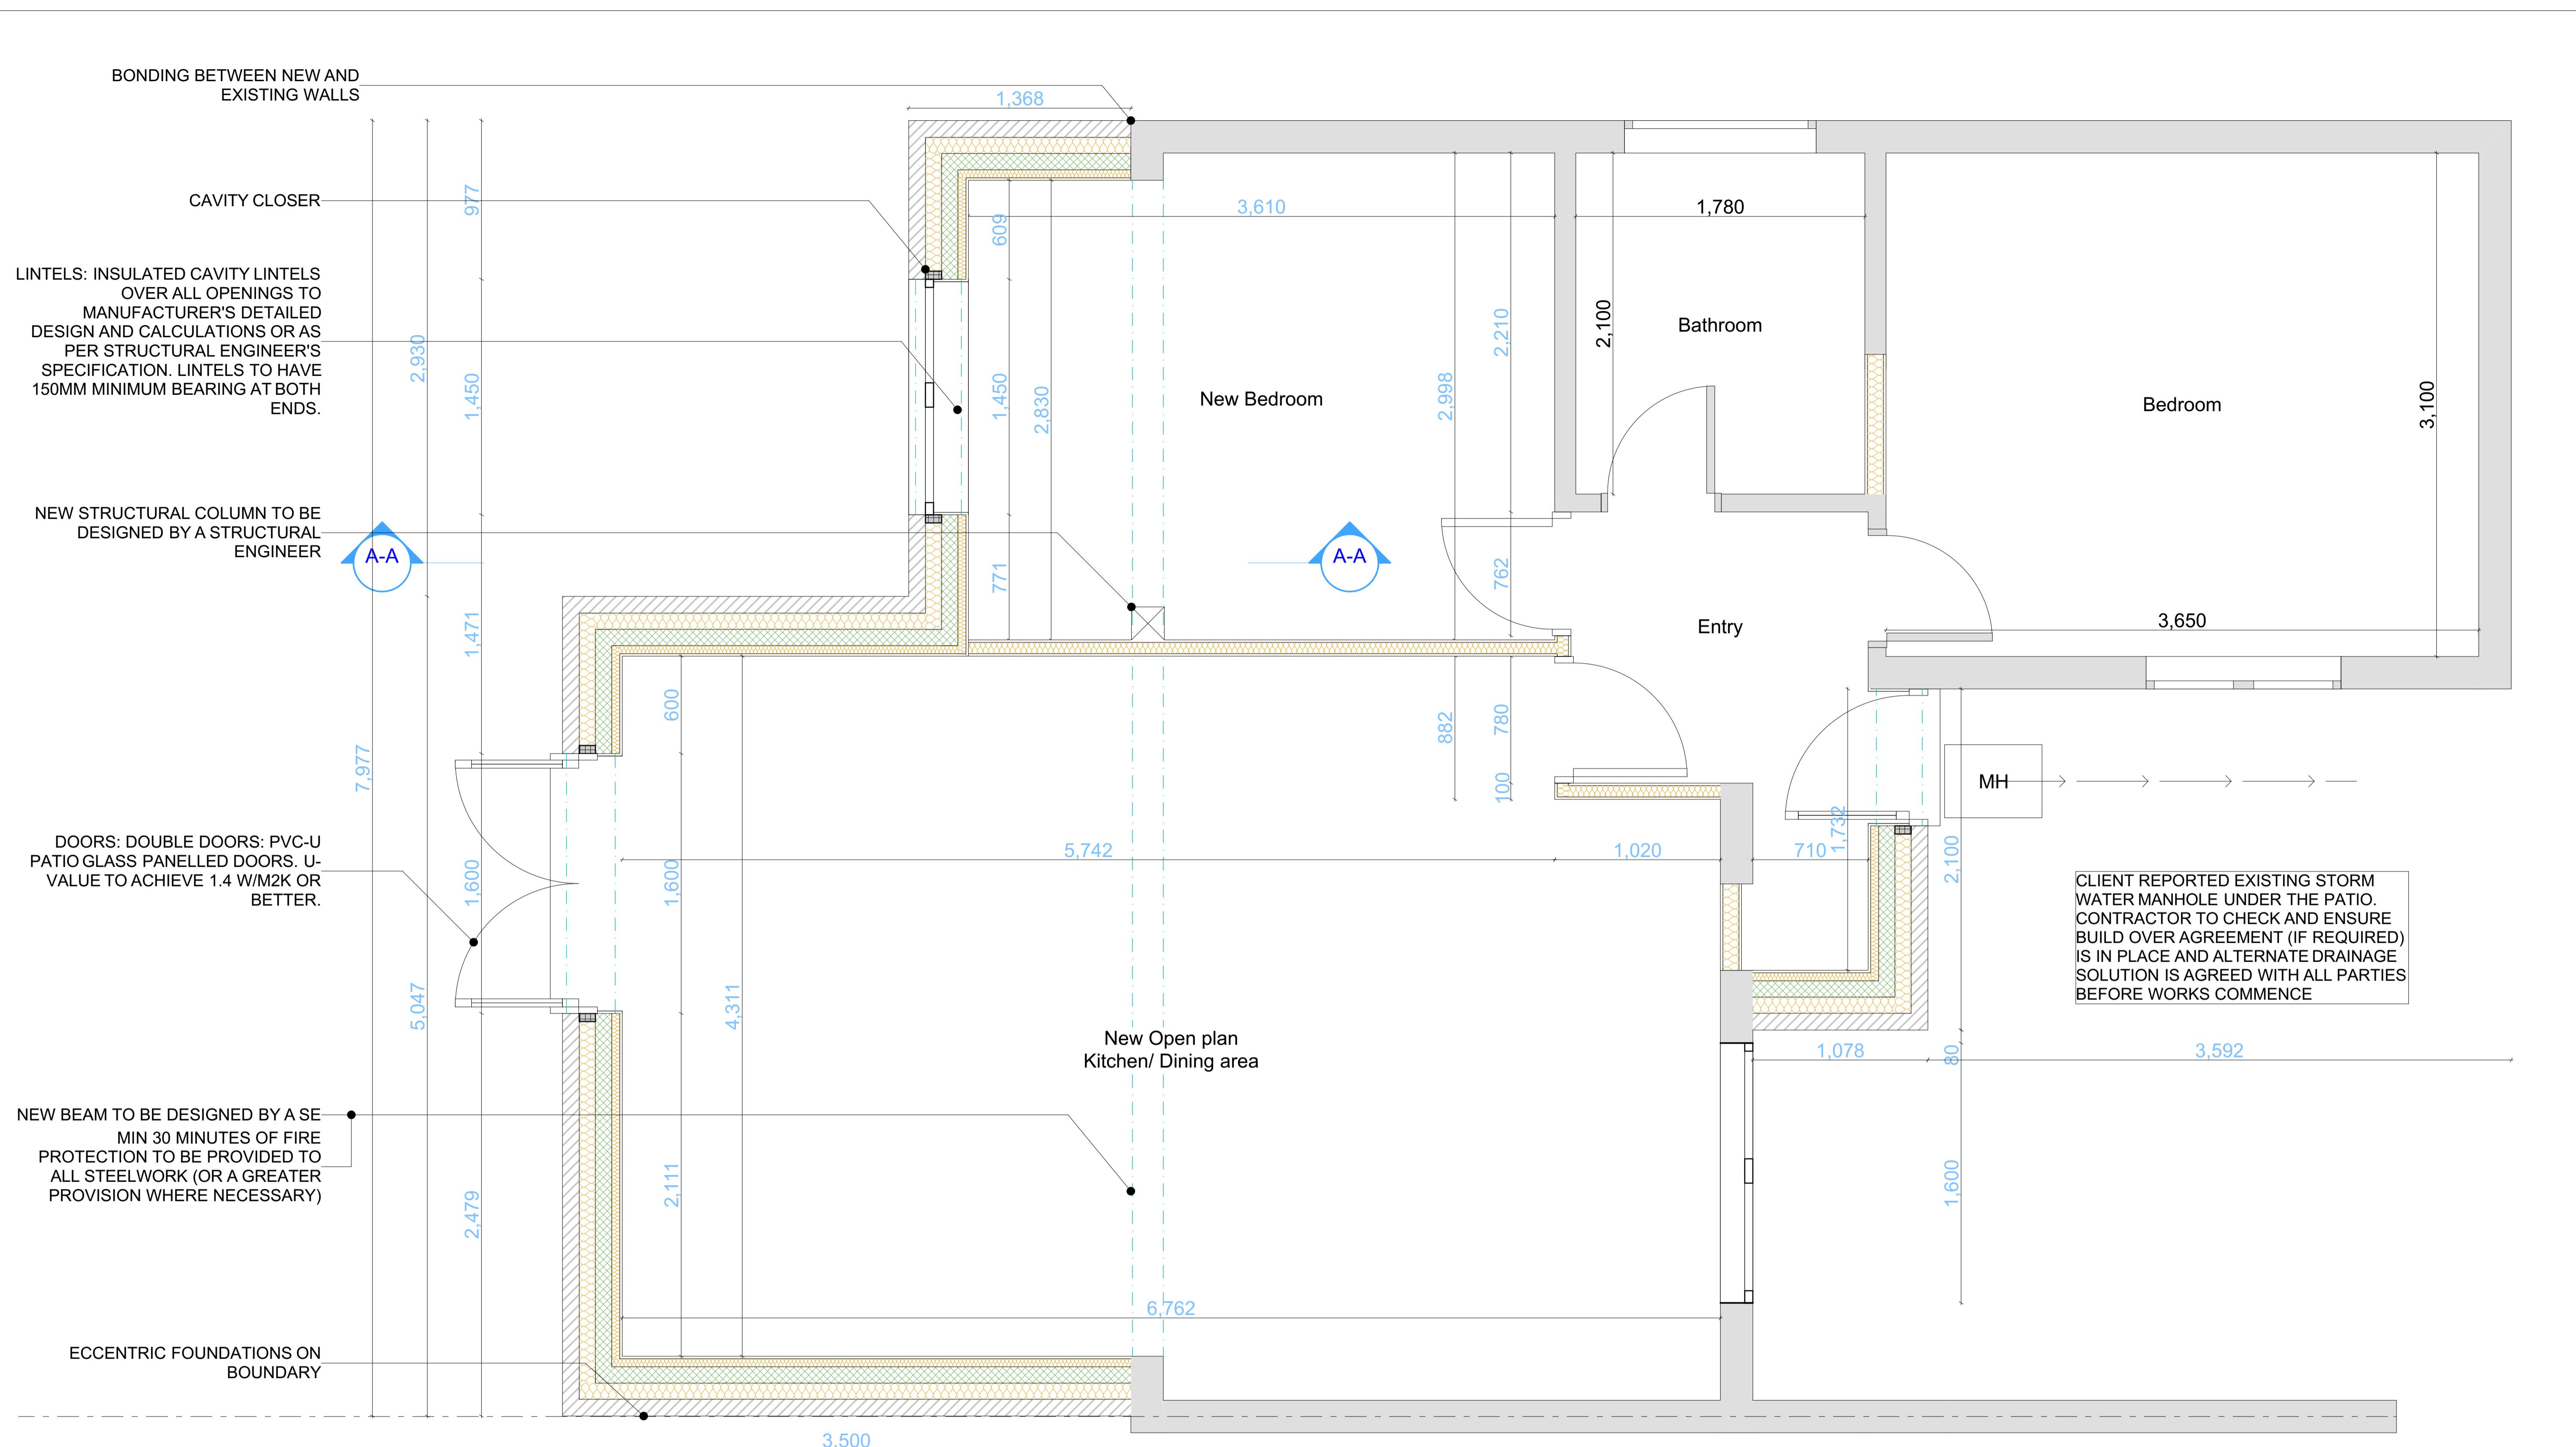

**+00-Ground Floor Plan - Proposed**


**1:20**

All Dims in millimeters unless otherwise stated. Do not scale except for planning purposes. If in doubt - Ask	Scale 1:25
This drawing is confidential and is the property of Keenan Project Designs Ltd.	Scale 1:50
© Copyright	Scale 1:100

**KEENAN  
PROJECT  
DESIGNS**


**KEENAN PROJECT DESIGNS**  
0800 233 5787  
INFO@KEENANPROJECTDESIGNS.COM  
WWW.KEENANPROJECTDESIGNS.COM

<b>CLIENT:</b> Mihai Lancu	<b>DATE:</b> 09/10/2023	<b>DRAWN BY:</b> Diyana Yordanova	<b>PROJECT LEAD:</b> Awwal Kazeem
<b>ADDRESS:</b> 13 Cheviot Cl, Harlington, Hayes UB3 5LR	<b>DRAWING NUMBER:</b> 2204 D - 03	<b>REVISION:</b> D 12/03/2025 Diyana Yordanova	

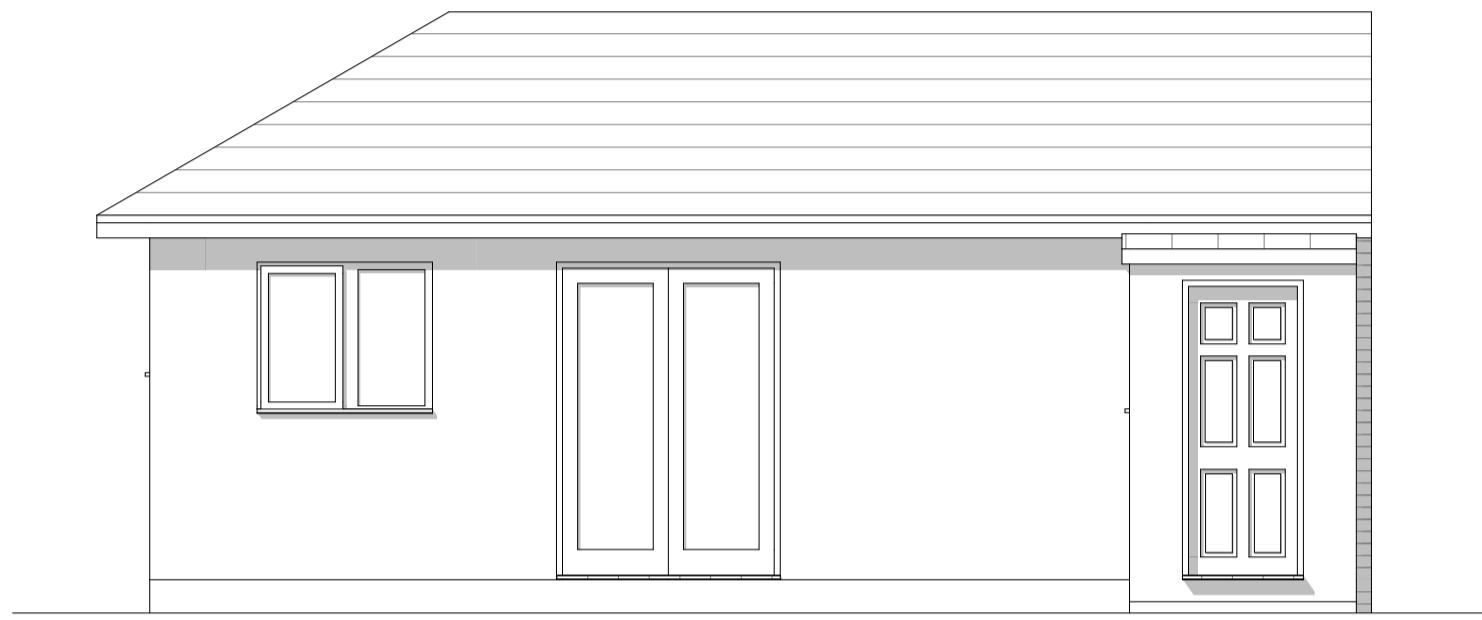


Existing Front Elevation

1:50

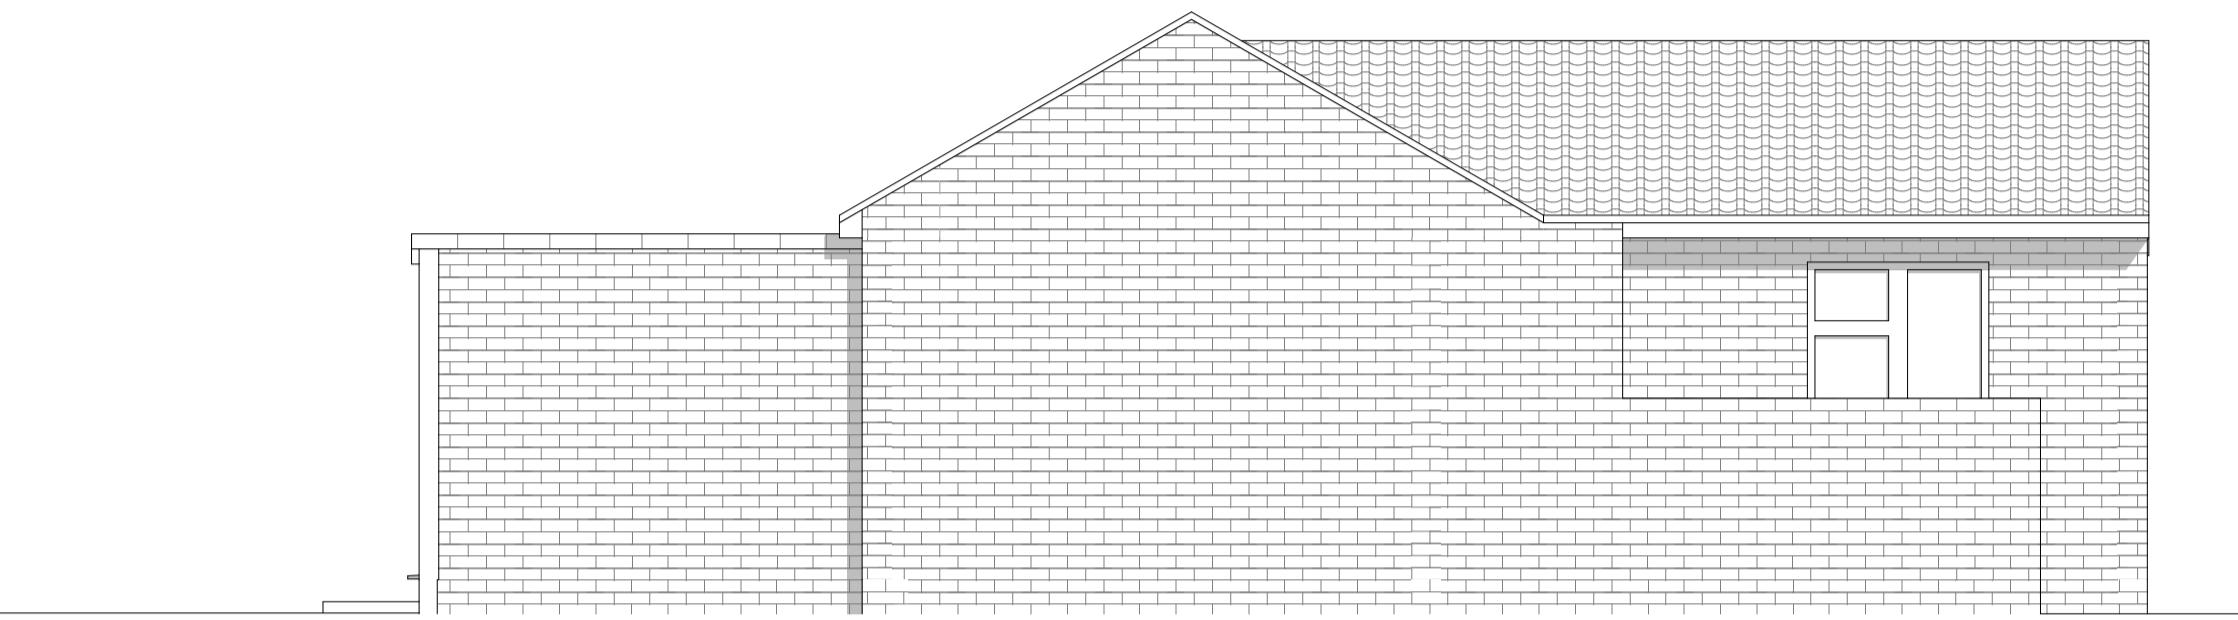


Existing Side 2 Elevation

1:50

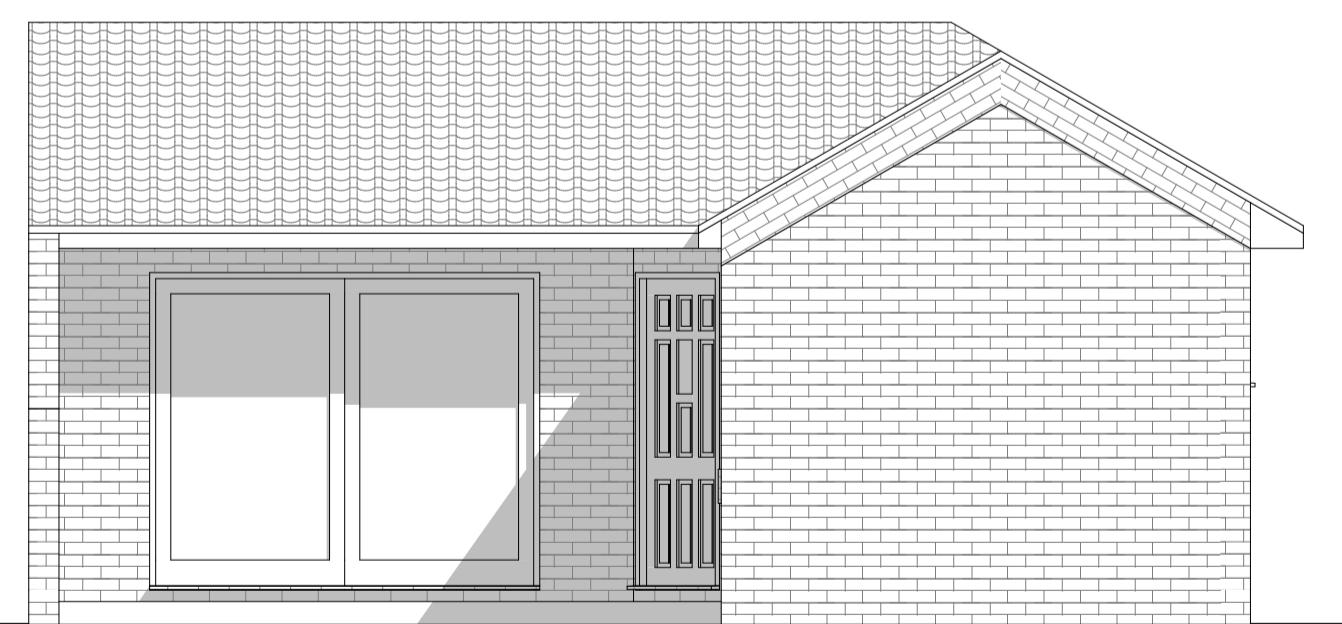

Existing Rear Elevation


1:50

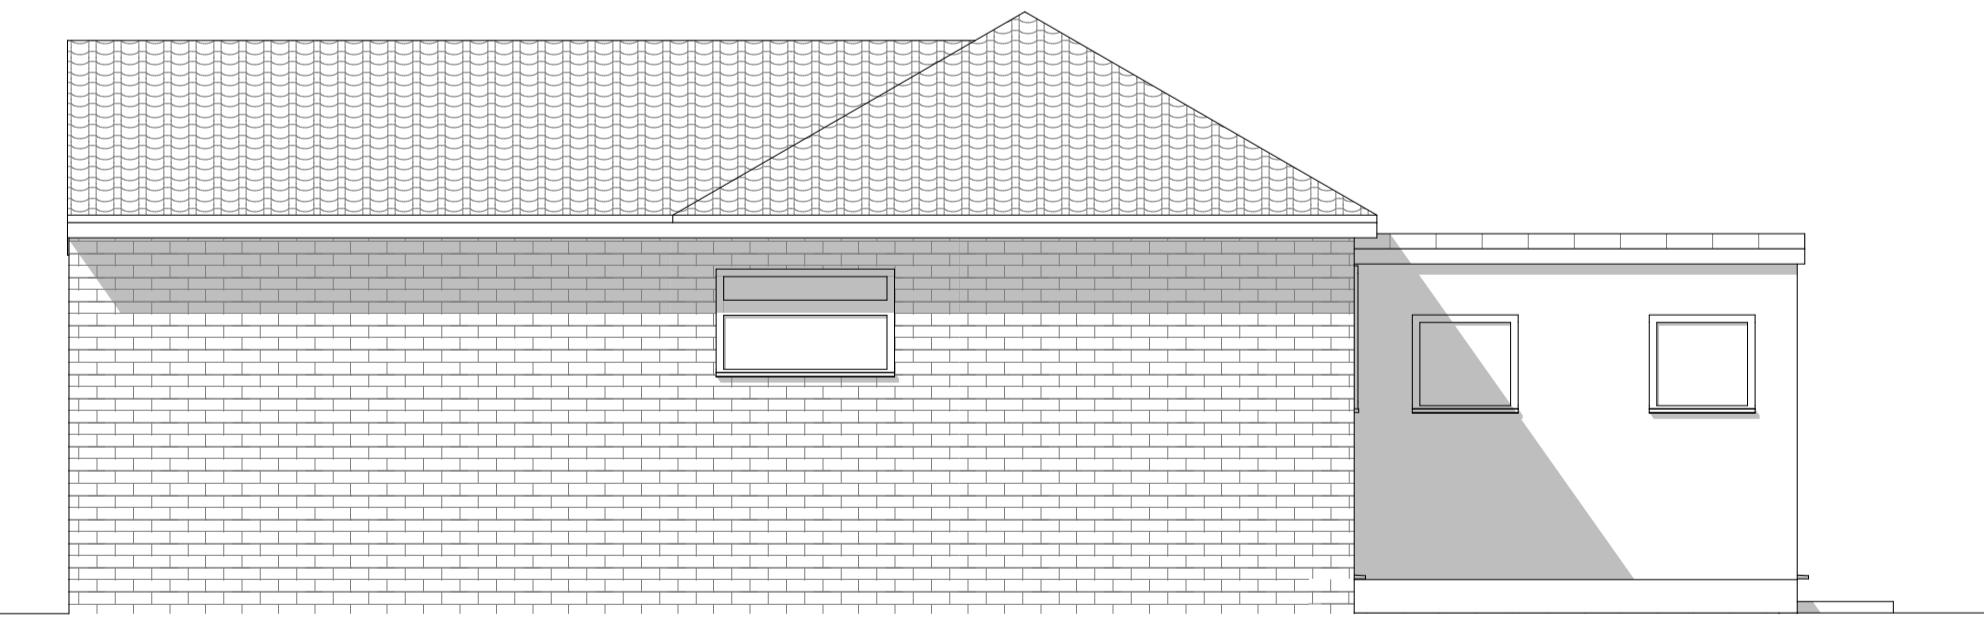

Existing Side 1 Elevation

1:50

All Dims in millimeters unless otherwise stated.  
Do not scale except for planning purposes.  
If in doubt - Ask  
This drawing is confidential and is the property of Keenan Project Designs Ltd.  
© Copyright

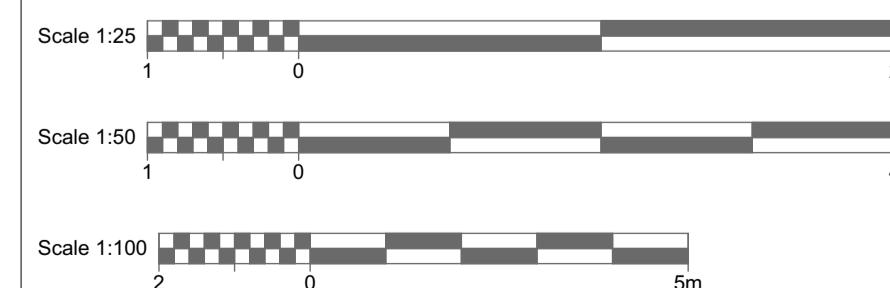

KEENAN  
PROJECT  
DESIGNS

KEENAN PROJECT DESIGNS  
0800 233 5787  
INFO@KEENANPROJECTDESIGNS.COM  
WWW.KEENANPROJECTDESIGNS.COM

CLIENT:  
Mihai Lancu

DATE:  
09/10/2023

DRAWN BY:  
Diyana Yordanova

PROJECT LEAD:  
Awwal Kazeem

ADDRESS:  
13 Cheviot Cl, Harlington, Hayes UB3 5LR


DRAWING NUMBER:  
2204 D - 04

REVISION: D  
12/03/2025  
Diyana Yordanova




Proposed Front Elevation

1:50

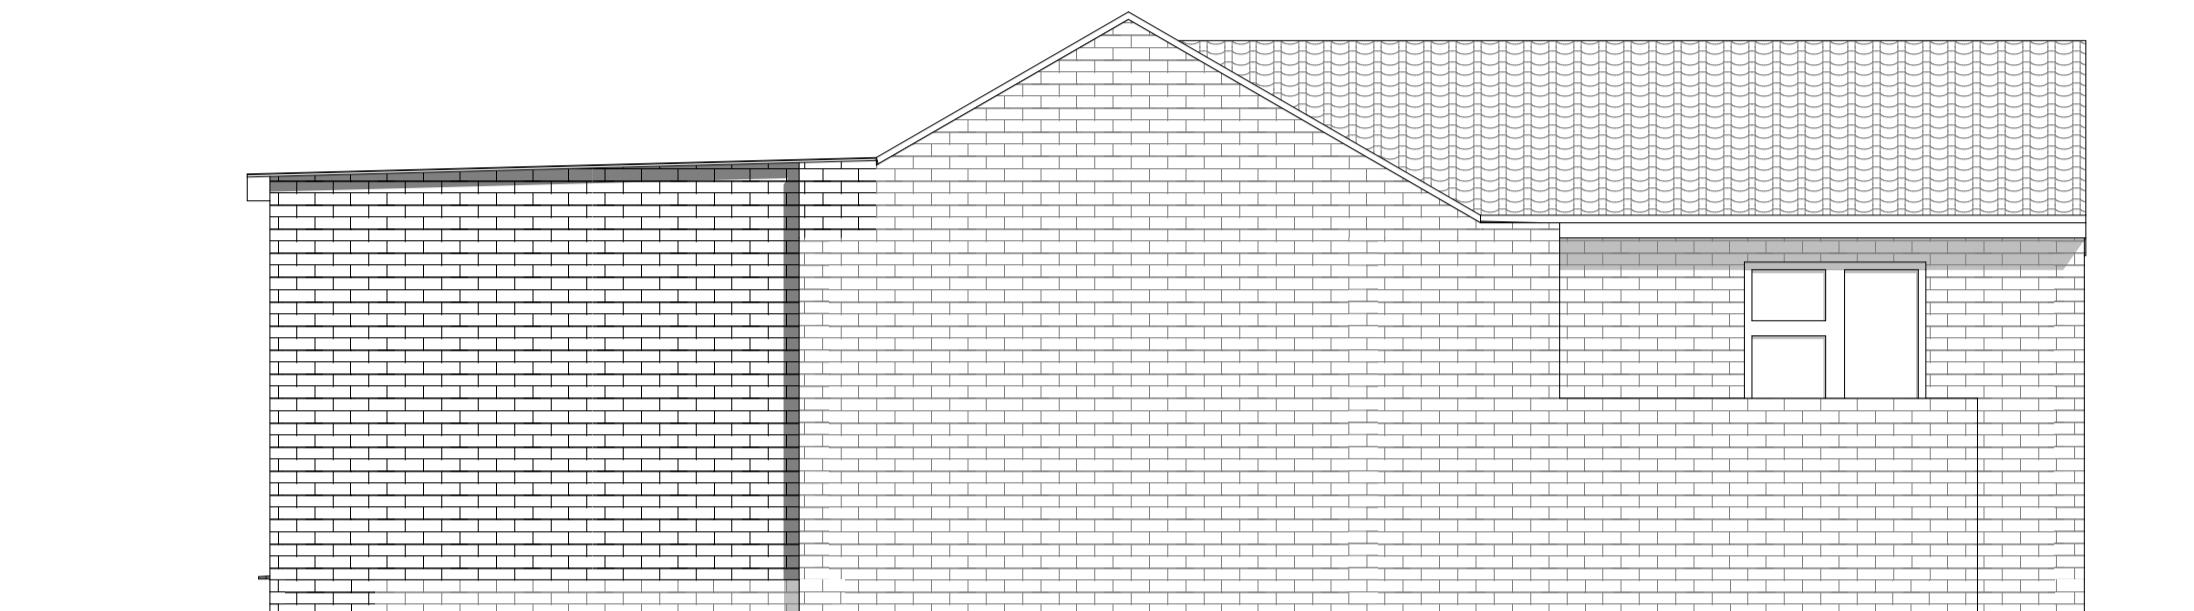


Proposed Side 2 Elevation

1:50

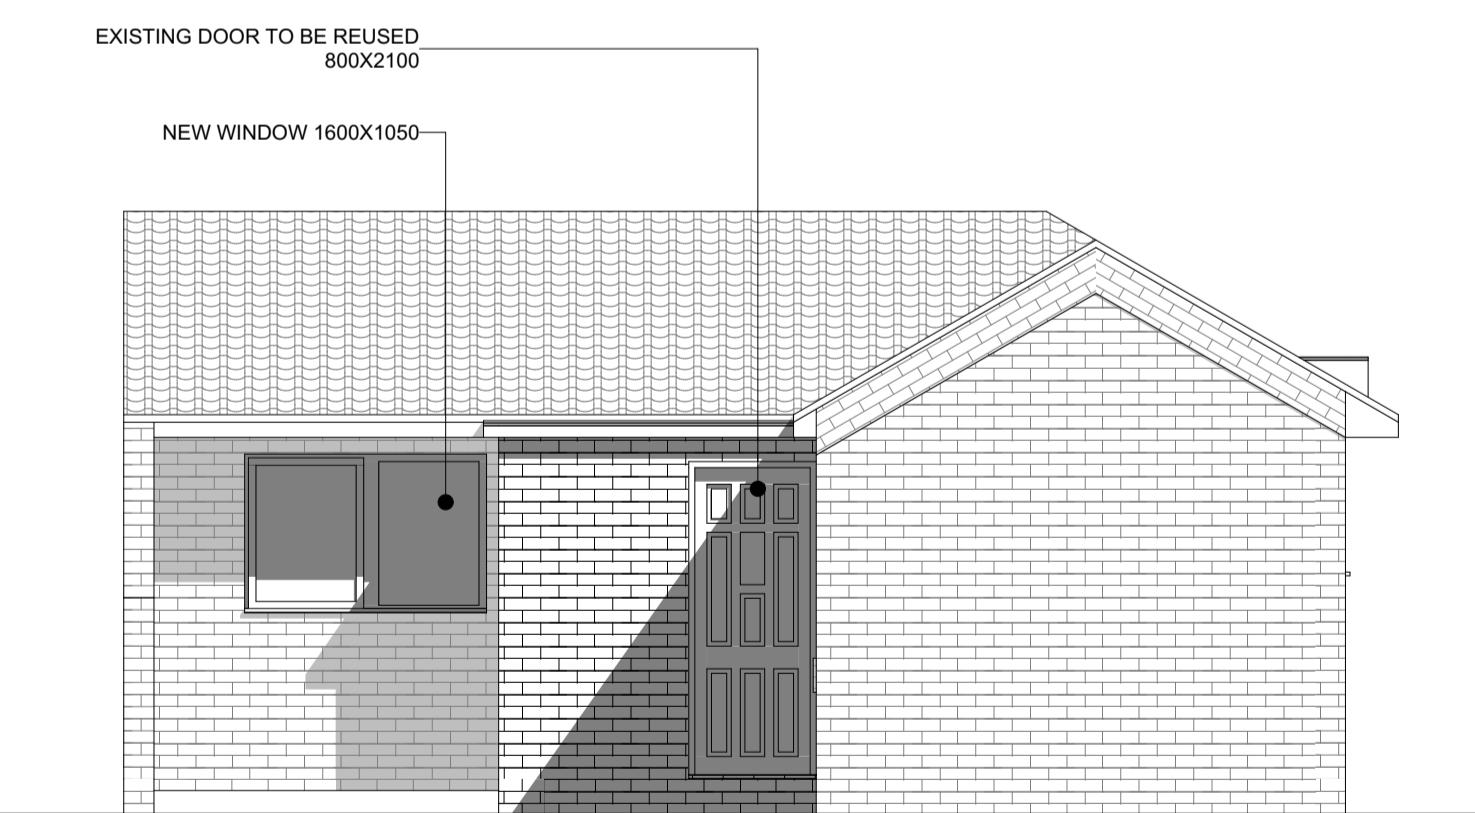

Proposed Rear Elevation


1:50

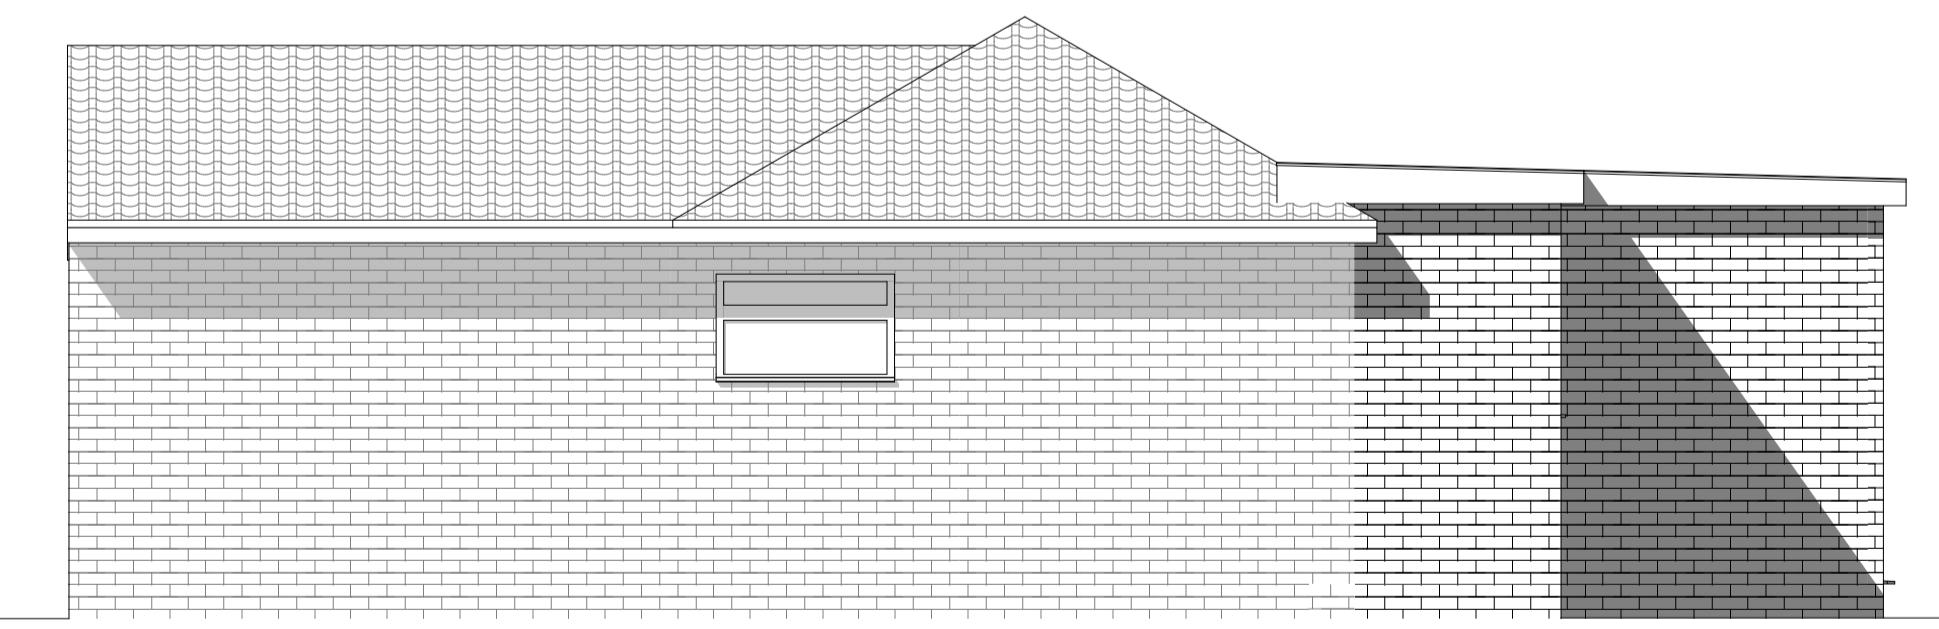

Proposed Side 1 Elevation

1:50

All Dims in millimeters unless otherwise stated.  
Do not scale except for planning purposes.  
If in doubt - Ask  
This drawing is confidential and is the property of Keenan Project Designs Ltd.  
© Copyright

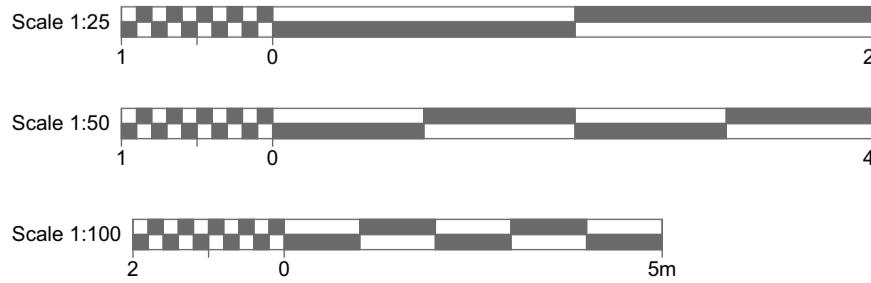

KEE N A N  
P R O J E C T  
D E S I G N S

KEENAN PROJECT DESIGNS  
0800 233 5787  
INFO@KEENANPROJECTDESIGNS.COM  
WWW.KEENANPROJECTDESIGNS.COM

CLIENT:  
Mihai Lancu

DATE:  
09/10/2023


DRAWN BY:  
Diyana Yordanova

PROJECT LEAD:  
Awwal Kazeem

ADDRESS:  
13 Cheviot Cl, Harlington, Hayes UB3 5LR

DRAWING NUMBER:  
2204 D - 05

REVISION: D  
12/03/2025  
Diyana Yordanova

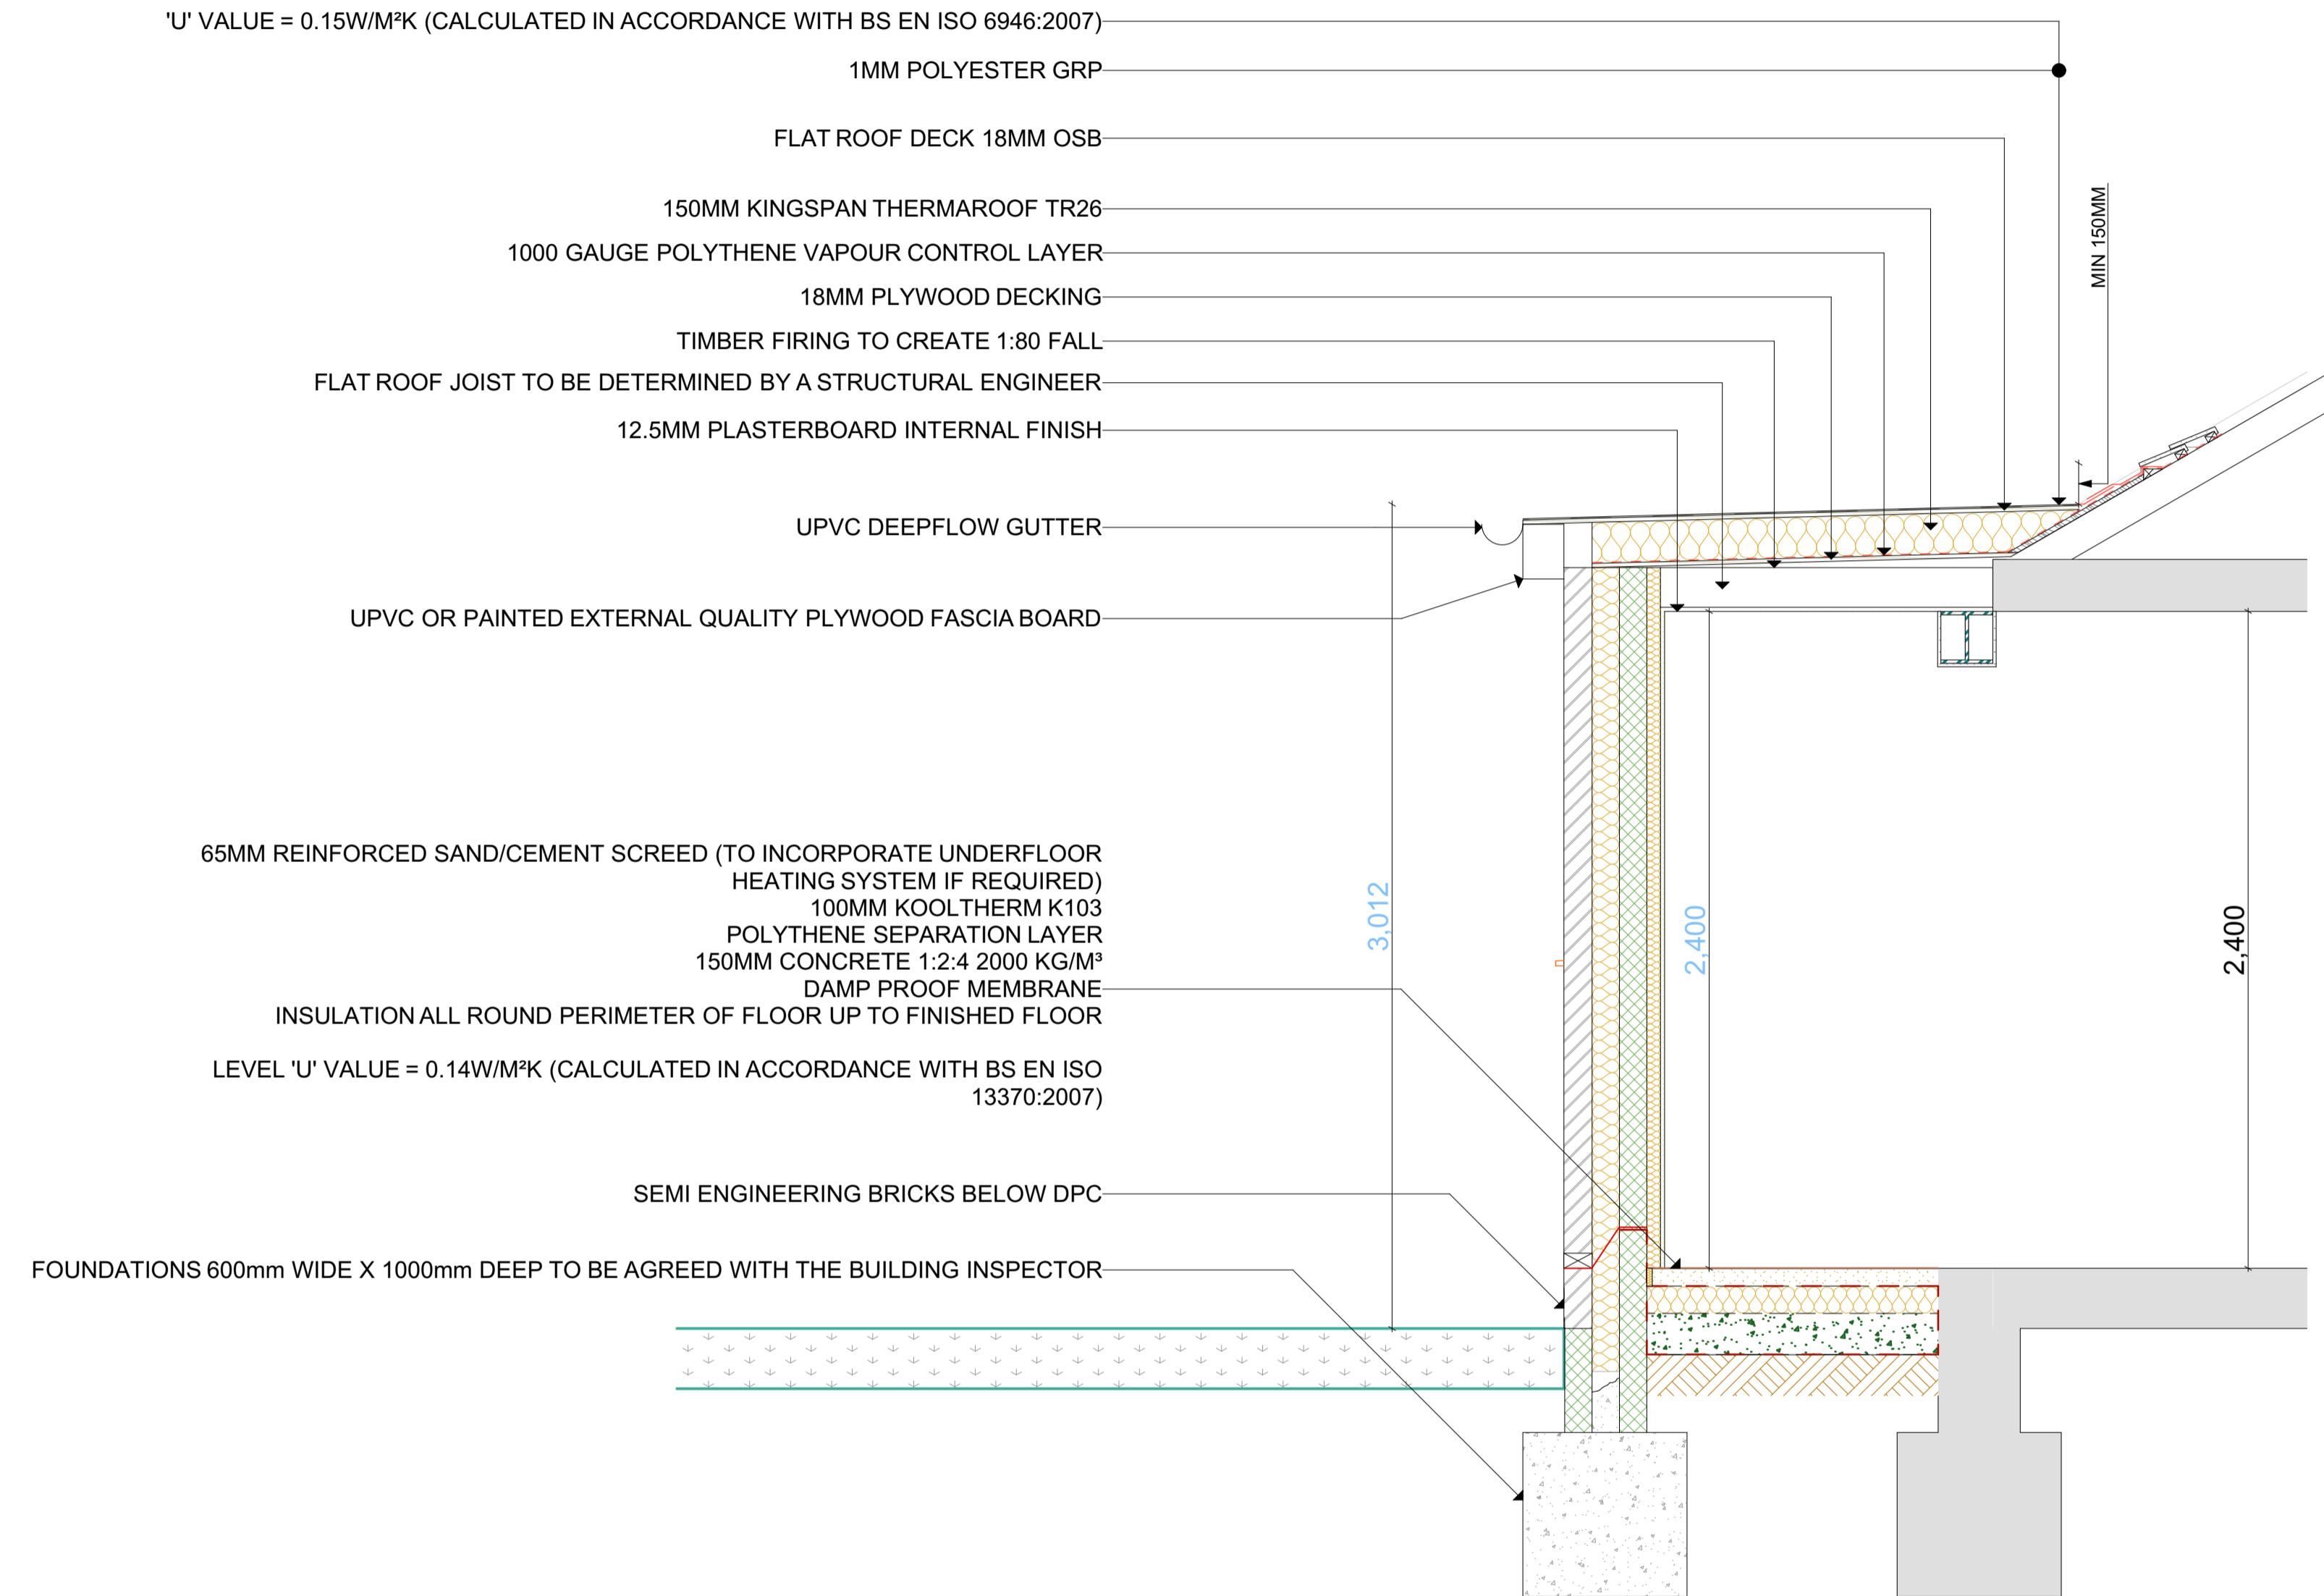

Proposed Section A-A

1:20

All dims in millimeters unless otherwise stated. Do not scale except for planning purposes. If in doubt - Ask	Scale 1:25	0 1 2m
This drawing is confidential and is the property of Keenan Project Designs Ltd.	Scale 1:50	0 1 4m
© Copyright	Scale 1:100	0 2 5m

KEENAN  
PROJECT  
DESIGNS


KEENAN PROJECT DESIGNS  
0800 233 5787  
INFO@KEENANPROJECTDESIGNS.COM  
WWW.KEENANPROJECTDESIGNS.COM

CLIENT: Mihai Lancu	DATE: 09/10/2023	DRAWN BY: Diyana Yordanova	PROJECT LEAD: Awwal Kazeem
ADDRESS: 13 Cheviot Cl, Harlington, Hayes UB3 5LR			DRAWING NUMBER: 2204 D - 06



Existing Site Plan

1:1250

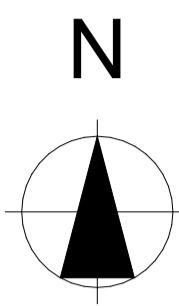

Existing Site Plan

1:500

All Dims in millimeters unless otherwise stated.  
Do not scale except for planning purposes.  
If in doubt - Ask

This drawing is confidential and is the property of Keenan Project Designs Ltd.  
© Copyright

Scale 1:1250 25 0 60m

Scale 1:500 5 0 30m

KEEAN  
PROJECT  
DESIGNS

KEEAN PROJECT DESIGNS  
0800 233 5787  
INFO@KEEANPROJECTDESIGNS.COM  
WWW.KEEANPROJECTDESIGNS.COM

CLIENT:  
Mihai Lancu

DATE:  
09/10/2023

DRAWN BY:  
Diyana Yordanova

PROJECT LEAD:  
Awwal Kazeem

ADDRESS:  
13 Cheviot Cl, Harlington, Hayes UB3 5LR

DRAWING NUMBER:  
2204 D - 07

REVISION: D  
12/03/2025  
Diyana Yordanova

## GENERAL CONSTRUCTION GUIDANCE NOTES

### GENERAL NOTE

Before commencement of work, positions of all existing services including drainage are to be ascertained & any protective or diversion works are to be carried out as necessary. Severn Trent approval may be required - contractor to check with relevant authority. Existing drainage invert is to be determined to establish adequate falls from new drainage fittings. Any necessary propping and strutting is to be carried out to ensure stability of the structure during building operations. All materials & workmanship are to comply with all building regulations, british standards & codes of practice. All timbers are to be double vacuum pressure impregnated with Protim Prevac 80' or similar approved preservative, with all site cuts, ends & holes etc to be treated with 'Protim' cut end preservative liberally applied by brush.

Client/builder to carry out site investigation & results to be forwarded to the building control body to establish the levels of contamination if any & the suitability of ground conditions before the works commence.

Builder to check all load bearing elements on site before any works commence on site. The drawings are prepared to comply with the current building regulations & are to be read in conjunction with all relevant specialist drawings, calculations & details where appropriate. All dimensions are to be checked on site by builder before work commences, and adhered to in all cases including heights etc. As noted on the drawings.

KPD takes no responsibility for any alterations to these drawings.

These drawings are for building regulation approval only.

Any work undertaken before approval is obtained is all at the risk of the client and builder. KPD takes no responsibility for any work undertaken at this stage. Please note these drawings were prepared in compliance with planning and building regulations which were in force at the time of preparation. KPD accepts no responsibility for drawings relied upon, which by virtue of a change in legislation and/or to planning guidelines or building regulations, render the drawings non-compliant with such legislation/guidelines after the preparation of such drawings. KPD accepts no responsibility for any alterations from the approved drawings. Nothing in our appointment or provision of drawings shall be deemed to create any appointment as or obligations as a duty holder pursuant to the regulation 7 of the cdm regulations 2015. Boundaries shown are for identification only and are not to be taken as a legal definition.

Notes: 1. Upon commencement of the works the size and position of all existing structural elements as shown on the drawing are to be verified by the contractor. 2. Existing timbers shall be exposed to allow complete timber and damp survey as necessary. All timbers shall be treated or replaced in accordance with the specialists recommendations. All timber connections are to be examined by the contractor to verify their integrity and made good of deemed necessary by the inspector. Where wall plates required replacement the new timbers are to be secured by 30x2.5mm galvanised mild steel straps at 1200mm max. cr's and screwed to existing wall with sno. 50mm long no.12 wood screws in plastic plugs. 3. All new timbers shall be strength class C16 to BS5268 part 2 unless noted otherwise. All new timbers shall be strength class C16 to BS5268 part 2 unless noted otherwise. All new timber connections are to be formed using joists hangers or framing anchors and clips supplied by 'Expamet' or similar. 4. All existing masonry shall be examined by the contractor any cracked or flaked brickwork shall be repaired or rebuilt to the satisfaction of the client, any loose or soft mortar shall be raked out and repointed. 5. All new steelwork shall comply fully with BS5950. The contractor shall take all necessary site dimensions and levels prior to commencement of fabrication. 6. The contractor shall be responsible for the stability of the existing building whilst carrying out the proposed alterations all temporary works needing propping and shoring to the existing structure shall be designed by the contractor. 7. All new brickwork to have a compressive strength of 21N/mm sq. built in 1:16 cement:lime:sand mortar unless stated otherwise. 8. Concrete padstones to be grade C35 10mm maximum size aggregate with 300kg/m<sup>3</sup> c.p.c. 9. Floor joists to be doubled up below new baths 10. Joist size to be deemed by structural engineer Building regulations approval, cdm regulations, health & safety, temporary work and interim stability

1. The builder shall comply with the building regulations. Any work carried out on site prior to full building regulation approval from the building control body is entirely at the risk of the builder. 2. The builder shall comply with all aspects of the construction (Design & Management) regulations 2015. 2.1 The builder shall carry out his own risk assessments for all aspects of the Works. 2.2 The builder shall provide method statements for the following items of work or items as requested: a) Excavation below existing foundation levels when in close proximity to existing foundations. b) Underpinning c) Working with machinery when adjacent to or over existing occupied buildings d) Erection/installation of steelwork adjacent to or over existing occupied buildings 3. The builder shall maintain records of all on site changes to the drawings and calculations and provide a full set of "marked-up" drawings to show the "as-built" construction. 4. The builder is reminded that the structures stability relies on all structural elements to be completed and cured. The builder is required to consider his construction methods/sequences and to assess temporary works and bracing requirements to ensure the interim stability of partially completed

THE PARTY WALL ACT 1996: The client is responsible for conforming with the Party Wall Act. The client is responsible for conforming with the Party Wall Act 1996 and obtaining the necessary neighbour agreements in the required period depending on the extent of work to the party wall/boundary.

SITE CLEARANCE  
Site to be cleared of all vegetable matter, turf, concrete etc to a minimum depth of 200mm below existing ground level.

FOUNDATIONS AND FOOTINGS  
New ground floor external walls to be taken down to concrete strip or trench fill foundations 600 wide. Internal walls to be taken down to strip foundations 440 x 200 thick. Depths to suit site conditions and to Local Authority approval prior to pouring concrete but not less than 1000mm deep.

Foundations to be grade C20P to BS.5328:1981 (min. mix 1:3:6) concrete incorporating 2 No. 16mm diameter m/s continuation reinforcing bars set centrally under each wall leaf and on the neutral axis, lapped min 200mm and bent neatly around corners, if deemed necessary by structural engineer.

Build up external walls in two skins of 7N solid dense concrete blocks using mortar mix 1:3 up to one brick depth below finished ground level. Fill cavity with sand cement mix.

### DAMP PROOF COURSE

To be Andersons XTRA-LOAD ELITE or equal approved polymeric DPC. To be installed to inner and outer skins of cavity walls and to all internal blockwork walls, to be located minimum 150mm above finished ground levels to avoid the raise of water through absorption. All joints to be lapped min. 150mm (basic Radon measure).

VERTICAL DPC: at abutments of external cavity wall to solid 215 wall. Cavity fill to finish minimum 225mm below.

Cavity trays and weepholes to be provided above structural openings and base of cavity to provide basic radon protection. Weep holes at 450mm centres over lintels

Allow for suitable cavity tray and lead flashing to roof abutment as required GROUND FLOOR

If Ground conditions permit Ground bearing floor slab to be used to specification as follows:

### GROUND FLOOR SLABS AND INFILLS:

Excavated site area to be treated with weed killer.

75mm reinforced cement/sand screed on 500-1000 gauge separation layer on 150mm Kingspan Kooltherm K103 overslab insulation (25mm edge insulation) on 100mm 100C 20P mix concrete slab, 1200gauge polythene DPM carried up at edges and lapped with dpc. If joints are required in dpm they are to be welded and tape sealed. New to existing dpm also to be welded and tape sealed.

50mm sand blinding on 150mm min crushed stone well watered and rolled hardcore.

25mm insulation to perimeter of all floors.

Construction to achieve U value of better than 0.14.

If Ground conditions don't permit using ground bearing slab then use the following suspended floor specification:

GROUND FLOOR Minimum of 150mm void under, Dense concrete block and precast concrete beam system to structural engineers and specialist suppliers design. Joints to grouted and trowelled off smooth to receive 1200g PIFA polythene dpm with 150mm min laps & to be carried up walls to lap with DPC.

100C 20P mix concrete slab, 1200gauge polythene DPM carried up at edges and lapped with dpc. All joints in dpm to be welded, taped and sealed. 100mm Kingspan ThermoFloor TF70 with 500g polythene separating layer laid over.

25mm insulation to perimeter of all floors.

Suspended concrete floor to be designed, manufactured and installed in strict accordance with the manufacturers & suppliers details and instructions.

Kingspan or similar approved insulation to be fitted in accordance with the manufacturers details and instructions.

Ventilation to underfloor void - perisopic vents at max 1.8m centres in external walls. The openings to be large enough to give an actual open area of at least the equivalent to 1500sq.mm per horizontal metre run of wall.

All perisopic vents to have pvc lintel over in inner leaf.

At least one perisopic vent within 450 of each corner/ return.

### EXTERNAL WALLS

Construction to comprise: 103 brick to match existing, 100mm cavity filled with 100mm Drytherm32 100mm blockwork inner lining to be 62.5mm insulated plasterboard on dabs and skim finish. achieving U-val 0.18 W/m<sup>2</sup>K

Both leaves of wall construction to be tied together using stainless steel vertical twist ties at 900mm horizontal, 450mm vertical centres and no greater than 300mm off reveals.

Cavities to be closed at reveals with proprietary fire proof closer such as Thermabate. Brickwork and blockwork attached to existing with Simpson Strong tie masonry connectors or similar ties

### WALL TIES

Two and a half wall ties per square metre of masonry with a maximum horizontal spacing is 900mm and a maximum vertical spacing is 450mm. Each wall tie to be set a minimum of 50mm into both masonry leaves. Cavity wall ties to be stainless steel and 225mm in length. Three courses of blue engineering bricks in 1:3 mortar to all 215mm external walls.

### BONDING OF NEW AND EXISTING WALLS

New walls to be secured to existing walls by use of stainless steel Firfix or Crocodile (or S.A.).

Fixings in accordance with manufacturers instructions complete with weather strip and mastic pointing. 100mm Dpc behind all wall end ties.

### CAVITY

To be cleared of all mortar droppings and closed at all openings at top of wall cavity closers. Lean mix concrete cavity fill to 225mm min. below DPC.

### MORTAR

Shall be at least in strength 1:1:6 Portland cement/lime/fine aggregate mortar measured by volume of dry materials up to the proportions given in BS.5628. mix to be 1:1/2 below dpc.

### LIMITING AIR LEAKAGE

The cavity wall insulation must be taken down below damp course level, finishing 150mm below the underside of the floor slab insulation. The cavity wall insulation and roof insulation

must meet at the top of the wall

Cavity wall insulation must be carried up to the full extent of gable walls. A 25mm upstand of insulation must be provided around the perimeter of floors, including where the floor slab touches outside wall (usually at door thresholds) using Celotex T-breaktm TB3000 boards.

All cavity closers must be fire proof and insulated. All details are designed to comply with the robust construction manual details for air leakage and thermal bridging. A suitably qualified person should be appointed to inspect all works during construction, and shall issue a signed report on completion and issue to local authority.

### STRUCTURE

FOUNDATIONS, STEEL BEAMS, PURLINS, RAFTERS, LINTELS, FLOOR JOISTS, PADSTONES & BEARINGS, SUSPENDED SOLID FLOORS, BLOCK STRENGTH, LATERAL RESTRAINT, SCREEN WALLS, RETAINING WALLS, ALL MOVEMENT JOINTS, PIER SIZES & STRUCTURAL STABILITY OF WALLS, BUTTRESSES ETC., TO BE DESIGNED BY STRUCTURAL ENGINEER.

### HALF HOUR FIRE PROTECTION

to structural steel beams supporting floors and steel columns to be encased with 12.5mm Fireline plasterboard and skim to give 30mins fire resistance.

If restricted space around beams then coat the steelwork with intumescent paint to the thickness required by the manufacturer to provide 30mins fire protection

Lintels to be insulated in external walls.

Foundations within 5m of any trees to be adequate for root protection.

### GENERAL

All work to be carried out in full accordance with current Building Regulations and robust details as applicable. All on site operations to be carried out in full accordance with current Health & Safety Regulations and CDM Regulations 1994 as applicable.

### STUDWALLS

1No layers of 12.5mm Gyproc wall board ten (with a minimum mass per unit area of 10Kg/m<sup>2</sup>) fixed each side on studs, at 150mm c/s, with 40mm non-ferrous drywall screws to 100x50 sw treated studs at 450mm c/s for 900mm boards + 600mm c/s for 1200mm boards. With a sound absorbent layer of Isowool Acoustic partition roll fully filling the wall cavity. All joints to be well sealed. 100x50mm noggins to be fixed to support ends of boards and 900mm c/s vertically between studs.

Stud walls to be skimmed with 5mm thistle board finish.

Gyproc moisture resistant board to be used in bathroom areas.

Fill all gaps around internal walls to avoid air paths between rooms. Where partitions occur at first floor level and run parallel with joists, additional joist is to be inserted and the two bolted together.

Acoustic sealant and intumescent/ acoustic sealant on the 30min walls and ceiling around the garage.

### TIMBER TREATMENT

All existing timber to be checked for damage and repaired/replaced with similar material as necessary, under the guidance and agreement of the conservation officer and the structural engineer.

All existing timbers in roof spaces to be treated against rot and infestation. All structural timber to be pressure impregnated with an approved fungicide/insecticide preservative fluid all in accordance with B S 4978:1975 and BS 5268.

### CEILINGS

To be 12.5mm plasterboard with scrim taped joints and 3mm skim finish. 50x50mm noggins to be provided to all unsupported edges.

### LINTELS

To be either Cantic or similar approved (or to structural engineers details) to have minimum 150mm end bearing.

### FLAT ROOF 0.15 W/m<sup>2</sup>K

Flat roof to be a warm roof with fully adhered GRP single ply membrane on 150mm thick Kingspan ThermoRoof TR27 LPC/FM on Vapour control barrier on 18mm plywood deck on Timber Joists @400ctrs. built into internal walls or on hangers where reqd. (depth of flat roof joist to suit span)

12.5mm plasterboard with 3mm skim finish

Lateral restraint: 30x5mm mild steel straps at 2.0m max centres fixed along joists or perpendicular to joists with 38x150 noggins. Strap taken down cavity by a minimum of 450mm.

Roofing and insulation all bonded in accordance with relevant manufacturers details

### EAVES & SOFFITS

Soffits and fascias to be upvc or painted or stained, treated timber

### DOORS & WINDOWS

Glazing in doors which is wholly or partially within 1500mm from floor level and any glazing between finished floor level and 800mm above that level in internal and external walls and partitions should conform to at least Class C of BS 6206.

However if the smaller dimension of the pane is greater than 900MM, it should conform to at least Class B of BS 6206. In both cases glass must be marked in accordance with BS 6206.

### WINDOW AND DOOR REVEALS

All window reveals to be formed by closing cavity at jambs and cills with Thermabate or similar approved, insulated cavity closer to avoid cold bridging, installed strictly in accordance with manufacturers instructions.

### CAVITY

To be cleared of all mortar droppings and closed at all openings at top of wall cavity closers. Lean mix concrete cavity fill to 225mm min. below DPC.

### MANHOLES

For depths of over 900 mm to be constructed in Class B engineering brickwork, min wall thickness 225 mm, and flush pointed internally.

Base slab to be 150 mm thick concrete. Benching channel to be 30 degrees and topped with monolithic render (1:1 mortar).

Back filling to chamber should not be carried out until 48 hours after construction and hand packed with selected hard material.

Manholes deeper than 1.0 m to be fitted with iron steps set at 300 mm apart vertically and 200 mm apart horizontally.

Inspection chambers 900mm deep max to be Hepworth or similar 450mm dia polypropylene fitted in accordance with the manufacturers details and instructions

### HEATING

to be extended small bore h.w. radiator system

Thermostatic control in ground floor hall space and thermostatic valves to all radiators

New floor areas to have underfloor heating system if required

Space and water heating also controlled using a manually adjustable timer

Heating system generally to comply with the requirements of BS5449:1990

Existing boiler to remain in existing position. Details to be found on site visit.

Hot water & heating system. Hot water & heating system to be sealed gas fired condensing combi boiler with automatic ignition with balanced flue - outlet to terminate externally through the external wall 300mm from any opening light. System to be

designed & installed by a Capita gas safe registered heating engineer/contractor. All radiators are to be convector type with thermostatic valves. New boilers to have a

SEDBUK rating of 88.