



PROPOSED SIDE ELEVATION  
SCALE 1:100

PROPOSED REAR ELEVATION  
SCALE 1:100


PROPOSED SIDE ELEVATION  
SCALE 1:100

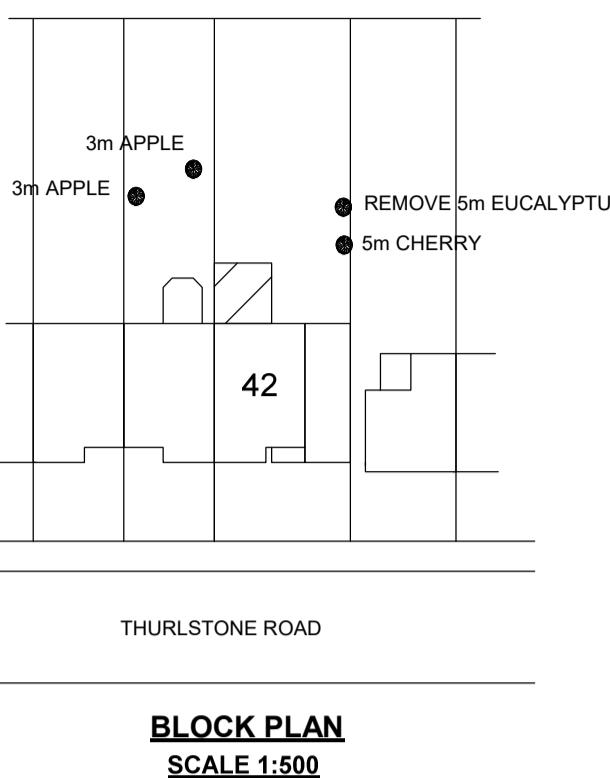


BLOCK PLAN  
SCALE 1:500

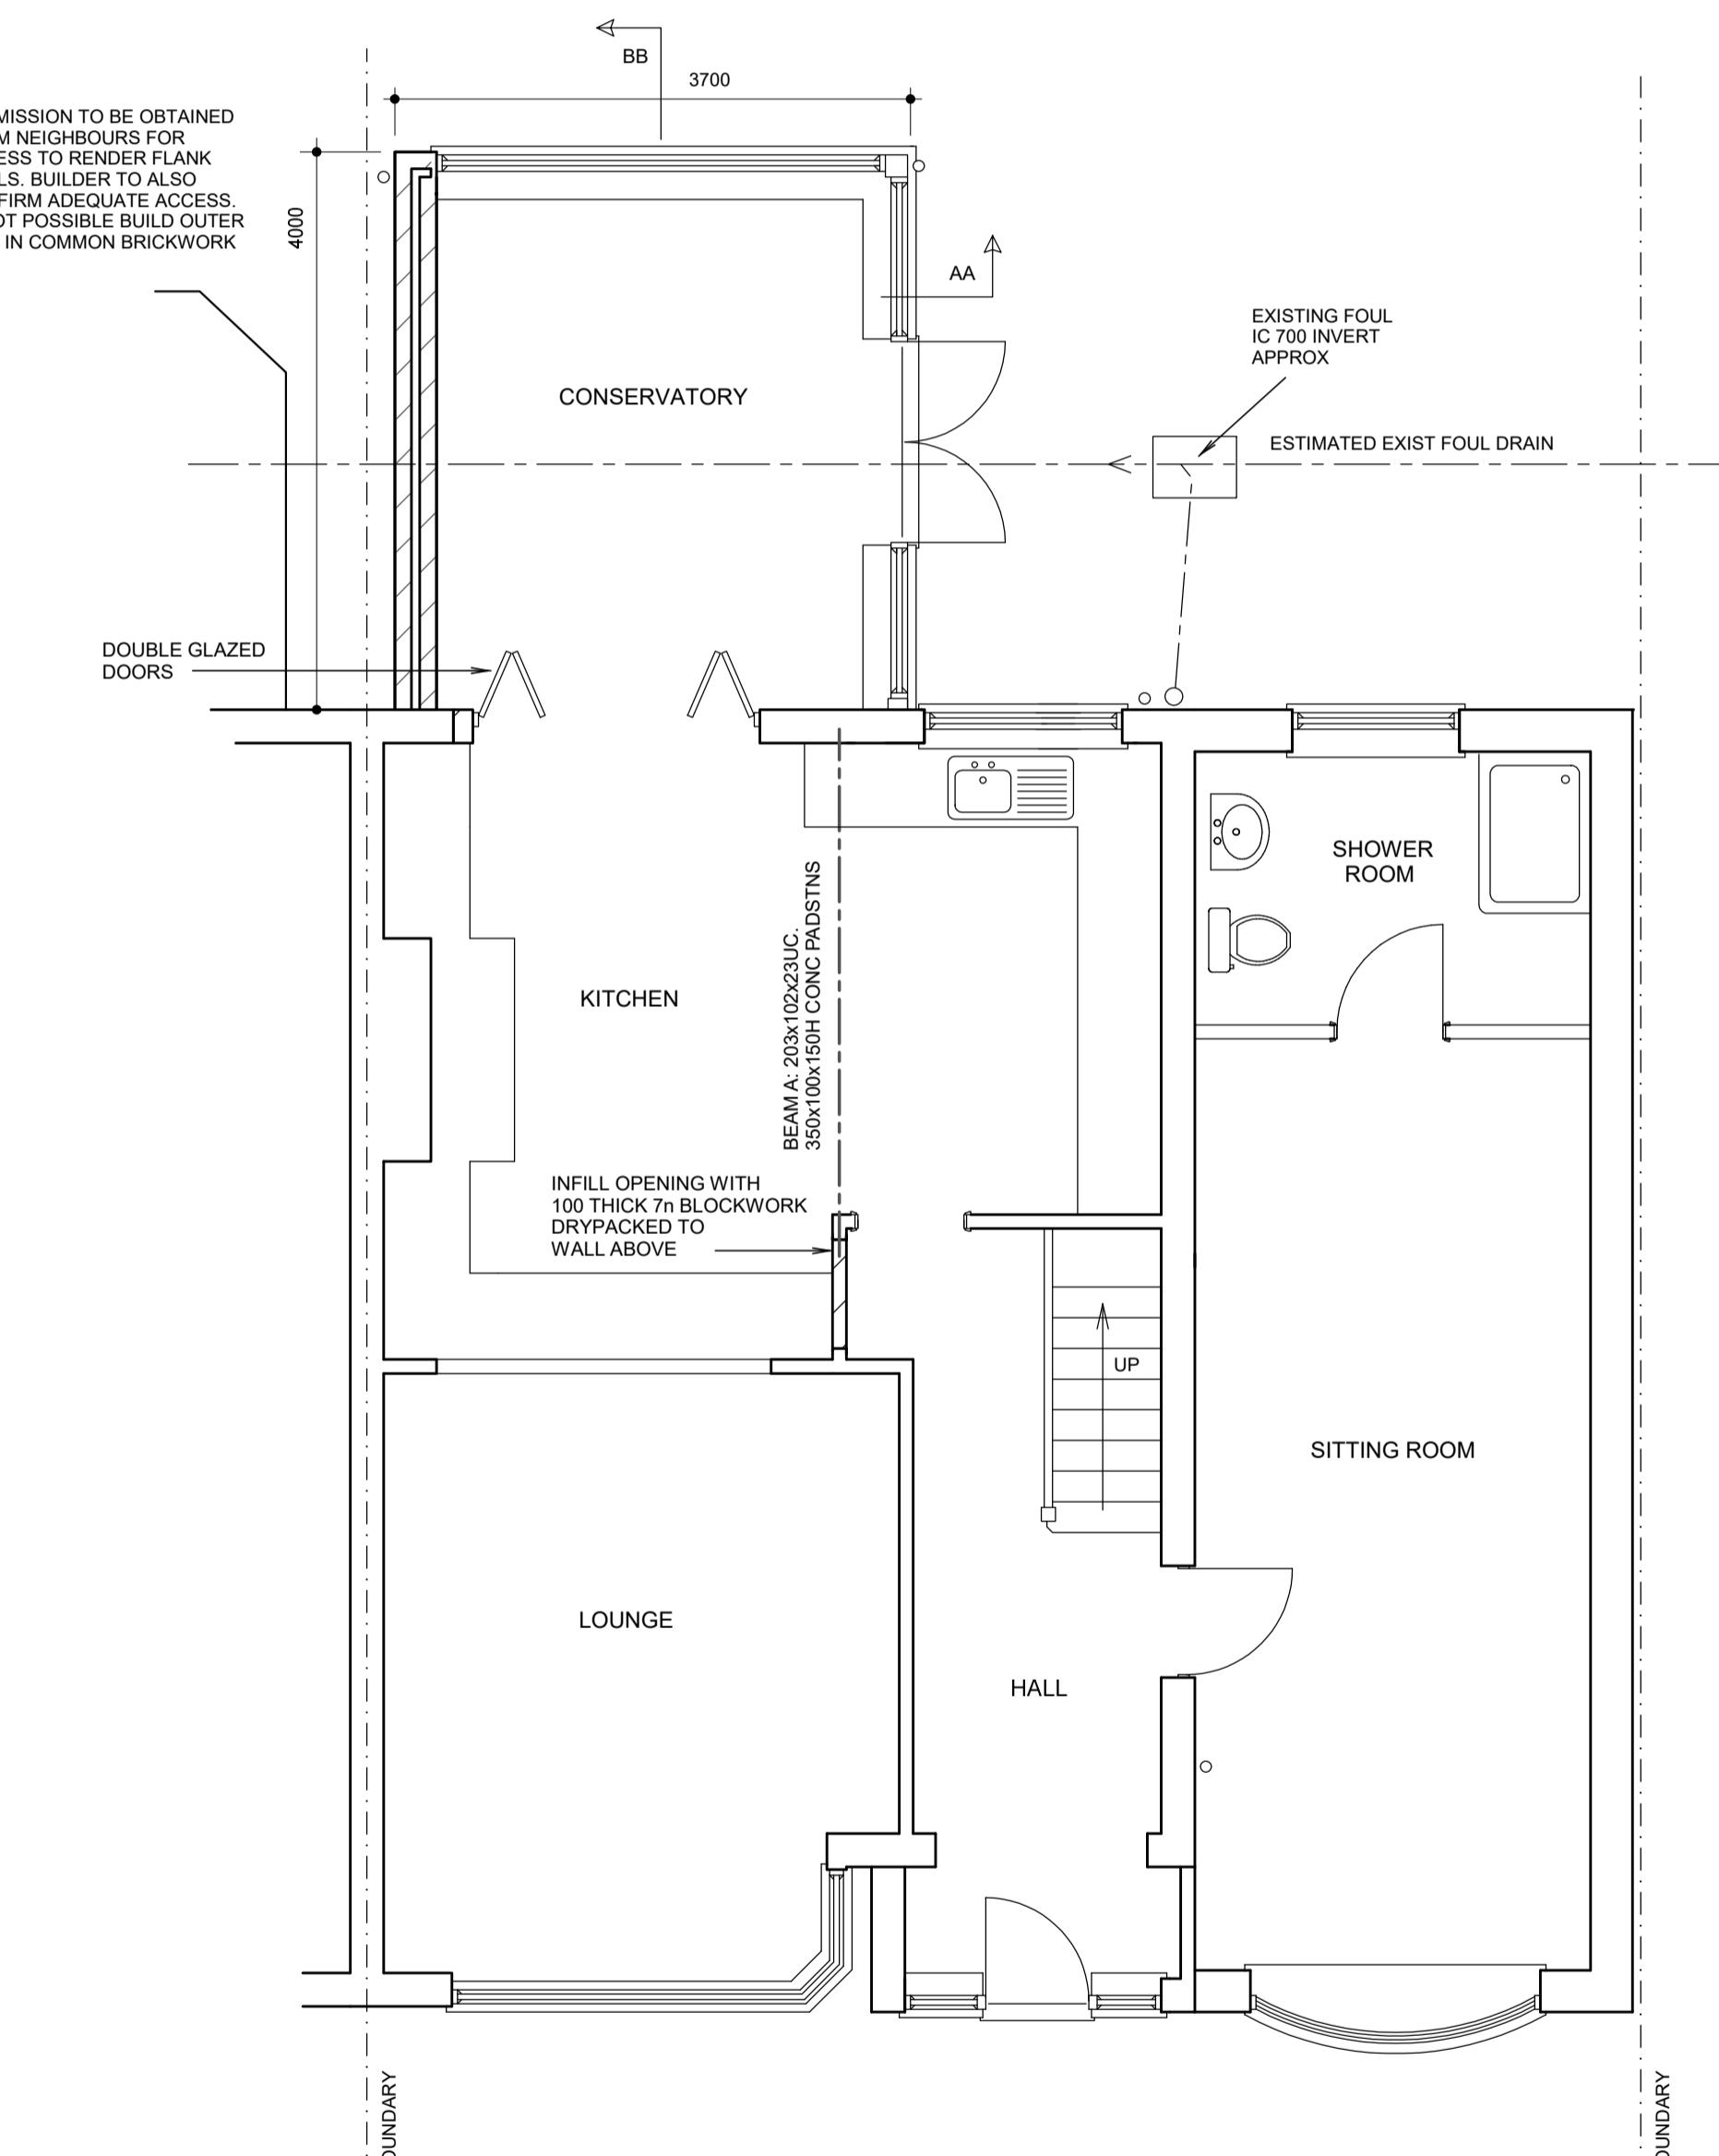

PROPOSED GROUND FLOOR PLAN

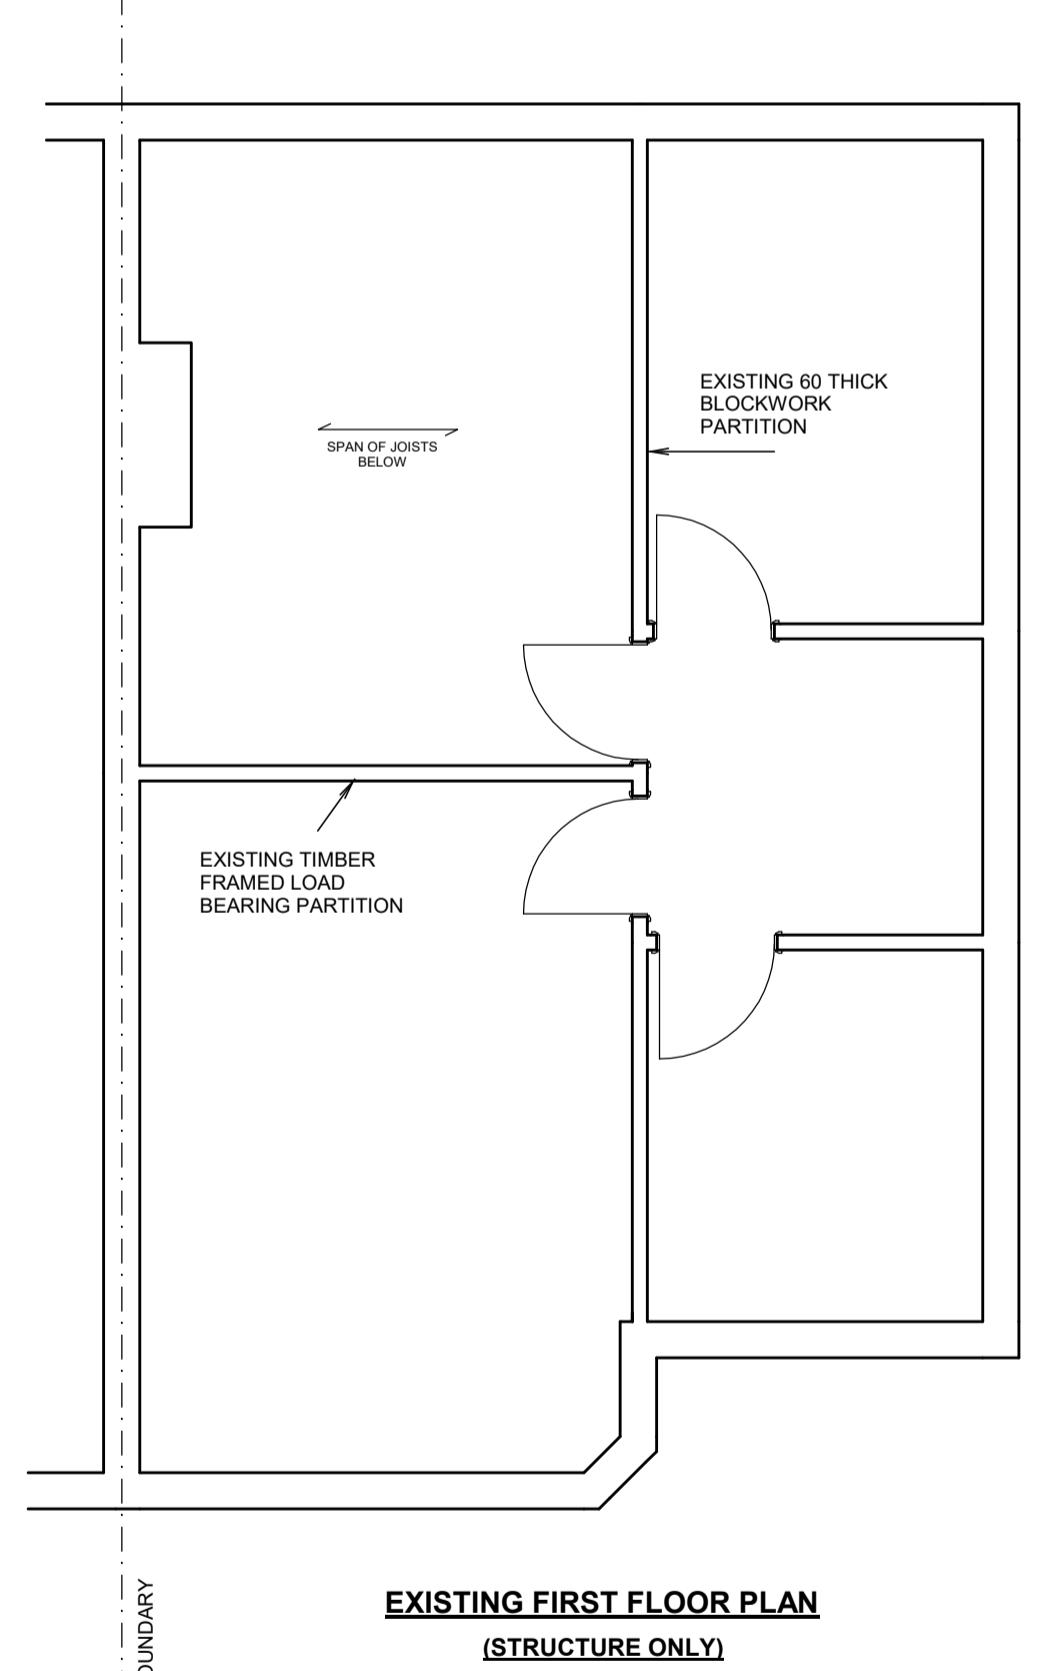

EXISTING FIRST FLOOR PLAN  
(STRUCTURE ONLY)

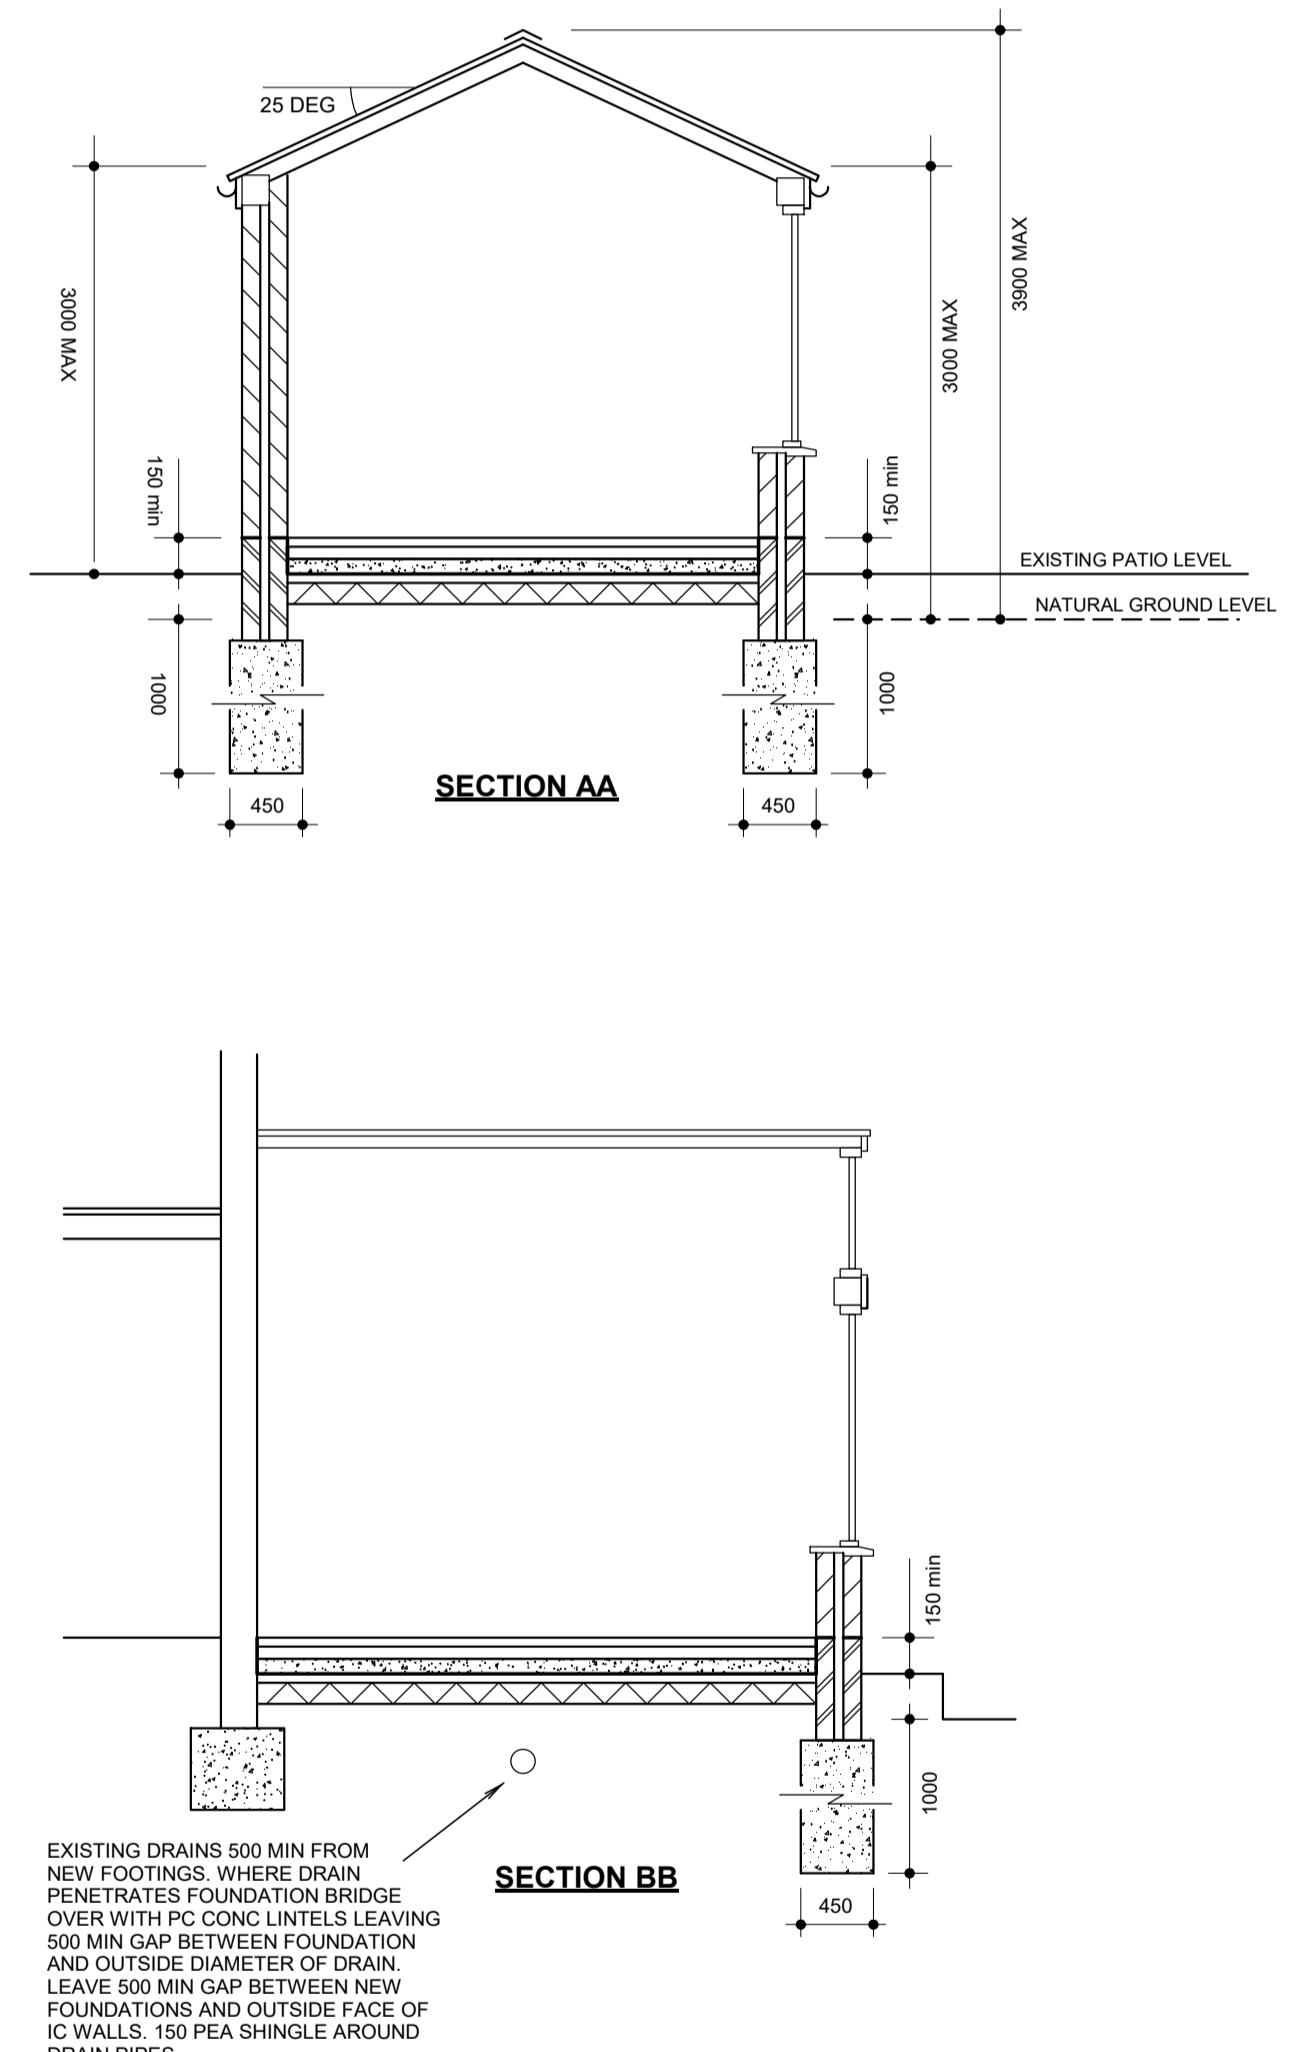

NOTE:  
FOUNDATION DEPTHS ESTIMATED AND TO BE CONFIRMED ON SITE BASED ON SITE CONDITIONS. FOOTINGS TO BE 600 BELOW LOWEST FLOOR LEVEL. 150 MM FROM ADJACENT DRAIN. 75 CLAYMASTER TO BE PROVIDED TO FOUNDATION DEPTHS EXCEEDING 1.5m. DEPTHS MEASURED TO ORIGINAL GROUND LEVEL. NOT TO TOP OF BUILT UP GROUND

GENERAL SPECIFICATION  
(unless noted otherwise on drawings or engineer's design)

FOUNDATIONS

Concrete deep strip 30 N/mm<sup>2</sup> strength sulphate resisting cement. Depth & width provisionally as plan but final depth & width to be agreed on site with building inspector. Drains running through foundations or under new walls to have 150 RC lintel over with 50 clearance. Foundations exceeding 1500 deep to have 75 claymaster to inside face kept 500 from bottom of excavation. Foundations dug next to neighbouring structures to be constructed in 'hit & miss' sequence. Excavate alternate bays not exceeding 1m long. Fill with concrete and dig next bay after concrete has fully set. Connect pins with M16 MS dowels. Any eccentrically loaded foundation to be 600mm wide with the outer face of wall 60 from foundation edge.

GROUND FLOOR – GROUND BEARING CONCRETE SLAB

Min 150 rammed hardcore blinded with 50 sand 1200 PVC DPM lapped to DPC. 100 concrete. 80 Celotex GA4000 insulation slab with staggered & taped joints. 75 screed. 500 gauge polythene separating layer between insulation & screed. All existing air vents ducted through 100 dia PVC pipe under DPC. Strip of insulation to perimeter of screed.

EXTERNAL CAVITY WALLS WITH RENDERED EXTERNAL FINISH

Cavity wall of 100 Celcon Standard lightweight block (K=0.15 W/mK) to inner & outer skin. 1:1:6 mortar mix. Class B eng brick with sulphate resisting cement below DPC. 60 cavity with 50 Knauf DriTherm-32 full fill insulation. Fill cavity with weak mix concrete to 225mm below DPC. Stainless wall ties 750 horiz. 450 vert. & 300 at reveals. Join to existing building with furfix movement joint. DPC to BS743 lapped to existing. Close cavity reveals with Thermabaté insulated cavity closers. Render exterior to match existing 2 x coat 1:1:6 mix + waterproof additive BS5262 to blockwork. Stainless steel bell drip at DPC level. Lightweight Gypsum plaster internally - 11 Thistle Bonding Coat + 3 Thistle multi finish skim.

STEELWORK

Beams to be clad with 12.5 fireline plasterboard + skim to provide 30 min fire rating. Alternatively steelwork to be painted with intumescent paint by suitably trained person to approval of building inspector on site.

SURFACE WATER

112 dia PVC gutters. 68 dia PVC downpipes. Surface water downpipes connected into existing surface water drain. If not possible construct soakaway minimum 5 metres from any building. Volume of 1 cubic metre per 16.5 square metres of roof area served. Fill with hardcore.

ABUTMENTS

All exterior abutments to have code 4 lead min 150 flashing let into brickwork or blockwork.

WINDOWS, DOORS & ROOF

Double glazed with 16 air gap and soft low E coating. Built in 8000mm<sup>2</sup> adjustable vent. All glass below 800mm, glass in doors or within 300mm of a door to be toughened safety glass.

ELECTRICAL WORK

All electrical work required to meet the requirements of Part P (Electrical Safety). Must be designed, installed, inspected & tested by a person competent to do so.

42 THURLSTONE ROAD RUISLIP MIDDX HA4 0BT

CONSERVATORY

© COPYRIGHT JAMES RUSH ASSOCIATES LTD

SCALE 1:50 / 1:100 @ A1

MARCH 2022

JAMES RUSH ASSOCIATES LTD

54 JOINERS LANE CHALFONT ST PETER  
BUCKINGHAMSHIRE SL9 0AT TEL: 01923 775 761  
EMAIL: [jamesrush@hotmail.com](mailto:jamesrush@hotmail.com)

DRG No. 2300.2 REV A

BOUNDARIES ESTIMATED AND TO BE CONFIRMED ON SITE. ALL NEW WORKS TO BE CONTAINED WITHIN TRUE BOUNDARIES UNLESS STATED OTHERWISE ON PLAN. ALL NEW WORKS TO BE IN ACCORDANCE WITH CURRENT BUILDING REGULATIONS. DIMENSIONS IN MILLIMETRES AND TO BE CONFIRMED ON SITE. ALL STEEL DIMENSIONS TO BE CONFIRMED ON SITE AND NOT BE TAKEN FROM STRUCTURAL CALCULATIONS. ALL DRAINS & TREES ARE ESTIMATED AND ARE TO BE CHECKED & CONFIRMED ON SITE. ALL WORK TO BE CARRIED OUT & SUPERVISED BY COMPETENT OPERATIVES. CLIENT TO SERVE PARTY WALL ACT NOTICE BEFORE WORK COMMENCES. DUE TO SURVEY LIMITATIONS EXISTING JOIST SPANS ASSUMED UNTIL CONFIRMED ON SITE. ALL WALLS & PARTITIONS TO BE CONSIDERED LOAD BEARING UNTIL OTHERWISE CONFIRMED. ALL EXISTING DRAINS TO BE LEFT IN PLACE UNTIL OTHERWISE. MUST BE CONFIRMED BEFORE ANY WORK COMMENCES. IF STRUCTURAL ENGINEERS DESIGN RELATING TO STRUCTURAL ELEMENTS OVERLAYS THIS DRAWING, THE DRAWING IS TO BE OVERLAIN ON THE ORIGINAL DRAWINGS. THIS DRAWING IS FOR PLANNING & BUILDING REGULATION APPLICATION PURPOSES ONLY. BUILDER/CLIENT TO APPOINT CDM CONSULTANT TO ENSURE WORKS ARE CONDUCTED IN ACCORDANCE WITH CDM REGULATIONS. SINCE WE HAVE NO ACCESS TO THE DEEDS OF THE PROPERTY IT IS THE RESPONSIBILITY OF THE CLIENT TO ENSURE THAT THE WORKS DO NOT CONTRAVENE ANY RESTRICTIVE COVENANTS CONTAINED IN THE DEEDS.

10.00 METRES @ 1:100

5.00 METRES @ 1:50