


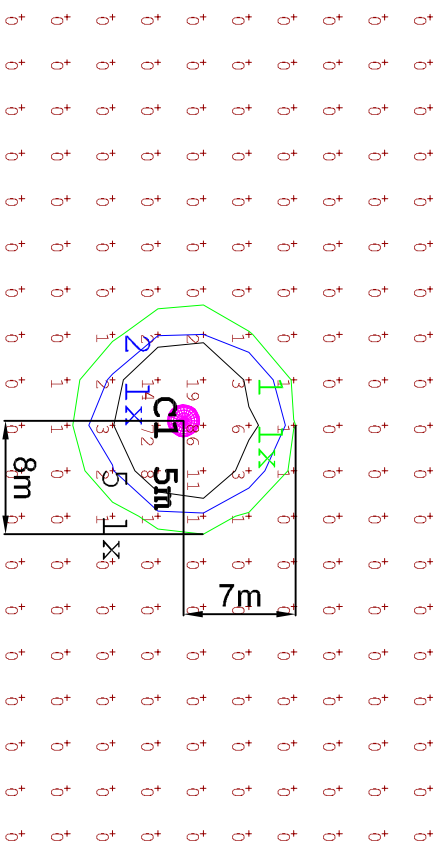

## LIGHTING EQUIPMENT

**1 x 1m Classique Bollard Luminaires:-**

..... 1 x AL1012 / 70W SON-E, lantern

Grid Intervals 5m

Grid Values in Lux

Contours Values 5, 2 & 1 Lux

Maintanace Factor: 0.85

Location: Medium Pollution

Cleaning Intervals: 12 Months

© Copyright  
Abacus Lighting  
All rights reserved

*This Lighting Design / Scheme and results given are based on the specific performance of Abacus Lighting products. This design and supporting documents are the sole property of Abacus Lighting Limited. This design and supporting documents must not be reproduced in any way without the written permission of Abacus Lighting. Any use of this design with non-Abacus luminaires after planning has been submitted may breach planning consent.*



## Lighting Project: Classique Bollard

Title: Isolux diagram

Design Ref:

N/A

Revision(s) From Previous Design:

Design By: Neil McClymont

Date: 20/09/2013

Scale: 1:500@A4

**ABACUS LIGHTING LTD.**  
Sutton-in-Ashfield, Nottinghamshire  
NG17 5FT England  
Tel: (+44) 01623 511111  
Fax: (+44) 01623 552133  
Email: [light@abacuslighting.com](mailto:light@abacuslighting.com)  
Home page: [www.abacuslighting.com](http://www.abacuslighting.com)

All Illuminance values are the result of computer calculations, based upon precisely positioned luminaires in a fixed relationship to each other and to the area under examination. In practice the values may vary due to tolerances on luminaires, luminaire positioning, reflection properties and electrical supply.