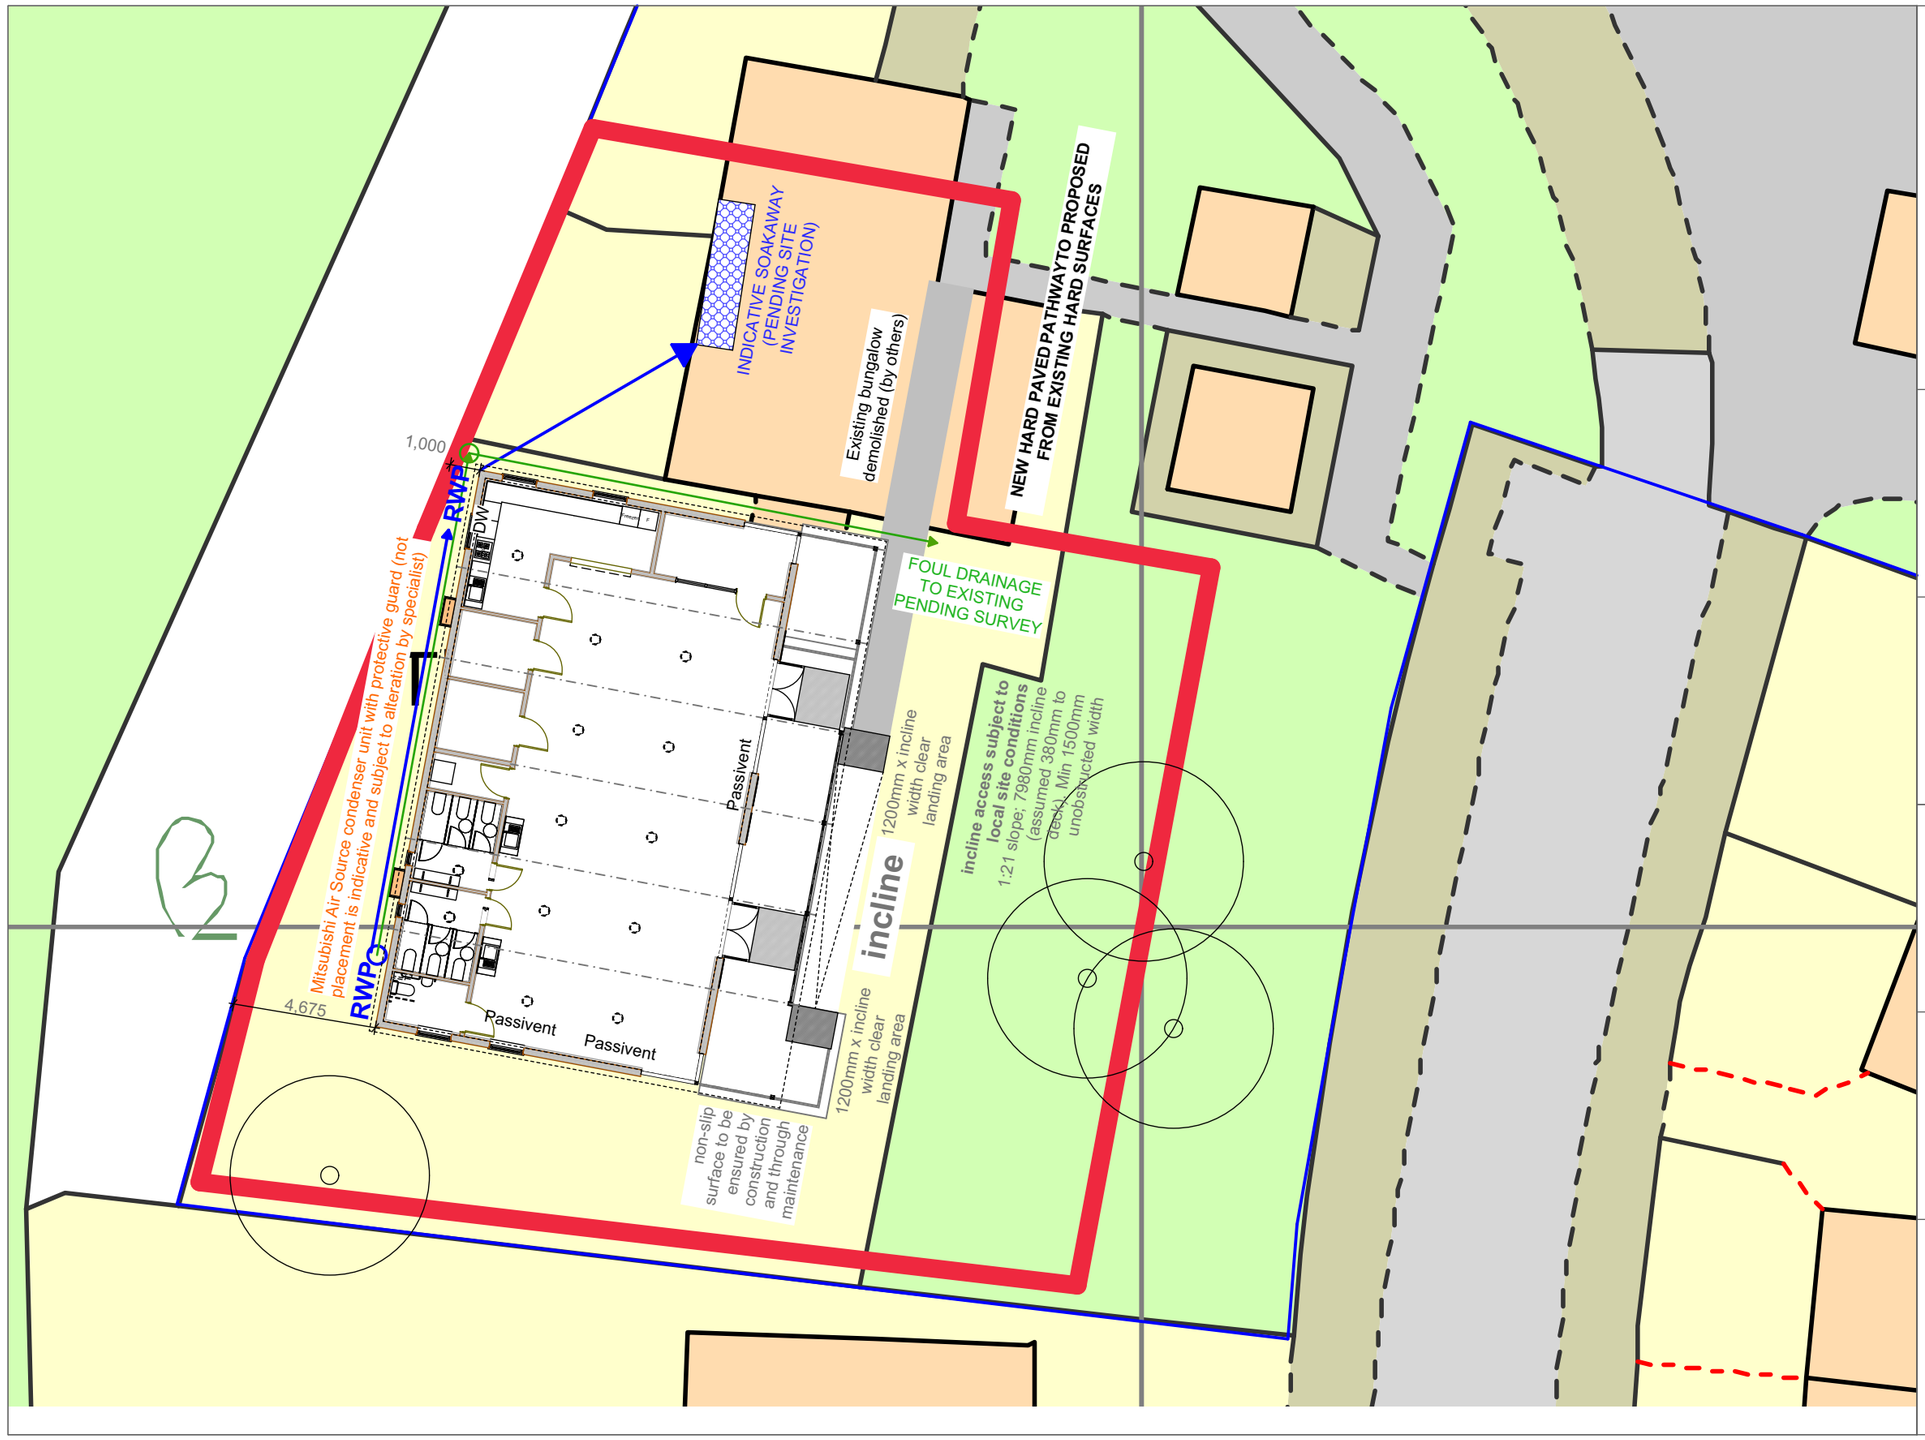

Drainage:

Foul Water discharged along min. 100mm internal diameter pipe at min. 1.80 falls into existing man hole via new 450mm inspection chamber. Exact location to be determined on site.

Storm water to discharge to new soakaway: minimum 5000mm from any building and/ or boundary and designed in accordance with BRE 365 OR ALTERNATIVELY to existing storm systems. Details confirmed onsite.

existing storm

existing foul

proposed storm

proposed foul

Trees and lanscaping:

Tree retained

Tree removed

N.B: Trees and spreads are shown indivatively for guidance and are not the result of a tree survey

Vehicle Parking:

NOT AFFECTED BY PROPOSED

Application site

land in same ownership as application site

0 20

N

Rev.A: HW: 24.06.19: Amendments to WC layouts.

© 2018 Metropolis Architecture Ltd.

Site Plan- 1:200 (at A3)

11A Planning : Rabbsfarm Primary School / July 2018