


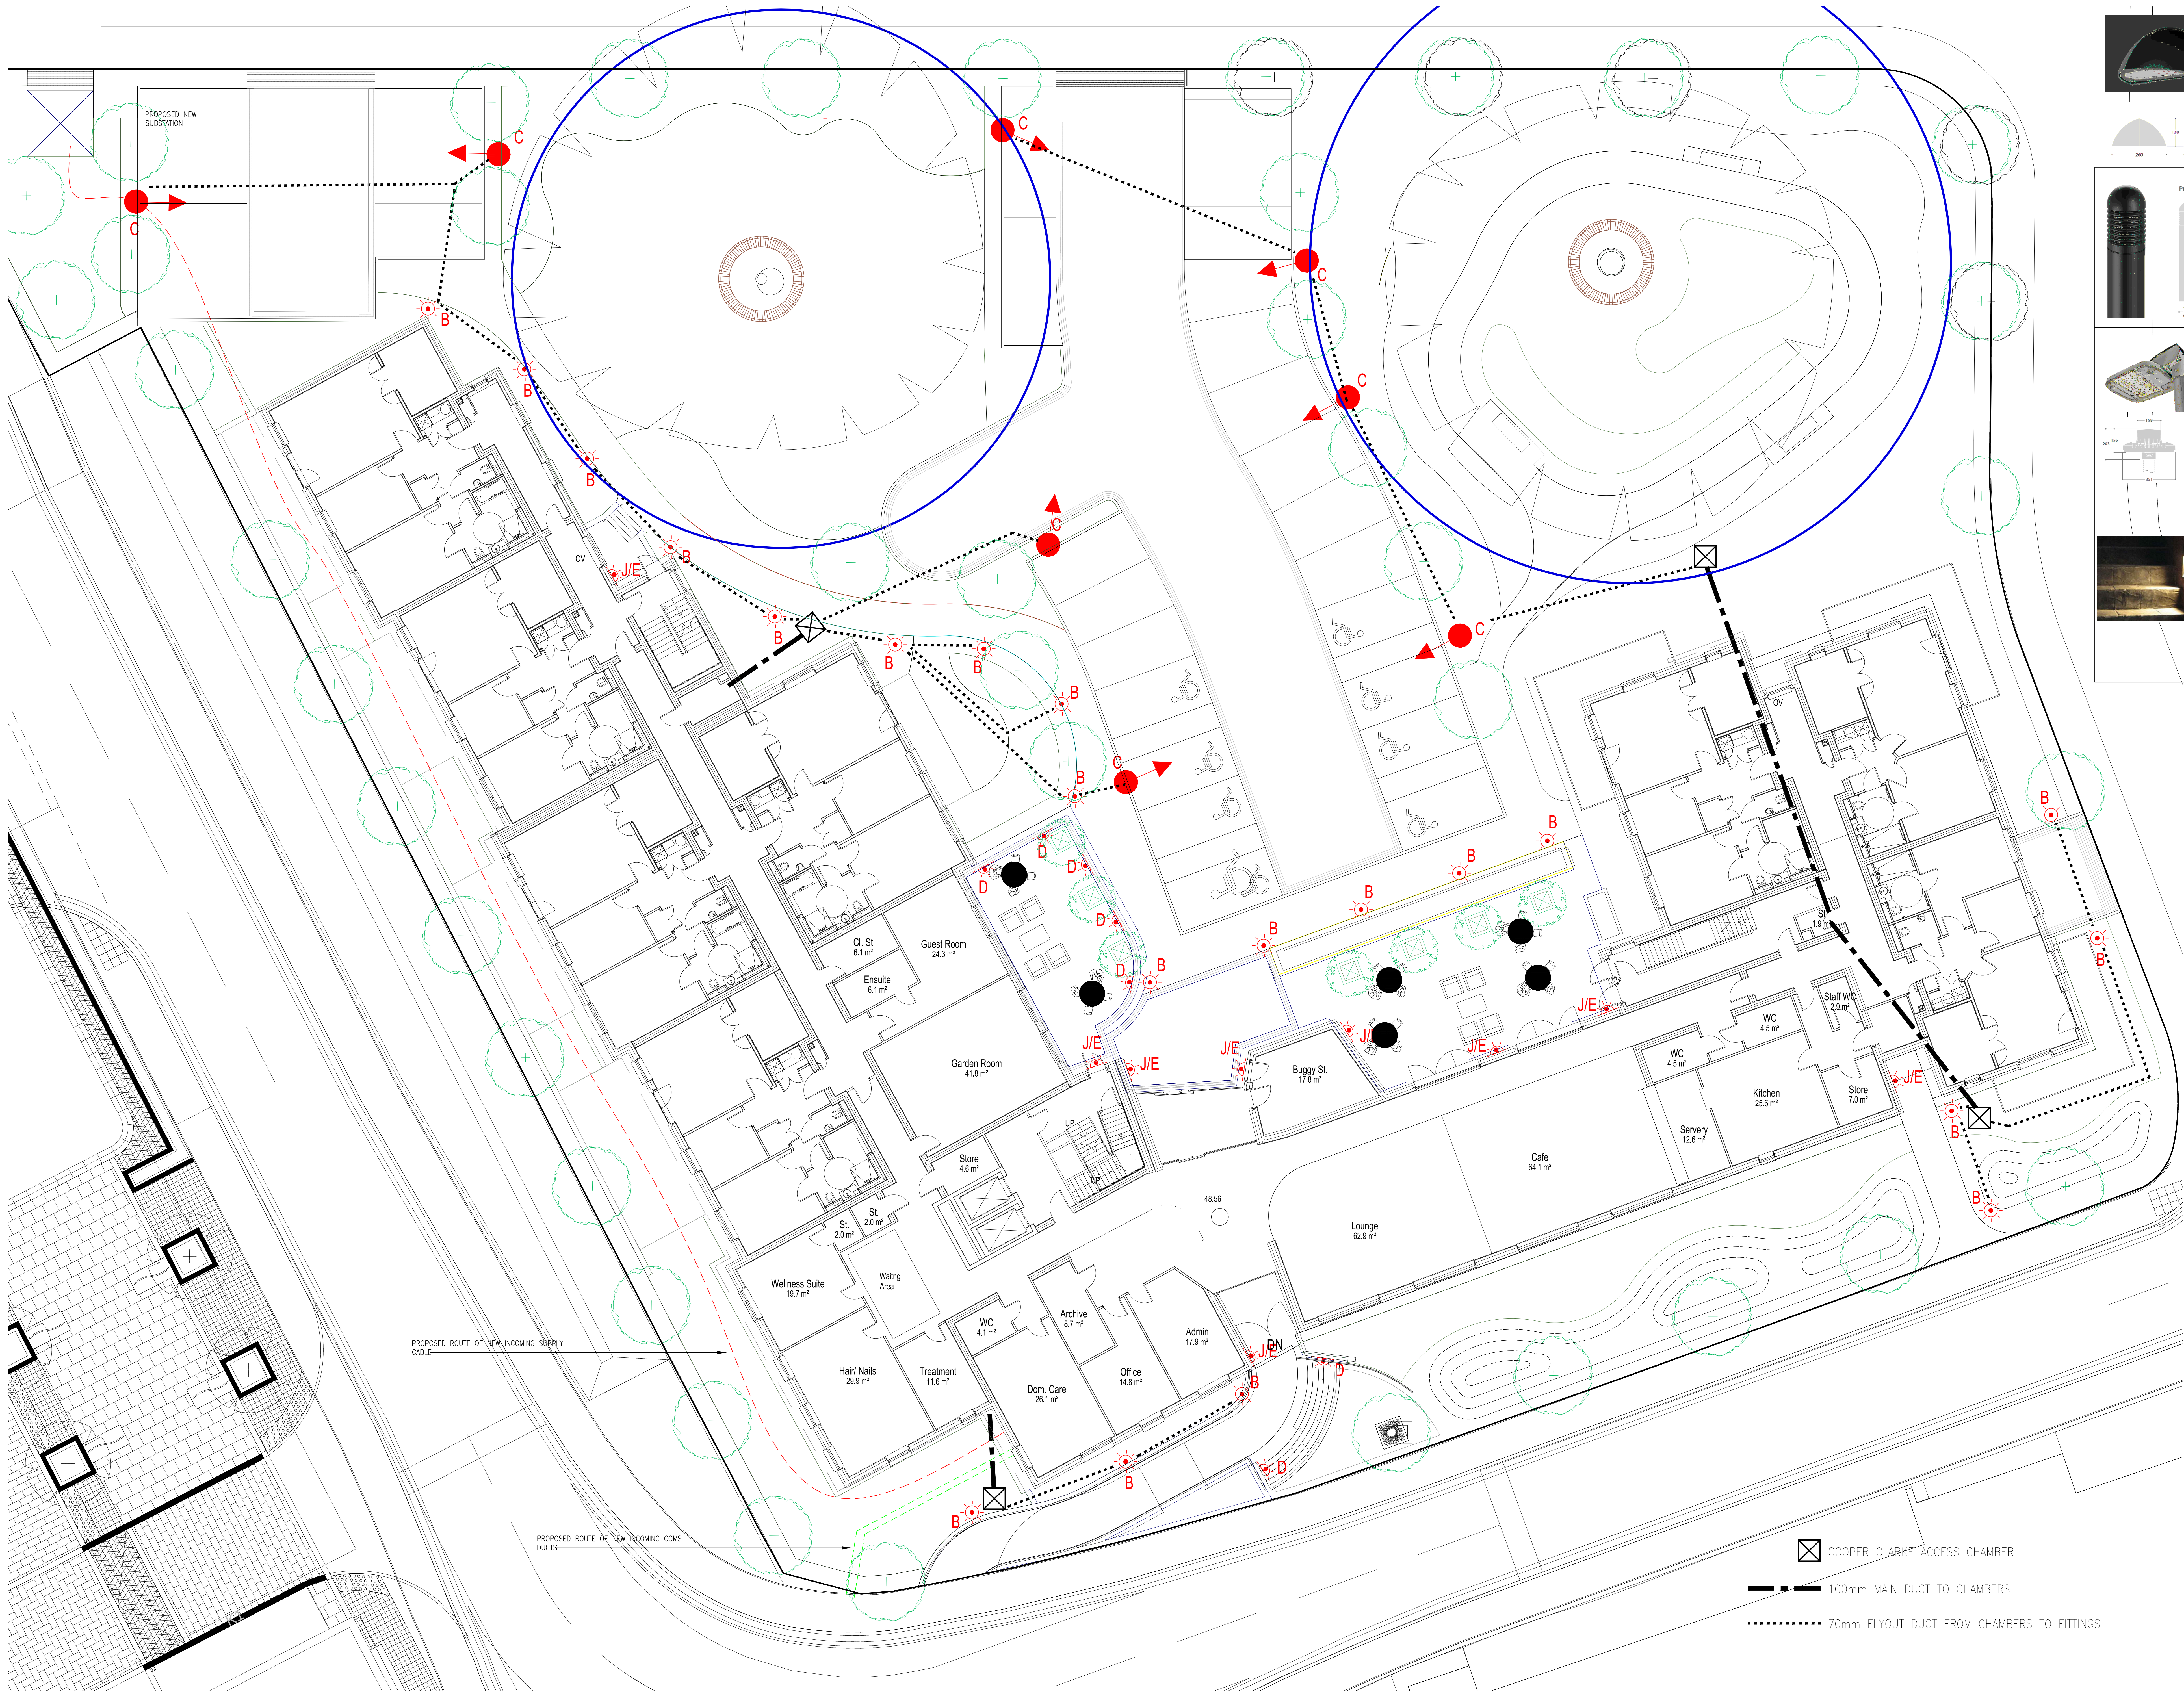

LIGHTING FITTING LEGEND

TYPE J & JE FITTING
WALL MOUNTED LIGHT FITTING AS PER THORLUX LIGHTING REALTA. COMPLETE WITH LED LAMP INSTALLED TO EXIT DOWNWAYS AS INDICATED. LIGHT FITTING ALSO PROVIDE INTEGRATED EMERGENCY LIGHTING UNIT TO PROVIDE ESCAPE LIGHTING. FITTING MOUNTED AT 2.4 MTRS AFFL.
HIGH QUALITY ALUMINIUM BODY FINISHED IN BLACK. COMPLETE WITH LOW GLARE DOWNWARD LIGHT OFFICER ZERO UPWARD LIGHT AND MINIMAL SPILL LIGHT.

TYPE B FITTING
GROUND MOUNTED ROLLAND LIGHT FITTING AS PER THORLUX LIGHTING PROBE. COMPLETE WITH 2MM LED LAMP INSTALLED TO PERIMETER PATHWAYS AS INDICATED. HIGH QUALITY ALUMINIUM BODY FINISHED IN BLACK. COMPLETE WITH LOW GLARE DOWNWARD LIGHT OFFICER ZERO UPWARD LIGHT.

TYPE C FITTING
COLUMN MOUNTED LIGHT FITTING AS PER THORLUX STARBREAM FITTING WITH ROW LED LAMP MOUNTED AT 5 MTRS TO DOWNWELL STEEL LIGHTING COLUMN IN SELF COLOUR OR TO RECEIVE PAINT FINISH THIC.

TYPE D FITTING
LOW LEVEL RECESSED GROUND MOUNTED LED LUMINAIRE TO LIGHT PATH EDGE WAYS AND PRODUCE LOW LEVEL FEATURE LIGHTING TO WALKWAYS IN GARDEN AREAS.
HIGH QUALITY DIE-CAST ALUMINIUM BODY FINISHED IN GRAPHITE STEEL. LIGHTING QUADRAT MCH LED 9w

Drn: D.I.A	Date: Jan 19	Scale:
Chkd: R.B	Date: Jan 19	1:200@A0
Project Title: ANCHOR HOUSING PROPOSED DEVELOPMENT UXBIDGE		
Drawing Title: PROPOSED EXTERNAL ELECTRICAL INSTALLATIONS		
 JRB ENVIRONMENTAL DESIGN LTD M&E BUILDING SERVICES CONSULTING ENGINEERS Morris Office Park, 10 Eaton Avenue, Burslem, Stoke-on-Trent, ST4 7NA Tel: 01752 331700 Fax: 01752 458466 email: m&e@jrb.co.uk		
Org. No:	019.020.E306	Rev: T3
Status:	TENDER	