



BEAMS TO BE LACED AND PLAN
BRACED VIA LOAD BEARING
COUPLERS AT ALL TIMES.

ALL BEAMS TO BE CONNECTED
TO UPRIGHTS WITH CHECK
LEDGERS AT ALL TIMES

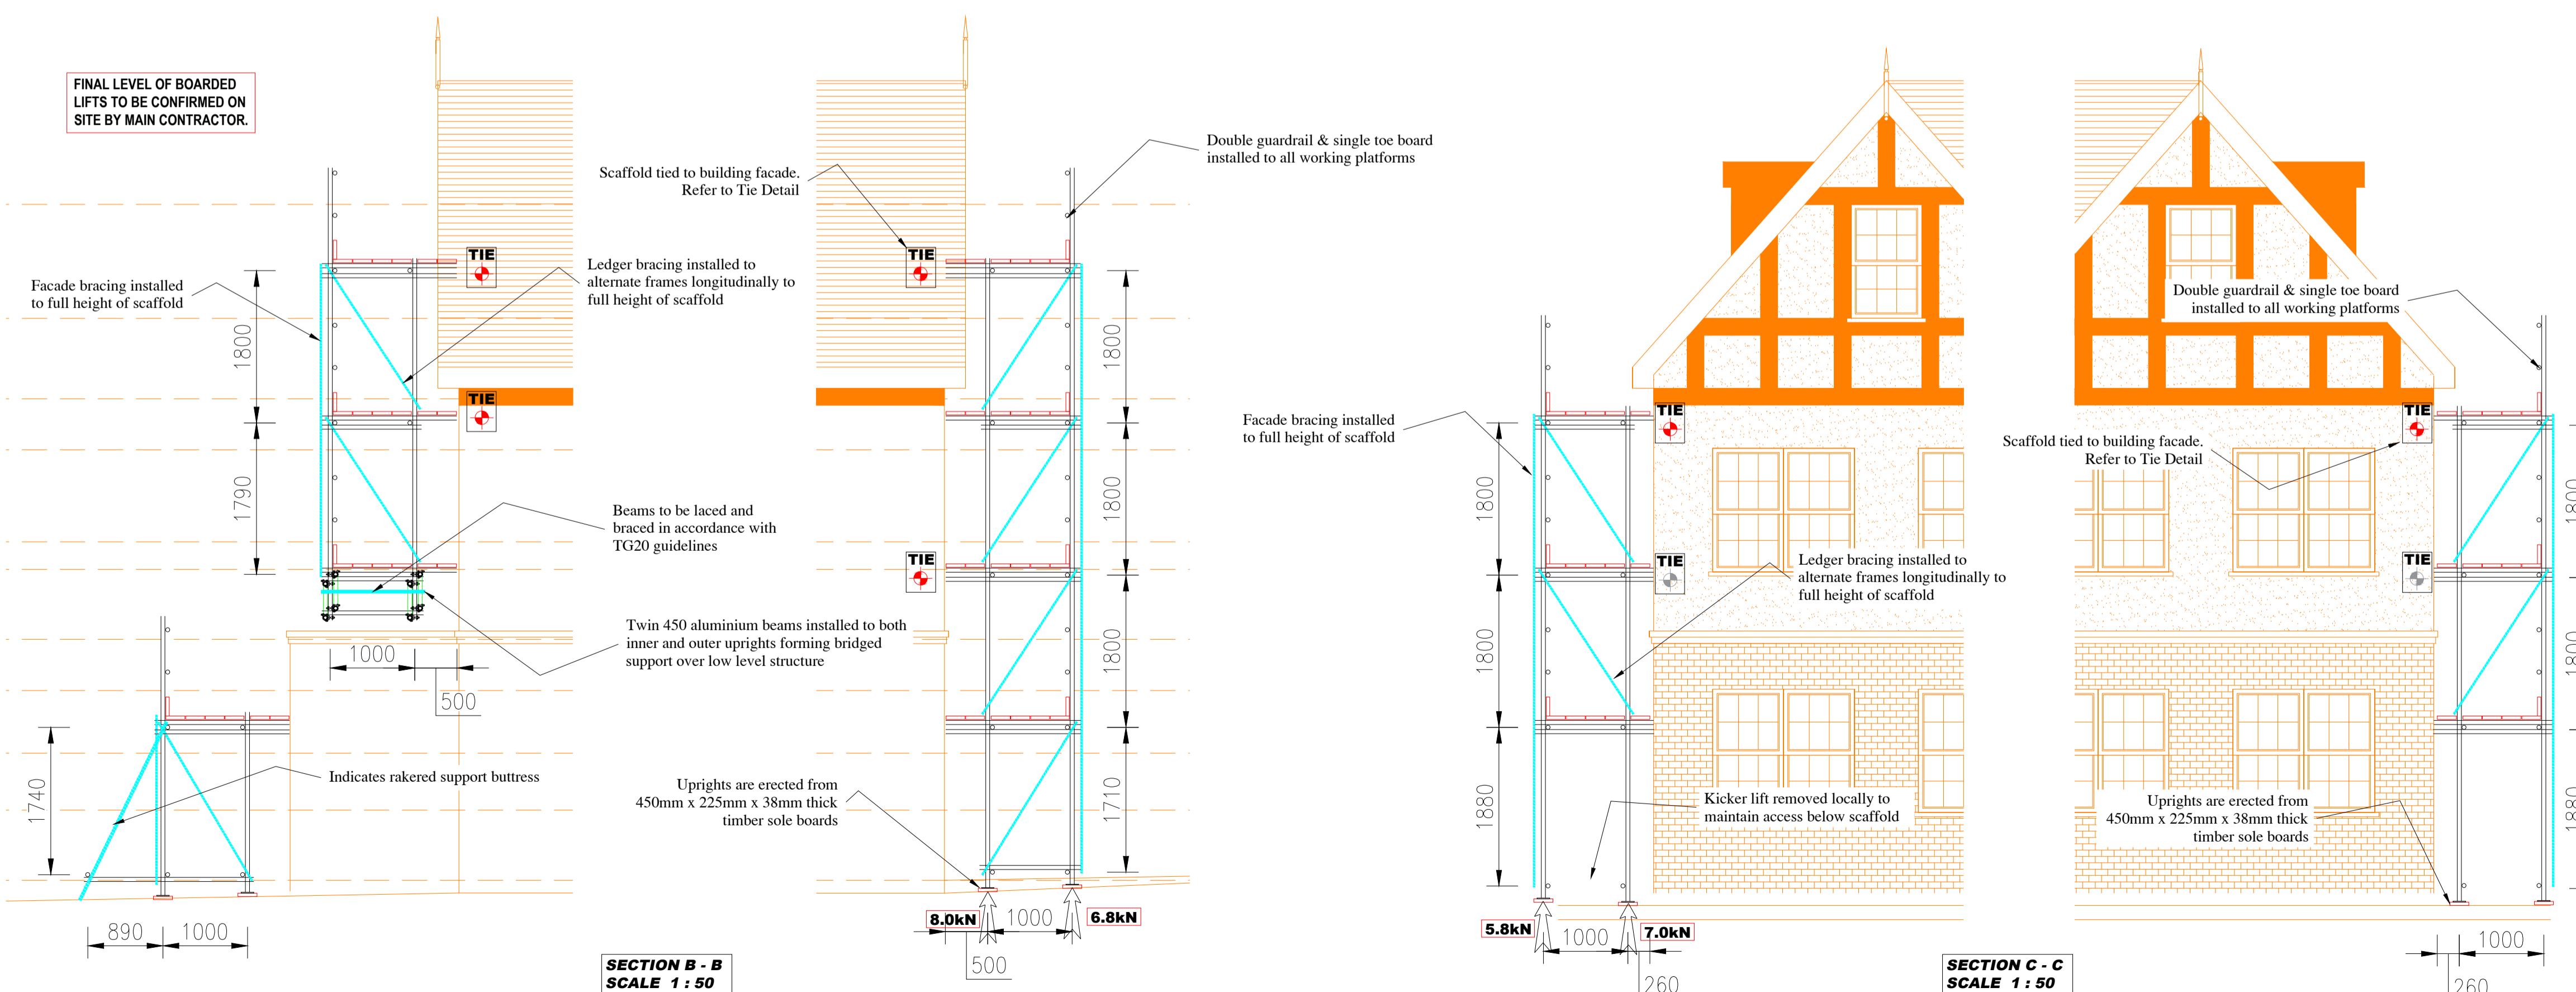

SECTION B-B
SCALE 1:50

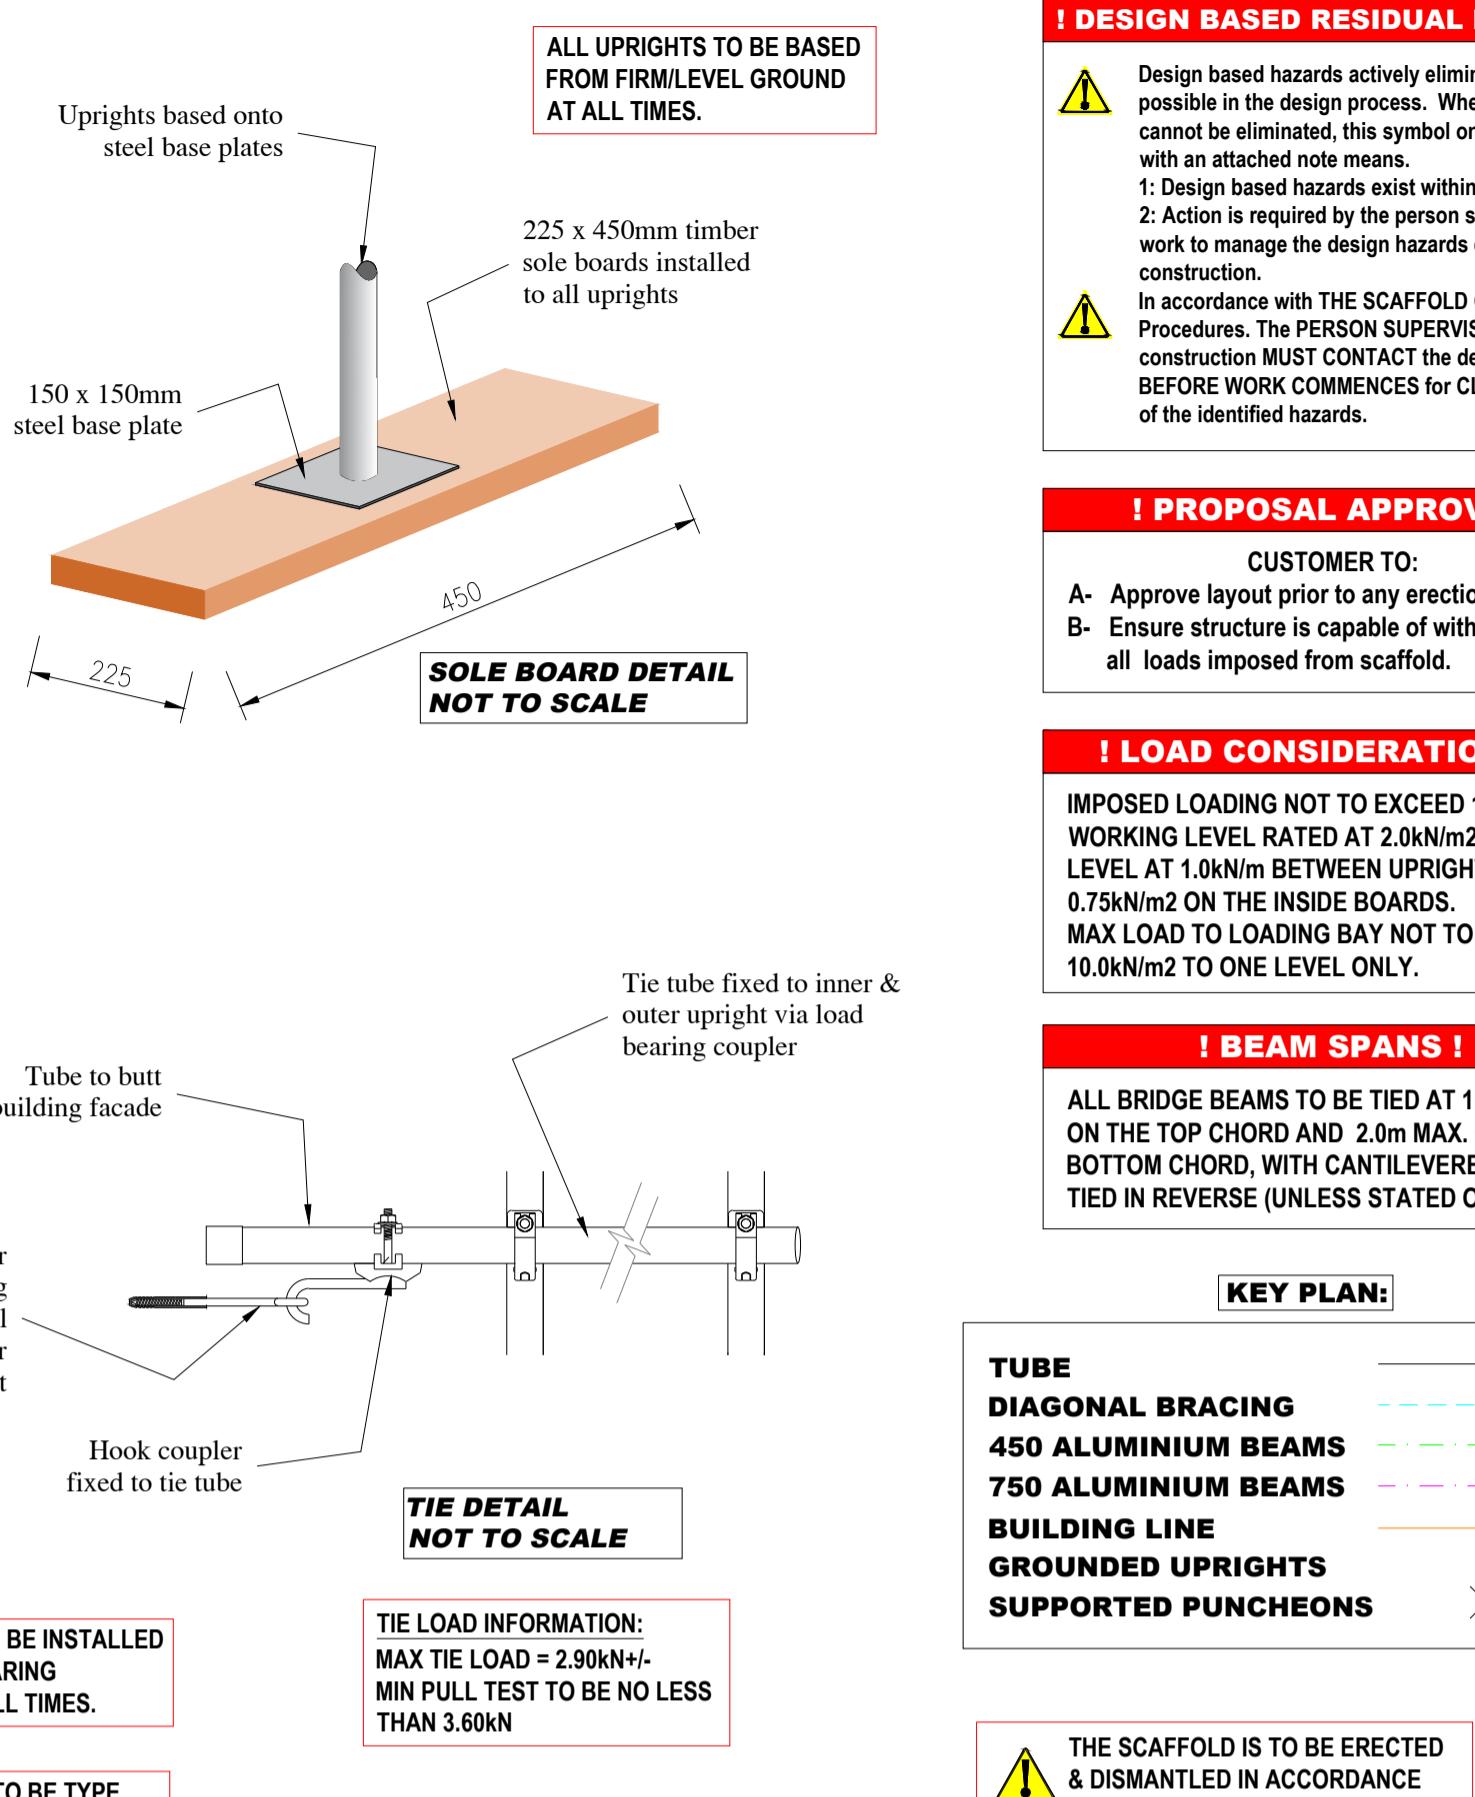

ALL UPRIGHTS TO BE BASED
FROM FIRM/LEVEL GROUND
AT ALL TIMES.

! DESIGN BASED RESIDUAL HAZARD !
Design based hazards actively eliminated where possible in the design process. Where hazards cannot be eliminated, this symbol on the drawing with an attached note means:
1: Design based hazards exist within this proposal.
2: Action is required by the person supervising the work to mitigate the design hazards during construction.
In accordance with THE SCAFFOLD CONTRACTORS Procedures, the PERSON SUPERVISING the construction MUST CONTACT the design office BEFORE WORK COMMENCES for CLARIFICATION of the identified hazards.

! PROPOSAL APPROVAL !
CUSTOMER TO:
A- Approve layout prior to any erection.
B- Ensure structure is capable of withstanding all loads imposed from scaffold.

! LOAD CONSIDERATIONS !
IMPOSED LOAD NOT TO EXCEED 1 NO.
WORKING LEVEL RATED AT 2.0kN/m² AND 1 NO.
LEVEL AT 1.0kN/m BETWEEN UPRIGHTS WITH
0.75kN/m² ON THE INSIDE BOARDS.
MAX LOAD TO LOADING BAY NOT TO EXCEED
10.0kN/m² TO ONE LEVEL ONLY.

! BEAM SPANS !
ALL BRIDGE BEAMS TO BE TIED AT 1.0m MAX.
ON THE TOP CHORD AND 2.0m MAX. ON THE
BOTTOM CHORD, WITH CANTILEVERED BEAMS
TIED IN REVERSE (UNLESS STATED OTHERWISE)

KEY PLAN:
TUBE
DIAGONAL BRACING
450 ALUMINIUM BEAMS
750 ALUMINIUM BEAMS
BUILDING LINE
GROUNDED UPRIGHTS
SUPPORTED PUNCHEONS

! TIE LOAD INFORMATION:
MAX TIE LOAD = 2.9kN/m²
MIN PULL TEST TO BE NO LESS
THAN 3.60kN

THE SCAFFOLD IS TO BE ERECTED & DISMANTLED IN ACCORDANCE WITH NASC DOCUMENT SG4:15

ANCHORS TO BE TESTED IN ACCORDANCE WITH N.A.S.C DOCUMENT TG4

GENERAL NOTES

BASIS OF DESIGN
This drawing has been prepared from information supplied to us by, or on behalf of the contractor, who should check that his requirements have been correctly interpreted and that all loadings, dimensions, lift heights, bay sizes, erection/striking sequences etc. are as required and practicable.

IMPOSED LOADS
The contractor is to ensure that the existing structure, its fabric and/or the ground will safely support the extra imposed loads, or supply new.
Maximum calculated tie load: See notes
Maximum calculated leg load: See notes

LOADINGS ALLOWED
The contractor must ensure that all loading(s) allowed for is sufficient.
Live loads: See notes
See notes
Windloading: As BSEN1991-1-4
Maximum number of boarded levels: See notes

SHORING WORK
We can not and will not pass comment on the structure being shored, as this involves matters beyond our control and knowledge. It is the contractors responsibility to ensure that the existing structure will safely span between our supports, and can be safely shored in the way indicated.

FOUNDATIONS

The contractor must prepare all foundations prior to erection.

TEMPORARY ROOFS

No temporary roof can be made watertight.
Loading: Snow loading assessed using BSEN1991-1-3 (current edition), unless the contractor adopts a snow management system.

MATERIALS
All scaffolding materials forming this structure are to comply, and be constructed in accordance with BS1139, BSEN12811 and TG20 (current edition).

MODIFICATION
No alteration is to be made to the structure detailed on this drawing without prior written permission from Prime Scaffold and Structural Designs Ltd.

PROPERTY
This drawing is confidential and the exclusive property of THE SCAFFOLD CONTRACTOR.
No unauthorised use, copy or disclosure is to be made, and is to be returned on request.

DIMENSIONS
Written dimensions shall take precedence over scaled dimensions. The contractor must verify all site dimensions and notify of any discrepancies prior to erection.

PERMITS AND PERMISSIONS
The contractor must obtain all permits and permissions prior to erection.


CONSTRUCTION NOTES
1) All ladder beams and/or unit beams are to be tied together at 1200 centres on top chord and 2400 centres on bottom chord, with the top chord plan braced, unless stated otherwise.
2) Unless otherwise noted all lifts other than boarded platform levels are to be constructed using load bearing couplers.
3) All general construction is to be in accordance with TG20 (current edition) unless noted otherwise.
4) Main contractor to undertake all making good where necessary.
5) Main contractors to provide and maintain adequate tie positions.
6) No additional sheeting, wind protection or fans to be added to this structure without prior written permission from Prime Scaffold and Structural Designs Ltd.

**ISSUED AS WORKING DRAWING
[APPROVED FOR CONSTRUCTION]**

Revisions:

	DATE	REVISION DETAILS	INITIAL
A	11/08/2022	Issued for construction	D.R
B			
C			
D			
E			
F			
G			

Client:



Silver Circle Property



Prime Scaffold and
Structural Designs Limited
Tel: 0207 403 2994
Web: www.psd.uk.com

TITLE:
**Proposed Scaffold Layout
Section & Elevation Details
59 Elm Ave. Ruslip**

DRAWN: D. Rogerson	CHECKED BY: A. Robertson
CLIENT: S C Property Ltd	DATE: 09/08/2022
SCALE: As Drg @ A1	DRG No: A/10553-2A