


Provide high level ventilation via ridge tiles or proprietary ventilation tiles installed in accordance with manufacturer's fitting instructions to provide ventilation equiv to 5mm continuously.
Maintain 50mm air gap above ridge beam.



PROPOSED SECTION

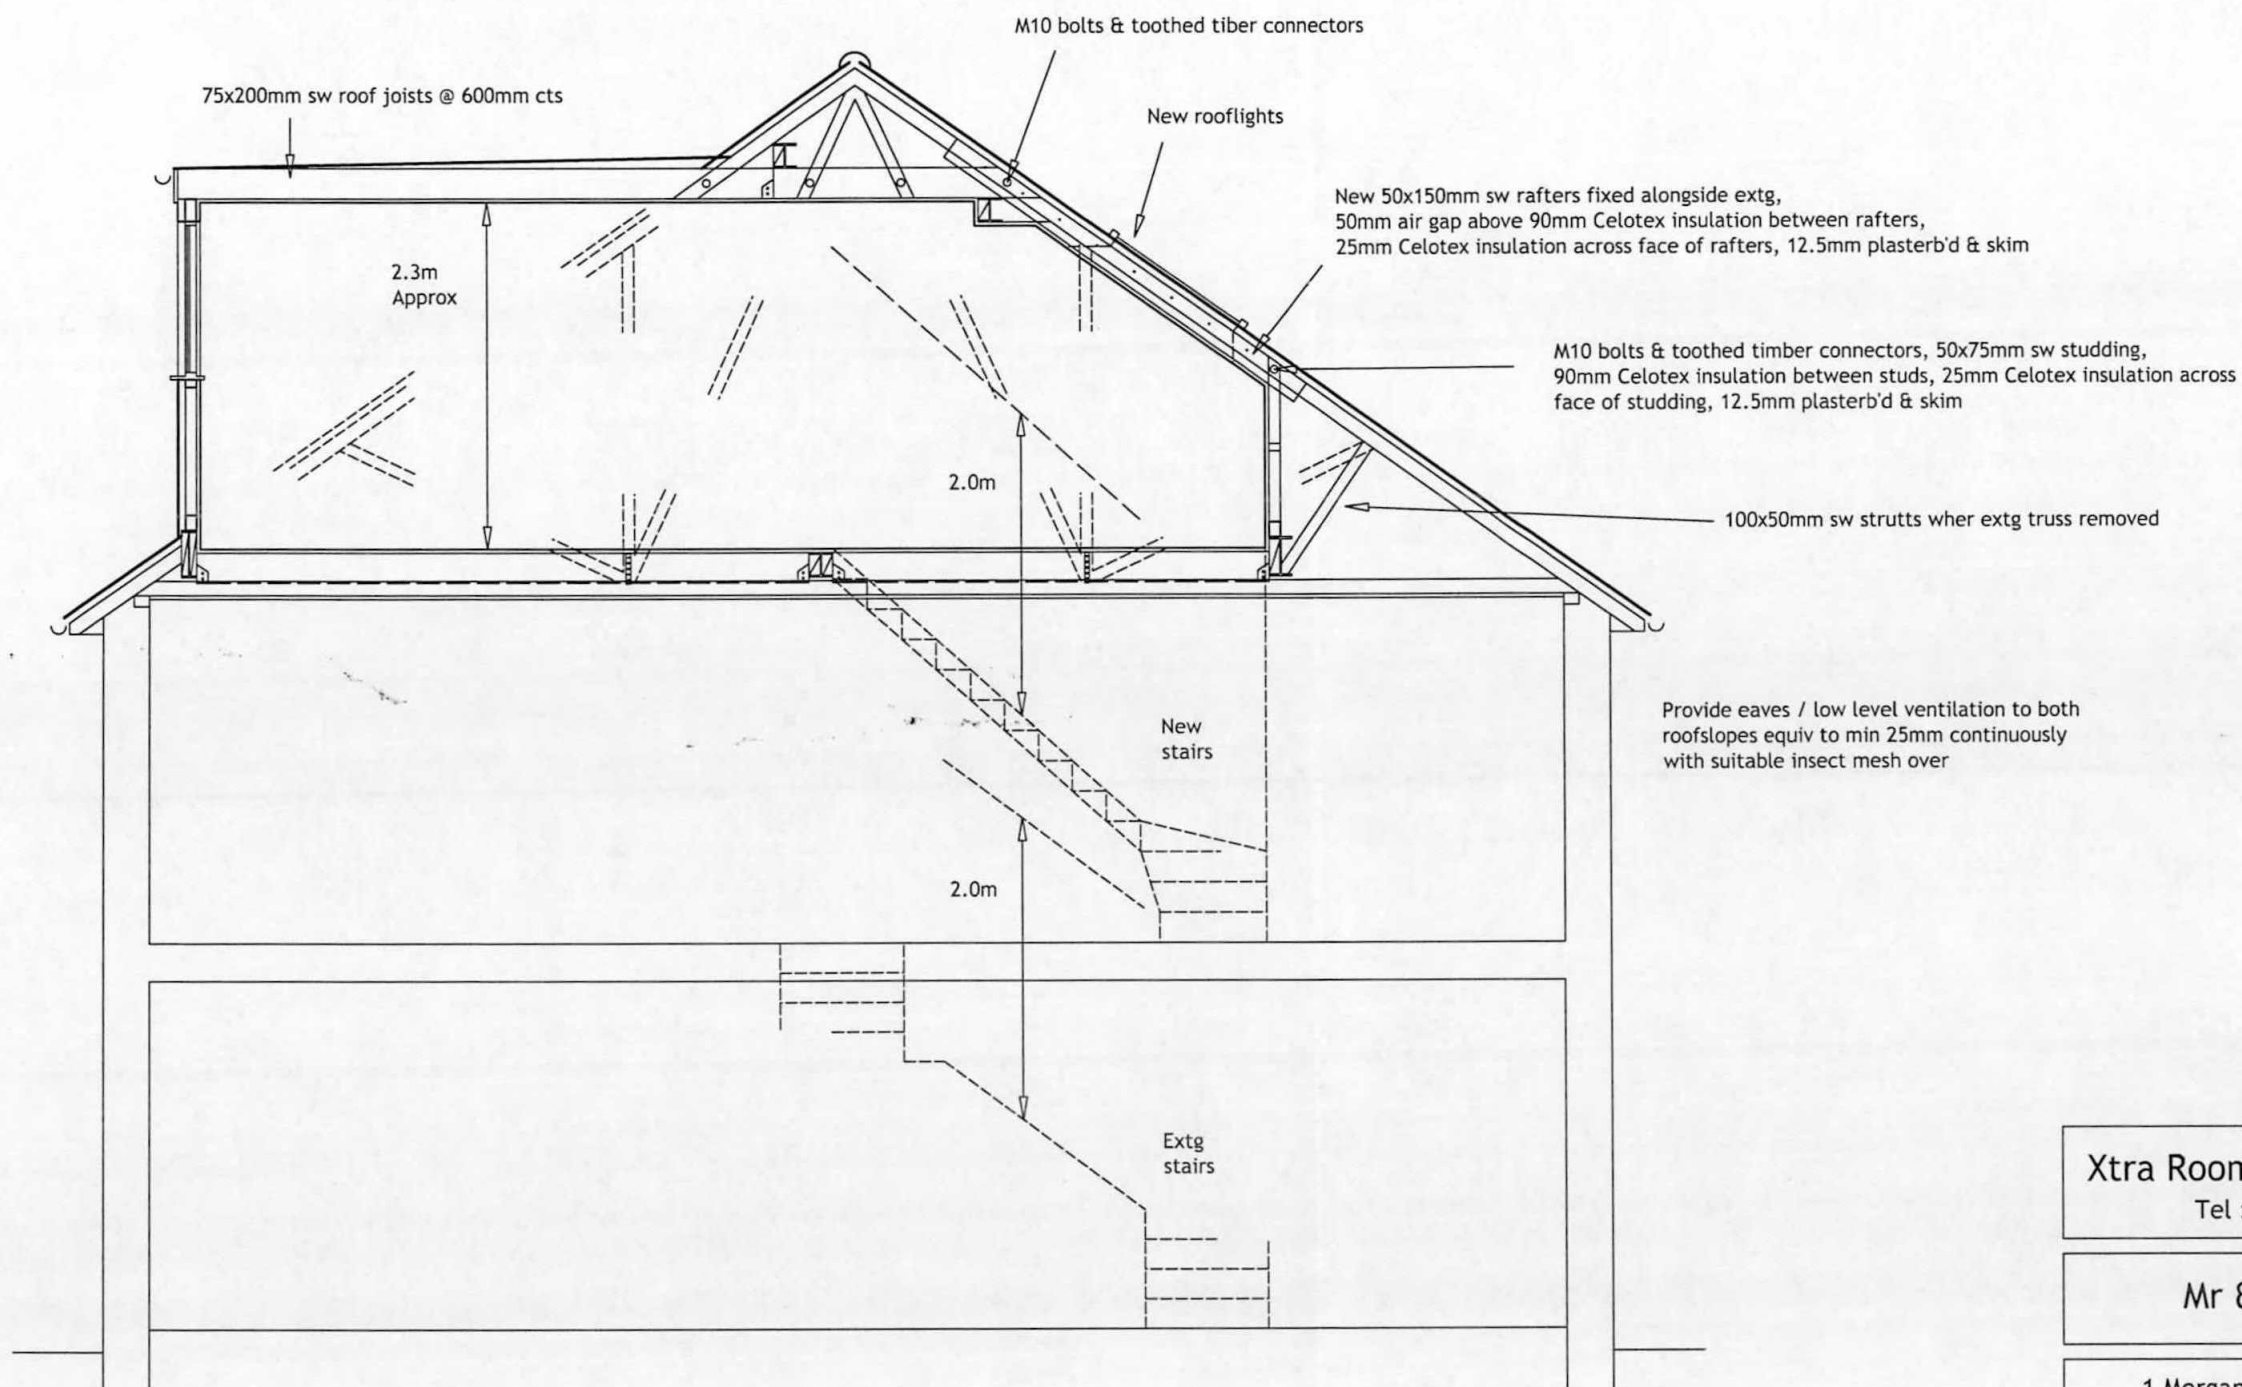

Xtra Room Conversions Ltd
Tel : 01283 567804

Mr & Mrs VINES

1 Morgan Close, Northwood,
Middlesex. HA6 3NE

PROPOSED LOFT CONVERSION

SCALE : 1:50 on A3
DATE : March 2016
DRAWN : A. Lloyd
SHEET : 3 of 5

Drawing number :
2330 /3645