



EXTERNAL WALL:


Element	U-value (W/m ² K)	Thermal Transmittance (W/m ² K)	Thermal Resistance (m ² K/W)	U-value (W/m ² K)	Thermal Transmittance (W/m ² K)	Thermal Resistance (m ² K/W)
External wall	0.18	0.000	5.556	0.18	0.000	5.556
Roof	0.18	0.000	5.556	0.18	0.000	5.556
Floor	0.18	0.000	5.556	0.18	0.000	5.556
Window	1.10	0.000	0.909	1.10	0.000	0.909
Door	1.10	0.000	0.909	1.10	0.000	0.909
Other	1.10	0.000	0.909	1.10	0.000	0.909
Overall U-value	0.18	0.000	5.556	0.18	0.000	5.556
Overall Thermal Transmittance	0.18	0.000	5.556	0.18	0.000	5.556
Overall Thermal Resistance	0.18	0.000	5.556	0.18	0.000	5.556

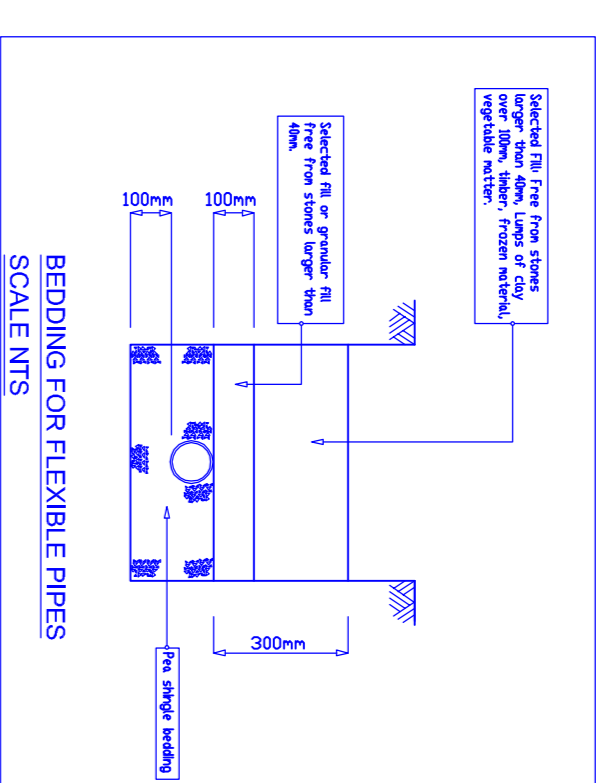

Pipe will be encased in 150mm of compressible material such as pea shingles.

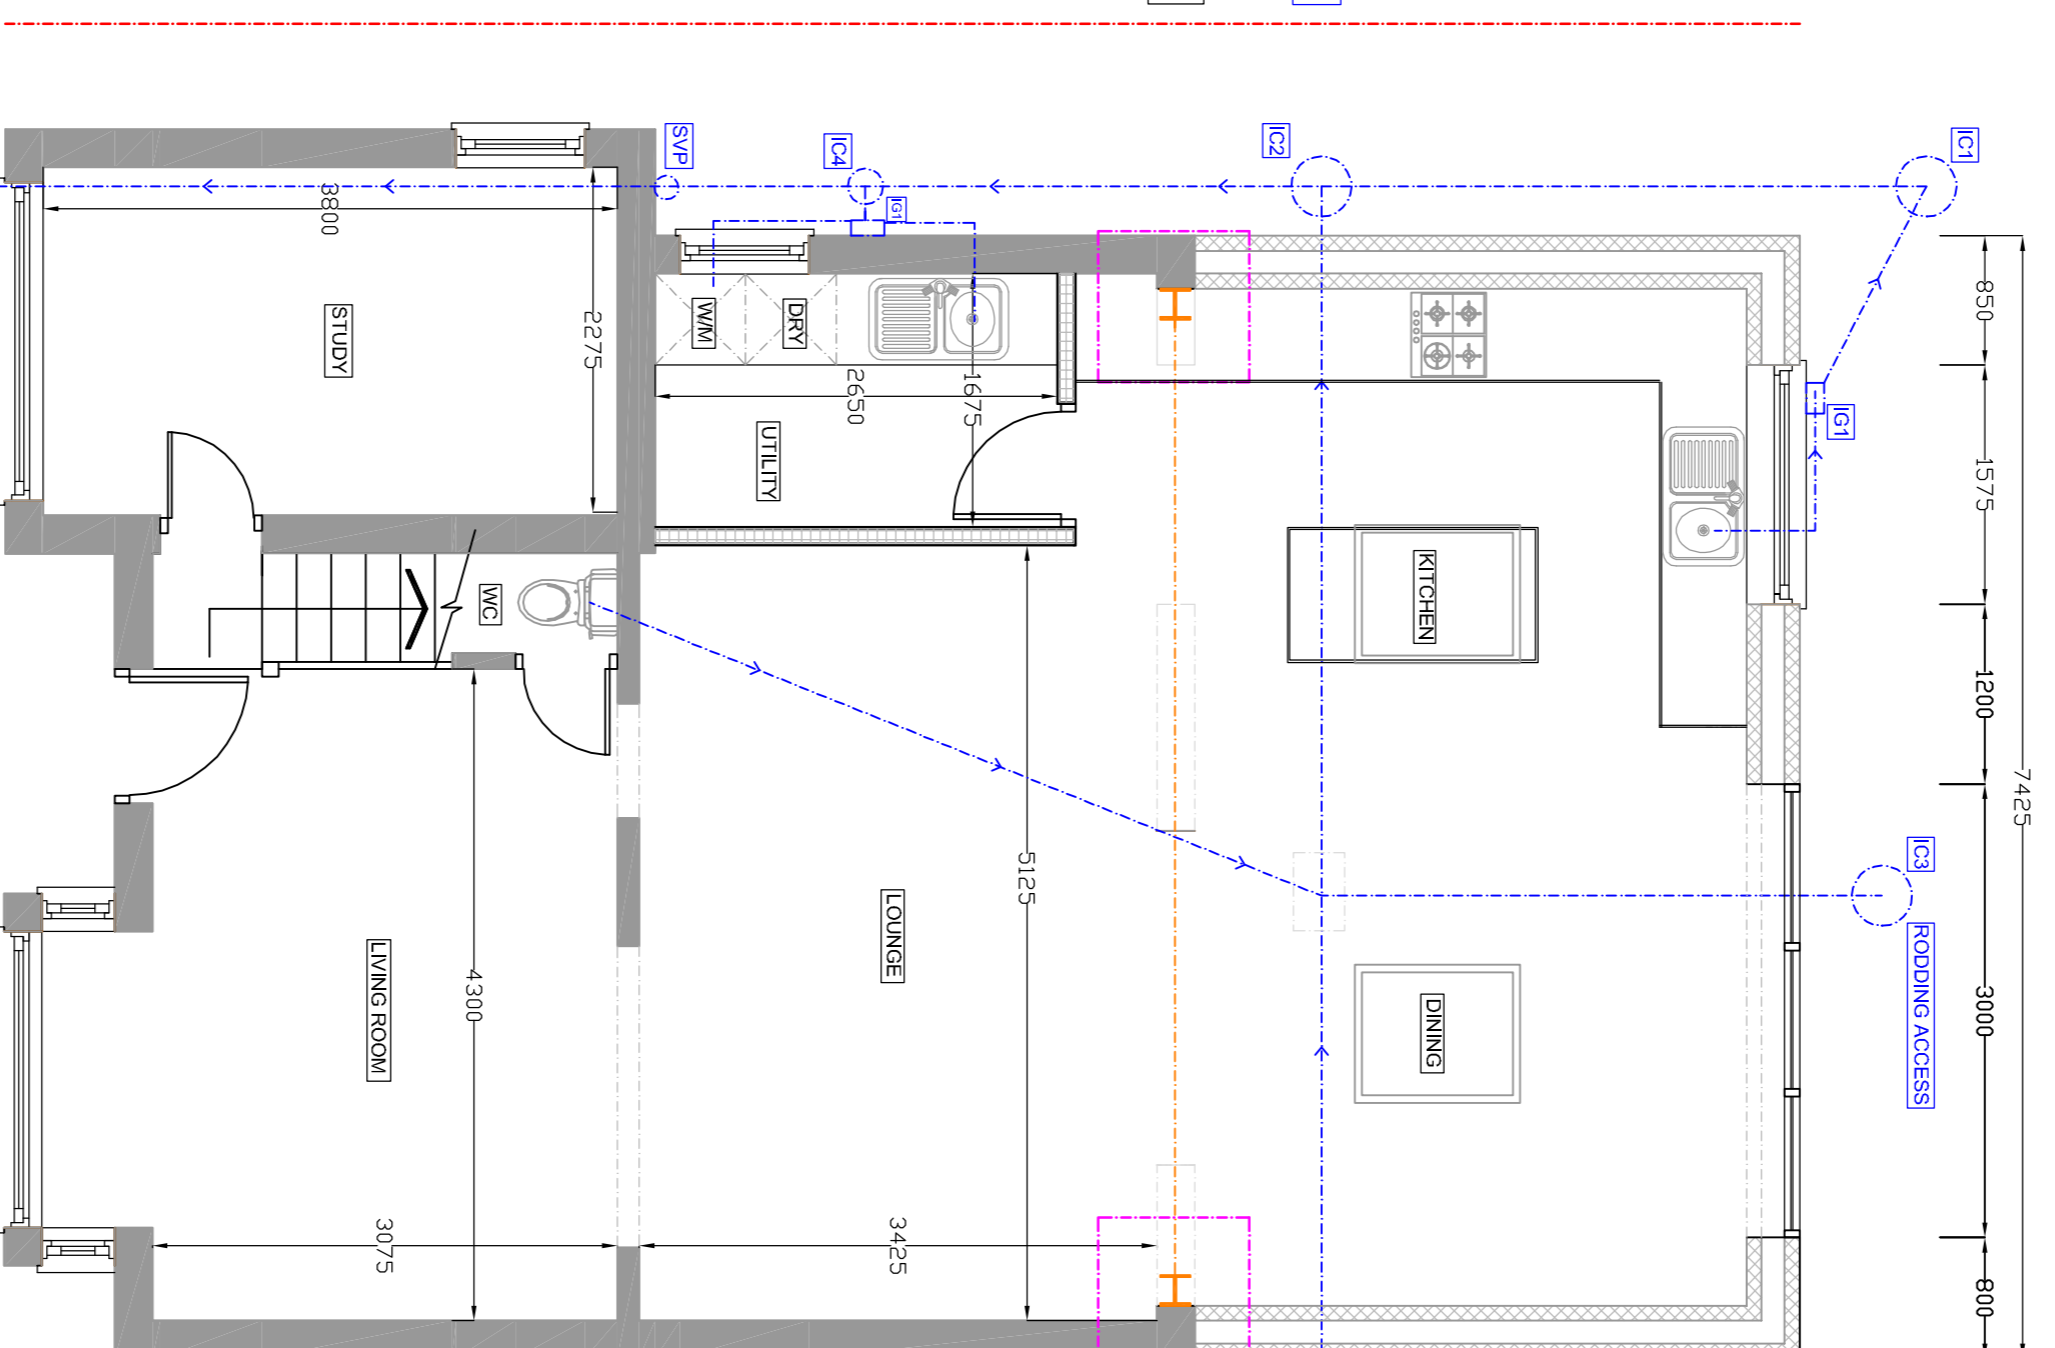

PROPOSED GROUND FLOOR PLAN
SCALE BAR 1:50 @ A1

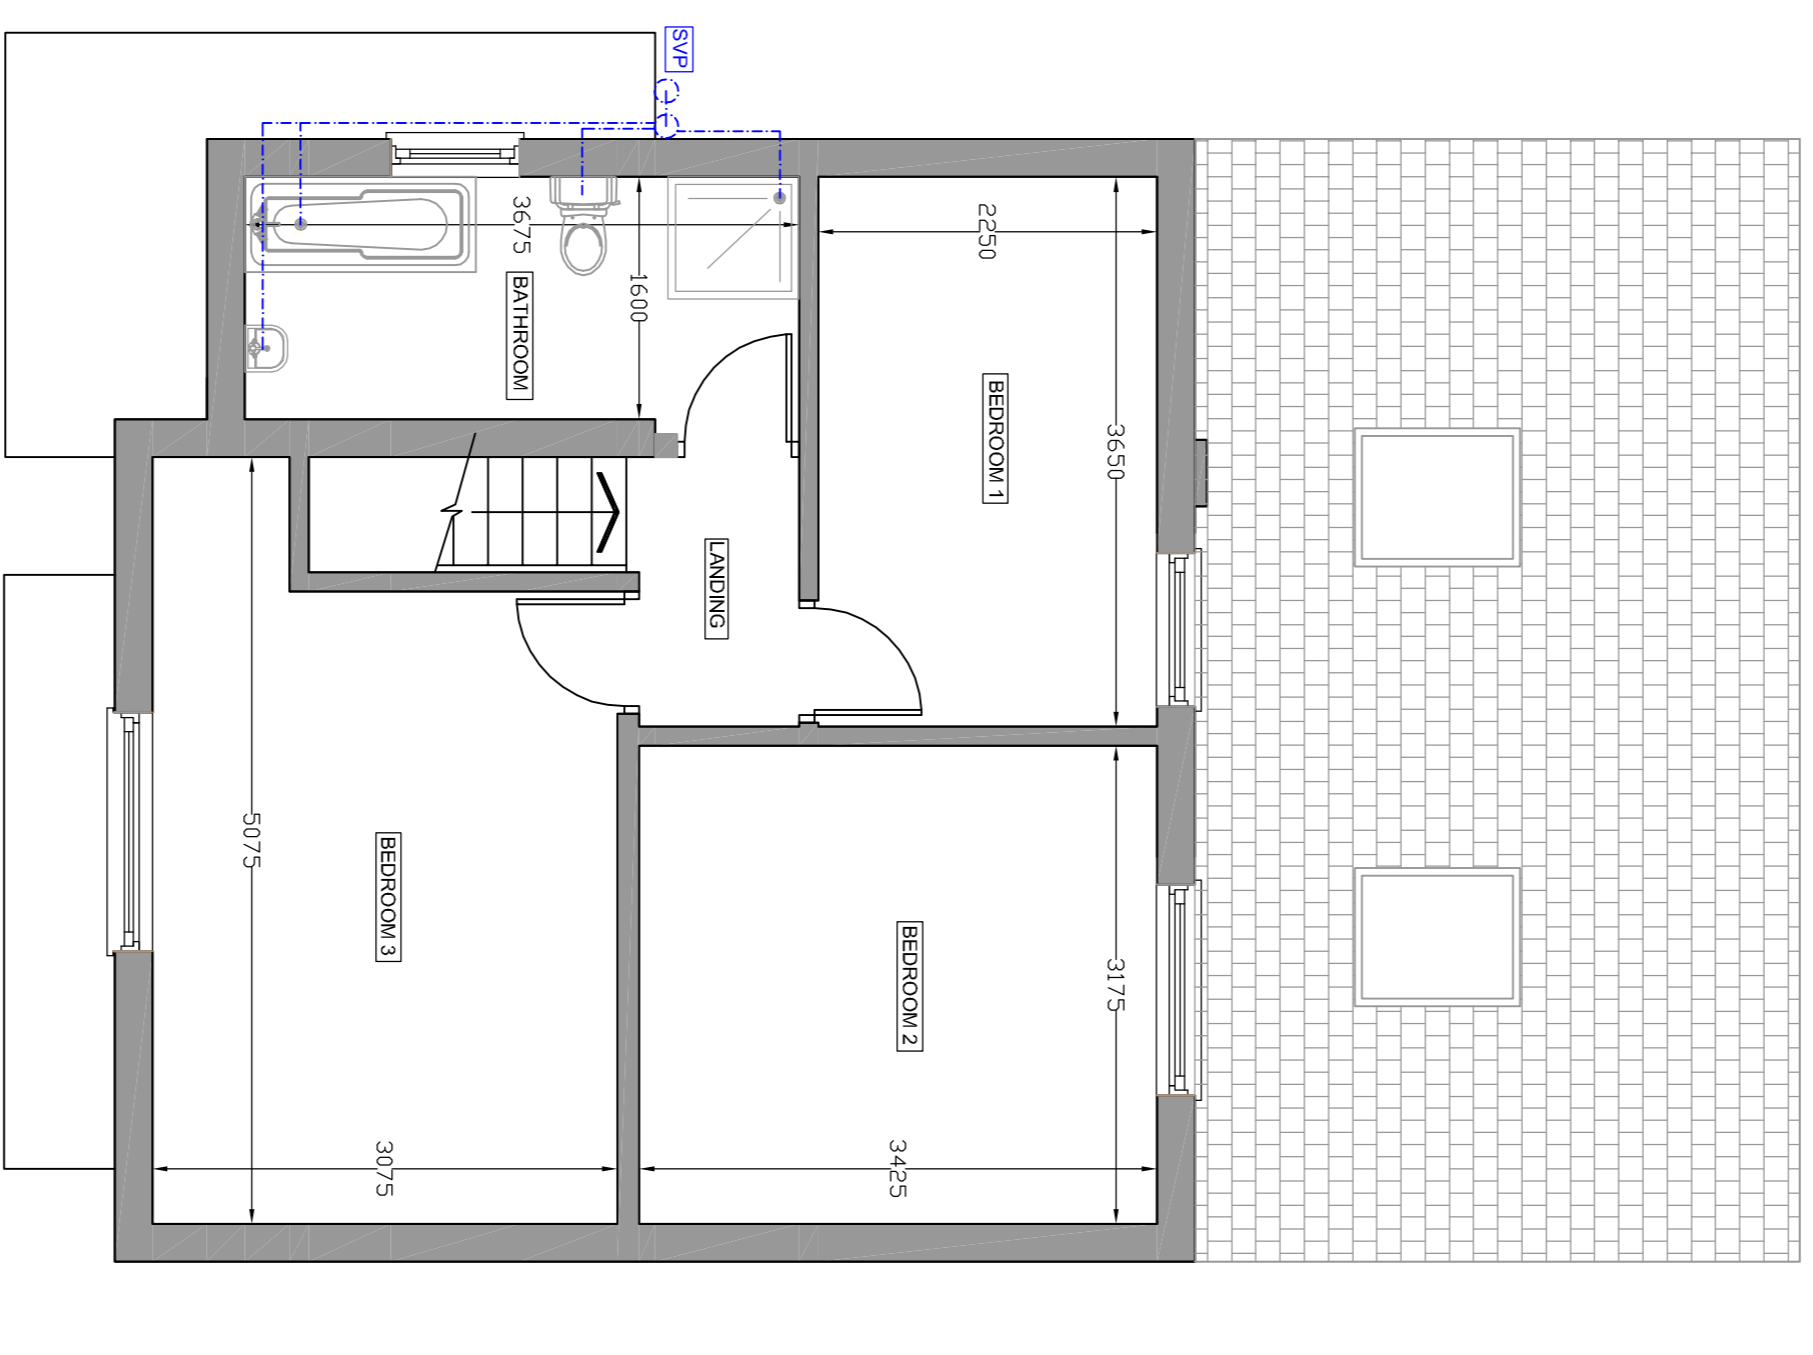

PROPOSED FIRST FLOOR PLAN
SCALE BAR 1:50 @ A1

REVISION	DESCRIPTION	DATE	BY
1	Issue for Bidding Following Client's Comments	09/07/24	BU

Coltswood Residential Design Ltd


Order Office: 118 Carrington Middle Home Park,
Missake Road
Oxshott
Ox18 3FW
Tel: 01845 811111
Email: info@coltswoodresidential.co.uk

DRAWING TITLE: PROPOSED FLOOR PLANS

SITE ADDRESS: 7 BREAKSPEAR ROAD, RUIBURN, HA4 7QB

SCALE: 1:50 @ A1
DATE: 06/07/24
DRAWN BY: BU

DRAWING NO: BREAKSPEAR03 REVISION A



SCALE BAR 1:50 @ A1

Element Type	Maximum U-value W/m ² K
Roof	0.18
Wall	0.18
Floor	0.18
Window	1.4 or Window Energy Rating Band B minimum
Door	1.4 or Doorset Energy Rating Band C minimum
Other doors	1.4 or Doorset Energy Rating Band B minimum

Steelwork
New structural steel beams to be painted in Intumescent paint to provide minimum one hour fire resistance.

Main Contractors Note:
Due to spans/weights of beams method statements & risk assessments are to be produced for safe delivery and safe installation prior to delivery and installation of steels on site.

Plumbing Installation

Complete installation to be subject to and capable of withstanding testing in accordance with BS 5572:1978. Above ground level foul drainage pipe work shall be PVC-U to BS 4514

Pipework must be designed in accordance with BS 5572 and installed to ensure that appliances drain efficiently without causing crossflow, backfall, leakage or blockage. No air from the drainage system shall be permitted to enter the building. Adequate support to lengths and at junctions - changes of direction to be provided. No branch connection to be within 450mm above foot of soil pipe. All PVC-U pipework to be installed to BS 4514.

Minimum pipe sizes for sanitary plumbing to be:

- WC's soil pipes - 100mm dia Nominal size.
- Handbasins - 32mm dia Nominal size.
- Showers - 32mm dia Nominal size.
- Overflow - 19mm dia Nominal size.
- Kitchen sink - 32mm dia Nominal size.

All fittings to have a 75mm deep seal traps. All waste pipes to be laid to falls 25mm per metre run. All sanitary fittings to be installed as per manufacturers instructions.

The maximum lengths of waste pipes shall be as follows.

- 32mm pipe - 1.7m Maximum length.
- 40mm pipe - 3.0m Maximum length.
- 50mm pipe - 4.0m Maximum length.
- 100mm pipe - 6.0m Maximum length.

Soil and ventilating stacks @ head of drainage run to be ventilated to the external air via rigid ducting.
(Min 900mm above any openable window head or within 3m horizontally).

Soil pipes passing through habitable rooms (including kitchens) to be lagged with minimum 50mm sound deadening quilt and 2 layers of 12.5mm plasterboard in 38mm x 38mm softwood framing. Access and rodding eye fittings to be provided to ensure all pipework is accessible as required. Pipework laid between joists to be adequately supported. Underground pipes with less than 750mm ground cover shall be insulated. Mains are to be insulated.

New 100mm dia stub stack as indicated with rodding access to serve new shower/senslites.

Surface water to be conveyed to existing rainwater drainage system.

Ventilation

All habitable rooms to have rapid ventilation via windows/doors of an operable area of at least 1/20th of the floor area, part of the ventilation area is to be 1.75m above floor area.

Windows are to provide 4000 sq/m minimum of background ventilation via controlled trickle vents in utility room, en suite and bedroom. All habitable rooms to achieve 8000 sq/m. Alternatively the sum of all trickle vents must equal 6000 sq/m as specified in Table 1 of approved document F1.

Kitchen to be ventilated mechanically ventilated with a wall mounted fan which can achieve extract to external air @ 30 litres per second. Utility to provide 60 litres per second.

Mechanical vents are to be tested and commissioned in accordance with regulation 4.2 and part F1 2010.

Electrical Installation.

All the electrical installation is to be in full accordance with BS 7671 and with the latest addition of IEE wiring regulations part 'F' building regs, and should be carried out in accordance with current installation techniques applicable to the material and equipment being used. Full completion certificates to be issued by a certified electrical engineer to be provided upon completion of the electrical installation.

Note that all wiring which is covered or surrounded with thermal insulation to be de-rated in accordance with Appendix A of BRE 'Thermal Insulation'; avoiding risks 2002 edition.

All downlighters in ceiling voids are to be fitted with Intumescent covers to maintain half hour fire resistance.

All light switches are to be fitted 1200mm from finished floor level and all switched outlets to be fitted 450mm above finished floor levels.

Lighting:
100 % of new light fittings to be energy efficient.

Lighting layout to be confirmed by client

Gas:
All works to the boiler and heating system to be carried out by a Gas Safety Registered person.

The hot water supply to baths/sinks/showers must incorporate measures to ensure that the temperature of the water does not exceed 48 degrees celcius. Thermostatic mixing valves to be provided. Hot Water pipes to be insulated to conserve heat in unheated spaces with material having a thermal conductivity at 40 degrees celcius not exceeding 0.035 W/m2K, having a thickness equal to the diameter of the pipe up to a maximum of 40mm.