100mm x 50mm rafters @ 400mm centers, 38mm x 19mm sw battens on breather layer felt. Roof pitch and tile to match main roof. Provide 275mm fibreglass insulation between / over 175mm x 50mm C24 ceiling joists @ 400 centers, 500g polythene vapour barrier, 12mm plasterboard and skim.

175 x 50 flat roof joists @ 400 centers firred to a 1:40 fall. 18thk external quality ply decking, 3 layers felt hot bonded and white spar chippings to finish.

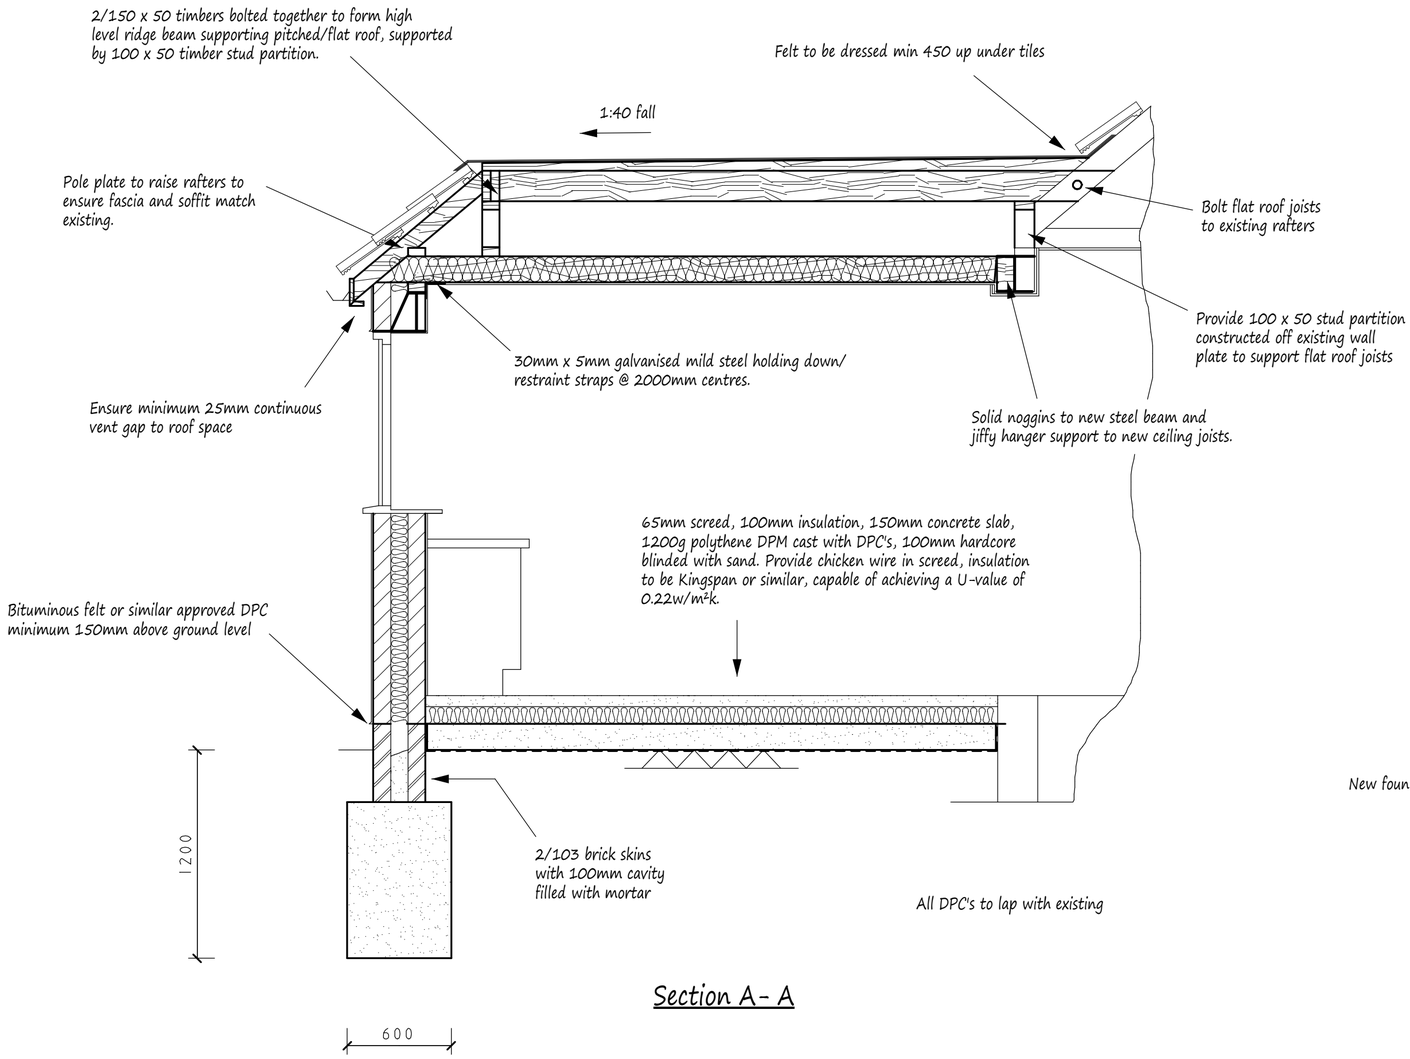

Section A- A

Foundations to be taken down minimum as noted and to extend below any local drains and 600mm below any tree roots found, all to the satisfaction of the Local Authority. If foundations depths have to exceed 1500mm, then suspended block and beam house floor will be required - contact G.E. Pottle & Co for further details.

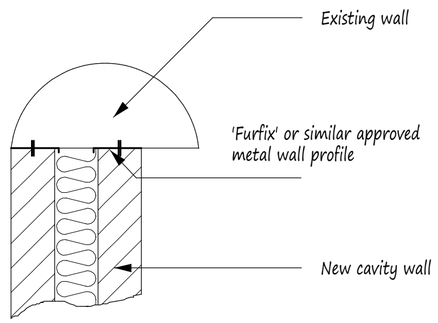

Section - Where new wall abuts existing

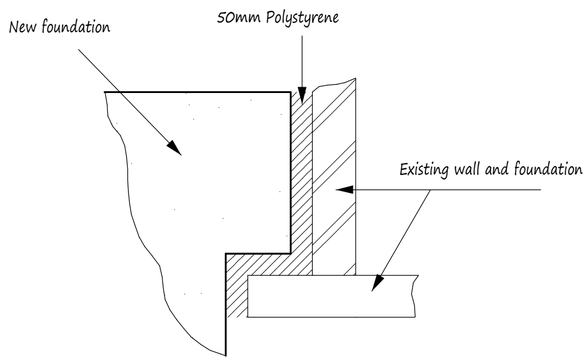

Detail - Where new foundation abuts existing

This drawing to be read in conjunction with Drg No's 3426/01

NOTES:
All dimensions must be checked on site and not scaled from this drawing.

For general notes see Drg No 3426/01

A		
	Date	Revisions

Copyright

G.E. Pottle & Co.
Building Design & Management Services

Suite B
128 Manor Way
Ruislip
Middlesex
HA4 8HR

Tel: 01895 622800
Fax: 01895 622900
www.planning-pottle.co.uk

Client
Mr. E. Blitz

Job Title
33 Highland Road
Northwood Hills
Middlesex

Drawing Title
Sections and Details

Scale
1:25. 10

Date	Drawn by
September 2014	MDP

Drg No.
3426/02