



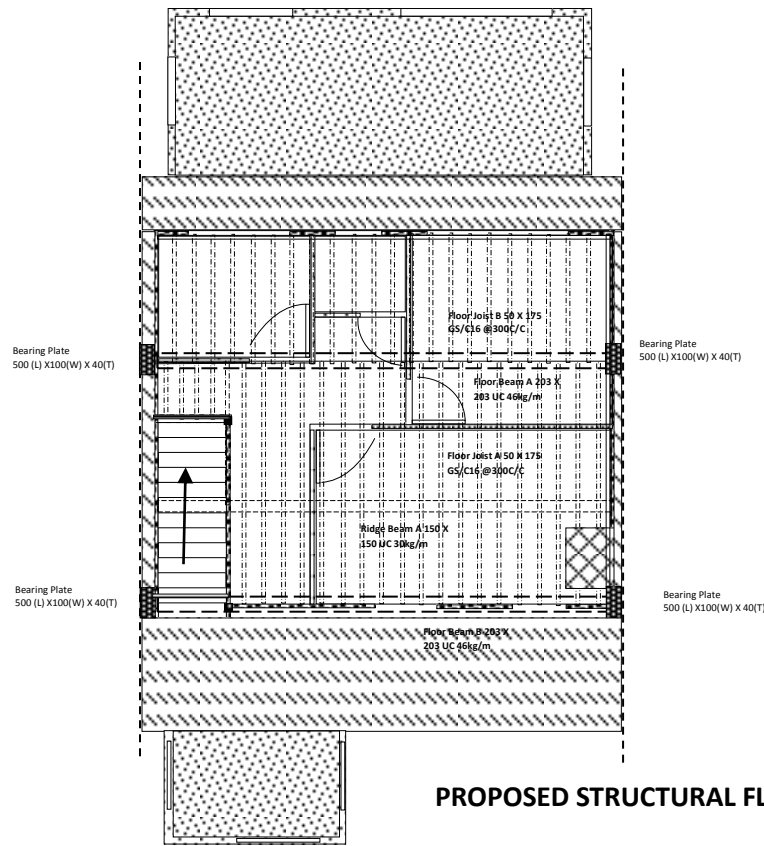


PROPOSED STRUCTURAL FLOOR PLAN

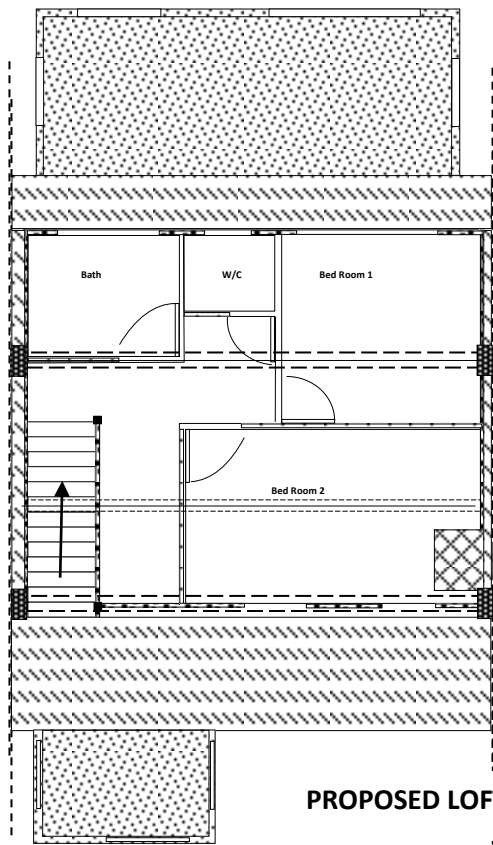

PROPOSED LOFT FLOOR PLAN

Notes :

- A. Slope Roof should be provided with 150 mm Celotex Insulation with front roof void
- B. 100 mm Celotex Insulation should be provided within Flat Roof and 45 mm beneath joist to achieve U-Value of 0.18 W/m2K
- C. Structural Timbers to be a minimum of 40mm clear of Chimney breasts. Floor Joist to be 25mm (or more) clear of existing ceiling

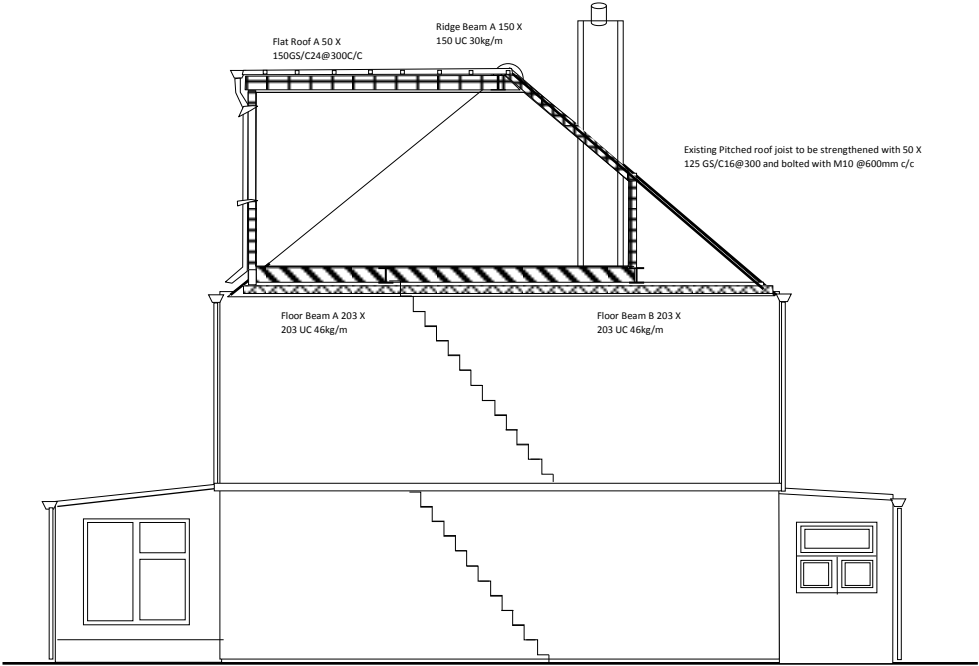

PROPOSED SECTION



EXISTING SECTION



Address:
13, Ninth Avenue
Hayes , UB3 2HH

Drawing Title: Section and
Proposed Floor Plans

DRAWING – 0010/SEPT/0003

Scale: 1:100 @ A3
Date: 10-10-2016

Notes: Contractor in general is responsible for the verification of all dimensions on site and inform Contract Administrator of any discrepancy.

Do not scale from this drawing.