

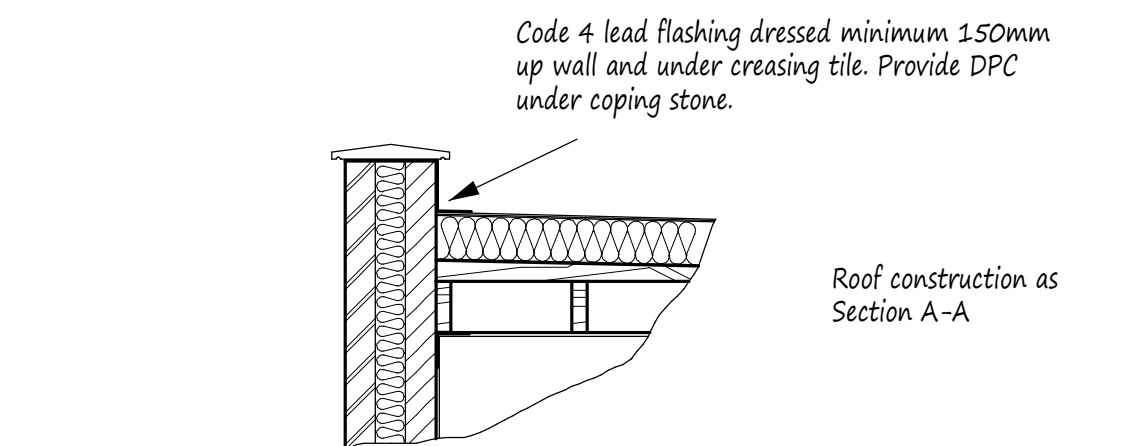


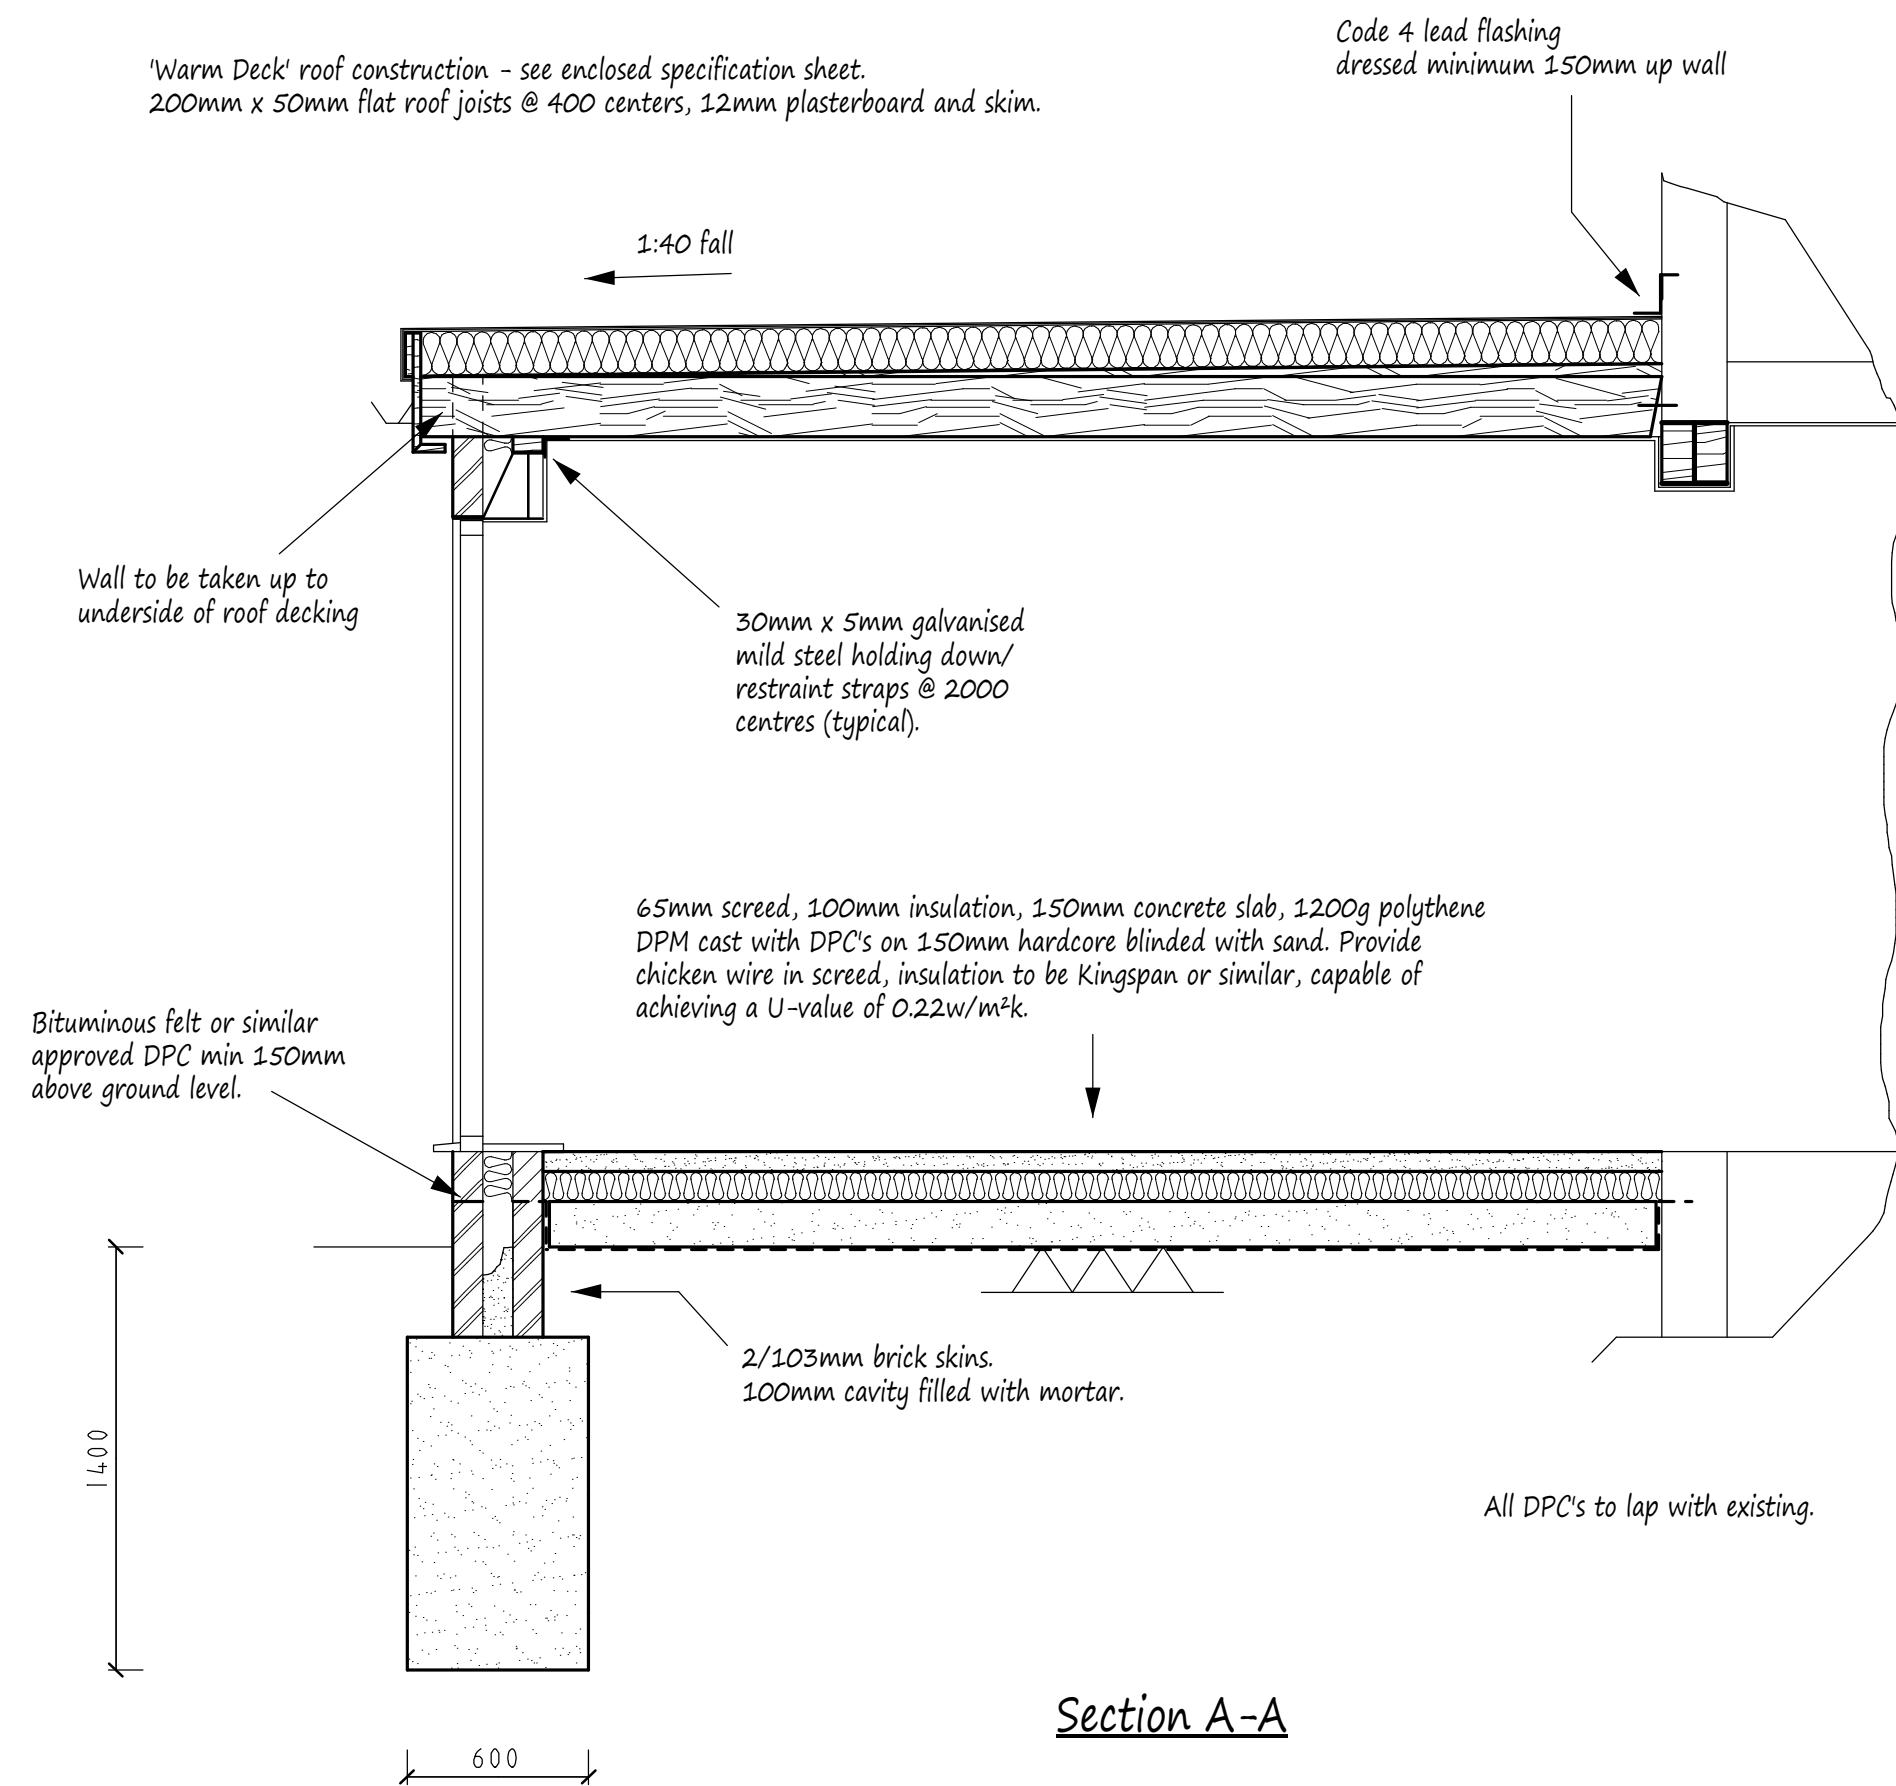


Parapet Detail

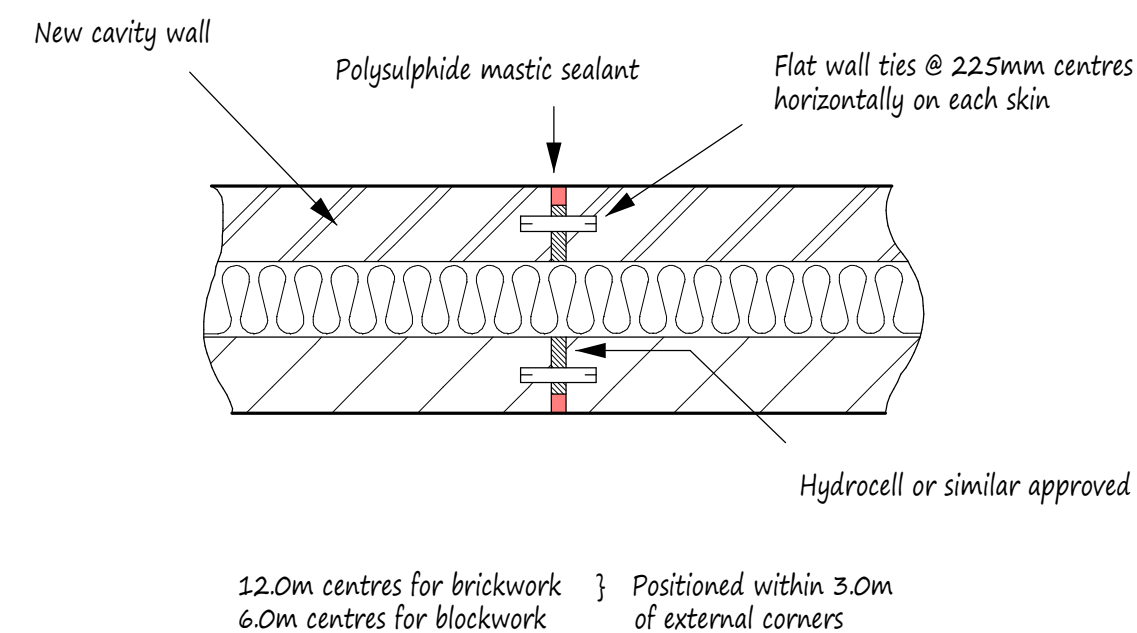


Detail - Tied Movement Joint

This drawing to be read in conjunction with Drg No 4189/01

Foundations to be taken down minimum as noted, however also to extend below invert levels of any local drains and 600mm below any tree roots - all to the satisfaction of the Local Authority. If foundation depths need to exceed 1500mm due to tree roots found, then provide suspended ground floor slab and 75mm claymaster to inner walls of trench. Contact Pottle & Co Ltd for revised details if required.

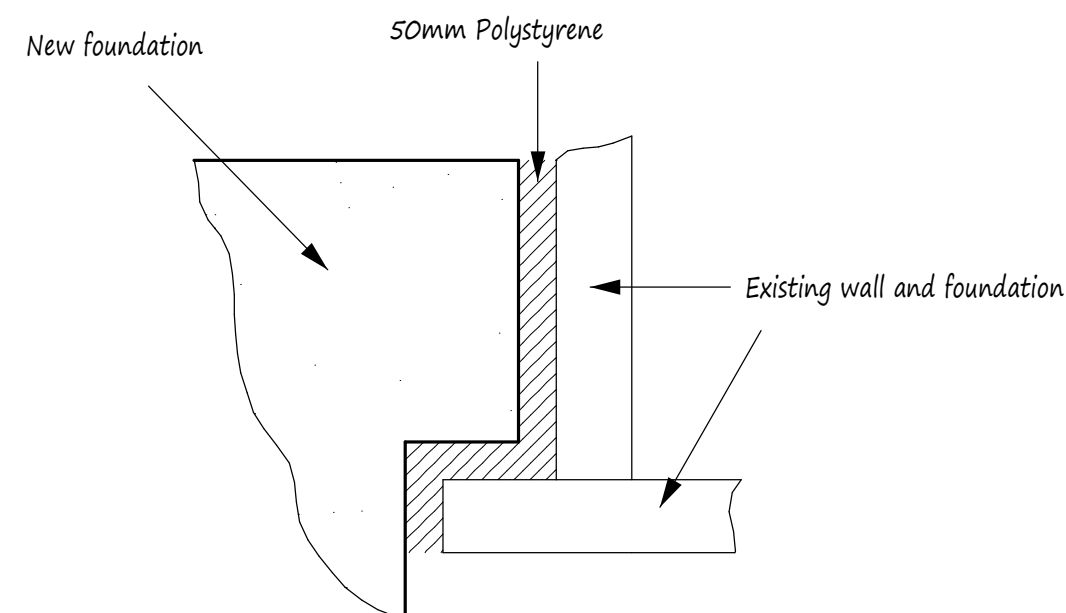

Detail - Where new foundation abuts existing

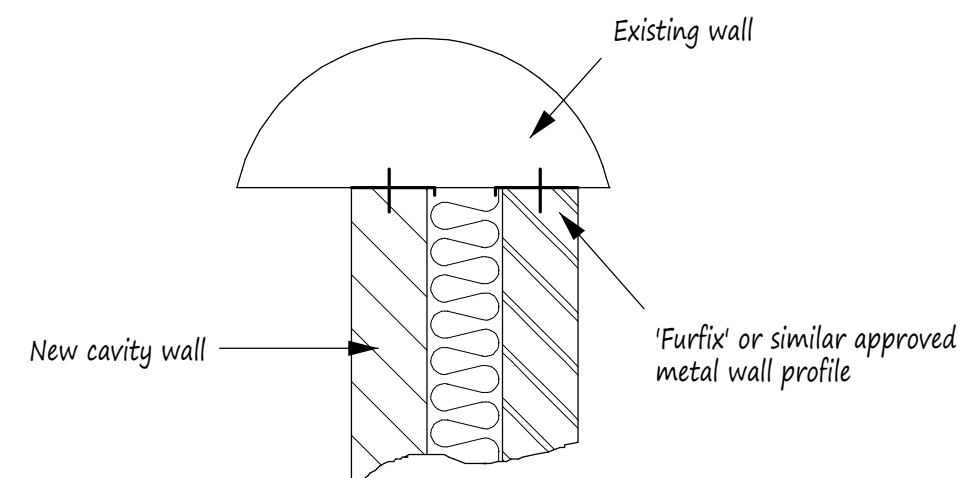

Detail - Where new wall abuts existing

NOTES:
All dimensions must be checked on site and not scaled from this drawing.

For general notes see
Drg No 4189/01

A		
	Date	Revisions

Copyright

Pottle & Co Ltd.
Building Design &
Management Services

Suite A
128 Manor Way
Ruislip
Middlesex
HA4 8HR

Tel: 01895 622800
www.pottle.uk.com

Client
Mr & Mrs Vincent

Job Title

2 Festival Close
Hillingdon
Middlesex

Drawing Title

Sections and Details

Scale
1:25. 10

Date
January 2019

Drawn by
MDP

Drg No.
4189/02

Thames Water Requirements

1. No internal manholes
2. Foundations to extend below invert level of any drain.
3. Pre-cast concrete lintels to be provided where drains pass through walls.
4. Min 600mm from side of trench to side wall of sewer if sewer deeper than 1.1m, otherwise minimum of 100mm required if less than 1.1m deep.