

GENERAL SPECIFICATION
(unless noted otherwise on drawings or engineer's design)

FOUNDATIONS

Concrete deep strip 30 N/mm² strength sulphate resisting cement. Depth & width provisionally as plan but final depth & width to be agreed on site with building inspector. Drains running through foundations or under new walls to have 150 RC lintel over & 50 clearance. Foundations exceeding 1500 deep to have 75 claymaster to inside face kept 500 from bottom of excavation. Foundations dug next to neighbouring structures to be constructed in 'hit & miss' sequence. Excavate alternate bays not exceeding 1m long. Fill with concrete and dig next bay after concrete has fully set. Connect pins with M16 MS dowels. Any eccentrically loaded foundation to be 600mm wide with the outer face of wall 60 from foundation edge.

GROUND FLOOR – GROUND BEARING CONCRETE SLAB

Min 150 rammed hardcore blinded with 50 sand 1200 PVC DPM lapped to DPC. 100 concrete. 80 Celotex GA4000 insulation slab. 75 screed finish reinforced with chicken wire mesh. 500 gauge polythene separating layer between insulation & screed. All existing air vents ducted through 100 dia PVC pipe under DPC. Strip of insulation to perimeter of screed.

EXTERNAL CAVITY WALLS

Cavity wall of 100 Celcon Standard lightweight block (K=0.15 W/m²K) inner skin. 102 brick or 100 Celcon Standard lightweight block (refer to plan) outer skin. Class B engineering brick below DPC to both skins. 95 cavity with 85 Knauf DrTherm-32 full fill insulation to achieve U-value of 0.28W/m²K. Fill cavity with weak mix concrete to 225mm below DPC. Stainless wall ties (225 long) 750 horiz. 450 vert & 300 at reveals. Join to existing building with furris movement joint. DPC to BS743 lapped to existing. Mortar mix 1:1:6. Sulphate resisting cement to be used on all work below DPC. Cavity reveals to be closed with Thermabate insulated cavity closers. Lightweight Gypsum plaster internally - 11 Thistle Bonding Coat + 3 Thistle multi finish skim. Bifold doors to have Catnic CX90/100. 150 min bearings.

STEELWORK

Beams to be clad with 2x12.5 plasterboard bound with 1.6mm Gauge wire at 100mm pitch prior to skim coat of plaster to provide 30 min fire resistance.

PITCHED ROOF (WITH SLOPING SOFFIT) - UNVENTILATED

150x50 C16 rafters at 400 cts spiked & B-mouthed to joists & wall plates. 5x30 MS anchor straps at 1200 max cts screw fixed at three points to both roof structure and wall. 120mm Celotex XR4000 insulation slab between joists & 20mm Celotex TB4000 insulation slab beneath joists to achieve U-value of 0.18W/m²K. 15 degree pitch. 1 layer Tyvek breathable membrane. 19x38 battens. Sandtoft 20/20 interlocking clay tiles with 100 headlap laid to suit 15 deg pitch (or similar approved). Tile colour to match existing. 9 plasterbd + 3 skim to soffit.

FLAT ROOF (WARM DECK CONSTRUCTION)

100x50 C16 joists at 400 cts on steel joist hangers. 5x30 MS anchor straps at 2000 max cts. 18 WBP plywood fired to fall min 1 in 40. 1 layer felt vapour control layer (VCL) in accordance with BS6229 fully bonded to ply decking. Fully bond 120mm Celotex TC3000 insulation slab to VCL. Loose lay venting layer directly onto insulation. Torch on underlay sheet over venting layer. Torch on mineral surface cap sheet to underlay. Finish with bitumen bedded stone chippings covering the whole surface to a depth of 12.5mm. Ceiling 9 plasterboard & 3 skim. Roof to achieve U-value of 0.18W/m²K. Separate from pitched roof with strip of 1200 gauge PVC.

ROOFLIGHTS – PITCHED ROOFS

Install with manufacturers upstand/flashing kit and all to manufacturers instructions. 15 degree min pitch for Velux rooflight. Doubled up rafters and trimmers around opening to be bolted together with M12 bolts @ 600cts.

VENTILATION

Windows/doors to match existing & provide vent of min 1/20 floor area & built in adjustable 8000mm² min vent. Install power vent to kitchen to achieve 30 litres/sec if over a cooker or 60 litres/sec if elsewhere. WC to achieve 15 litres/sec and be connected to light switch with 15 minute overrun. Vent to be ducted at ceiling level to outside air.

DRAINS

Clay 100 dia pipe laid in 150 pea shingle to fall min 1 in 40. Inspection chambers 150 concrete base. 215 shaft of engineering bricks type B flat pointed. Clay fittings in 1:3 mortar benching. 600x450 cast iron frame & cover. Alternatively use Osma preformed IC all to manufactures spec (only on private non shared drains). Drains shown on drawings are estimated and are to be confirmed on site before any work commences.

SURFACE WATER

112 dia PVC gutters. 68 dia PVC downpipes. Surface water downpipes connected to soakaway minimum 5 metres from any building. Volume of 1 cubic metre per 16.5 square metres of roof area served. Fill with hardcore. Construct new soakaway if required. If not possible connect into existing surface water drain.

ABUTMENTS

All exterior abutments to have code 4 lead min 150 flashing let into brickwork or blockwork.

WINDOWS & DOORS

Double glazed with 16 air gap and soft low E coating. Built in 8000mm² adjustable vent. All windows to achieve minimum U value of 1.6 w/m²K. All doors to achieve minimum U value of 1.8 w/m²K. All glass below 800mm and glass in doors or within 300mm of a door to be toughened safety glass.

ABOVE GROUND DRAINAGE AND PLUMBING

Sink to have 40 dia waste. Basin to have 32 dia waste. All with 75 D/S traps & rodding access at bends. Long & combination wastes 50 dia. WC with low flush cistern & 110 dia waste. Plumbing to comply with British Standards. Air admittance valves (Durgo Valve) to be installed above level of highest fitting that it serves. All SVPs to vent 900 above any openable window within 3m. Wholesome water (ie water provided by statutory water supplier via a compliant water supply installation) to be provided to all taps.

ELECTRICAL WORK

All electrical work required to meet the requirements of Part P (Electrical Safety). Must be designed, installed, inspected & tested by a person competent to do so. Prior to completion the council should be satisfied the Part P has been complied with. This may require an appropriate BS7671 electrical installation certificate to be issued for the work by a person competent to do so. New light fittings to have LED bulbs. Electrical switches and sockets to be installed between 450mm and 1200mm from floor level where practical.

HEATING

All new radiators to be fitted with thermostatic valves. All work to gas pipework, boilers & appliances to be carried out, tested and certified by Gas Safe registered person.



EXISTING SIDE ELEVATION
SCALE 1:100




EXISTING REAR ELEVATION
SCALE 1:100




PROPOSED SIDE ELEVATION
SCALE 1:100




PROPOSED REAR ELEVATION
SCALE 1:100

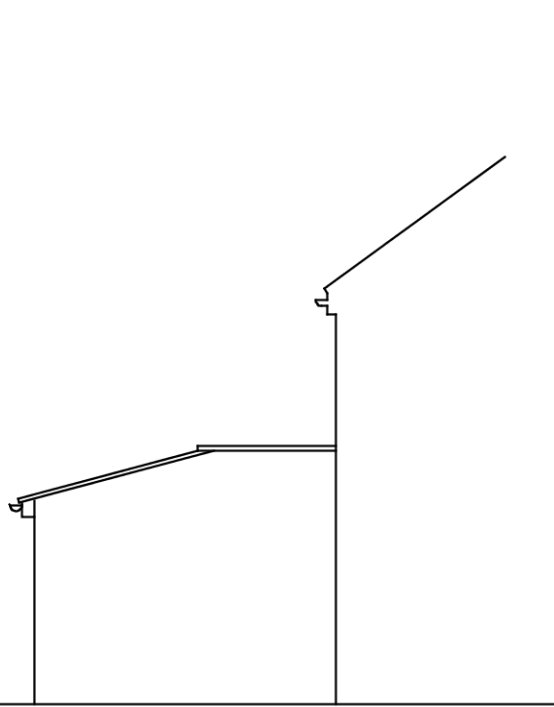


PROPOSED SIDE ELEVATION
SCALE 1:100

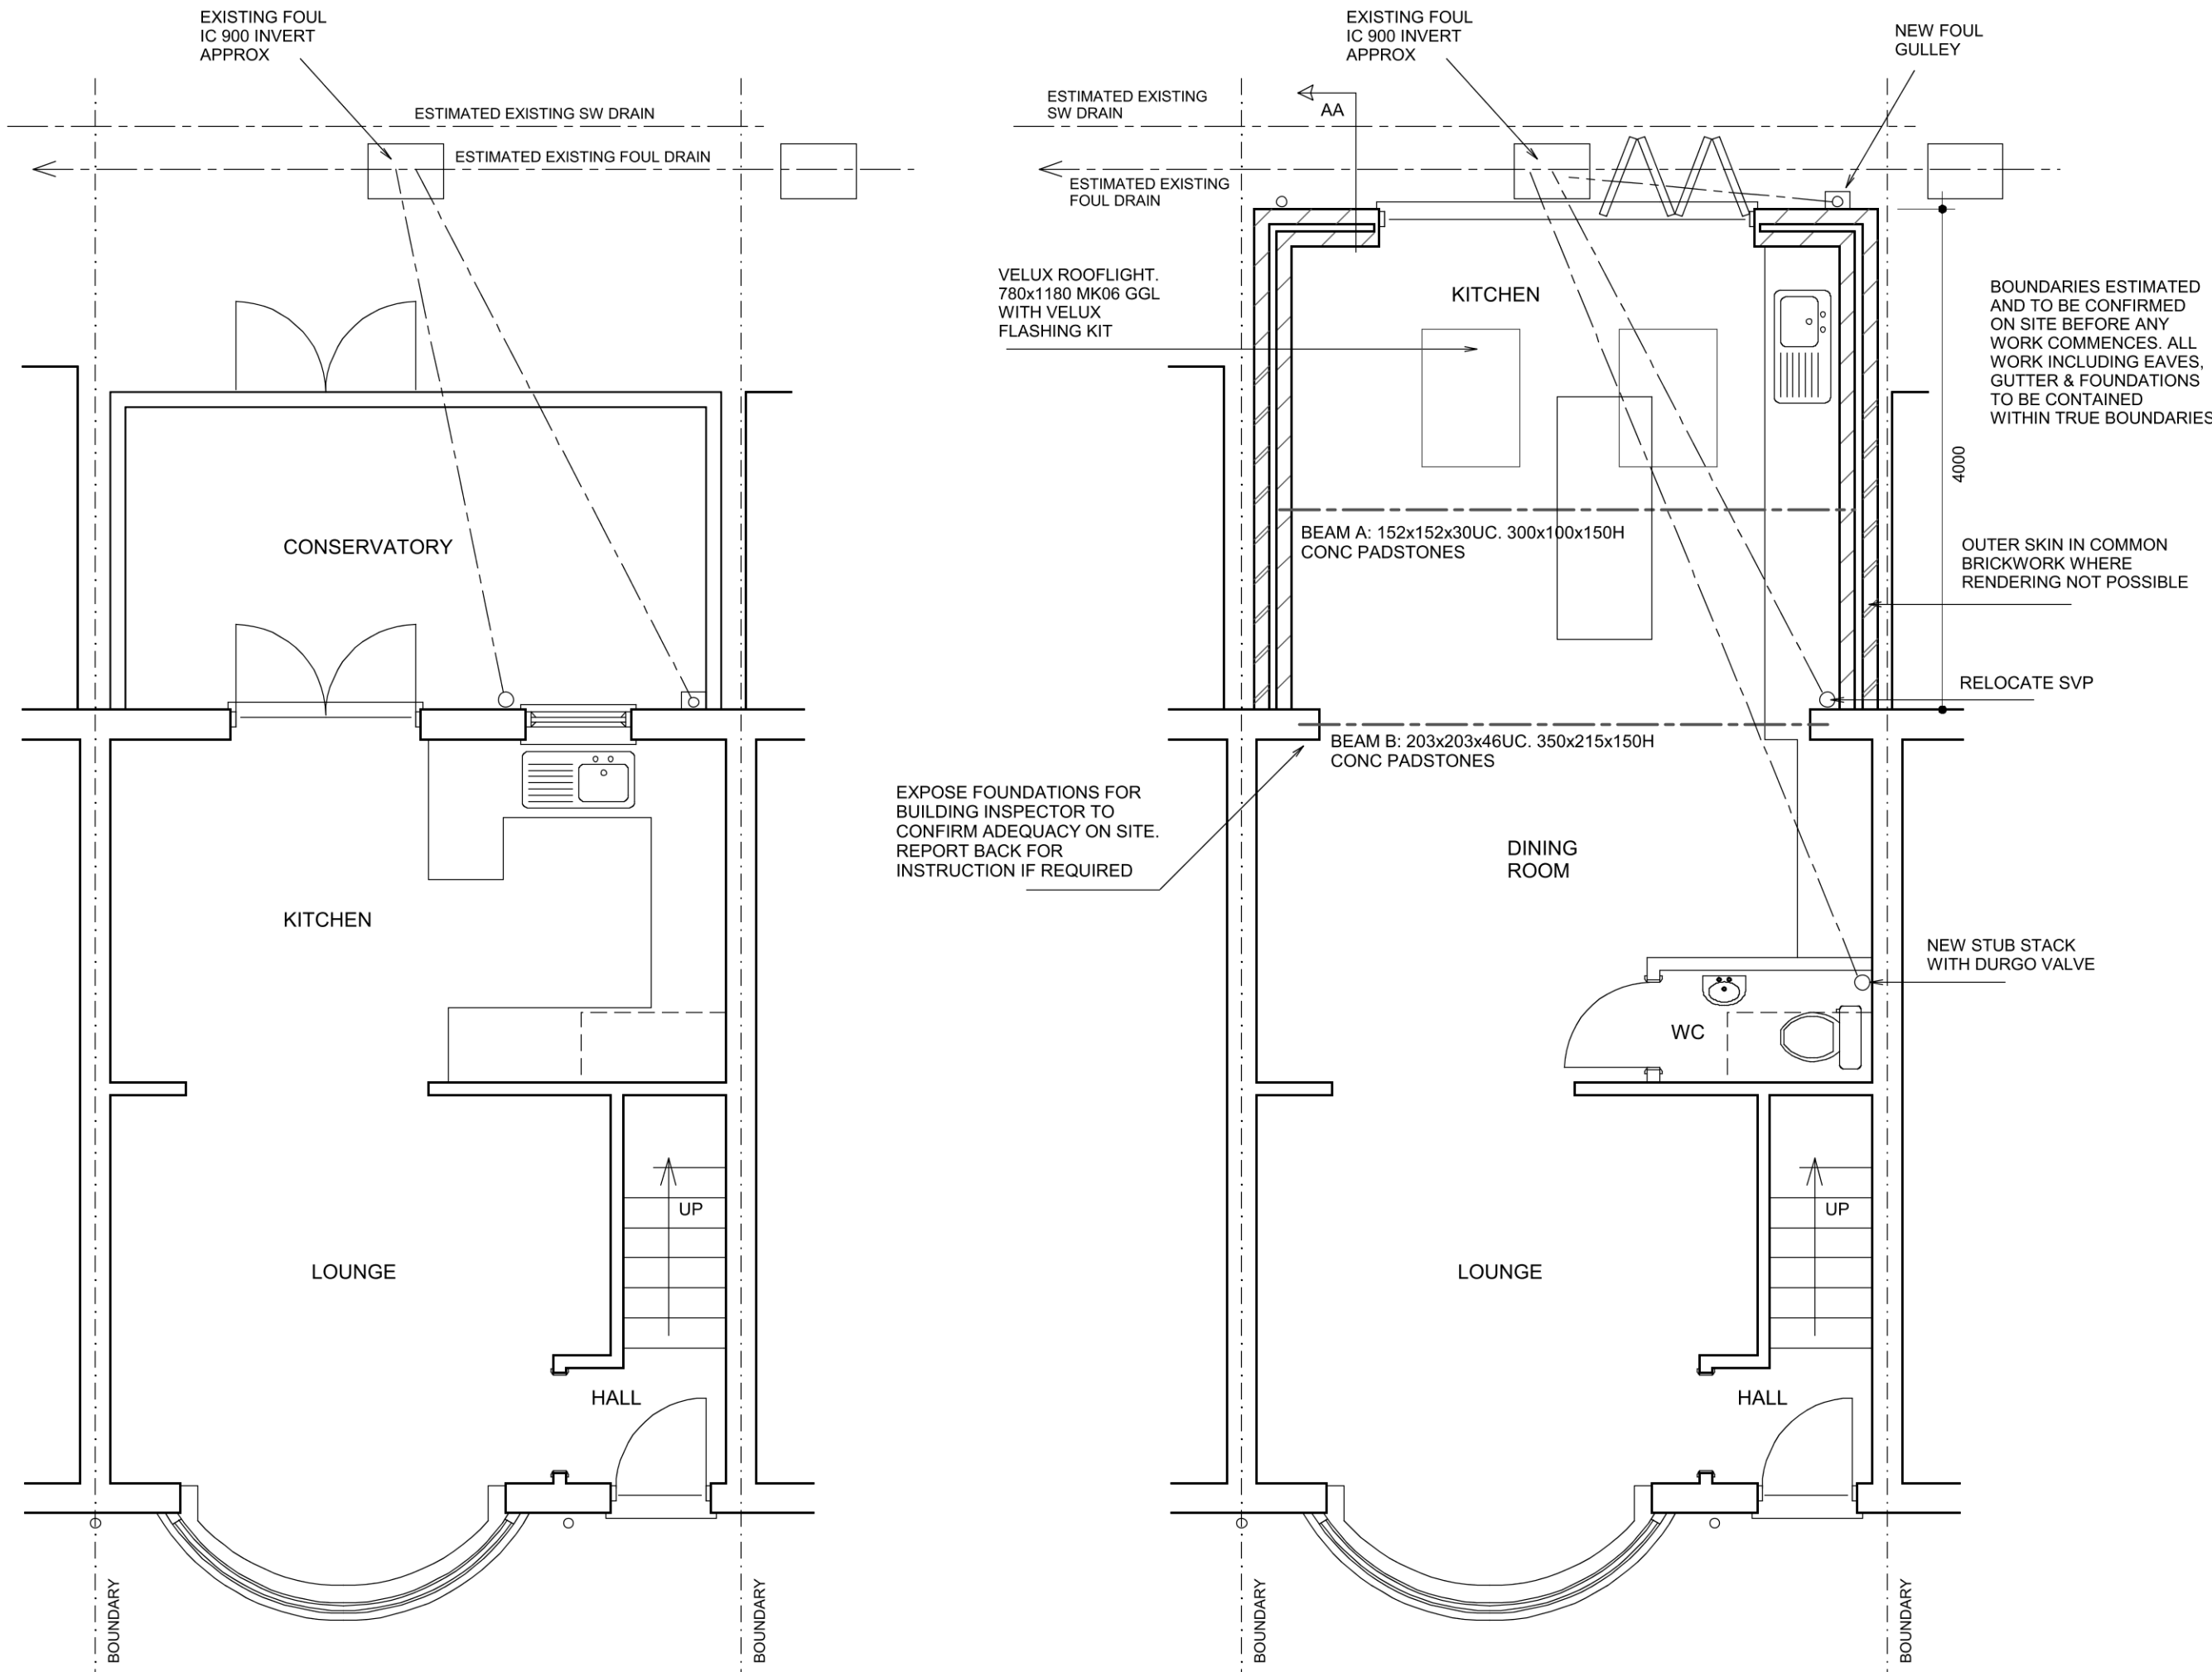


EXISTING GROUND FLOOR PLAN

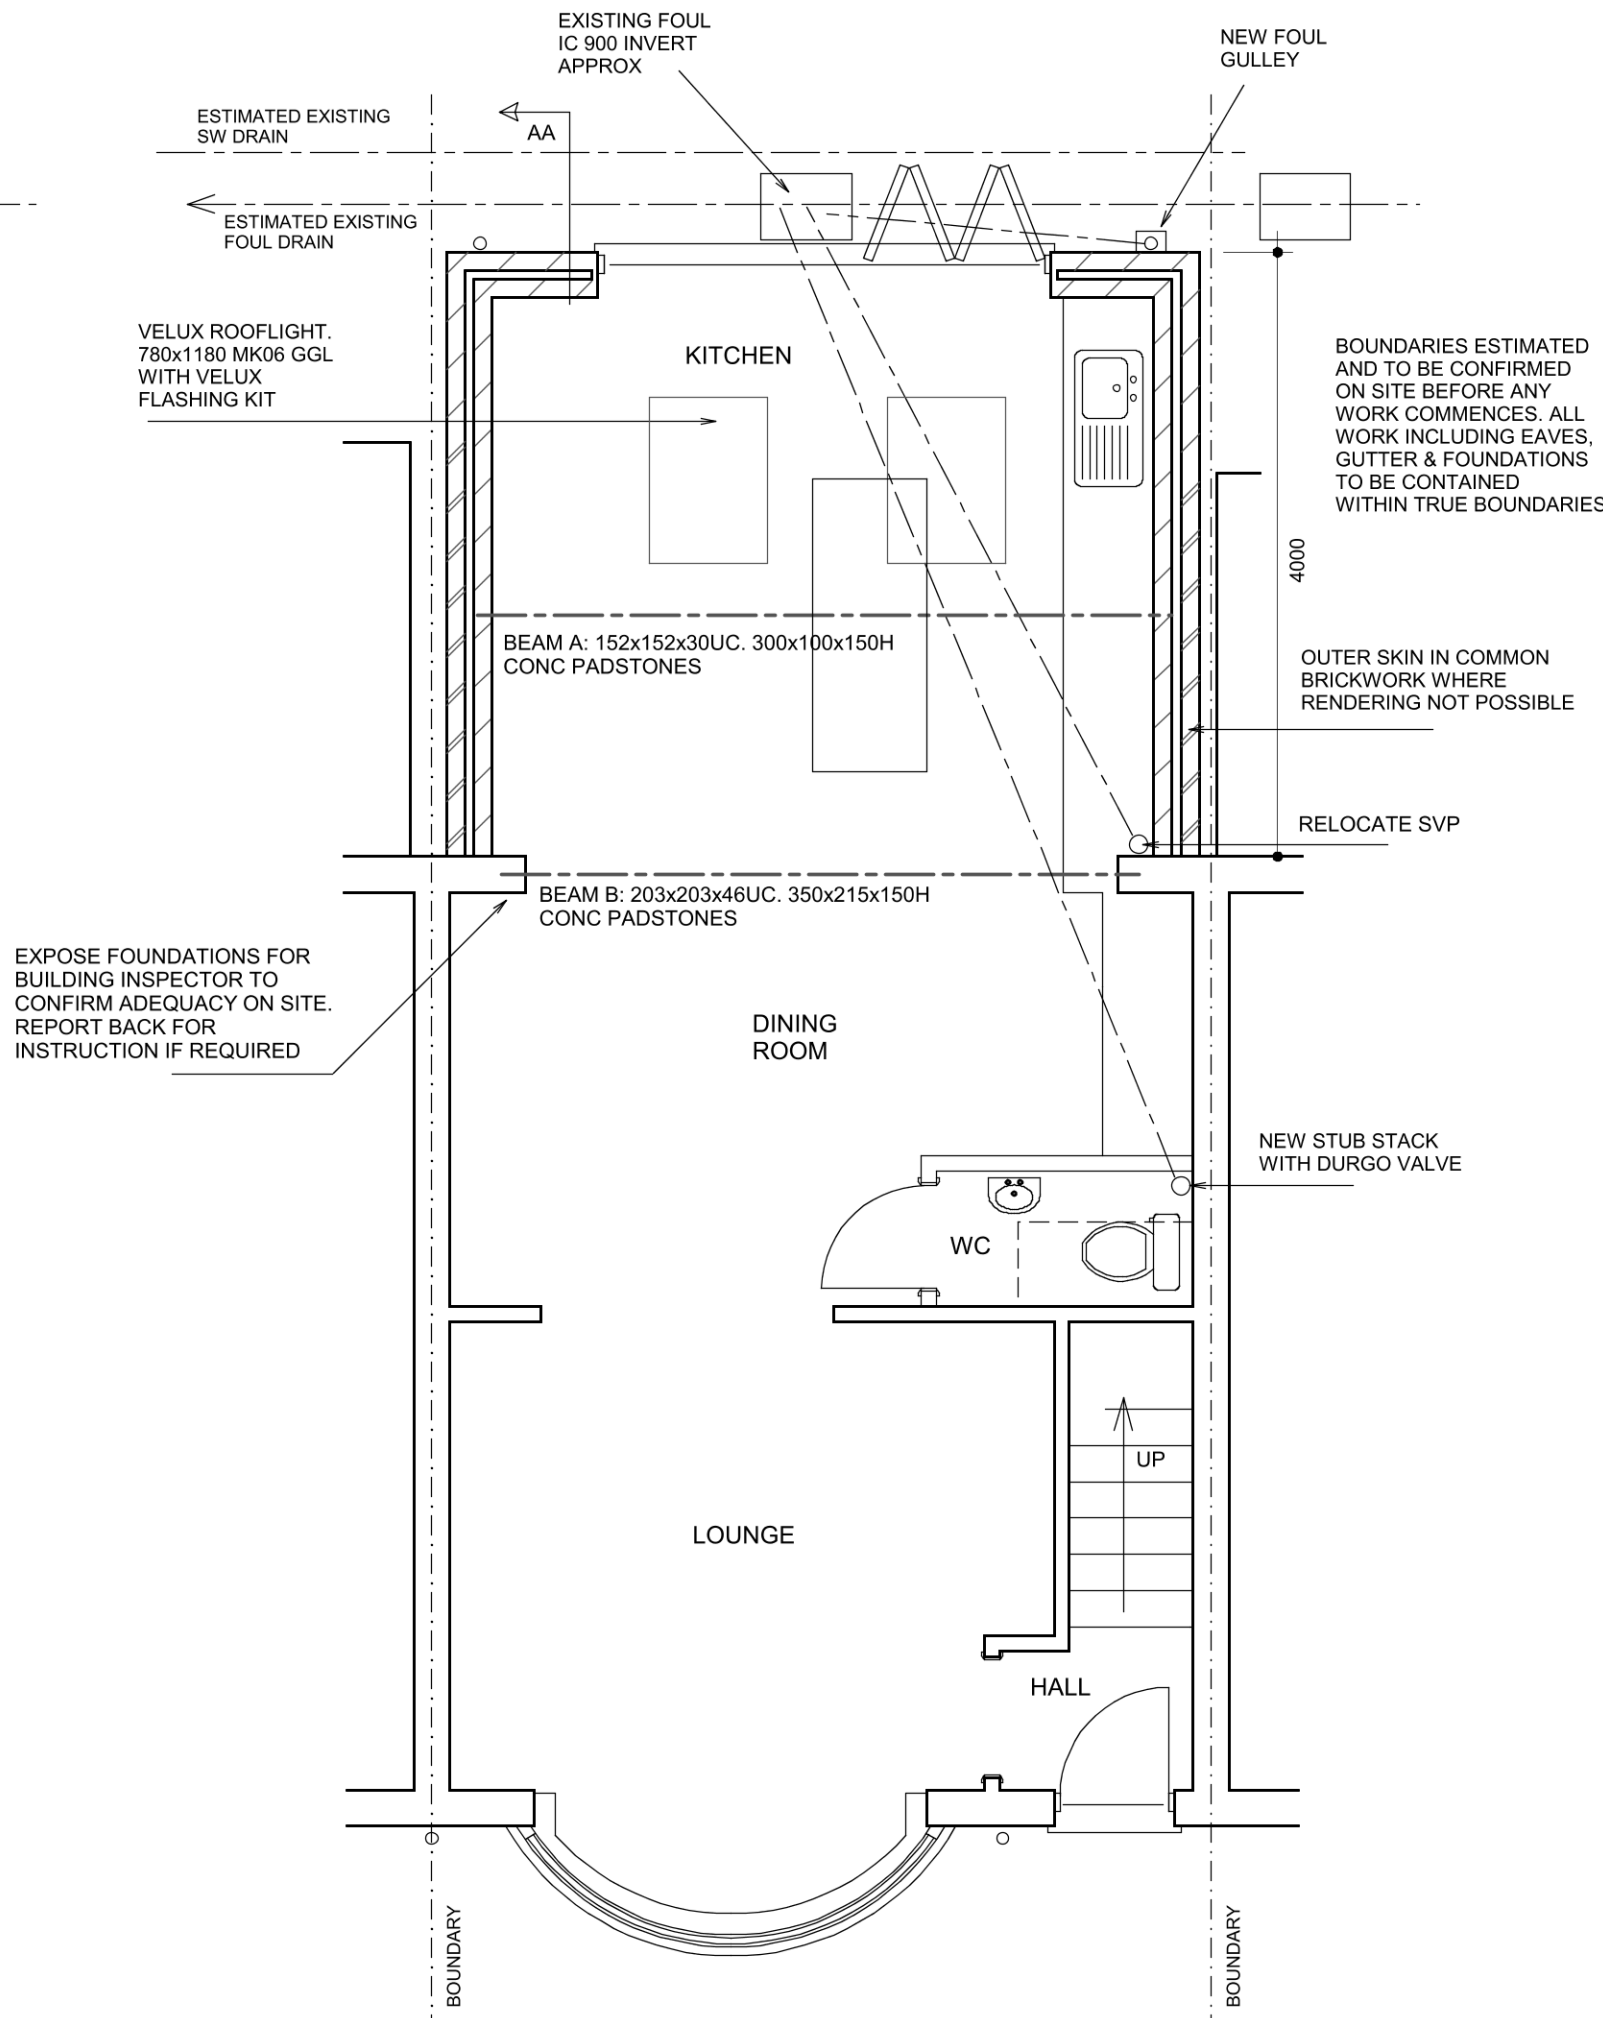

PROPOSED GROUND FLOOR PLAN

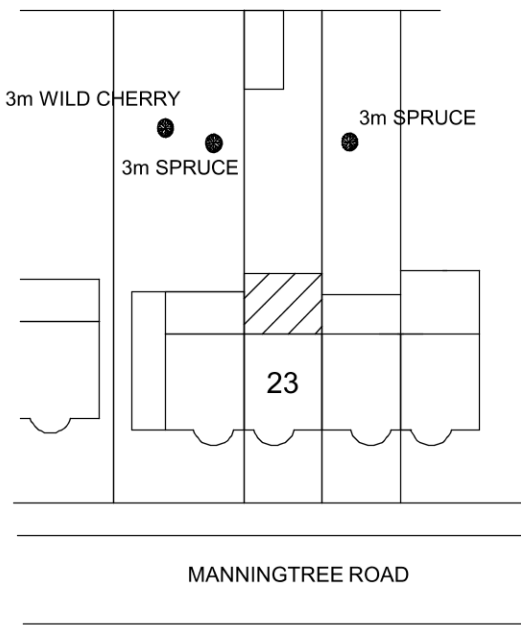

BLOCK PLAN
SCALE 1:500

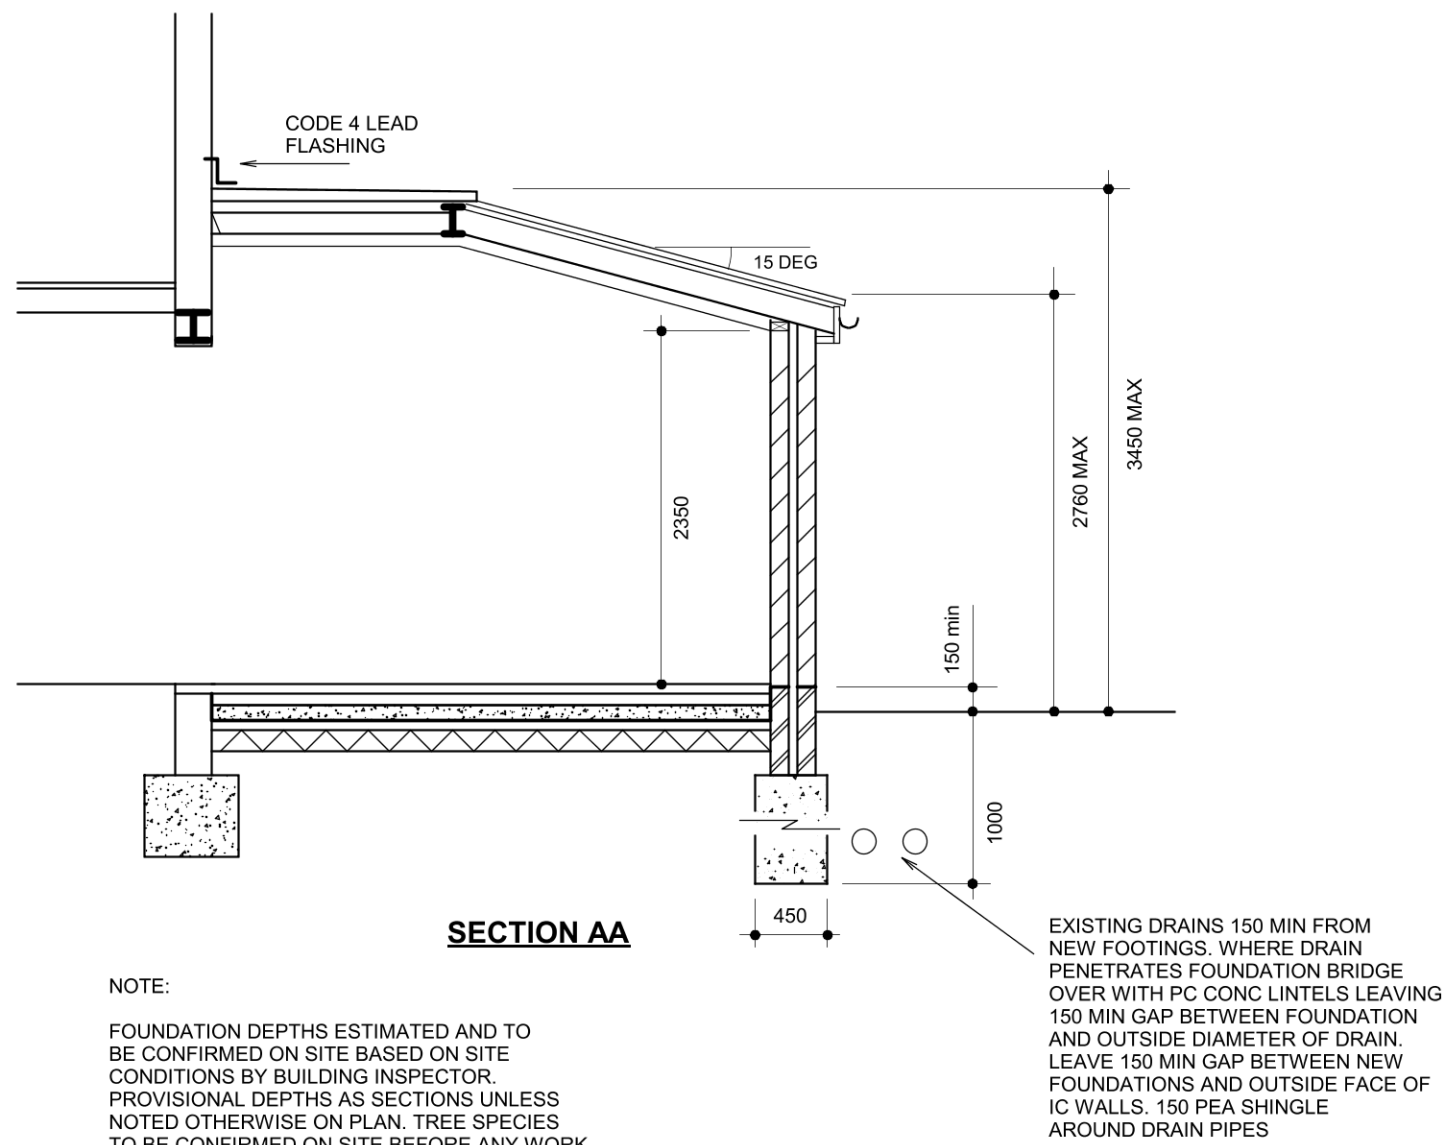

SECTION AA

NOTE:

FOUNDATION DEPTHS ESTIMATED AND TO BE CONFIRMED ON SITE BASED ON SITE CONDITIONS BY BUILDING INSPECTOR. PROVISIONAL DEPTHS AS SECTIONS UNLESS NOTED OTHERWISE ON PLAN. TREE SPECIES TO BE CONFIRMED ON SITE BEFORE ANY WORK COMMENCES. FOOTINGS TO BE 600 BELOW LOWEST ROOT ACTIVITY AND BELOW ANY ADJACENT DRAIN. 75 CLAYMASTER TO BE PROVIDED TO FOUNDATION DEPTHS EXCEEDING 1.5m. DEPTHS MEASURED TO ORIGINAL GROUND LEVEL. NOT TO TOP OF BUILT UP GROUND.

23 MANNINGTREE ROAD RUISLIP MIDDX HA4 0EN

SINGLE STOREY EXTENSION

JAMES RUSH ASSOCIATES LTD

54 JOINERS LANE CHALFONT ST PETER
BUCKINGHAMSHIRE SL9 0AT TEL: 01923 775 761
EMAIL: jamesvrush@hotmail.com

SCALE 1:50 / 1:100 @ A1

SEPT 2019

DRG No. 2072.1

BOUNDARIES ESTIMATED AND TO BE CONFIRMED ON SITE. ALL NEW WORKS TO BE CONTAINED WITHIN TRUE BOUNDARIES UNLESS STATED OTHERWISE ON PLAN
ALL NEW WORK TO COMPLY WITH CURRENT BUILDING REGULATIONS
DIMENSIONS IN MILLIMETRES AND TO BE CONFIRMED ON SITE
ALL DRAINS & TREES ARE ESTIMATED AND ARE TO BE CHECKED & CONFIRMED ON SITE BEFORE ANY WORK COMMENCES
CLIENT TO SERVE PARTY WALL ACT NOTICE BEFORE WORK COMMENCES
ALL WORK TO BE CARRIED OUT & SUPERVISED BY COMPETENT OPERATIVES
DUE TO SURVEY LIMITATIONS EXISTING JOIST SPANS ASSUMED UNTIL CONFIRMED ON SITE. ALL WALLS & PARTITIONS TO BE CONSIDERED LOADBEARING UNTIL OPENED UP ON SITE AND CHECKED BY COMPETENT PERSON TO CONFIRM OTHERWISE. MUST BE CONFIRMED BEFORE ANY WORK COMMENCES
IF STRUCTURAL ENGINEERS DESIGN RELATING TO STRUCTURAL ELEMENTS CONTRADICTS ARCHITECTURAL DRAWINGS SPEC. ENGINEERS DESIGN PREVAILS
THIS DRAWING IS FOR PLANNING & BUILDING REGULATION APPLICATION PURPOSES ONLY. BUILD/ER/CLIENT TO APPOINT CDM CONSULTANT TO ENSURE WORKING COMPLY WITH CDM REGULATIONS BEFORE WORK COMMENCES
SINCE WE HAVE NO ACCESS TO THE DEEDS OF THE PROPERTY IT IS THE RESPONSIBILITY OF THE CLIENT TO ENSURE THAT THE WORKS DO NOT CONTRAVENE ANY RESTRICTIVE COVENANTS CONTAINED IN THE DEEDS