

**PROPOSED SIDE ELEVATION**

SCALE 1:100

**PROPOSED REAR ELEVATION**


SCALE 1:100

**PROPOSED SIDE ELEVATION**

SCALE 1:100

**PROPOSED FRONT ELEVATION**

SCALE 1:100

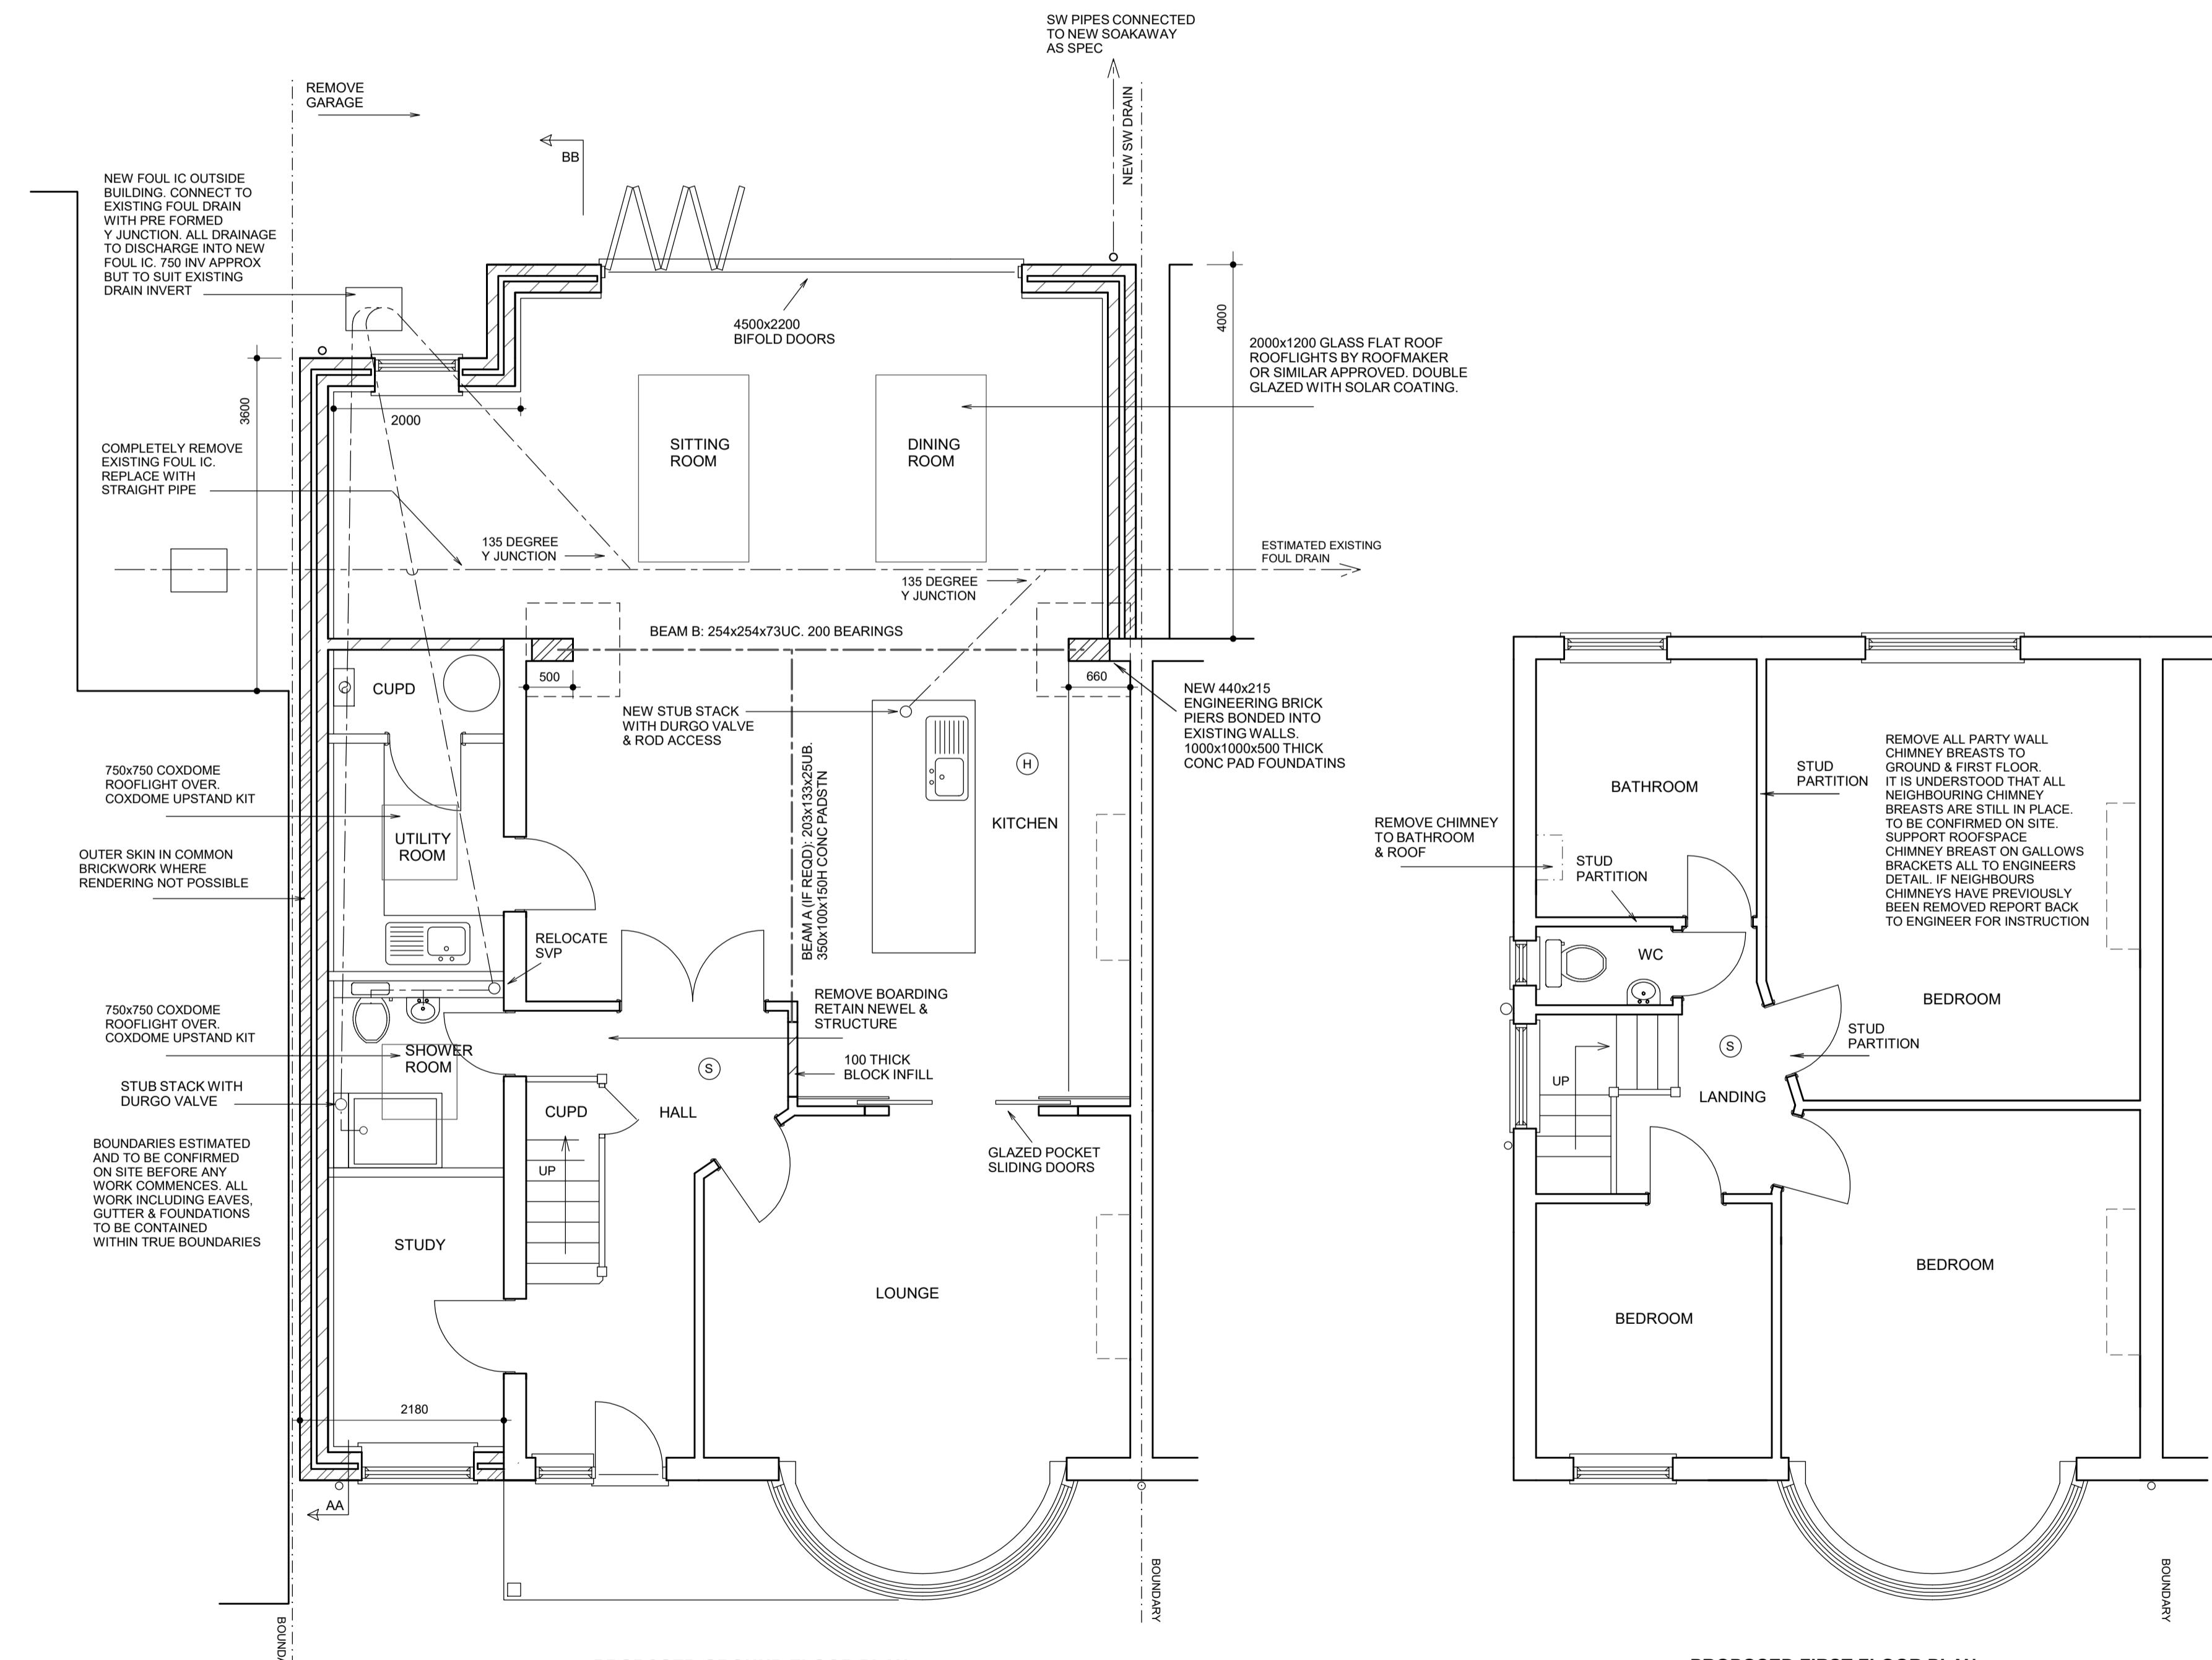

**PROPOSED GROUND FLOOR PLAN**

**PROPOSED FIRST FLOOR PLAN**

(S) SELF CONTAINED MAINS OPERATED INTERLINKED OPTICAL SMOKE DETECTOR SYSTEM IN ACCORDANCE WITH BS5839 OR BS5446. ALARMS TO HAVE BATTERY BACK UP. DETECTORS 300mm FROM WALLS

(H) HEAT DETECTOR INTERLINKED WITH SMOKE DETECTORS

BOUNDARIES ESTIMATED AND TO BE CONFIRMED ON SITE. ALL NEW WORKS TO BE CONTAINED WITHIN THESE BOUNDARIES UNLESS STATED OTHERWISE. ON PLAN ALL NEW WORK TO COMPLY WITH CURRENT BUILDING REGULATIONS. DIMENSIONS IN MILLIMETRES AND TO BE CONFIRMED ON SITE. ALL STEEL DIMENSIONS TO BE CONFIRMED ON SITE AND NOT TO BE TAKEN FROM DRAWINGS. ALL DRAINS & TREES ARE ESTIMATED AND ARE TO BE CHECKED & CONFIRMED ON SITE BEFORE ANY WORK COMMENCES. CLIENT TO SERVE PARTY WALL ACT NOTICE BEFORE WORK COMMENCES. ALL WORK TO BE CARRIED OUT & SUPERVISED BY COMPETENT OPERATIVES. DUE TO SURVEY LIMITATIONS EXISTING JOINTS ARE ASSUMED TO BE CONFIRMED ON SITE. ALL WALLS & PARTITIONS TO BE CONSIDERED LOADBEARING UNTIL OPENED UP ON SITE AND CHECKED BY COMPETENT PERSON TO CONFIRM. OTHER THAN THE ABOVE, THE CONTRACTOR IS NOT RESPONSIBLE FOR ANY PARTS OF THE EXISTING BUILDING. IF STRUCTURAL ENGINEERS DESIGN RELATED TO STRUCTURAL ELEMENTS CONTRACTORS ARCHITECTURAL DRAWINGS/SPEC - ENGINEERS DESIGN PREVAILS. THIS DRAWING IS FOR PLANNING & BUILDING REGULATION PURPOSES ONLY. CONTRACTORS ARE RESPONSIBLE FOR DESIGNING THE WORKS TO ENSURE WORKS COMPLY WITH CDM REGULATIONS BEFORE WORK COMMENCES. SINCE WE ARE NOT A SURVEYOR, THE CONTRACTOR IS RESPONSIBLE FOR THE RESPONSIBILITY OF THE CLIENT TO ENSURE THAT THE WORKS DO NOT CONTRAVENE ANY RESTRICTIVE COVENANTS CONTAINED IN THE DEEDS

**GENERAL SPECIFICATION**  
(unless noted otherwise on drawings or engineer's design)

**FOUNDATIONS**

Concrete deep strip 30 N/mm<sup>2</sup> strength sulphate resisting cement. Depth & width provisionally as plan but final depth & width to be agreed on site with building inspector. Drains running through foundations or under new walls to have 150 RC lintel over 50 clearance. Foundations exceeding 1500 deep to have 75 claymaster to inside face kept 500 from bottom of excavation. Foundations dug next to neighbouring structures to be constructed in 'hit & miss' sequence. Excavate alternate bays not exceeding 1m long. Fill with concrete and dig next bay after concrete has fully set. Connect pins with M16 MS dowels. Any eccentrically loaded foundation to be 600mm wide with the outer face of wall 60 from foundation edge.

**GROUND FLOOR - GROUND BEARING CONCRETE SLAB**

Min 150 rammed hardcore blinded with 50 sand 1200 PVC DPM lapped to DPC. 100 concrete. 100 Celotex GA4000 insulation slab with staggered & taped joints. 75 screed. 500 gauge polythene separating layer between screed & concrete. All existing air vents ducted through 100 dia PVC pipe under DPC. Strip of insulation to perimeter of screed.

**EXTERNAL CAVITY WALLS**

Cavity wall of 100 Celcon Standard lightweight block (K=0.15 W/m2K) inner skin, 100 Celcon Standard lightweight block OR 102 facing brick outer skin to match existing outer skin (refer to plan). 1:1:6 mortar mix. Class B eng brick with sulphate resisting cement below DPC. 100 cavity with 100 Knauf DrTherm-32 full fill insulation. Dryline internally with 52.5 Celotex PL4000 insulation backed plasterboard dot & dabbed to wall with 3 skim. Wall to achieve U-value of 0.18W/m2K. Fill cavity with weak mix concrete to 225mm below DPC. Stainless steel walls 750 horiz, 450 vert, & 300 at reveals. Join to existing building with furfix movement joint. Provide thermal expansion joint to external leaf on spans in excess of 6m. DPC to BS743 lapped to existing. Close cavity reveals with Thermablate insulated cavity closers. Render outer skin blockwork to match existing 2 x 10 coat 1:1:6 mix + waterproof additive BS5262 to blockwork. Stainless steel bell drip at DPC level. Bi-fold doors to have Catnic CXL290 with 200 min bearings. Other openings to have Catnic CG90/100 lintels. 150 min bearings.

**INTERNAL BLOCKWORK PARTITIONS**

100 Celcon Standard lightweight block (K=0.15 W/m2K). 1:1:6 mortar mix. Class B eng brick with sulphate resisting cement below DPC. Bond into new external walls. Join to existing building with furfix movement joint. DPC to BS743 lapped to existing.

**STEELWORK**

Beams to be clad with 12.5 fireline plasterboard + skim to provide 30 min fire rating. Alternatively steelwork to be painted with intumescent paint by suitably trained person to approval of building inspector on site.

**INTERNAL PARTITIONS**

75x50 stud. 1981x762 doorways. Lay DPC under sole plates where on concrete ground floor. All partitions to contain 75 acoustic quilt. Clad partitions with 12.5 soundblock + 3 skim each side.

**PITCHED FRONT ROOF**

100x50 C16 rafters at 400 cts Spiked & B-mouthed to wall plate. 150x50 header beam supported on vertical 100x50 uprights @ 800cts. Clad upstand with 18 WBP ply dressed in felt. Tyvek breathable membrane, 19x38 battens, 5x30 MS anchor straps at 1200 max cts screed fixed at three points to both roof structure and wall. Roof tiles to match existing. Pitch to match existing. 300 fibreglass quilt laid between joists & over joists. Ventilation not required. 9 plasterb+ 3 skim to underside of joists. New hip & ridge tiles to be bedded on mortar in addition to a mechanical fixing

**FLAT ROOF (WARM DECK CONSTRUCTION)**

175x50 C24 joists at 400 cts on steel joist hangers. 5x30 MS anchor straps at 2000 max cts. 1 in 40 firrings. 12 WBP ply. Bond vapour control layer to ply (Alutrix 600 or similar). Fully bond 150mm Celotex GA4000 to VCL. 18 OSB. Loose laying layer. 3 layer felt to BS747 hot bonded to OSB decking. Ceiling 9 plasterboard + skim. Roof to achieve U-value of 0.15W/m2K.

**ROOFLIGHTS - FLAT ROOFS**

Install with manufacturers upstand/flashings kit and all to manufacturers instructions. Doubled up joists and trimmers around side extension rooflights. Triple joists and trimmers around rear extension rooflights. Bolt together with M12 bolts @ 600cts.

**VENTILATION**

Windows/doors to match existing & provide vent of min 1/20 floor area & built in adjustable 8000mm<sup>2</sup> min vent. Open plan kitchen diners to have 3x800mm<sup>2</sup> vents. Install power vent to kitchen to achieve 30 litres/sec if over a cooker or 60 litres/sec if elsewhere. Utility room to achieve 30 litres/sec. WC/Bath/shower room to achieve 1.5 litres/sec and be connected to light switch with 15 min overrun. Vent to be ducted at ceiling level to outside air.

**DRAINS**

Clay 100 dia pipe laid in 150 pea shingle to fall min 1 in 40. Inspection chambers 150 concrete base, 215 shaft of engineering bricks type B flat pointed. Clay fittings in 1:3 mortar bedding. 600x450 steel frame & cover. Drains shown on drawings are estimated and are to be confirmed on site before any work commences.

**SURFACE WATER**

112 dia PVC gutters. 68 dia PVC downpipes connected to soakaway minimum 5 metres from any building. Volume of 1 cubic metre per 16.5 square metres of roof area served. Fill with hardcore.

**ABUTMENTS**

All exterior abutments to have code 4 lead min 150 flashing let into brickwork or blockwork.

**WINDOWS & DOORS**

Double glazed with 16 air gap and soft low E coating. Built in 8000mm<sup>2</sup> adjustable vent. Windows & doors to achieve U value of 1.4 w/m2K. All glass below 800mm, glass in doors or within 300mm of a door to be toughened safety glass.

**ABOVE GROUND DRAINAGE AND PLUMBING**

Sink, bath & shower to have 40 dia waste. Basin with 32 dia waste. All with 75 D/S traps & rodding access at bends. WC with 110 dia waste. Plumbing to comply with British Standards. Air admittance valves (Duro) to be installed above level of highest fitting that it serves. SVPs to vent 900 above any openable window within 3m. Wholesome water (ie water provided by statutory water supplier via a compliant water supply installation) to be provided to all taps.

**ELECTRICAL WORK**

All electrical work required to meet the requirements of Part P (Electrical Safety). Must be designed, installed, inspected & tested by a person competent to do so. Prior to completion the council should be satisfied the Part P has been complied with. This may require an appropriate BS7671 electrical installation certificate to be issued for the work by a person competent to do so. New light fittings to have LED bulbs. Electrical switches and sockets to be installed between 450mm and 1200mm from floor level where practical.

**HEATING**

New radiators to be fitted with thermostatic valves. Work to gas pipework, boilers & appliances to be carried out, tested and certified by Gas Safe registered person.