


PROPOSED FRONT ELEVATION
SCALE 1:100


PROPOSED SIDE ELEVATION
SCALE 1:100

PROPOSED REAR ELEVATION
SCALE 1:100


PROPOSED SIDE ELEVATION
SCALE 1:100

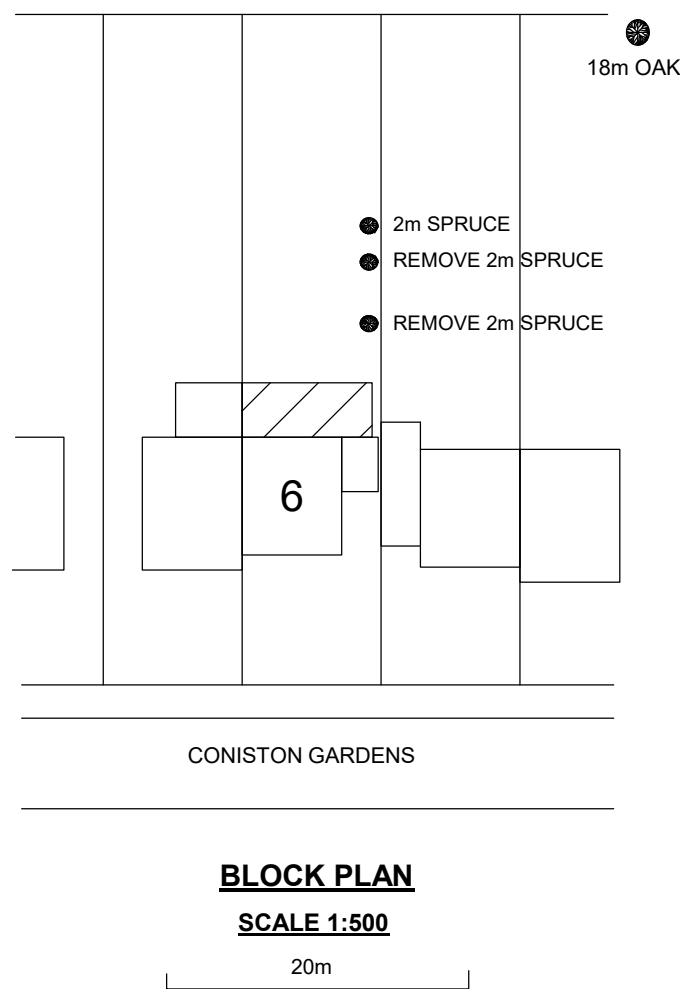


BLOCK PLAN
SCALE 1:500

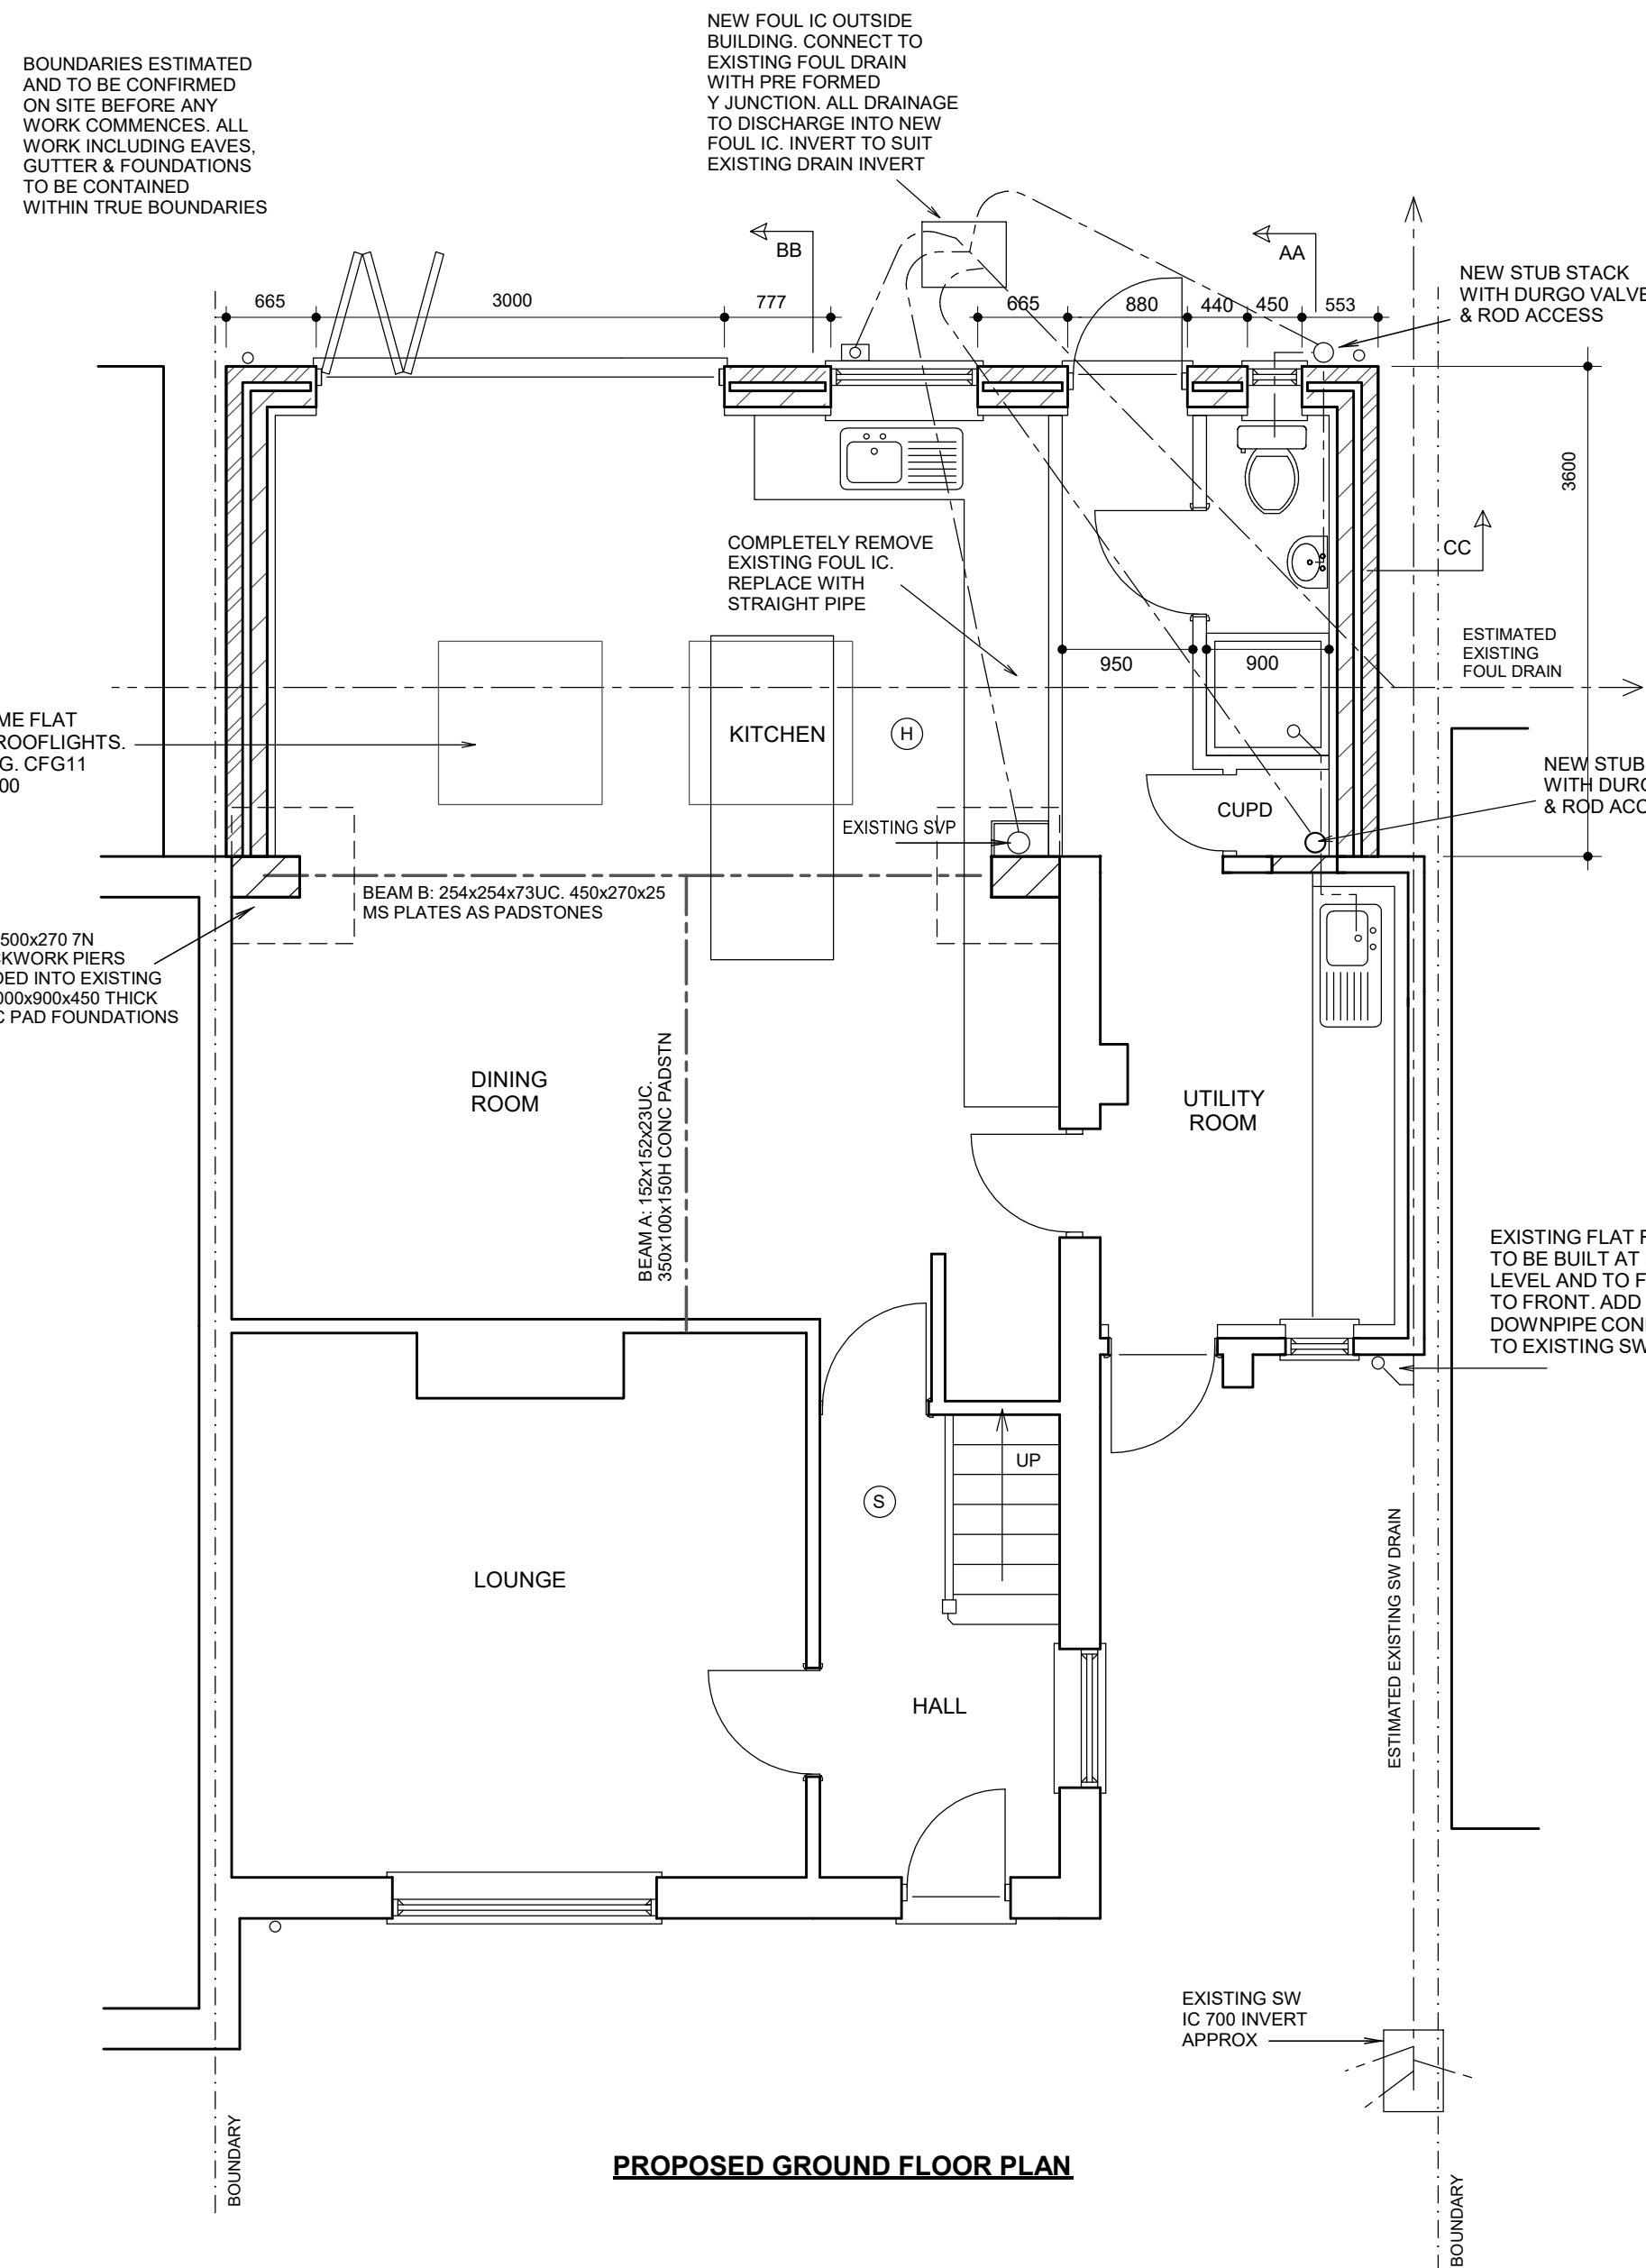


PROPOSED GROUND FLOOR PLAN

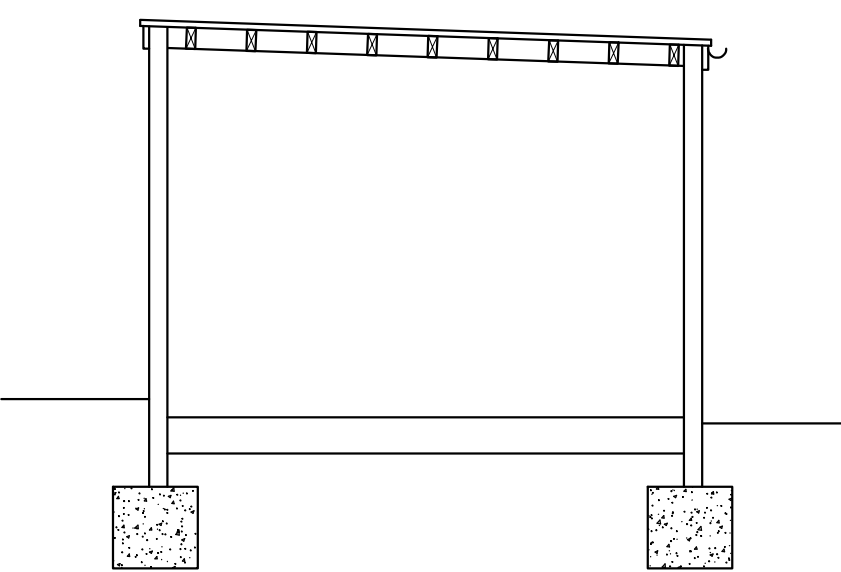


EXISTING SECTION AA

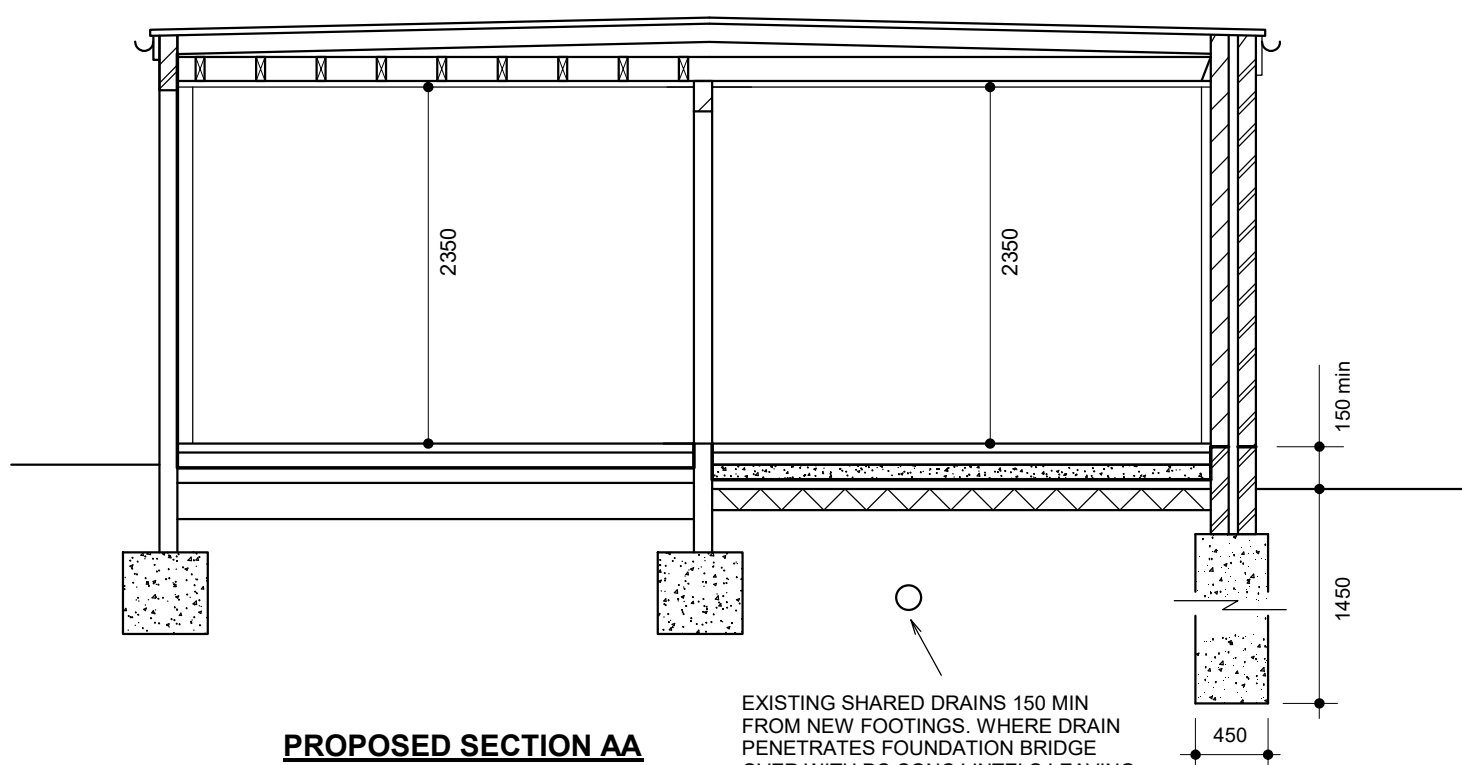

PROPOSED SECTION AA

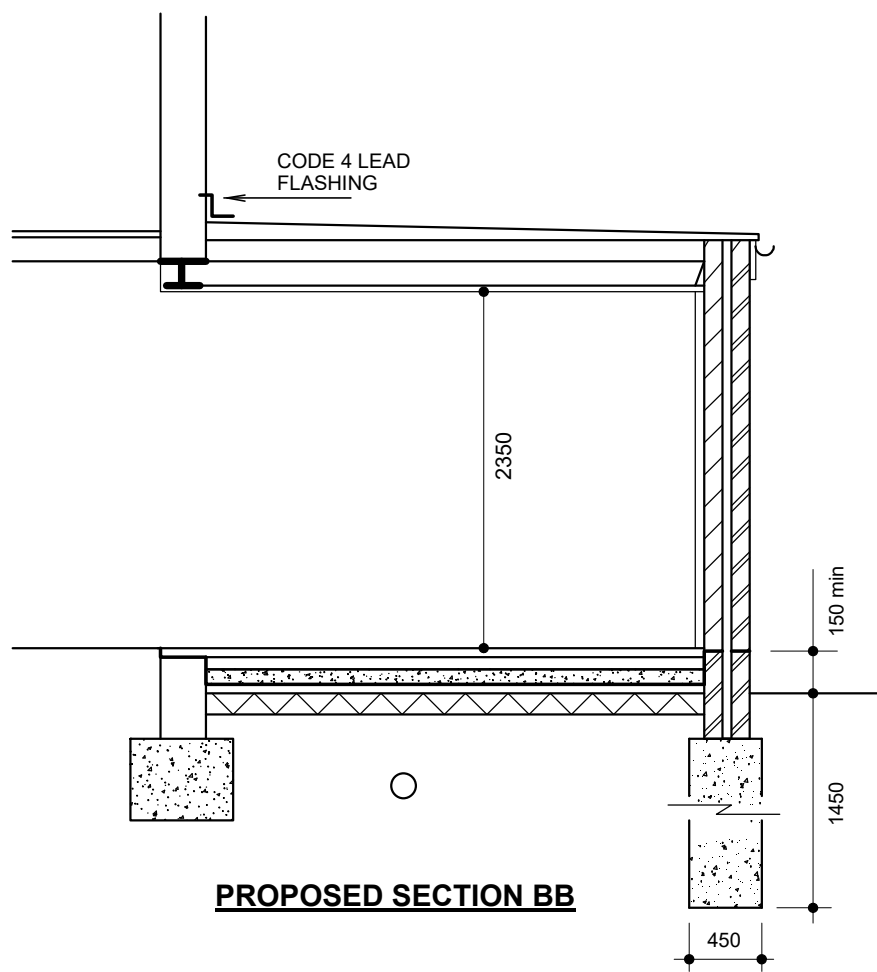

PROPOSED SECTION BB

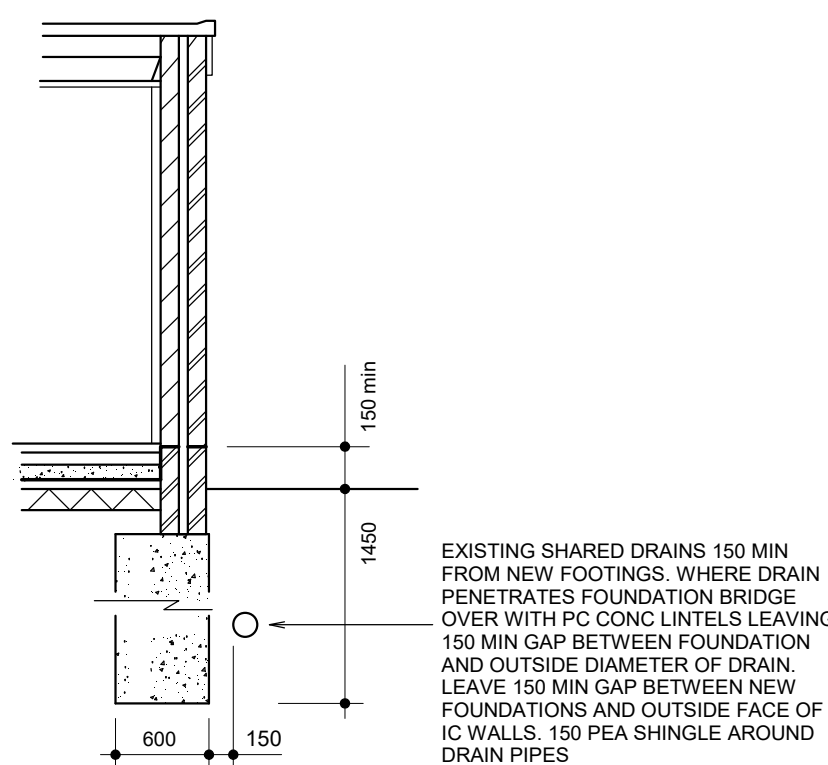

PROPOSED SECTION CC

NOTE:

FOUNDATIONS ESTIMATED AND TO BE CONFIRMED ON SITE BASED ON SITE CONDITIONS BY BUILDING INSPECTOR. PROVISIONAL DEPTHS AS SECTIONS UNLESS NOTED OTHERWISE ON PLAN. TREE SPECIES TO BE CONFIRMED ON SITE BEFORE ANY WORK COMMENCES. FOOTINGS TO BE 600 BELOW LOWEST ROOT ACTIVITY AND BELOW ANY ADJACENT DRAIN. 75 CLAYMASTER TO BE PROVIDED TO FOUNDATION DEPTHS EXCEEDING 1.5m. DEPTHS MEASURED TO ORIGINAL GROUND LEVEL. NOT TO TOP OF BUILT UP GROUND

BOUNDARIES ESTIMATED AND TO BE CONFIRMED ON SITE. ALL NEW WORKS TO BE CONTAINED WITHIN TRUE BOUNDARIES UNLESS STATED OTHERWISE ON PLAN. ALL NEW WORK TO COMPLY WITH CURRENT BUILDING REGULATIONS. DIMENSIONS IN MILLIMETRES AND TO BE CONFIRMED ON SITE. ALL STEEL DIMENSIONS TO BE CONFIRMED ON SITE AND NOT BE TAKEN FROM STRUCTURAL CALCULATIONS. ALL DRAINS & TREES ARE ESTIMATED AND ARE TO BE CHECKED & CONFIRMED ON SITE BEFORE ANY WORK COMMENCES. CLIENT TO SERVE PARTY WALL ACT NOTICE BEFORE WORK COMMENCES. ALL WORK TO BE CARRIED OUT & SUPERVISED BY COMPETENT OPERATIVES

DUE TO SURVEY LIMITATIONS EXISTING JOIST SPANS ASSUMED UNTIL CONFIRMED ON SITE. ALL WALLS & PARTITIONS TO BE CONSIDERED LOADBEARING UNTIL OPENED UP ON SITE AND CHECKED BY COMPETENT PERSON TO CONFIRM OTHERWISE. MUST BE CONFIRMED BEFORE ANY WORK COMMENCES. IF STRUCTURAL ENGINEERS DESIGN RELATING TO STRUCTURAL ELEMENTS CONTRADICTS ARCHITECTURAL DRAWINGS/SEC - ENGINEERS DESIGN PREVAILS. THIS DRAWING IS FOR PLANNING & BUILDING REGULATION APPLICATION PURPOSES ONLY. BUILDER/CLIENT TO APPOINT CON CONSULTANT TO ENSURE WORKS COMPLY WITH CON REGULATIONS BEFORE WORK COMMENCES. SINCE WE HAVE NO ACCESS TO THE DEEDS OF THE PROPERTY IT IS THE RESPONSIBILITY OF THE CLIENT TO ENSURE THAT THE WORKS DO NOT CONTRAVENE ANY RESTRICTIVE COVENANTS CONTAINED IN THE DEEDS

GENERAL SPECIFICATION (unless noted otherwise on drawings or engineer's design)

FOUNDATIONS

Concrete deep strip 30 N/mm² strength sulphate resisting cement. Depth & width provisionally as plan but final depth & width to be agreed on site with building inspector. Drains running through foundations or under new walls to have 150 RC lintel over with 50 clearance. Foundations exceeding 1500 deep to have 75 claymaster to inside face kept 500 from bottom of excavation. Foundations dug next to neighbouring structures to be constructed in 'hit & miss' sequence. Excavate alternate bays not exceeding 1m long. Fill with concrete and dig next bay after concrete has fully set. Connect pins with M16 MS dowels. Any eccentrically loaded foundation to be 600mm wide with the outer face of wall 60 from foundation edge.

GROUND FLOOR – GROUND BEARING CONCRETE SLAB

Min 150 rammed hardcore blinded with 50 sand 1200 PVC DPM lapped to DPC. 100 concrete. 100 Celotex GA4000 insulation slab with staggered & taped joints. 75 screed. 500 gauge polythene separating layer between insulation & screed. All existing air vents ducted through 100 dia PVC pipe under DPC. Strip of insulation to perimeter of screed.

UPGRADE GROUND FLOOR TO EXISTING UTILITY ROOM

Retain existing concrete slab. Make up levels with sand. 1200 PVC DPM lapped to DPC. 100 Celotex GA4000 insulation slab with staggered & taped joints. 75 screed. All existing air vents ducted through 100 dia PVC pipe under DPC. Strip of insulation to perimeter of screed. Final level to match existing house.

UPGRADING OF EXISTING UTILITY ROOM EXTERNAL WALLS

Raise height with 102 brick to match to suit roof. Expose existing foundation to confirm adequate before any work starts. Raise window and doors as shown on plan. Dry line wall with 72.5 thick Celotex PL4000 insulation backed plasterboard fixed to 47x47 battens on 1200 gauge DPM sheet. Additional 40 Celotex TB4000 between battens. 3 skim. Wall to achieve U-value of 0.18W/m2K.

NEW EXTERNAL CAVITY WALLS WITH FACING BRICK OUTER SKIN

Cavity wall of 100 Celcon Standard lightweight block (K=0.15 W/m2K) inner skin. 102 facing brick outer skin to match existing outer skin. 1:1:6 mortar mix. Class B eng brick with sulphate resisting cement below DPC. 100 cavity with 100 Knauf DrTherm-32 full fill insulation. Dryline internally with 52.5 Celotex PL4000 insulation backed plasterboard dot & dabbed to wall with 3 skim. Wall to achieve U-value of 0.18W/m2K. Fill cavity with weak mix concrete to 225mm below DPC. Stainless wall ties (225 long) 750 horiz, 450 vert & 300 at reveals. Join to existing building with furlex movement joint. Provide thermalite expansion joint to external leaf on spans in excess of 6m. DPC to BS743 lapped to existing. Close cavity reveals with Thermabate insulated cavity closers. Bifold doors to have Catmic CX90/100 with 200 min bearings. Other openings to have Catmic CG90/100 lintels. 150 min bearings.

STEELWORK

Beams to be clad with 12.5 fireline plasterboard + skim to provide 30 min fire rating. Alternatively steelwork to be painted with intumescent paint by suitably trained person to approval of building inspector on site.

INTERNAL PARTITIONS

75x50 stud. Lay DPC under sole plates where on concrete ground floor. All partitions to contain 75 acoustic quilt. Clad partitions with 12.5 soundblock + 3 skim each side.

FLAT ROOF (WARM DECK CONSTRUCTION)

175x50 C16 joists at 400 cts on steel joist hangers. 5x30 MS anchor straps at 2000 max cts. 1 in 40 firrings. 12 WBP ply. Bond vapour control layer to ply (Alutrix 600 or similar). Fully bond 150mm Celotex GA4000 to VCL. 18 OSB. Loose lay venting layer. 3 layer felt to BS747 hot bonded to OSB decking. Ceiling 9 plasterboard + skim. Roof to achieve U-value of 0.15W/m2K. Roof covering to achieve AA, AB or AC surface spread of flame rating.

ROOFLIGHTS – FLAT ROOFS

Install with manufacturers upstand/flushing kit and all to manufacturers instructions. Doubled up joists and trimmers around opening to be bolted together with M12 bolts @ 600cts.

VENTILATION

Windows/doors to match existing & provide vent of min 1/20 floor area & built in adjustable 8000mm² min vent. Open plan kitchen diners to have 3x8000mm² vents. Install power vent to kitchen to achieve 30 litres/sec if over a cooker or 60 litres/sec if elsewhere. Utility room to achieve 30 litres/sec. WC/shower room to achieve 15 litres/sec and be connected to light switch with 15 min overrun. Vent to be ducted at ceiling level to outside air.

DRAINS

Clay 100 dia pipe laid in 150 pea shingle to fall min 1 in 40. Inspection chambers 150 concrete base. 215 shaft of engineering bricks type B flat pointed. Clay fittings in 1:3 mortar benching. 600x450 steel frame & cover. Drains shown on drawings are estimated and are to be confirmed on site before any work commences.

SURFACE WATER

112 dia PVC gutters. 68 dia PVC downpipes. Surface water downpipes connected to soakaway minimum 5 metres from any building. Volume of 1 cubic metre per 16.5 square metres of roof area served. Fill with hardcore. If clay found use crate system soakaway.

ABUTMENTS

All exterior abutments to have code 4 lead min 150 flashing let into brickwork or blockwork.

WINDOWS & DOORS

Double glazed with 16 air gap and soft low E coating. Built in 8000mm² adjustable vent. Windows & doors to achieve U value of 1.4 w/m2K. All glass below 800mm, glass in doors or within 300mm of a door to be toughened safety glass.

ABOVE GROUND DRAINAGE AND PLUMBING

Sink, bath & shower to have 40 dia waste. Basin with 32 dia waste. All with 75 D/S traps & rodding access at bends. WC with 110 dia waste. Plumbing to comply with British Standards. Air admittance valves (Durgo) to be installed above level of highest fitting that it serves. SVPs to vent 900 above any openable window within 3m. Wholesome water (ie water provided by statutory water supplier via a compliant water supply installation) to be provided to all taps. Baths & shower taps to be thermostatically controlled to ensure water does not exceed 48 deg C

ELECTRICAL WORK

All electrical work required to meet the requirements of Part P (Electrical Safety). Must be designed, installed, inspected & tested by a person competent to do so. Prior to completion the council should be satisfied the Part P has been complied with. This may require an appropriate BS7671 electrical installation certificate to be issued for the work by a person competent to do so. New light fittings to have LED bulbs. Electrical switches and sockets to be installed between 450mm and 1200mm from floor level where practical.

HEATING

New radiators to be fitted with thermostatic valves. Work to gas pipework, boilers & appliances to be carried out, tested and certified by Gas Safe registered person.

- (S) SELF CONTAINED MAINS OPERATED INTERLINKED OPTICAL SMOKE DETECTOR SYSTEM IN ACCORDANCE WITH BS5839 OR BS5446. ALARMS TO HAVE BATTERY BACK UP. DETECTORS 300mm FROM WALLS
- (H) HEAT DETECTOR INTERLINKED WITH SMOKE DETECTORS

6 CONISTON GARDENS EASTCOTE PINNER MIDDX HA5 2JL

SINGLE STOREY EXTENSION

SCALE 1:50 / 1:100 @ A1

MAY 2023

DRG No. 2373.2

JAMES RUSH ASSOCIATES LTD

54 JOINERS LANE CHALFONT ST PETER
BUCKINGHAMSHIRE SL9 0AT TEL: 01923 775 761
EMAIL: jamesvrush@hotmail.com

© COPYRIGHT JAMES RUSH ASSOCIATES LTD

10.00 METRES @ 1:100

5.00 METRES @ 1:50