

FOUNDATIONS: Min. 1.0m below lowest ground level or to level of adjacent drains, whichever is deeper. To be below any roots by 0.6m. All depths in accordance with NHBC prac. note 3

DRAINAGE: All new & existing drains to be encased in 150mm concrete and bridged by RC lintels where passing through walls/foundations. All new drains to be bedded in 150mm pea shingle.

EXTERNAL WALLS: 100mm block external skin (112mm brick where face brick finish), 150mm Dritherm cavity batts and inner skin of 100mm thermalite turbo blocks (1:1:6 mortar). Insert galv. wall ties @ 450mm CRS vertically and 900mm CRS horizontally and at every block at reveals to all openings and at floor level @ min. of 150mm above g.l. and lapped into existing DPC.

VENTILATION: Provide min. ventilation opening to all rooms of 1/20th of floor area.

STEELWORK: Provide half hour fire protection to all new steel beams with 2 layers of 12.5mm

FLOOR: new suspended timber floor with 150mm Celotex insulation between 50*200mm floor joists with 22mm T&G flooring. Min sub floor void 150mm below underside of new floor joists to top of 100mm concrete oversite on 150mm hardcore

PITCHED ROOF: 50 x 150mm rafters @ 400mm CRS with 19 x 38mm tanned roofing battens on roofing felt.

Provide 150mm Celotex insulation between ceiling joists and provide continuous Glidevale strip vents in soffit for ventilation of new pitched roof

provide min. background ventilation of 1/20th floor area by means of trickle vent in window 8,000 sq. mm
Holding down straps to wall plate 30x5mm ms restraint straps 1m long @ max 1.8mtr ctrs

Provide mechanical extractor fan to new shower room with min. 15 litres/sec extraction with 15 minute o/run, extracted to external air

Wall cavity to be 150mm with stainless steel wall ties
Lintels over all new openings to be Catnic or similar
All brickwork below DPC to be in semi engineering brick with SR cement
all bath, sink, shower wastes to be 38mm waste pipes with 38mm deep seal traps or 50mm waste pipes with 50mm traps where combined
provide rodding access in waste pipes at bends/changes of direction

bathrooms to have 4000mm² background ventilation & extractor fan with 15 litres per second with 15 minute over run
Provide mechanical ventilation to kitchen area with min. 60 litres/sec extraction ducted to external air(30 l/s in cooker hood)


All electrical installations required to meet requirements of Part P (Electrical Safety) must be designed, installed inspected & tested by a person competent to do so
Prior to completion the council should be satisfied that Part P has been complied with.
This may require an appropriate BS 7671 electrical installation certificate to be issued for the work by a person competent to do so

new foundation stopped at min 150mm from outer edges of drain & bridged over with 2No. 65x100mm pc conc lintels to support the two 100mm walls
Provide background ventilation of min. 8,000 sq.mm by trickle vents in window

PITCHED ROOF: 50 x 150mm rafters @ 400mm CRS with 19 x 38mm tanned roofing battens on roofing felt.

Provide 150mm Celotex insulation between ceiling joists and provide continuous

Glidevale strip vents in soffit for ventilation of new pitched roof

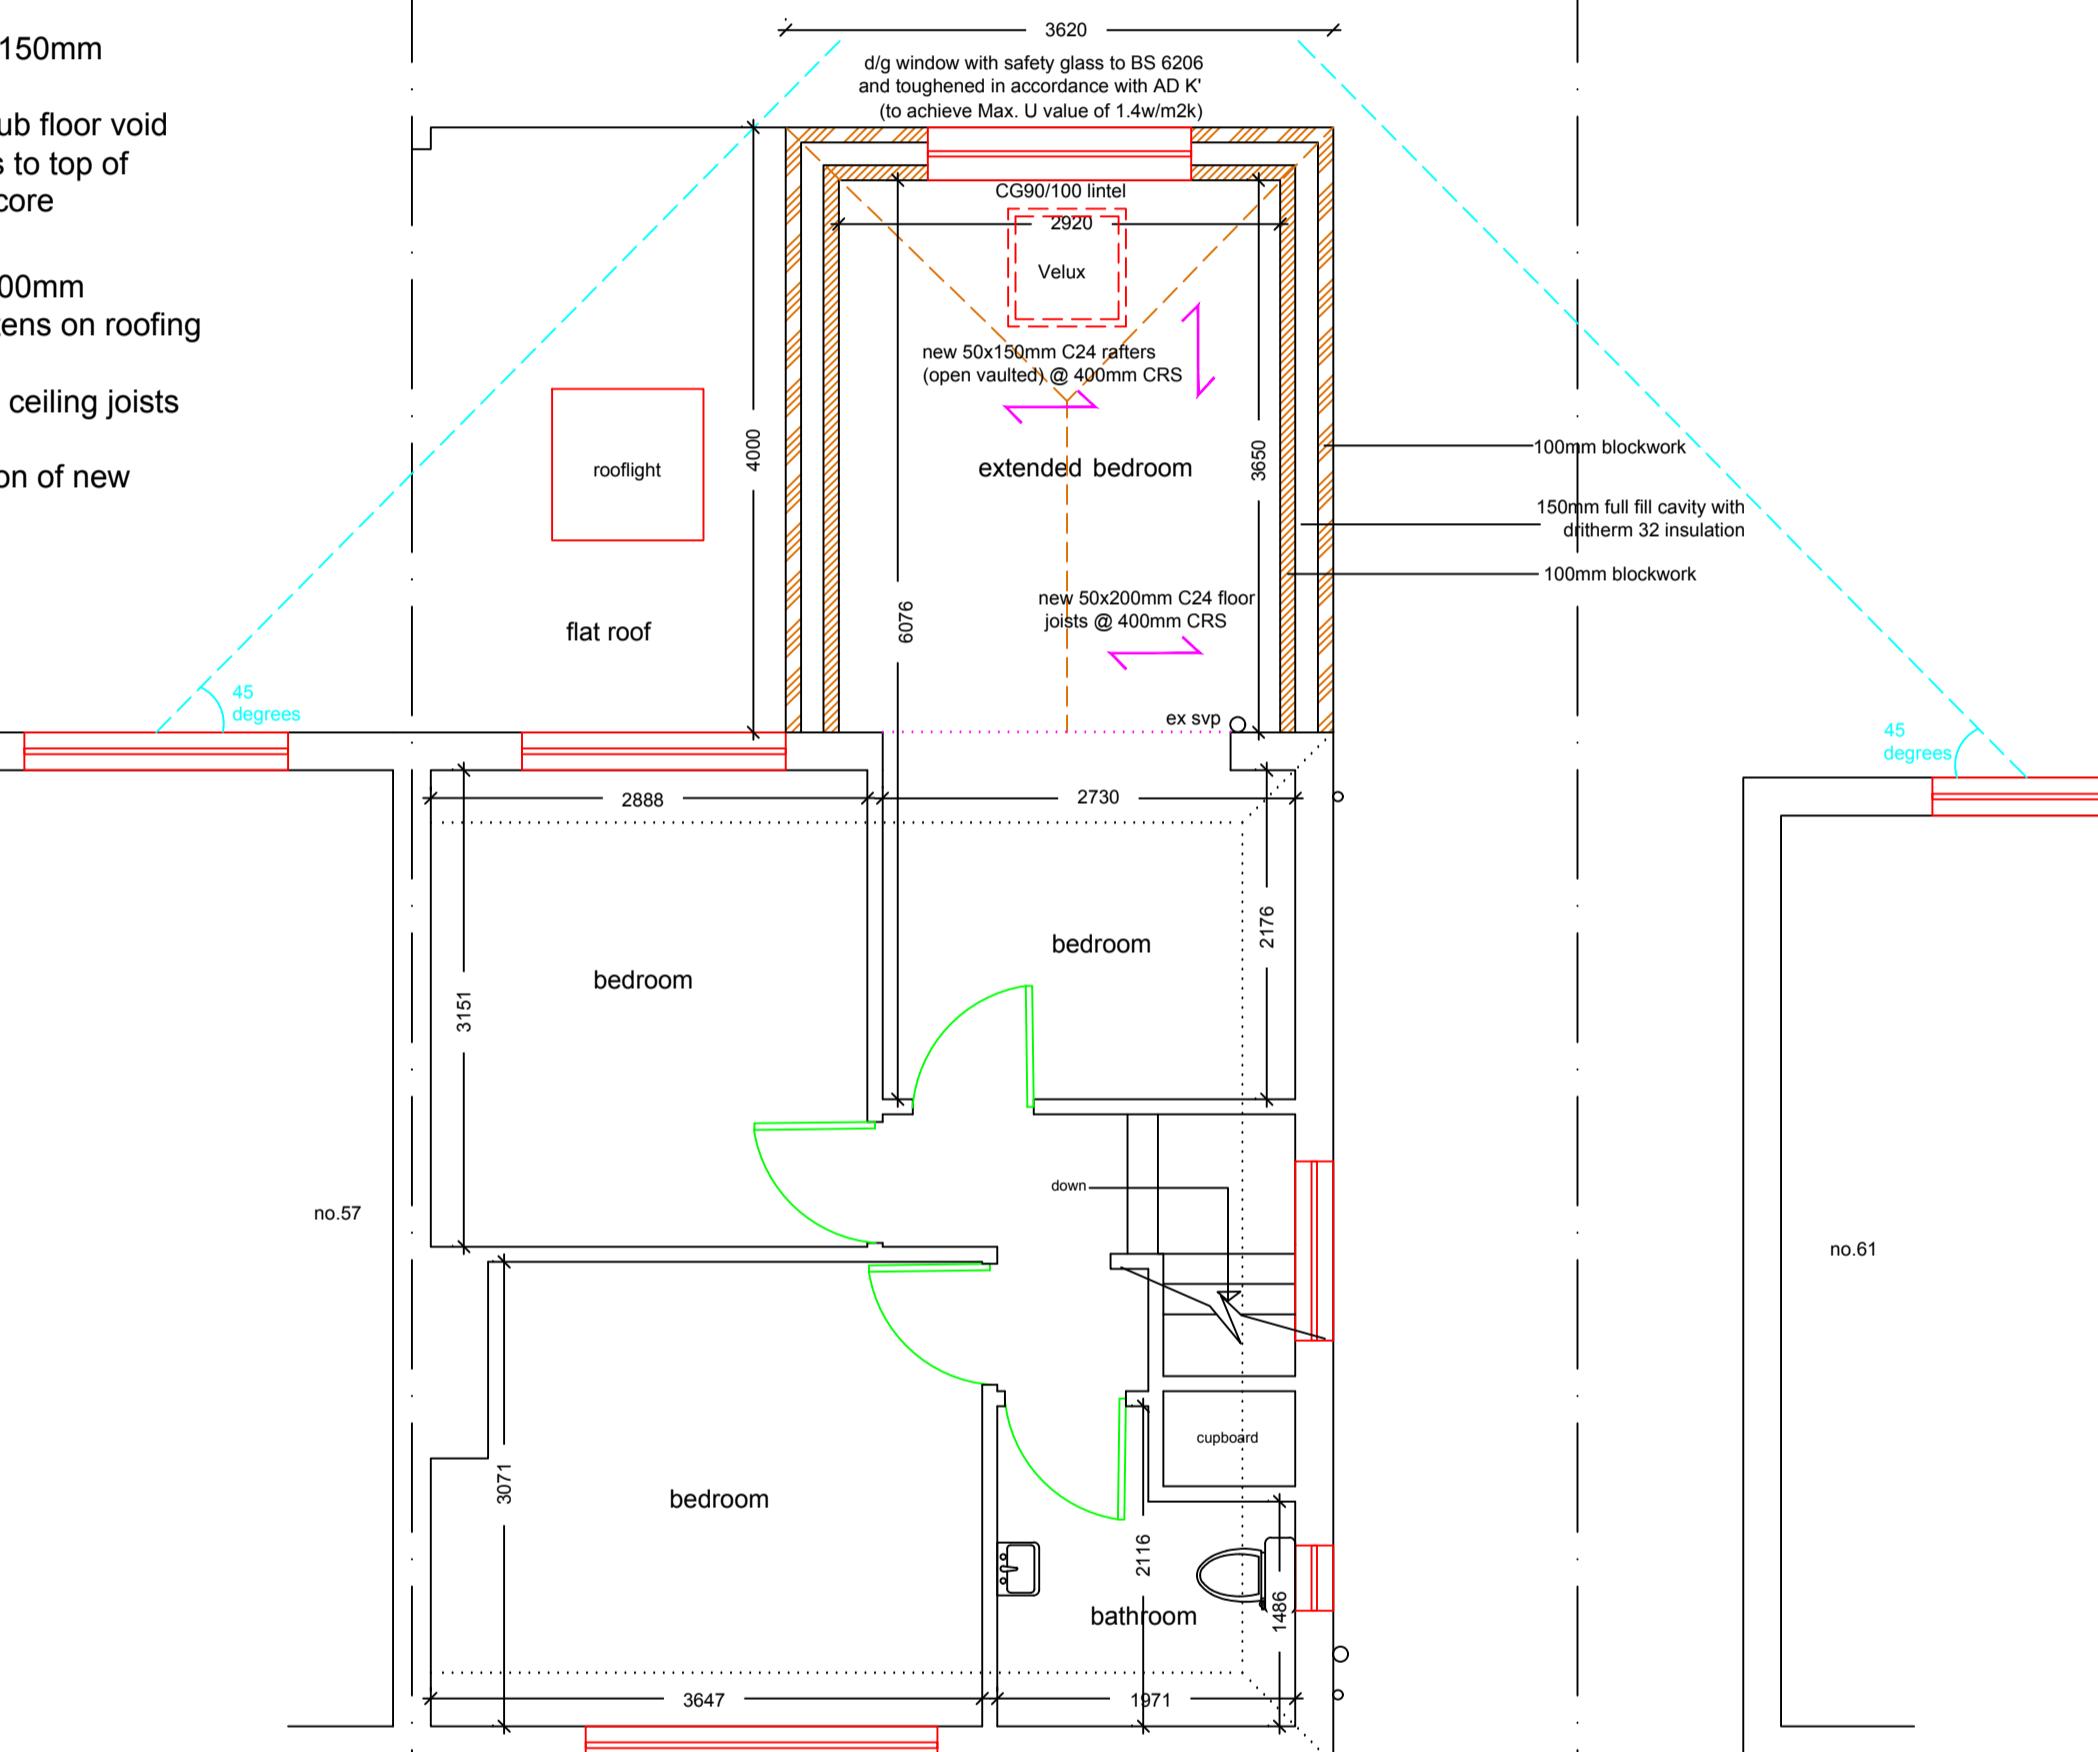

1. Proposed foundations min depth 1.0m & 500mm wide or 600mm wide for eccentrically loaded foundations

2. RW to connect to ex surface water system if available or soakaway @ 5m away if no sw drain available (6m in clay soil) (100mm upvc u/ground drain @ 1:40 fall to soakaway min. 1m x 1mx 1m deep with hardcore backfill for adequate rainfall of rainwater, & top soil over)

3. Wall cavity to be 150mm with stainless steel wall ties

4. D/glazed windows to achieve min U value of 1.4 W/m²K

5. Energy efficient lighting to be provided in acc. with AD 'L'

6. All new drainage in 100mm upvc bedded in 150mm pea shingle all around, 1:40 fall

7. Cavities to be closed with an insulated cavity closer (i.e. Thermabat)

8. Use 150mm Celotex floor insulation to achieve max. U value of 0.15W/m²K

9. Lintels over all new openings to be Catnic or similar

11. Ventilation to existing timber floor of house to be maintained with 150x225mm pvc air bricks in new extension ducted through new concrete floor to ex airbricks with min 100 sq. mm cross sectional area of ducting @ max 1.8 metre ctrs

12. SR cement to be used for all work below ground level & below DPC with semi engineering brick below dpc

13. DPC to be lapped into existing DPC of house & kept at 150mm above adjacent ground level

14. Foundation depths in accordance with current NHBC guide with 50mm claymaster on inner face of foundation where depth in excess of 1.5m

15. Foundation concrete to be min 1:2.4 mix with S.R. cement

16. DPM to be lapped into DPC's

17. New cavity wall to be connected to existing with Furfix wall connector

18. New roof to connect to cavity wall with 30x5mm m.s. restraint straps @ max. 1.8 mtr ctrs fixed to wall plate

N.B. FW drain run to be checked & agreed with L.A. building inspector
Rainwater to drain into existing surface water system or into soak away if this is not possible.
Soakaway to be min 1 cu.mtr at min 5m away from building or 6m in clay soils
new soakaway 1m3 for every 20m² of roof area to be drained, therefore soakaway min 1m3

Heating controls to any extension of existing heating system to be in accordance with A.D. part L, i.e. all new radiators to have TRV's, boiler to be operated by a full programmer to enable heating & hot water operations to be timed independently

SEDBUK 2009 seasonal efficiency rating of any proposed boiler to be greater than 88%

General Notes

Drg. No.	PLA/0103/A
Planning A	06/06/24
No.	Revision/Issue

Firm Name and Address
Middlesex & Herts 7 Elgin Drive Northwood Middlesex HA6 2YR 01923 826280

Project Name and Address
Mr and Mrs Gora 59 Whitemorn Avenue Viewley West Drayton Middlesex UB7 8JZ

Project Single storey rear & part first floor rear extension
Date 14-04-24
Scale 1:50

Sheet
02A