


The Star, Uxbridge Road,  
Uxbridge,  
UB10 0LY

Dwelling type: House, Semi-Detached  
Date of assessment: 08/04/2022  
Produced by: Paul Whiffin  
Total floor area: 128.11 m<sup>2</sup>

This document is a Predicted Energy Assessment for properties marketed when they are incomplete. It includes a predicted energy rating which might not represent the final energy rating of the property on completion. Once the property is completed, this rating will be updated and an official Energy Performance Certificate will be created for the property. This will include more detailed information about the energy performance of the completed property.

The energy performance has been assessed using the Government approved SAP2012 methodology and is rated in terms of the energy use per square meter of floor area; the energy efficiency is based on fuel costs and the environmental impact is based on carbon dioxide (CO<sub>2</sub>) emissions.

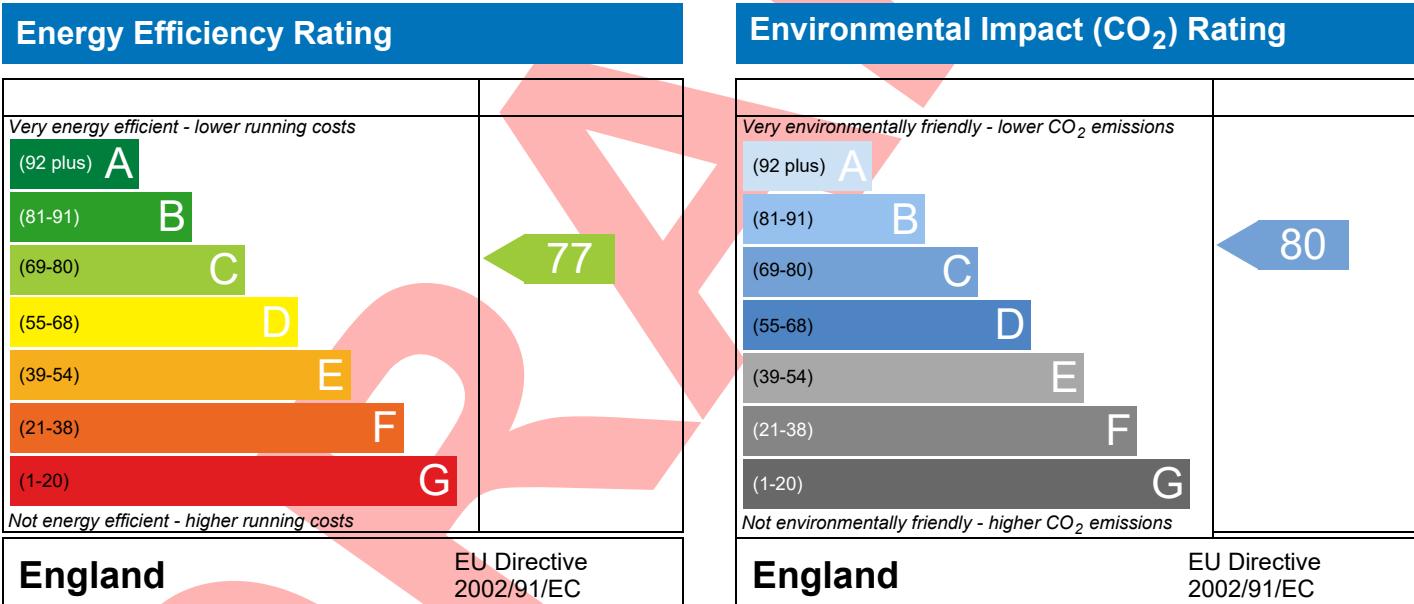

The energy efficiency rating is a measure of the overall efficiency of a home. The higher the rating the more energy efficient the home is and the lower the fuel bills are likely to be.

The environmental impact rating is a measure of a home's impact on the environment in terms of carbon dioxide (CO<sub>2</sub>) emissions. The higher the rating the less impact it has on the environment.

*This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.*

# BUILDING REGULATION COMPLIANCE

## Calculation Type: New Build (As Designed)

Property Reference	Q-03466 H.01	Issued on Date	08/04/2022
Assessment Reference	Design V1	Prop Type Ref	New Build
Property	The Star, Uxbridge Road, Uxbridge, UB10 0LY		
SAP Rating	77 C	DER	23.29
Environmental	80 C	% DER<TER	1.50
CO <sub>2</sub> Emissions (t/year)	2.38	DFEE	42.13
General Requirements Compliance	Pass	% DFEE<TFEE	23.15

Assessor Details	Mr. Paul Whiffin, Paul Whiffin, Tel: 01763 268685, pw@atspaceltd.co.uk	Assessor ID	y314-0001
Client	Harjeet Suri, 33244		

### SUMMARY FOR INPUT DATA FOR New Build (As Designed)

#### Criterion 1 – Achieving the TER and TFEE rate

##### 1a TER and DER

Fuel for main heating	Electricity	
Fuel factor	1.55 (electricity)	
Target Carbon Dioxide Emission Rate (TER)	23.65	kgCO <sub>2</sub> /m <sup>2</sup>
Dwelling Carbon Dioxide Emission Rate (DER)	23.29	kgCO <sub>2</sub> /m <sup>2</sup>
	-0.36 (-1.5%)	kgCO <sub>2</sub> /m <sup>2</sup>

##### 1b TFEE and DFEE

Target Fabric Energy Efficiency (TFEE)	54.81	kWh/m <sup>2</sup> /yr
Dwelling Fabric Energy Efficiency (DFEE)	42.13	kWh/m <sup>2</sup> /yr
	-12.7 (-23.2%)	kWh/m <sup>2</sup> /yr

#### Criterion 2 – Limits on design flexibility

##### Limiting Fabric Standards

##### 2 Fabric U-values

Element	Average	Highest	
External wall	0.21 (max. 0.30)	0.24 (max. 0.70)	Pass
Party wall	0.00 (max. 0.20)	-	Pass
Floor	0.15 (max. 0.25)	0.15 (max. 0.70)	Pass
Roof	0.14 (max. 0.20)	0.16 (max. 0.35)	Pass
Openings	1.20 (max. 2.00)	1.20 (max. 3.30)	Pass

##### 2a Thermal bridging

Thermal bridging calculated from linear thermal transmittances for each junction

##### 3 Air permeability

Air permeability at 50 pascals	3.00 (design value)	m <sup>3</sup> /(h.m <sup>2</sup> ) @ 50 Pa
Maximum	10.0	m <sup>3</sup> /(h.m <sup>2</sup> ) @ 50 Pa

##### Limiting System Efficiencies

##### 4 Heating efficiency

Main heating system	Boiler system with radiators or underfloor - Electric Direct-acting boiler	
---------------------	---	--

This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.

# BUILDING REGULATION COMPLIANCE

## Calculation Type: New Build (As Designed)

Secondary heating system

None

### 5 Cylinder insulation

Hot water storage

Measured cylinder loss: 1.90 kWh/day  
Permitted by DBSCG 2.24

Pass

Primary pipework insulated

No primary pipework

### 6 Controls

Space heating controls

Time and temperature zone control

Pass

Hot water controls

Cylinderstat

Pass

### 7 Low energy lights

Percentage of fixed lights with low-energy fittings

100 %

Minimum

75 %

Pass

### 8 Mechanical ventilation

Continuous supply and extract system

Specific fan power

0.62

Maximum

1.5

Pass

MVHR efficiency

94 %

Minimum

70 %

Pass

## Criterion 3 – Limiting the effects of heat gains in summer

### 9 Summertime temperature

Overheating risk (Thames Valley)

Slight

Pass

Based on:

Overshading

Average

Windows facing South East

16.82 m<sup>2</sup>, No overhang

Windows facing North West

19.32 m<sup>2</sup>, No overhang

Air change rate

6.00 ach

Blinds/curtains

None

## Criterion 4 – Building performance consistent with DER and DFEE rate

### Party Walls

Type

U-value

Filled Cavity with Edge Sealing

0.00 W/m<sup>2</sup>K

Pass

### Air permeability and pressure testing

#### 3 Air permeability

Air permeability at 50 pascals

3.00 (design value) m<sup>3</sup>/(h.m<sup>2</sup>) @ 50 Pa

Maximum

10.0 m<sup>3</sup>/(h.m<sup>2</sup>) @ 50 Pa

Pass

### 10 Key features

External wall U-value

0.11 W/m<sup>2</sup>K

External wall U-value

0.14 W/m<sup>2</sup>K

Party wall U-value

0.00 W/m<sup>2</sup>K

Roof U-value

0.11 W/m<sup>2</sup>K

Thermal bridging y-value

0.037 W/m<sup>2</sup>K

Air permeability

3.0 m<sup>3</sup>/m<sup>2</sup>h


*This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.*

The Star, Uxbridge Road,  
Uxbridge,  
UB10 0LY

Dwelling type: House, Semi-Detached  
Date of assessment: 08/04/2022  
Produced by: Paul Whiffin  
Total floor area: 128.11 m<sup>2</sup>

This document is a Predicted Energy Assessment for properties marketed when they are incomplete. It includes a predicted energy rating which might not represent the final energy rating of the property on completion. Once the property is completed, this rating will be updated and an official Energy Performance Certificate will be created for the property. This will include more detailed information about the energy performance of the completed property.

The energy performance has been assessed using the Government approved SAP2012 methodology and is rated in terms of the energy use per square meter of floor area; the energy efficiency is based on fuel costs and the environmental impact is based on carbon dioxide (CO<sub>2</sub>) emissions.

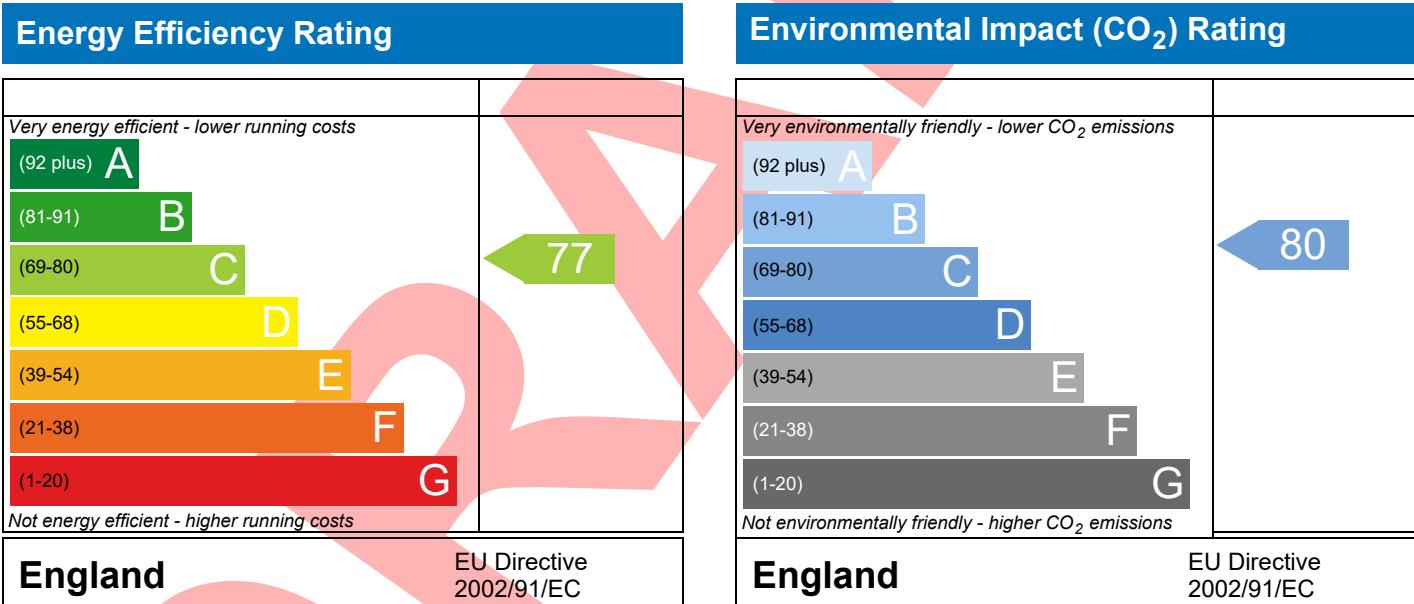

The energy efficiency rating is a measure of the overall efficiency of a home. The higher the rating the more energy efficient the home is and the lower the fuel bills are likely to be.

The environmental impact rating is a measure of a home's impact on the environment in terms of carbon dioxide (CO<sub>2</sub>) emissions. The higher the rating the less impact it has on the environment.

*This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.*

# BUILDING REGULATION COMPLIANCE

## Calculation Type: New Build (As Designed)

Property Reference	Q-03466 H.02	Issued on Date	08/04/2022
Assessment Reference	Design V1	Prop Type Ref	New Build
Property	The Star, Uxbridge Road, Uxbridge, UB10 0LY		
SAP Rating	77 C	DER	23.29
Environmental	80 C	% DER<TER	1.50
CO <sub>2</sub> Emissions (t/year)	2.38	DFEE	42.13
General Requirements Compliance	Pass	% DFEE<TFEE	23.15

Assessor Details	Mr. Paul Whiffin, Paul Whiffin, Tel: 01763 268685, pw@atspaceltd.co.uk	Assessor ID	y314-0001
Client	Harjeet Suri, 33244		

### SUMMARY FOR INPUT DATA FOR New Build (As Designed)

#### Criterion 1 – Achieving the TER and TFEE rate

##### 1a TER and DER

Fuel for main heating	Electricity	
Fuel factor	1.55 (electricity)	
Target Carbon Dioxide Emission Rate (TER)	23.65	kgCO <sub>2</sub> /m <sup>2</sup>
Dwelling Carbon Dioxide Emission Rate (DER)	23.29	kgCO <sub>2</sub> /m <sup>2</sup>
	-0.36 (-1.5%)	kgCO <sub>2</sub> /m <sup>2</sup>

##### 1b TFEE and DFEE

Target Fabric Energy Efficiency (TFEE)	54.81	kWh/m <sup>2</sup> /yr
Dwelling Fabric Energy Efficiency (DFEE)	42.13	kWh/m <sup>2</sup> /yr
	-12.7 (-23.2%)	kWh/m <sup>2</sup> /yr

#### Criterion 2 – Limits on design flexibility

##### Limiting Fabric Standards

##### 2 Fabric U-values

Element	Average	Highest	
External wall	0.21 (max. 0.30)	0.24 (max. 0.70)	Pass
Party wall	0.00 (max. 0.20)	-	Pass
Floor	0.15 (max. 0.25)	0.15 (max. 0.70)	Pass
Roof	0.14 (max. 0.20)	0.16 (max. 0.35)	Pass
Openings	1.20 (max. 2.00)	1.20 (max. 3.30)	Pass

##### 2a Thermal bridging

Thermal bridging calculated from linear thermal transmittances for each junction

##### 3 Air permeability

Air permeability at 50 pascals	3.00 (design value)	m <sup>3</sup> /(h.m <sup>2</sup> ) @ 50 Pa
Maximum	10.0	m <sup>3</sup> /(h.m <sup>2</sup> ) @ 50 Pa

##### Limiting System Efficiencies

##### 4 Heating efficiency

Main heating system	Boiler system with radiators or underfloor - Electric Direct-acting boiler	
---------------------	---	--

This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.

# BUILDING REGULATION COMPLIANCE

## Calculation Type: New Build (As Designed)

Secondary heating system

None

### 5 Cylinder insulation

Hot water storage

Measured cylinder loss: 1.90 kWh/day  
Permitted by DBSCG 2.24

Pass

Primary pipework insulated

No primary pipework

### 6 Controls

Space heating controls

Time and temperature zone control

Pass

Hot water controls

Cylinderstat

Pass

### 7 Low energy lights

Percentage of fixed lights with low-energy fittings

100 %

Minimum

75 %

Pass

### 8 Mechanical ventilation

Continuous supply and extract system

Specific fan power

0.62

Maximum

1.5

Pass

MVHR efficiency

94 %

Minimum

70 %

Pass

## Criterion 3 – Limiting the effects of heat gains in summer

### 9 Summertime temperature

Overheating risk (Thames Valley)

Slight

Pass

Based on:

Overshading

Average

Windows facing South East

16.82 m<sup>2</sup>, No overhang

Windows facing North West

19.32 m<sup>2</sup>, No overhang

Air change rate

6.00 ach

Blinds/curtains

None

## Criterion 4 – Building performance consistent with DER and DFEE rate

### Party Walls

Type

U-value

Filled Cavity with Edge Sealing

0.00 W/m<sup>2</sup>K

Pass

### Air permeability and pressure testing

#### 3 Air permeability

Air permeability at 50 pascals

3.00 (design value) m<sup>3</sup>/(h.m<sup>2</sup>) @ 50 Pa

Maximum

10.0 m<sup>3</sup>/(h.m<sup>2</sup>) @ 50 Pa

Pass

### 10 Key features

External wall U-value

0.11 W/m<sup>2</sup>K

External wall U-value

0.14 W/m<sup>2</sup>K

Party wall U-value

0.00 W/m<sup>2</sup>K

Roof U-value

0.11 W/m<sup>2</sup>K

Thermal bridging y-value

0.037 W/m<sup>2</sup>K

Air permeability

3.0 m<sup>3</sup>/m<sup>2</sup>h

*This report has not been submitted through the Elmhurst Energy members' portal, therefore results are subject to change when the dwelling is completed.*