




EXISTING GROUND FLOOR PLAN
1:50

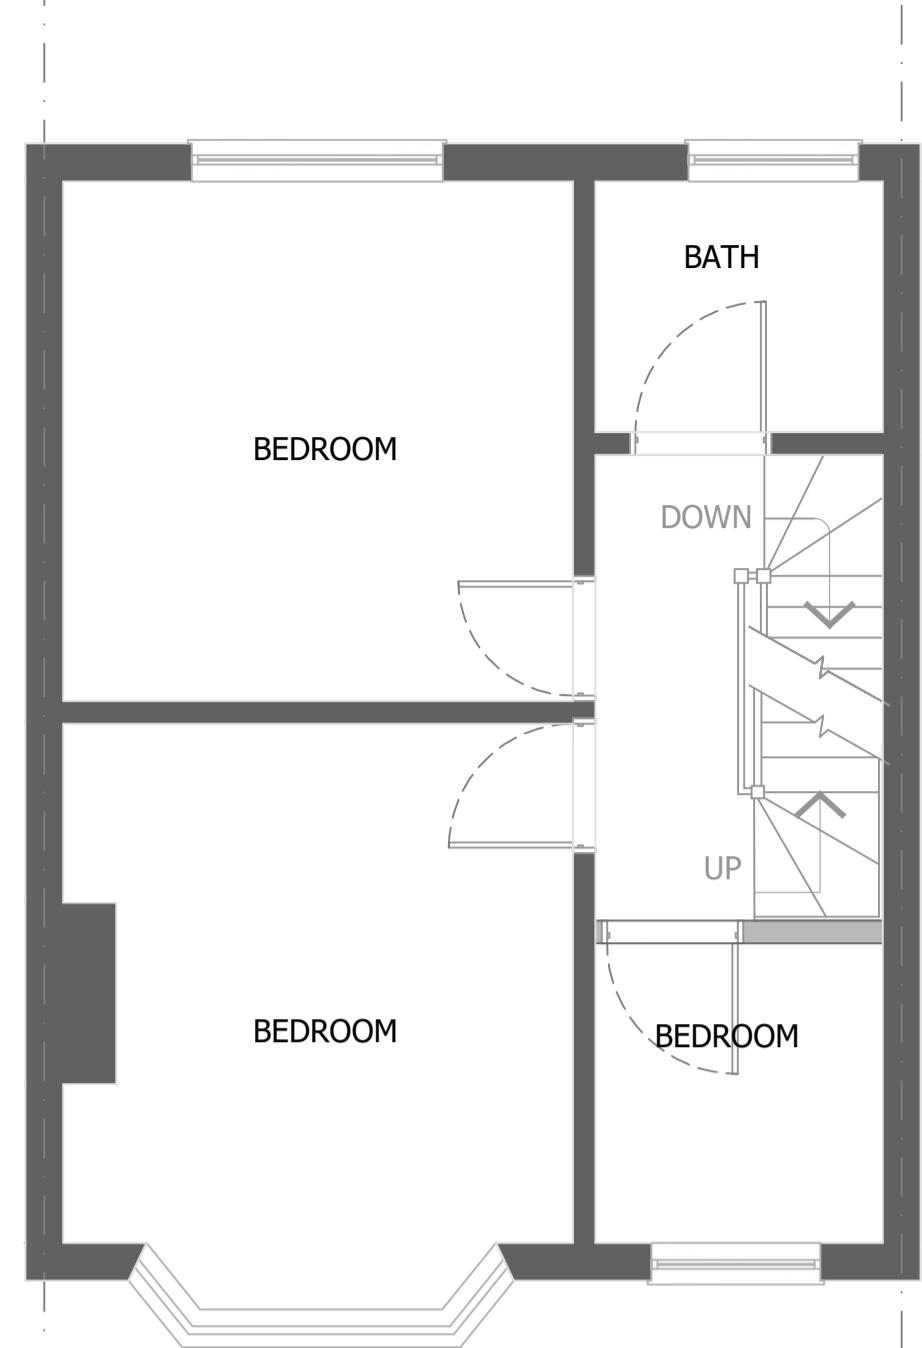

EXISTING FIRST FLOOR PLAN
1:50

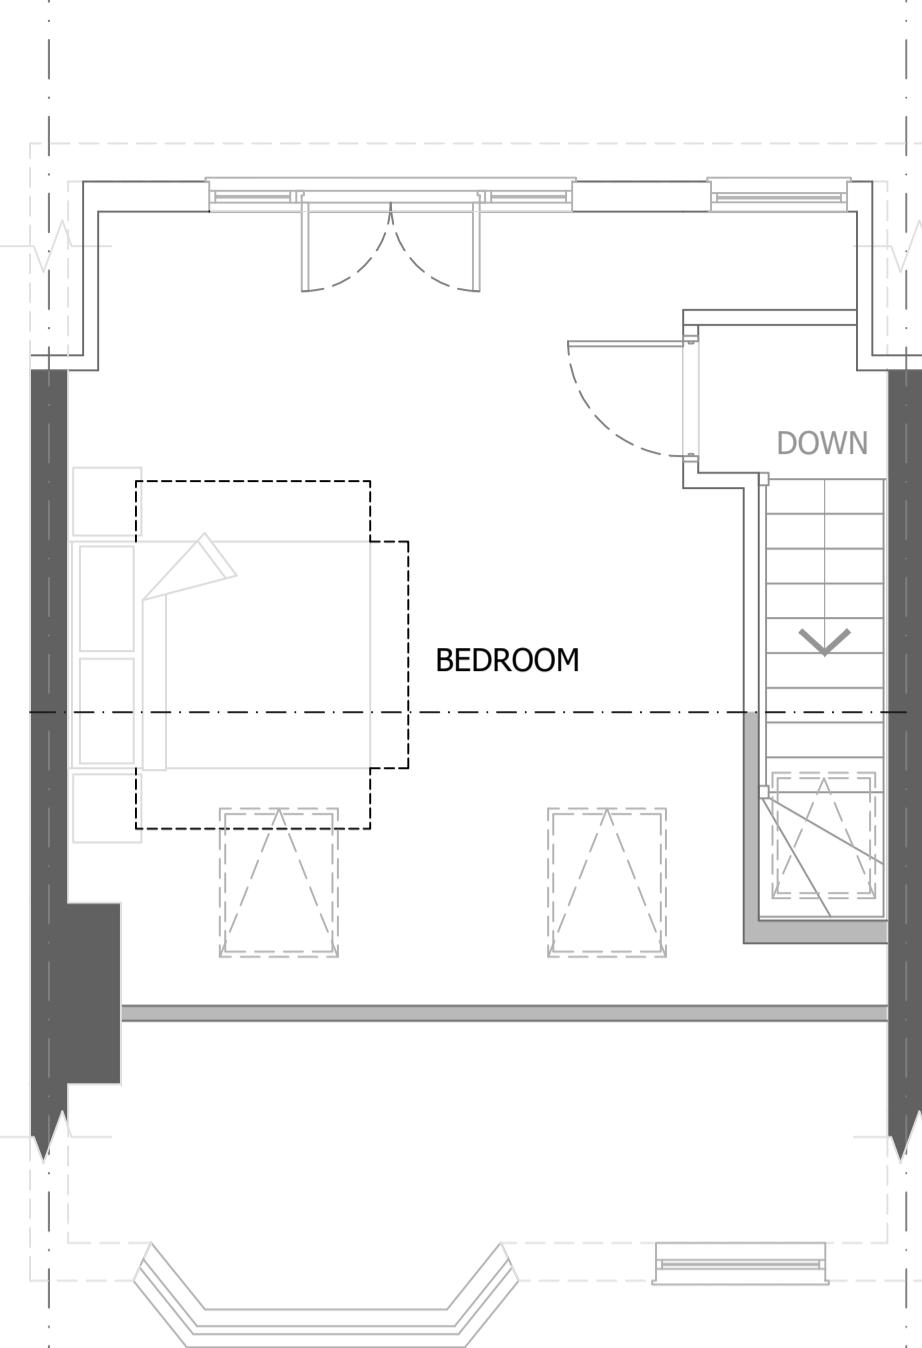


EXISTING LOFT FLOOR PLAN
1:50

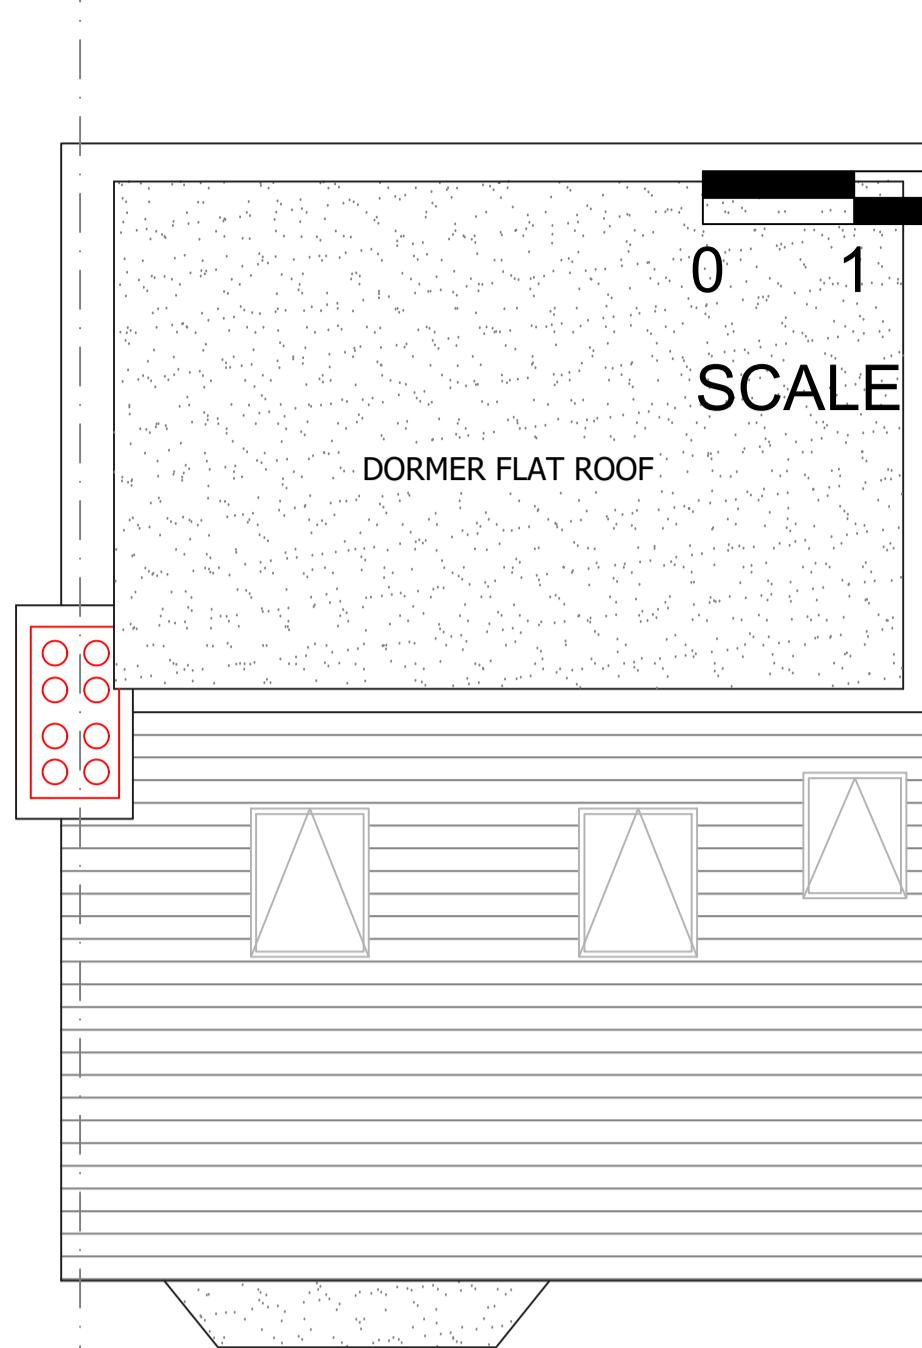


SCALE BAR 1:50


REV	DESCRIPTION	DRN	CHK	APP	DATE
 Shakthi Consulting UK Ltd					
Client: Mr Jeevanathan Thirunavukarasu					
Project: 8 Burleigh Road Uxbridge UB10 9BG					
Drawing Title: SINGLE STOREY REAR EXTENSION EXISTING & PROPOSED FLOOR PLANS					
Sheet 1 of 2					
Drawn	Name	Date	Scale 1:50 / 1:100 @ A1		
Design			File No. N/A		
Checked			Drawing Status: For Approval		
Approved					
Drawing No. CUK2021-0008_007			Revision A		

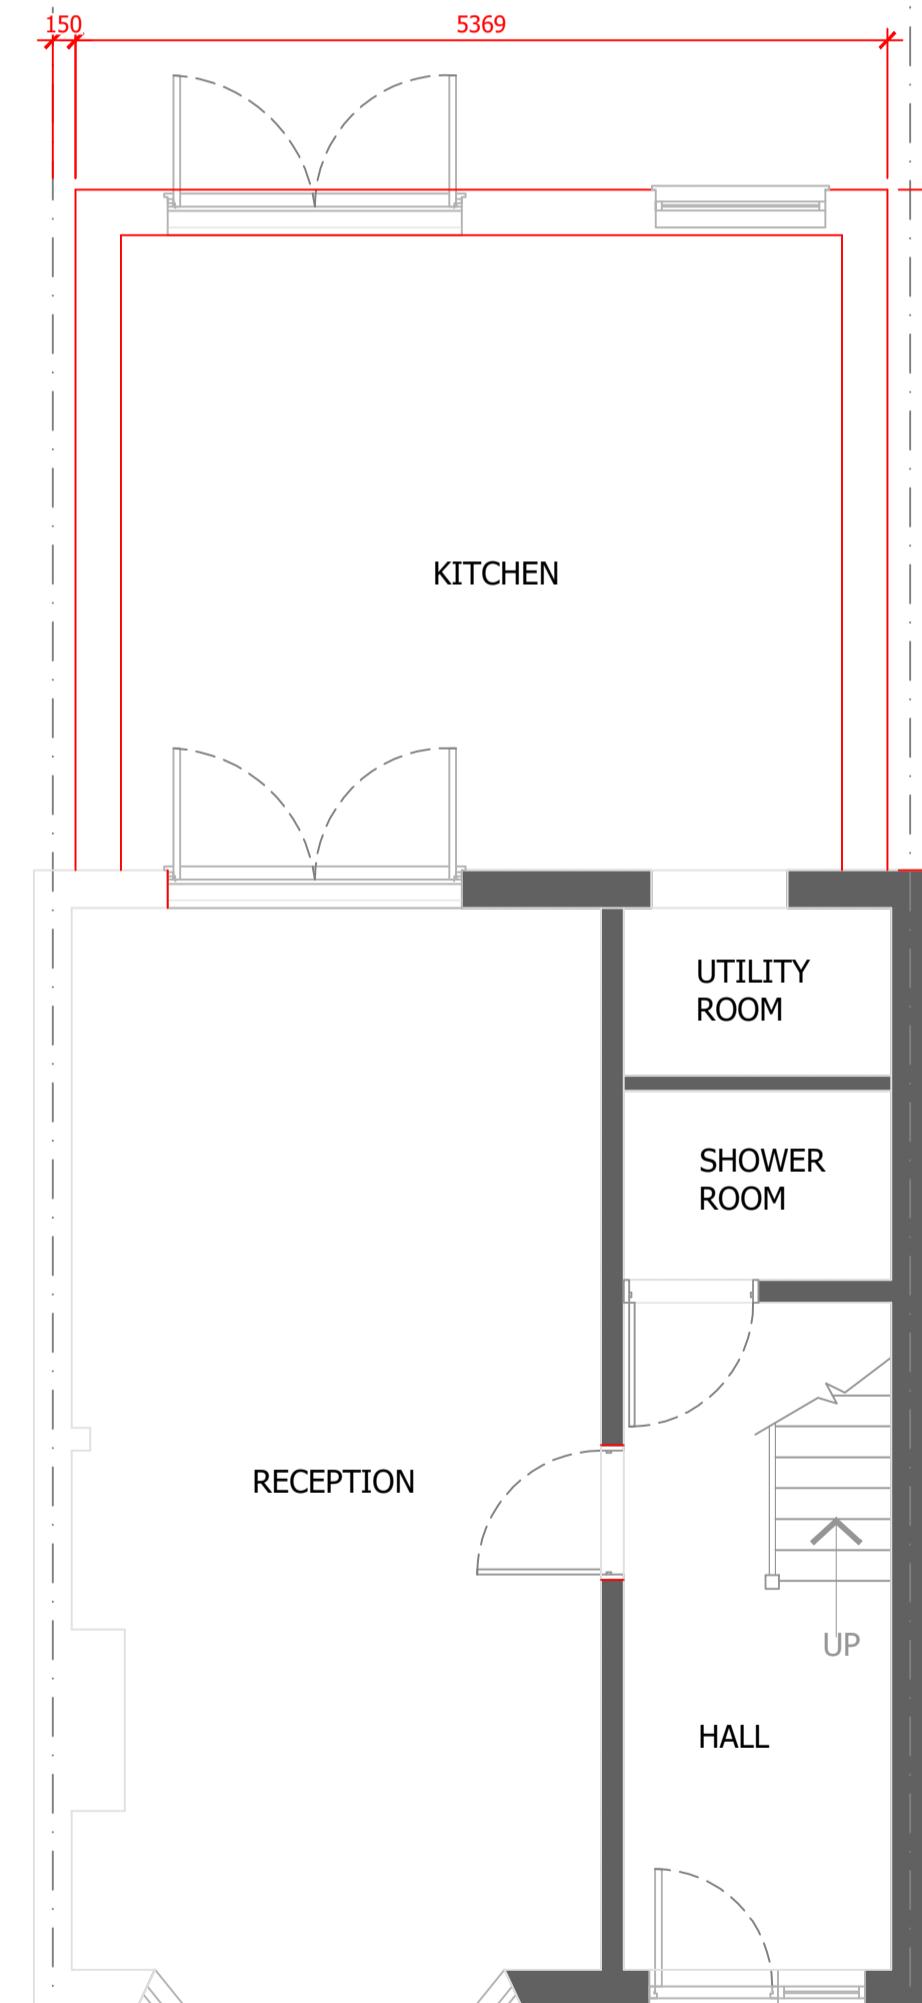

PROPOSED GROUND FLOOR PLAN
1:50

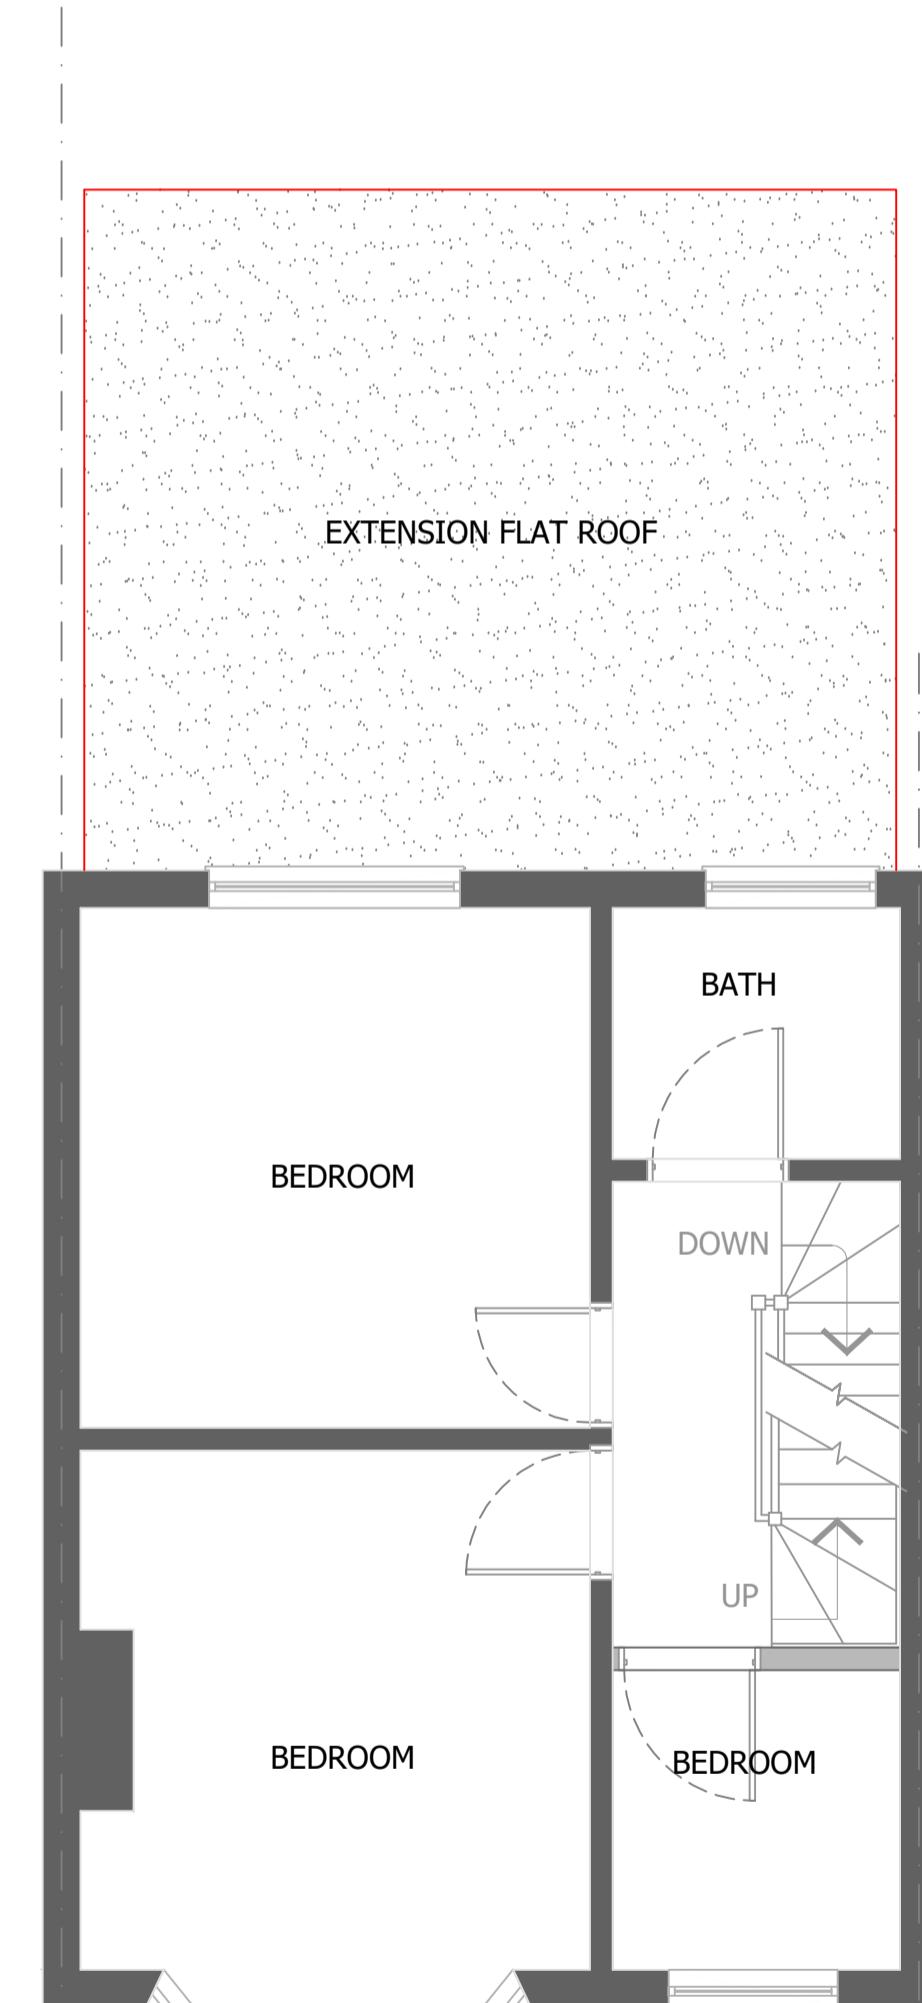

PROPOSED FIRST FLOOR PLAN
1:50

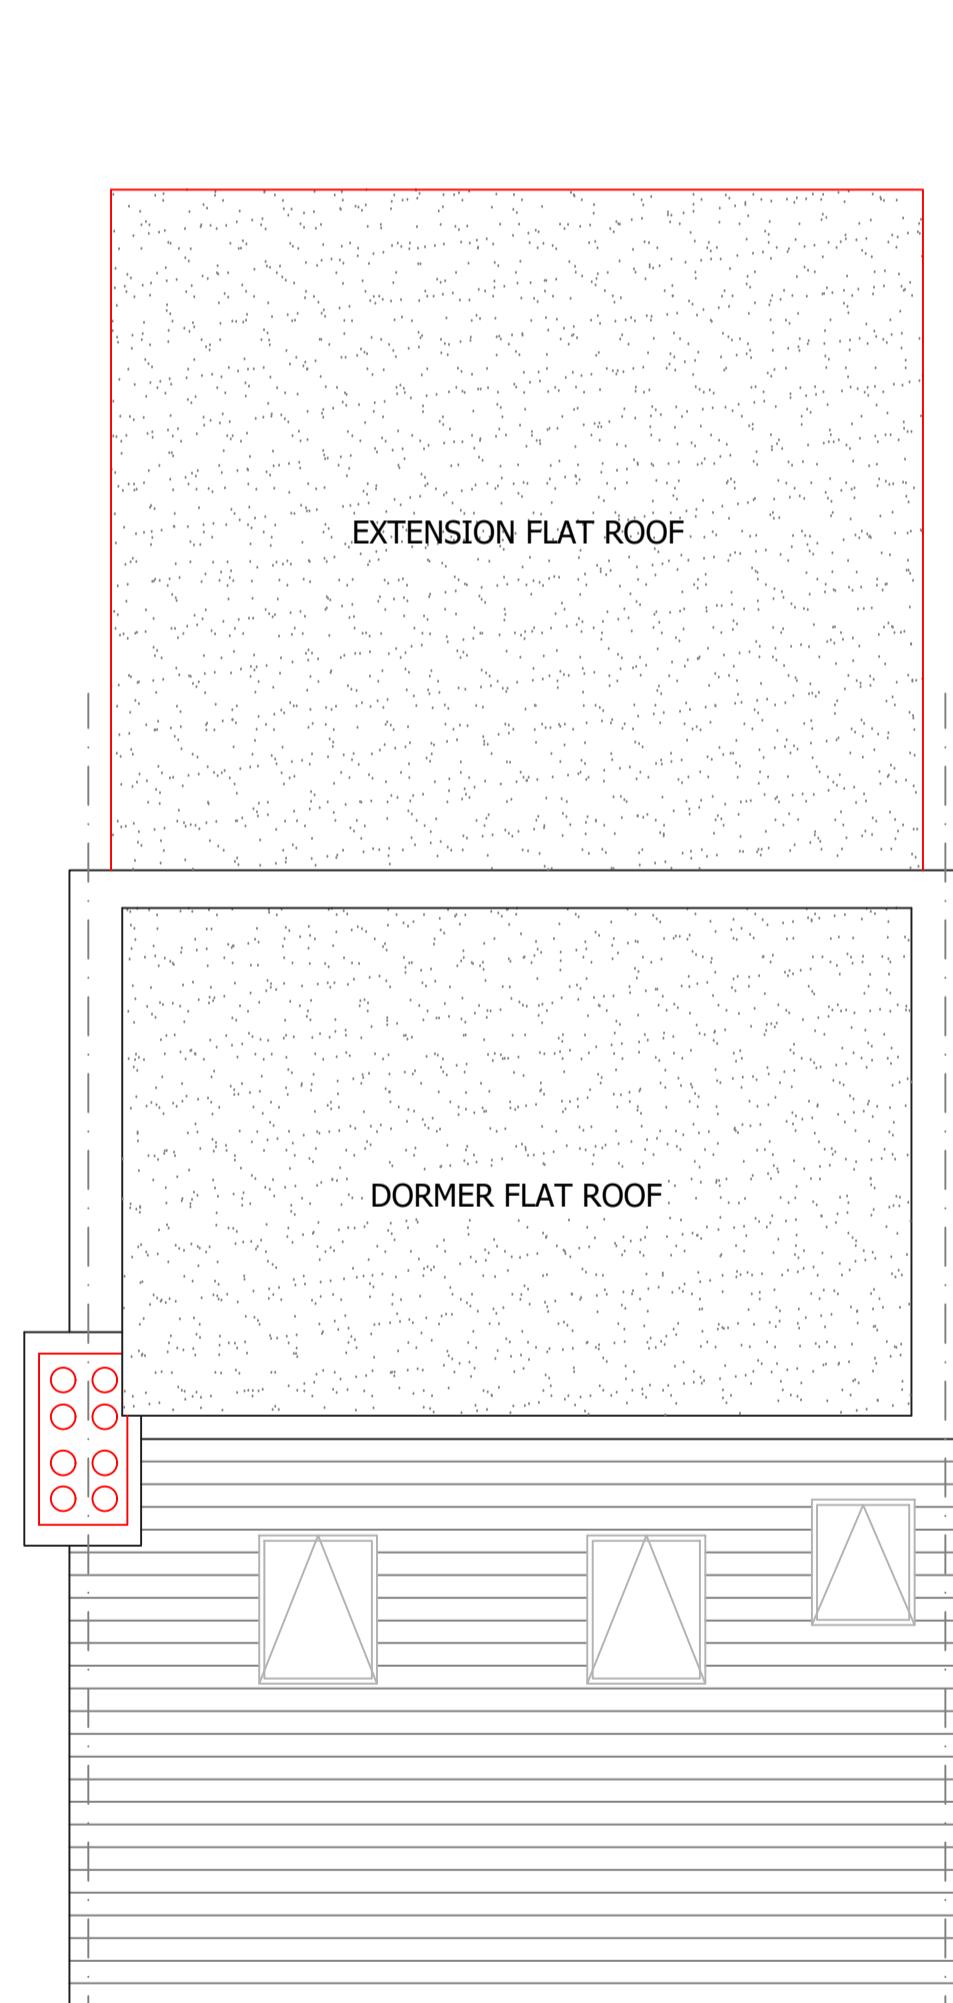

PROPOSED LOFT PLAN
1:50

GENERAL NOTES

- THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL GENERAL ARRANGEMENT DRAWINGS, PROJECT DETAILS AND SPECIFICATIONS.
- UNLESS NOTED OTHERWISE, ALL DIMENSIONS ARE TO STRUCTURAL FACES AND/OR PARTITION STUDS.
- ALL DIMENSIONS TO BE CHECKED ON SITE PRIOR TO THE FABRICATION OF ANY WORK AND/OR ORDERING ANY MATERIAL.
- STRUCTURAL ENGINEER TO CONFIRM AND PROVIDE DETAILS OF ALL STEEL BEAMS, LINTELS, MOVEMENT JOINTS AND ALL STRUCTURAL INFORMATION.
- ELECTRIC AND M&E WORK TO BE CARRIED OUT BY QUALIFIED AND REGISTERED SPECIALISTS.
- ALL DRAINAGE RUNS TO BE ABOVE FLOOR UNLESS STATED OTHERWISE.


4. ABBREVIATIONS USED:-
MJ - MOVEMENT JOINT, AAV - AIR ADMITTANCE VALVE, SVP - SOIL AND VENT PIPE
DP - DRAINAGE POINT, RWP - RAIN WATER PIPE
WI - WINDOW REFERENCE

5. LEGEND
 NEW FACING BRICKWORK TO MATCH WITH THE EXISTING.
 7.3 N/SQ. MM LOADBEARING ACRETE BLOCK (450 - 800 KG/M³) TO EXTERNAL CAVITY WALL TO CLIENTS
 SPECIFICATION. BLOCK STRENGTH TO BE CONFIRMED AND DETAILED BY THE STRUCTURAL ENGINEER

10. KITCHEN LAYOUT TO SPECIALIST'S DESIGN AND DETAILS
 11. MECHANICAL VENTILATION
 ALL EXTRACT DUCTS TO RUN BE WITHIN FLOORS AND ROOF VOID
 UNLESS STATED OTHERWISE.

12. ALL EXTERNAL MATERIALS AND DETAILS TO BE CONFIRMED BY THE END USER AND LOCAL AUTHORITY BEFORE PLACING ANY ORDER FOR MATERIALS OR COMMENCEMENT OF WORK ON SITE.

INDICATES EXTRACT LOCATION

6. — — — DENOTES STRUCTURAL STEEL BEAM/TIMBER TRIMMER OVER. ALL STEEL BEAMS TO HAVE MINIMUM 1 HOUR FIRE PROTECTION.
 WALL FOR ATTIC ROOM, EXACT SIZE OF TIMBER TO BE CONFIRMED BY ENGINEER
 DENOTES SPAN OF FLOOR OVER (TYPE STATED)
 SB - STEEL BEAM
 CSB - CRANKED STEEL BEAM
 TR - TIMBER TRIMMER

7.3 N/SQ. MM LOADBEARING ACRETE BLOCK (450 - 800 KG/M³) TO EXTERNAL CAVITY WALL TO CLIENTS
 SPECIFICATION. BLOCK STRENGTH TO BE CONFIRMED AND DETAILED BY THE STRUCTURAL ENGINEER
 50MM SOUND QUILT INSULATION TO BE FILLED AS INDICATED ON FLOOR PLANS