




0m 1m 2m 3m 4m 5m

VISUAL SCALE 1:50 @ A1

0m 2m 4m 6m 8m 10m

VISUAL SCALE 1:100 @ A1

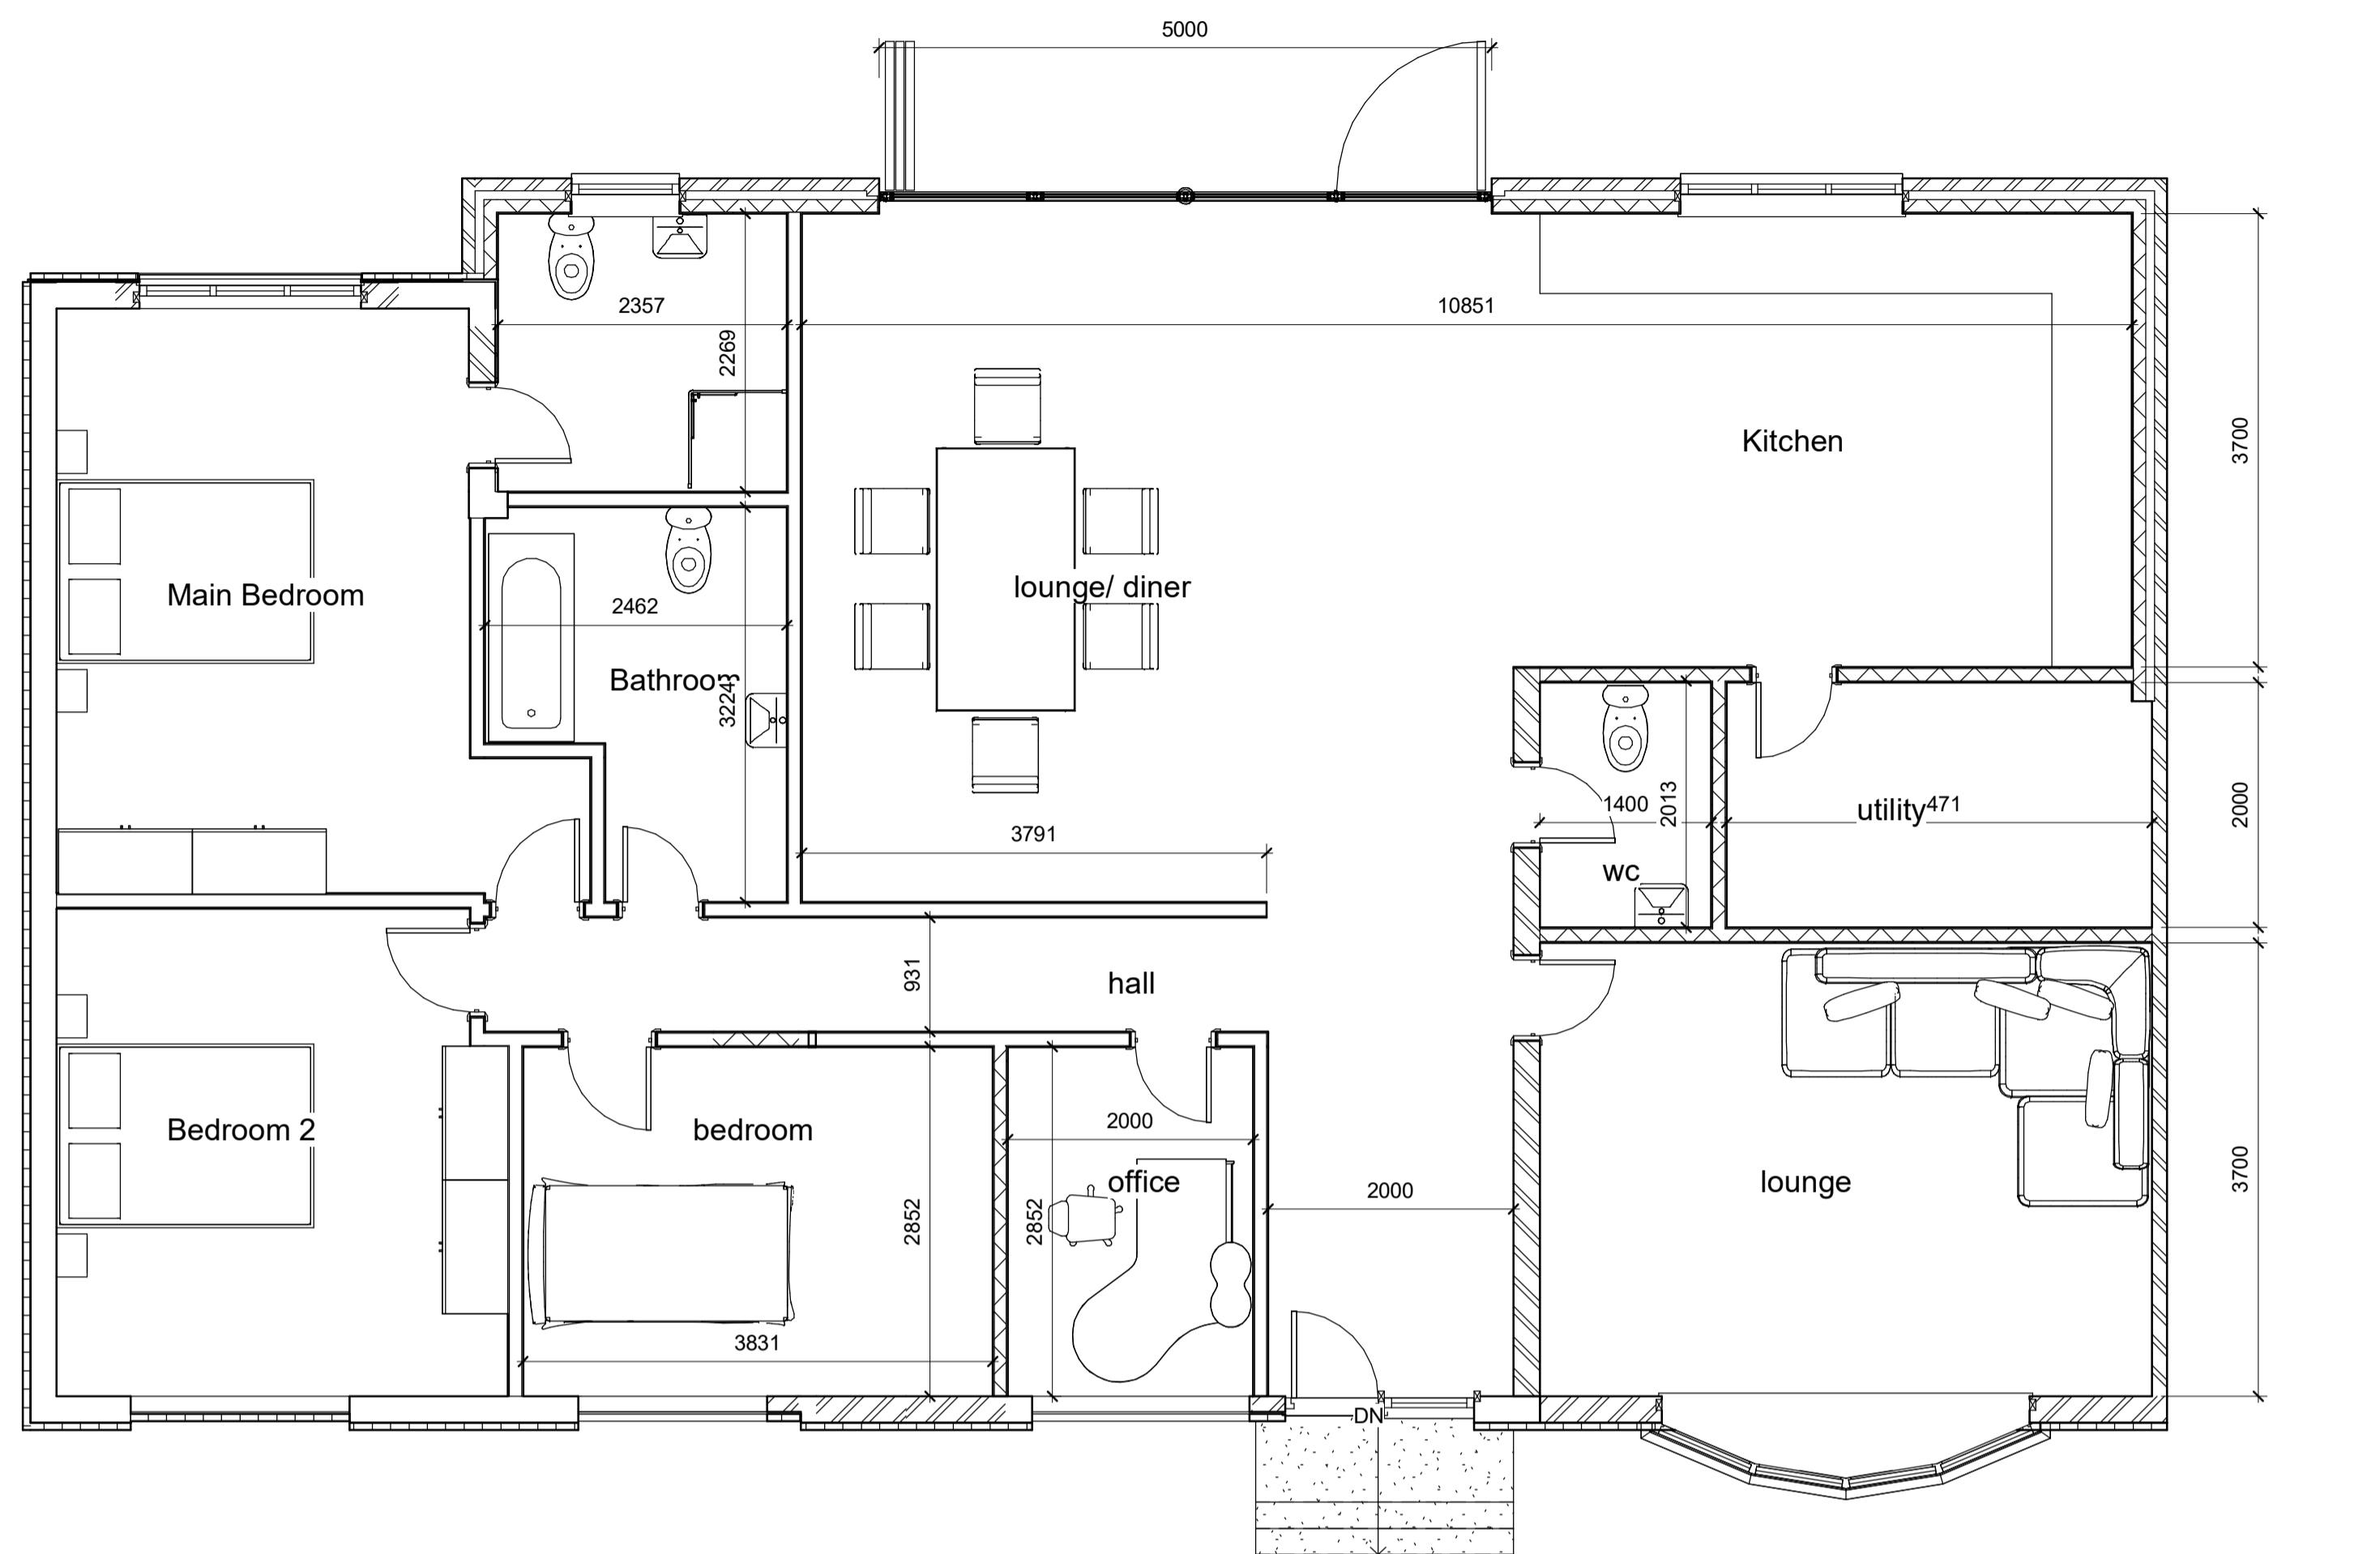


Proposed Ground Floor

1 : 50




Proposed Front Elevation

1 : 100

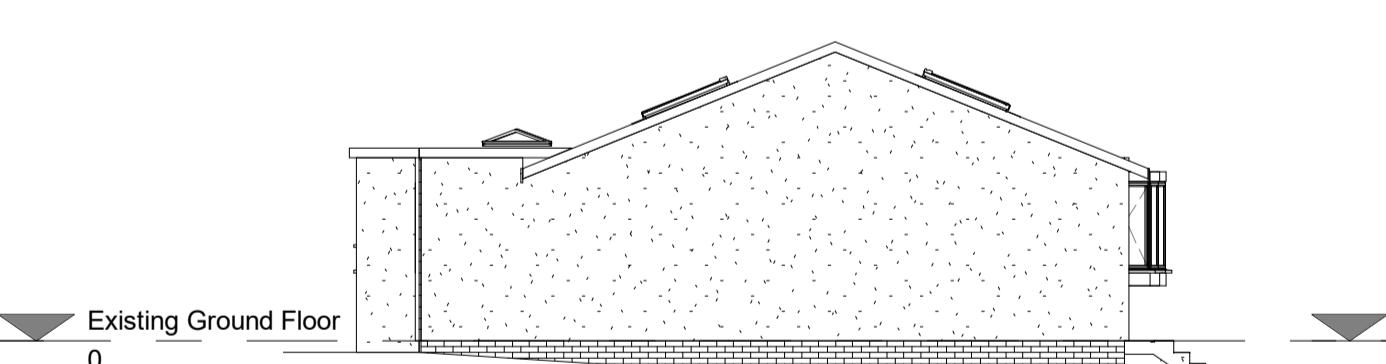


Proposed side elevation

1 : 100

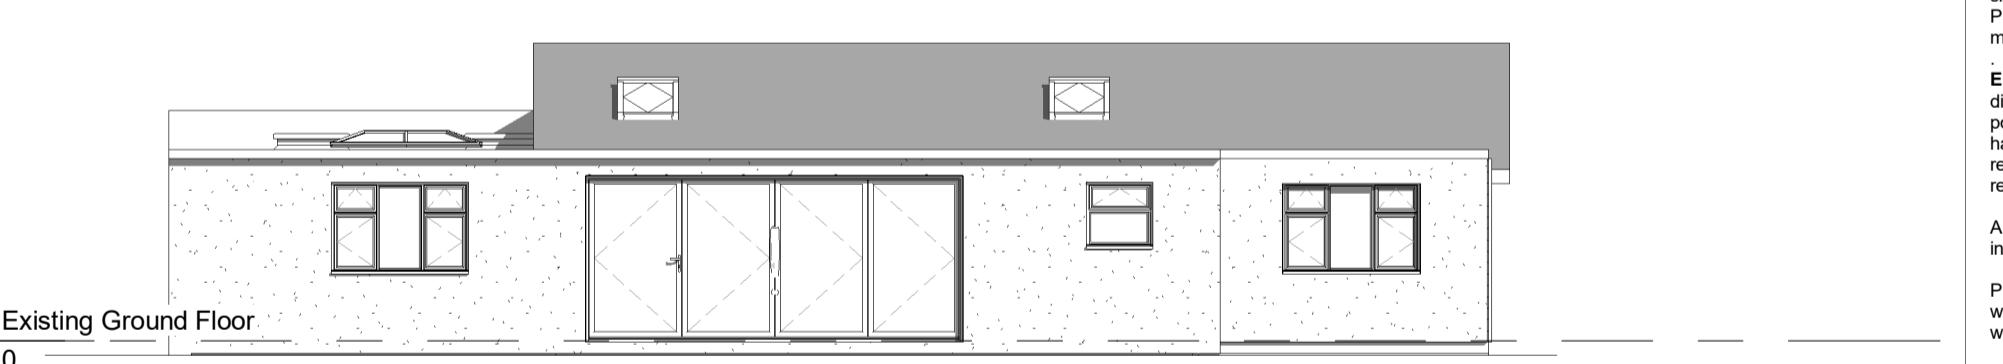


Proposed Rear Elevation

1 : 100

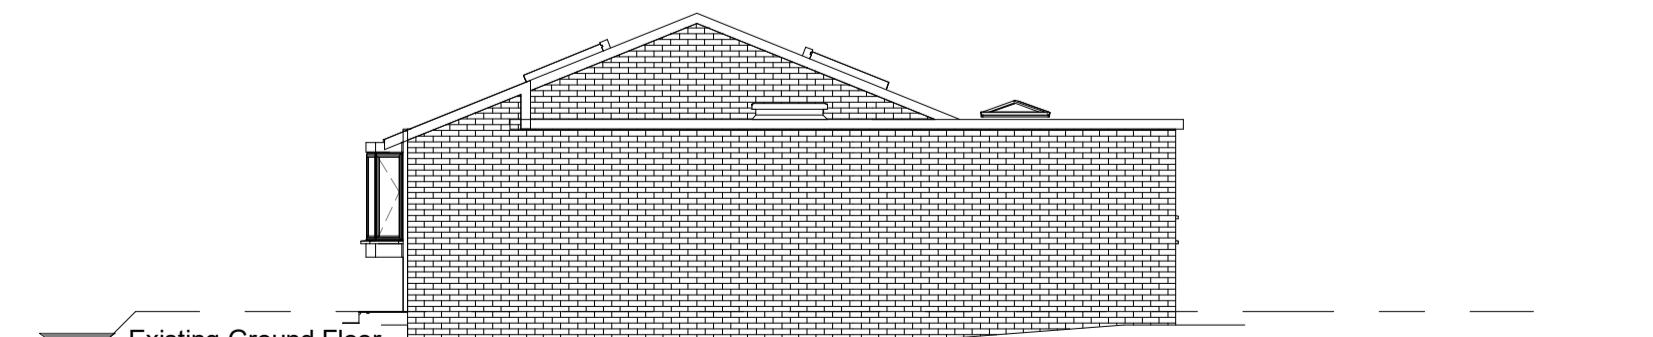

Proposed other side

1 : 100

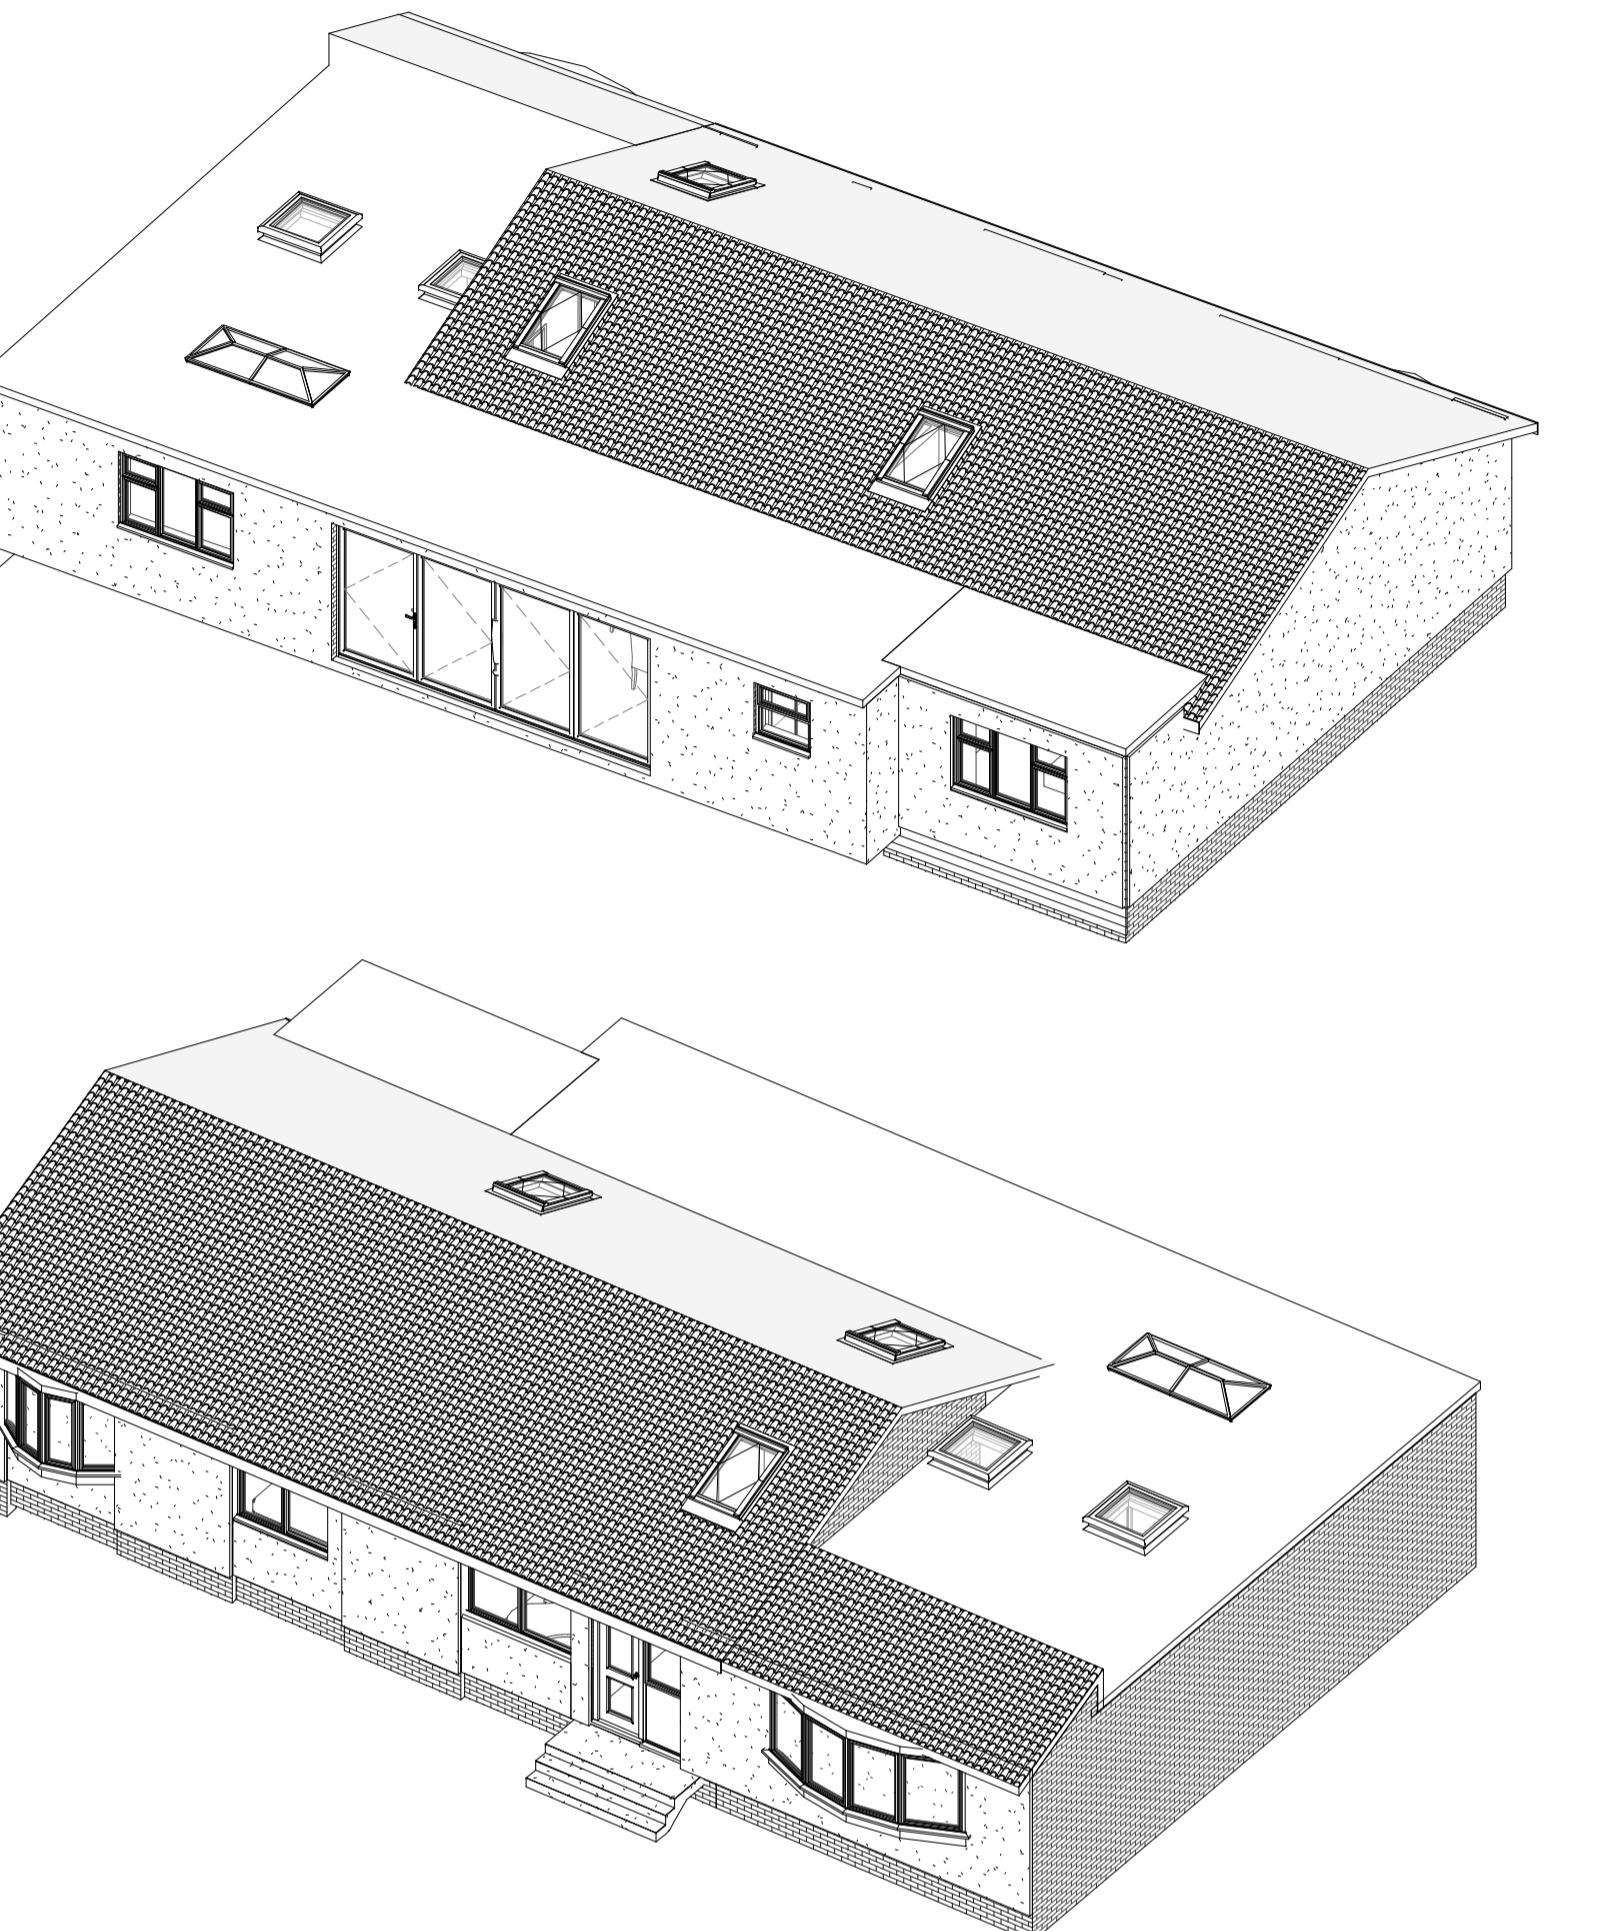

**BENJAMIN**  
ASSOCIATES LTD

Chartered  
Building  
Consultants

31 Danemead Grove  
Northolt  
Middlesex  
UB5 4NX

Tel 0208 423 0608  
Fax 0208 357 9714

[www.benjaminassociates.co.uk](http://www.benjaminassociates.co.uk)



Chartered  
Institute  
of  
Architects  
Registered Practice

GENERAL  
ALL WORK TO BE CARRIED OUT TO LOCAL AUTHORITY APPROVAL AND IN ACCORDANCE WITH THE CURRENT BUILDING REGULATIONS AND CODES OF PRACTICE  
ALL DIMENSIONS AND LEVELS TO BE CHECKED ON SITE AND ANY DISCREPANCIES TO BE REPORTED IMMEDIATELY.  
CONTRACTOR IS RESPONSIBLE FOR SETTING OUT THE WORKS  
ALL STYLING WORK TO BE CARRIED OUT IN ACCORDANCE WITH ENGINEER'S DESIGN AND DETAILS  
DO NOT SCALE DRAWINGS  
DRAWINGS PRODUCED FOR THE PURPOSE OF OBTAINING BUILDING REGULATIONS APPROVALS ONLY AND DO NOT CONSTITUTE FULL WORKING DRAWINGS  
ALL DRAWINGS ARE THE COPYRIGHT OF BENJAMIN ASSOCIATES LTD THIS DRAWING MAY NOT BE COPIED

Foundations: concrete strip foundation to be 600mm wide/width conc. mix 1:2.4. Foundation depth to be 600mm below lowest ground level or 100mm below ground level whichever is greater. Foundation to be 100mm thick and reinforced with 10mm diameter 800kg/m<sup>3</sup> Sulphate resisting cement to be used in all works below D.P.C. level. Engineering bricks below D.P.C.

Drainage: All internal pipes above ground level to be PVC sink to have 50mm dia. up to 4m length, basis to have 25mm dia up to 1.7m length, shower to have 50mm dia w.c. to have 100mm dia pipe. All traps to be 50mm dia. Provide rodding eye at change of direction, ground floor w.c. to have soil stack. Soil stack terminal to be higher than any overflow of sanitary discharge. No soil pipe to be 100mm dia. Provide external surface water drains. The position of the surface water drains to be as per engineer's communication of work if not readily ascertainable and final arrangement to be agreed with L.A. surveyor.

Ventilation: Rapid ventilation to all habitable rooms and sanitary accommodation if separate from bathroom to be minimum 1/20th of floor area.  
Background ventilation to all habitable rooms to have 8000 sq mm kitchen to have 4000 sq mm sanitary accommodation to have 4000 sq mm.  
Mechanical extract ventilation - kitchen to have 30 litres/sec. in adjacent to hob. 60 litres/sec down the chimney and up the chimney to extract fan capable of extracting 15 litres/sec with 15 minutes overrun connected to light switch.

Doors and windows: all new external doors and windows to be aluminium double glazed with night ventilation of minimum area 100sq mm.  
All new doors & side panels to have safety laminated glazing between finished floor level and 1500mm above that level. Windows and partitions to have laminated glazing between finished floor level and 800mm above that level.  
Habitable room must have emergency egress window of opening minimum 450mm wide and 700mm high.

All double glazed windows to 28mm with 6.4mm outer laminated glass and inner 4mm clear glass. 17.8mm air gap, argon filled and a "soft" low-E coating. Double glazed unit to achieve "U" value of at least 1.6W/m<sup>2</sup>K. Windows to comply with L.A. 2008.

Floor: 75mm 1:4 cement/sand screed with 10mm crack width. 200kg bags per square metre. Repoint between 10mm thick screed and 10mm thick slab. 10mm thick PVA fabric 0.33 m<sup>2</sup> to 150mm dia pipe to achieve U-value 0.221 (as in accordance with manufacturer's instructions) on 150mm thick RC (A142 mesh) FND2 conc. slab on 1200 granular pumice P.M on 50mm sand blinding on compacted Type 1 granular fill hardcore. Slab to be thickened below external walls. 25mm thick insulation to be applied to slab. 10mm thick PVA fabric 0.33 m<sup>2</sup> to 150mm thick Polystyrene brought up to edges of slab to LAP D.P.C. in walls and all joints lapped and sealed.

Wall: To achieve minimum U value of 0.28W/m<sup>2</sup>K.  
New cavity wall to comprise 10mm facing brick to match existing. Fill the cavity with 100mm Rockwool Cavity insulation as manufacturer's details. Inner leaf to be 100mm lightweight block, K value 0.16. (Aercrete, Celcon solid, Topblock profile standard). Internal finish to be 12.5mm plasterboard on dabs. Walls to be built with 1:16 cement mortar.

Wall ties to be 10mm diameter stainless steel evenly spaced at 750mm centres horizontally staggered in alternate courses at 750mm centres vertically. Provide additional tie beneath the lowest row of insulation bats and double at reveals.

Stud partition to 50 x 100 studs at 400cc with 12.5mm plaster board skin finished. 50x100mm base plate of stud partition supported on floors joists with 50 x 100 nogging@ 400 c/c void with partition filled with rockwool rollbatts.

Damp Proof Course: Hessian based felt or similar horizontal and vertical D.P.C. to walls D.P.C. 150mm minimum above all adjoining ground level. D.P.C. under window cill and reveals. All damp proof elements to be lapped and bonded with existing D.P.C.

Flat Roof (Warm): (imposed load max 1.0 kN/m<sup>2</sup>, dead load max 0.75 kN/m<sup>2</sup>)  
Electrical: PVC cables should be buried in the screed. All cables to be in direct contact with any expanded polystyrene insulation. recessed fittings designed for compact fluorescent or low voltage tungsten halogen lamps should only be used within enclosure, set between the joists, to dissipate heat. If recessed light fittings are used, ensure that the floor maintains a full half hour period of fire resistance.

All electrical works required to meet the provision of part P (electrical safety) must be designed, installed, inspected and tested by a person competent to do so.  
Prior to electrical completion the council should be satisfied that the part P has been completed with a person competent to do so.

Lighting and electrical works: Lighting to new extension and loft conversion to be efficient lighting that only uses lamps of luminous efficiency greater than 40 luminous per circuit-watt. All electrical works must be designed, installed, inspected and tested by a competent person to do so.

Client Mr M Dore

Address 20 Curzon Place  
Pinner  
Middlesex  
HA5 2TQ

Project name Single storey rear  
extension and Garage  
conversion

Project number 20CUR/023

Date February 2023

Drawn by M.Benjamin

Checked by MSB

Sheet number A102

Scale As indicated